

Durbin Law Offices, P.L.L.C.
144 Washington Street
P.O. Box 1222
Portsmouth, NH 03802
www.durbinlawoffices.com



Derek R. Durbin, Esq.
603.287.4764
derek@durbinlawoffices.com
**Also admitted in MA*

BY: VIEWPOINT & HAND DELIVERY

January 27, 2021

City of Portsmouth
Zoning Board of Adjustment
1 Junkins Avenue
Portsmouth, NH 03801

**RE: Variance Application of SAI Builders LLC
27 Elwyn Avenue, Tax Map 113, Lot 28-1**

Dear Chairman Rheaume,

Our Office represents SAI BUILDERS LLC. Attached herewith, please find the following materials for submission to the Zoning Board of Adjustment for consideration at its next regularly scheduled meeting:

- 1) Landowner Letter of Authorization;
- 2) Narrative to Variance Application with Exhibits A and B;
- 3) Plan Set (Site Plan, Floor Plans and Elevations);
- 4) Photographs of the Property; and
- 5) Tax Map Image of the Property.

Twelve (12) copies of the application submission are being delivered to the City on this date. Should you have any questions or concerns regarding the enclosed application materials, do not hesitate to contact me at your convenience.

Sincerely,

A handwritten signature in black ink, appearing to read 'Derek R. Durbin', written over a horizontal line.

Derek R. Durbin, Esq.

LETTER OF AUTHORIZATION

SAI Builders LLC, of 12 Industrial Way, Salem, New Hampshire 03079, the owner of the property located at 27 Elwyn Avenue, Portsmouth, NH 03801 (the "Property"), hereby authorizes Durbin Law Offices PLLC to act as his agent and representative in connection with any building, zoning, planning or other municipal permit applications filed with the City of Portsmouth for said Property. Said Letter of Authorization shall be valid until expressly revoked in writing.



Printed Name: Anton J. Miller
Duly Authorized

1/25/2021
Date

**CITY OF PORTSMOUTH
ZONING BOARD OF ADJUSTMENT
APPLICATION NARRATIVE**

SAI Builders LLC
(Owner/Applicant)
Tax Map 113, Lot 28-1
27 Elwyn Avenue
Portsmouth, NH 03801

INTRODUCTORY STATEMENT

Background

SAI Builders LLC (the “Applicant”) is the owner of property located at 27 Elwyn Avenue, identified on Portsmouth Tax Map 113, as Lot 28-1 (the “Property”). The Property is located within Portsmouth’s General Residence A (“GRA”) Zoning District.

The Property contains a newly constructed single-family home on a non-conforming lot of record. The Property has 4,996 square feet of lot area where 7,500 square feet is the minimum required and 50 feet of road frontage where 100’ is required. On September 24, 2019, the Zoning Board of Adjustment (the “Board”) granted the requisite lot area per dwelling unit and frontage relief to allow for the construction of the existing single-family home. The Applicant took great care in choosing and constructing a home design that would be in keeping with the neighborhood and that would respect the required zoning setbacks despite the small size of the lot.

What the Applicant failed to consider or realize when presenting its zoning application to the Board on September 24, 2019 is that an AC condenser unit is considered be a “structure” under current zoning which would require relief if located within a required setback. Upon learning of this, well after the home was substantially complete, it applied for a 5.7’ right yard setback variance to install two (2) Amana ASX Condenser Units within this area of the Property. Exhibit A. That relief was denied by the Board on November 17, 2020.

At the public hearing of November 17, 2020, the abutting property owner to the right, nearest to the proposed AC condenser units objected to the variance as a result of its proximity to certain windows of her home and the potential noise it would project into her residence during the summer months if only setback 5.7’. Echoing the concerns of the abutter about location, the Board denied the right yard setback variance sought by the Applicant.

After the November 17, 2020 hearing, the Applicant’s representatives met with the affected abutter to discuss alternatives. The abutter and the Applicant were able to reach an agreement following this meeting. As a result of this agreement, the Applicant is proposing to install a different, smaller AC condensing units that will run quieter than the Amana ASX Condenser Units previously proposed. Exhibit B. The location of the newly proposed condensing units will be different than the prior location. The alternative plan allows for the right yard setback relief to be reduced from 5.7’ to 8’, thus addressing and mitigating the concerns previously expressed by the

affected abutter and the Board. For these reasons, the application is materially different than the prior application before the Board, thus satisfying the *Fisher v. Dover* test. Moreover, it meets the five (5) criteria for granting the variance relief sought.

SUMMARY OF VARIANCE RELIEF

The Applicant seeks the following variance from the Board:

Section 10.521: To allow a 8' (+/-) right yard setback where 10' is required by the Ordinance.

VARIANCE CRITERIA

Granting the variances will not be contrary to the public interest and will observe the spirit of the Ordinance.

“There are two methods of ascertaining whether granting a variance would violate an ordinance’s basic zoning objectives: (1) examining whether granting the variance would alter the essential character of the neighborhood or, in the alternative; and (2) examining whether granting the variance would threaten the public health, safety, or welfare.” *Harborside Assoc v. Parade Residence Hotel*, 162 N.H. 508, 514 (2011).

Many of the existing houses and accessory structures in the neighborhood do not comply with current zoning setback standards due to the small lot sizes and constrained building envelopes. The goal of GRA Zoning is “to provide areas for **single-family, two family and multifamily dwellings**, with appropriate **accessory uses**, at moderate to high densities...[.]” With the increasingly hot summers that New England is experiencing, having central air conditioning is important to homebuyers. It improves the comfort, functionality, and value of a home. The proposed condensing units and related appurtenances will occupy an area of only 26 square feet and will be setback far enough that they will not negatively impact the abutter’s use and enjoyment of their property. The appearance of the house will remain consistent with the character of the neighborhood. The location and specifications of the condensing units are not inconsistent with or more impactful than most if not all other related proposals that the Board has considered and approved in recent years. Therefore, it is reasonable for the Board to conclude that granting the variance will not be contrary to the public interest and will observe the spirit of the Ordinance.

Substantial justice will be done by granting the variance relief.

Any loss to the individual that is not outweighed by a gain to the general public is an injustice. *New Hampshire Office of State Planning, The Board of Adjustment in New Hampshire, A Handbook for Local Officials* (1997); *Malachy Glen Assocs., Inc. v. Town of Chichester*, 155 N.H. 102 (2007).

The application involves a small request for relief from the dimensional requirements of the Ordinance that addresses concerns raised by the only impacted abutter. The proposed condensing units are consistent with the evolving needs and expectations of today's homebuyers. If the relief were denied, the comfort and desirability of the home would be diminished and there would be no offsetting gain realized by the public. As such, it is reasonable for the Board to conclude that substantial justice is done by granting the variance.

The values of surrounding properties will not be diminished by granting the variance relief.

The proposed condensing units will be inconspicuously located away from the streetscape and will not alter the essential character of the neighborhood. Central air conditioning will raise the value of the existing house which can only help maintain or increase the values of other properties in the neighborhood. It is reasonable for the Board to conclude that the values of surrounding properties will not be diminished by granting the variance relief.

Literal enforcement of the provisions of the Ordinance would result in an unnecessary hardship.

The Property, while not substantially different in size from other parcels within the surrounding neighborhood at 4,996 square feet, is a non-conforming lot of record that was vacant land until very recently. This makes it distinguishable from other surrounding properties, most of which contain dwellings and accessory structures that were constructed prior to current GRA setback and other zoning restrictions. Being an approximately 50' x 100' lot, the Property has a small building envelope that restricts what can be constructed on it without infringing upon one or more setbacks or exceeding the lot coverage restriction. The home itself meets the setback regulations. There are very few properties within the surrounding area where the buildings conform to current zoning.

In addition, it is important to consider the context of the "structure(s)" proposed within the setback. In the present instance, the Applicant is proposing two (2) small condensing units with related appurtenances that will occupy only 26 square feet of area. Unlike an accessory building such as a shed or garage or the addition to a home, it will not impose the same light, air and space concerns as a traditional *structure* would. For the foregoing reasons, there is no fair and substantial relationship between the general purposes of the Ordinance provisions and their application to the Property. Furthermore, the use of the Property is reasonable. The Applicant chose a system that operates more quietly than the system previously proposed. The location of the proposed condensing units is the result of an agreement with the nearest affected abutter.


CONCLUSION

In conclusion, the Applicant has demonstrated that it meets the five (5) criteria for granting each of the variances requested. Accordingly, it respectfully requests that the Board approve its Variance Application.

Dated: January 27, 2021

Respectfully Submitted,

SAI BUILDERS LLC




By: Derek R. Durbin, Esq.
DURBIN LAW OFFICES PLLC
144 Washington Street
Portsmouth, NH 03801
(603)-287-4764
derek@durbinlawoffices.com



ASX13

COOLING CAPACITY: 17,800 - 56,500 BTU/H

ENERGY-EFFICIENT
SPLIT SYSTEM AIR CONDITIONER
UP TO 14 SEER / 12 EER

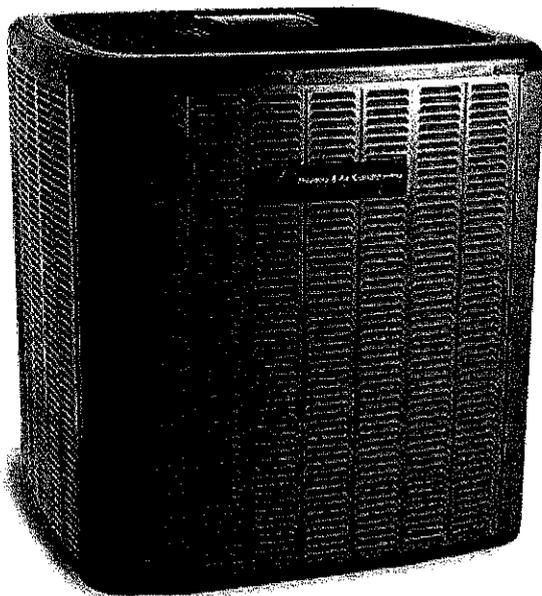

Contents

Nomenclature 2
 Product Specifications 3
 Expanded Cooling Data 4
 Dimensions 22
 Wiring Diagrams 23
 Accessories 25

Standard Features

- Energy-efficient scroll compressor
- High-density foam compressor sound blanket
- Copeland® ComfortAlert™ diagnostics
- Factory-installed filter drier
- Copper tube / enhanced aluminum fin coil
- Sweat connection service valves with easy access to gauge ports
- Contactor with lug connection
- Ground lug connection
- AHRI Certified; ETL Listed


Cabinet Features

- Heavy-gauge, galvanized-steel cabinet with sound control top design
- Attractive Architectural Gray powder-paint finish with 500-hour salt-spray approval
- Wire fan discharge grille
- Steel louver coil guard
- Compact footprint
- Top and side maintenance access
- Single-panel access to controls with space provided for field-installed accessories



* Complete warranty details available from your local dealer or at www.amana-hac.com. To receive the 2-Year Unit Replacement Limited Warranty and 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Quebec.

NOMENCLATURE

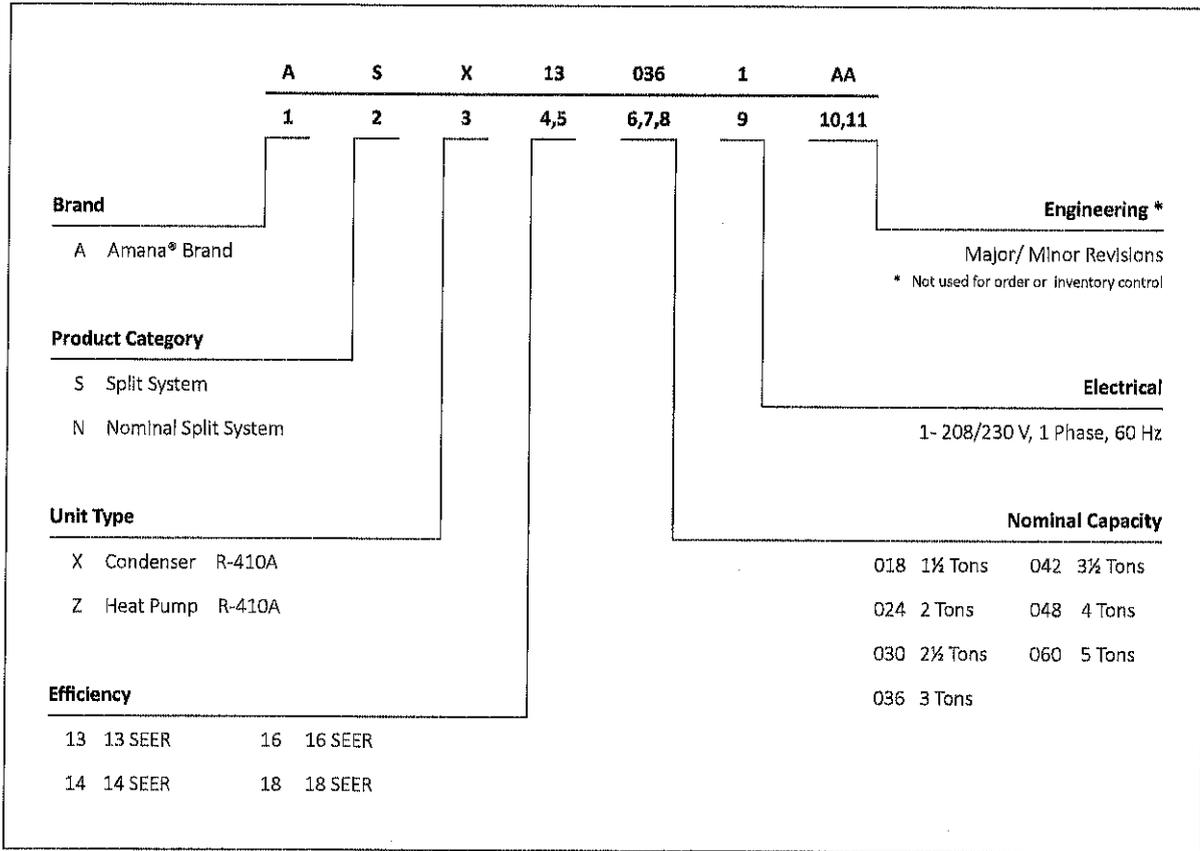

	ASX13 0181D	ASX13 0241C	ASX13 0301C	ASX13 0361D	ASX13 0421C	ASX13 0481C	ASX13 0601C	ASX13 0611A*
CAPACITIES								
Nominal Cooling (BTU/h)	17,800	23,000	28,400	33,600	40,000	46,000	57,000	56,500
SEER / EER	13 / 11	13 / 11	13 / 11	13 / 11	13 / 11	13 / 11	13 / 11	13 / 11
Decibels	75	75	73	74	75	76	77	77
COMPRESSOR								
RLA	9.0	13.5	12.8	14.1	17.9	19.9	25.0	26.4
LRA	48	58.3	64	77	112	109	134	134
CONDENSER FAN MOTOR								
Horsepower	1/8	1/8	1/8	1/4	1/4	1/4	1/4	1/4
FLA	0.7	0.7	0.7	1.4	1.3	1.3	1.3	1.3
REFRIGERATION SYSTEM								
Refrigerant Line Size								
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	3/4"	3/4"	7/8"	1 1/8"	1 1/8"	1 1/8"	7/8"
Refrigerant Connection Size								
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.) ^{3 4}	3/4"	3/4"	3/4"	3/4" ⁴	3/4" ⁵	3/4" ⁵	3/4" ⁵	3/4"
Valve Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	69	60	60	62	80	91	94	111
Shipped with Orifice Size	0.051	0.057	0.061	0.070	0.076	0.080	0.086	0.086
ELECTRICAL DATA								
Voltage / Phase (60 Hz)	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1
Minimum Circuit Ampacity ¹	12	17.6	16.7	19.0	23.7	26.2	32.6	34.3
Max. Overcurrent Protection ²	20	30	25	30	40	45	50	60
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
Equipment Weight (lbs)	102	115	115	118	171	175	184	211
Ship Weight (lbs)	117	128	132	135	189	193	202	233

¹ Line sizes denoted for 25' line sets, tested and rated in accordance with AHRI Standard 210/240. For other line-set lengths or sizes, refer to the Installation & Operating instructions and/or the long line-set guidelines.

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes.

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

⁴ Installer will need to supply 3/4" to 7/8" adapters for suction line connections.

⁵ Installer will need to supply 3/4" to 1 1/8" adapters for suction line connections.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.
- This product may not be installed in the Southeast (including Hawaii) or Southwest Regions as of Jan. 1, 2015.

IDB		OUTDOOR AMBIENT TEMPERATURE																											
		65				75				85				95				105				115							
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
		ENTERING INDOOR WET BULB TEMPERATURE																											
		AIRFLOW																											
70	MBh	15.8	16.4	17.9	-	15.4	16.0	17.5	-	15.1	15.6	17.1	-	14.7	15.2	16.7	-	14.0	14.5	15.9	-	14.0	14.5	15.9	-	12.9	13.4	14.7	-
	S/T	0.67	0.56	0.39	-	0.69	0.58	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.76	0.63	0.44	-	0.77	0.64	0.44	-
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-
	kW	1.27	1.30	1.34	-	1.36	1.39	1.43	-	1.44	1.47	1.51	-	1.51	1.54	1.59	-	1.57	1.60	1.65	-	1.57	1.60	1.65	-	1.62	1.65	1.71	-
	Amps	4.6	4.7	4.8	-	4.9	5.0	5.2	-	5.3	5.5	5.6	-	5.7	5.8	6.0	-	6.0	6.2	6.4	-	6.0	6.2	6.4	-	6.4	6.6	6.8	-
HI PR	203	218	230	-	228	245	259	-	259	279	294	-	295	317	335	-	332	357	377	-	332	357	377	-	366	394	416	-	
LO PR	103	109	119	-	109	116	126	-	113	120	131	-	119	126	138	-	124	132	144	-	124	132	144	-	129	137	149	-	
70	MBh	17.1	17.7	19.4	-	16.7	17.3	19.0	-	16.3	16.9	18.5	-	15.9	16.5	18.1	-	15.1	15.7	17.2	-	15.1	15.7	17.2	-	14.0	14.5	15.9	-
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.41	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.79	0.66	0.46	-	0.79	0.66	0.46	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
	kW	1.30	1.33	1.37	-	1.39	1.42	1.46	-	1.48	1.51	1.55	-	1.55	1.58	1.63	-	1.61	1.64	1.69	-	1.61	1.64	1.69	-	1.66	1.70	1.75	-
	Amps	4.7	4.8	5.0	-	5.1	5.2	5.3	-	5.5	5.6	5.8	-	5.9	6.0	6.2	-	6.2	6.4	6.6	-	6.2	6.4	6.6	-	6.6	6.7	7.0	-
HI PR	209	225	238	-	235	252	267	-	267	287	303	-	304	327	345	-	342	368	389	-	342	368	389	-	378	407	429	-	
LO PR	106	113	123	-	112	119	130	-	116	124	135	-	122	130	142	-	128	136	149	-	128	136	149	-	133	141	154	-	
70	MBh	17.6	18.3	20.0	-	17.2	17.9	19.6	-	16.8	17.4	19.1	-	16.4	17.0	18.6	-	15.6	16.2	17.7	-	15.6	16.2	17.7	-	14.4	15.0	16.4	-
	S/T	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.77	0.64	0.45	-	0.80	0.66	0.46	-	0.83	0.69	0.48	-	0.83	0.69	0.48	-	0.83	0.70	0.48	-
	ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-
	kW	1.31	1.34	1.38	-	1.40	1.43	1.48	-	1.49	1.52	1.56	-	1.56	1.59	1.64	-	1.62	1.65	1.71	-	1.62	1.65	1.71	-	1.67	1.71	1.76	-
	Amps	4.7	4.8	5.0	-	5.1	5.2	5.4	-	5.5	5.7	5.8	-	5.9	6.0	6.2	-	6.3	6.4	6.6	-	6.3	6.4	6.6	-	6.6	6.8	7.0	-
HI PR	211	227	240	-	237	255	269	-	270	290	306	-	307	330	349	-	345	372	392	-	345	372	392	-	382	411	434	-	
LO PR	107	114	124	-	113	120	131	-	118	125	137	-	123	131	143	-	129	138	150	-	129	138	150	-	134	142	155	-	
75	MBh	16.1	16.5	17.9	19.2	15.7	16.2	17.5	18.8	15.3	15.8	17.1	18.3	15.0	15.4	16.7	17.9	14.2	14.6	15.8	17.0	14.2	14.6	15.8	17.0	13.2	13.5	14.7	15.7
	S/T	0.76	0.68	0.51	0.33	0.79	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.38	0.86	0.77	0.58	0.38	0.87	0.78	0.59	0.38
	ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	21	20	16	11	21	20	16	11	20	18	15	10
	kW	1.28	1.31	1.35	1.39	1.37	1.40	1.44	1.49	1.45	1.48	1.53	1.57	1.52	1.55	1.60	1.65	1.58	1.62	1.67	1.72	1.58	1.62	1.67	1.72	1.63	1.67	1.72	1.77
	Amps	4.6	4.7	4.9	5.0	5.0	5.1	5.2	5.4	5.4	5.5	5.7	5.9	5.7	5.9	6.1	6.3	6.1	6.3	6.5	6.7	6.1	6.3	6.5	6.7	6.5	6.6	6.8	7.1
HI PR	205	220	233	243	230	247	261	272	261	281	297	310	298	320	338	353	335	361	381	397	335	361	381	397	370	398	421	439	
LO PR	104	111	121	128	110	117	127	136	114	121	132	141	120	127	139	148	126	134	146	155	126	134	146	155	130	138	151	161	
75	MBh	17.4	17.9	19.4	20.8	17.0	17.5	19.0	20.3	16.6	17.1	18.5	19.9	16.2	16.7	18.1	19.4	15.4	15.8	17.2	18.4	15.4	15.8	17.2	18.4	14.3	14.7	15.9	17.1
	S/T	0.79	0.70	0.53	0.34	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	21	19	16	11	20	18	15	10
	kW	1.31	1.34	1.38	1.42	1.40	1.43	1.48	1.52	1.49	1.52	1.56	1.61	1.56	1.59	1.64	1.69	1.62	1.65	1.71	1.76	1.62	1.65	1.71	1.76	1.67	1.71	1.76	1.82
	Amps	4.7	4.8	5.0	5.2	5.1	5.2	5.4	5.6	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.5	6.3	6.4	6.6	6.9	6.3	6.4	6.6	6.9	6.6	6.8	7.0	7.3
HI PR	211	227	240	250	237	255	269	281	270	290	306	319	307	330	349	364	345	372	392	409	345	372	392	409	382	411	434	452	
LO PR	107	114	124	132	113	120	131	140	118	125	137	145	124	131	143	153	129	138	150	160	129	138	150	160	134	142	156	166	
75	MBh	17.9	18.5	20.0	21.5	17.5	18.0	19.5	21.0	17.1	17.6	19.1	20.5	16.7	17.2	18.6	20.0	15.9	16.3	17.7	19.0	15.9	16.3	17.7	19.0	14.7	15.1	16.4	17.6
	S/T	0.82	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.94	0.84	0.64	0.41	0.94	0.84	0.64	0.41	0.95	0.85	0.64	0.41
	ΔT	20	19	15	10	20	19	15	11	20	19	15	11	21	19	16	11	20	19	15	11	20	19	15	11	19	17	14	10
	kW	1.32	1.35	1.39	1.43	1.42	1.44	1.49	1.53	1.50	1.53	1.57	1.62	1.57	1.60	1.65	1.70	1.63	1.67	1.72	1.77	1.63	1.67	1.72	1.77	1.69	1.72	1.78	1.83
	Amps	4.8	4.9	5.0	5.2	5.1	5.3	5.4	5.6	5.6	5.7	5.9	6.1	6.0	6.1	6.3	6.5	6.3	6.5	6.7	6.9	6.3	6.5	6.7	6.9	6.7	6.9	7.1	7.4
HI PR	213	230	242	253	239	258	272	284	272	293	309	323	310	334	352	368	349	375	396	413	349	375	396	413	385	415	438	457	
LO PR	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	131	139	152	162	131	139	152	162	135	144	157	167	

Amperage = outdoor unit amps (comp.+fan)
kW = Total system power

Shaded area reflects ACCA (TVA) conditions

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB		OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
		ENTERING INDOOR WET BULB TEMPERATURE																							
		AIRFLOW																							
80	MBh	16.4	16.7	17.9	19.1	16.0	16.3	17.4	18.6	15.6	15.9	17.0	18.2	15.2	15.6	16.6	17.8	14.5	14.8	15.8	16.9	13.4	13.7	14.6	15.6
	S/T	0.83	0.78	0.63	0.47	0.86	0.81	0.66	0.49	0.88	0.83	0.67	0.50	0.91	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.95	0.90	0.73	0.54
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	19	15
	kW	1.29	1.32	1.36	1.40	1.38	1.41	1.45	1.50	1.46	1.49	1.54	1.59	1.53	1.57	1.61	1.66	1.59	1.63	1.68	1.73	1.65	1.68	1.73	1.79
	Amps	4.6	4.8	4.9	5.1	5.0	5.1	5.3	5.5	5.4	5.6	5.7	6.0	5.8	5.9	6.1	6.4	6.2	6.3	6.5	6.8	6.5	6.7	6.9	7.2
	HI PR	207	223	235	245	232	250	264	275	264	284	300	313	301	324	342	357	338	364	385	401	374	402	425	443
LO PR	105	112	122	130	111	118	129	137	115	123	134	143	121	129	141	150	127	135	147	157	131	140	152	162	
600	MBh	17.7	18.1	19.4	20.7	17.3	17.7	18.9	20.2	16.9	17.3	18.5	19.7	16.5	16.8	18.0	19.2	15.7	16.0	17.1	18.3	14.5	14.8	15.8	16.9
	S/T	0.86	0.81	0.66	0.49	0.89	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.56
	ΔT	23	22	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15
	kW	1.32	1.35	1.39	1.43	1.42	1.44	1.49	1.53	1.50	1.53	1.58	1.62	1.57	1.60	1.65	1.71	1.63	1.67	1.72	1.77	1.69	1.72	1.78	1.83
	Amps	4.8	4.9	5.0	5.2	5.1	5.3	5.4	5.6	5.6	5.7	5.9	6.1	6.0	6.1	6.3	6.5	6.3	6.5	6.7	6.9	6.7	6.9	7.1	7.4
	HI PR	213	230	242	253	239	258	272	284	272	293	309	323	310	334	352	368	349	375	396	413	385	415	438	457
LO PR	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167	
675	MBh	18.3	18.7	19.9	21.3	17.8	18.2	19.5	20.8	17.4	17.8	19.0	20.3	17.0	17.4	18.5	19.8	16.1	16.5	17.6	18.8	14.9	15.3	16.3	17.4
	S/T	0.90	0.85	0.69	0.52	0.94	0.88	0.72	0.53	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.79	0.59
	ΔT	22	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	22	22	19	15	20	21	18	14
	kW	1.33	1.36	1.40	1.44	1.43	1.45	1.50	1.54	1.51	1.54	1.59	1.64	1.58	1.62	1.67	1.72	1.65	1.68	1.73	1.79	1.70	1.74	1.79	1.85
	Amps	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.8	6.0	6.2	6.0	6.2	6.4	6.6	6.4	6.5	6.8	7.0	6.8	6.9	7.2	7.4
	HI PR	215	232	245	255	242	260	275	287	275	296	313	326	313	337	356	371	352	379	400	418	389	419	442	461
LO PR	109	116	127	135	115	123	134	143	120	128	139	148	126	134	146	156	132	140	153	163	137	145	159	169	
525	MBh	16.6	17.0	17.8	19.0	16.3	16.6	17.4	18.5	15.9	16.2	16.9	18.1	15.5	15.8	16.5	17.6	14.7	15.0	15.7	16.8	13.6	13.9	14.5	15.5
	S/T	0.87	0.84	0.76	0.62	0.90	0.87	0.79	0.64	0.93	0.89	0.81	0.65	0.96	0.92	0.83	0.68	0.99	0.96	0.86	0.70	1.00	1.00	0.90	0.73
	ΔT	25	25	24	20	26	25	24	21	26	25	24	21	26	26	24	21	26	25	24	21	24	23	22	19
	kW	1.30	1.33	1.37	1.41	1.39	1.42	1.46	1.51	1.47	1.50	1.55	1.60	1.55	1.58	1.63	1.68	1.61	1.64	1.69	1.75	1.66	1.69	1.75	1.80
	Amps	4.7	4.8	5.0	5.1	5.1	5.2	5.3	5.5	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.4	6.6	6.8	6.6	6.7	7.0	7.2
	HI PR	209	225	238	248	235	252	267	278	267	287	303	316	304	327	345	360	342	368	388	405	378	406	429	448
LO PR	106	113	123	131	112	119	130	138	116	124	135	144	122	130	142	151	128	136	149	158	132	141	154	164	
85	MBh	18.0	18.4	19.3	20.5	17.6	18.0	18.8	20.1	17.2	17.5	18.4	19.6	16.8	17.1	17.9	19.1	15.9	16.2	17.0	18.2	14.8	15.0	15.8	16.8
	S/T	0.90	0.87	0.79	0.64	0.94	0.90	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.90	0.73
	ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	21	24	25	23	20	23	23	22	19
	kW	1.33	1.36	1.40	1.44	1.43	1.45	1.50	1.54	1.51	1.54	1.59	1.64	1.58	1.62	1.67	1.72	1.65	1.68	1.73	1.79	1.70	1.74	1.79	1.85
	Amps	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.8	6.0	6.2	6.0	6.2	6.4	6.6	6.4	6.5	6.8	7.0	6.8	6.9	7.2	7.4
	HI PR	215	232	245	255	242	260	275	287	275	296	313	326	313	337	356	371	352	379	400	418	389	419	442	461
LO PR	109	116	127	135	115	123	134	143	120	128	139	148	126	134	146	156	132	140	153	163	137	145	159	169	
675	MBh	18.6	18.9	19.8	21.2	18.1	18.5	19.4	20.7	17.7	18.1	18.9	20.2	17.3	17.6	18.4	19.7	16.4	16.7	17.5	18.7	15.2	15.5	16.2	17.3
	S/T	0.95	0.91	0.83	0.67	0.98	0.95	0.86	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.73	1.00	1.00	0.94	0.76	1.00	1.00	0.95	0.77
	ΔT	24	24	22	19	24	24	23	20	24	24	23	20	24	24	23	20	22	23	22	19	21	21	21	18
	kW	1.34	1.37	1.41	1.45	1.44	1.47	1.51	1.56	1.52	1.55	1.60	1.65	1.60	1.63	1.68	1.73	1.66	1.69	1.75	1.80	1.71	1.75	1.81	1.86
	Amps	4.9	5.0	5.1	5.3	5.2	5.4	5.5	5.7	5.7	5.8	6.0	6.2	6.1	6.2	6.4	6.7	6.4	6.6	6.8	7.1	6.8	7.0	7.2	7.5
	HI PR	218	234	247	258	244	263	278	289	278	299	316	329	316	340	359	375	356	383	404	422	393	423	447	466
LO PR	110	117	128	136	117	124	135	144	121	129	141	150	127	135	148	157	133	142	155	165	138	147	160	171	

Amps = outdoor unit amps (comp.-fan)
kW = Total system power

Shaded area reflects AHRI conditions

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB		OUTDOOR AMBIENT TEMPERATURE																																															
		65								75								85								95								105								115							
		AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71														
70	700	MBh	21.1	21.8	23.9	-	20.6	21.3	23.4	-	20.1	20.8	22.8	-	19.6	20.3	22.3	-	18.6	19.3	21.1	-	17.3	17.9	19.6	-	18.6	19.3	21.1	-	17.3	17.9	19.6	-															
		S/T	0.67	0.56	0.39	-	0.70	0.58	0.40	-	0.72	0.60	0.41	-	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.77	0.65	0.45	-	0.77	0.64	0.44	-	0.77	0.65	0.45	-															
		ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	13	-	19	16	12	-	18	15	12	-	19	16	12	-	18	15	12	-															
	800	kW	1.68	1.70	1.74	-	1.77	1.79	1.83	-	1.84	1.87	1.92	-	1.91	1.94	1.99	-	1.97	2.01	2.05	-	2.02	2.06	2.11	-	1.97	2.01	2.05	-	2.02	2.06	2.11	-															
		Amps	5.7	5.8	6.0	-	6.1	6.3	6.5	-	6.7	6.8	7.1	-	7.1	7.3	7.5	-	7.6	7.8	8.0	-	8.0	8.2	8.5	-	7.6	7.8	8.0	-	8.0	8.2	8.5	-															
		HI PR	209	225	237	-	234	252	266	-	267	287	303	-	304	327	345	-	342	368	388	-	377	406	429	-	342	368	388	-	377	406	429	-															
	900	LO PR	100	107	116	-	106	113	123	-	110	117	128	-	116	123	134	-	121	129	141	-	125	133	146	-	121	129	141	-	125	133	146	-															
		MBh	22.8	23.7	25.9	-	22.3	23.1	25.3	-	21.8	22.6	24.7	-	21.2	22.0	24.1	-	20.2	20.9	22.9	-	18.7	19.4	21.2	-	20.2	20.9	22.9	-	18.7	19.4	21.2	-															
		S/T	0.70	0.58	0.40	-	0.72	0.61	0.42	-	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.80	0.66	0.46	-	0.80	0.67	0.46	-	0.80	0.66	0.46	-	0.80	0.67	0.46	-															
	900	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-	18	16	12	-	17	15	11	-															
		kW	1.71	1.73	1.77	-	1.80	1.82	1.87	-	1.88	1.91	1.95	-	1.95	1.98	2.03	-	2.01	2.04	2.09	-	2.06	2.10	2.15	-	2.01	2.04	2.09	-	2.06	2.10	2.15	-															
		Amps	5.8	6.0	6.2	-	6.3	6.5	6.7	-	6.9	7.0	7.3	-	7.3	7.5	7.8	-	7.8	8.0	8.3	-	8.3	8.5	8.7	-	7.8	8.0	8.3	-	8.3	8.5	8.7	-															
900	HI PR	215	232	245	-	242	260	275	-	275	296	312	-	313	337	356	-	352	379	400	-	389	419	442	-	352	379	400	-	389	419	442	-																
	LO PR	103	110	120	-	109	116	127	-	114	121	132	-	119	127	138	-	125	133	145	-	129	137	150	-	125	133	145	-	129	137	150	-																
	MBh	23.5	24.4	26.7	-	23.0	23.8	26.1	-	22.4	23.2	25.5	-	21.9	22.7	24.8	-	20.8	21.5	23.6	-	19.3	20.0	21.9	-	20.8	21.5	23.6	-	19.3	20.0	21.9	-																
900	S/T	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.47	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-																
	ΔT	18	15	12	-	18	15	12	-	18	15	12	-	18	16	12	-	18	15	12	-	17	14	11	-	18	15	12	-	17	14	11	-																
	kW	1.71	1.74	1.78	-	1.81	1.84	1.88	-	1.89	1.92	1.97	-	1.96	1.99	2.04	-	2.02	2.06	2.11	-	2.08	2.11	2.16	-	2.02	2.06	2.11	-	2.08	2.11	2.16	-																
900	Amps	5.9	6.0	6.2	-	6.4	6.5	6.7	-	6.9	7.1	7.3	-	7.4	7.6	7.8	-	7.9	8.1	8.3	-	8.3	8.5	8.8	-	7.9	8.1	8.3	-	8.3	8.5	8.8	-																
	HI PR	217	234	247	-	244	263	277	-	278	299	315	-	316	340	359	-	356	383	404	-	393	423	446	-	356	383	404	-	393	423	446	-																
	LO PR	104	111	121	-	110	117	128	-	115	122	133	-	120	128	140	-	126	134	147	-	131	139	152	-	126	134	147	-	131	139	152	-																
75	700	MBh	21.4	22.1	23.9	25.6	20.9	21.6	23.3	25.0	20.4	21.0	22.8	24.4	26.5	21.6	22.2	24.1	25.8	23.8	18.9	19.5	21.1	22.7	17.5	18.1	19.6	21.0	19.6	21.2	22.7	17.5	18.1	19.6	21.0														
		S/T	0.77	0.69	0.52	0.33	0.79	0.71	0.54	0.35	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.87	0.78	0.59	0.38	0.88	0.79	0.60	0.38	0.88	0.79	0.60	0.38															
		ΔT	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	19	15	11	20	19	15	11															
	700	kW	1.69	1.71	1.75	1.79	1.78	1.80	1.84	1.89	1.86	1.88	1.93	1.98	2.05	2.12	1.93	1.96	2.00	2.05	2.05	1.99	2.02	2.07	2.12	2.04	2.07	2.12	2.18	2.04	2.07	2.12	2.18	2.04	2.07	2.12	2.18												
		Amps	5.7	5.9	6.1	6.3	6.2	6.3	6.6	6.8	6.7	6.9	7.1	7.4	7.7	7.9	7.2	7.4	7.6	7.9	8.1	7.7	7.8	8.1	8.4	8.1	8.3	8.6	8.9	8.1	8.3	8.6	8.9	8.1	8.3	8.6	8.9												
		HI PR	211	227	240	250	237	255	269	281	269	290	306	319	307	330	348	363	345	371	392	409	345	371	392	409	381	410	433	452	381	410	433	452	381	410	433	452											
	700	LO PR	101	108	118	125	107	114	124	132	111	118	129	138	117	124	136	145	122	130	142	151	122	130	142	151	127	135	147	157	127	135	147	157	127	135	147	157											
		MBh	23.2	23.9	25.9	27.8	22.7	23.4	25.3	27.1	22.1	22.8	24.7	26.5	28.6	26.5	22.2	24.1	25.8	27.5	25.8	20.5	21.1	22.9	24.5	19.0	19.6	21.2	22.7	19.0	19.6	21.2	22.7	19.0	19.6	21.2	22.7												
		S/T	0.79	0.71	0.54	0.35	0.82	0.74	0.56	0.36	0.84	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.90	0.81	0.61	0.39	0.91	0.82	0.62	0.40	0.91	0.82	0.62	0.40	0.91	0.82	0.62	0.40											
	700	ΔT	21	20	16	11	21	20	16	11	21	20	16	11	22	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10	20	18	15	10	20	18	15	10											
		kW	1.71	1.74	1.78	1.82	1.81	1.84	1.88	1.92	1.89	1.92	1.97	2.01	2.08	2.15	1.96	1.99	2.04	2.09	2.09	2.02	2.06	2.11	2.16	2.08	2.11	2.17	2.22	2.08	2.11	2.17	2.22	2.08	2.11	2.17	2.22												
		Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.9	8.1	7.4	7.6	7.8	8.1	8.1	7.9	8.1	8.3	8.6	8.3	8.5	8.8	9.2	8.3	8.5	8.8	9.2	8.3	8.5	8.8	9.2												
700	HI PR	218	234	247	258	244	263	277	289	278	299	315	329	316	340	359	375	356	383	404	422	393	423	442	422	393	423	447	466	393	423	447	466	393	423	447	466												
	LO PR	104	111	121	129	110	117	128	136	115	122	133	142	120	128	140	149	126	134	147	156	126	134	147	156	131	139	152	161	131	139	152	161	131	139	152	161												
	MBh	23.9	24.6	26.7	28.6	23.4	24.1	26.0	27.9	22.8	23.5	25.4	27.3	29.4	27.3	22.9	24.8	26.6	28.4	26.6	21.1	21.8	23.6	25.3	19.6	20.2	21.8	23.4	19.6	20.2	21.8	23.4	19.6	20.2	21.8	23.4													
700	S/T	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.38	0.89	0.79	0.60	0.39	0.91	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42	0.96	0.86	0.65	0.42	0.96	0.86	0.65	0.42												
	ΔT	20	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	14	10	19	18	14	10	19	18	14	10												
	kW	1.72	1.75	1.79	1.83	1.82	1.85	1.89	1.93	1.90	1.93	1.98	2.03	2.08	2.15	1.97	2.01	2.06	2.11	2.11	2.04	2.07	2.12	2.18	2.09	2.13	2.18	2.24	2.09	2.13	2.18	2.24	2.09	2.13	2.18	2.24													
700	Amps	5.9	6.1	6.3	6.5	6.4	6.6	6.8	7.1	7.0	7.2	7.4	7.7	7.9	8.1	7.5	7.6	7.9	8.2	8.2	7.9	8.1	8.4	8.7	8.4	8.6	8.9	9.3	8.4	8.6	8.9	9.3	8.4	8.6	8.9	9.3													
	HI PR	220	236	250	260	247	265	280	292	280	302	319	332	319	344	363	378	359	387	408	426	397	427	446	426	397	427	451	470	397	427	451	470	397	427	451	470												
	LO PR	105	112	122	130	111	119	129	138	116	123	135	143	122	129	141	150	127	136	148	158	127	136	148	158	132	140	153	163																				

IDB		OUTDOOR AMBIENT TEMPERATURE																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
		ENTERING INDOOR WET BULB TEMPERATURE																									
		ENTERING INDOOR DRY BULB TEMPERATURE																									
80	700	MBh	21.8	22.3	23.8	25.5	21.3	21.8	23.3	24.9	20.8	21.3	22.7	24.3	20.3	20.7	22.2	23.7	19.3	19.7	21.0	22.5	17.9	18.2	19.5	20.8	
		S/T	0.84	0.79	0.64	0.48	0.87	0.82	0.67	0.50	0.89	0.84	0.68	0.51	0.92	0.86	0.70	0.53	0.96	0.90	0.73	0.55	0.97	0.91	0.74	0.55	
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	25	24	20	16	24	24	23	20	16	23	22	19	15
		kW	1.70	1.72	1.76	1.80	1.79	1.81	1.86	1.90	1.87	1.90	1.94	1.99	2.03	1.94	1.97	2.02	2.07	2.00	2.03	2.08	2.13	2.05	2.08	2.14	2.19
		Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.5	7.7	7.3	7.4	7.7	8.0	7.7	7.9	8.2	8.5	8.2	8.4	8.7	9.0
		HI PR	213	229	242	253	239	257	272	283	272	293	309	322	330	310	333	352	367	348	375	396	413	385	414	438	456
LO PR	102	109	119	127	108	115	126	134	112	120	130	139	148	118	126	137	146	124	132	144	153	128	136	149	158		
80	800	MBh	23.6	24.1	25.8	27.6	23.1	23.6	25.2	26.9	22.5	23.0	24.6	26.3	22.0	22.5	24.0	25.7	20.9	21.3	22.8	24.4	19.3	19.8	21.1	22.6	
		S/T	0.87	0.82	0.67	0.50	0.90	0.85	0.69	0.52	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	0.99	0.93	0.76	0.57	1.00	0.94	0.76	0.57	
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	24	23	20	16	22	21	19	15
		kW	1.72	1.75	1.79	1.83	1.82	1.85	1.89	1.93	1.90	1.93	1.98	2.03	2.07	1.97	2.01	2.06	2.11	2.04	2.07	2.12	2.18	2.09	2.13	2.18	2.24
		Amps	5.9	6.1	6.3	6.5	6.4	6.6	6.8	7.1	7.0	7.2	7.4	7.7	7.9	7.5	7.6	7.9	8.2	7.9	8.1	8.4	8.7	8.4	8.6	8.9	9.3
		HI PR	220	236	250	260	247	265	280	292	280	302	319	332	339	319	344	363	379	359	387	408	426	397	427	451	470
LO PR	105	112	123	130	111	119	129	138	116	123	135	143	152	122	129	141	150	127	136	148	158	132	140	153	163		
80	900	MBh	24.3	24.9	26.6	28.4	23.8	24.3	26.0	27.7	23.2	23.7	25.3	27.1	22.6	23.1	24.7	26.4	21.5	22.0	23.5	25.1	19.9	20.4	21.8	23.3	
		S/T	0.91	0.86	0.70	0.52	0.95	0.89	0.72	0.54	1.00	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	1.00	0.79	0.59	1.00	1.00	0.80	0.60	
		ΔT	23	22	19	15	23	22	19	15	24	22	19	15	23	22	19	15	22	22	22	19	15	20	21	18	14
		kW	1.73	1.76	1.80	1.84	1.83	1.86	1.90	1.95	1.91	1.94	1.99	2.04	2.09	1.99	2.02	2.07	2.12	2.05	2.08	2.14	2.19	2.10	2.14	2.19	2.25
		Amps	6.0	6.1	6.3	6.6	6.5	6.6	6.9	7.1	7.0	7.2	7.5	7.7	7.9	7.5	7.7	8.0	8.3	8.0	8.2	8.5	8.8	8.5	8.7	9.0	9.3
		HI PR	222	239	252	263	249	268	283	295	283	305	322	336	343	323	347	367	382	363	390	412	430	401	431	456	475
LO PR	107	113	124	132	113	120	131	139	117	124	136	145	154	123	131	143	152	129	137	150	159	133	142	155	165		
85	700	MBh	22.2	22.6	23.7	25.3	21.7	22.1	23.1	24.7	21.2	21.6	22.6	24.1	20.6	21.0	22.0	23.5	19.6	20.0	20.9	22.3	18.2	18.5	19.4	20.7	
		S/T	0.88	0.85	0.77	0.62	0.91	0.88	0.80	0.65	0.94	0.90	0.82	0.66	0.97	0.93	0.84	0.68	1.00	0.97	0.87	0.71	1.00	0.98	0.88	0.71	
		ΔT	26	25	24	21	26	26	24	21	26	26	24	21	26	25	24	21	26	26	25	24	21	24	24	22	19
		kW	1.70	1.73	1.77	1.81	1.80	1.82	1.87	1.91	1.88	1.91	1.95	2.00	2.05	1.95	1.98	2.03	2.08	2.01	2.04	2.09	2.15	2.06	2.10	2.15	2.21
		Amps	5.8	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.9	7.0	7.3	7.5	7.7	7.3	7.5	7.8	8.0	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1
		HI PR	215	232	245	255	242	260	274	286	275	296	312	326	333	313	337	356	371	352	379	400	417	389	419	442	461
LO PR	103	110	120	128	109	116	127	135	113	121	132	140	149	119	127	138	147	125	133	145	155	129	137	150	160		
85	800	MBh	24.0	24.5	25.7	27.4	23.5	23.9	25.1	26.8	22.9	23.4	24.5	26.1	22.4	22.8	23.9	25.5	21.2	21.7	22.7	24.2	19.7	20.1	21.0	22.4	
		S/T	0.91	0.88	0.80	0.65	0.95	0.91	0.82	0.67	0.97	0.94	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.91	0.74	
		ΔT	25	25	23	20	26	25	24	21	26	25	24	21	26	25	24	21	26	24	25	24	20	23	23	22	19
		kW	1.73	1.76	1.80	1.84	1.83	1.86	1.90	1.95	1.91	1.94	1.99	2.04	2.09	1.99	2.02	2.07	2.12	2.05	2.08	2.14	2.19	2.10	2.14	2.19	2.25
		Amps	6.0	6.1	6.3	6.6	6.5	6.6	6.9	7.1	7.0	7.2	7.5	7.7	7.9	7.5	7.7	8.0	8.3	8.0	8.2	8.5	8.8	8.5	8.7	9.0	9.3
		HI PR	222	239	252	263	249	268	283	295	283	305	322	336	343	323	347	367	382	363	390	412	430	401	431	456	475
LO PR	107	113	124	132	113	120	131	139	117	124	136	145	154	123	131	143	152	129	137	150	159	133	142	155	165		
85	900	MBh	24.8	25.2	26.4	28.2	24.2	24.7	25.8	27.6	23.6	24.1	25.2	26.9	23.0	23.5	24.6	26.2	21.9	22.3	23.4	24.9	20.3	20.7	21.6	23.1	
		S/T	0.96	0.92	0.83	0.68	0.99	0.96	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78	
		ΔT	24	24	23	20	25	24	23	20	24	24	23	20	24	24	23	20	24	22	23	23	20	21	21	21	18
		kW	1.74	1.77	1.81	1.85	1.84	1.87	1.91	1.96	1.92	1.96	2.00	2.05	2.10	2.00	2.03	2.08	2.14	2.06	2.10	2.15	2.21	2.12	2.15	2.21	2.27
		Amps	6.1	6.2	6.4	6.6	6.5	6.7	6.9	7.2	7.1	7.3	7.5	7.8	8.0	7.6	7.8	8.0	8.4	8.1	8.3	8.6	8.9	8.6	8.8	9.1	9.4
		HI PR	224	241	255	266	251	271	286	298	286	308	325	339	346	326	351	370	386	366	394	416	434	405	436	460	480
LO PR	108	114	125	133	114	121	132	141	118	126	137	146	154	124	132	144	154	130	138	151	161	135	143	156	166		

Shaded area reflects AHRI conditions
 IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	24.9	25.8	28.3	-	24.4	25.2	27.7	-	23.8	24.6	27.0	-	23.2	24.0	26.3	-	22.0	22.8	25.0	-	20.4	21.2	23.2	-
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	kW	1.94	1.98	2.03	-	2.08	2.12	2.18	-	2.20	2.25	2.32	-	2.31	2.36	2.43	-	2.40	2.45	2.53	-	2.48	2.54	2.62	-
	Amps	6.8	7.0	7.2	-	7.4	7.6	7.8	-	8.0	8.2	8.5	-	8.6	8.8	9.1	-	9.1	9.3	9.7	-	9.7	9.9	10.2	-
	HI PR	228	245	259	-	256	275	291	-	291	313	331	-	332	357	377	-	373	401	424	-	412	443	468	-
	LO PR	102	109	119	-	108	115	125	-	112	119	130	-	118	125	137	-	124	131	143	-	128	136	148	-
	MBh	27.0	28.0	30.7	-	26.4	27.4	30.0	-	25.8	26.7	29.3	-	25.1	26.1	28.5	-	23.9	24.7	27.1	-	22.1	22.9	25.1	-
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
	kW	1.98	2.02	2.08	-	2.13	2.17	2.24	-	2.25	2.30	2.37	-	2.37	2.42	2.49	-	2.46	2.51	2.59	-	2.54	2.60	2.68	-
	Amps	7.0	7.2	7.4	-	7.6	7.8	8.0	-	8.2	8.4	8.7	-	8.8	9.0	9.3	-	9.4	9.6	9.9	-	9.9	10.2	10.5	-
HI PR	235	253	267	-	264	284	300	-	300	323	341	-	342	368	388	-	384	414	437	-	425	457	483	-	
LO PR	105	112	122	-	111	118	129	-	116	123	134	-	122	129	141	-	127	135	148	-	132	140	153	-	
MBh	27.8	28.8	31.6	-	27.2	28.2	30.9	-	26.5	27.5	30.1	-	25.9	26.8	29.4	-	24.6	25.5	27.9	-	22.8	23.6	25.9	-	
S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-	
ΔT	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	16	14	11	-	
kW	2.00	2.04	2.10	-	2.14	2.19	2.25	-	2.27	2.32	2.39	-	2.39	2.44	2.51	-	2.48	2.53	2.62	-	2.56	2.62	2.70	-	
Amps	7.1	7.2	7.5	-	7.7	7.8	8.1	-	8.3	8.5	8.8	-	8.9	9.1	9.4	-	9.5	9.7	10.0	-	10.0	10.3	10.6	-	
HI PR	237	256	270	-	266	287	303	-	303	326	344	-	345	371	392	-	388	418	441	-	429	462	488	-	
LO PR	106	113	124	-	112	120	131	-	117	124	136	-	123	131	143	-	129	137	149	-	133	142	155	-	
75	MBh	25.4	26.1	28.3	30.3	24.8	25.5	27.6	29.6	24.2	24.9	26.9	28.9	23.6	24.3	26.3	28.2	22.4	23.1	25.0	26.8	20.8	21.4	23.1	24.8
	S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10
	kW	1.95	1.99	2.05	2.11	2.09	2.14	2.20	2.27	2.22	2.26	2.33	2.41	2.33	2.45	2.53	2.63	2.42	2.47	2.55	2.63	2.50	2.56	2.64	2.72
	Amps	6.9	7.1	7.3	7.6	7.4	7.6	7.9	8.2	8.1	8.3	8.6	8.9	8.6	8.9	9.2	9.5	9.2	9.4	9.7	10.1	9.7	10.0	10.3	10.7
	HI PR	230	248	262	273	259	278	294	306	294	316	334	349	335	360	381	397	377	405	428	447	416	448	473	493
	LO PR	103	110	120	128	109	116	127	135	113	121	132	140	119	127	138	147	125	133	145	154	129	137	150	160
	MBh	27.5	28.3	30.6	32.9	26.8	27.6	29.9	32.1	26.2	27.0	29.2	31.3	25.6	26.3	28.5	30.6	24.3	25.0	27.1	29.0	22.5	23.2	25.1	26.9
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10
	kW	2.00	2.04	2.10	2.16	2.14	2.19	2.25	2.32	2.27	2.32	2.39	2.47	2.39	2.44	2.51	2.59	2.48	2.53	2.62	2.70	2.57	2.62	2.70	2.79
	Amps	7.1	7.2	7.5	7.8	7.7	7.8	8.1	8.4	8.3	8.5	8.8	9.1	8.9	9.1	9.4	9.8	9.5	9.7	10.0	10.4	10.0	10.3	10.6	11.0
HI PR	238	256	270	282	267	287	303	316	303	326	344	359	345	372	392	409	388	418	441	460	429	462	488	509	
LO PR	106	113	124	132	112	120	131	139	117	124	136	145	123	131	143	152	129	137	149	159	133	142	155	165	
MBh	28.3	29.1	31.5	33.9	27.6	28.5	30.8	33.1	27.0	27.8	30.1	32.3	26.3	27.1	29.3	31.5	25.0	25.8	27.9	29.9	23.2	23.9	25.8	27.7	
S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43	
ΔT	20	18	15	10	20	18	15	10	20	18	15	10	20	19	15	11	20	18	15	10	19	17	14	10	
kW	2.01	2.05	2.11	2.18	2.16	2.20	2.27	2.34	2.29	2.34	2.41	2.49	2.40	2.46	2.53	2.61	2.50	2.56	2.64	2.72	2.59	2.64	2.73	2.82	
Amps	7.1	7.3	7.6	7.8	7.7	7.9	8.2	8.5	8.4	8.6	8.9	9.2	9.0	9.2	9.5	9.9	9.6	9.8	10.1	10.5	10.1	10.4	10.7	11.1	
HI PR	240	258	273	284	269	290	306	319	306	329	348	363	349	375	396	413	392	422	446	465	433	466	493	514	
LO PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166	

Amps = outdoor unit amps (comp.+fan)
kW = Total system power

Shaded area reflects ACCA (TVA) conditions

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

EXPANDED EXPANDED COOLING DATA — ASX130301** (CONT.)

IDB		OUTDOOR AMBIENT TEMPERATURE																								
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
		ENTERING INDOOR WET BULB TEMPERATURE																								
		AIRFLOW																								
80	MBh	25.8	26.4	28.2	30.1	25.2	25.8	27.5	29.4	24.6	25.1	26.9	28.7	24.0	24.5	26.2	28.0	22.8	23.3	24.9	26.6	21.1	21.6	23.1	24.7	
	S/T	0.86	0.81	0.66	0.49	0.90	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57	
	ΔT	23	22	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	24	23	20	16	22	21	18	15
	kW	1.97	2.01	2.07	2.13	2.11	2.15	2.22	2.29	2.24	2.28	2.35	2.43	2.35	2.40	2.47	2.55	2.44	2.49	2.57	2.66	2.52	2.58	2.66	2.75	
	Amps	7.0	7.1	7.3	7.6	7.5	7.7	7.9	8.2	8.2	8.4	8.6	9.0	8.7	8.9	9.2	9.6	9.3	9.5	9.8	10.2	9.8	10.1	10.4	10.8	
	HI PR	233	250	264	276	261	281	297	310	297	320	338	352	338	364	384	401	381	410	432	451	420	452	478	498	
	LO PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161	
	MBh	28.0	28.6	30.5	32.6	27.3	27.9	29.8	31.9	26.7	27.2	29.1	31.1	26.0	26.6	28.4	30.4	24.7	25.3	27.0	28.8	22.9	23.4	25.0	26.7	
	S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59	
	ΔT	23	22	19	15	23	22	19	16	23	22	19	16	23	23	20	16	23	23	22	19	15	21	21	18	14
kW	2.01	2.05	2.12	2.18	2.16	2.20	2.27	2.34	2.29	2.34	2.41	2.49	2.40	2.46	2.53	2.61	2.50	2.56	2.64	2.72	2.59	2.64	2.73	2.82		
Amps	7.1	7.3	7.6	7.8	7.7	7.9	8.2	8.5	8.4	8.6	8.9	9.2	9.0	9.2	9.5	9.9	9.6	9.8	10.1	10.5	10.1	10.4	10.7	11.1		
HI PR	240	258	273	284	269	290	306	319	306	330	348	363	349	375	396	413	392	422	446	465	433	466	493	514		
LO PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166		
MBh	28.8	29.4	31.4	33.6	28.1	28.7	30.7	32.8	27.5	28.1	30.0	32.1	26.8	27.4	29.3	31.3	25.5	26.0	27.8	29.7	23.6	24.1	25.7	27.5		
S/T	0.94	0.88	0.72	0.54	1.00	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62		
ΔT	22	21	18	15	23	21	19	15	22	21	19	15	22	22	19	15	21	21	19	15	19	20	17	14		
kW	2.03	2.07	2.13	2.20	2.18	2.22	2.29	2.36	2.31	2.36	2.43	2.51	2.42	2.48	2.55	2.64	2.52	2.58	2.66	2.74	2.61	2.66	2.75	2.84		
Amps	7.2	7.4	7.6	7.9	7.8	8.0	8.2	8.6	8.5	8.7	9.0	9.3	9.1	9.3	9.6	10.0	9.6	9.9	10.2	10.6	10.2	10.5	10.8	11.2		
HI PR	242	261	275	287	272	293	309	322	309	333	351	367	352	379	400	417	396	426	450	470	438	471	498	519		
LO PR	109	116	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168		
85	MBh	26.3	26.8	28.0	29.9	25.7	26.1	27.4	29.2	25.0	25.5	26.7	28.5	24.4	24.9	26.1	27.8	23.2	23.7	24.8	26.4	21.5	21.9	23.0	24.5	
	S/T	0.91	0.87	0.79	0.64	0.94	0.91	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.91	0.73	
	ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	21	24	25	23	20	23	23	22	19	
	kW	1.98	2.02	2.08	2.15	2.13	2.17	2.24	2.31	2.25	2.30	2.37	2.45	2.37	2.42	2.49	2.57	2.46	2.51	2.59	2.68	2.54	2.60	2.68	2.77	
	Amps	7.0	7.2	7.4	7.7	7.6	7.8	8.0	8.3	8.2	8.4	8.7	9.0	8.8	9.0	9.3	9.7	9.4	9.6	9.9	10.3	9.9	10.2	10.5	10.9	
	HI PR	235	253	267	279	264	284	300	313	300	323	341	356	342	368	388	405	384	414	437	456	425	457	483	503	
	LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163	
	MBh	28.5	29.0	30.4	32.4	27.8	28.3	29.7	31.7	27.1	27.7	29.0	30.9	26.5	27.0	28.3	30.1	25.1	25.6	26.8	28.6	23.3	23.7	24.9	26.5	
	S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.71	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76	
	ΔT	25	24	23	20	25	24	23	20	25	24	23	20	24	25	23	20	23	24	23	20	21	22	21	19	
kW	2.03	2.07	2.13	2.20	2.18	2.22	2.29	2.36	2.31	2.36	2.43	2.51	2.42	2.48	2.55	2.64	2.52	2.58	2.66	2.74	2.61	2.66	2.75	2.84		
Amps	7.2	7.4	7.6	7.9	7.8	8.0	8.2	8.6	8.5	8.7	9.0	9.3	9.1	9.3	9.6	10.0	9.6	9.9	10.2	10.6	10.2	10.5	10.8	11.2		
HI PR	242	261	275	287	272	293	309	322	309	333	351	367	352	379	400	417	396	426	450	470	438	471	498	519		
LO PR	109	116	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168		
MBh	29.3	29.9	31.3	33.4	28.6	29.2	30.6	32.6	27.9	28.5	29.8	31.8	27.3	27.8	29.1	31.1	25.9	26.4	27.7	29.5	24.0	24.5	25.6	27.3		
S/T	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.98	0.79	1.00	1.00	0.98	0.80		
ΔT	24	23	22	19	23	23	22	19	23	23	23	19	22	23	22	19	21	22	22	19	20	20	21	18		
kW	2.04	2.08	2.15	2.21	2.19	2.24	2.31	2.38	2.33	2.37	2.45	2.53	2.44	2.49	2.57	2.66	2.54	2.60	2.68	2.77	2.63	2.69	2.77	2.86		
Amps	7.3	7.4	7.7	8.0	7.9	8.1	8.3	8.6	8.5	8.8	9.0	9.4	9.1	9.4	9.7	10.0	9.7	10.0	10.3	10.7	10.3	10.6	10.9	11.3		
HI PR	245	263	278	290	275	296	312	326	312	336	355	370	356	383	404	422	400	431	455	474	442	476	503	524		
LO PR	110	117	127	136	116	123	135	143	120	128	140	149	126	135	147	156	133	141	154	164	137	146	159	170		

Amps = outdoor unit amps (comp.-fan)
kW = Total system power

Shaded area reflects AHRI conditions

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB		OUTDOOR AMBIENT TEMPERATURE																																				
		65						75						85						95						105						115						
		AIRFLOW			59			63			67			71			59			63			67			71			59			63			67			71
MBh	S/T	ΔT	kW	Amps	HI PR	LO PR	31.1	32.2	35.3	30.4	31.5	34.5	29.6	30.7	33.7	28.9	30.0	32.8	27.5	28.5	31.2	25.4	26.4	28.9	31.1	32.1	34.8	30.7	31.8	34.8	29.8	30.8	33.8	27.6	28.6	31.3		
1050	MBh	0.70	0.58	0.40	-	-	0.72	0.60	0.42	-	-	-	0.74	0.62	0.43	-	-	-	0.76	0.64	0.44	-	-	-	0.79	0.66	0.46	-	-	-	0.80	0.67	0.46	-	-	-		
	S/T	19	16	12	-	-	19	17	13	-	-	-	19	17	13	-	-	-	19	16	12	-	-	-	19	16	12	-	-	-	18	15	12	-	-	-		
	ΔT	2.40	2.44	2.52	-	-	2.57	2.63	2.71	-	-	-	2.73	2.78	2.87	-	-	-	2.86	2.92	3.02	-	-	-	2.98	3.04	3.14	-	-	-	3.08	3.15	3.25	-	-	-		
	kW	8.7	8.9	9.2	-	-	9.4	9.7	10.0	-	-	-	10.3	10.5	10.9	-	-	-	11.0	11.3	11.6	-	-	-	11.7	12.0	12.4	-	-	-	12.4	12.7	13.1	-	-	-		
	Amps	214	231	244	-	-	241	259	273	-	-	-	274	294	311	-	-	-	312	335	354	-	-	-	351	377	398	-	-	-	387	417	440	-	-	-		
	HI PR	99	106	115	-	-	105	112	122	-	-	-	109	116	127	-	-	-	115	122	133	-	-	-	120	128	139	-	-	-	124	132	144	-	-	-		
LO PR	33.7	34.9	38.2	-	-	32.9	34.1	37.4	-	-	-	32.1	33.3	36.5	-	-	-	31.3	32.5	35.6	-	-	-	29.8	30.8	33.8	-	-	-	27.6	28.6	31.3	-	-	-			
1200	MBh	0.72	0.60	0.42	-	-	0.75	0.62	0.43	-	-	-	0.77	0.64	0.44	-	-	-	0.79	0.66	0.46	-	-	-	0.82	0.69	0.48	-	-	-	0.83	0.69	0.48	-	-	-		
	S/T	19	16	12	-	-	19	16	12	-	-	-	19	16	12	-	-	-	19	16	12	-	-	-	19	16	12	-	-	-	17	15	11	-	-	-		
	ΔT	2.45	2.50	2.58	-	-	2.63	2.69	2.77	-	-	-	2.79	2.85	2.94	-	-	-	2.93	3.00	3.09	-	-	-	3.05	3.12	3.22	-	-	-	3.16	3.23	3.33	-	-	-		
	kW	9.0	9.2	9.5	-	-	9.7	10.0	10.3	-	-	-	10.6	10.8	11.2	-	-	-	11.3	11.6	12.0	-	-	-	12.0	12.3	12.8	-	-	-	12.8	13.1	13.5	-	-	-		
	Amps	221	238	251	-	-	248	267	282	-	-	-	282	304	321	-	-	-	321	346	365	-	-	-	361	389	411	-	-	-	399	430	454	-	-	-		
	HI PR	102	109	119	-	-	108	115	126	-	-	-	112	120	131	-	-	-	118	126	137	-	-	-	124	132	144	-	-	-	128	136	149	-	-	-		
LO PR	34.7	36.0	39.4	-	-	33.9	35.1	38.5	-	-	-	33.1	34.3	37.6	-	-	-	32.3	33.4	36.6	-	-	-	30.7	31.8	34.8	-	-	-	28.4	29.4	32.2	-	-	-			
1350	MBh	0.76	0.63	0.44	-	-	0.78	0.65	0.45	-	-	-	0.80	0.67	0.47	-	-	-	0.83	0.69	0.48	-	-	-	0.86	0.72	0.50	-	-	-	0.87	0.73	0.50	-	-	-		
	S/T	18	15	12	-	-	18	16	12	-	-	-	18	16	12	-	-	-	18	16	12	-	-	-	18	16	12	-	-	-	17	15	11	-	-	-		
	ΔT	2.47	2.52	2.60	-	-	2.65	2.71	2.79	-	-	-	2.82	2.88	2.97	-	-	-	2.96	3.02	3.12	-	-	-	3.08	3.15	3.25	-	-	-	3.18	3.25	3.36	-	-	-		
	kW	9.1	9.3	9.6	-	-	9.8	10.0	10.4	-	-	-	10.7	10.9	11.3	-	-	-	11.4	11.7	12.1	-	-	-	12.1	12.5	12.9	-	-	-	12.9	13.2	13.7	-	-	-		
	Amps	223	240	254	-	-	250	270	285	-	-	-	285	307	324	-	-	-	324	349	369	-	-	-	365	393	415	-	-	-	403	434	458	-	-	-		
	HI PR	103	110	120	-	-	109	116	127	-	-	-	114	121	132	-	-	-	119	127	139	-	-	-	125	133	145	-	-	-	129	138	150	-	-	-		
LO PR	34.2	35.3	38.2	41.0	37.8	30.9	31.8	34.4	36.9	30.1	31.0	33.6	36.1	29.4	30.3	32.8	35.2	29.4	30.3	32.8	35.2	27.9	28.8	31.1	33.4	25.9	26.6	28.8	31.0	31.2	33.7	36.2	28.0	28.9	31.2	33.5		
75	MBh	0.82	0.73	0.56	0.36	0.34	0.85	0.76	0.58	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.93	0.83	0.63	0.41	0.94	0.84	0.64	0.41	0.94	0.84	0.64	0.41	0.94	0.84	0.64	0.41	0.94	0.84	0.64	
	S/T	22	20	16	11	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11
	ΔT	2.41	2.46	2.54	2.62	2.68	2.59	2.65	2.73	2.81	2.75	2.81	2.89	2.99	2.89	2.95	3.04	3.14	3.00	3.07	3.17	3.27	3.11	3.17	3.27	3.11	3.17	3.28	3.38	3.11	3.17	3.28	3.38	3.11	3.17	3.28	3.38	
	kW	8.8	9.0	9.3	9.7	10.0	9.5	9.8	10.1	10.5	10.4	10.6	11.0	11.4	11.1	11.4	11.7	12.2	11.8	12.1	12.5	13.0	12.5	12.8	13.0	12.5	12.8	13.3	13.8	12.5	12.8	13.3	13.8	12.5	12.8	13.3	13.8	
	Amps	217	233	246	257	265	243	262	276	288	276	297	314	328	315	339	358	373	354	381	402	420	391	421	445	464	391	421	445	464	391	421	445	464	391	421	445	
	HI PR	100	107	117	124	124	106	113	123	131	110	117	128	136	116	123	134	143	121	129	141	150	125	133	146	155	125	133	146	155	125	133	146	155	125	133	146	
LO PR	34.2	35.3	38.2	41.0	37.8	33.5	34.4	37.3	40.0	32.7	33.6	36.4	39.1	31.9	32.8	35.5	38.1	31.9	32.8	35.5	38.1	30.3	31.2	33.7	36.2	28.0	28.9	31.2	33.5	31.2	32.1	34.7	37.3	28.9	29.7	32.2	34.5	
1350	MBh	0.86	0.77	0.58	0.37	0.37	0.89	0.80	0.60	0.39	0.91	0.82	0.62	0.40	0.94	0.84	0.64	0.41	0.98	0.88	0.66	0.43	0.99	0.88	0.67	0.43	0.99	0.88	0.67	0.43	0.99	0.88	0.67	0.43	0.99	0.88	0.67	
	S/T	21	19	16	11	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11
	ΔT	2.49	2.54	2.62	2.70	2.76	2.68	2.73	2.82	2.91	2.84	2.90	2.99	3.09	2.98	3.05	3.14	3.25	3.10	3.17	3.27	3.38	3.21	3.28	3.39	3.21	3.28	3.39	3.50	3.21	3.28	3.39	3.50	3.21	3.28	3.39	3.50	
	kW	9.1	9.4	9.7	10.0	10.4	9.9	10.1	10.5	10.9	10.8	11.0	11.4	11.8	11.5	11.8	12.2	12.7	12.3	12.6	13.0	13.5	13.0	13.3	13.8	14.3	13.0	13.3	13.8	14.3	13.0	13.3	13.8	14.3	13.0	13.3	13.8	14.3
	Amps	226	243	256	267	272	253	272	288	300	288	310	327	341	328	353	372	388	369	397	419	437	407	438	463	483	407	438	463	483	407	438	463	483	407	438	463	
	HI PR	104	111	121	129	129	110	117	128	137	115	122	133	142	121	128	140	149	126	134	147	156	131	139	152	162	131	139	152	162	131	139	152	162	131	139	152	
LO PR	35.3	36.3	39.3	42.2	41.2	34.5	35.5	38.4	41.2	33.6	34.6	37.5	40.2	32.8	33.8	36.6	39.3	32.8	33.8	36.6	39.3	31.2	32.1	34.7	37.3	28.9	29.7	32.2	34.5	31.2	32.1	34.7	37.3	28.9	29.7	32.2	34.5	

Shaded area reflects ACCA (TVA) conditions
 IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	32.2	32.9	35.1	37.5	31.4	32.1	34.3	36.7	30.7	31.3	33.5	35.8	29.9	30.6	32.7	34.9	28.4	29.1	31.0	33.2	26.3	26.9	28.8	30.7
	S/T	0.87	0.81	0.66	0.49	0.90	0.84	0.69	0.51	0.92	0.86	0.70	0.53	0.95	0.89	0.73	0.54	0.99	0.93	0.75	0.56	1.00	0.93	0.76	0.57
	ΔT	24	24	23	20	25	24	21	16	25	24	21	16	25	24	21	17	25	24	20	16	23	22	19	15
	kW	2.43	2.48	2.56	2.64	2.61	2.67	2.75	2.84	2.77	2.83	2.92	3.01	2.91	2.97	3.07	3.17	3.03	3.09	3.19	3.30	3.13	3.20	3.30	3.41
	Amps	8.9	9.1	9.4	9.8	9.6	9.9	10.2	10.6	10.5	10.7	11.1	11.5	11.2	11.5	11.9	12.3	11.9	12.2	12.6	13.1	12.6	13.0	13.4	13.9
	Hi PR	219	235	249	259	245	264	279	291	279	300	317	331	318	342	361	377	358	385	406	424	395	425	449	468
	Lo PR	101	108	118	125	107	114	124	132	111	118	129	138	117	124	136	145	123	130	142	152	127	135	147	157
	MBh	34.9	35.6	38.1	40.7	34.0	34.8	37.2	39.7	33.2	34.0	36.3	38.8	32.4	33.1	35.4	37.8	30.8	31.5	33.6	36.0	28.5	29.2	31.2	33.3
	S/T	0.90	0.84	0.69	0.51	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	0.99	0.93	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.97	0.79	0.59
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	25	23	20	16	24	23	20	16	22	22	19	15
kW	2.49	2.54	2.62	2.70	2.68	2.73	2.82	2.91	2.84	2.90	2.99	3.09	2.98	3.05	3.14	3.25	3.11	3.17	3.27	3.38	3.21	3.28	3.39	3.50	
Amps	9.1	9.4	9.7	10.0	9.9	10.1	10.5	10.9	10.8	11.0	11.4	11.8	11.5	11.8	12.2	12.7	12.3	12.6	13.0	13.5	13.0	13.3	13.8	14.3	
Hi PR	226	243	256	267	253	272	288	300	288	310	327	341	328	353	373	389	369	397	419	437	407	438	463	483	
Lo PR	105	111	121	129	110	117	128	137	115	122	133	142	121	128	140	149	126	134	147	156	131	139	152	162	
MBh	35.9	36.7	39.2	41.9	35.1	35.8	38.3	40.9	34.2	35.0	37.4	40.0	33.4	34.1	36.5	39.0	31.7	32.4	34.6	37.0	29.4	30.0	32.1	34.3	
S/T	0.94	0.88	0.72	0.54	1.00	0.92	0.75	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.83	0.62	
ΔT	23	22	19	15	24	22	19	16	23	22	19	16	23	23	20	16	22	22	19	15	20	20	18	14	
kW	2.51	2.56	2.64	2.72	2.70	2.75	2.84	2.93	2.86	2.92	3.01	3.11	3.01	3.07	3.17	3.27	3.13	3.20	3.30	3.41	3.24	3.31	3.42	3.53	
Amps	9.2	9.5	9.8	10.1	10.0	10.2	10.6	11.0	10.9	11.1	11.5	11.9	11.6	11.9	12.3	12.8	12.4	12.7	13.1	13.6	13.1	13.5	13.9	14.5	
Hi PR	228	245	259	270	256	275	290	303	291	313	330	345	331	356	376	392	372	401	423	441	412	443	468	488	
Lo PR	106	112	123	131	112	119	130	138	116	123	135	143	122	130	141	151	128	136	148	158	132	140	153	163	
85	MBh	32.7	33.4	34.9	37.3	32.0	32.6	34.1	36.4	31.2	31.8	33.3	35.6	30.5	31.0	32.5	34.7	28.9	29.5	30.9	33.0	26.8	27.3	28.6	30.5
	S/T	0.91	0.88	0.79	0.64	0.94	0.91	0.82	0.67	0.97	0.93	0.84	0.68	1.00	0.96	0.87	0.70	1.00	1.00	0.90	0.73	1.00	1.00	0.91	0.74
	ΔT	26	26	24	21	26	26	25	21	26	26	25	21	27	26	25	21	25	26	24	21	23	24	23	20
	kW	2.45	2.50	2.58	2.66	2.63	2.69	2.77	2.86	2.79	2.85	2.94	3.04	2.93	3.00	3.09	3.19	3.05	3.12	3.22	3.33	3.16	3.23	3.33	3.44
	Amps	9.0	9.2	9.5	9.9	9.7	10.0	10.3	10.7	10.6	10.8	11.2	11.6	11.3	11.6	12.0	12.4	12.0	12.3	12.8	13.2	12.8	13.1	13.5	14.0
	Hi PR	221	238	251	262	248	267	282	294	282	303	320	334	321	346	365	381	361	389	411	428	399	430	454	473
	Lo PR	102	109	119	127	108	115	126	134	112	120	131	139	118	126	137	146	124	132	144	153	128	136	149	158
	MBh	35.5	36.2	37.9	40.4	34.6	35.3	37.0	39.5	33.8	34.5	36.1	38.5	33.0	33.6	35.2	37.6	31.3	31.9	33.5	35.7	29.0	29.6	31.0	33.1
	S/T	0.94	0.91	0.82	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76
	ΔT	26	25	24	21	26	26	24	21	26	26	24	21	25	26	24	21	24	24	24	21	22	23	22	19
kW	2.51	2.56	2.64	2.72	2.70	2.75	2.84	2.93	2.86	2.92	3.01	3.11	3.01	3.07	3.17	3.27	3.13	3.20	3.30	3.41	3.24	3.31	3.42	3.53	
Amps	9.2	9.5	9.8	10.1	10.0	10.2	10.6	11.0	10.9	11.1	11.5	11.9	11.6	11.9	12.3	12.8	12.4	12.7	13.1	13.6	13.1	13.5	13.9	14.5	
Hi PR	228	245	259	270	256	275	290	303	291	313	330	345	331	356	376	392	372	401	423	441	412	443	468	488	
Lo PR	106	112	123	131	112	119	130	138	116	123	135	143	122	130	141	151	128	136	148	158	132	140	153	163	
MBh	36.5	37.2	39.0	41.6	35.7	36.4	38.1	40.6	34.8	35.5	37.2	39.7	34.0	34.6	36.3	38.7	32.3	32.9	34.5	36.8	29.9	30.5	31.9	34.1	
S/T	0.99	0.95	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.77	1.00	1.00	0.98	0.80	1.00	1.00	0.99	0.80	
ΔT	25	24	23	20	24	24	23	20	24	24	23	20	23	24	23	20	22	22	23	20	20	21	21	19	
kW	2.53	2.58	2.66	2.74	2.72	2.77	2.86	2.95	2.88	2.95	3.04	3.14	3.03	3.10	3.20	3.30	3.16	3.22	3.33	3.44	3.26	3.33	3.44	3.56	
Amps	9.3	9.5	9.9	10.2	10.1	10.3	10.7	11.1	11.0	11.2	11.6	12.1	11.7	12.0	12.4	12.9	12.5	12.8	13.2	13.8	13.3	13.6	14.0	14.6	
Hi PR	230	248	261	273	258	278	293	306	294	316	334	348	334	360	380	396	376	405	427	446	416	447	472	493	
Lo PR	107	113	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	159	133	142	155	165	

Amps = outdoor unit amps (comp.+fan)
kW = Total system power

Shaded area reflects AHR1 conditions

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB		OUTDOOR AMBIENT TEMPERATURE																																															
		65								75								85								95								105								115							
		AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71														
1350	MBh	32.9	34.1	37.4	-	32.2	33.3	36.5	-	31.4	32.5	35.7	-	30.6	31.7	34.8	-	29.1	30.2	33.0	-	27.0	27.9	30.6	-	29.1	30.2	33.0	-	27.0	27.9	30.6	-																
	S/T	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.82	0.69	0.48	-	0.85	0.71	0.49	-	0.88	0.74	0.51	-	0.89	0.74	0.51	-	0.88	0.74	0.51	-	0.89	0.74	0.51	-																
	ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	17	15	11	-	16	14	11	-	17	15	11	-	16	14	11	-																
	kW	2.44	2.49	2.55	-	2.61	2.65	2.73	-	2.75	2.80	2.88	-	2.88	2.94	3.02	-	2.99	3.05	3.14	-	3.08	3.14	3.24	-	2.99	3.05	3.14	-	3.08	3.14	3.24	-																
	Amps	9.7	9.9	10.0	-	10.1	10.3	10.5	-	10.6	10.8	11.0	-	11.0	11.2	11.4	-	11.4	11.6	11.8	-	11.8	12.0	12.2	-	11.4	11.6	11.8	-	11.8	12.0	12.2	-																
70	HI PR	183	197	208	-	205	221	234	-	234	252	266	-	266	286	302	-	299	322	340	-	331	356	376	-	299	322	340	-	331	356	376	-																
	LO PR	95	101	110	-	100	107	117	-	104	111	121	-	110	117	127	-	115	122	134	-	119	126	138	-	115	122	134	-	119	126	138	-																
	MBh	32.0	33.1	36.3	-	31.2	32.4	35.5	-	30.5	31.6	34.6	-	29.7	30.8	33.8	-	28.2	29.3	32.1	-	26.2	27.1	29.7	-	28.2	29.3	32.1	-	26.2	27.1	29.7	-																
	S/T	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.84	0.70	0.49	-	0.85	0.71	0.49	-	0.84	0.70	0.49	-	0.85	0.71	0.49	-																
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-	18	16	12	-	17	15	11	-																
1050	kW	2.42	2.47	2.54	-	2.59	2.64	2.71	-	2.73	2.78	2.86	-	2.86	2.91	3.00	-	2.96	3.02	3.11	-	3.06	3.12	3.21	-	2.96	3.02	3.11	-	3.06	3.12	3.21	-																
	Amps	9.7	9.8	10.0	-	10.1	10.2	10.4	-	10.6	10.7	10.9	-	11.0	11.1	11.3	-	11.4	11.5	11.8	-	11.8	11.9	12.2	-	11.4	11.5	11.8	-	11.8	11.9	12.2	-																
	HI PR	181	195	206	-	203	219	231	-	231	249	263	-	264	284	299	-	296	319	337	-	328	353	372	-	296	319	337	-	328	353	372	-																
	LO PR	94	100	109	-	99	106	116	-	103	110	120	-	109	116	126	-	114	121	132	-	118	125	137	-	114	121	132	-	118	125	137	-																
	MBh	29.5	30.6	33.5	-	28.8	29.9	32.7	-	28.1	29.2	31.9	-	27.4	28.4	31.2	-	26.1	27.0	29.6	-	24.2	25.0	27.4	-	26.1	27.0	29.6	-	24.2	25.0	27.4	-																
75	S/T	0.71	0.59	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-																
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-	19	16	12	-	17	15	11	-																
	kW	2.37	2.42	2.48	-	2.53	2.58	2.65	-	2.67	2.72	2.80	-	2.79	2.85	2.93	-	2.90	2.96	3.04	-	2.99	3.05	3.14	-	2.90	2.96	3.04	-	2.99	3.05	3.14	-																
	Amps	9.6	9.7	9.8	-	10.0	10.1	10.3	-	10.4	10.5	10.7	-	10.8	10.9	11.1	-	11.2	11.3	11.6	-	11.6	11.7	12.0	-	11.2	11.3	11.6	-	11.6	11.7	12.0	-																
	HI PR	176	189	200	-	197	212	224	-	224	242	255	-	256	275	291	-	288	309	327	-	318	342	361	-	288	309	327	-	318	342	361	-																
LO PR	91	97	106	-	96	103	112	-	100	107	116	-	105	112	122	-	110	117	128	-	114	121	133	-	110	117	128	-	114	121	133	-																	

1350	MBh	33.5	34.5	37.3	40.0	32.7	33.7	36.4	39.1	31.9	32.9	35.6	38.2	31.1	32.1	34.7	37.3	29.6	30.5	33.0	35.4	27.4	28.2	30.5	32.8	29.6	30.5	33.0	35.4	27.4	28.2	30.5	32.8	
	S/T	0.88	0.79	0.60	0.38	0.91	0.81	0.62	0.40	0.93	0.84	0.63	0.41	0.96	0.86	0.65	0.42	1.00	0.90	0.68	0.44	1.00	0.90	0.68	0.44	1.00	0.90	0.68	0.44	1.00	0.90	0.68	0.44	
	ΔT	20	18	15	10	20	19	15	11	20	19	15	11	20	19	15	11	20	19	15	11	19	17	14	10	20	19	15	11	19	17	14	10	
	kW	2.46	2.50	2.57	2.65	2.62	2.67	2.75	2.83	2.77	2.82	2.91	2.99	2.90	2.96	3.04	3.14	3.01	3.07	3.16	3.26	3.10	3.17	3.26	3.36	3.01	3.07	3.16	3.26	3.10	3.17	3.26	3.36	
	Amps	9.8	9.9	10.1	10.3	10.2	10.3	10.5	10.7	10.7	10.8	11.0	11.3	11.1	11.2	11.4	11.7	11.5	11.5	11.7	11.9	12.2	11.9	12.1	12.3	12.6	11.5	11.7	11.9	12.2	11.9	12.1	12.3	12.6
75	HI PR	185	199	210	219	208	223	236	246	236	254	268	280	269	289	306	319	303	326	344	359	334	360	380	396	303	326	344	359	334	360	380	396	
	LO PR	96	102	112	119	101	108	118	126	105	112	123	130	111	118	129	137	116	124	135	144	120	128	139	149	116	124	135	144	120	128	139	149	
	MBh	32.5	33.5	36.2	38.9	31.8	32.7	35.4	38.0	31.0	31.9	34.5	37.1	30.2	31.1	33.7	36.2	28.7	29.6	32.0	34.4	26.6	27.4	29.7	31.8	28.7	29.6	32.0	34.4	26.6	27.4	29.7	31.8	
	S/T	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.89	0.80	0.60	0.39	0.92	0.82	0.62	0.40	0.95	0.85	0.65	0.42	0.96	0.86	0.65	0.42	0.95	0.85	0.65	0.42	0.96	0.86	0.65	0.42	
	ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	20	16	11	21	20	16	11	20	18	15	10	21	19	16	11	20	18	15	10	
1050	kW	2.44	2.49	2.56	2.63	2.61	2.66	2.73	2.81	2.75	2.80	2.89	2.97	2.88	2.94	3.02	3.11	2.99	3.05	3.14	3.23	3.08	3.14	3.24	3.34	3.05	3.10	3.19	3.28	3.08	3.14	3.24	3.34	
	Amps	9.7	9.9	10.0	10.2	10.1	10.3	10.5	10.7	10.6	10.8	11.0	11.2	11.0	11.2	11.4	11.6	11.4	11.4	11.6	11.8	12.1	11.8	12.0	12.2	12.5	11.4	11.6	11.8	12.1	11.8	12.0	12.2	12.5
	HI PR	183	197	208	217	206	221	234	244	234	252	266	277	266	287	303	316	300	322	340	355	331	356	376	392	300	322	340	355	331	356	376	392	
	LO PR	95	101	110	118	100	107	117	124	104	111	121	129	110	117	127	136	115	122	134	142	119	127	138	147	115	122	134	142	119	127	138	147	
	MBh	30.0	30.9	33.4	35.9	29.3	30.2	32.7	35.1	28.6	29.5	31.9	34.2	27.9	28.7	31.1	33.4	26.5	27.3	29.6	31.7	24.6	25.3	27.4	29.4	26.5	27.3	29.6	31.7	24.6	25.3	27.4	29.4	
75	S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40	
	ΔT	21	20	16	11	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	18	15	10	22	20	16	11	20	18	15	10	
	kW	2.39	2.43	2.50	2.57	2.55	2.60	2.67	2.75	2.69	2.74	2.82	2.90	2.81	2.87	2.95	3.04	2.92	2.98	3.07	3.16	3.01	3.07	3.16	3.26	2.92	2.98	3.07	3.16	3.01	3.07	3.16	3.26	
	Amps	9.6	9.7	9.9	10.1	10.0	10.1	10.3	10.5	10.5	10.6	10.8	11.0	10.8	11.0	11.2	11.4	11.2	11.4	11.6	11.9	11.6	11.8	12.0	12.3	11.2	11.4	11.6	11.9	11.6	11.8	12.0	12.3	
	HI PR	178	191	202	211	199	215	227	236	227	244	258	269	258	278	293	306	291	313	330	344	321	345	365	380	291	313	330	344	321	345	365	380	
LO PR	92	98	107	114	97	104	113	121	101	108	118	125	106	113	124	132	112	119	130	138	115	123	134	143	112	119	130	138	115	123	134	143		

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)
 Design Subcooling 9 ±3 °F @ the liquid service valve, ARI 95 test conditions

IDB		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
		ENTERING INDOOR WET BULB TEMPERATURE																							
		1350																							
MBh		34.1	34.8	37.2	39.8	33.3	34.0	36.3	38.8	32.5	33.2	35.5	37.9	31.7	32.4	34.6	37.0	30.1	30.8	32.9	35.1	27.9	28.5	30.5	32.6
S/T		0.96	0.90	0.74	0.6	1.00	0.94	0.76	0.57	1.00	0.96	0.78	0.6	1.00	1.00	0.81	0.60	1.00	1.00	0.84	0.6	1.00	1.00	0.84	0.63
ΔT		22	21	19	15	23	22	19	15	22	22	19	15	22	22	19	15	21	21	19	15	19	19	18	14
kW		2.48	2.52	2.59	2.7	2.64	2.69	2.77	2.85	2.79	2.85	2.93	3.0	2.92	2.98	3.07	3.16	3.03	3.09	3.19	3.3	3.13	3.19	3.29	3.39
/anos		9.8	10.0	10.1	10.3	10.2	10.4	10.6	10.8	10.7	10.9	11.1	11.3	11.1	11.3	11.5	11.8	11.5	11.7	12.0	12.2	12.0	12.1	12.4	12.7
Hi PR		187	201	212	221.5	210	226	238	249	238	257	271	282.7	272	292	309	322	306	329	347	362.2	338	363	384	400
Lo PR		97	103	113	120.0	103	109	119	127	107	113	124	131.8	112	119	130	138	117	125	136	145.1	121	129	141	150
		1200																							
MBh		33.1	33.8	36.1	38.6	32.3	33.0	35.3	37.7	31.5	32.2	34.4	36.8	30.8	31.4	33.6	35.9	29.2	29.9	31.9	34.1	27.1	27.7	29.6	31.6
S/T		0.92	0.86	0.70	0.5	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.6	1.00	0.95	0.77	0.58	1.00	0.98	0.80	0.6	1.00	0.99	0.81	0.60
ΔT		23	22	19	16	24	23	20	16	24	23	20	16	24	23	20	16	22	22	20	16	21	21	18	15
kW		2.46	2.50	2.57	2.6	2.62	2.67	2.75	2.83	2.77	2.82	2.91	3.0	2.90	2.96	3.05	3.14	3.01	3.07	3.16	3.3	3.10	3.17	3.26	3.36
/anos		9.8	9.9	10.1	10.3	10.2	10.3	10.5	10.7	10.7	10.8	11.0	11.3	11.1	11.2	11.5	11.7	11.5	11.7	11.9	12.2	11.9	12.1	12.3	12.6
Hi PR		185	199	210	219.3	208	223	236	246	236	254	268	279.9	269	289	306	319	303	326	344	358.6	334	360	380	396
Lo PR		96	102	112	118.8	102	108	118	126	105	112	123	130.5	111	118	129	137	116	124	135	143.6	120	128	140	149
		1050																							
MBh		30.5	31.2	33.3	35.6	29.8	30.5	32.6	34.8	29.1	29.8	31.8	34.0	28.4	29.0	31.0	33.2	27.0	27.6	29.5	31.5	25.0	25.5	27.3	29.2
S/T		0.89	0.83	0.68	0.5	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.5	0.97	0.91	0.74	0.55	1.01	0.95	0.77	0.6	1.02	0.95	0.78	0.58
ΔT		24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	19	15
kW		2.41	2.45	2.52	2.6	2.57	2.62	2.69	2.77	2.71	2.76	2.84	2.9	2.84	2.89	2.98	3.07	2.94	3.00	3.09	3.2	3.03	3.10	3.19	3.29
/anos		9.7	9.8	9.9	10.1	10.0	10.2	10.4	10.6	10.5	10.6	10.8	11.1	10.9	11.1	11.3	11.5	11.3	11.5	11.7	11.9	11.7	11.9	12.1	12.4
Hi PR		179	193	204	212.7	201	217	229	239	229	246	260	271.5	261	281	296	309	293	316	333	347.8	324	349	368	384
Lo PR		93	99	108	115.3	98	105	114	122	102	109	119	126.6	107	114	125	133	113	120	131	139.3	117	124	135	144
		85																							
MBh		34.7	35.3	37.0	39.5	33.9	34.5	36.2	38.6	33.1	33.7	35.3	37.7	32.3	32.9	34.4	36.7	30.6	31.2	32.7	34.9	28.4	28.9	30.3	32.3
S/T		1.00	0.98	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.97	0.78	1.00	1.00	1.00	0.81	1.00	1.00	0.82	
ΔT		24	23	22	19	23	24	22	19	23	23	22	19	22	22	23	20	21	21	22	19	19	20	21	18
kW		2.49	2.54	2.61	2.68	2.66	2.71	2.79	2.87	2.81	2.87	2.95	3.04	2.94	3.00	3.09	3.19	3.06	3.12	3.21	3.31	3.15	3.22	3.31	3.42
/anos		9.9	10.0	10.2	10.4	10.3	10.4	10.6	10.8	10.8	10.9	11.1	11.4	11.2	11.4	11.6	11.8	11.6	11.8	12.0	12.3	12.0	12.2	12.5	12.7
Hi PR		189	203	214	224	212	228	241	251	241	259	274	285	274	295	312	325	309	332	351	366	341	367	387	404
Lo PR		98	104	114	121	104	110	120	128	108	114	125	133	113	120	131	140	118	126	138	147	123	130	142	152
		1350																							
MBh		33.7	34.3	35.9	38.3	32.9	33.5	35.1	37.5	32.1	32.7	34.3	36.6	31.3	31.9	33.4	35.7	29.7	30.3	31.8	33.9	27.6	28.1	29.4	31.4
S/T		0.96	0.93	0.84	0.68	1.00	0.96	0.87	0.71	1.00	0.99	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.96	0.78	1.00	1.00	0.96	0.78
ΔT		25	24	23	20	25	25	23	20	25	25	23	20	24	24	24	20	23	23	23	20	21	22	22	19
kW		2.48	2.52	2.59	2.67	2.64	2.69	2.77	2.85	2.79	2.85	2.93	3.02	2.92	2.98	3.07	3.16	3.03	3.09	3.19	3.28	3.13	3.19	3.29	3.39
/anos		9.8	10.0	10.1	10.3	10.2	10.4	10.6	10.8	10.7	10.9	11.1	11.3	11.1	11.3	11.5	11.8	11.5	11.7	12.0	12.2	12.0	12.1	12.4	12.7
Hi PR		187	201	212	221	210	226	238	249	238	257	271	283	272	292	309	322	306	329	347	362	338	363	384	400
Lo PR		97	103	113	120	103	109	119	127	107	113	124	132	112	119	130	138	117	125	136	145	121	129	141	150
		1200																							
MBh		31.1	31.7	33.2	35.4	30.3	30.9	32.4	34.6	29.6	30.2	31.6	33.7	28.9	29.5	30.9	32.9	27.5	28.0	29.3	31.3	25.4	25.9	27.2	29.0
S/T		0.93	0.90	0.81	0.66	0.96	0.93	0.84	0.68	0.99	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75
ΔT		25	25	24	20	26	25	24	21	26	25	24	21	25	25	24	21	24	25	24	20	22	23	22	19
kW		2.42	2.47	2.54	2.61	2.59	2.64	2.71	2.79	2.73	2.78	2.86	2.95	2.86	2.91	3.00	3.09	2.96	3.02	3.11	3.21	3.06	3.12	3.21	3.31
/anos		9.7	9.8	10.0	10.2	10.1	10.2	10.4	10.6	10.6	10.7	10.9	11.1	11.0	11.1	11.3	11.6	11.4	11.5	11.7	12.0	11.8	11.9	12.2	12.5
Hi PR		181	195	206	215	203	219	231	241	231	249	263	274	263	284	299	312	296	319	337	351	327	352	372	388
Lo PR		94	100	109	116	99	106	115	123	103	110	120	128	109	115	126	134	114	121	132	141	118	125	137	146

Amps = outdoor unit amps (comp. + fan)
 Design Subcooling 9 ± 3 °F @ the liquid service valve, ARI 95 test conditions

Shaded area reflects AHRI conditions
 kW = Total system power

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.

IDB		OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
		ENTERING INDOOR WET BULB TEMPERATURE																							
		AIRFLOW																							
70	MBh	36.0	37.3	40.9	-	35.2	36.4	39.9	-	34.3	35.6	39.0	-	33.5	34.7	38.0	-	31.8	33.0	36.1	-	29.5	30.5	33.5	-
	S/T	0.69	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.79	0.66	0.46	-
	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-
	kW	2.78	2.84	2.92	-	2.98	3.04	3.13	-	3.15	3.21	3.31	-	3.30	3.37	3.47	-	3.43	3.50	3.61	-	3.54	3.61	3.73	-
	Amps	10.7	10.9	11.2	-	11.5	11.8	12.1	-	12.5	12.7	13.2	-	13.3	13.6	14.0	-	14.1	14.5	14.9	-	14.9	15.3	15.8	-
	Hi PR	209	225	238	-	235	253	267	-	267	288	304	-	304	328	346	-	343	369	389	-	378	407	430	-
	Lo PR	101	107	117	-	106	113	124	-	111	118	129	-	116	124	135	-	122	130	141	-	126	134	146	-
	MBh	39.0	40.4	44.3	-	38.1	39.5	43.3	-	37.2	38.5	42.2	-	36.3	37.6	41.2	-	34.5	35.7	39.1	-	31.9	33.1	36.3	-
	S/T	0.71	0.59	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	kW	2.84	2.90	2.98	-	3.05	3.11	3.20	-	3.22	3.29	3.39	-	3.38	3.45	3.55	-	3.51	3.58	3.70	-	3.63	3.70	3.82	-
	Amps	10.9	11.2	11.6	-	11.8	12.1	12.5	-	12.8	13.1	13.5	-	13.7	14.0	14.4	-	14.5	14.9	15.3	-	15.4	15.7	16.2	-
Hi PR	216	232	245	-	242	261	275	-	276	297	313	-	314	338	357	-	353	380	401	-	390	420	443	-	
Lo PR	104	111	121	-	110	117	127	-	114	121	132	-	120	127	139	-	126	134	146	-	130	138	151	-	
MBh	40.2	41.6	45.6	-	39.2	40.7	44.6	-	38.3	39.7	43.5	-	37.4	38.7	42.4	-	35.5	36.8	40.3	-	32.9	34.1	37.3	-	
S/T	0.75	0.62	0.43	-	0.77	0.65	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.86	0.72	0.50	-	
ΔT	18	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-	
kW	2.87	2.92	3.01	-	3.07	3.13	3.22	-	3.25	3.31	3.41	-	3.41	3.48	3.58	-	3.54	3.61	3.73	-	3.66	3.73	3.85	-	
Amps	11.0	11.3	11.7	-	11.9	12.2	12.6	-	12.9	13.2	13.6	-	13.8	14.1	14.6	-	14.6	15.0	15.5	-	15.5	15.9	16.4	-	
Hi PR	218	235	248	-	245	263	278	-	278	300	316	-	317	341	360	-	357	384	405	-	394	424	448	-	
Lo PR	105	112	122	-	111	118	129	-	115	123	134	-	121	129	141	-	127	135	147	-	131	140	152	-	
75	MBh	36.6	37.7	40.8	43.8	35.8	36.8	39.9	42.8	34.9	35.9	38.9	41.8	34.1	35.1	38.0	40.7	32.4	33.3	36.1	38.7	30.0	30.9	33.4	35.8
	S/T	0.78	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.90	0.80	0.61	0.39
	ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	19	15	10
	kW	2.80	2.86	2.94	3.03	3.00	3.06	3.15	3.24	3.17	3.24	3.33	3.44	3.33	3.39	3.50	3.61	3.46	3.53	3.64	3.75	3.57	3.64	3.76	3.88
	Amps	10.8	11.0	11.3	11.8	11.6	11.9	12.2	12.7	12.6	12.9	13.3	13.8	13.4	13.7	14.2	14.7	14.2	14.6	15.1	15.6	15.1	15.4	15.9	16.5
	Hi PR	212	228	240	251	237	256	270	281	270	291	307	320	308	331	350	365	346	372	393	410	382	411	434	453
	Lo PR	102	108	118	126	108	114	125	133	112	119	130	138	117	125	136	145	123	131	143	152	127	135	148	157
	MBh	39.7	40.8	44.2	47.4	38.7	39.9	43.2	46.3	37.8	38.9	42.2	45.2	36.9	38.0	41.1	44.1	35.1	36.1	39.1	41.9	32.5	33.4	36.2	38.8
	S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.37	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10
	kW	2.87	2.92	3.01	3.10	3.07	3.13	3.22	3.32	3.25	3.31	3.41	3.52	3.41	3.48	3.58	3.70	3.54	3.61	3.73	3.84	3.66	3.73	3.85	3.97
	Amps	11.0	11.3	11.7	12.1	11.9	12.2	12.6	13.0	12.9	13.2	13.6	14.1	13.8	14.1	14.6	15.1	14.6	15.0	15.5	16.1	15.5	15.9	16.4	17.0
Hi PR	218	235	248	259	245	263	278	290	278	300	316	330	317	341	360	376	357	384	405	423	394	424	448	467	
Lo PR	105	112	122	130	111	118	129	137	115	123	134	143	121	129	141	150	127	135	147	157	131	140	152	162	
MBh	40.9	42.1	45.5	48.9	39.9	41.1	44.5	47.7	39.0	40.1	43.4	46.6	38.0	39.1	42.4	45.5	36.1	37.2	40.2	43.2	33.4	34.4	37.3	40.0	
S/T	0.85	0.76	0.57	0.37	0.88	0.79	0.60	0.38	0.90	0.81	0.61	0.39	0.93	0.83	0.63	0.41	0.97	0.86	0.65	0.42	0.97	0.87	0.66	0.42	
ΔT	20	19	15	11	20	19	15	11	21	19	15	11	21	19	16	11	20	19	15	11	19	18	14	10	
kW	2.89	2.94	3.03	3.12	3.09	3.15	3.25	3.35	3.27	3.34	3.44	3.55	3.43	3.50	3.61	3.72	3.57	3.64	3.76	3.87	3.68	3.76	3.88	4.00	
Amps	11.1	11.4	11.8	12.2	12.0	12.3	12.7	13.2	13.0	13.3	13.8	14.3	13.9	14.2	14.7	15.2	14.8	15.1	15.6	16.2	15.6	16.0	16.5	17.2	
Hi PR	220	237	250	261	247	266	281	293	281	303	320	333	322	345	364	380	360	388	409	427	398	428	452	472	
Lo PR	106	113	123	131	112	119	130	139	116	124	135	144	122	130	142	151	128	136	149	158	133	141	154	164	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

IDB		OUTDOOR AMBIENT TEMPERATURE																																										
		65						75						95						105						115																		
		59			63			67			71			75			79			83			87			91			95			99			103			107			111			115
AIRFLOW		ENTERING INDOOR WET BULB TEMPERATURE																																										
80	1225	MBh	37.3	38.1	40.7	43.5	36.4	37.2	39.7	42.5	35.5	36.3	38.8	41.5	34.7	35.4	37.8	40.5	32.9	33.6	36.0	38.4	30.5	31.2	33.3	35.6																		
		S/T	0.86	0.80	0.65	0.49	0.89	0.83	0.68	0.51	0.91	0.85	0.69	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.56	1.00	0.95	0.77	0.58																		
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15																		
		kW	2.82	2.88	2.96	3.05	3.02	3.08	3.17	3.27	3.20	3.26	3.36	3.46	3.35	3.42	3.53	3.64	3.48	3.56	3.67	3.78	3.60	3.67	3.79	3.91																		
		Amps	10.8	11.1	11.4	11.9	11.7	12.0	12.4	12.8	12.7	13.0	13.4	13.9	13.5	13.8	14.3	14.8	14.4	14.7	15.2	15.8	15.2	15.6	16.1	16.7																		
		Hi PR	214	230	243	253	240	258	273	284	273	294	310	323	311	334	353	368	350	376	397	414	386	416	439	458																		
	Lo PR	103	109	119	127	109	116	126	134	113	120	131	140	119	126	138	147	124	132	144	154	129	137	149	159																			
	MBh	40.4	41.3	44.1	47.1	39.4	40.3	43.1	46.0	38.5	39.3	42.0	44.9	37.6	38.4	41.0	43.8	35.7	36.5	39.0	41.6	33.0	33.8	36.1	38.6																			
	S/T	0.89	0.83	0.68	0.51	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.56	1.00	0.95	0.77	0.58	1.00	0.96	0.78	0.58																			
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15																			
	kW	2.89	2.94	3.03	3.12	3.09	3.15	3.25	3.35	3.27	3.34	3.44	3.55	3.43	3.50	3.61	3.72	3.57	3.64	3.76	3.88	3.68	3.76	3.88	4.01																			
	Amps	11.1	11.4	11.8	12.2	12.0	12.3	12.7	13.2	13.0	13.3	13.8	14.3	13.9	14.2	14.7	15.2	14.8	15.1	15.6	16.2	15.6	16.0	16.5	17.2																			
Hi PR	220	237	250	261	247	266	281	293	281	303	320	333	320	345	364	380	360	388	410	427	398	428	452	472																				
Lo PR	106	113	123	131	112	119	130	139	116	124	135	144	122	130	142	151	128	136	149	158	133	141	154	164																				
MBh	41.6	42.5	45.4	48.5	40.6	41.5	44.3	47.4	39.6	40.5	43.3	46.3	38.7	39.5	42.2	45.1	36.7	37.6	40.1	42.9	34.0	34.8	37.2	39.7																				
S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.74	0.55	1.00	0.93	0.75	0.56	1.00	0.96	0.78	0.58	1.00	1.00	0.81	0.60	1.00	1.00	0.82	0.61																				
ΔT	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	21	22	19	15	20	20	18	14																				
kW	2.91	2.96	3.05	3.14	3.11	3.18	3.27	3.37	3.30	3.36	3.47	3.58	3.46	3.53	3.64	3.75	3.60	3.67	3.79	3.91	3.71	3.79	3.91	4.04																				
Amps	11.2	11.5	11.9	12.3	12.1	12.4	12.8	13.3	13.1	13.5	13.9	14.4	14.0	14.4	14.8	15.4	14.9	15.3	15.8	16.4	15.8	16.2	16.7	17.3																				
Hi PR	223	240	253	264	250	269	284	296	284	306	323	337	324	348	368	383	364	392	414	431	402	433	457	477																				
Lo PR	107	114	124	132	113	120	131	140	118	125	137	145	123	131	143	153	129	138	150	160	134	142	155	166																				
MBh	37.9	38.6	40.5	43.2	37.0	37.7	39.5	42.2	36.2	36.9	38.6	41.2	35.3	36.0	37.7	40.2	33.5	34.2	35.8	38.2	31.0	31.6	33.1	35.4																				
S/T	0.90	0.87	0.78	0.63	0.93	0.90	0.81	0.66	0.95	0.92	0.83	0.67	0.98	0.95	0.86	0.70	1.00	1.00	0.89	0.72	1.00	1.00	0.90	0.73																				
ΔT	26	25	24	21	26	25	24	21	26	25	24	21	26	26	24	21	25	25	24	21	23	24	22	19																				
kW	2.84	2.90	2.98	3.07	3.04	3.11	3.20	3.29	3.22	3.29	3.39	3.49	3.38	3.45	3.55	3.66	3.51	3.58	3.70	3.81	3.63	3.70	3.82	3.94																				
Amps	10.9	11.2	11.6	12.0	11.8	12.1	12.5	12.9	12.8	13.1	13.5	14.0	13.6	14.0	14.4	15.0	14.5	14.9	15.3	15.9	15.4	15.7	16.2	16.8																				
Hi PR	216	232	245	256	242	261	275	287	276	297	313	327	314	338	357	372	353	380	401	418	390	420	443	462																				
Lo PR	104	110	121	128	110	117	127	136	114	121	132	141	120	127	139	148	126	134	146	155	130	138	151	161																				
MBh	41.1	41.9	43.9	46.8	40.1	40.9	42.8	45.7	39.2	39.9	41.8	44.6	38.2	39.0	40.8	43.5	36.3	37.0	38.8	41.3	33.6	34.3	35.9	38.3																				
S/T	0.93	0.90	0.81	0.66	0.96	0.93	0.84	0.68	0.99	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75																				
ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	21	24	24	23	20	22	23	22	19																				
kW	2.91	2.96	3.05	3.14	3.11	3.18	3.27	3.37	3.30	3.36	3.47	3.58	3.46	3.53	3.64	3.75	3.60	3.67	3.79	3.91	3.71	3.79	3.91	4.04																				
Amps	11.2	11.5	11.9	12.3	12.1	12.4	12.8	13.3	13.1	13.5	13.9	14.4	14.0	14.4	14.8	15.4	14.9	15.3	15.8	16.4	15.8	16.2	16.7	17.3																				
Hi PR	223	240	253	264	250	269	284	296	284	306	323	337	324	348	368	383	364	392	414	431	402	433	457	477																				
Lo PR	107	114	124	132	113	120	131	140	118	125	137	145	123	131	143	153	129	138	150	160	134	142	155	166																				
MBh	42.3	43.1	45.2	48.2	41.3	42.1	44.1	47.1	40.3	41.1	43.1	45.9	39.4	40.1	42.0	44.8	37.4	38.1	39.9	42.6	34.6	35.3	37.0	39.4																				
S/T	0.98	0.94	0.85	0.69	1.00	0.98	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.97	0.78	1.00	1.00	0.98	0.79																				
ΔT	24	24	22	19	24	24	23	20	24	24	23	20	23	23	23	20	22	22	23	20	20	21	21	18																				
kW	2.93	2.99	3.07	3.17	3.14	3.20	3.30	3.40	3.32	3.39	3.49	3.60	3.49	3.56	3.67	3.78	3.62	3.70	3.82	3.94	3.74	3.82	3.94	4.07																				
Amps	11.3	11.6	12.0	12.4	12.2	12.5	12.9	13.4	13.3	13.6	14.0	14.5	14.2	14.5	15.0	15.5	15.0	15.4	15.9	16.5	15.9	16.3	16.9	17.5																				
Hi PR	225	242	255	266	252	271	287	299	287	309	326	340	327	352	371	387	368	396	418	436	406	437	462	481																				
Lo PR	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167																				

Amps = outdoor unit amps (comp.+fan)
kW = Total system power

Shaded area reflects AHRI conditions

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB		OUTDOOR AMBIENT TEMPERATURE																																															
		65								75								85								95								105								115							
		AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71														
1400	MBh	40.4	41.9	45.9	-	39.5	40.9	44.8	-	38.5	39.9	43.7	-	37.6	38.9	42.7	-	35.7	37.0	40.5	-	33.1	34.3	37.5	-	35.7	37.0	40.5	-	33.1	34.3	37.5	-																
	S/T	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-																
	ΔT	19	16	12	-	19	16	12	-	19	16	13	-	19	17	13	-	19	16	12	-	18	15	12	-	19	16	12	-	18	15	12	-																
	kW	3.17	3.23	3.32	-	3.39	3.46	3.56	-	3.59	3.66	3.77	-	3.77	3.84	3.96	-	3.91	4.00	4.12	-	4.04	4.13	4.26	-	3.91	4.00	4.12	-	4.04	4.13	4.26	-																
	Amps	11.6	11.9	12.3	-	12.6	12.9	13.3	-	13.7	14.0	14.5	-	14.6	15.0	15.5	-	15.5	15.9	16.5	-	16.5	16.9	17.4	-	15.5	15.9	16.5	-	16.5	16.9	17.4	-																
	Hi PR	215	231	244	-	241	259	274	-	274	295	311	-	312	336	354	-	351	377	399	-	388	417	440	-	351	377	399	-	388	417	440	-																
	Lo PR	104	111	121	-	110	117	128	-	115	122	133	-	120	128	140	-	126	134	146	-	130	139	151	-	126	134	146	-	130	139	151	-																
	MBh	43.8	45.4	49.7	-	42.7	44.3	48.5	-	41.7	43.2	47.4	-	40.7	42.2	46.2	-	38.7	40.1	43.9	-	35.8	37.1	40.7	-	38.7	40.1	43.9	-	35.8	37.1	40.7	-																
	S/T	0.73	0.61	0.43	-	0.76	0.64	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.84	0.70	0.48	-	0.84	0.70	0.49	-	0.84	0.70	0.48	-	0.84	0.70	0.49	-																
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-	19	16	12	-	17	15	11	-																
kW	3.24	3.30	3.40	-	3.47	3.54	3.65	-	3.67	3.75	3.87	-	3.86	3.94	4.06	-	4.01	4.09	4.22	-	4.14	4.23	4.36	-	4.01	4.09	4.22	-	4.14	4.23	4.36	-																	
Amps	12.0	12.3	12.7	-	12.9	13.2	13.7	-	14.1	14.4	14.9	-	15.0	15.4	15.9	-	16.0	16.4	16.9	-	16.9	17.4	17.9	-	16.0	16.4	16.9	-	16.9	17.4	17.9	-																	
Hi PR	221	238	251	-	248	267	282	-	282	304	321	-	321	346	365	-	362	389	411	-	400	430	454	-	362	389	411	-	400	430	454	-																	
Lo PR	108	114	125	-	114	121	132	-	118	126	137	-	124	132	144	-	130	138	151	-	134	143	156	-	130	138	151	-	134	143	156	-																	
MBh	45.1	46.7	51.2	-	44.0	45.6	50.0	-	43.0	44.5	48.8	-	41.9	43.5	47.6	-	39.8	41.3	45.2	-	36.9	38.2	41.9	-	39.8	41.3	45.2	-	36.9	38.2	41.9	-																	
S/T	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.88	0.73	0.51	-	0.88	0.74	0.51	-	0.88	0.73	0.51	-	0.88	0.74	0.51	-																	
ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	15	12	-	17	14	11	-	18	15	12	-	17	14	11	-																	
kW	3.26	3.33	3.42	-	3.50	3.57	3.67	-	3.70	3.78	3.90	-	3.89	3.97	4.09	-	4.04	4.13	4.26	-	4.18	4.26	4.40	-	4.04	4.13	4.26	-	4.18	4.26	4.40	-																	
Amps	12.1	12.4	12.8	-	13.0	13.4	13.8	-	14.2	14.5	15.0	-	15.2	15.5	16.0	-	16.1	16.5	17.1	-	17.1	17.5	18.1	-	16.1	16.5	17.1	-	17.1	17.5	18.1	-																	
Hi PR	223	240	254	-	251	270	285	-	285	307	324	-	325	349	369	-	365	393	415	-	404	434	459	-	365	393	415	-	404	434	459	-																	
Lo PR	109	116	126	-	115	122	133	-	119	127	139	-	125	133	146	-	131	140	152	-	136	144	158	-	131	140	152	-	136	144	158	-																	
MBh	41.1	42.3	45.8	49.1	40.1	41.3	44.7	48.0	39.2	40.3	43.7	46.8	38.2	39.3	42.6	45.7	36.3	37.4	40.5	43.4	33.6	34.6	37.5	40.2	36.3	37.4	40.5	43.4	33.6	34.6	37.5	40.2																	
S/T	0.81	0.72	0.55	0.35	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41																	
ΔT	22	20	16	11	22	20	17	11	22	20	17	11	22	20	16	11	22	20	16	11	21	18	15	11	22	20	16	11	20	19	15	11																	
kW	3.19	3.25	3.35	3.45	3.42	3.49	3.59	3.70	3.62	3.69	3.80	3.92	3.79	3.87	3.99	4.12	3.95	4.03	4.15	4.29	4.08	4.16	4.29	4.43	3.95	4.03	4.15	4.29	4.08	4.16	4.29	4.43																	
Amps	11.7	12.0	12.4	12.9	12.7	13.0	13.4	13.9	13.8	14.1	14.6	15.1	14.7	15.1	15.6	16.2	15.7	16.1	16.6	17.2	16.6	17.0	17.6	18.3	15.7	16.1	16.6	17.2	16.6	17.0	17.6	18.3																	
Hi PR	217	233	246	257	243	262	276	288	277	298	314	328	315	339	358	373	354	381	403	420	391	421	445	464	354	381	403	420	391	421	445	464																	
Lo PR	105	112	122	130	111	118	129	138	116	123	134	143	122	129	141	150	127	136	148	158	132	140	153	163	127	136	148	158	132	140	153	163																	
MBh	44.5	45.8	49.6	53.2	43.5	44.8	48.4	52.0	42.4	43.7	47.3	50.8	41.4	42.6	46.1	49.5	39.3	40.5	43.8	47.0	36.4	37.5	40.6	43.6	39.3	40.5	43.8	47.0	36.4	37.5	40.6	43.6																	
S/T	0.84	0.75	0.57	0.36	0.87	0.77	0.59	0.38	0.89	0.79	0.60	0.39	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42																	
ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10	21	20	16	11	20	18	15	10																	
kW	3.26	3.33	3.42	3.53	3.50	3.57	3.68	3.79	3.70	3.78	3.90	4.02	3.89	3.97	4.09	4.22	4.04	4.13	4.26	4.39	4.18	4.26	4.40	4.54	4.04	4.13	4.26	4.39	4.18	4.26	4.40	4.54																	
Amps	12.1	12.4	12.8	13.2	13.1	13.4	13.8	14.3	14.2	14.5	15.0	15.6	15.2	15.5	16.1	16.7	16.1	16.5	17.1	17.7	17.1	17.5	18.1	18.8	16.1	16.5	17.1	17.7	17.1	17.5	18.1	18.8																	
Hi PR	223	240	254	265	251	270	285	297	285	307	324	338	325	349	369	385	365	393	415	433	404	434	459	478	365	393	415	433	404	434	459	478																	
Lo PR	109	116	126	134	115	122	133	142	119	127	139	148	125	133	146	155	131	140	153	162	136	145	158	168	131	140	153	162	136	145	158	168																	
MBh	45.8	47.2	51.1	54.8	44.8	46.1	49.9	53.6	43.7	45.0	48.7	52.3	42.6	43.9	47.5	51.0	40.5	41.7	45.1	48.5	37.5	38.6	41.8	44.9	40.5	41.7	45.1	48.5	37.5	38.6	41.8	44.9																	
S/T	0.88	0.78	0.59	0.38	0.91	0.81	0.61	0.40	0.93	0.83	0.63	0.41	0.96	0.86	0.65	0.42	1.00	0.89	0.67	0.43	1.00	0.90	0.68	0.44	1.00	0.89	0.67	0.43	1.00	0.90	0.68	0.44																	
ΔT	21	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10	21	19	16	11	19	18	15	10																	
kW	3.29	3.35	3.45	3.55	3.52	3.59	3.70	3.82	3.73	3.81	3.93	4.05	3.92	4.00	4.12	4.26	4.07	4.16	4.29	4.43	4.21	4.30	4.44	4.58	4.07	4.16	4.29	4.43	4.21	4.30	4.44	4.58																	
Amps	12.2	12.5	12.9	13.4	13.2	13.5	13.9	14.5	14.3	14.7	15.1	15.7	15.3	15.7	16.2	16.8	16.3	16.7	17.2	17.9	17.3	17.7	18.3	19.0	16.3	16.7	17.2	17.9	17.3	17.7	18.3	19.0																	
Hi PR	226	243	256	267	253	272	288	300	288	310	327	341	328	353	373	389	369	397	419	437	408	439	463	483	369	397	419	437	408	439	463	483																	
Lo PR	110	117	127	136	116	123	135	143	120	128	140	149	127	135	147	157	133	141	154	164	137	146	159	170	133	141	154	164	137	146	159	170																	

High and low pressures are measured at the liquid and suction service valves. Shaded area reflects ACCA (TVA) conditions. Amps = outdoor unit amps (comp. fan) kW = Total system power

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	MBh	41.8	42.7	45.6	48.8	40.8	41.7	44.6	47.7	39.9	40.7	43.5	46.5	38.9	39.7	42.5	45.4	36.9	37.8	40.3	43.1	34.2	35.0	37.4	39.9	
	S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.01	0.94	0.77	0.57	1.01	0.95	0.77	0.58	
	ΔT	24	23	20	16	25	24	20	16	25	24	20	16	25	24	21	16	24	23	20	16	23	22	19	15	
	kW	3.21	3.28	3.37	3.47	3.44	3.51	3.62	3.73	3.65	3.72	3.83	3.95	3.82	3.90	4.03	4.15	3.98	4.06	4.19	4.32	4.11	4.20	4.33	4.47	
	Amps	11.9	12.1	12.5	13.0	12.8	13.1	13.6	14.1	13.9	14.3	14.7	15.3	14.9	15.2	15.8	16.3	15.8	16.2	16.8	17.4	16.8	17.2	17.8	18.5	
	Hi PR	219	236	249	259	246	264	279	291	279	301	317	331	318	342	362	377	358	385	407	424	395	426	449	469	
	Lo PR	106	113	124	132	112	120	131	139	117	124	136	145	123	131	143	152	129	137	149	159	133	142	155	165	
	MBh	45.3	46.3	49.5	52.9	44.2	45.2	48.3	51.6	43.2	44.1	47.2	50.4	42.1	43.1	46.0	49.2	40.0	40.9	43.7	46.7	37.1	37.9	40.5	43.3	
	S/T	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.97	0.91	0.74	0.56	1.00	0.94	0.77	0.57	1.00	0.98	0.80	0.60	1.00	0.99	0.80	0.60	
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	23	23	20	16	21	21	19	15	
kW	3.29	3.35	3.45	3.56	3.52	3.59	3.70	3.82	3.73	3.81	3.93	4.05	3.92	4.00	4.12	4.26	4.07	4.16	4.29	4.43	4.21	4.30	4.44	4.58		
Amps	12.2	12.5	12.9	13.4	13.2	13.5	13.9	14.5	14.3	14.7	15.2	15.7	15.3	15.7	16.2	16.8	16.3	16.7	17.3	17.9	17.3	17.7	18.3	19.0		
Hi PR	226	243	256	267	253	272	288	300	288	310	327	341	328	353	373	389	369	397	419	437	408	439	463	483		
Lo PR	110	117	127	136	116	123	135	143	120	128	140	149	127	135	147	157	133	141	154	164	137	146	159	170		
MBh	46.7	47.7	50.9	54.4	45.6	46.6	49.7	53.2	44.5	45.5	48.6	51.9	43.4	44.3	47.4	50.6	41.2	42.1	45.0	48.1	38.2	39.0	41.7	44.6		
S/T	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.96	0.78	0.58	1.00	1.00	0.80	0.60	1.00	1.00	0.83	0.62	1.00	1.00	0.84	0.63		
ΔT	23	22	19	15	23	22	19	15	23	22	19	15	22	23	19	16	21	22	19	15	20	20	18	14		
kW	3.31	3.38	3.48	3.58	3.55	3.62	3.73	3.85	3.76	3.84	3.96	4.08	3.95	4.03	4.16	4.29	4.11	4.19	4.33	4.47	4.24	4.33	4.47	4.62		
Amps	12.3	12.6	13.0	13.5	13.3	13.6	14.1	14.6	14.4	14.8	15.3	15.9	15.4	15.8	16.4	17.0	16.4	16.8	17.4	18.1	17.4	17.9	18.5	19.2		
Hi PR	228	245	259	270	256	275	291	303	291	313	331	345	331	356	376	393	373	401	423	442	412	443	468	488		
Lo PR	111	118	129	137	117	125	136	145	122	129	141	151	128	136	148	158	134	143	156	166	139	147	161	171		
85	MBh	42.5	43.4	45.4	48.5	41.5	42.4	44.4	47.3	40.6	41.3	43.3	46.2	39.6	40.3	42.2	45.1	37.6	38.3	40.1	42.8	34.8	35.5	37.2	39.7	
	S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.88	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.93	0.75	
	ΔT	26	25	24	21	26	26	24	21	26	26	24	21	26	26	25	21	25	25	24	21	23	23	23	20	
	kW	3.24	3.30	3.40	3.50	3.47	3.54	3.65	3.76	3.67	3.75	3.86	3.99	3.85	3.94	4.06	4.19	4.01	4.09	4.22	4.36	4.14	4.23	4.36	4.50	
	Amps	12.0	12.2	12.6	13.1	12.9	13.2	13.7	14.2	14.0	14.4	14.9	15.4	15.0	15.4	15.9	16.5	16.0	16.4	16.9	17.6	16.9	17.4	17.9	18.6	
	Hi PR	221	238	251	262	248	267	282	294	282	304	321	334	321	346	365	381	361	389	411	428	399	430	454	473	
	Lo PR	108	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166	
	MBh	46.1	47.0	49.2	52.5	45.0	45.9	48.1	51.3	43.9	44.8	46.9	50.1	42.9	43.7	45.8	48.8	40.7	41.5	43.5	46.4	37.7	38.5	40.3	43.0	
	S/T	0.96	0.93	0.84	0.68	1.00	0.96	0.87	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78	
	ΔT	25	25	24	20	26	25	24	21	25	25	24	21	25	25	24	21	23	24	24	21	22	22	22	19	
kW	3.31	3.38	3.48	3.58	3.55	3.62	3.73	3.85	3.76	3.84	3.96	4.08	3.95	4.03	4.16	4.29	4.11	4.19	4.33	4.47	4.24	4.33	4.47	4.62		
Amps	12.3	12.6	13.0	13.5	13.3	13.6	14.1	14.6	14.4	14.8	15.3	15.9	15.4	15.8	16.4	17.0	16.4	16.8	17.4	18.1	17.4	17.9	18.5	19.2		
Hi PR	228	245	259	270	256	275	291	303	291	313	331	345	331	356	376	393	373	401	423	442	412	443	468	488		
Lo PR	111	118	129	137	117	125	136	145	122	129	141	151	128	136	148	158	134	143	156	166	139	147	161	171		
1400	MBh	47.5	48.4	50.7	54.1	46.4	47.3	49.5	52.8	45.3	46.1	48.3	51.6	44.2	45.0	47.1	50.3	42.0	42.8	44.8	47.8	38.9	39.6	41.5	44.3	
	S/T	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.93	0.76	1.00	1.00	0.96	0.78	1.00	1.00	0.95	0.81	1.00	1.00	0.96	0.82	
	ΔT	24	24	23	20	24	24	23	20	23	23	23	20	23	23	23	20	21	22	23	20	20	20	21	18	
	kW	3.34	3.40	3.50	3.61	3.58	3.65	3.76	3.88	3.79	3.87	3.99	4.11	3.98	4.06	4.19	4.32	4.14	4.23	4.36	4.50	4.28	4.37	4.51	4.65	
	Amps	12.4	12.7	13.1	13.6	13.4	13.7	14.2	14.7	14.6	14.9	15.4	16.0	15.6	16.0	16.5	17.1	16.6	17.0	17.6	18.2	17.6	18.0	18.6	19.3	
	Hi PR	230	248	262	273	258	278	294	306	294	316	334	348	335	360	380	397	376	405	428	446	416	448	473	493	
	Lo PR	112	119	130	138	118	126	137	146	123	131	143	152	129	137	150	160	135	144	157	167	140	149	163	173	
	1600	MBh	42.5	43.4	45.4	48.5	41.5	42.4	44.4	47.3	40.6	41.3	43.3	46.2	39.6	40.3	42.2	45.1	37.6	38.3	40.1	42.8	34.8	35.5	37.2	39.7
		S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.88	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.93	0.75
		ΔT	26	25	24	21	26	26	24	21	26	26	24	21	26	26	25	21	25	25	24	21	23	23	23	20
kW		3.24	3.30	3.40	3.50	3.47	3.54	3.65	3.76	3.67	3.75	3.86	3.99	3.85	3.94	4.06	4.19	4.01	4.09	4.22	4.36	4.14	4.23	4.36	4.50	
Amps		12.0	12.2	12.6	13.1	12.9	13.2	13.7	14.2	14.0	14.4	14.9	15.4	15.0	15.4	15.9	16.5	16.0	16.4	16.9	17.6	16.9	17.4	17.9	18.6	
Hi PR		221	238	251	262	248	267	282	294	282	304	321	334	321	346	365	381	361	389	411	428	399	430	454	473	
Lo PR		108	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166	
MBh		46.1	47.0	49.2	52.5	45.0	45.9	48.1	51.3	43.9	44.8	46.9	50.1	42.9	43.7	45.8	48.8	40.7	41.5	43.5	46.4	37.7	38.5	40.3	43.0	
S/T		0.96	0.93	0.84	0.68	1.00	0.96	0.87	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78	
ΔT		25	25	24	20	26	25	24	21	25	25	24	21	25	25	24	21	23	24	24	21	22	22	22	19	
kW	3.31	3.38	3.48	3.58	3.55	3.62	3.73	3.85	3.76	3.84	3.96	4.08	3.95	4.03	4.16	4.29	4.11	4.19	4.33	4.47	4.24	4.33	4.47	4.62		
Amps	12.3	12.6	13.0	13.5	13.3	13.6	14.1	14																		

IDB AIRFLOW		OUTDOOR AMBIENT TEMPERATURE																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	1500	MBh	50.1	51.9	56.8	-	48.9	50.7	55.5	-	47.7	49.5	54.2	-	46.6	48.3	52.9	-	44.2	45.8	50.2	-	41.0	42.5	46.5	-	
		S/T	0.67	0.56	0.39	-	0.69	0.58	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.76	0.64	0.44	-	0.77	0.64	0.44	-	
		ΔT	21	18	13	-	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-	19	17	13	-	
		kW	3.87	3.95	4.07	-	4.16	4.24	4.38	-	4.41	4.50	4.65	-	4.63	4.73	4.89	-	4.82	4.93	5.09	-	4.99	5.10	5.26	-	
		Amps	14.4	14.8	15.3	-	15.6	16.0	16.5	-	17.0	17.4	18.0	-	18.2	18.6	19.2	-	19.3	19.8	20.5	-	20.5	21.0	21.7	-	
		HI PR	229	246	260	-	257	276	292	-	292	314	332	-	333	358	378	-	374	403	425	-	413	445	470	-	
	LO PR	101	108	118	-	107	114	125	-	111	119	129	-	117	125	136	-	123	130	142	-	127	135	147	-		
	1750	MBh	54.2	56.2	61.6	-	53.0	54.9	60.1	-	51.7	53.6	58.7	-	50.4	52.3	57.3	-	47.9	49.7	54.4	-	44.4	46.0	50.4	-	
		S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-	
		ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	16	12	-	
		kW	3.96	4.04	4.17	-	4.26	4.35	4.48	-	4.52	4.62	4.76	-	4.75	4.85	5.01	-	4.95	5.05	5.22	-	5.12	5.23	5.40	-	
		Amps	14.8	15.2	15.7	-	16.1	16.4	17.0	-	17.5	17.9	18.5	-	18.7	19.1	19.8	-	19.9	20.4	21.1	-	21.1	21.6	22.4	-	
HI PR		236	254	268	-	265	285	301	-	301	324	342	-	343	369	390	-	386	415	438	-	426	459	484	-		
LO PR	105	111	122	-	111	118	128	-	115	122	133	-	121	128	140	-	126	135	147	-	131	139	152	-			
2000	MBh	55.9	57.9	63.4	-	54.6	56.5	62.0	-	53.3	55.2	60.5	-	52.0	53.9	59.0	-	49.4	51.2	56.1	-	45.7	47.4	51.9	-		
	S/T	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.83	0.70	0.48	-		
	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	13	-	19	16	12	-	18	15	12	-		
	kW	3.99	4.07	4.20	-	4.29	4.38	4.52	-	4.56	4.65	4.80	-	4.79	4.89	5.05	-	4.99	5.10	5.26	-	5.16	5.27	5.44	-		
	Amps	15.0	15.3	15.8	-	16.2	16.6	17.2	-	17.6	18.1	18.7	-	18.9	19.3	20.0	-	20.1	20.6	21.3	-	21.3	21.8	22.6	-		
	HI PR	238	256	271	-	267	288	304	-	304	327	346	-	346	373	394	-	390	419	443	-	430	463	489	-		
LO PR	106	112	123	-	112	119	130	-	116	123	135	-	122	130	142	-	128	136	148	-	132	141	153	-			
75	1500	MBh	50.9	52.4	56.7	60.9	49.7	51.2	55.4	59.5	48.5	50.0	54.1	58.1	47.3	48.8	52.8	56.6	45.0	46.3	50.1	53.8	41.7	42.9	46.4	49.8	
		S/T	0.76	0.68	0.51	0.33	0.79	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.75	0.56	0.36	0.86	0.77	0.59	0.38	0.87	0.78	0.59	0.38	
		ΔT	24	22	18	12	24	22	18	13	24	22	18	13	24	22	18	13	24	23	21	17	12	22	21	17	12
		kW	3.90	3.98	4.10	4.23	4.19	4.28	4.41	4.55	4.45	4.54	4.68	4.84	4.67	4.77	4.93	5.09	4.86	4.97	5.13	5.30	5.03	5.14	5.31	5.48	
		Amps	14.6	14.9	15.4	16.0	15.8	16.1	16.7	17.3	17.1	17.6	18.1	18.8	18.3	18.8	19.4	20.2	19.5	20.0	20.7	21.5	20.7	21.2	21.9	22.8	
		HI PR	231	249	263	274	259	279	295	307	295	317	335	350	336	362	382	398	378	407	430	448	418	449	475	495	
	LO PR	103	109	119	127	108	115	126	134	113	120	131	139	118	126	137	146	124	132	144	153	128	136	149	159		
	1750	MBh	55.1	56.8	61.5	66.0	53.9	55.5	60.0	64.4	52.6	54.1	58.6	62.9	51.3	52.8	57.2	61.4	48.7	50.2	54.3	58.3	45.1	46.5	50.3	54.0	
		S/T	0.79	0.71	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.59	0.38	0.90	0.80	0.61	0.39	0.91	0.81	0.61	0.39	
		ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	18	12	23	23	21	17	12	21	20	16	11
		kW	3.99	4.07	4.20	4.33	4.29	4.38	4.52	4.66	4.56	4.65	4.80	4.96	4.79	4.89	5.05	5.22	4.99	5.10	5.26	5.44	5.16	5.27	5.44	5.63	
		Amps	15.0	15.3	15.8	16.4	16.2	16.6	17.2	17.8	17.6	18.1	18.7	19.4	18.9	19.3	20.0	20.8	20.1	20.6	21.3	22.1	21.3	21.8	22.6	23.5	
HI PR		238	256	271	282	267	288	304	317	304	327	346	360	346	373	394	411	390	419	443	462	431	463	489	510		
LO PR	106	112	123	131	112	119	130	138	116	123	135	144	122	130	142	151	128	136	148	158	132	141	153	163			
2000	MBh	56.8	58.5	63.3	67.9	55.5	57.1	61.8	66.4	54.2	55.8	60.4	64.8	52.8	54.4	58.9	63.2	50.2	51.7	55.9	60.0	46.5	47.9	51.8	55.6		
	S/T	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.59	0.38	0.91	0.81	0.61	0.39	0.94	0.84	0.64	0.41	0.95	0.85	0.64	0.41		
	ΔT	22	20	16	11	22	20	16	11	22	20	16	11	22	20	17	11	22	22	20	16	11	20	19	15	11	
	kW	4.02	4.11	4.23	4.37	4.33	4.42	4.56	4.70	4.59	4.69	4.84	5.00	4.83	4.93	5.09	5.26	5.03	5.14	5.31	5.48	5.20	5.32	5.49	5.67		
	Amps	15.1	15.5	16.0	16.6	16.4	16.8	17.3	18.0	17.8	18.2	18.8	19.6	19.0	19.5	20.2	20.9	20.3	20.8	21.5	22.3	21.5	22.0	22.8	23.7		
	HI PR	241	259	274	285	270	291	307	320	307	331	349	364	350	376	398	415	394	424	447	466	435	468	494	515		
LO PR	107	114	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	160	133	142	155	165			

Amps = outdoor unit amps (comp.+fan)
kW = Total system power

Shaded area reflects ACCA (TVA) conditions

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB		OUTDOOR AMBIENT TEMPERATURE																																															
		65								75								85								95								105								115							
		AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71														
80	1500	MBh	51.8	52.9	56.6	60.5	50.6	51.7	55.2	59.1	49.4	50.5	53.9	57.6	48.2	49.2	52.6	56.2	45.8	46.8	50.0	53.4	42.4	43.3	46.3	49.5	45.8	46.8	50.0	53.4	42.4	43.3	46.3	49.5															
		S/T	0.83	0.78	0.64	0.48	0.86	0.81	0.66	0.51	0.89	0.83	0.68	0.51	0.91	0.86	0.70	0.52	0.95	0.95	0.89	0.72	0.54	0.96	0.90	0.73	0.55	0.95	0.89	0.72	0.54	0.96	0.90	0.73	0.55														
		ΔT	26	25	22	18	27	26	22	18	27	26	22	18	27	26	22	18	27	26	25	21	17	24	23	20	16	27	26	22	18	27	25	21	17														
		kW	3.93	4.01	4.13	4.26	4.22	4.31	4.45	4.59	4.48	4.58	4.72	4.88	4.71	4.81	4.97	5.13	4.90	4.90	5.01	5.17	5.34	5.07	5.18	5.35	5.53	4.90	5.01	5.17	5.34	5.07	5.18	5.35	5.53														
		Amps	14.7	15.1	15.6	16.1	15.9	16.3	16.8	17.5	17.3	17.7	18.3	19.0	18.5	19.0	19.6	20.4	19.7	19.7	20.2	20.9	21.7	20.9	21.4	22.2	23.0	19.7	20.2	20.9	21.7	20.9	21.4	22.2	23.0														
	1750	HI PR	234	251	265	277	262	282	298	311	298	321	339	353	339	365	386	402	382	382	411	434	453	422	454	479	500	382	411	434	453	422	454	479	500														
		LO PR	104	110	120	128	109	116	127	135	114	121	132	141	119	127	139	148	125	133	145	155	129	138	150	160	125	133	145	155	129	138	150	160															
		MBh	56.1	57.4	61.3	65.5	54.8	56.0	59.9	64.0	53.5	54.7	58.4	62.5	52.2	53.4	57.0	60.9	49.6	50.7	54.2	57.9	45.9	46.9	50.2	53.6	49.6	50.7	54.2	57.9	45.9	46.9	50.2	53.6															
		S/T	0.86	0.81	0.66	0.49	0.90	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57															
		ΔT	25	24	21	17	26	25	22	17	26	25	22	17	26	25	22	17	26	25	21	17	24	23	20	16	26	25	21	17	24	23	20	16															
2000	kW	4.02	4.11	4.23	4.37	4.33	4.42	4.56	4.70	4.59	4.69	4.84	5.00	4.83	4.93	5.09	5.26	5.03	5.14	5.31	5.48	5.20	5.32	5.49	5.67	5.03	5.14	5.31	5.48	5.20	5.32	5.49	5.67																
	Amps	15.1	15.5	16.0	16.6	16.4	16.8	17.3	18.0	17.8	18.2	18.8	19.6	19.0	19.5	20.2	20.9	20.3	20.8	21.5	22.3	21.5	22.0	22.8	23.7	20.3	20.8	21.5	22.3	21.5	22.0	22.8	23.7																
	HI PR	241	259	274	285	270	291	307	320	307	331	349	364	350	377	398	415	394	424	447	467	435	468	494	515	394	424	447	467	435	468	494	515																
	LO PR	107	114	124	132	113	120	131	140	117	125	136	145	123	131	143	152	129	137	150	160	133	142	155	165	129	137	150	160	133	142	155	165																
	MBh	57.8	59.1	63.1	67.5	56.5	57.7	61.6	65.9	55.1	56.3	60.2	64.3	53.8	55.0	58.7	62.8	51.1	52.2	55.8	59.6	47.3	48.4	51.7	55.2	51.1	52.2	55.8	59.6	47.3	48.4	51.7	55.2																
85	1500	S/T	0.91	0.85	0.69	0.52	0.94	0.88	0.72	0.54	0.96	0.90	0.74	0.55	1.00	0.93	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.79	0.59	1.00	0.97	0.79	0.59	1.00	1.00	0.79	0.59															
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	25	24	20	16	23	23	20	16	22	22	19	15	23	23	20	16	22	22	19	15															
		kW	4.05	4.14	4.27	4.40	4.36	4.45	4.59	4.74	4.63	4.73	4.88	5.04	4.87	4.97	5.13	5.30	5.07	5.18	5.35	5.53	5.24	5.36	5.54	5.72	5.07	5.18	5.35	5.53	5.24	5.36	5.54	5.72															
		Amps	15.2	15.6	16.1	16.7	16.5	16.9	17.5	18.1	18.0	18.4	19.0	19.8	19.2	19.7	20.4	21.1	20.5	21.0	21.7	22.5	21.7	22.3	23.0	23.9	21.0	21.5	22.2	23.0	21.7	22.3	23.0	23.9															
		HI PR	243	262	276	288	273	294	310	323	310	334	353	368	353	380	402	419	398	428	452	471	439	473	499	521	398	428	452	471	439	473	499	521															
	1750	LO PR	105	111	121	129	110	118	128	137	115	122	133	142	121	128	140	149	126	134	147	156	131	139	152	162	126	134	147	156	131	139	152	162															
		MBh	57.1	58.2	61.0	65.0	55.8	56.9	59.6	63.5	54.5	55.5	58.1	62.0	53.1	54.2	56.7	60.5	50.5	51.4	53.9	57.5	46.7	47.7	49.9	53.2	50.5	51.4	53.9	57.5	46.7	47.7	49.9	53.2															
		S/T	0.91	0.87	0.79	0.64	0.94	0.91	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.87	0.70	1.00	1.00	0.90	0.73	1.00	1.00	0.91	0.74	1.00	1.00	0.90	0.73	1.00	1.00	0.91	0.74															
		ΔT	27	27	25	22	28	27	26	22	28	27	26	22	28	27	26	22	27	27	25	22	25	25	24	21	27	27	25	22	25	25	24	21															
		kW	4.05	4.14	4.27	4.40	4.36	4.45	4.59	4.74	4.63	4.73	4.88	5.04	4.87	4.97	5.13	5.30	5.07	5.18	5.35	5.53	5.24	5.36	5.54	5.72	5.07	5.18	5.35	5.53	5.24	5.36	5.54	5.72															
2000	Amps	15.2	15.6	16.1	16.7	16.5	16.9	17.5	18.1	18.0	18.4	19.0	19.8	19.2	19.7	20.4	21.1	20.5	21.0	21.7	22.5	21.7	22.3	23.0	23.9	21.0	21.5	22.2	23.0	21.7	22.3	23.0	23.9																
	HI PR	243	262	276	288	273	294	310	323	310	334	353	368	353	380	402	419	398	428	452	471	439	473	499	521	398	428	452	471	439	473	499	521																
	LO PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	157	167	130	139	151	161	135	143	157	167																
	MBh	58.8	60.0	62.8	67.0	57.5	58.6	61.3	65.4	56.1	57.2	59.9	63.9	54.7	55.8	58.4	62.3	52.0	53.0	55.5	59.2	48.2	49.1	51.4	54.8	52.0	53.0	55.5	59.2	48.2	49.1	51.4	54.8																
	S/T	0.95	0.92	0.83	0.67	0.99	0.95	0.86	0.70	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.95	0.77	1.00	1.00	0.94	0.76	1.00	1.00	0.95	0.77																
85	1500	ΔT	26	25	24	21	26	26	24	21	26	26	24	21	25	26	24	21	24	24	24	21	22	23	22	19	24	24	24	21	22	23	22	19															
		kW	4.09	4.17	4.30	4.44	4.39	4.49	4.63	4.78	4.67	4.77	4.92	5.08	4.91	5.01	5.18	5.35	5.11	5.22	5.39	5.57	5.29	5.40	5.58	5.77	5.11	5.22	5.39	5.57	5.29	5.40	5.58	5.77															
		Amps	15.4	15.8	16.3	16.9	16.7	17.1	17.6	18.3	18.1	18.6	19.2	19.9	19.4	19.9	20.6	21.3	20.7	21.2	21.9	22.7	21.9	22.5	23.2	24.1	21.9	22.5	23.2	24.1	21.9	22.5	23.2	24.1															
		HI PR	246	264	279	291	276	297	313	327	313	337	356	371	357	384	406	423	402	432	456	476	444	477	504	526	384	406	423	444	444	477	504	526															
		LO PR	109	116	126	135	115	122	134	142	120	127	139	148	126	134	146	155	132	140	153	163	136	145	158	168	132	140	153	163	136	145	158	168															
85	1750	MBh	58.8	60.0	62.8	67.0	57.5	58.6	61.3	65.4	56.1	57.2	59.9	63.9	54.7	55.8	58.4	62.3	52.0	53.0	55.5	59.2	48.2	49.1	51.4	54.8	52.0	53.0	55.5	59.2	48.2	49.1	51.4	54.8															
		S/T	0.95	0.92	0.83	0.67	0.99	0.95	0.86	0.70	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.95	0.77	1.00	1.00	0.94	0.76	1.00	1.00	0.95	0.77															
		ΔT	26	25	24	21	26	26	24	21	26	26	24	21	25	26	24	21	24	24	24	21	22	23	22	19	24	24	24	21	22	23	22	19															
		kW	4.09	4.17	4.30	4.44	4.39	4.49	4.63	4.78	4.67	4.77	4.92	5.08	4.91	5.01	5.18	5.35	5.11	5.22	5.39	5.57	5.29	5.40	5.58	5.77	5.11	5.22	5.39	5.57	5.29	5.40	5.58	5.77															
		Amps	15.4	15.8	16.3	16.9	16.7	17.1	17.6	18.3	18.1	18.6	19.2	19.9	19.4	19.9	20.6	21.3	20.7	21.2	21.9	22.7	21.9	22.5	23.2	24.1	21.9	22.5	23.2	24.1	21.9	22.5	23.2	24.1															
85	2000	HI PR	246	264	279	291	276	297	313	327	313	337	356	371	357	384	406	423	402	432	456	476	444	477	504	526	384	406	423</																				

IDB		OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
		ENTERING INDOOR WET BULB TEMPERATURE																							
		ENTERING INDOOR DRY BULB TEMPERATURE																							
1500	MBh	53.8	55.7	61.0	-	52.5	54.4	59.6	-	51.3	53.1	58.2	-	50.0	51.8	56.8	-	47.5	49.2	53.9	-	44.0	45.6	50.0	-
	S/T	0.66	0.55	0.38	-	0.68	0.57	0.39	-	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.75	0.62	0.43	-	0.75	0.63	0.44	-
	ΔT	22	19	14	-	22	19	14	-	22	19	14	-	22	19	14	-	22	19	14	-	20	18	13	-
	kW	3.97	4.05	4.18	-	4.27	4.37	4.51	-	4.54	4.64	4.80	-	4.78	4.89	5.05	-	4.99	5.10	5.27	-	5.16	5.28	5.45	-
	Amps	15.4	15.8	16.3	-	16.7	17.1	17.6	-	18.1	18.6	19.2	-	19.4	19.9	20.6	-	20.7	21.2	21.9	-	22.0	22.5	23.3	-
	HI PR	228	245	259	-	256	275	291	-	291	313	331	-	331	357	377	-	373	401	424	-	412	443	468	-
	LO PR	98	104	114	-	103	110	120	-	107	114	125	-	113	120	131	-	118	126	137	-	122	130	142	-
	MBh	55.4	57.4	62.9	-	54.1	56.1	61.4	-	52.8	54.7	59.9	-	51.5	53.4	58.5	-	48.9	50.7	55.6	-	45.3	47.0	51.5	-
	S/T	0.69	0.57	0.40	-	0.71	0.60	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.79	0.66	0.46	-
	ΔT	20	17	13	-	20	18	13	-	20	18	13	-	20	18	13	-	20	17	13	-	19	16	12	-
kW	4.00	4.09	4.21	-	4.31	4.40	4.54	-	4.58	4.68	4.84	-	4.82	4.93	5.09	-	5.03	5.14	5.31	-	5.20	5.32	5.50	-	
Amps	15.5	15.9	16.4	-	16.8	17.2	17.8	-	18.3	18.8	19.4	-	19.6	20.1	20.8	-	20.9	21.4	22.2	-	22.2	22.7	23.5	-	
HI PR	230	248	262	-	258	278	294	-	294	316	334	-	335	360	380	-	377	405	428	-	416	448	473	-	
LO PR	99	105	115	-	104	111	121	-	108	115	126	-	114	121	132	-	119	127	139	-	124	131	143	-	
MBh	55.6	57.7	63.2	-	54.3	56.3	61.7	-	53.0	55.0	60.2	-	51.8	53.6	58.8	-	49.2	51.0	55.8	-	45.5	47.2	51.7	-	
S/T	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.80	0.67	0.46	-	
ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-	
kW	4.03	4.12	4.25	-	4.34	4.44	4.58	-	4.62	4.72	4.88	-	4.86	4.97	5.13	-	5.07	5.18	5.36	-	5.25	5.37	5.55	-	
Amps	15.7	16.0	16.6	-	17.0	17.4	18.0	-	18.5	18.9	19.6	-	19.8	20.3	21.0	-	21.1	21.6	22.4	-	22.4	22.9	23.7	-	
HI PR	233	250	264	-	261	281	297	-	297	319	337	-	338	364	384	-	380	409	432	-	420	452	477	-	
LO PR	100	106	116	-	105	112	122	-	110	117	127	-	115	122	134	-	121	128	140	-	125	133	145	-	

IDB		OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
		ENTERING INDOOR WET BULB TEMPERATURE																							
		ENTERING INDOOR DRY BULB TEMPERATURE																							
1500	MBh	54.7	56.3	60.9	65.4	53.4	55.0	59.5	63.9	52.1	53.7	58.1	62.3	50.9	52.4	56.7	60.8	48.3	49.7	53.8	57.8	44.7	46.1	49.9	53.5
	S/T	0.75	0.67	0.50	0.32	0.77	0.69	0.52	0.34	0.79	0.71	0.54	0.35	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.86	0.77	0.58	0.37
	ΔT	25	23	19	13	25	23	19	13	25	23	19	13	26	23	19	13	25	23	19	13	23	22	18	12
	kW	4.00	4.09	4.22	4.35	4.31	4.40	4.55	4.69	4.58	4.68	4.84	5.00	4.82	4.93	5.09	5.26	5.03	5.14	5.31	5.49	5.20	5.32	5.50	5.69
	Amps	15.5	15.9	16.4	17.1	16.8	17.2	17.8	18.5	18.3	18.8	19.4	20.2	19.6	20.1	20.8	21.6	20.9	21.4	22.2	23.0	22.2	22.7	23.5	24.4
	HI PR	230	248	262	273	258	278	294	306	294	316	334	348	335	360	380	397	377	405	428	446	416	448	473	493
	LO PR	99	105	115	122	104	111	121	129	108	115	126	134	114	121	132	141	119	127	139	148	124	131	143	153
	MBh	56.3	58.0	62.7	67.3	55.0	56.6	61.3	65.8	53.7	55.3	59.8	64.2	52.4	53.9	58.4	62.6	49.8	51.2	55.5	59.5	46.1	47.5	51.4	55.1
	S/T	0.78	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.90	0.80	0.61	0.39
	ΔT	23	21	17	12	23	22	18	12	23	22	18	12	24	22	18	12	23	21	18	12	22	20	16	11
kW	4.03	4.12	4.25	4.39	4.34	4.44	4.58	4.73	4.62	4.72	4.88	5.04	4.86	4.97	5.14	5.31	5.07	5.18	5.36	5.54	5.25	5.37	5.55	5.74	
Amps	15.7	16.1	16.6	17.2	17.0	17.4	18.0	18.7	18.5	18.9	19.6	20.3	19.8	20.3	21.0	21.8	21.1	21.6	22.4	23.2	22.4	22.9	23.7	24.7	
HI PR	233	250	264	276	261	281	297	309	297	320	337	352	338	364	384	401	380	409	432	451	420	452	478	498	
LO PR	100	106	116	123	105	112	122	130	110	117	127	136	115	122	134	142	121	128	140	149	125	133	145	154	
MBh	56.6	58.3	63.1	67.7	55.3	56.9	61.6	66.1	53.9	55.5	60.1	64.5	52.6	54.2	58.7	63.0	50.0	51.5	55.7	59.8	46.3	47.7	51.6	55.4	
S/T	0.79	0.71	0.54	0.35	0.82	0.73	0.56	0.36	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.91	0.81	0.62	0.40	
ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10	
kW	4.06	4.15	4.28	4.42	4.38	4.48	4.62	4.77	4.66	4.76	4.92	5.08	4.90	5.01	5.18	5.35	5.11	5.23	5.40	5.59	5.29	5.41	5.59	5.78	
Amps	15.8	16.2	16.7	17.4	17.1	17.6	18.1	18.8	18.7	19.1	19.8	20.5	20.0	20.5	21.2	22.0	21.3	21.8	22.6	23.5	22.6	23.2	24.0	24.9	
HI PR	235	253	267	278	264	284	300	312	300	323	341	355	341	367	388	405	384	413	437	455	424	457	482	503	
LO PR	101	107	117	125	106	113	124	132	111	118	129	137	116	124	135	144	122	130	141	151	126	134	146	156	


IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 Amps = outdoor unit amps (comp.+fan)
 kW = Total system power

IDB		OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
AIRFLOW		55.6	56.9	60.7	64.9	54.3	55.5	59.3	63.4	53.0	54.2	57.9	61.9	51.8	52.9	56.5	60.4	49.2	50.2	53.7	57.4	45.5	46.5	49.7	53.2
S/T		0.82	0.77	0.62	0.47	0.85	0.80	0.65	0.48	0.87	0.82	0.66	0.50	0.90	0.84	0.69	0.51	0.93	0.87	0.71	0.53	0.94	0.88	0.72	0.54
ΔT		28	27	23	19	28	27	24	19	28	27	24	19	28	27	24	19	28	27	23	19	26	25	22	17
kW		4.03	4.12	4.25	4.39	4.35	4.44	4.58	4.73	4.62	4.72	4.88	5.04	4.86	4.97	5.14	5.31	5.07	5.18	5.36	5.54	5.25	5.37	5.55	5.74
Amps		15.7	16.1	16.6	17.2	17.0	17.4	18.0	18.7	18.5	18.9	19.6	20.3	19.8	20.3	21.0	21.8	21.1	21.6	22.4	23.2	22.4	22.9	23.7	24.7
HI PR		233	250	264	276	261	281	297	309	297	320	337	352	338	364	384	401	380	409	432	451	420	452	478	498
LO PR		100	106	116	123	105	112	122	130	110	117	127	136	115	122	134	142	121	128	140	149	125	133	145	154
MBh		57.3	58.6	62.6	66.9	56.0	57.2	61.1	65.3	54.6	55.8	59.6	63.8	53.3	54.5	58.2	62.2	50.6	51.7	55.3	59.1	46.9	47.9	51.2	54.7
S/T		0.86	0.80	0.65	0.49	0.89	0.83	0.68	0.51	0.91	0.85	0.70	0.52	0.94	0.88	0.72	0.54	1.00	0.92	0.75	0.56	1.00	0.92	0.75	0.56
ΔT		26	25	22	17	26	25	22	17	26	25	22	17	26	25	22	18	27	25	22	17	25	23	20	16
kW		4.07	4.15	4.28	4.42	4.38	4.48	4.62	4.77	4.66	4.76	4.92	5.08	4.90	5.01	5.18	5.35	5.11	5.23	5.40	5.59	5.29	5.41	5.59	5.79
Amps		15.8	16.2	16.7	17.4	17.1	17.6	18.2	18.9	18.7	19.1	19.8	20.5	20.0	20.5	21.2	22.0	21.3	21.8	22.6	23.5	22.6	23.2	24.0	24.9
HI PR		235	253	267	279	264	284	300	313	300	323	341	355	342	368	388	405	384	414	437	455	425	457	482	503
LO PR		101	107	117	125	107	113	124	132	111	118	129	137	116	124	135	144	122	130	142	151	126	134	146	156
MBh		57.6	58.8	62.9	67.2	56.2	57.5	61.4	65.6	54.9	56.1	59.9	64.1	53.6	54.7	58.5	62.5	50.9	52.0	55.6	59.4	47.1	48.2	51.5	55.0
S/T		0.87	0.82	0.66	0.50	0.90	0.85	0.69	0.51	0.92	0.87	0.71	0.53	0.95	0.89	0.73	0.54	1.00	0.93	0.76	0.56	1.00	0.94	0.76	0.57
ΔT		23	22	19	15	23	22	19	16	23	22	19	16	23	23	20	16	23	22	19	15	22	21	18	14
kW		4.10	4.19	4.32	4.46	4.42	4.51	4.66	4.81	4.70	4.80	4.96	5.12	4.94	5.06	5.22	5.40	5.16	5.27	5.45	5.63	5.34	5.46	5.64	5.84
Amps		16.0	16.4	16.9	17.6	17.3	17.7	18.3	19.0	18.8	19.3	20.0	20.7	20.2	20.7	21.4	22.2	21.5	22.0	22.8	23.7	22.8	23.4	24.2	25.1
HI PR		237	255	270	281	266	287	303	316	303	326	344	359	345	371	392	409	388	418	441	460	429	461	487	508
LO PR		102	108	118	126	108	114	125	133	112	119	130	138	117	125	136	145	123	131	143	152	127	135	148	157
MBh		56.6	57.7	60.4	64.5	55.3	56.4	59.0	63.0	54.0	55.0	57.6	61.5	52.7	53.7	56.2	60.0	50.0	51.0	53.4	57.0	46.3	47.2	49.5	52.8
S/T		0.86	0.83	0.75	0.61	0.89	0.86	0.77	0.63	0.91	0.88	0.79	0.64	0.94	0.91	0.82	0.66	0.98	0.94	0.85	0.69	0.98	0.95	0.86	0.70
ΔT		30	29	28	24	30	30	28	24	30	30	28	24	30	30	28	24	30	29	28	24	28	28	26	23
kW		4.07	4.15	4.28	4.42	4.38	4.48	4.62	4.77	4.66	4.76	4.92	5.08	4.90	5.01	5.18	5.35	5.11	5.23	5.40	5.59	5.29	5.41	5.59	5.79
Amps		15.8	16.2	16.7	17.4	17.1	17.6	18.2	18.9	18.7	19.1	19.8	20.5	20.0	20.5	21.2	22.0	21.3	21.8	22.6	23.5	22.6	23.2	24.0	24.9
HI PR		235	253	267	279	264	284	300	313	300	323	341	355	342	368	388	405	384	414	437	455	425	457	482	503
LO PR		101	107	117	125	107	113	124	132	111	118	129	137	116	124	135	144	122	130	142	151	126	134	146	156
MBh		58.3	59.4	62.2	66.4	56.9	58.1	60.8	64.9	55.6	56.7	59.4	63.3	54.2	55.3	57.9	61.8	51.5	52.5	55.0	58.7	47.7	48.7	51.0	54.4
S/T		0.90	0.87	0.78	0.64	0.93	0.90	0.81	0.66	0.96	0.92	0.83	0.68	0.99	0.95	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.90	0.73
ΔT		28	27	26	22	28	27	26	22	28	27	26	22	28	28	26	23	27	27	26	22	25	25	24	21
kW		4.10	4.19	4.32	4.46	4.42	4.51	4.66	4.81	4.70	4.80	4.96	5.12	4.95	5.06	5.22	5.40	5.16	5.27	5.45	5.63	5.34	5.46	5.64	5.84
Amps		16.0	16.4	16.9	17.6	17.3	17.7	18.3	19.0	18.8	19.3	20.0	20.7	20.2	20.7	21.4	22.2	21.5	22.0	22.8	23.7	22.8	23.4	24.2	25.1
HI PR		237	255	270	281	266	287	303	316	303	326	344	359	345	371	392	409	388	418	441	460	429	461	487	508
LO PR		102	108	118	126	108	114	125	133	112	119	130	138	117	125	136	145	123	131	143	152	127	135	148	157
MBh		58.6	59.7	62.5	66.7	57.2	58.3	61.1	65.2	55.9	56.9	59.6	63.6	54.5	55.6	58.2	62.1	51.8	52.8	55.3	59.0	48.0	48.9	51.2	54.6
S/T		0.91	0.88	0.79	0.64	0.94	0.91	0.82	0.67	0.97	0.93	0.84	0.68	1.00	0.96	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.91	0.74
ΔT		25	24	23	20	25	24	23	20	25	24	23	20	25	25	23	20	24	24	23	20	22	22	21	19
kW		4.13	4.22	4.35	4.50	4.45	4.55	4.70	4.85	4.74	4.84	5.00	5.17	4.99	5.10	5.27	5.45	5.20	5.32	5.49	5.68	5.38	5.50	5.69	5.89
Amps		16.1	16.5	17.1	17.7	17.5	17.9	18.5	19.2	19.0	19.5	20.1	20.9	20.4	20.9	21.6	22.4	21.7	22.2	23.0	23.9	23.0	23.6	24.4	25.4
HI PR		240	258	272	284	269	289	306	319	306	329	348	363	348	375	396	413	392	422	445	465	433	466	492	513
LO PR		103	109	119	127	109	116	126	134	113	120	131	140	119	126	138	147	124	132	144	154	129	137	149	159

Amps = outdoor unit amps (comp.+fan)
kW = Total system power

Shaded area reflects AHRI conditions

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

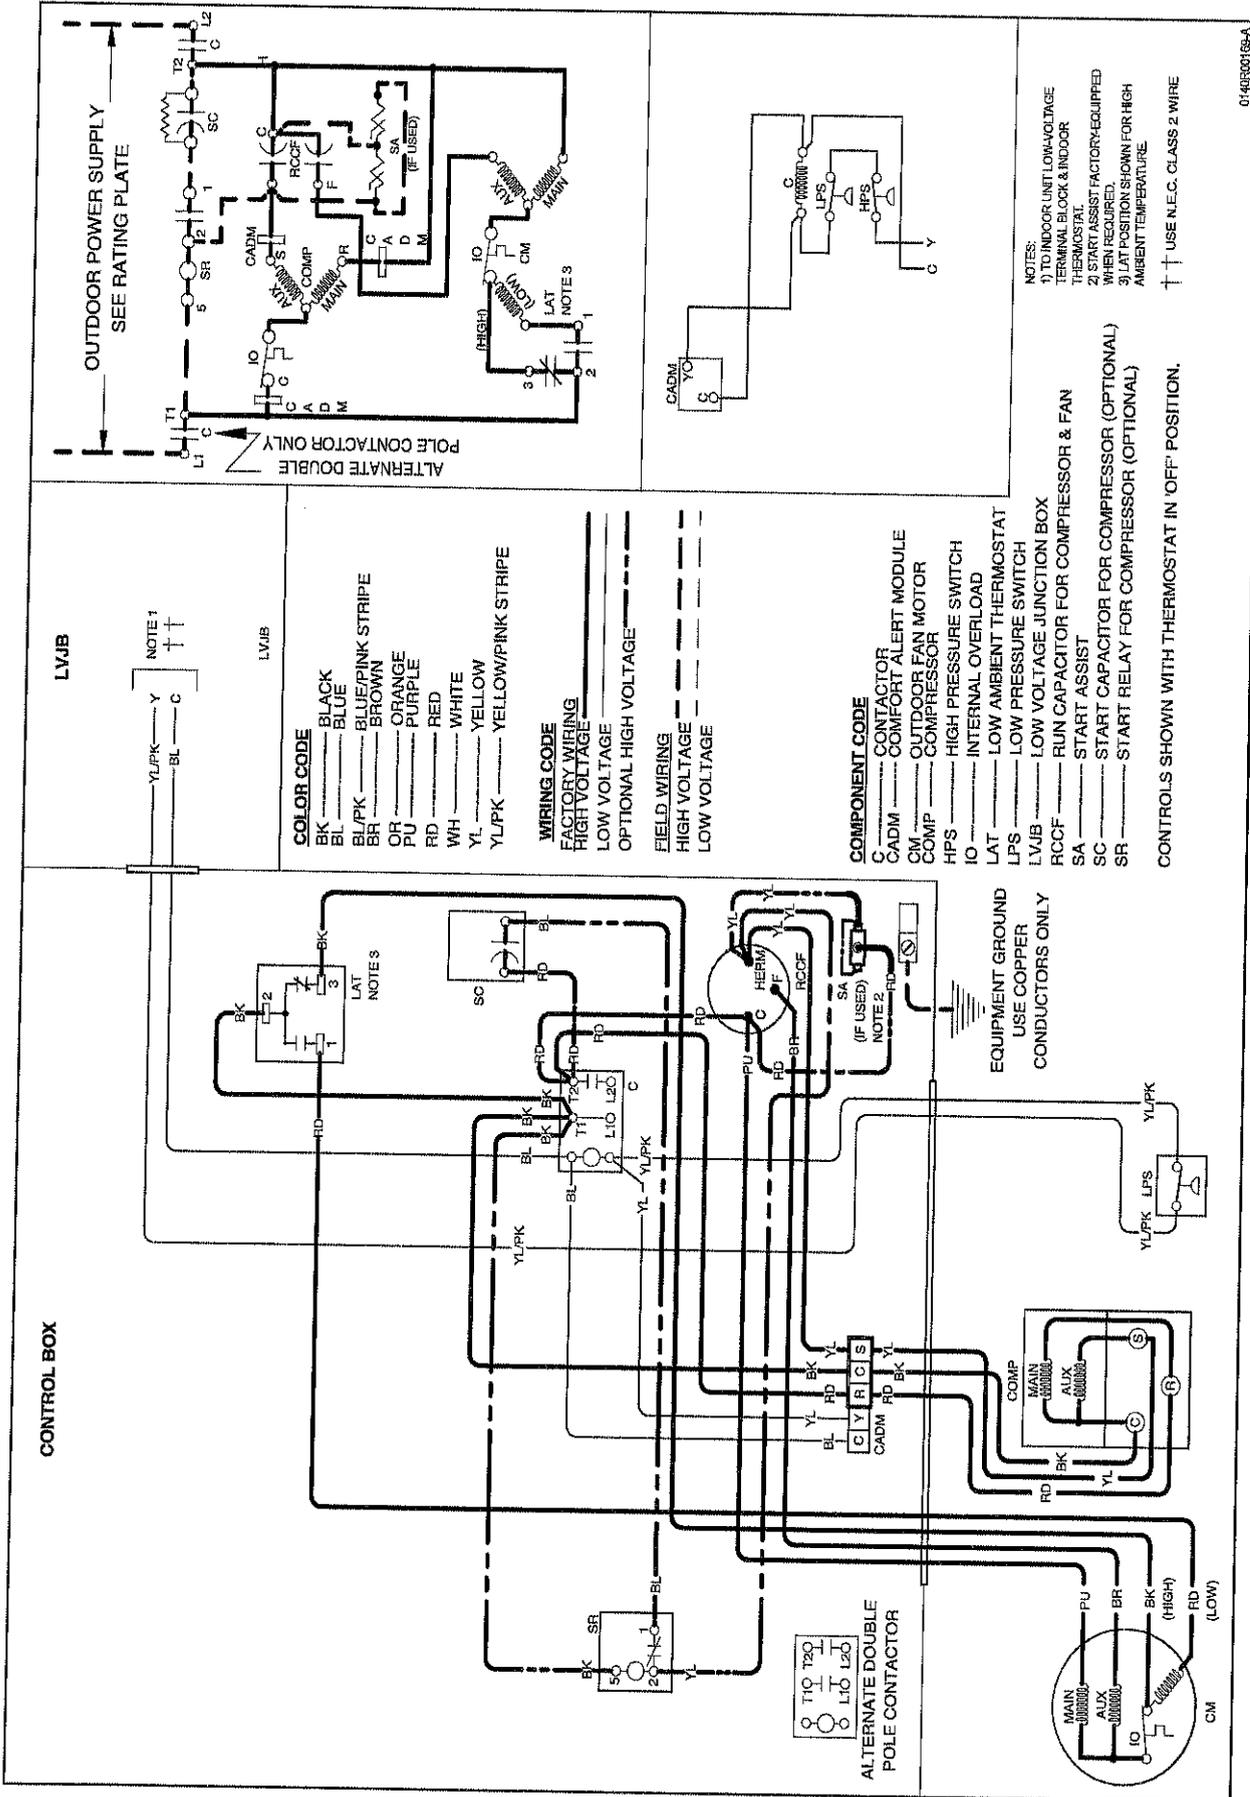

MODEL	DESCRIPTION	ASX13 018*	ASX13 024*	ASX13 030*	ASX13 036*	ASX13 042*	ASX13 048*	ASX13 060*
ABK-20	Anchor Bracket Kit ⁰	X	X	X	X	X	X	X
ASC-01	Anti-Short Cycle Kit	X	X	X	X	X	X	X
CSR-U-1	Hard-start Kit	X	X	X	X	X	X	X
FSK01A ¹	Freeze Protection Kit	X	X	X	X	X	X	X
LAKT01A	Low-Ambient Kit	X	X	X	X	X	X	X
LSK01A	Liquid Line Solenoid Kit	X	X	X	X	X	X	X
OT18-60A	Outdoor Thermostat	X	X	X	X	X	X	X
TX2N4A ²	TXV Kit	X	X					
TX3N4 ²	TXV Kit			X	X			
TX5N4 ²	TXV Kit					X	X	X

⁰ Contains 20 brackets; four brackets needed to anchor unit to pad

¹ Installed on indoor coil


² Field-installed, non-bleed, expansion valve kit — Condensing units and heat pumps with reciprocating or rotary compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid line solenoid kit. The TXV should always be sized based on the tonnage of the outdoor unit.

All AHRI system ratings are accessible in the System Configurator tool via PartnerLink.

SUBMITTALS

Side-Discharge Condensing Unit

Rev. July 2020

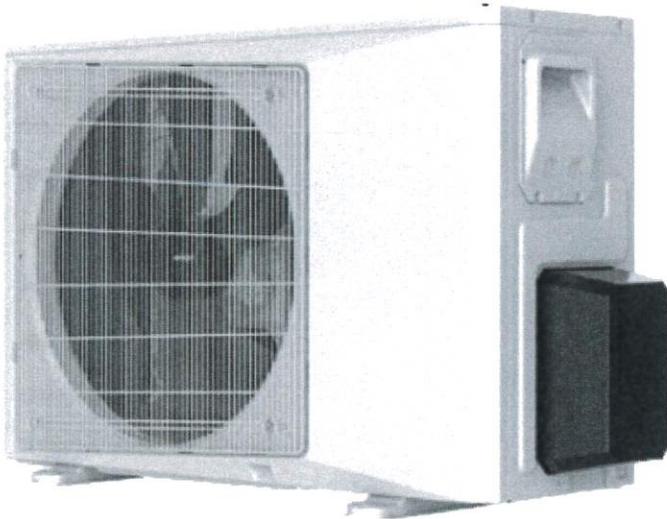

UUC112WCDA
UUC118WCDA
UUC124WCDA
UUC130WCDA
UUC136WCDA
UUC148WCDA

Revision History

Rev. July 2020 - Submittal edition release.

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

12,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER

UUC112WCDA

Job Name: _____

Purchaser: _____

Submitted To: _____

Construction: _____

Reference: _____


Approval: _____

Date: _____

Submitted By: _____

Unit: _____

Drawing #: _____

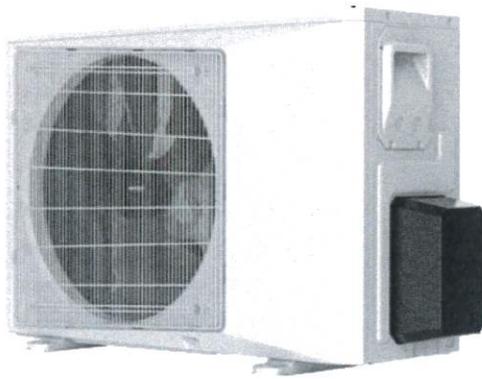

Specifications

	Compressor	Rotary
Uncrated Dimension (HxWxD)	21.9 x 33.5 x 13.6 in (555 x 850 x 345 mm)	
Crated (HxWxD)	24.5 x 36.0 x 15.0 in (622 x 915 x 380 mm)	
Outdoor Sound Rating dB	52	
Heat Exchanger Fin Type	Aluminum	
Weight (Net/Gross)	76.1/92.6 lbs	
Factory Refrigerant Charge	R-410A (3.1 lbs)	

Electrical Requirement

Power Supply	115V, 1 Phase, 60 HZ
Operating Voltage Range	103-127 VAC
Max. Fuse/Breaker Size	15A
MCA	11A

Operating Range

Cooling	15-115°F (-9-46°C)
---------	--------------------

Cooling Performance



Rated Cooling Capacity	12,000 BTU
SEER	14
EER	12.0

Pipe Length

Minimum Pipe Length	10 ft
Maximum Pipe Length	82 ft
Maximum Pipe Height Difference	33 ft
Braze Connection	1/4"(Discharge) 1/2"(Suction)

Dimensions (In.)

A	B	C	D	E
33.5	13.6	21.9	20.0	11.0

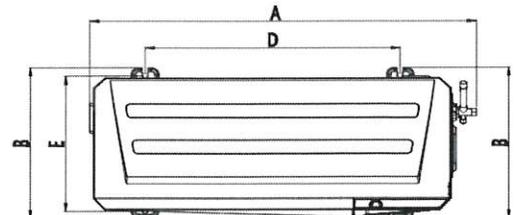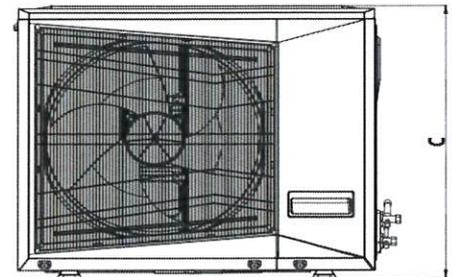

Notice: Federal law allows this unit to be installed only in AK, CO, CT, ID, IL, IA, IN, KS, MA, ME, MI, MN, MO, MT, ND, NE, NH, NJ, NY, OH, OR, PA, RI, SD, UT, VT, WA, WV, WI, WY, and U.S. territories.

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

12,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER UUC112WCDA

COOLING CAPACITY DATA


Outdoor Air Temp DB	Indoor Set Temperature					
	70°F (21°C)		75°F (24°C)		80°F (27°C)	
	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)
65°F (18°C)	11950	770	13000	780	14060	795
75°F (24°C)	11550	805	12550	815	13580	830
85°F (29°C)	11100	870	12050	885	13000	900
95°F (35°C)	10550	965	11300	980	12180	995
105°F (41°C)	9950	1065	10550	1080	11290	1097
115°F (46°C)	9300	1170	9750	1185	10300	1203

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

18,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER UUC118WCDA

Job Name: _____
 Purchaser: _____
 Submitted To: _____
 Construction: _____
 Reference: _____

Approval: _____
 Date: _____
 Submitted By: _____
 Unit: _____
 Drawing #: _____

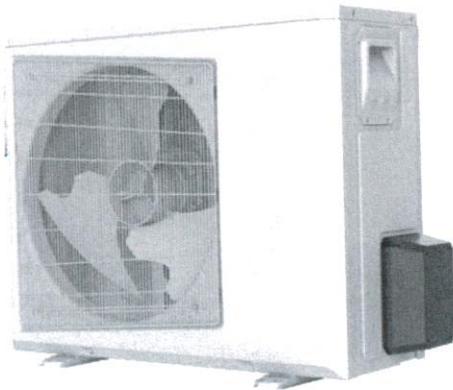


Specifications	
Compressor	Rotary
Uncrated Dimension (HxWxD)	27.6 x 36.0 x 15.0 in (702 x 914 x 382 mm)
Crated (HxWxD)	30.8 x 38.4 x 16.5 in (782 x 975 x 420 mm)
Outdoor Sound Rating dB	55
Heat Exchanger Fin Type	Aluminum
Weight (Net/Gross)	105.8/123.5 lbs
Factory Refrigerant Charge	R-410A (4.7 lbs)

Electrical Requirement	
Power Supply	208-230V, 1 Phase, 60 HZ
Operating Voltage Range	187-253 VAC
Max. Fuse/Breaker Size	15A
MCA	10A

Dimensions (In.)				
A	B	C	D	E
36.0	15.0	27.6	21.4	12.8

Operating Range	
Cooling	15-115°F (-9-46°C)

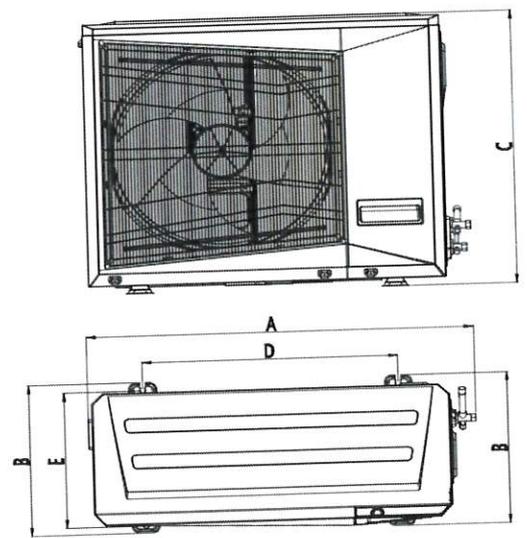

Cooling Performance	
Rated Cooling Capacity	17,500 BTU
SEER	14.5
EER	12.0

Pipe Length	
Minimum Pipe Length	10 ft
Maximum Pipe Length	82 ft
Maximum Pipe Height Difference	33 ft
Braze Connection	1/4"(Discharge) 1/2"(Suction)



Notice: Federal law allows this unit to be installed only in AK, AL, AR, CO, CT, DC, DE, FL, GA, HI, ID, IL, IA, IN, KS, KY, LA, MA, ME, MD, MI, MN, MO, MS, MT, NC, ND, NE, NH, NJ, NY, OH, OR, PA, RI, SC, SD, TN, TX, UT, VA, VT, WA, WV, WI, WY, AND U.S. territories

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

18,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER UUC118WCDA

COOLING CAPACITY DATA

Outdoor Air Temp DB	Indoor Set Temperature					
	70°F (21°C)		75°F (24°C)		80°F (27°C)	
	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)
65°F (18°C)	17700	1150	19450	1170	21200	1190
75°F (24°C)	17200	1210	18700	1230	20200	1250
85°F (29°C)	16600	1310	17900	1330	19100	1350
95°F (35°C)	15950	1455	17150	1475	18000	1495
105°F (41°C)	15250	1595	16000	1615	16750	1635
115°F (46°C)	14200	1730	14700	1755	15550	1775

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

24,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER

UUC124WCDA

Job Name: _____

Purchaser: _____

Submitted To: _____

Construction: _____

Reference: _____


Approval: _____

Date: _____

Submitted By: _____

Unit: _____

Drawing #: _____

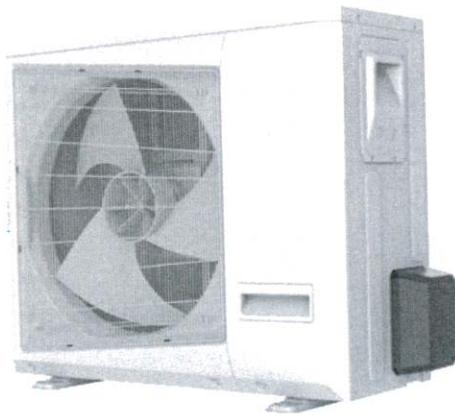


Specifications	
Compressor	Rotary
Uncrated Dimension (HxWxD)	31.9 x 40.0 x 17.5 in (810 x 1015 x 445 mm)
Crated (HxWxD)	38.4 x 42.3 x 19.5 in (975 x 1075 x 495 mm)
Outdoor Sound Rating dB	59
Heat Exchanger Fin Type	Aluminum
Weight (Net/Gross)	125.7/169.7 lbs
Factory Refrigerant Charge	R-410A (6.1 lbs)


Electrical Requirement	
Power Supply	208-230V, 1 Phase, 60 HZ
Operating Voltage Range	187-253 VAC
Max. Fuse/Breaker Size	15A
MCA	12A

Dimensions (In.)				
A	B	C	D	E
40.0	17.5	31.9	26.4	15.2

Operating Range	
Cooling	15-115°F (-9-46°C)

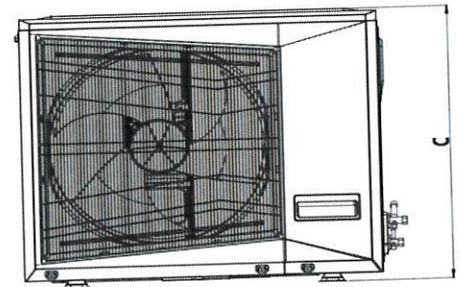

Cooling Performance	
Rated Cooling Capacity	23,400 BTU
SEER	14.5
EER	12.0

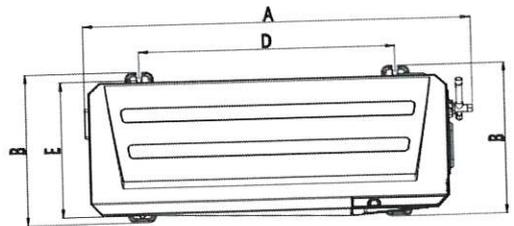

Pipe Length	
Minimum Pipe Length	10 ft
Maximum Pipe Length	82 ft
Maximum Pipe Height Difference	33 ft
Braze Connection	3/8" (Discharge) 5/8" (Suction)



Notice: Federal law allows this unit to be installed only in AK, AL, AR, CO, CT, DC, DE, FL, GA, HI, ID, IL, IA, IN, KS, KY, LA, MA, ME, MD, MI, MN, MO, MS, MT, NC, ND, NE, NH, NJ, NY, OH, OR, PA, RI, SC, SD, TN, TX, UT, VA, VT, WA, WV, WI, WY, AND U.S. territories

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

24,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER UUC124WCDA

COOLING CAPACITY DATA


Outdoor Air Temp DB	Indoor Set Temperature					
	70°F (21°C)		75°F (24°C)		80°F (27°C)	
	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)
65°F (18°C)	22500	1460	24700	1485	26950	1510
75°F (24°C)	22000	1540	24150	1585	26150	1625
85°F (29°C)	21300	1680	23400	1720	25150	1760
95°F (35°C)	20400	1845	22400	1885	23800	1925
105°F (41°C)	19000	2010	20700	2050	21900	2090
115°F (46°C)	17500	2180	18800	2220	19750	2260

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

30,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER UUC130WCDA

Job Name: _____
 Purchaser: _____
 Submitted To: _____
 Construction: _____
 Reference: _____

Approval: _____
 Date: _____
 Submitted By: _____
 Unit: _____
 Drawing #: _____

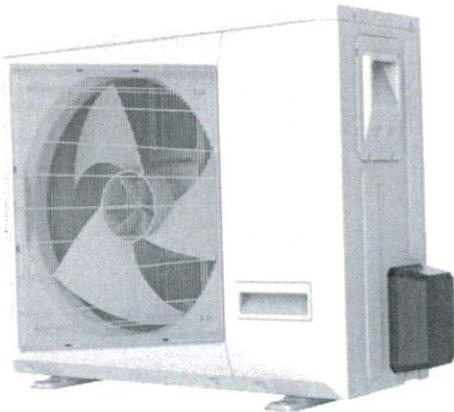


Specifications	
Compressor	Rotary
Uncrated Dimension (HxWxD)	31.9 x 40.0 x 17.5 in (810 x 1015 x 445 mm)
Crated (HxWxD)	38.4 x 42.3 x 19.5 in (975 x 1075 x 495 mm)
Outdoor Sound Rating dB	59
Heat Exchanger Fin Type	Aluminum
Weight (Net/Gross)	141.1/187.4 lbs
Factory Refrigerant Charge	R-410A (7.3 lbs)


Electrical Requirement	
Power Supply	208-230V, 1 Phase, 60 HZ
Operating Voltage Range	187-253 VAC
Max. Fuse/Breaker Size	20A
MCA	14A

Dimensions (In.)				
A	B	C	D	E
40.0	17.5	31.9	26.4	15.2

Operating Range	
Cooling	15-115°F (-9-46°C)

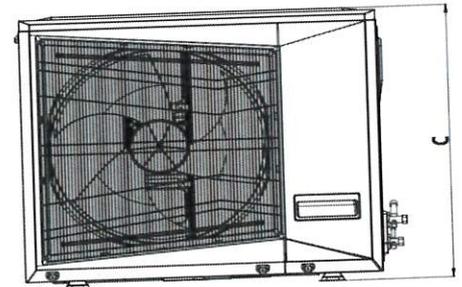

Cooling Performance	
Rated Cooling Capacity	28,600 BTU
SEER	14.5
EER	12.0

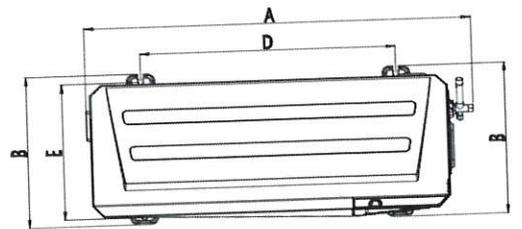

Pipe Length	
Minimum Pipe Length	10 ft
Maximum Pipe Length	82 ft
Maximum Pipe Height Difference	33 ft
Braze Connection	3/8" (Discharge) 3/4" (Suction)



Notice: Federal law allows this unit to be installed only in AK, AL, AR, CO, CT, DC, DE, FL, GA, HI, ID, IL, IA, IN, KS, KY, LA, MA, ME, MD, MI, MN, MO, MS, MT, NC, ND, NE, NH, NJ, NY, OH, OR, PA, RI, SC, SD, TN, TX, UT, VA, VT, WA, WV, WI, WY, AND U.S. territories

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

30,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER UUC130WCDA

COOLING CAPACITY DATA


Outdoor Air Temp DB	Indoor Set Temperature					
	70°F (21°C)		75°F (24°C)		80°F (27°C)	
	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)
65°F (18°C)	29000	1870	31800	1900	34400	1930
75°F (24°C)	28200	1980	30900	2020	33200	2060
85°F (29°C)	27200	2140	29750	2180	31700	2220
95°F (35°C)	26150	2350	28600	2390	30000	2430
105°F (41°C)	24800	2620	27000	2660	28100	2700
115°F (46°C)	23200	2890	25200	2930	26150	2970

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

36,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER UUC136WCDA

Job Name: _____
 Purchaser: _____
 Submitted To: _____
 Construction: _____
 Reference: _____

Approval: _____
 Date: _____
 Submitted By: _____
 Unit: _____
 Drawing #: _____

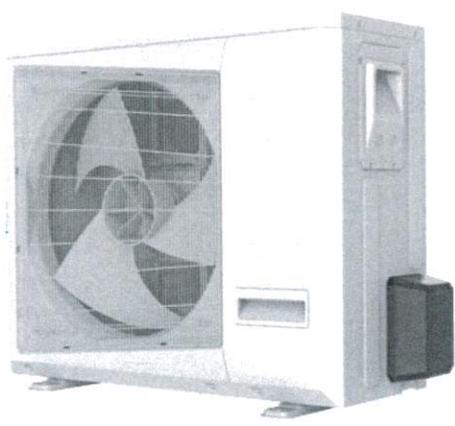


Specifications	
Compressor	Rotary
Uncrated Dimension (HxWxD)	31.9 x 40.0 x 17.5 in (810 x 1015 x 445 mm)
Crated (HxWxD)	38.4 x 42.3 x 19.5 in (975 x 1075 x 495 mm)
Outdoor Sound Rating dB	59
Heat Exchanger Fin Type	Aluminum
Weight (Net/Gross)	141.1/187.4 lbs
Factory Refrigerant Charge	R-410A (7.3 lbs)

Electrical Requirement	
Power Supply	208-230V, 1 Phase, 60 HZ
Operating Voltage Range	187-253 VAC
Max. Fuse/Breaker Size	25A
MCA	16A

Dimensions (In.)				
A	B	C	D	E
40.0	17.5	31.9	26.4	15.2

Operating Range	
Cooling	15-115°F (-9-46°C)

Cooling Performance	
Rated Cooling Capacity	34,000 BTU
SEER	14.5
EER	12.0

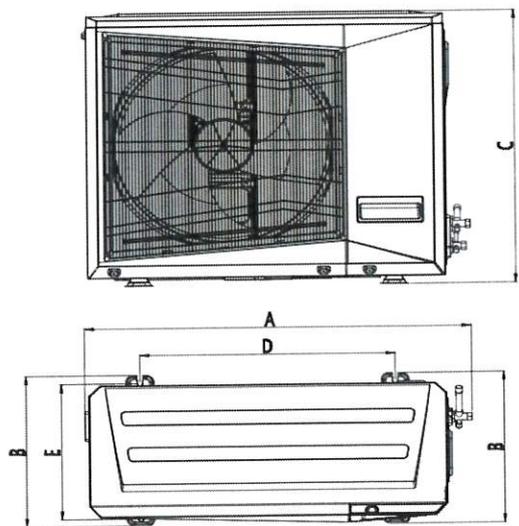

Pipe Length	
Minimum Pipe Length	10 ft
Maximum Pipe Length	82 ft
Maximum Pipe Height Difference	33 ft
Braze Connection	3/8" (Discharge) 3/4" (Suction)



Notice: Federal law allows this unit to be installed only in AK, AL, AR, CO, CT, DC, DE, FL, GA, HI, ID, IL, IA, IN, KS, KY, LA, MA, ME, MD, MI, MN, MO, MS, MT, NC, ND, NE, NH, NJ, NY, OH, OK, OR, PA, RI, SC, SD, TN, TX, UT, VA, VT, WA, WV, WI, WY, AND U.S. territories

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

36,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER

UUC136WCDA

COOLING CAPACITY DATA


Outdoor Air Temp DB	Indoor Set Temperature					
	70°F (21°C)		75°F (24°C)		80°F (27°C)	
	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)
65°F (18°C)	33350	2160	36550	2195	39800	2230
75°F (24°C)	32600	2320	35600	2355	38600	2390
85°F (29°C)	31750	2540	34500	2575	37000	2610
95°F (35°C)	30850	2795	33000	2830	34800	2865
105°F (41°C)	29600	3090	31200	3120	32500	3150
115°F (46°C)	28100	3405	29000	3435	30150	3465

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

48,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER UUC148WCDA

Job Name: _____
 Purchaser: _____
 Submitted To: _____
 Construction: _____
 Reference: _____

Approval: _____
 Date: _____
 Submitted By: _____
 Unit: _____
 Drawing #: _____

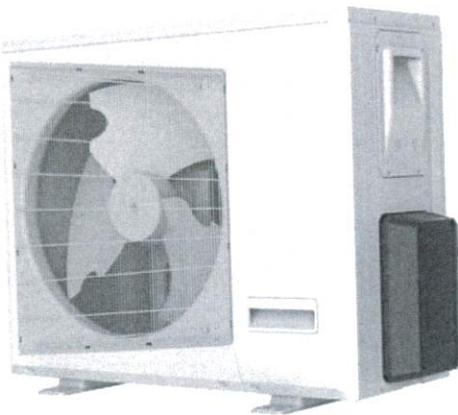

Specifications	
Compressor	Scroll
Uncrated Dimension (HxWxD)	34.25 x 43.31 x 20.79 in (870 x 1100 x 528 mm)
Crated (HxWxD)	40.6 x 45.0 x 21.5 in (1030 x 1145 x 545 mm)
Outdoor Sound Rating dB	64
Heat Exchanger Fin Type	Aluminum
Weight (Net/Gross)	198.4/248 lbs
Factory Refrigerant Charge	R-410A (8.8 lbs)



Electrical Requirement	
Power Supply	208-230V, 1 Phase, 60 HZ
Operating Voltage Range	187-253 VAC
Max. Fuse/Breaker Size	40A
MCA	26A

Dimensions (In.)				
A	B	C	D	E
43.3	20.8	34.3	25.0	17.4

Operating Range	
Cooling	15-115°F (-9-46°C)

Cooling Performance	
Rated Cooling Capacity	46,000 BTU
SEER	14
EER	11.7

Pipe Length	
Minimum Pipe Length	10 ft
Maximum Pipe Length	98 ft
Maximum Pipe Height Difference	49 ft
Braze Connection	3/8" (Discharge) 3/4" (Suction)

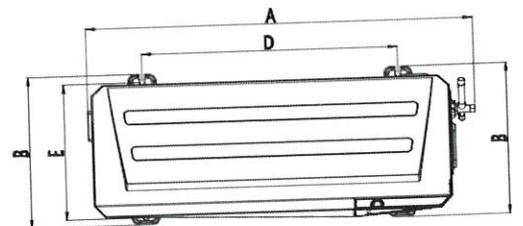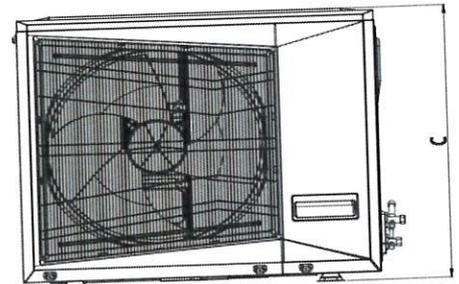

Notice: Federal law allows this unit to be installed only in AK, AL, AR, CO, CT, DC, DE, FL, GA, HI, ID, IL, IA, IN, KS, KY, LA, MA, ME, MD, MI, MN, MO, MS, MT, NC, ND, NE, NH, NJ, NY, OH, OR, PA, RI, SC, SD, TN, TX, UT, VA, VT, WA, WV, WI, WY, AND U.S. territories

SIDE-DISCHARGE AIR CONDITIONER SUBMITTAL

48,000 BTU 14 SEER SIDE-DISCHARGE AIR CONDITIONER

UUC148WCDA

COOLING CAPACITY DATA

Outdoor Air Temp DB	Indoor Set Temperature					
	70°F (21°C)		75°F (24°C)		80°F (27°C)	
	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)	Total Capacity (Btu/h)	Power Usage (w)
65°F (18°C)	46000	3170	50950	3195	55900	3230
75°F (24°C)	45200	3455	49600	3490	54100	3525
85°F (29°C)	44200	3800	48000	3835	52050	3870
95°F (35°C)	43000	4190	46100	4225	49650	4260
105°F (41°C)	41500	4630	44000	4665	47000	4700
115°F (46°C)	39700	5115	41500	5150	44100	5185

AMBIT ENGINEERING, INC.
Civil Engineers & Land Surveyors
100 Main Street, Suite 214
Portsmouth, NH 03801
Tel: (603) 430-8212
Fax: (603) 430-8212

NOTES:

- 1) PARCEL IS SHOWN ON THE CITY OF PORTSMOUTH ASSESSOR'S MAP 113 AS LOT 28-1.
- 2) OWNER OF RECORD:
11. INDUSTRIAL WAY
SHELTON, NH 03070
- 3) PARCEL IS NOT IN A SPECIAL FLOOD HAZARD ZONE AS SHOWN ON FEMA PANEL 3301500229E. EFFECTIVE DATE MAY 17, 2002.
- 4) EXISTING LOT AREA:
LOT 28-1
8,144 SQUARE FEET
- 5) PARCEL IS LOCATED IN THE GENERAL RESIDENCE A (GRA) ZONING DISTRICT.
- 6) DIMENSIONAL REQUIREMENTS:
MIN. LOT AREA: 7,500 S.F.
MIN. FRONT SETBACK: 10 FEET
MIN. SIDE SETBACK: 10 FEET
MIN. REAR SETBACK: 15 FEET
MAXIMUM STRUCTURE HEIGHT: 32 FEET
MAXIMUM BUILDING COVERAGE: 25%
MINIMUM OPEN SPACE: 50%
- 7) THE PURPOSE OF THIS PLAN IS TO SHOW A PROPOSED DWELLING (CURRENTLY UNDER CONSTRUCTION) AND DRIVEWAY LOCATED ON TAX MAP 113 LOT 28-1 IN THE CITY OF PORTSMOUTH.
- 8) PROPERTY IS SUBJECT TO CONDITIONS AND RESTRICTIONS CONTAINED IN E.C.D. 581/212 & 581/194.
- 9) PLANS BASED ON ARCHITECTURAL DESIGN BY OSULIHAN ARCHITECTS, INC.

**PROPOSED RESIDENCE
227 ELWYN AVENUE
PORTSMOUTH, N.H.**

NO.	ISSUED FOR COMMENT	DATE	REVISIONS
0		1/25/21	

SCALE: 1" = 10'
APPROVED BY THE PORTSMOUTH ZONING BOARD
JANUARY 2021

VARIANCE APPLICATION
PLAN
CI

**PROPOSED OPEN SPACES
AREA (S.F.)**

RESERVE WALK	1,105
DECK	25
STAIRS	12
DRIVEWAY	140
BULKHEAD	39
SHEDWALK	26
CONCRETE PAD	26
TOTAL COVERAGE	1,435
PROPOSED OPEN SPACE	4,596
STAKE	63.2%

**PROPOSED BUILDING
COVERAGE AREA**

RESIDENCE	1,796
DECK	25
STAIRS	12
TOTAL (S.F.)	1,833
LOT AREA (S.F.)	8,144
BUILDING COVERAGE (%)	24.2%



- PLAN REFERENCES:**
- 1) PLAN OF A LOT OF LAND OWNED BY ALFRED L. ELWYN PORTSMOUTH, NH, COMPILED FROM A SURVEY MADE TERS BY A.C. HOOT C.E. PREPARED BY W.H. WHITNEY, DATED AUGUST 1928, RECORDED PLAN #10172.
 - 2) BOUNDARY LINE AGREEMENT & LOT LINE RELOCATION PLAN TAX MAP 113 - LOTS 15 & 26, JONATHAN AND MEGAN ROCKLAND STREET, CITY OF PORTSMOUTH, COUNTY OF ROCKINGHAM, STATE OF NEW HAMPSHIRE, PREPARED BY AMBIT ENGINEERING, INC., DATED FEBRUARY 2020, TIME RECORDING DATE NOVEMBER 1, 2020, E.C.D. 581/212.
 - 3) TAX MAP 113 LOT 28 BOUNDARY PLAN FOR PARCELS 28-1, 28-2, 28-3, 28-4, 28-5, 28-6, 28-7, 28-8, 28-9, 28-10, 28-11, 28-12, 28-13, 28-14, 28-15, 28-16, 28-17, 28-18, 28-19, 28-20, 28-21, 28-22, 28-23, 28-24, 28-25, 28-26, 28-27, 28-28, 28-29, 28-30, 28-31, 28-32, 28-33, 28-34, 28-35, 28-36, 28-37, 28-38, 28-39, 28-40, 28-41, 28-42, 28-43, 28-44, 28-45, 28-46, 28-47, 28-48, 28-49, 28-50, 28-51, 28-52, 28-53, 28-54, 28-55, 28-56, 28-57, 28-58, 28-59, 28-60, 28-61, 28-62, 28-63, 28-64, 28-65, 28-66, 28-67, 28-68, 28-69, 28-70, 28-71, 28-72, 28-73, 28-74, 28-75, 28-76, 28-77, 28-78, 28-79, 28-80, 28-81, 28-82, 28-83, 28-84, 28-85, 28-86, 28-87, 28-88, 28-89, 28-90, 28-91, 28-92, 28-93, 28-94, 28-95, 28-96, 28-97, 28-98, 28-99, 28-100, 28-101, 28-102, 28-103, 28-104, 28-105, 28-106, 28-107, 28-108, 28-109, 28-110, 28-111, 28-112, 28-113, 28-114, 28-115, 28-116, 28-117, 28-118, 28-119, 28-120, 28-121, 28-122, 28-123, 28-124, 28-125, 28-126, 28-127, 28-128, 28-129, 28-130, 28-131, 28-132, 28-133, 28-134, 28-135, 28-136, 28-137, 28-138, 28-139, 28-140, 28-141, 28-142, 28-143, 28-144, 28-145, 28-146, 28-147, 28-148, 28-149, 28-150, 28-151, 28-152, 28-153, 28-154, 28-155, 28-156, 28-157, 28-158, 28-159, 28-160, 28-161, 28-162, 28-163, 28-164, 28-165, 28-166, 28-167, 28-168, 28-169, 28-170, 28-171, 28-172, 28-173, 28-174, 28-175, 28-176, 28-177, 28-178, 28-179, 28-180, 28-181, 28-182, 28-183, 28-184, 28-185, 28-186, 28-187, 28-188, 28-189, 28-190, 28-191, 28-192, 28-193, 28-194, 28-195, 28-196, 28-197, 28-198, 28-199, 28-200, 28-201, 28-202, 28-203, 28-204, 28-205, 28-206, 28-207, 28-208, 28-209, 28-210, 28-211, 28-212, 28-213, 28-214, 28-215, 28-216, 28-217, 28-218, 28-219, 28-220, 28-221, 28-222, 28-223, 28-224, 28-225, 28-226, 28-227, 28-228, 28-229, 28-230, 28-231, 28-232, 28-233, 28-234, 28-235, 28-236, 28-237, 28-238, 28-239, 28-240, 28-241, 28-242, 28-243, 28-244, 28-245, 28-246, 28-247, 28-248, 28-249, 28-250, 28-251, 28-252, 28-253, 28-254, 28-255, 28-256, 28-257, 28-258, 28-259, 28-260, 28-261, 28-262, 28-263, 28-264, 28-265, 28-266, 28-267, 28-268, 28-269, 28-270, 28-271, 28-272, 28-273, 28-274, 28-275, 28-276, 28-277, 28-278, 28-279, 28-280, 28-281, 28-282, 28-283, 28-284, 28-285, 28-286, 28-287, 28-288, 28-289, 28-290, 28-291, 28-292, 28-293, 28-294, 28-295, 28-296, 28-297, 28-298, 28-299, 28-300, 28-301, 28-302, 28-303, 28-304, 28-305, 28-306, 28-307, 28-308, 28-309, 28-310, 28-311, 28-312, 28-313, 28-314, 28-315, 28-316, 28-317, 28-318, 28-319, 28-320, 28-321, 28-322, 28-323, 28-324, 28-325, 28-326, 28-327, 28-328, 28-329, 28-330, 28-331, 28-332, 28-333, 28-334, 28-335, 28-336, 28-337, 28-338, 28-339, 28-340, 28-341, 28-342, 28-343, 28-344, 28-345, 28-346, 28-347, 28-348, 28-349, 28-350, 28-351, 28-352, 28-353, 28-354, 28-355, 28-356, 28-357, 28-358, 28-359, 28-360, 28-361, 28-362, 28-363, 28-364, 28-365, 28-366, 28-367, 28-368, 28-369, 28-370, 28-371, 28-372, 28-373, 28-374, 28-375, 28-376, 28-377, 28-378, 28-379, 28-380, 28-381, 28-382, 28-383, 28-384, 28-385, 28-386, 28-387, 28-388, 28-389, 28-390, 28-391, 28-392, 28-393, 28-394, 28-395, 28-396, 28-397, 28-398, 28-399, 28-400, 28-401, 28-402, 28-403, 28-404, 28-405, 28-406, 28-407, 28-408, 28-409, 28-410, 28-411, 28-412, 28-413, 28-414, 28-415, 28-416, 28-417, 28-418, 28-419, 28-420, 28-421, 28-422, 28-423, 28-424, 28-425, 28-426, 28-427, 28-428, 28-429, 28-430, 28-431, 28-432, 28-433, 28-434, 28-435, 28-436, 28-437, 28-438, 28-439, 28-440, 28-441, 28-442, 28-443, 28-444, 28-445, 28-446, 28-447, 28-448, 28-449, 28-450, 28-451, 28-452, 28-453, 28-454, 28-455, 28-456, 28-457, 28-458, 28-459, 28-460, 28-461, 28-462, 28-463, 28-464, 28-465, 28-466, 28-467, 28-468, 28-469, 28-470, 28-471, 28-472, 28-473, 28-474, 28-475, 28-476, 28-477, 28-478, 28-479, 28-480, 28-481, 28-482, 28-483, 28-484, 28-485, 28-486, 28-487, 28-488, 28-489, 28-490, 28-491, 28-492, 28-493, 28-494, 28-495, 28-496, 28-497, 28-498, 28-499, 28-500, 28-501, 28-502, 28-503, 28-504, 28-505, 28-506, 28-507, 28-508, 28-509, 28-510, 28-511, 28-512, 28-513, 28-514, 28-515, 28-516, 28-517, 28-518, 28-519, 28-520, 28-521, 28-522, 28-523, 28-524, 28-525, 28-526, 28-527, 28-528, 28-529, 28-530, 28-531, 28-532, 28-533, 28-534, 28-535, 28-536, 28-537, 28-538, 28-539, 28-540, 28-541, 28-542, 28-543, 28-544, 28-545, 28-546, 28-547, 28-548, 28-549, 28-550, 28-551, 28-552, 28-553, 28-554, 28-555, 28-556, 28-557, 28-558, 28-559, 28-560, 28-561, 28-562, 28-563, 28-564, 28-565, 28-566, 28-567, 28-568, 28-569, 28-570, 28-571, 28-572, 28-573, 28-574, 28-575, 28-576, 28-577, 28-578, 28-579, 28-580, 28-581, 28-582, 28-583, 28-584, 28-585, 28-586, 28-587, 28-588, 28-589, 28-590, 28-591, 28-592, 28-593, 28-594, 28-595, 28-596, 28-597, 28-598, 28-599, 28-600, 28-601, 28-602, 28-603, 28-604, 28-605, 28-606, 28-607, 28-608, 28-609, 28-610, 28-611, 28-612, 28-613, 28-614, 28-615, 28-616, 28-617, 28-618, 28-619, 28-620, 28-621, 28-622, 28-623, 28-624, 28-625, 28-626, 28-627, 28-628, 28-629, 28-630, 28-631, 28-632, 28-633, 28-634, 28-635, 28-636, 28-637, 28-638, 28-639, 28-640, 28-641, 28-642, 28-643, 28-644, 28-645, 28-646, 28-647, 28-648, 28-649, 28-650, 28-651, 28-652, 28-653, 28-654, 28-655, 28-656, 28-657, 28-658, 28-659, 28-660, 28-661, 28-662, 28-663, 28-664, 28-665, 28-666, 28-667, 28-668, 28-669, 28-670, 28-671, 28-672, 28-673, 28-674, 28-675, 28-676, 28-677, 28-678, 28-679, 28-680, 28-681, 28-682, 28-683, 28-684, 28-685, 28-686, 28-687, 28-688, 28-689, 28-690, 28-691, 28-692, 28-693, 28-694, 28-695, 28-696, 28-697, 28-698, 28-699, 28-700, 28-701, 28-702, 28-703, 28-704, 28-705, 28-706, 28-707, 28-708, 28-709, 28-710, 28-711, 28-712, 28-713, 28-714, 28-715, 28-716, 28-717, 28-718, 28-719, 28-720, 28-721, 28-722, 28-723, 28-724, 28-725, 28-726, 28-727, 28-728, 28-729, 28-730, 28-731, 28-732, 28-733, 28-734, 28-735, 28-736, 28-737, 28-738, 28-739, 28-740, 28-741, 28-742, 28-743, 28-744, 28-745, 28-746, 28-747, 28-748, 28-749, 28-750, 28-751, 28-752, 28-753, 28-754, 28-755, 28-756, 28-757, 28-758, 28-759, 28-760, 28-761, 28-762, 28-763, 28-764, 28-765, 28-766, 28-767, 28-768, 28-769, 28-770, 28-771, 28-772, 28-773, 28-774, 28-775, 28-776, 28-777, 28-778, 28-779, 28-780, 28-781, 28-782, 28-783, 28-784, 28-785, 28-786, 28-787, 28-788, 28-789, 28-790, 28-791, 28-792, 28-793, 28-794, 28-795, 28-796, 28-797, 28-798, 28-799, 28-800, 28-801, 28-802, 28-803, 28-804, 28-805, 28-806, 28-807, 28-808, 28-809, 28-810, 28-811, 28-812, 28-813, 28-814, 28-815, 28-816, 28-817, 28-818, 28-819, 28-820, 28-821, 28-822, 28-823, 28-824, 28-825, 28-826, 28-827, 28-828, 28-829, 28-830, 28-831, 28-832, 28-833, 28-834, 28-835, 28-836, 28-837, 28-838, 28-839, 28-840, 28-841, 28-842, 28-843, 28-844, 28-845, 28-846, 28-847, 28-848, 28-849, 28-850, 28-851, 28-852, 28-853, 28-854, 28-855, 28-856, 28-857, 28-858, 28-859, 28-860, 28-861, 28-862, 28-863, 28-864, 28-865, 28-866, 28-867, 28-868, 28-869, 28-870, 28-871, 28-872, 28-873, 28-874, 28-875, 28-876, 28-877, 28-878, 28-879, 28-880, 28-881, 28-882, 28-883, 28-884, 28-885, 28-886, 28-887, 28-888, 28-889, 28-890, 28-891, 28-892, 28-893, 28-894, 28-895, 28-896, 28-897, 28-898, 28-899, 28-900, 28-901, 28-902, 28-903, 28-904, 28-905, 28-906, 28-907, 28-908, 28-909, 28-910, 28-911, 28-912, 28-913, 28-914, 28-915, 28-916, 28-917, 28-918, 28-919, 28-920, 28-921, 28-922, 28-923, 28-924, 28-925, 28-926, 28-927, 28-928, 28-929, 28-930, 28-931, 28-932, 28-933, 28-934, 28-935, 28-936, 28-937, 28-938, 28-939, 28-940, 28-941, 28-942, 28-943, 28-944, 28-945, 28-946, 28-947, 28-948, 28-949, 28-950, 28-951, 28-952, 28-953, 28-954, 28-955, 28-956, 28-957, 28-958, 28-959, 28-960, 28-961, 28-962, 28-963, 28-964, 28-965, 28-966, 28-967, 28-968, 28-969, 28-970, 28-971, 28-972, 28-973, 28-974, 28-975, 28-976, 28-977, 28-978, 28-979, 28-980, 28-981, 28-982, 28-983, 28-984, 28-985, 28-986, 28-987, 28-988, 28-989, 28-990, 28-991, 28-992, 28-993, 28-994, 28-995, 28-996, 28-997, 28-998, 28-999, 29-000, 29-001, 29-002, 29-003, 29-004, 29-005, 29-006, 29-007, 29-008, 29-009, 29-010, 29-011, 29-012, 29-013, 29-014, 29-015, 29-016, 29-017, 29-018, 29-019, 29-020, 29-021, 29-022, 29-023, 29-024, 29-025, 29-026, 29-027, 29-028, 29-029, 29-030, 29-031, 29-032, 29-033, 29-034, 29-035, 29-036, 29-037, 29-038, 29-039, 29-040, 29-041, 29-042, 29-043, 29-044, 29-045, 29-046, 29-047, 29-048, 29-049, 29-050, 29-051, 29-052, 29-053, 29-054, 29-055, 29-056, 29-057, 29-058, 29-059, 29-060, 29-061, 29-062, 29-063, 29-064, 29-065, 29-066, 29-067, 29-068, 29-069, 29-070, 29-071, 29-072, 29-073, 29-074, 29-075, 29-076, 29-077, 29-078, 29-079, 29-080, 29-081, 29-082, 29-083, 29-084, 29-085, 29-086, 29-087, 29-088, 29-089, 29-090, 29-091, 29-092, 29-093, 29-094, 29-095, 29-096, 29-097, 29-098, 29-099, 29-100, 29-101, 29-102, 29-103, 29-104, 29-105, 29-106, 29-107, 29-108, 29-109, 29-110, 29-111, 29-112, 29-113, 29-114, 29-115, 29-116, 29-117, 29-118, 29-119, 29-120, 29-121, 29-122, 29-123, 29-124, 29-125, 29-126, 29-127, 29-128, 29-129, 29-130, 29-131, 29-132, 29-133, 29-134, 29-135, 29-136, 29-137, 29-138, 29-139, 29-140, 29-141, 29-142, 29-143, 29-144, 29-145, 29-146, 29-147, 29-148, 29-149, 29-150, 29-151, 29-152, 29-153, 29-154, 29-155, 29-156, 29-157, 29-158, 29-159, 29-160, 29-161, 29-162, 29-163, 29-164, 29-165, 29-166, 29-167, 29-168, 29-169, 29-170, 29-171, 29-172, 29-173, 29-174, 29-175, 29-176, 29-177, 29-178, 29-179, 29-180, 29-181, 29-182, 29-183, 29-184, 29-185, 29-186, 29-187, 29-188, 29-189, 29-190, 29-191, 29-192, 29-193, 29-194, 29-195, 29-196, 29-197, 29-198, 29-199, 29-200, 29-201, 29-202, 29-203, 29-204, 29-205, 29-206, 29-207, 29-208, 29-209, 29-210, 29-211, 29-212, 29-213, 29-214, 29-215, 29-216, 29-217, 29-218, 29-219, 29-220, 29-221, 29-222, 29-223, 29-224, 29-225, 29-226, 29-227, 29-228, 29-229, 29-230, 29-231, 29-232, 29-233, 29-234, 29-235, 29-236, 29-237, 29-238, 29-239, 29-240, 29-241, 29-242, 29-243, 29-244, 29-245, 29-246, 29-247, 29-248, 29-249, 29-250, 29-251, 29-252, 29-253, 29-254, 29-255, 29-256, 29-257, 29-258, 29-259, 29-260, 29-261, 29-262, 29-263, 29-264, 29-265, 29-266, 29-267, 29-268, 29-269, 29-270, 29-271, 29-272, 29-273, 29-274, 29-275, 29-276, 29-277, 29-278, 29-279, 29-280, 29-281, 29-282, 29-283, 29-284, 29-285, 29-286, 29-287, 29-288, 29-289, 29-290, 29-291, 29-292, 29-293, 29-294, 29-295, 29-296, 29-297, 29-298, 29-299, 29-300, 29-301, 29-302, 29-303, 29-304, 29-305, 29-306, 29-307, 29-308, 29-309, 29-310, 29-311, 29-312, 29-313, 29-314, 29-315, 29-316, 29-317, 29-318, 29-319, 29-320, 29-321, 29-322, 29-323, 29-324, 29-325, 29-326, 29-327, 29-328, 29-329, 29-330, 29-331, 29-332, 29-333, 29-334, 29-335, 29-336, 29-337, 29-338, 29-339, 29-340, 29-341, 29-342, 29-343, 29-344, 29-


21B Elwyn Ave

Portsmouth, NH



DRAWING LIST

- G1 GENERAL NOTES
- G2 OUTLINE SPECIFICATIONS
- A1 FOUNDATION & RADON PLAN
- A2 FLOOR PLANS
- A3 ELEVATIONS
- A4 ELEVATIONS
- A5 SECTIONS
- A6 SECTIONS
- A7 DETAILS
- A8 FRAMING PLANS

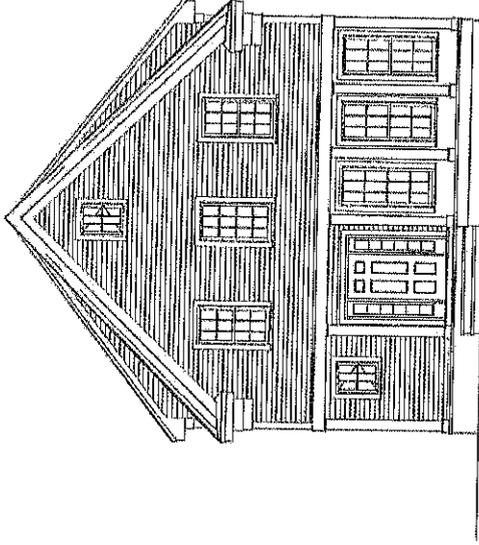

ARCHITECT
O'SULLIVAN ARCHITECTS
606 MAIN STREET, SUITE 3001
READING, MA 01867-3009
Voice: (781) 439-6166
Fax: (781) 439-6170

DEVELOPER
SAI BUILDERS, LLC
12 INDUSTRIAL WAY
SALEM, NH
Voice (603) 421-0470

SITE ENGINEER
AMBIT ENGINEERING, INC.
200 GRIFFIN RD - UNIT 3
PORTSMOUTH, NH 03801
Voice (603) 430-9282
Fax (603) 436-2315




PERMIT SET - 10/04/19

GENERAL NOTES

1. FOUNDATIONS
 A) ALL FOOTINGS SHALL BE SET ON UNDISTURBED SOIL HAVING A MINIMUM BEARING CAPACITY OF 5000 PSF (POUNDS PER SQUARE FOOT).
 B) THE BOTTOM ELEVATION OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 4'-0" BELOW FINISH GRADE. LOWER FOOTINGS AS REQUIRED TO REACH ACCEPTABLE BEARINGS.
 C) THOROUGHLY COMPACT THE BOTTOM OF EXCAVATIONS PRIOR TO FORMING FOOTINGS.
 D) ALL FOUNDATION WALLS SHALL BE BACKFILLED EVENLY ON BOTH SIDES TO PREVENT UNBALANCED LOADINGS.
 E) ALL BACKFILL USED INSIDE THE BUILDING SHALL BE WELL GRADED SCAVELL THROUGHOUT COMPACTED IN 6" LAYERS. ONCE THE MATERIAL HAS BEEN USED IT IS ACCEPTABLE TO THE GEOTECHNICAL ENGINEER.
 F) ALL CONCRETE SHALL BE PLACED IN DRY EXCAVATIONS, PUMP AWAY GROUND WATER AS REQUIRED.
 G) FOR CONSTRUCTION DURING WINTER, FOOTINGS AND FLOOR SLABS WILL REQUIRE PROTECTION FROM FREEZING TEMPERATURES AT THE BEARING SURFACES UNTIL THE BUILDING IS ENCLOSED AND HEATED.
 2. CONCRETE
 A) ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 5000 PSI AT 28 DAYS.
 B) MAXIMUM ALLOWABLE SLUMP OF CONCRETE SHALL NOT EXCEED 4".
 C) ALL CONCRETE WORK SHALL COMPLY WITH A.C.I. SPECIFICATIONS.
 3. REINFORCING STEEL
 A) ALL REINFORCING STEEL SHALL BE ASTM A636, GRADE 60 AND SHALL BE DETACHED FROM WALLS AND INSTALLED IN ACCORDANCE WITH THE LATEST A.C.I. SPECIFICATIONS.
 B) WELDED WIRE FABRIC (W.W.F.) SHALL BE ASTM A-65. LAP ALL SPARKS TO MINIMUM. SECURELY FASTEN W.W.F. IN PLACE TO PREVENT MOVEMENT DURING CONCRETE PLACEMENT.
 C) ALL HORIZONTAL RODS ARE CONTINUOUS. THE LENGTH OF ALL LAP SPICES SHALL BE AS REQUIRED FOR CLASS B TENSION SPICES PER THE LATEST A.C.I. CODE REQUIREMENTS UNLESS OTHERWISE NOTED ON THE CONTRACT DRAWINGS. PROVIDE CORNER RODS AS DETAILED ON THE CONTRACT DRAWINGS.
 D) PROVIDE A CLEAR COVER FROM REINFORCING STEEL TO ADJACENT CONCRETE SURFACES AS FOLLOWS:
 PIERIS AND WALLS: 1 1/2" (EXCEPT 2" AT #4 AND LARGER BARS)
 BOTTOM OF FOOTINGS: 3"
 THESE DIMENSIONS SHALL BE CONSIDERED ACTUAL AND ARE NOT TO BE ADJUSTED IN EITHER DIRECTION.
 E) ALL REINFORCING RODS AND WIRE SHALL BE ENCLOSED IN PROPER POSITION ON CHAIRS OR SPACERS AS MANUFACTURED BY RICHMOND SCREEN/ANCOR CO. OR APPROVED EQUAL.


FOOTING NOTES

1. ALL WOOD IN CONTACT WITH CONCRETE MUST BE PRESSURE TREATED.
2. PROVIDE #40 CONCRETE PUMP. (SEE SECTIONS)
3. TOP OF MAIN FOUNDATION WALL ASSUMED TO BE 100'-0".
4. FOOTING ELEVATIONS REPRESENT A MINIMUM ALLOWABLE SETBACK. FOOTINGS MUST BE PLACED ON UNDISTURBED SOIL OR COMPACTED FILL BUT IN NO CASE LESS THAN THE FOOT LINE DEPTH. 4'-0" MIN. CONTRACTOR TO VERIFY SOIL CONDITIONS UNDER ALL FOOTINGS.

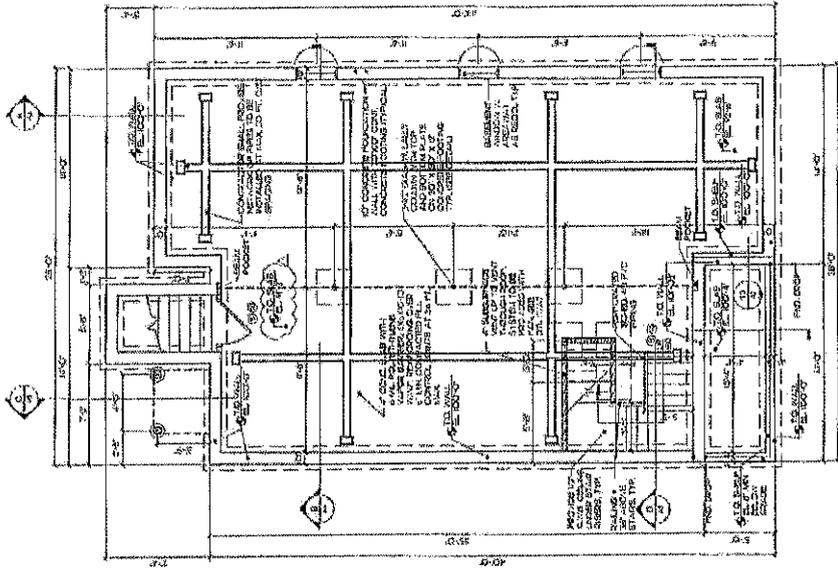

Basement Plan
Rev. 10/14

UNDERGROUND RADIATION GAS VENT SYSTEM
 1. GO TO PROVIDE NETWORK OF PIPES TO BE INSTALLED AT MAX 20' SPACING EACH WAY
 2. AN INDEPENDENT SYSTEM IS REQUIRED FOR EACH UNIT. COMPLETE WITH INDIVIDUAL VENT STACKS THROUGH TO THE ROOF FOR EACH UNIT
 3. NETWORK OF PIPES TO BE REFORCED SOLED #4 PVC PIPING. REFER TO DETAILS

	O'SULLIVAN ARCHITECTS, INC. <small>ARCHITECTURE INTERIOR DESIGN</small> 100 MAIN STREET, SUITE 2001 PORTSMOUTH, NEW HAMPSHIRE 02877 TEL: (603) 436-8800 FAX: (603) 436-8877 WWW.OSULLIVANARCHITECTS.COM	SAI Builders, LLC	21B Elwyn Ave Portsmouth, NH	Basement & Radon Plan							
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">SCALE: AS SHOWN</td> <td style="width: 50%;">DESIGNED BY: [REDACTED]</td> </tr> <tr> <td>DATE: 10/14/14</td> <td>CHECKED BY: [REDACTED]</td> </tr> <tr> <td colspan="2" style="text-align: center;"> JOB NO: 19041 SHEET NUMBER: A1 </td> </tr> </table>						SCALE: AS SHOWN	DESIGNED BY: [REDACTED]	DATE: 10/14/14	CHECKED BY: [REDACTED]	JOB NO: 19041 SHEET NUMBER: A1	
SCALE: AS SHOWN	DESIGNED BY: [REDACTED]										
DATE: 10/14/14	CHECKED BY: [REDACTED]										
JOB NO: 19041 SHEET NUMBER: A1											



O'SULLIVAN ARCHITECTS, INC.
ARCHITECTS
 200 CHAN STREET, SUITE 200
 PORTSMOUTH, NH 03801
 TEL: 603.883.1234 FAX: 603.883.1235
 WWW.OSULLIVANARCHITECTS.COM

SAI Builders, LLC
 21 B Elmyn Ave
 Portsmouth, NH



Floor Plans



SCALE: As Noted
 ISSUED/DRAWN BY:
 YEAR/S
 CHECKED/DESIGNED BY:
 YEAR/S

JOB NO: 19041
 SHEET NUMBER
A2

BUILDING S.F. 10,215 S.F. FIRST FLOOR 1005 S.F. SECOND FLOOR 540 S.F. TOTAL 1,545 S.F. BASEMENT 989 S.F.	(S) SMOKE DETECTOR (H) HEAT DETECTOR (C) CARBON MONOXIDE DETECTOR
--	---

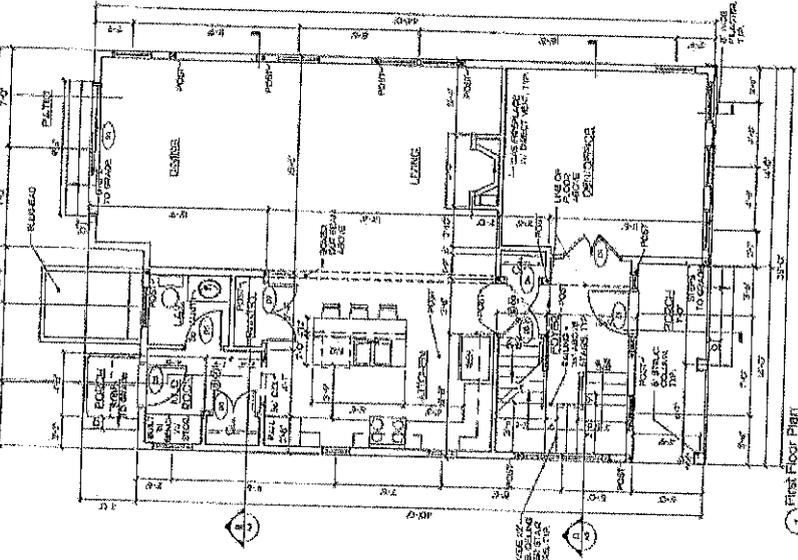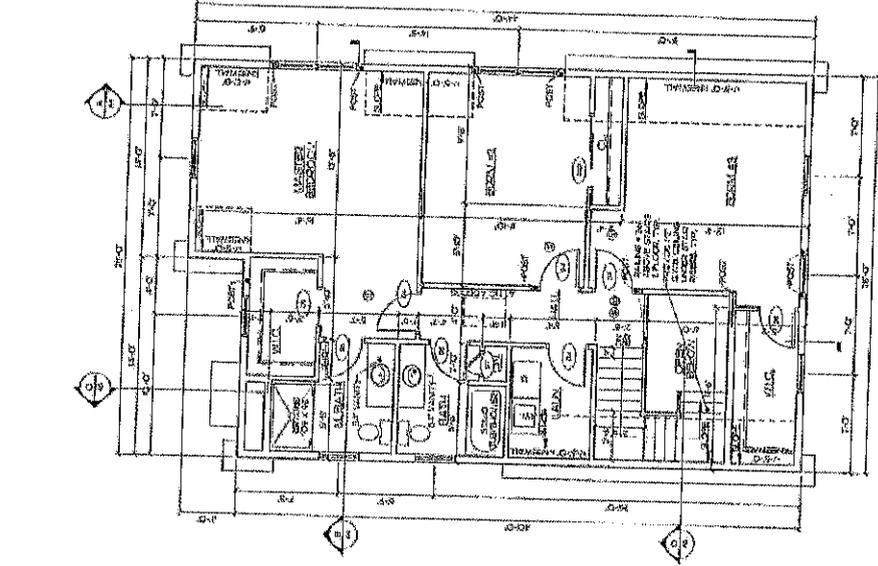

DOOR SCHEDULE

NUMBER	TYPE	MATERIAL	WIDTH	HEIGHT	THICKNESS	REMARKS
D1	ENTRY	MTL/INSL	3'-0"	5'-8"	1 3/4"	
D2	SINGLE	MTL/INSL	3'-10"	5'-8"	1 3/4"	1/2 SIDELITES EA. SIDE
D3	TRFL SLIDER	WLD/GLASS	9'-0"	6'-8"		- HALF GLASS DOOR
D4	SINGLE	WOOD	2'-6"	6'-8"	1 3/8"	
D5	SINGLE	WOOD	2'-6"	5'-8"	1 3/8"	
D6	SINGLE	WOOD	2'-4"	6'-8"	1 3/8"	
D7	SINGLE	WOOD	1'-8"	5'-8"	1 3/8"	
D8	DOUBLE	WOOD	01'-6"	6'-8"	1 3/8"	
D9	DOUBLE	WOOD	02'-0"	6'-8"	1 3/8"	
D10	SLIDER	WOOD	5'-0"	5'-8"	1 3/8"	
D11	POCKET	WOOD	2'-5"	6'-8"	1 3/8"	



O'SULLIVAN ARCHITECTS, INC.
 ARCHITECTS REGISTERED IN THE STATE OF MASSACHUSETTS
 600 MAIN STREET, SUITE 200
 NEEDHAM HILLS, MASSACHUSETTS 02461
 TEL: 781-451-1000 FAX: 781-451-1001
 WWW.OSULLIVANARCHITECTS.COM

THIS DOCUMENT IS THE PROPERTY OF O'SULLIVAN ARCHITECTS, INC.
 IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN.
 ANY REUSE OR MODIFICATION OF THIS DOCUMENT WITHOUT THE WRITTEN CONSENT OF O'SULLIVAN ARCHITECTS, INC. IS PROHIBITED.

SAI Builders, LLC

21 B Elwyn Ave
 Portsmouth, NH

Elevations




SEAL: ARCHITECT
 O'SULLIVAN ARCHITECTS, INC.
 MASSACHUSETTS
 REGISTERED ARCHITECT

JOB NO: 19041


SHEET NUMBER

A3

NOTES:
 1. ALL WINDOWS TO BE HARVEY PROUDER VINYL WINDOW SERIES WINDOWS UNLESS OTHERWISE NOTED
 2. ALL WINDOWS 8'-0" OR HIGHER ABOVE GRADE TO HAVE FULL HEIGHT OF 2" x 4" P.F.F. OR UNLESS AS NOTED.

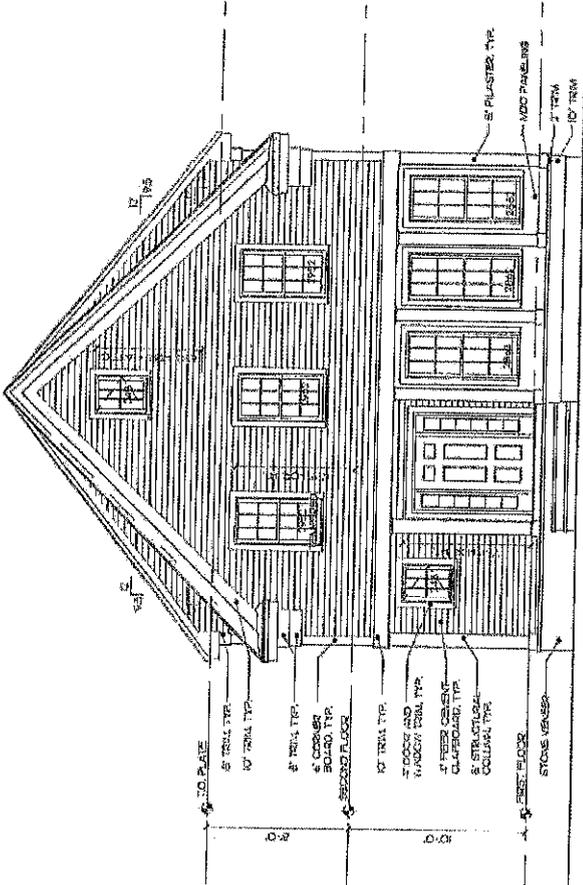

1. Front Elevation
 Scale: 1/8" = 1'-0"

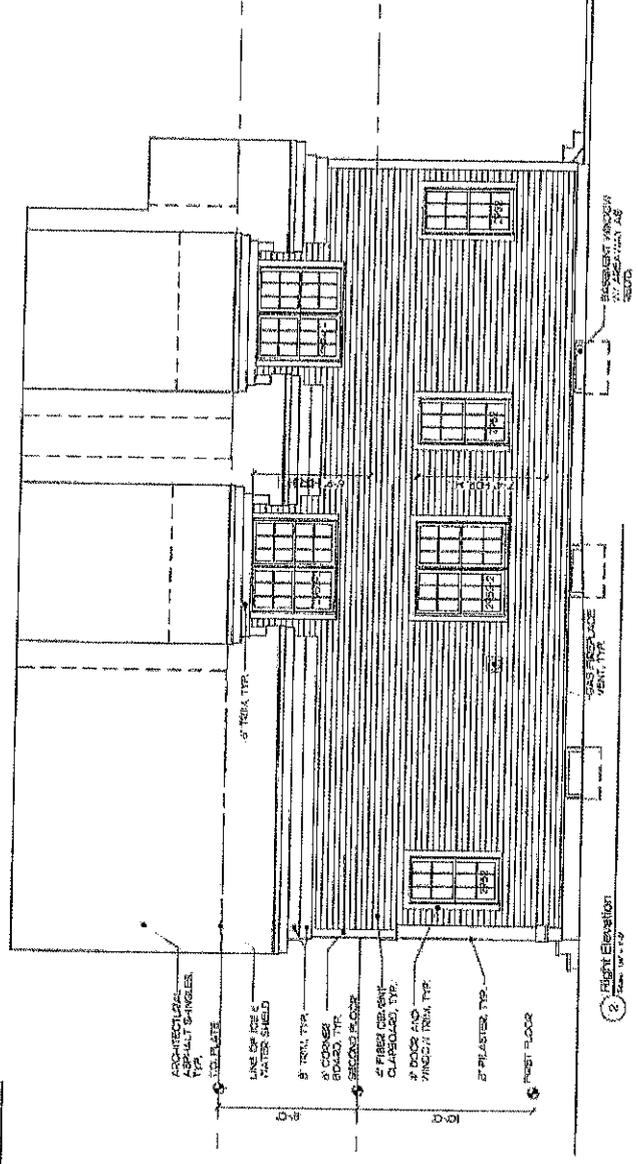


2. Right Elevation
 Scale: 1/8" = 1'-0"



Front of House



Northerly Side of House

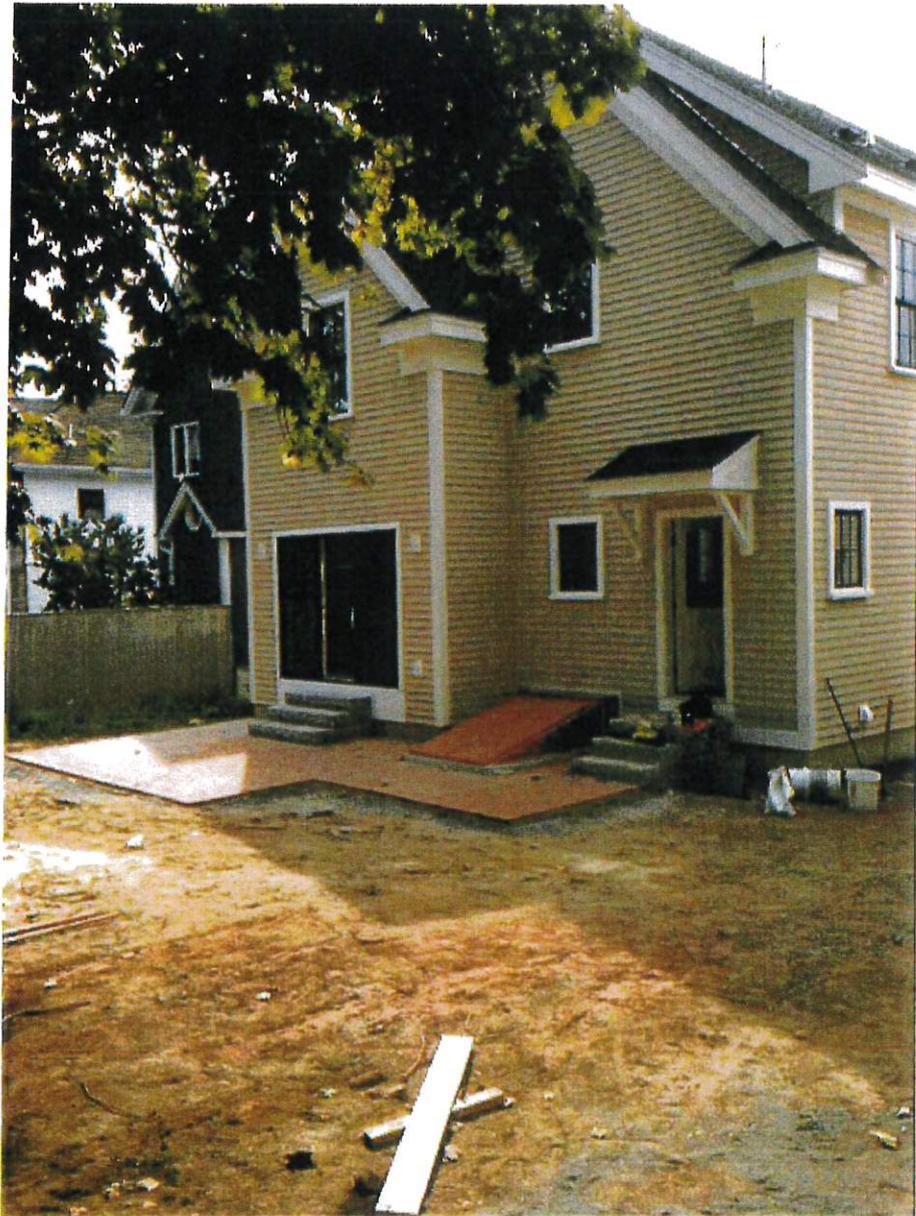

Rear of House



Southerly Abutter's House



Southerly Side of House



Approximate Location of
Proposed AC Equipment



Southerly Side of House



**MAP FOR REFERENCE ONLY
NOT A LEGAL DOCUMENT**

City of Portsmouth, NH makes no claims and no warranties, expressed or implied, concerning the validity or accuracy of the GIS data presented on this map.

Geometry updated 4/1/2019
Data updated 7/17/2019