

L-0700-023
July 21, 2022

Mr. Rick Chellman, Chairman
City of Portsmouth Planning Board
1 Junkins Avenue
Portsmouth, New Hampshire 03801

Re: **Site Review Permit Application**
Lonza Biologics – Proposed Café Expansion

Dear Chairman Chellman:

On behalf of Lonza Biologics, we are pleased to submit via the City of Portsmouth online permitting system the following information to support a request to the Planning Board for a recommendation for approval to the Pease Development Authority (PDA) for Site Plan Review for the above referenced project:

- One (1) copy of the PDA Application for Site Review, dated June 21, 2021;
- One (1) full-size & one (1) half-size copy of the Site Plan Set, last revised July 21, 2022;
- One (1) copy of the TAC Stipulation Response Report, dated July 21, 2022;
- One (1) copy of the Drainage Memo, last revised July 21, 2022;
- One (1) copy of the Operations and Maintenance Plan, dated June 21, 2022;
- One (1) copy of the Exterior Rendering, dated May 19, 2022;

The proposed project is located at 101 International Drive which is identified as Map 305 Lot 6 on the City of Portsmouth Tax Maps. The proposed project is to expand Lonza Biologics café to support its existing workforce in the pharmaceutical and biologic industries.


The proposed project includes the construction of an approximately 4,200 SF expansion to Lonza's existing café. This café expansion is necessary to support Lonza's existing workforce. The proposed expansion is directly adjacent to the existing café internal to the main building. The project will consist of associated site improvements such as landscaping, retaining wall, relocation of the existing grease trap, and stormwater management that will include stormwater treatment via a proprietary filtration unit. The proposed project is providing stormwater treatment for all the proposed new impervious surfaces plus an equivalent area of existing impervious surfaces as required by the PDA. The relocated existing grease trap will discharge to the existing 8" clay gravity-fed sewer line that runs parallel to International Drive in the grassed portion of the right of way on the development lot side of the street.



On May 17, 2022, the PDA Board granted conceptual approval for these improvements. The project also received a recommendation for approval from the Technical Advisory Committee (TAC) at their July 5, 2022, meeting. We respectfully request to be placed on the Planning Board (PB) meeting agenda for August 18, 2022. If you have any questions or need any additional information, please contact Neil Hansen by phone at (603) 294-9213 or by email at nahansen@tighebond.com.

Sincerely,

TIGHE & BOND, INC.



Neil A. Hansen, PE
Project Manager



Patrick M. Crimmins, PE
Vice President

Copy: Lonza Biologics (via email)
Fulcrum Associates (via email)
Pease Development Authority

J:\L\L0700 Lonza Biologics Expansion was 1576F\023_Cafe Expansion\Report_Evaluation\Applications\City of Portsmouth\20220721 PB Submission\L-0700-023 PB Cover Letter.docx



Application for Site Review

For PDA Use Only			
Date Submitted: _____	Municipal Review: _____	Fee: _____	
Application Complete: _____	Date Forwarded: _____	Paid: _____	Check #: _____

Applicant Information

Applicant: Lonza Biologics, Inc.	Agent: Tighe & Bond, Inc.
Address: 101 International Drive Portsmouth, NH 03801	Address: 177 Corporate Drive Portsmouth, NH 03801
Business Phone: 603-610-5129	Business Phone: 603-433-8818
Mobile Phone:	Mobile Phone:
Fax:	Fax:


Site Information

Portsmouth Tax Map: 305	Lot #: 006	Zone: Airport, Business, Commercial
Site Address / Location : 101 International Drive, Portsmouth, NH 03801		
Site Address / Location :		Area of On-site Wetlands: 0 SF

Activity Information

Change of Use: Yes [] No [X]	Existing Use: <u>Office/Research/Manufacturing</u>
	Proposed Use: <u>Office/Research/Manufacturing</u>
Description of Project: The proposed project consists of the construction an approximate 4,200 SF footprint expansion to Lonza's existing cafe to support it's growing workforce. The expansion is directly adjacent to the existing cafe internal to the main building. There will also be associated site improvements to support the proposed project including stormwater treatment, relocation of the existing grease trap and landscaping.	
<i>All above information shall be shown on a site plan submitted with this application. Provide 3 full size hard copies and one PDF copy of all application materials as well as one half-size set of drawings to PDA. Applicant shall supply additional copies as may be required by applicable municipality. Refer to Chapter 400 of PDA land Use Controls for additional information.</i>	

Certification

I hereby certify under the penalties of perjury that the foregoing information and accompanying plans, documents, and supporting data are true and complete to the best of my knowledge. I hereby apply for Site Review and acknowledge I will comply with all regulations and any conditions established by the Review Committee(s) and PDA Board in the development and construction of this project.	
 _____ Signature of Applicant	6/21/22 _____ Date
_____ Printed Name	

N:\Engineer\ ApplicationforSiteReview.xlsx

CAFE EXPANSION

LONZA BIOLOGICS

101 INTERNATIONAL DRIVE


PORTSMOUTH, NEW HAMPSHIRE

JUNE 27, 2022

LAST REVISED JULY 21, 2022

LIST OF DRAWINGS		
SHEET NO.	SHEET TITLE	LAST REVISED
	COVER SHEET	7/21/2022
1 of 1	EXISTING DOUCET PLAN	5/26/2022
C-101	OVERALL EXISTING CONDITIONS PLAN	7/21/2022
C-101.1	DEMOLITION PLAN	7/21/2022
C-102	OVERALL SITE PLAN	7/21/2022
C-102.1	SITE PLAN	7/21/2022
C-103	GRADING, DRAINAGE, AND EROSION CONTROL PLAN	7/21/2022
C-104	UTILITIES PLAN	7/21/2022
C-105	LANDSCAPE PLAN	7/21/2022
C-501	EROSION CONTROL NOTES AND DETAILS SHEET	7/21/2022
C-502	DETAILS SHEET	7/21/2022
C-503	DETAILS SHEET	7/21/2022
C-504	DETAILS SHEET	7/21/2022
AP-101	FIRST FLOOR AREA PLAN	6/7/2022
AP-102	SECOND FLOOR AREA PLAN	6/7/2022
	PROPOSED EXTERIOR ELEVATIONS	5/19/2022

LIST OF PERMITS		
LOCAL	STATUS	DATE
SITE PLAN REVIEW PERMIT	PENDING	

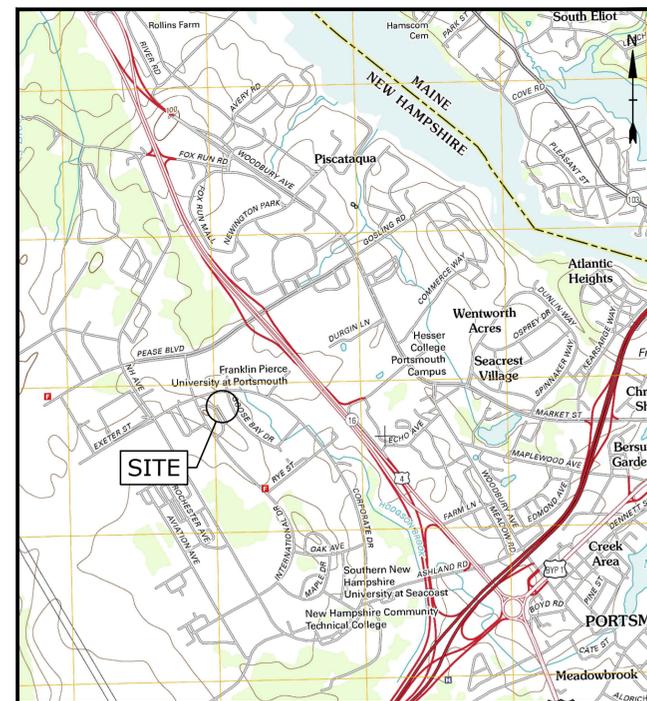

LOCATION MAP
SCALE: 1" = 2,000'

LESSOR: PEASE DEVELOPMENT AUTHORITY
55 INTERNATIONAL DRIVE
PORTSMOUTH, NEW HAMPSHIRE 03801





APPLICANT: LONZA BIOLOGICS
101 INTERNATIONAL DRIVE
PORTSMOUTH, NH 03801

CIVIL ENGINEER: **Tighe&Bond**
177 CORPORATE DRIVE
PORTSMOUTH, NEW HAMPSHIRE 03801

SURVEYOR: DOUCET SURVEY, INC.
102 KENT PLACE
NEWMARKET, NEW HAMPSHIRE 03857



PLANNING BOARD
SUBMISSION PLAN SET
COMPLETE SET 16 SHEETS

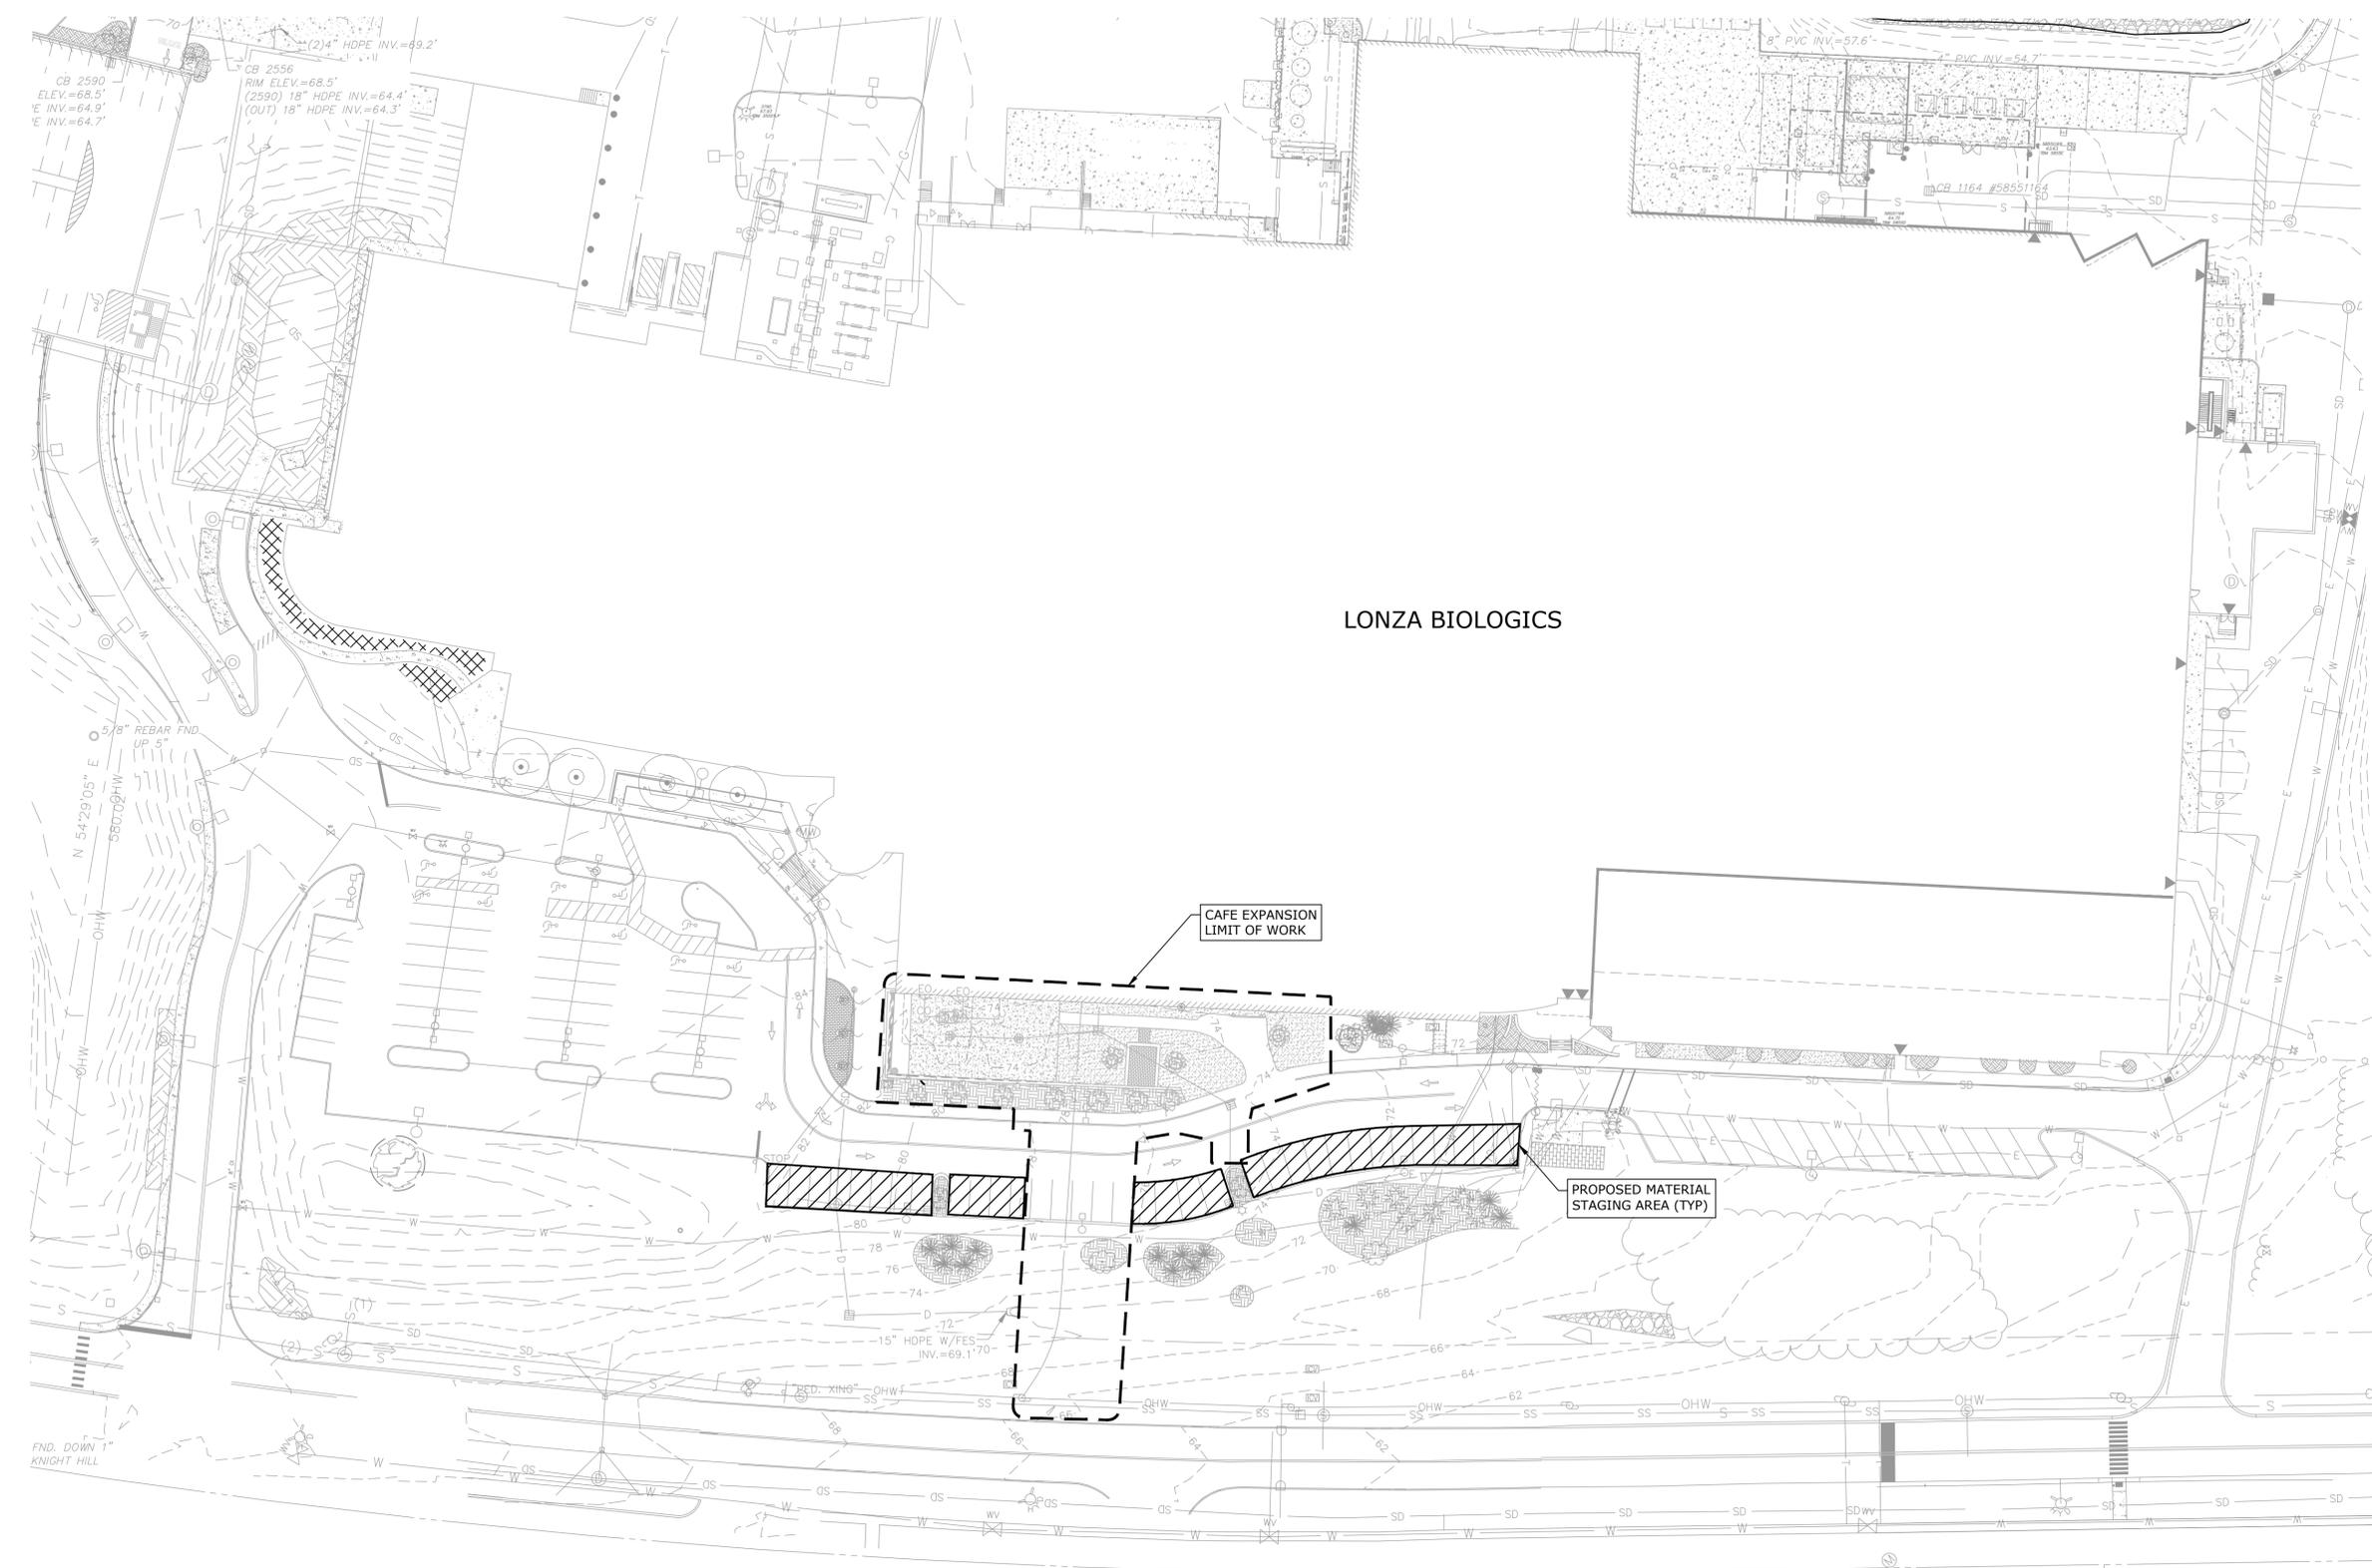

LONZA BIOLOGICS

CAFE EXPANSION
LIMIT OF WORK

PROPOSED MATERIAL
STAGING AREA (TYP)

**Cafe
Expansion**

Lonza Biologics

Portsmouth,
New Hampshire

A	7/21/2022	PB Submission
MARK	DATE	DESCRIPTION
PROJECT NO:	L-0700-023	
DATE:	June 27, 2022	
FILE:	L-0700-023-C-DSGN.DWG	
DRAWN BY:	CJ/K/NHW	
CHECKED BY:	NAH	
APPROVED BY:	PMC	

OVERALL EXISTING
CONDITIONS


SCALE: AS SHOWN

Last Saved: 7/21/2022 10:07:23am By: CK/ezekiel
Project: 07/21/2022 10:07:23am
File: L:\Projects\21\10700 Lonza Biologics Expansion\15766F\023_Cafe Expansion\Drawings_Figures\AutoCAD\L-0700-023-C-DSGN.dwg



- DEMOLITION NOTES:**
- THE LOCATIONS OF UNDERGROUND UTILITIES ARE APPROXIMATE AND THE LOCATIONS ARE NOT GUARANTEED BY THE OWNER OR THE ENGINEER. IT IS THE CONTRACTOR'S RESPONSIBILITY TO LOCATE ALL UTILITIES, ANTICIPATE CONFLICTS, REPAIR EXISTING UTILITIES AND RELOCATE EXISTING UTILITIES REQUIRED TO COMPLETE THE WORK.
 - THE CONTRACTOR SHALL VERIFY LOCATION OF ALL EXISTING UTILITIES. CALL DIG SAFE AT LEAST 72 HOURS PRIOR TO THE COMMENCEMENT OF ANY DEMOLITION/CONSTRUCTION ACTIVITIES.
 - ALL MATERIALS SCHEDULED TO BE REMOVED SHALL BECOME THE PROPERTY OF THE CONTRACTOR UNLESS OTHERWISE SPECIFIED. THE CONTRACTOR SHALL DISPOSE OF ALL MATERIALS OFF-SITE IN ACCORDANCE WITH ALL FEDERAL, STATE, AND LOCAL REGULATIONS, ORDINANCES AND CODES EXCEPT AS SPECIFIED IN NOTE #22.
 - COORDINATE REMOVAL, RELOCATION, DISPOSAL OR SALVAGE OF UTILITIES WITH THE OWNER AND APPROPRIATE UTILITY COMPANY.
 - ANY EXISTING WORK OR PROPERTY DAMAGED OR DISRUPTED BY CONSTRUCTION/ DEMOLITION ACTIVITIES SHALL BE REPLACED OR REPAIRED TO MATCH ORIGINAL EXISTING CONDITIONS BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER.
 - SAW CUT AND REMOVE PAVEMENT ONE (1) FOOT OFF PROPOSED EDGE OF PAVEMENT OR EXISTING CURB LINE IN ALL AREAS WHERE PAVEMENT TO BE REMOVED ABUTS EXISTING PAVEMENT OR CONCRETE TO REMAIN.
 - IT IS THE CONTRACTOR'S RESPONSIBILITY TO FAMILIARIZE THEMSELVES WITH THE CONDITIONS OF ALL OF THE PERMIT APPROVALS.
 - THE CONTRACTOR SHALL OBTAIN AND PAY FOR ADDITIONAL PERMITS, NOTICES AND FEES NECESSARY TO COMPLETE THE WORK AND ARRANGE FOR AND PAY FOR NECESSARY INSPECTIONS AND APPROVALS FROM THE AUTHORITIES HAVING JURISDICTION.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DEMOLITION AND OFF-SITE DISPOSAL OF MATERIALS REQUIRED TO COMPLETE THE WORK, EXCEPT FOR WORK NOTED TO BE COMPLETED BY OTHERS AND AS SPECIFIED IN NOTE #22.
 - UTILITIES SHALL BE TERMINATED AT THE MAIN LINE PER UTILITY COMPANY STANDARDS. THE CONTRACTOR SHALL REMOVE ALL ABANDONED UTILITIES LOCATED WITHIN THE LIMITS OF WORK.
 - CONTRACTOR SHALL VERIFY ORIGIN OF ALL DRAINS AND UTILITIES PRIOR TO REMOVAL/TERMINATION TO DETERMINE IF DRAINS OR UTILITY IS ACTIVE, AND SERVICES ANY ON OR OFF-SITE STRUCTURE TO REMAIN. THE CONTRACTOR SHALL NOTIFY ENGINEER IMMEDIATELY OF ANY SUCH UTILITY FOUND AND SHALL MAINTAIN THESE UTILITIES UNTIL PERMANENT SOLUTION IS IN PLACE.
 - PAVEMENT REMOVAL LIMITS ARE SHOWN FOR CONTRACTOR'S CONVENIENCE. ADDITIONAL PAVEMENT REMOVAL MAY BE REQUIRED DEPENDING ON THE CONTRACTOR'S OPERATION. CONTRACTOR TO VERIFY FULL LIMITS OF PAVEMENT REMOVAL PRIOR TO BID.
 - THE CONTRACTOR SHALL REMOVE AND DISPOSE OF ALL EXISTING STRUCTURES, CONCRETE PADS, UTILITIES AND PAVEMENT WITHIN THE WORK LIMITS SHOWN UNLESS SPECIFICALLY IDENTIFIED TO REMAIN. ITEMS TO BE REMOVED INCLUDE BUT ARE NOT LIMITED TO: CONCRETE, PAVEMENT, CURBS, UNDER GROUND PIPING, SEWER GREASE TRAP, AND SEWER LINES.
 - COORDINATE ALL WORK WITHIN THE PUBLIC RIGHT OF WAYS WITH THE CITY OF PORTSMOUTH.
 - CONTRACTOR SHALL PROTECT ALL PROPERTY MONUMENTATION THROUGHOUT DEMOLITION AND CONSTRUCTION OPERATIONS. SHOULD ANY MONUMENTATION BE DISTURBED BY THE CONTRACTOR, THE CONTRACTOR SHALL EMPLOY A NEW HAMPSHIRE LICENSED SURVEYOR TO REPLACE DISTURBED MONUMENTS.
 - PROVIDE INLET PROTECTION BARRIERS AT ALL CATCH BASINS/CURB INLETS WITHIN CONSTRUCTION LIMITS AS WELL AS CATCH BASINS/CURB INLETS THAT RECEIVE RUNOFF FROM CONSTRUCTION ACTIVITIES. INLET PROTECTION BARRIERS SHALL BE MAINTAINED FOR THE DURATION OF THE PROJECT. INLET PROTECTION BARRIERS SHALL BE "HIGH FLOW SILT SACK" BY ACF ENVIRONMENTAL OR EQUAL. INSPECT BARRIERS WEEKLY AND AFTER EACH RAIN EVENT OF 0.25 INCHES OR GREATER. CONTRACTOR SHALL COMPLETE A MAINTENANCE INSPECTION REPORT AFTER EACH INSPECTION. SEDIMENT DEPOSITS SHALL BE REMOVED AFTER EACH STORM EVENT OR MORE OFTEN IF THE FABRIC BECOMES CLOGGED OR SEDIMENT HAS ACCUMULATED TO 1/3 THE DESIGN DEPTH OF THE BARRIER.
 - EROSION CONTROL MEASURES SHALL BE INSTALLED PRIOR TO THE START OF ANY CLEARING OR DEMOLITION ACTIVITIES.
 - THE CONTRACTOR SHALL PAY ALL COSTS NECESSARY FOR TEMPORARY PARTITIONING, BARRICADING, FENCING, SECURITY AND SAFETY DEVICES REQUIRED FOR THE MAINTENANCE OF A CLEAN AND SAFE CONSTRUCTION SITE.
 - SAW CUT AND REMOVE PAVEMENT AND CONSTRUCT PAVEMENT TRENCH PATCH FOR ALL UTILITIES TO BE REMOVED AND PROPOSED UTILITIES LOCATED IN EXISTING PAVEMENT AREAS TO REMAIN.
 - THE CONTRACTOR SHALL ACQUIRE A PDA DIG PERMIT BEFORE ANY DISTURBANCE CAN TAKE PLACE. ALLOW 7 CALENDAR DAYS FOR PROCESSING.
 - BEFORE ANY DEWATERING IS PERFORMED, COORDINATION BETWEEN THE APPLICANT, PDA, NHDES AND THE AIR FORCE IS REQUIRED TO DETERMINE PROPER PROCEDURES AND PERMITTING REQUIRED. AT A MINIMUM A NHDES TEMPORARY DISCHARGE PERMIT IS REQUIRED.
 - ALL EXCESS SOIL RESULTING FROM THE CONSTRUCTION SHALL REMAIN ON SITE. COORDINATE WITH OWNER AND PEASE DEVELOPMENT AUTHORITY ON FINAL LOCATION OF EXCESS MATERIALS. A SOIL MANAGEMENT PLAN SHALL BE PREPARED FOR THE RELOCATION OF ANY CONTAMINATED MATERIALS TO BE RELOCATED DURING CONSTRUCTION.
 - REMOVE TREES AND BRUSH AS REQUIRED FOR COMPLETION OF WORK. CONTRACTOR SHALL GRUB AND REMOVE ALL STUMPS WITHIN LIMITS OF WORK AND DISPOSE OF OFF SITE IN ACCORDANCE WITH FEDERAL, STATE, AND LOCAL LAWS AND REGULATIONS.
 - THE CONTRACTOR SHALL PHASE DEMOLITION AND CONSTRUCTION AS REQUIRED TO PROVIDE CONTINUOUS SERVICE TO THE EXISTING BUSINESS THROUGHOUT THE CONSTRUCTION PERIOD. EXISTING BUSINESS SERVICES INCLUDE, BUT ARE NOT LIMITED TO ELECTRICAL, COMMUNICATION, FIRE PROTECTION, DOMESTIC WATER AND SEWER SERVICES. TEMPORARY SERVICES, IF REQUIRED, SHALL COMPLY WITH ALL FEDERAL, STATE, LOCAL AND UTILITY COMPANY STANDARDS. CONTRACTOR SHALL PROVIDE DETAILED CONSTRUCTION SCHEDULE TO OWNER PRIOR TO ANY DEMOLITION/CONSTRUCTION ACTIVITIES AND SHALL COORDINATE TEMPORARY SERVICES TO ABUTTERS WITH THE UTILITY COMPANY AND AFFECTED. ABUTTER.

- EXISTING CONDITIONS NOTES:**
- THE EXISTING CONDITIONS INFORMATION SHOWN IS BASED ON SURVEY DRAWINGS PROVIDED BY DOUCET SURVEY TITLED "FOR TIGHE & BOND", DATED MAY 26, 2022.
 - THE DRAWINGS ARE BASED ON THE FOLLOWING DATUMS: HORIZONTAL NAD83; VERTICAL NAVD88.
 - CONTOUR LINES INDICATE ELEVATION CHANGE IN TWO FOOT INTERVALS.

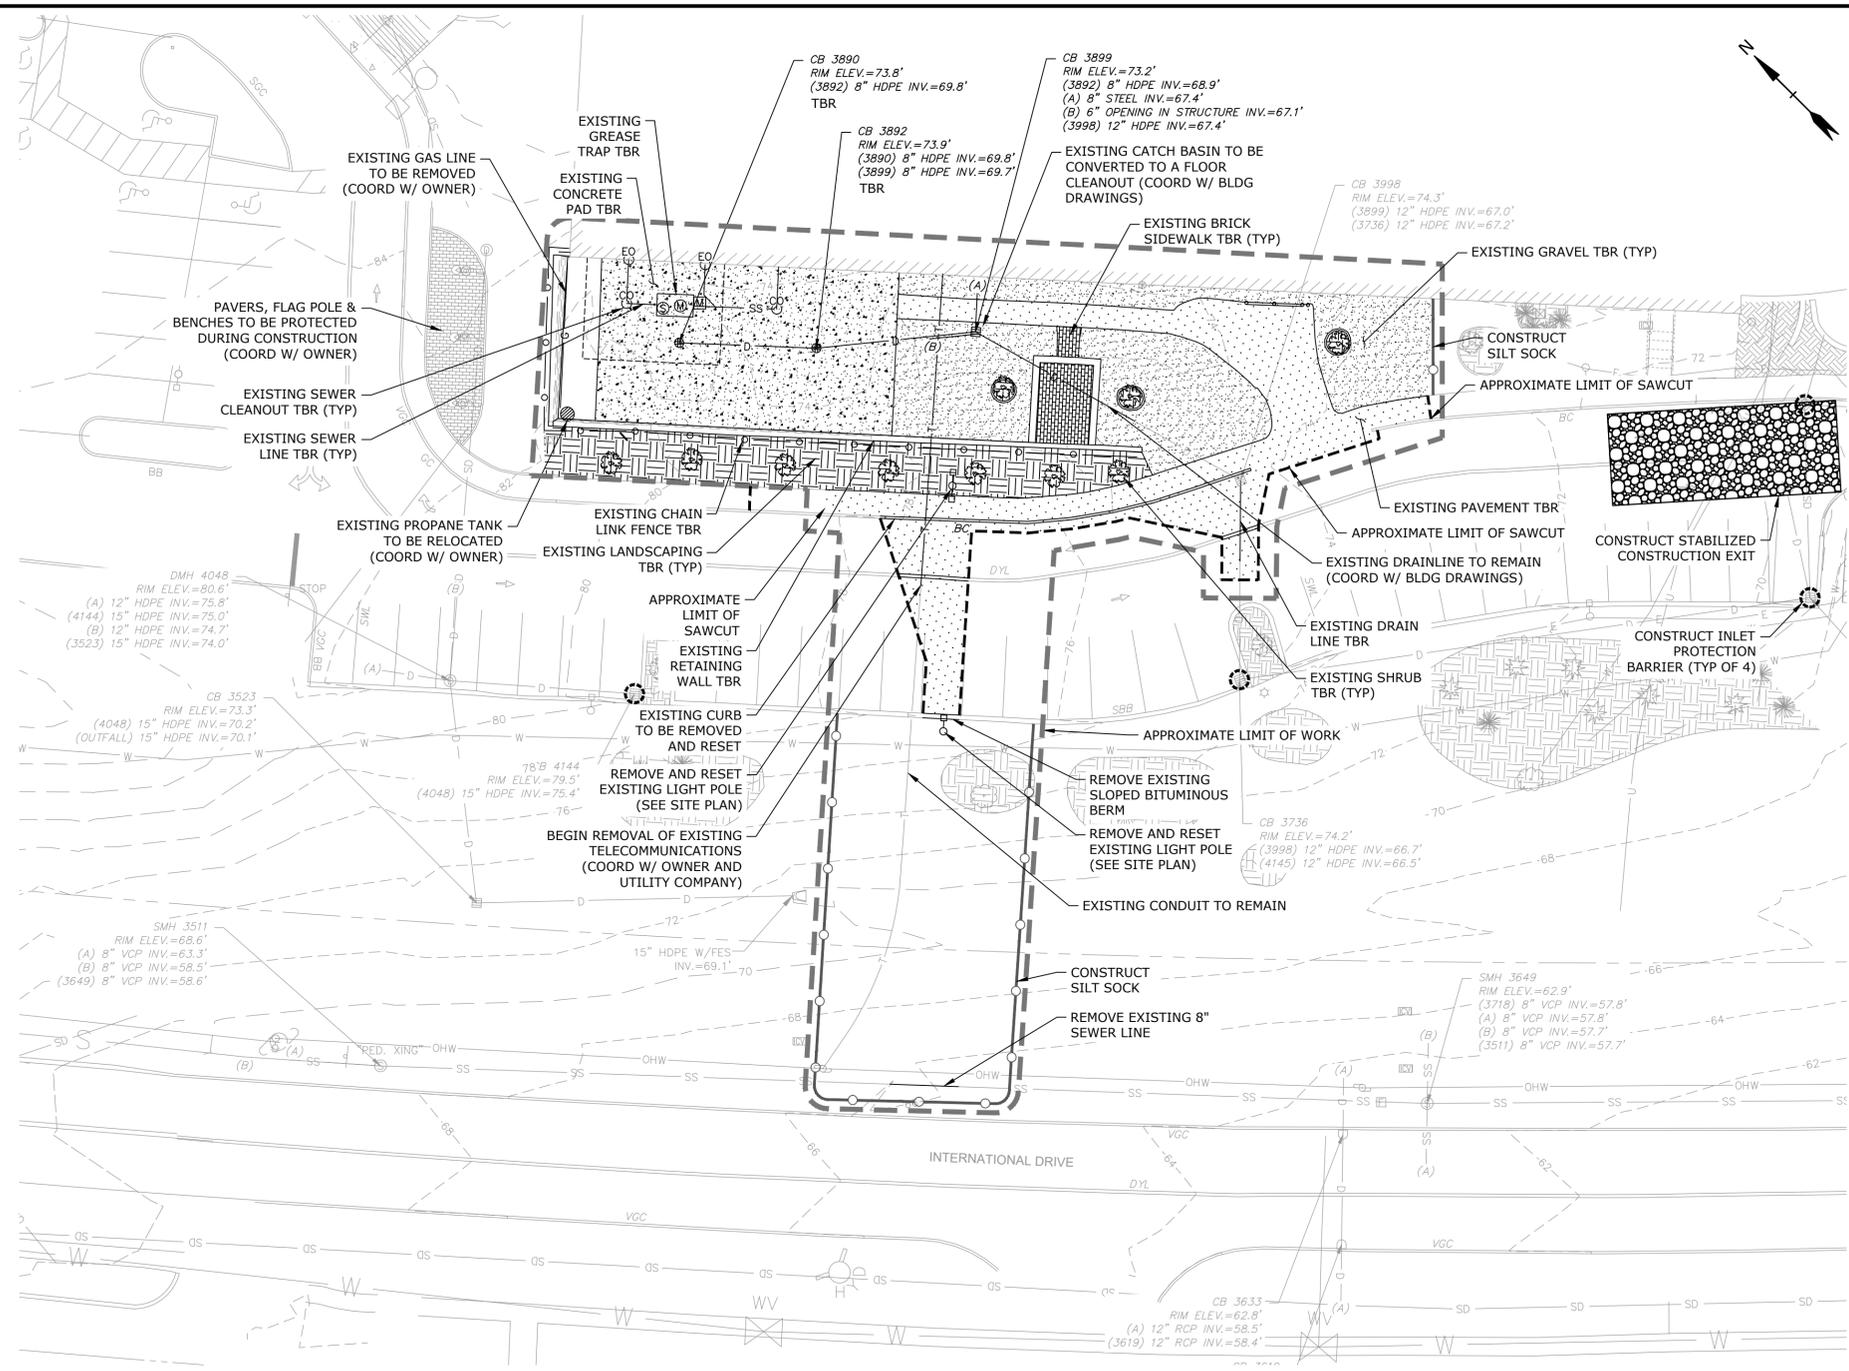

LEGEND

	APPROXIMATE LIMIT OF PROPOSED SAW CUT
	LIMIT OF WORK
	PROPOSED SILT SOCK
	APPROXIMATE LIMIT OF PAVEMENT TO BE REMOVED
	INLET PROTECTION SILT SACK
	TO BE REMOVED
	BUILDING
	TYPICAL
	COORDINATE
	DMH
	CB
	EXISTING TREES/SHRUBS
	EXISTING SHRUBS TBR

Cafe Expansion

Lonza Biologics

Portsmouth, New Hampshire

MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission
PROJECT NO:		L-0700-023
DATE:		June 27, 2022
FILE:		L-0700-023-C-DSGN.DWG
DRAWN BY:		CHK/NHW
CHECKED BY:		NAH
APPROVED BY:		PMC

EXISTING CONDITIONS AND DEMOLITION PLAN

SCALE: AS SHOWN

C-101.1

Last Saved: 7/21/2022, 10:07:46am By: CKZcznik
 Project: On: July 21, 2022, 10:07:46am
 Tighe & Bond 211 Main Street, Portsmouth, NH 03801
 Figures: AutoCAD, L-0700-023-C-DSGN.dwg

SITE DATA BLOCK

LESSOR: PEASE DEVELOPMENT AUTHORITY
 55 INTERNATIONAL DRIVE
 PORTSMOUTH NH, 03801
 APPLICANT: LONZA BIOLOGICS, INC.
 101 INTERNATIONAL DRIVE
 PORTSMOUTH NH, 03801
 LOCATION: 101 INTERNATIONAL DRIVE
 PORTSMOUTH NH, 03801
 MAP 305 LOT 6
 ZONING DISTRICT: AIRPORT BUSINESS AND COMMERCIAL ZONE (ABC)
 PROPOSED USES: OFFICE/MANUFACTURING/RESEARCH AND DEVELOPMENT

DEVELOPMENT STANDARDS

AREA, YARD, AND HEIGHT REQUIREMENTS	REQUIRED/ALLOWED	PROPOSED/PROVIDED
MINIMUM LOT AREA	5 ACRES	46.02 ACRES
MINIMUM LOT FRONTAGE	200 FEET	1038 FEET
MINIMUM FRONT YARD	70 FEET	112± FEET
MINIMUM SIDE YARD	30 FEET	30± FEET (EXISTING)
MINIMUM REAR YARD	50 FEET	50± FEET (EXISTING)
MAXIMUM BUILDING HEIGHT	FAA CRITERIA	86 FEET
MINIMUM OPEN SPACE	25% OF LOT AREA	38.1%

OFF-STREET PARKING REQUIREMENTS:

PARKING SPACES REQUIRED:

INDUSTRIAL:

2 SPACES PER 3 EMPLOYEES ON LARGEST SHIFT	LARGEST SHIFT: 740 EMPLOYEES	494 SPACES
FUTURE EMPLOYEES	1250 EMPLOYEES	834 SPACES


COMPANY VEHICLES:

1 SPACE PER VEHICLE	1 VEHICLE	1 SPACE
TOTAL MINIMUM PARKING SPACES REQUIRED =		1,329 SPACES

TOTAL PARKING SPACES PROVIDED:

TOTAL PARKING SPACES PROVIDED = 419 SPACES (GARAGE & GARAGE OVERFLOW PARKING)
 160 SPACES (SURFACE PARKING)
 200 SPACES (LYNX LOT)
 700 SPACES (IRON PARCEL GARAGE)
 1,479 SPACES


ADA ACCESSIBLE SPACES EXISTING = 15 SPACES
 ADA ACCESSIBLE SPACES REQUIRED = 35 SPACES (INCLUDING 7 VAN SPACES)
 ADA ACCESSIBLE SPACES PROPOSED = 35 SPACES (INCLUDING 7 VAN SPACES)



Cafe Expansion

Lonza Biologics

Portsmouth, New Hampshire

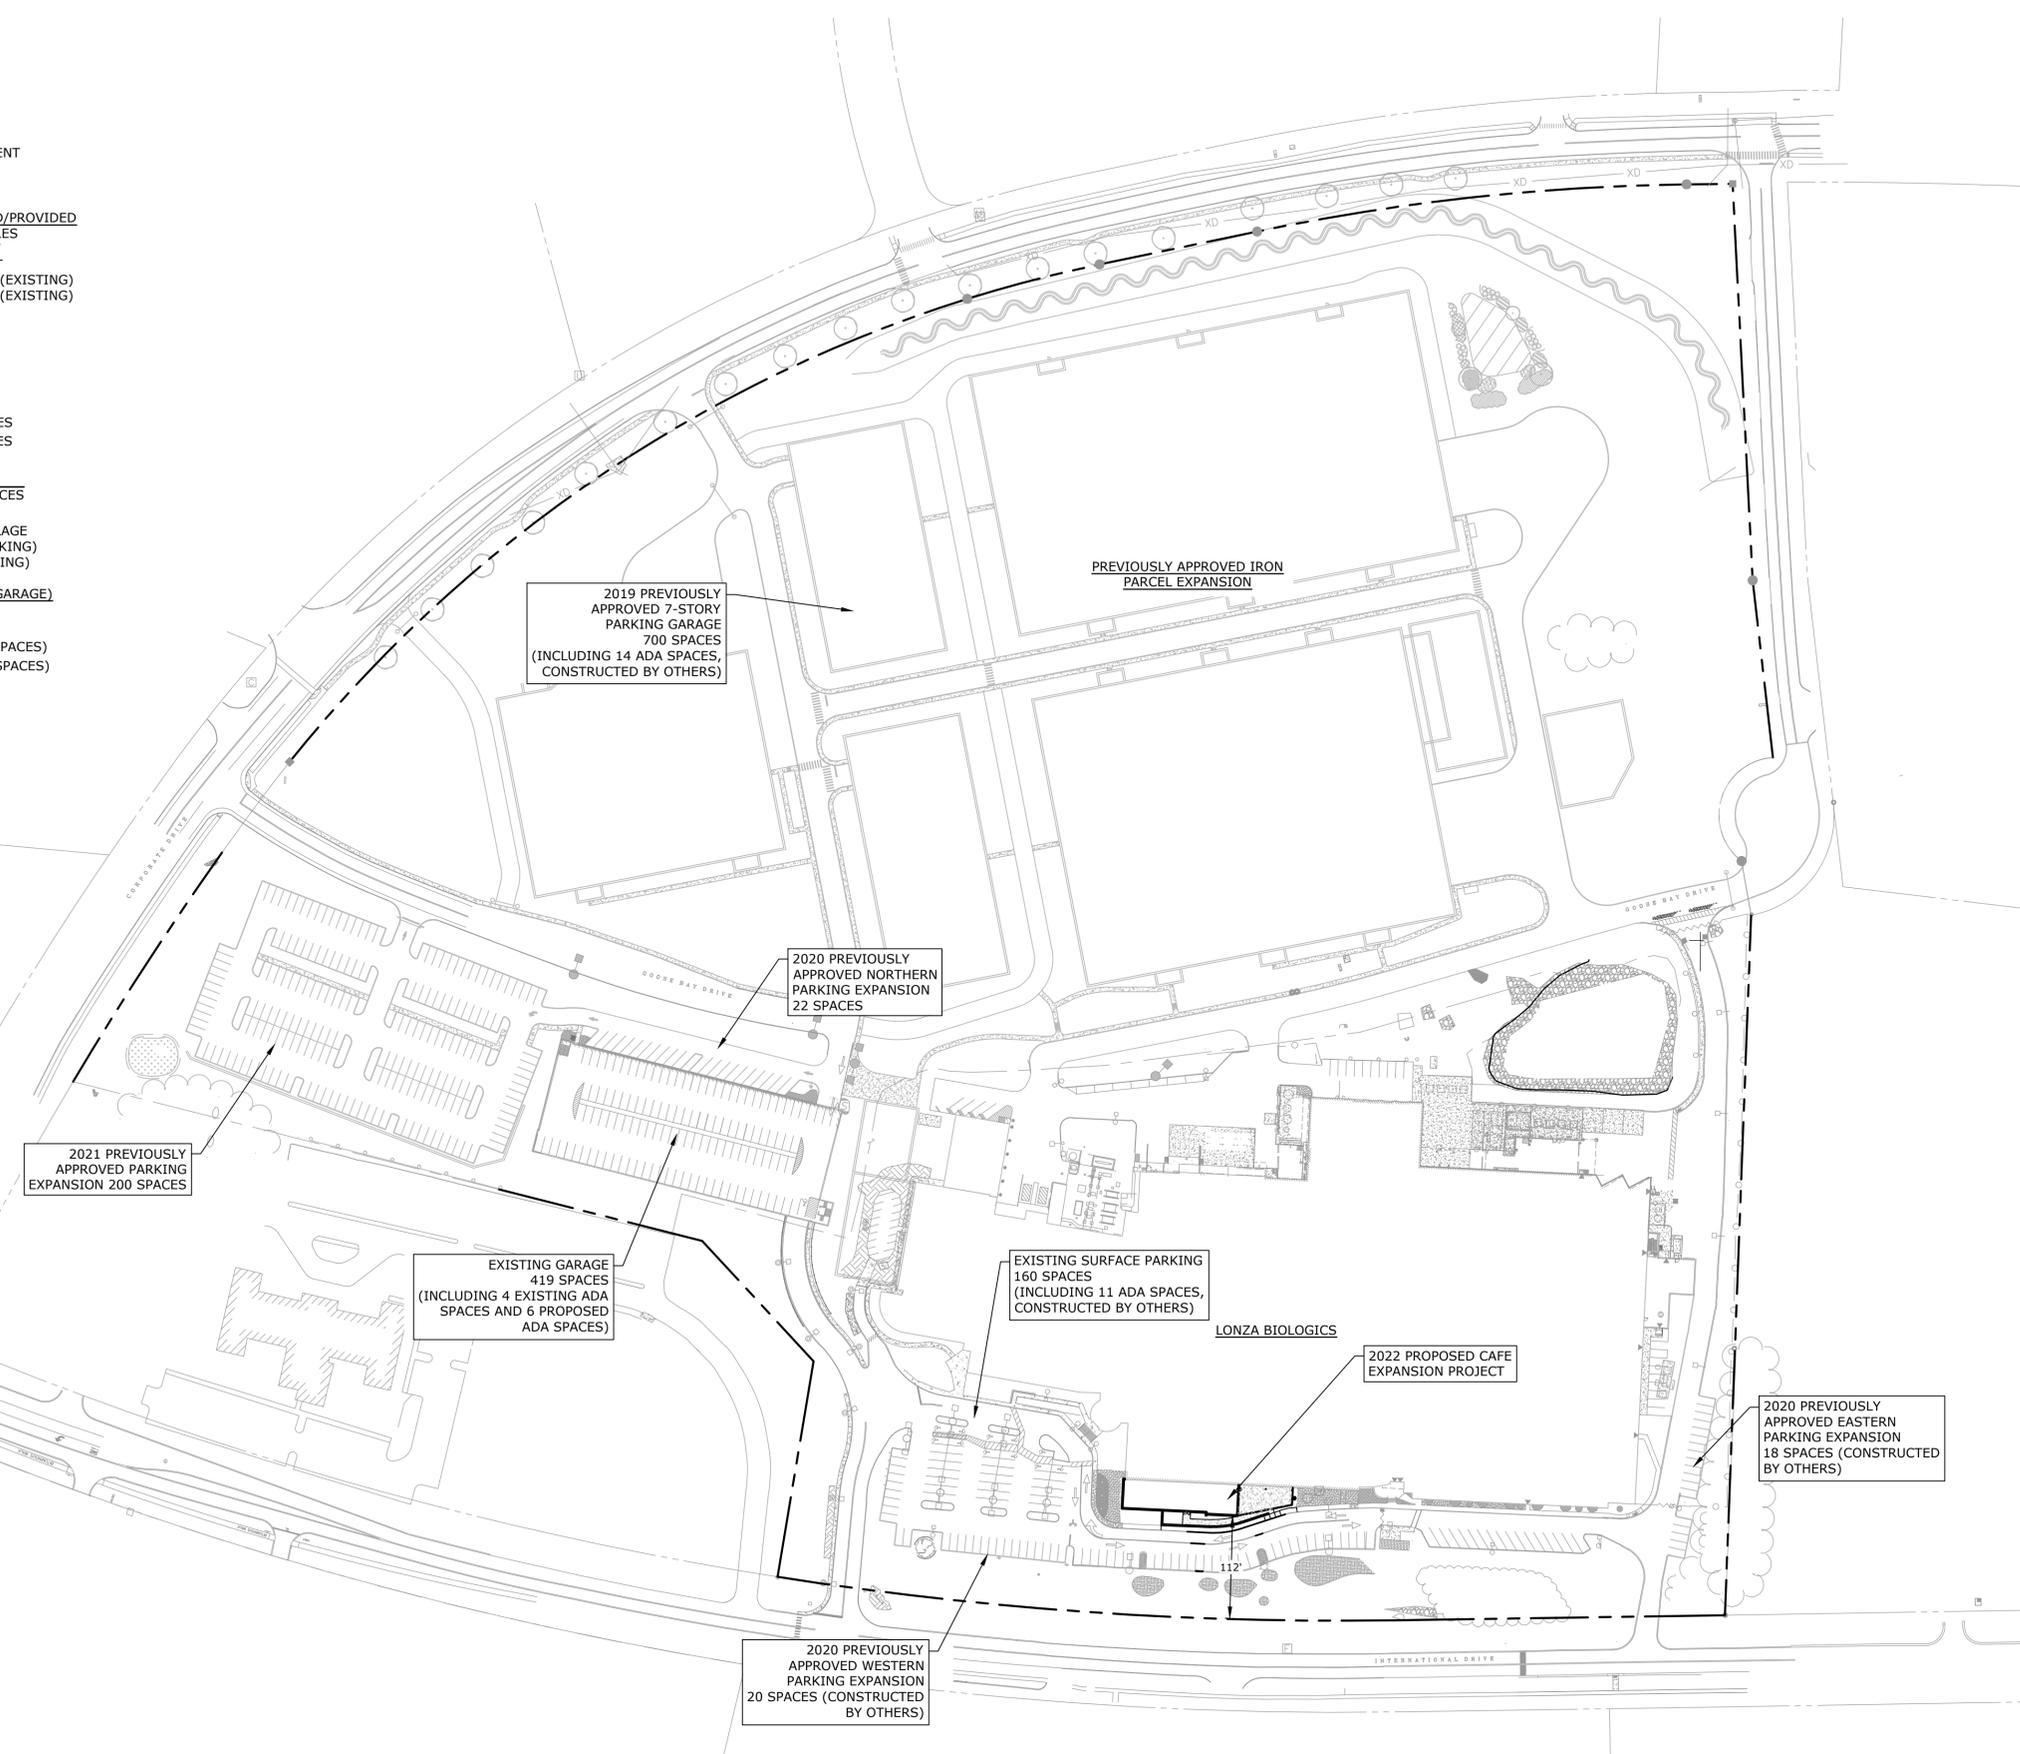

MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission

PROJECT NO: L-0700-023
 DATE: June 27, 2022
 FILE: L-0700-023-C-DSGN.DWG
 DRAWN BY: CJK/NHW
 CHECKED BY: NAH
 APPROVED BY: PMC



OVERALL SITE PLAN

SCALE: AS SHOWN

Last Saved: 7/21/2022 10:07:25am By: CKZcznik
 Tighe & Bond 21\1\2022\1\1\2022\Cafe Expansion\Drawings_Figures\AutoCAD\L-0700-023-C-DSGN.dwg

SITE NOTES:

1. THE CONTRACTOR SHALL EMPLOY A NEW HAMPSHIRE LICENSED LAND SURVEYOR TO DETERMINE ALL LINES AND GRADES.
2. CLEAN AND COAT VERTICAL FACE OF EXISTING PAVEMENT AT SAW CUT LINE WITH RS-1 EMULSION IMMEDIATELY PRIOR TO PLACING NEW BITUMINOUS CONCRETE.
3. ALL MATERIALS AND CONSTRUCTION SHALL CONFORM WITH APPLICABLE FEDERAL, STATE, AND LOCAL CODES & SPECIFICATIONS.
4. COORDINATE ALL WORK WITHIN PUBLIC RIGHT OF WAY WITH THE CITY OF PORTSMOUTH.
5. CONTRACTOR TO SUBMIT AS-BUILT PLANS IN DIGITAL FORMAT (.DWG AND .PDF FILES) ON DISK TO THE OWNER AND ENGINEER UPON COMPLETION OF THE PROJECT. AS-BUILTS SHALL BE PREPARED AND CERTIFIED BY A NEW HAMPSHIRE LICENSED LAND SURVEYOR.
6. ALL WORK SHALL CONFORM TO THE CITY OF PORTSMOUTH DEPARTMENT OF PUBLIC WORKS, STANDARD SPECIFICATIONS AND WITH THE STATE OF NEW HAMPSHIRE DEPARTMENT OF TRANSPORTATION, "STANDARD SPECIFICATIONS OF ROAD AND BRIDGE CONSTRUCTION", CURRENT EDITION.
7. CONTRACTOR TO PROVIDE BACKFILL AND COMPACTION AT CURB LINE AFTER CONCRETE FORMS FOR SIDEWALKS AND PADS HAVE BEEN STRIPPED.
8. ALL DIMENSIONS ARE TO THE FACE OF CURB UNLESS OTHERWISE NOTED.
9. ALL CONDITIONS ON THIS PLAN SHALL REMAIN IN EFFECT IN PERPETUITY PURSUANT TO THE REQUIREMENTS OF THE SITE PLAN REVIEW REGULATIONS.
10. UPON COMPLETION OF CONSTRUCTION AND PRIOR TO RELEASE OF BOND, THE APPLICANT SHALL SUBMIT A LETTER TO THE PEASE DEVELOPMENT AUTHORITY, SIGNED AND STAMPED BY A PROFESSIONAL ENGINEER, STATING CONSTRUCTION HAS BEEN COMPLETED IN CONFORMANCE WITH THE APPROVED PLANS.
11. STRIPE PARKING AREAS AS SHOWN, INCLUDING PARKING SPACES AND ARROWS SHALL BE CONSTRUCTED USING WHITE TRAFFIC PAINT. STOP BARS SHALL BE THERMOPLASTIC MATERIAL. THERMOPLASTIC MATERIAL SHALL MEET THE REQUIREMENTS OF AASHTO M249. (ALL MARKINGS EXCEPT STOP BARS TO BE CONSTRUCTED USING WHITE TRAFFIC PAINT. ALL TRAFFIC PAINT SHALL MEET THE REQUIREMENTS OF AASHTO M248 TYPE "F").
12. ALL PAVEMENT MARKINGS AND SIGNS TO CONFORM TO "MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES", "STANDARD ALPHABETS FOR HIGHWAY SIGNS AND PAVEMENT MARKINGS", AND THE AMERICANS WITH DISABILITIES ACT REQUIREMENTS, LATEST EDITIONS.
13. RETAINING WALL SHALL BE DESIGNED AND STAMPED BY A NEW HAMPSHIRE LICENSED PROFESSIONAL ENGINEER AND SHALL BE SUBMITTED TO PEASE DEVELOPMENT AUTHORITY FOR REVIEW.
14. IF A CRANE IS TO BE UTILIZED FOR CONSTRUCTION, CONTRACTOR SHALL SUBMIT FAA FORM 7460-1.

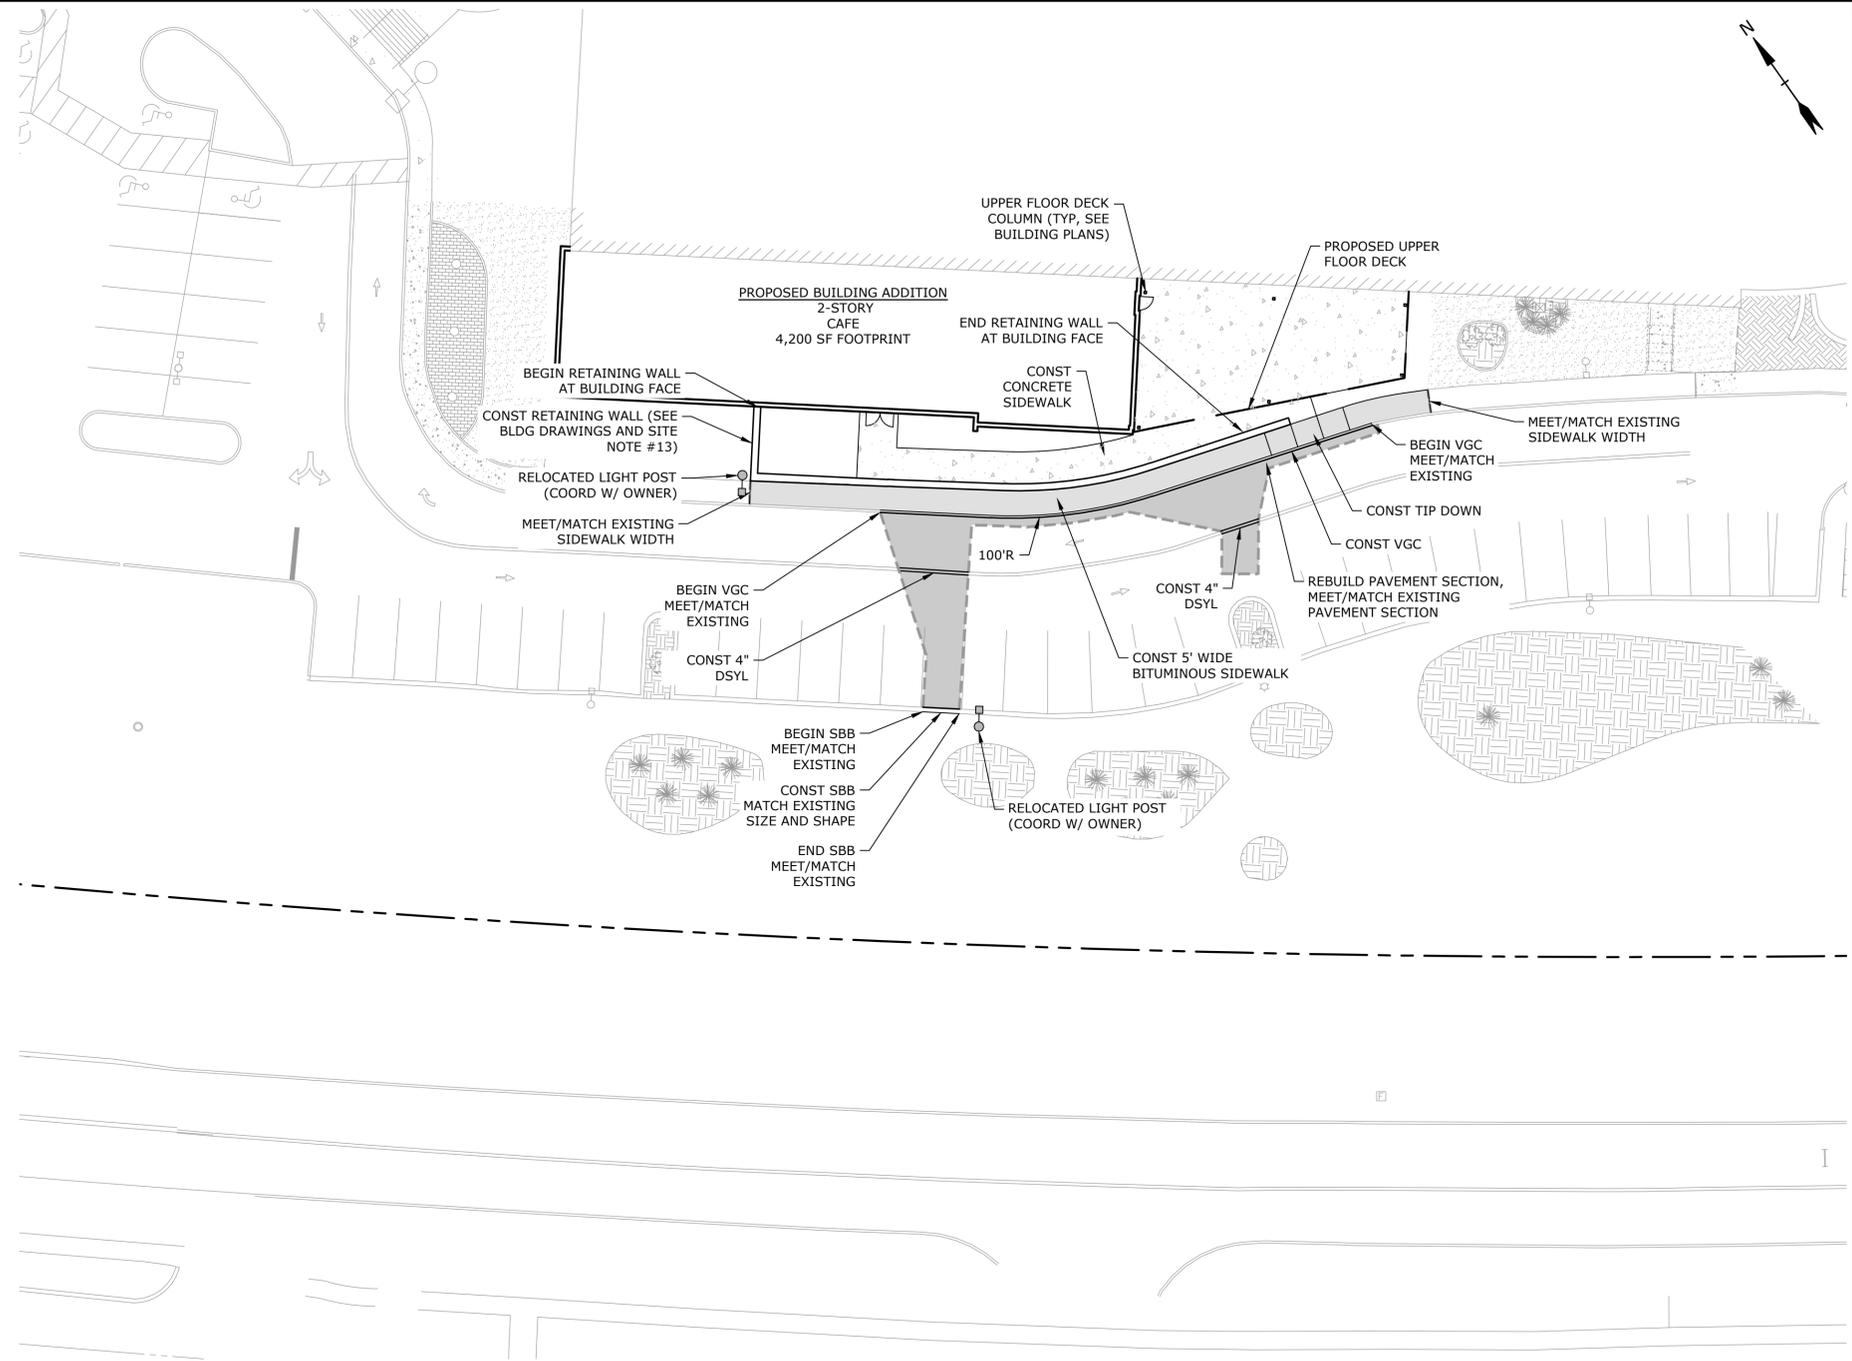

Cafe Expansion

Lonza Biologics

Portsmouth, New Hampshire

LEGEND


---	PROPERTY LINE
---	PROPOSED EDGE OF PAVEMENT
▨	PROPOSED BITUMINOUS SIDEWALK
▨	PROPOSED PAVEMENT SECTION
▨	PROPOSED CONCRETE PAD
---	RETAINING WALL
---	PROPOSED BUILDING
---	PROPOSED UPPER FLOOR AREA
---	PROPOSED SAWCUT LINE
○	RELOCATED LIGHT POLE
□	BUILDING
○	TYPICAL
○	COORDINATE
○	VERTICAL GRANITE CURB
○	SQUARE FOOT
○	WITH
○	SLOPED BITUMINOUS BERM

MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission
PROJECT NO: L-0700-023		
DATE: June 27, 2022		
FILE: L-0700-023-C-DSGN.DWG		
DRAWN BY: CJK/NHW		
CHECKED BY: NAH		
APPROVED BY: PMC		

SITE PLAN


SCALE: AS SHOWN

C-102.1



- EROSION CONTROL NOTES:**
1. INSTALL EROSION CONTROL BARRIERS AS SHOWN AS FIRST ORDER OF WORK.
 2. SEE GENERAL EROSION CONTROL NOTES ON "EROSION CONTROL NOTES & DETAILS SHEET".
 3. PROVIDE INLET PROTECTION AROUND ALL EXISTING AND PROPOSED CATCH BASIN INLETS WITHIN THE WORK LIMITS AS WELL AS CATCH BASINS/CURB INLETS THAT RECEIVE RUNOFF FROM CONSTRUCTION ACTIVITIES. MAINTAIN FOR THE DURATION OF THE PROJECT.
 4. INSTALL STABILIZED CONSTRUCTION EXIT(S).
 5. INSPECT INLET PROTECTION AND PERIMETER EROSION CONTROL MEASURES DAILY AND AFTER EACH RAIN STORM OF 0.25 INCH OR GREATER. REPAIR/MODIFY PROTECTION AS NECESSARY TO MAXIMIZE EFFICIENCY OF FILTER. REPLACE ALL FILTERS WHEN SEDIMENT IS 1/3 THE FILTER HEIGHT.
 6. ALL DISTURBED AREAS NOT TO BE PAVED OR OTHERWISE TREATED SHALL RECEIVE 6" LOAM, SEED, FERTILIZER AND MULCH.
 7. CONSTRUCT EROSION CONTROL BLANKET ON ALL SLOPES STEEPER THAN 3:1.
 8. PRIOR TO ANY WORK OR SOIL DISTURBANCE COMMENCING ON THE SUBJECT PROPERTY, INCLUDING MOVING OF EARTH, THE APPLICANT SHALL INSTALL ALL EROSION AND SILTATION MITIGATION AND CONTROL MEASURES AS REQUIRED BY STATE AND LOCAL PERMITS AND APPROVALS.
 9. CONTRACTOR SHALL BE RESPONSIBLE TO CONTROL DUST AND WIND EROSION THROUGHOUT THE CONSTRUCTION PERIOD. DUST CONTROL MEASURES SHALL INCLUDE, BUT ARE NOT LIMITED TO, SPRINKLING WATER ON UNSTABLE SOILS SUBJECT TO ARID CONDITIONS.
 10. THE CONTRACTOR SHALL REMOVE AND PROPERLY DISPOSE OF ALL TEMPORARY EROSION CONTROL DEVICES UPON COMPLETION OF CONSTRUCTION.
 11. ALL CATCH BASIN SUMPS AND PIPING SHALL BE THOROUGHLY CLEANED TO REMOVE ALL SEDIMENT AND DEBRIS AFTER THE PROJECT HAS BEEN FULLY PAVED. PROVIDE COPIES OF REPORT TO PEASE DEVELOPMENT AUTHORITY.
 12. TEMPORARY SOIL STOCKPILE SHALL BE SURROUNDED WITH PERIMETER CONTROLS AND SHALL BE STABILIZED BY TEMPORARY EROSION CONTROL SEEDING. STOCKPILE AREAS TO BE LOCATED AS FAR AS POSSIBLE FROM THE DELINEATED EDGE OF WETLANDS.
 13. SAFETY FENCING SHALL BE PROVIDED AROUND STOCKPILES OVER 10 FT.
 14. CONCRETE TRUCKS WILL BE REQUIRED TO WASH OUT (IF NECESSARY) SHOOTS ONLY WITHIN AREAS WHERE CONCRETE HAS BEEN PLACED. NO OTHER WASH OUT WILL BE ALLOWED.

- GRADING AND DRAINAGE NOTES:**
1. COMPACTION REQUIREMENTS:
 - BELOW PAVED OR CONCRETE AREAS 95%
 - TRENCH BEDDING MATERIAL AND SAND BLANKET BACKFILL 95%
 - BELOW LOAM AND SEED AREAS 90%
 - * ALL PERCENTAGES OF COMPACTION SHALL BE OF THE MAXIMUM DRY DENSITY AT THE OPTIMUM MOISTURE CONTENT AS DETERMINED AND CONTROLLED IN ACCORDANCE WITH ASTM D-1557, METHOD C FIELD DENSITY TESTS SHALL BE MADE IN ACCORDANCE WITH ASTM D-1556 OR ASTM-2922.
 2. SEE EXISTING CONDITIONS PLAN FOR BENCHMARK INFORMATION. CONTRACTOR TO VERIFY BENCHMARK LOCATIONS AND ELEVATIONS PRIOR TO CONSTRUCTION.
 3. ALL STORM DRAINAGE PIPES SHALL BE HIGH DENSITY POLYETHYLENE (HANCOR HI-Q, ADS N-12 OR EQUAL).
 4. ADJUST ALL MANHOLES, CATCH BASINS, CURB BOXES, ETC. WITHIN LIMITS OF WORK TO FINISH GRADE.
 5. CONTRACTOR SHALL PROVIDE A FINISH PAVEMENT SURFACE AND LAWN AREAS FREE OF LOW SPOTS AND PONDING AREAS.
 6. CONTRACTOR SHALL THOROUGHLY CLEAN ALL CATCH BASINS AND DRAIN LINES, WITHIN THE LIMIT OF WORK, OF SEDIMENT IMMEDIATELY UPON COMPLETION OF CONSTRUCTION. PROVIDE COPIES OF REPORT TO PEASE DEVELOPMENT AUTHORITY.
 7. ALL MATERIALS AND CONSTRUCTION SHALL CONFORM WITH APPLICABLE FEDERAL, STATE AND LOCAL CODES.
 8. ALL DISTURBED AREAS NOT TO BE PAVED OR OTHERWISE TREATED SHALL RECEIVE 6" LOAM, SEED FERTILIZER AND MULCH.
 9. ALL STORM DRAIN CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE NHDOT STANDARD SPECIFICATIONS FOR HIGHWAYS AND BRIDGES, LATEST EDITION.
 10. ALL WORK SHALL CONFORM TO THE CITY OF PORTSMOUTH DEPARTMENT OF PUBLIC WORKS, STANDARD SPECIFICATIONS AND WITH THE STATE OF NEW HAMPSHIRE DEPARTMENT OF TRANSPORTATION, "STANDARD SPECIFICATIONS OF ROAD AND BRIDGE CONSTRUCTION", CURRENT EDITION.
 11. SEE EXISTING CONDITIONS PLAN FOR BENCH MARK INFORMATION.
 12. SEE UTILITY PLAN FOR ALL SITE UTILITY INFORMATION.
 13. CONTRACTOR TO SUBMIT AS-BUILT PLANS IN DIGITAL FORMAT (.DWG AND .PDF FILES) ON DISK TO THE OWNER AND ENGINEER UPON COMPLETION OF THE PROJECT. AS-BUILTS SHALL BE PREPARED AND CERTIFIED BY A NEW HAMPSHIRE LICENSED LAND SURVEYOR.

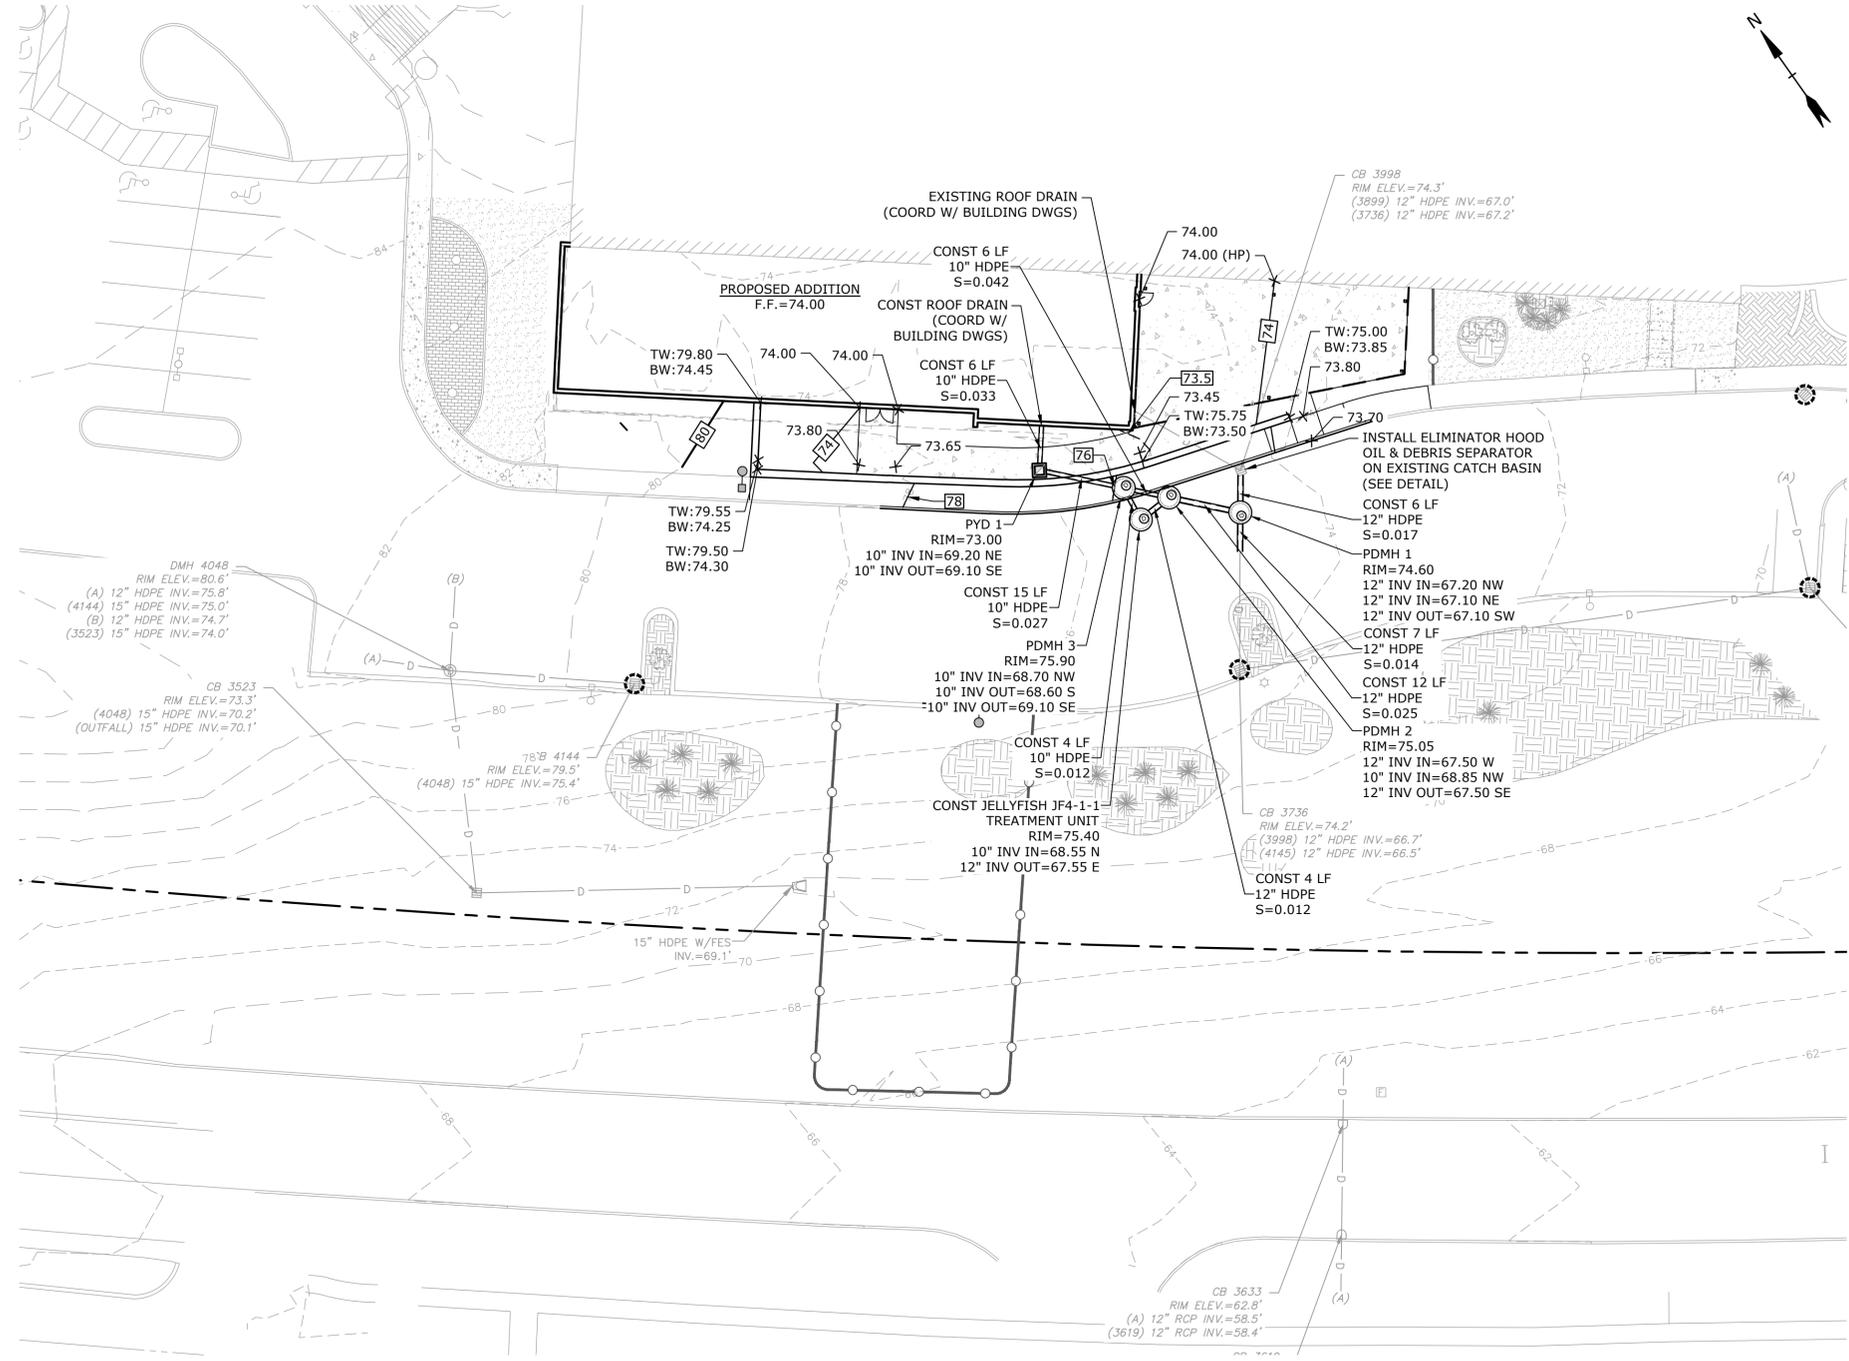

LEGEND

	PROPOSED MAJOR CONTOUR LINE
	PROPOSED MINOR CONTOUR LINE
	PROPOSED DRAIN LINE (TYP)
	PROPOSED SILT SOCK
	INLET PROTECTION SILT SACK
	PROPOSED DRAIN MANHOLE
	PROPOSED YARD DRAIN
	EXISTING DRAIN MANHOLE
	EXISTING CATCH BASIN
	TYPICAL
	PROPOSED YARD DRAIN
	INVERT
	PROPOSED DRAIN MANHOLE
	CONSTRUCT
	TOP OF WALL
	BOTTOM OF WALL
	COORDINATE
	WITH
	LINEAR FEET
	HIGH DENSITY POLYETHYLENE
	FINISH FLOOR

Cafe Expansion

Lonza Biologics

Portsmouth, New Hampshire

MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission
PROJECT NO: L-0700-023		
DATE: June 27, 2022		
FILE: L-0700-023-C-DSGN.DWG		
DRAWN BY: CJK/NHW		
CHECKED BY: NAH		
APPROVED BY: PMC		




GRADING, DRAINAGE, AND EROSION CONTROL PLAN

SCALE: AS SHOWN

Last Saved: 7/21/2022 12:13pm By: nahansen
 Project: 07/21/2022 12:07:00
 Tighe & Bond 21/11/2022
 Figure: Expansion\Drawings - Figures\AutoCAD\L-0700-023-C-DSGN.dwg

UTILITY NOTES:

1. THE LOCATIONS OF EXISTING UNDERGROUND UTILITIES ARE APPROXIMATE AND THE LOCATIONS ARE NOT GUARANTEED BY THE OWNER OR ENGINEER. IT IS THE CONTRACTOR'S RESPONSIBILITY TO LOCATE ALL UTILITIES, ANTICIPATE CONFLICTS, REPAIR EXISTING UTILITIES, AND RELOCATE EXISTING UTILITIES REQUIRED TO COMPLETE THE WORK AT NO ADDITIONAL COST TO THE OWNER.
2. COORDINATE ALL UTILITY WORK WITH APPROPRIATE UTILITY COMPANY.
 - WATER - CITY OF PORTSMOUTH
 - SEWER - CITY OF PORTSMOUTH
 - COMMUNICATIONS - CONSOLIDATED COMMUNICATIONS
3. SEE EXISTING CONDITIONS PLAN FOR BENCHMARK INFORMATION.
4. COORDINATE ALL WORK WITHIN PUBLIC RIGHT OF WAYS WITH THE CITY OF PORTSMOUTH.
5. CONTRACTOR SHALL MAINTAIN UTILITY SERVICES TO ADJUTING PROPERTIES THROUGHOUT CONSTRUCTION.
6. ALL ELECTRICAL MATERIAL WORKMANSHIP SHALL CONFORM TO THE NATIONAL ELECTRIC CODE, LATEST EDITION, AND ALL APPLICABLE STATE AND LOCAL CODES.
7. THE CONTRACTOR SHALL OBTAIN, PAY FOR, AND COMPLY WITH ALL REQUIRED PERMITS, ARRANGE FOR ALL INSPECTIONS, AND SUBMIT COPIES OF ACCEPTANCE CERTIFICATES TO THE OWNER PRIOR TO THE COMPLETION OF THIS PROJECT.
8. THE CONTRACTOR SHALL PROVIDE AND INSTALL ALL MANHOLES, BOXES, FITTINGS, CONNECTORS, COVER PLATES, AND OTHER MISCELLANEOUS ITEMS NOT NECESSARILY DETAILED ON THESE DRAWINGS TO RENDER INSTALLATION OF UTILITIES COMPLETE AND OPERATIONAL.
9. THE CONTRACTOR SHALL CONTACT "DIG-SAFE" 72 HOURS PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL HAVE THE "DIG-SAFE" NUMBER ON SITE AT ALL TIMES.
10. SAW CUT AND REMOVE PAVEMENT AND CONSTRUCT PAVEMENT TRENCH PATCHES FOR ALL PROPOSED UTILITIES LOCATED IN EXISTING PAVEMENT AREAS TO REMAIN.
11. HYDRANTS, GATE VALVES, FITTINGS, ETC. SHALL MEET THE REQUIREMENTS OF PEASE DEVELOPMENT AUTHORITY AND THE CITY OF PORTSMOUTH.
12. SEE GRADING, DRAINAGE & EROSION CONTROL PLAN FOR PROPOSED GRADING AND EROSION CONTROL MEASURES.
13. THE EXACT LOCATION OF NEW UTILITY SERVICES AND CONNECTIONS SHALL BE COORDINATED WITH THE BUILDING DRAWINGS AND THE APPLICABLE UTILITY COMPANIES.
14. ADJUST ALL MANHOLES, CATCH BASINS, CURB BOXES, ETC. WITHIN LIMITS OF WORK TO FINISH GRADE.
15. ALL UNDERGROUND CONDUITS SHALL HAVE NYLON PULL ROPES TO FACILITATE PULLING CABLES.
16. CONTRACTOR TO SUBMIT AS-BUILT PLANS ON REPRODUCIBLE MYLARS AND IN DIGITAL FORMAT (.DWG FILES) TO THE OWNER AND ENGINEER UPON COMPLETION OF THE PROJECT. AS-BUILTS SHALL BE PREPARED AND CERTIFIED BY A NEW HAMPSHIRE LICENSED LAND SURVEYOR OR PROFESSIONAL ENGINEER.
17. SOLID MATERIAL COUPLINGS SHALL BE USED FOR CONNECTIONS TO THE EXISTING SEWER. COUPLINGS SHALL BE APPROVED BY THE CITY OF PORTSMOUTH SEWER DEPARTMENT PRIOR TO INSTALLATION.
18. CONTRACTOR SHALL APPROPRIATELY DISPOSE OF ASBESTOS CEMENT PIPES SHOULD ANY BE FOUND DURING CONSTRUCTION.

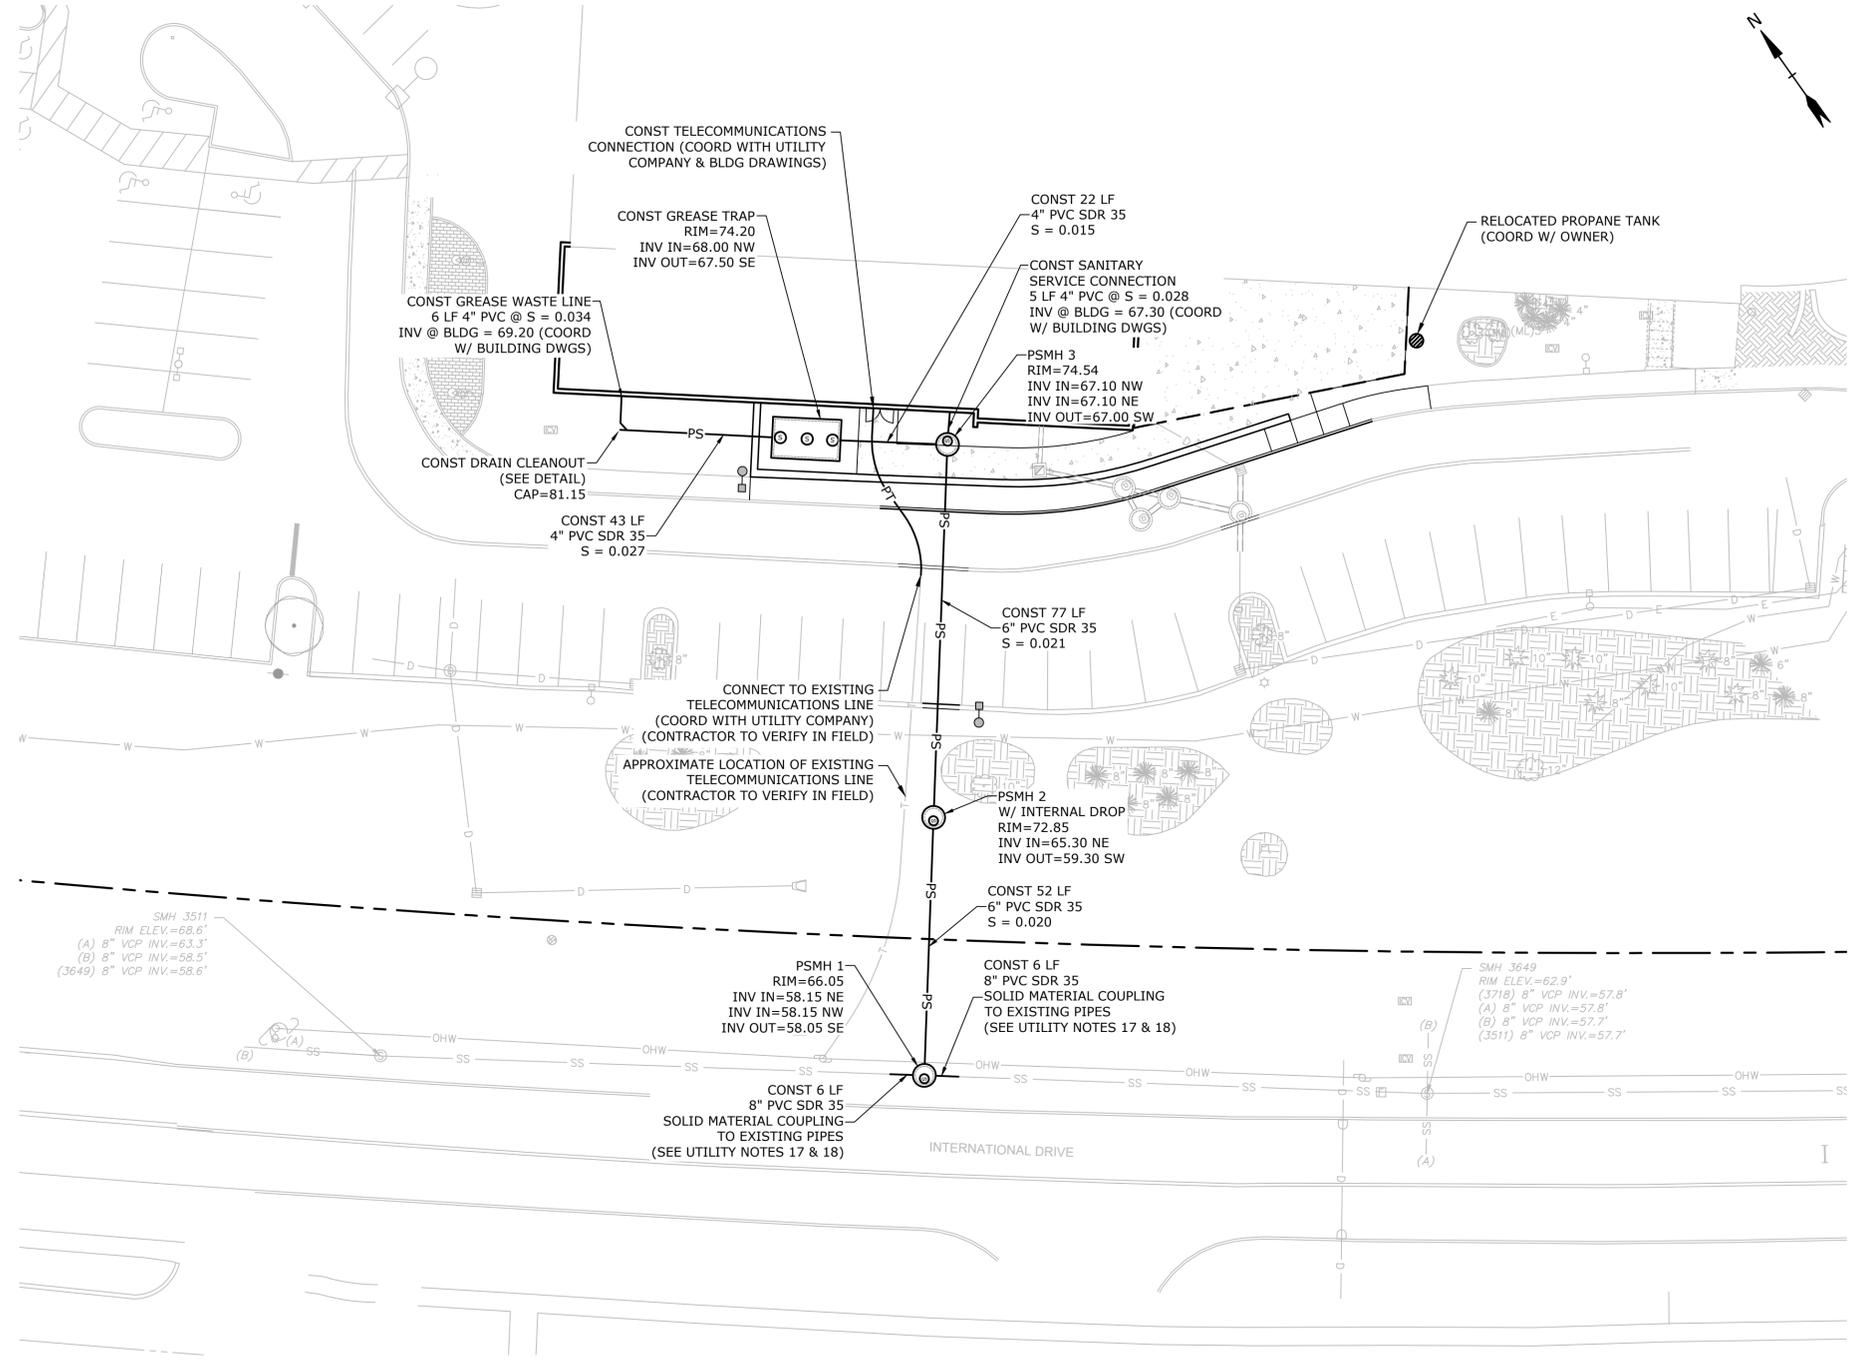

Cafe Expansion

Lonza Biologics

Portsmouth,
New Hampshire

LEGEND

— W —	EXISTING WATER
— D —	EXISTING STORM DRAIN
— G —	EXISTING GAS
— OHW —	EXISTING OVERHEAD WIRE
— SS —	EXISTING SEWER
— PT —	PROPOSED TELECOMMUNICATIONS LINE
— PS —	PROPOSED SEWER LINE
⊙	PROPOSED SEWER MANHOLE
⊙ ⊙ ⊙	PROPOSED GREASE TRAP
⊙	RELOCATED PROPANE TANK
⊙	RELOCATED LIGHT POLE BASE AND FIXTURES
⊙	EXISTING CATCH BASIN
⊙	EXISTING SEWER MANHOLE
⊙	EXISTING ELECTRIC MANHOLE
⊙	EXISTING HYDRANT
TYP	TYPICAL
INV	INVERT
PSMH	PROPOSED SEWER MANHOLE
CONST	CONSTRUCT
LF	LINEAR FEET
COORD	COORDINATE
BLDG	BUILDING
W/	WITH


Last Saved: 7/21/2022 12:20pm By: nahansen
 Project: On: July 21, 2022 12:20pm
 Tighe & Bond 211 CUT000 Cafe Expansion Drawings Figures\AutoCAD\L-0700-023-C-DSGN.dwg

A	7/21/2022	PB Submission
MARK	DATE	DESCRIPTION
PROJECT NO: L-0700-023		
DATE: June 27, 2022		
FILE: L-0700-023-C-DSGN.DWG		
DRAWN BY: CJK/NHW		
CHECKED BY: NAH		
APPROVED BY: PMC		


UTILITY PLAN
SCALE: AS SHOWN

LANDSCAPE NOTES:

1. THE CONTRACTOR SHALL FURNISH AND PLANT ALL PLANTS IN QUANTITIES AS SHOWN ON THIS PLAN. NO SUBSTITUTIONS WILL BE PERMITTED UNLESS APPROVED BY OWNER. ALL PLANTS SHALL BE NURSERY GROWN.
2. ALL PLANTS SHALL BE NURSERY GROWN AND PLANTS AND WORKMANSHIP SHALL CONFORM TO THE AMERICAN ASSOCIATION OF NURSERYMEN STANDARDS, INCLUDING BUT NOT LIMITED TO SIZE, HEALTH, SHAPE, ETC., AND SHALL BE SUBJECT TO THE APPROVAL OF THE LANDSCAPE ARCHITECT PRIOR TO ARRIVAL ON-SITE AND AFTER PLANTING.
3. PLANT STOCK SHALL BE GROWN WITHIN THE HARDINESS ZONES 4 THRU 7 ESTABLISHED BY THE PLANT HARDINESS ZONE MAP, MISCELLANEOUS PUBLICATIONS NO. 814, AGRICULTURAL RESEARCH SERVICE, UNITED STATES DEPARTMENT AGRICULTURE, LATEST REVISION.
4. PLANT MATERIAL SHALL BEAR THE SAME RELATIONSHIP TO FINISHED GRADE AS TO THE ORIGINAL PLANTING GRADE PRIOR TO DIGGING.
5. THE NUMBER OF EACH INDIVIDUAL PLANT TYPE AND SIZE PROVIDED IN THE PLANT LIST OR ON THE PLAN IS FOR THE CONTRACTOR'S CONVENIENCE ONLY. IF A DISCREPANCY EXISTS BETWEEN THE NUMBER OF PLANTS ON THE LABEL AND THE NUMBER OF SYMBOLS SHOWN ON THE DRAWINGS, THE GREATER NUMBER SHALL APPLY.
6. NO SUBSTITUTION OF PLANT MATERIALS WILL BE ALLOWED WITHOUT THE PRIOR WRITTEN APPROVAL OF THE OWNER'S REPRESENTATIVE.
7. THE CONTRACTOR SHALL LOCATE, VERIFY AND MARK ALL EXISTING AND NEWLY INSTALLED UNDERGROUND UTILITIES PRIOR TO ANY LAWN WORK OR PLANTING. ANY CONFLICTS WHICH MIGHT OCCUR BETWEEN PLANTING AND UTILITIES SHALL IMMEDIATELY BE REPORTED TO THE OWNER SO THAT ALTERNATE PLANTING LOCATIONS CAN BE DETERMINED.
8. ALL DISTURBED AREAS NOT TO BE PAVED OR OTHERWISE TREATED, SHALL RECEIVE 6" OF LOAM AND SEED. NO FILL SHALL BE PLACED IN ANY WETLAND AREA.
9. THREE INCHES (3") OF BARK MULCH IS TO BE USED AROUND THE TREE AND SHRUB PLANTING AS SPECIFIED IN THE DETAILS. WHERE BARK MULCH IS TO BE USED IN A CURBED ISLAND THE BARK MULCH SHALL MEET THE TOP INSIDE EDGE OF THE CURB. ALL OTHER AREAS SHALL RECEIVE 6" INCHES OF LOAM AND SEED.
10. SEE PLANTING DETAILS AND SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
11. TREE STAKES SHALL REMAIN IN PLACE FOR NO LESS THAN 6 MONTHS AND NO MORE THAN 1 YEAR.
12. PLANTING SHALL BE COMPLETED FROM APRIL 15TH THROUGH OCTOBER 1ST. NO PLANTING DURING JULY AND AUGUST UNLESS SPECIAL PROVISIONS ARE MADE FOR DROUGHT.
13. PARKING AREA PLANTED ISLANDS TO HAVE MINIMUM OF 1'-0" TOPSOIL PLACED TO WITHIN 3 INCHES OF THE TOP OF CURB ELEVATION. REMOVE ALL CONSTRUCTION DEBRIS BEFORE PLACING TOPSOIL.
14. TREES SHALL BE PRUNED IN ACCORDANCE WITH THE LATEST EDITION OF ANSI A300 'TREES, SHRUBS AND OTHER WOOD PLANT MAINTENANCE STANDARD PRACTICES.
15. ALL PLANTS SHALL BE WATERED THOROUGHLY TWICE DURING THE FIRST 24 HOUR PERIOD AFTER PLANTING. ALL PLANTS SHALL BE WATERED WEEKLY, OR MORE OFTEN, IF NECESSARY DURING THE FIRST GROWING SEASON. LANDSCAPE CONTRACTOR SHALL COORDINATE WATERING SCHEDULE WITH OWNER DURING THE ONE (1) YEAR GUARANTEE PERIOD.
16. EXISTING TREES AND SHRUBS SHOWN ON THE PLAN ARE TO REMAIN UNDISTURBED. ALL EXISTING TREES AND SHRUBS SHOWN TO REMAIN ARE TO BE PROTECTED WITH A 4-FOOT SNOW FENCE PLACED AT THE DRIP LINE OF THE BRANCHES OR AT 8 FEET MINIMUM FROM THE TREE TRUNK. ANY EXISTING TREE OR SHRUB SHOWN TO REMAIN, WHICH IS REMOVED DURING CONSTRUCTION, SHALL BE REPLACED BY A TREE OF COMPARABLE SIZE AND SPECIES TREE OR SHRUB.
17. THE CONTRACTOR SHALL GUARANTEE ALL PLANTINGS TO BE IN GOOD HEALTHY, FLOURISHING AND ACCEPTABLE CONDITION FOR A PERIOD OF ONE (1) YEAR BEGINNING AT THE DATE OF ACCEPTANCE OF SUBSTANTIAL COMPLETION. ALL GRASSES, TREES AND SHRUBS THAT, IN THE OPINION OF THE LANDSCAPE ARCHITECT, SHOW LESS THAN 80% HEALTHY GROWTH AT THE END OF ONE YEAR PERIOD SHALL BE REPLACED BY THE CONTRACTOR.
18. UPON EXPIRATION OF THE CONTRACTOR'S ONE YEAR GUARANTEE PERIOD, THE OWNER SHALL BE RESPONSIBLE FOR LANDSCAPE MAINTENANCE INCLUDING WATERING DURING PERIODS OF DROUGHT.
19. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL PLANTING AND LAWNS AGAINST DAMAGE FROM ONGOING CONSTRUCTION. THIS PROTECTION SHALL BEGIN AT THE TIME THE PLANT IS INSTALLED AND CONTINUE UNTIL THE FORMAL ACCEPTANCE OF ALL THE PLANTINGS.
20. PRE-PURCHASE PLANT MATERIAL AND ARRANGE FOR DELIVERY TO MEET PROJECT SCHEDULE AS REQUIRED IT MAY BE NECESSARY TO PRE-DIG CERTAIN SPECIES WELL IN ADVANCE OF ACTUAL PLANTING DATES.

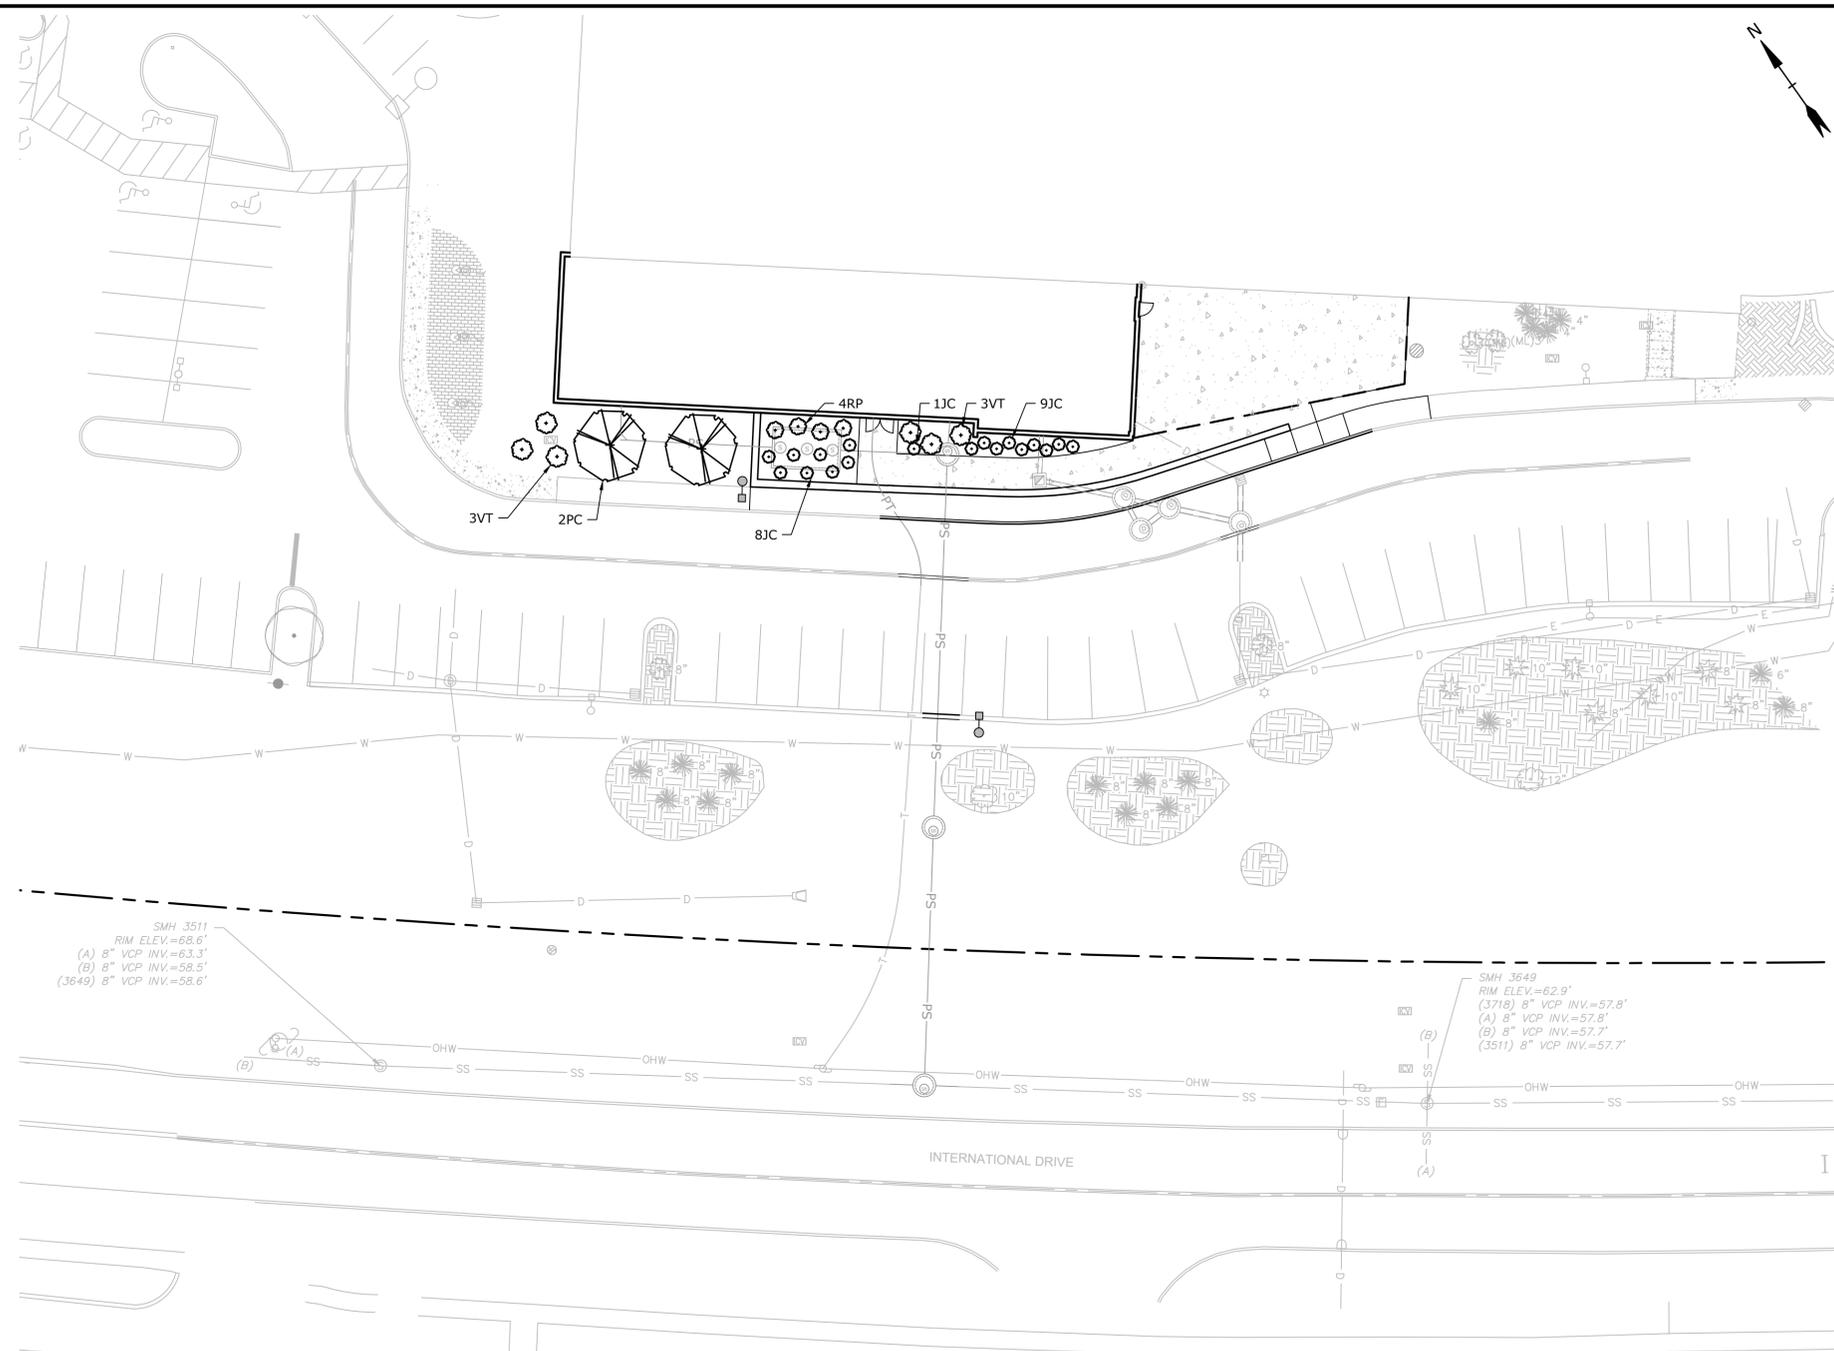


PLANT SCHEDULE				
CODE	COMMON NAME	SIZE	REMARKS	
TREES				
PC	PRUNUS CERASIFERA "THUNDERCLOUD"	THUNDERCLOUD PLUMB	2-2 1/2" CALIPER	B & B
SHRUBS				
JC	JUNIPERUS COMMUNIS "BLUEBERRY DELIGHT"	BLUEBERRY DELIGHT JUNIPER	3 GALLON	CONTAINER
RP	RHODODENDRON "PJM PINK DELIGHT"	RHODODENDRON	5 GALLON	CONTAINER
VT	VIBURNUM TRILOBUM "COMPACTA"	COMPACT AMERICAN CRANBERRY	5 GALLON	CONTAINER

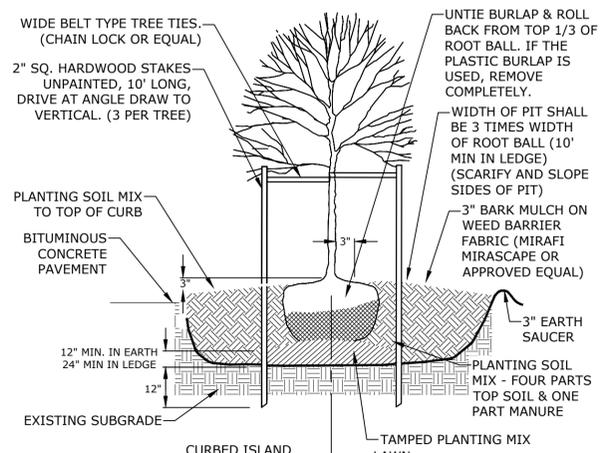

- NOTES:**
1. PLANT AT SAME DEPTH AS PREVIOUSLY PLANTED OR WITHIN 2" ABOVE.
 2. NEW TREE ROOT FLARES SHALL BE PLANTED AT FINISH GRADE.


DECIDUOUS TREE PLANTING
NO SCALE

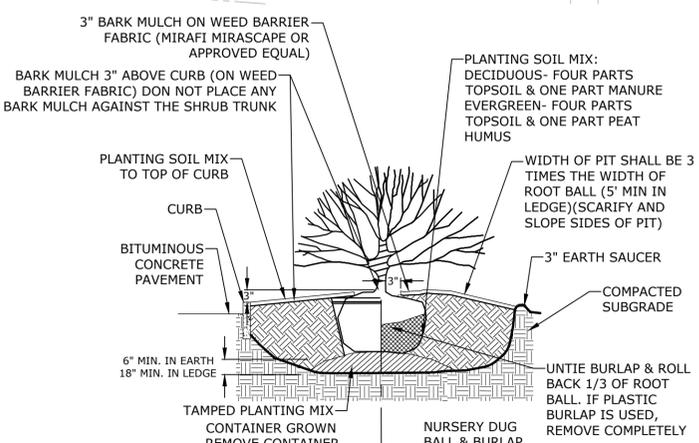


- NOTE:**
1. PLANT AT SAME DEPTH AS PREVIOUSLY PLANTED, OR WITHIN 2" ABOVE.

SHRUB PLANTING
NO SCALE

LEGEND

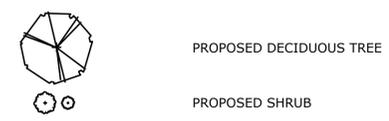

Last Saved: 7/21/2022 10:02:27 AM By: CKZcznik
 Project: 07-21-2022 10:02:27 AM By: CKZcznik
 Title: Cafe Expansion Drawings - Figures AutoCAD L-0700-023-C-DSGN.dwg
 Tighe & Bond 21-11-1000 Lonza Biologics Expansion



Cafe Expansion

Lonza Biologics

Portsmouth, New Hampshire

MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission

PROJECT NO: L-0700-023
 DATE: June 27, 2022
 FILE: L-0700-023-C-DSGN.DWG
 DRAWN BY: CKJ/NHW
 CHECKED BY: NAH
 APPROVED BY: PMC

LANDSCAPE PLAN

SCALE: AS SHOWN

GENERAL PROJECT INFORMATION

PROJECT LESSOR: PEASE DEVELOPMENT AUTHORITY
55 INTERNATIONAL DRIVE
PORTSMOUTH, NH 03801
PROJECT APPLICANT: LONZA BIOLOGICS
101 INTERNATIONAL DRIVE
PORTSMOUTH, NH 03801
PROJECT ADDRESS: 101 INTERNATIONAL DRIVE
PORTSMOUTH, NH 03801
PROJECT LATITUDE: 43°-04'-57"N
PROJECT LONGITUDE: 70°-48'-16"W

PROJECT DESCRIPTION

THE PROJECT CONSISTS OF THE EXPANSION OF LONZA BIOLOGICS CAFE FACILITIES, WHICH INCLUDES THE CONSTRUCTION OF A 4,200 SF, 2-STORY ADDITION AND ASSOCIATED SITE IMPROVEMENTS.

DISTURBED AREA

THE TOTAL AREA TO BE DISTURBED IS APPROXIMATELY 0.40 ACRES.

SOIL CHARACTERISTICS

BASED ON THE WEB SOIL SURVEY REPORT GENERATED ON MAY 10TH 2022, THE SITE SOILS CONSIST OF URBAN LAND AND THEREFORE DO NOT HAVE AN ASSOCIATED DRAINAGE CLASS.

NAME OF RECEIVING WATERS

THE STORM WATER RUNOFF WILL ULTIMATELY DISCHARGE INTO HODGSON BROOK

CONSTRUCTION SEQUENCE OF MAJOR ACTIVITIES:

- 1. CUT AND CLEAR TREES.
- 2. CONSTRUCT TEMPORARY AND PERMANENT SEDIMENT, EROSION AND DETENTION CONTROL FACILITIES. EROSION, SEDIMENT AND DETENTION MEASURES SHALL BE INSTALLED PRIOR TO ANY EARTH MOVING OPERATIONS THAT WILL INFLUENCE STORMWATER RUNOFF SUCH AS:
 - NEW CONSTRUCTION
 - CONTROL OF DUST
 - CONSTRUCTION DURING LATE WINTER AND EARLY SPRING
- 3. ALL PERMANENT DITCHES, SWALES, DETENTION, RETENTION AND SEDIMENTATION BASINS TO BE STABILIZED USING THE VEGETATIVE AND NON-STRUCTURAL BMPS PRIOR TO DIRECTING RUNOFF TO THEM.
- 4. CLEAR AND DISPOSE OF DEBRIS.
- 5. CONSTRUCT TEMPORARY CULVERTS AND DIVERSION CHANNELS AS REQUIRED.
- 6. GRADE AND GRAVEL ROADWAYS AND PARKING AREAS - ALL ROADS AND PARKING AREA SHALL BE STABILIZED WITHIN 72 HOURS OF ACHIEVING FINISHED GRADE.
- 7. BEGIN PERMANENT AND TEMPORARY SEEDING AND MULCHING. ALL CUT AND FILL SLOPES SHALL BE SEEDED AND MULCHED WITHIN 72 HOURS OF ACHIEVING FINISHED GRADE.
- 8. DAILY, OR AS REQUIRED, CONSTRUCT TEMPORARY BERMS, DRAINS, DITCHES, PERIMETER EROSION CONTROL MEASURES, SEDIMENT TRAPS, ETC., MULCH AND SEED AS REQUIRED.
- 9. SEDIMENT TRAPS AND/OR BASINS SHALL BE USED AS NECESSARY TO CONTAIN RUNOFF UNTIL SOILS ARE STABILIZED.
- 10. FINISH PAVING ALL ROADWAYS AND PARKING LOTS.
- 11. INSPECT AND MAINTAIN ALL EROSION AND SEDIMENT CONTROL MEASURES.
- 12. COMPLETE PERMANENT SEEDING AND LANDSCAPING.
- 13. REMOVE TRAPPED SEDIMENTS FROM COLLECTOR DEVICES AS APPROPRIATE AND THEN REMOVE TEMPORARY EROSION CONTROL MEASURES.

SPECIAL CONSTRUCTION NOTES:

- 1. THE CONSTRUCTION SEQUENCE MUST LIMIT THE DURATION AND AREA OF DISTURBANCE.
- 2. THE PROJECT IS TO BE MANAGED IN A MANNER THAT MEETS THE REQUIREMENTS AND INTENT OF RSA 430:53 AND CHAPTER AGR 3800 RELATIVE TO INVASIVE SPECIES.

EROSION CONTROL NOTES:

- 1. ALL EROSION CONTROL MEASURES AND PRACTICES SHALL CONFORM TO THE "NEW HAMPSHIRE STORMWATER MANUAL VOLUME 3: EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION" PREPARED BY THE NHDES.
- 2. PRIOR TO ANY WORK OR SOIL DISTURBANCE, CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR EROSION CONTROL MEASURES AS REQUIRED IN THE PROJECT MANUAL.
- 3. CONTRACTOR SHALL INSTALL TEMPORARY EROSION CONTROL BARRIERS, INCLUDING HAY BALES, SILT FENCES, MULCH BERMS, SILT SACKS AND SILT SOCKS AS SHOWN IN THESE DRAWINGS AS THE FIRST ORDER OF WORK.
- 4. SILT SACK INLET PROTECTION SHALL BE INSTALLED IN ALL EXISTING AND PROPOSED CATCH BASIN INLETS WITHIN THE WORK LIMITS AND BE MAINTAINED FOR THE DURATION OF THE PROJECT.
- 5. PERIMETER CONTROLS INCLUDING SILT FENCES, MULCH BERM, SILT SOCK, AND/OR HAY BALE BARRIERS SHALL BE MAINTAINED FOR THE DURATION OF THE PROJECT UNTIL NON-PAVED AREAS HAVE BEEN STABILIZED.
- 6. THE CONTRACTOR SHALL REMOVE AND PROPERLY DISPOSE OF ALL TEMPORARY EROSION CONTROL DEVICES UPON COMPLETION OF CONSTRUCTION.
- 7. ALL DISTURBED AREAS NOT OTHERWISE BEING TREATED SHALL RECEIVE 6" LOAM, SEED AND FERTILIZER.
- 8. INSPECT ALL INLET PROTECTION AND PERIMETER CONTROLS WEEKLY AND AFTER EACH RAIN STORM OF 0.25 INCH OR GREATER. REPAIR/MODIFY PROTECTION AS NECESSARY TO MAXIMIZE EFFICIENCY OF FILTER. REPLACE ALL FILTERS WHEN SEDIMENT IS 1/3 THE FILTER HEIGHT.
- 9. CONSTRUCT EROSION CONTROL BLANKETS ON ALL SLOPES STEEPER THAN 3:1.

STABILIZATION:

- 1. AN AREA SHALL BE CONSIDERED STABLE WHEN ONE OF THE FOLLOWING HAS OCCURRED:
 - A. BASE COURSE GRAVELS HAVE BEEN INSTALLED IN AREAS TO BE PAVED;
 - B. A MINIMUM OF 85% VEGETATED GROWTH HAS BEEN ESTABLISHED;
 - C. A MINIMUM OF 3" OF NON-EROSIVE MATERIAL SUCH AS STONE OR RIPRAP HAS BEEN INSTALLED;
 - D. EROSION CONTROL BLANKETS HAVE BEEN PROPERLY INSTALLED.;
 - E. IN AREAS TO BE PAVED, "STABLE" MEANS THAT BASE COURSE GRAVELS MEETING THE REQUIREMENTS OF NHDOT STANDARD FOR ROAD AND BRIDGE CONSTRUCTION, 2016, ITEM 304.2 HAVE BEEN INSTALLED.
- 2. WINTER STABILIZATION PRACTICES:
 - A. ALL PROPOSED VEGETATED AREAS THAT DO NOT EXHIBIT A MINIMUM OF 85 PERCENT VEGETATIVE GROWTH BY OCTOBER 15, OR WHICH ARE DISTURBED AFTER OCTOBER 15, SHALL BE STABILIZED BY SEEDING AND INSTALLING EROSION CONTROL BLANKETS ON SLOPES GREATER THAN 3:1, AND SEEDING AND PLACING 3 TO 4 TONS OF MULCH PER ACRE, SECURED WITH ANCHORED NETTING, ELSEWHERE. THE INSTALLATION OF EROSION CONTROL BLANKETS OR MULCH AND NETTING SHALL NOT OCCUR OVER ACCUMULATED SNOW OR ON FROZEN GROUND AND SHALL BE COMPLETED IN ADVANCE OF THAW OR SPRING MELT EVENTS;
 - B. ALL DITCHES OR SWALES WHICH DO NOT EXHIBIT A MINIMUM OF 85 PERCENT VEGETATIVE GROWTH BY OCTOBER 15, OR WHICH ARE DISTURBED AFTER OCTOBER 15, SHALL BE STABILIZED TEMPORARILY WITH STONE OR EROSION CONTROL BLANKETS APPROPRIATE FOR THE DESIGN FLOW CONDITIONS;
 - C. AFTER OCTOBER 15, INCOMPLETE ROAD OR PARKING SURFACES, WHERE WORK HAS STOPPED FOR THE WINTER SEASON, SHALL BE PROTECTED WITH A MINIMUM OF 3 INCHES OF CRUSHED GRAVEL PER NHDOT ITEM 304.3, OR IF CONSTRUCTION IS TO CONTINUE THROUGH THE WINTER SEASON BE CLEARED OF ANY ACCUMULATED SNOW AFTER EACH STORM EVENT;
- 3. STABILIZATION SHALL BE INITIATED ON ALL LOAM STOCKPILES, AND DISTURBED AREAS, WHERE CONSTRUCTION ACTIVITY SHALL NOT OCCUR FOR MORE THAN TWENTY-ONE (21) CALENDAR DAYS BY THE FOURTEENTH (14TH) DAY AFTER CONSTRUCTION ACTIVITY HAS PERMANENTLY OR TEMPORARILY CEASED IN THAT AREA. STABILIZATION MEASURES TO BE USED INCLUDE:
 - A. TEMPORARY SEEDING;
 - B. MULCHING.
 - C. ALL AREAS SHALL BE STABILIZED WITHIN 45 DAYS OF INITIAL DISTURBANCE.
- 4. WHEN CONSTRUCTION ACTIVITY PERMANENTLY OR TEMPORARILY CEASES WITHIN 100 FEET

OF NEARBY SURFACE WATERS OR DELINEATED WETLANDS, THE AREA SHALL BE STABILIZED WITHIN SEVEN (7) DAYS OR PRIOR TO A RAIN EVENT. ONCE CONSTRUCTION ACTIVITY CEASES PERMANENTLY IN AN THESE AREAS, SILT FENCES, MULCH BERMS, HAY BALE BARRIERS AND ANY EARTH/DIKES SHALL BE REMOVED ONCE PERMANENT MEASURES ARE ESTABLISHED.

- 6. DURING CONSTRUCTION, RUNOFF WILL BE DIVERTED AROUND THE SITE WITH EARTH DIKES, PIPING OR STABILIZED CHANNELS WHERE POSSIBLE. SHEET RUNOFF FROM THE SITE WILL BE FILTERED THROUGH SILT FENCES, MULCH BERMS, HAY BALE BARRIERS, OR SILT SOCKS. ALL STORM DRAIN BASIN INLETS SHALL BE PROVIDED WITH FLARED END SECTIONS AND TRASH RACKS. THE SITE SHALL BE STABILIZED FOR THE WINTER BY NOVEMBER 15.

DUST CONTROL:

- 1. THE CONTRACTOR SHALL BE RESPONSIBLE TO CONTROL DUST THROUGHOUT THE CONSTRUCTION PERIOD.
- 2. DUST CONTROL METHODS SHALL INCLUDE, BUT BE NOT LIMITED TO SPRINKLING WATER ON EXPOSED AREAS, COVERING LOADED DUMP TRUCKS LEAVING THE SITE, AND TEMPORARY MULCHING.
- 3. DUST CONTROL MEASURES SHALL BE UTILIZED SO AS TO PREVENT THE MIGRATION OF DUST FROM THE SITE TO ABUTTING AREAS.

STOCKPILES:

- 1. LOCATE STOCKPILES A MINIMUM OF 50 FEET AWAY FROM CATCH BASINS, SWALES, AND CULVERTS.
- 2. ALL STOCKPILES SHOULD BE SURROUNDED WITH TEMPORARY EROSION CONTROL MEASURES PRIOR TO THE ONSET OF PRECIPITATION.
- 3. PERIMETER BARRIERS SHOULD BE MAINTAINED AT ALL TIMES, AND ADJUSTED AS NEEDED TO ACCOMMODATE THE DELIVERY AND REMOVAL OF MATERIALS FROM THE STOCKPILE. THE INTEGRITY OF THE BARRIER SHOULD BE INSPECTED AT THE END OF EACH WORKING DAY.
- 4. PROTECT ALL STOCKPILES FROM STORMWATER RUN-OFF USING TEMPORARY EROSION CONTROL MEASURES SUCH AS BERMS, SILT SOCK, OR OTHER APPROVED PRACTICE TO PREVENT MIGRATION OF MATERIAL BEYOND THE IMMEDIATE CONFINES OF THE STOCKPILES.

OFF SITE VEHICLE TRACKING:

- 1. THE CONTRACTOR SHALL CONSTRUCT STABILIZED CONSTRUCTION ENTRANCE(S) PRIOR TO ANY EXCAVATION ACTIVITIES.

VEGETATION:

- 1. TEMPORARY GRASS COVER:
 - A. SEEDBED PREPARATION:
 - a. APPLY FERTILIZER AT THE RATE OF 600 POUNDS PER ACRE OF 10-10-10. APPLY LIMESTONE (EQUIVALENT TO 50 PERCENT CALCIUM PLUS MAGNESIUM OXIDE) AT A RATE OF THREE (3) TONS PER ACRE;
 - b. SEEDING:
 - UTILIZE ANNUAL RYE GRASS AT A RATE OF 40 LBS/ACRE;
 - WHERE THE SOIL HAS BEEN COMPACTED BY CONSTRUCTION OPERATIONS, LOOSEN SOIL TO A DEPTH OF TWO (2) INCHES BEFORE APPLYING FERTILIZER, LIME AND SEED;
 - APPLY SEED UNIFORMLY BY HAND, CYCLONE SEEDER, OR HYDROSEEDER (SLURRY INCLUDING SEED AND FERTILIZER). HYDROSEEDING, WHICH INCLUDE MULCH, MAY BE LEFT ON SOIL SURFACE. SEEDING RATES MUST BE INCREASED 10% WHEN HYDROSEEDING;
 - c. MAINTENANCE:
 - TEMPORARY SEEDING SHALL BE PERIODICALLY INSPECTED. AT A MINIMUM, 95% OF THE SOIL SURFACE SHOULD BE COVERED BY VEGETATION. IF ANY EVIDENCE OF EROSION OR SEDIMENTATION IS APPARENT, REPAIRS SHALL BE MADE AND OTHER TEMPORARY MEASURES USED IN THE INTERIM (MULCH, FILTER BARRIERS, CHECK DAMS, ETC.).
- 2. VEGETATIVE PRACTICE:
 - A. FOR PERMANENT MEASURES AND PLANTINGS:
 - a. LIMESTONE SHALL BE THOROUGHLY INCORPORATED INTO THE LOAM LAYER AT A RATE OF THREE (3) TONS PER ACRE IN ORDER TO PROVIDE A PH VALUE OF 5.5 TO 7.6;
 - b. FERTILIZER SHALL BE SPREAD ON THE TOP LAYER OF LOAM AND WORKED INTO THE SURFACE. FERTILIZER APPLICATION RATE SHALL BE 800 POUNDS PER ACRE OF 10-20-20 FERTILIZER;
 - c. SOIL CONDITIONERS AND FERTILIZER SHALL BE APPLIED AT THE RECOMMENDED RATES AND SHALL BE THOROUGHLY WORKED INTO THE LOAM. LOAM SHALL BE RAKED UNTIL THE SURFACE IS FINELY PULVERIZED, SMOOTH AND EVEN, AND THEN COMPACTED TO AN EVEN SURFACE CONFORMING TO THE REQUIRED LINES AND GRADES WITH APPROVED ROLLERS WEIGHING BETWEEN 4-1/2 POUNDS AND 5-1/2 POUNDS PER INCH OF WIDTH;
 - d. SEED SHALL BE SOWN AT THE RATE SHOWN BELOW. SOWING SHALL BE DONE ON A CALM, DRY DAY, PREFERABLY BY MACHINE, BUT IF BY HAND, ONLY BY EXPERIENCED WORKMEN. IMMEDIATELY BEFORE SEEDING, THE SOIL SHALL BE LIGHTLY RAKED. ONE HALF THE SEED SHALL BE SOWN IN ONE DIRECTION AND THE OTHER HALF AT RIGHT ANGLES TO THE ORIGINAL DIRECTION. IT SHALL BE LIGHTLY RAKED INTO THE SOIL TO A DEPTH NOT OVER 1/4 INCH AND ROLLED WITH A HAND ROLLER WEIGHING NOT OVER 100 POUNDS PER LINEAR FOOT OF WIDTH;
 - e. HAY MULCH SHALL BE APPLIED IMMEDIATELY AFTER SEEDING AS INDICATED ABOVE;
 - f. THE SURFACE SHALL BE WATERED AND KEPT MOIST WITH A FINE SPRAY AS REQUIRED, WITHOUT WASHING AWAY THE SOIL, UNTIL THE GRASS IS WELL ESTABLISHED. ANY AREAS WHICH ARE NOT SATISFACTORILY COVERED WITH GRASS SHALL BE RESEEDED, AND ALL NOXIOUS WEEDS REMOVED;
 - g. THE CONTRACTOR SHALL PROTECT AND MAINTAIN THE SEEDED AREAS UNTIL ACCEPTED;
 - h. A GRASS SEED MIXTURE CONTAINING THE FOLLOWING SEED REQUIREMENTS SHALL BE APPLIED AT THE INDICATED RATE:

SEED MIX	APPLICATION RATE
CREeping RED FESCUE	20 LBS/ACRE
TALL FESCUE	20 LBS/ACRE
REDTOP	2 LBS/ACRE

IN NO CASE SHALL THE WEED CONTENT EXCEED ONE (1) PERCENT BY WEIGHT. ALL SEED SHALL COMPLY WITH STATE AND FEDERAL SEED LAWS. SEEDING SHALL BE DONE NO LATER THAN SEPTEMBER 15. IN NO CASE SHALL SEEDING TAKE PLACE OVER SNOW.
 - B. DORMANT SEEDING (SEPTEMBER 15 TO FIRST SNOWFALL):
 - A. FOLLOW PERMANENT MEASURES SLOPE, LIME, FERTILIZER AND GRADING REQUIREMENTS. APPLY SEED MIXTURE AT TWICE THE INDICATED RATE. APPLY MULCH AS INDICATED FOR PERMANENT MEASURES.

CONCRETE WASHOUT AREA:

- 1. THE FOLLOWING ARE THE ONLY NON-STORMWATER DISCHARGES ALLOWED. ALL OTHER NON-STORMWATER DISCHARGES ARE PROHIBITED ON SITE:
 - A. THE CONCRETE DELIVERY TRUCKS SHALL, WHENEVER POSSIBLE, USE WASHOUT FACILITIES AT THEIR OWN PLANT OR DISPATCH FACILITY;
 - B. IF IT IS NECESSARY, SITE CONTRACTOR SHALL DESIGNATE SPECIFIC WASHOUT AREAS AND DESIGN FACILITIES TO HANDLE ANTICIPATED WASHOUT WATER;
 - C. CONTRACTOR SHALL LOCATE WASHOUT AREAS AT LEAST 150 FEET AWAY FROM STORM DRAINS, SWALES AND SURFACE WATERS OR DELINEATED WETLANDS;
 - D. INSPECT WASHOUT FACILITIES DAILY TO DETECT LEAKS OR TEARS AND TO IDENTIFY WHEN MATERIALS NEED TO BE REMOVED.

ALLOWABLE NON-STORMWATER DISCHARGES:

- 1. FIRE-FIGHTING ACTIVITIES;
- 2. FIRE HYDRANT FLUSHING;
- 3. WATERS USED TO WASH VEHICLES WHERE DETERGENTS ARE NOT USED;
- 4. WATER USED TO CONTROL DUST;
- 5. POTABLE WATER INCLUDING UNCONTAMINATED WATER LINE FLUSHING;
- 6. ROUTINE EXTERNAL BUILDING WASH DOWN WHERE DETERGENTS ARE NOT USED;
- 7. PAVEMENT WASH WATERS WHERE DETERGENTS ARE NOT USED;
- 8. UNCONTAMINATED AIR CONDITIONING/COMPRESSOR CONDENSATION;
- 9. UNCONTAMINATED GROUND WATER OR SPRING WATER;
- 10. FOUNDATION OR FOOTING DRAINS WHICH ARE UNCONTAMINATED;
- 11. UNCONTAMINATED EXCAVATION DEWATERING;
- 12. LANDSCAPE IRRIGATION.

WASTE DISPOSAL:


- 1. WASTE MATERIAL:
 - A. ALL WASTE MATERIALS SHALL BE COLLECTED AND STORED IN SECURELY LIDDED RECEPTACLES. ALL TRASH AND CONSTRUCTION DEBRIS FROM THE SITE SHALL BE DEPOSITED IN A DUMPSTER;
 - B. NO CONSTRUCTION WASTE MATERIALS SHALL BE BURIED ON SITE;
 - C. ALL PERSONNEL SHALL BE INSTRUCTED REGARDING THE CORRECT PROCEDURE FOR WASTE DISPOSAL BY THE SUPERINTENDENT.
- 2. HAZARDOUS WASTE:
 - A. ALL HAZARDOUS WASTE MATERIALS SHALL BE DISPOSED OF IN THE MANNER SPECIFIED BY LOCAL OR STATE REGULATION OR BY THE MANUFACTURER;
 - B. SITE PERSONNEL SHALL BE INSTRUCTED IN THESE PRACTICES BY THE SUPERINTENDENT.
- 3. SANITARY WASTE:
 - A. ALL SANITARY WASTE SHALL BE COLLECTED FROM THE PORTABLE UNITS A MINIMUM OF ONCE PER WEEK BY A LICENSED SANITARY WASTE MANAGEMENT CONTRACTOR.

SPILL PREVENTION:

- 1. CONTRACTOR SHALL BE FAMILIAR WITH SPILL PREVENTION MEASURES REQUIRED BY LOCAL, STATE AND FEDERAL AGENCIES. AT A MINIMUM, CONTRACTOR SHALL FOLLOW THE BEST MANAGEMENT SPILL PREVENTION PRACTICES OUTLINED BELOW.
- 2. THE FOLLOWING ARE THE MATERIAL MANAGEMENT PRACTICES THAT SHALL BE USED TO REDUCE THE RISK OF SPILLS OR OTHER ACCIDENTAL EXPOSURE OF MATERIALS AND SUBSTANCES DURING CONSTRUCTION TO STORMWATER RUNOFF:
 - A. GOOD HOUSEKEEPING - THE FOLLOWING GOOD HOUSEKEEPING PRACTICE SHALL BE FOLLOWED ON SITE DURING CONSTRUCTION:
 - a. ONLY SUFFICIENT AMOUNTS OF PRODUCTS TO DO THE JOB SHALL BE STORED ON SITE;
 - b. ALL MATERIALS STORED ON SITE SHALL BE STORED IN A NEAT, ORDERLY MANNER IN THEIR PROPER (ORIGINAL IF POSSIBLE) CONTAINERS AND, IF POSSIBLE, UNDER A ROOF OR OTHER ENCLOSURE;
 - c. MANUFACTURER'S RECOMMENDATIONS FOR PROPER USE AND DISPOSAL SHALL BE FOLLOWED;
 - d. THE SITE SUPERINTENDENT SHALL INSPECT DAILY TO ENSURE PROPER USE AND DISPOSAL OF MATERIALS;
 - e. SUBSTANCES SHALL NOT BE MIXED WITH ONE ANOTHER UNLESS RECOMMENDED BY THE MANUFACTURER;
 - f. WHENEVER POSSIBLE ALL OF A PRODUCT SHALL BE USED UP BEFORE DISPOSING OF THE CONTAINER.
 - B. HAZARDOUS PRODUCTS - THE FOLLOWING PRACTICES SHALL BE USED TO REDUCE THE RISKS ASSOCIATED WITH HAZARDOUS MATERIALS:
 - g. PRODUCTS SHALL BE KEPT IN THEIR ORIGINAL CONTAINERS UNLESS THEY ARE NOT RESEALABLE;
 - h. ORIGINAL LABELS AND MATERIAL SAFETY DATA SHALL BE RETAINED FOR IMPORTANT PRODUCT INFORMATION;
 - i. SURPLUS PRODUCT THAT MUST BE DISPOSED OF SHALL BE DISCARDED ACCORDING TO THE MANUFACTURER'S RECOMMENDED METHODS OF DISPOSAL.
 - C. PRODUCT SPECIFIC PRACTICES - THE FOLLOWING PRODUCT SPECIFIC PRACTICES SHALL BE FOLLOWED ON SITE:
 - a. PETROLEUM PRODUCTS:
 - ALL ON SITE VEHICLES SHALL BE MONITORED FOR LEAKS AND RECEIVE REGULAR PREVENTIVE MAINTENANCE TO REDUCE LEAKAGE;
 - PETROLEUM PRODUCTS SHALL BE STORED IN TIGHTLY SEALED CONTAINERS WHICH ARE CLEARLY LABELED. ANY ASPHALT BASED SUBSTANCES USED ON SITE SHALL BE APPLIED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS.
 - b. FERTILIZERS:
 - FERTILIZERS USED SHALL BE APPLIED ONLY IN THE MINIMUM AMOUNTS DIRECTED BY THE SPECIFICATIONS;
 - ONCE APPLIED FERTILIZER SHALL BE WORKED INTO THE SOIL TO LIMIT EXPOSURE TO STORMWATER;
 - STORAGE SHALL BE IN A COVERED SHED OR ENCLOSED TRAILERS. THE CONTENTS OF ANY PARTIALLY USED BAGS OF FERTILIZER SHALL BE TRANSFERRED TO A SEALABLE PLASTIC BIN TO AVOID SPILLS.
 - c. PAINTS:
 - ALL CONTAINERS SHALL BE TIGHTLY SEALED AND STORED WHEN NOT REQUIRED FOR USE;
 - EXCESS PAINT SHALL NOT BE DISCHARGED TO THE STORM SEWER SYSTEM;
 - EXCESS PAINT SHALL BE DISPOSED OF PROPERLY ACCORDING TO MANUFACTURER'S INSTRUCTIONS OR STATE AND LOCAL REGULATIONS.
 - D. SPILL CONTROL PRACTICES - IN ADDITION TO GOOD HOUSEKEEPING AND MATERIAL MANAGEMENT PRACTICES DISCUSSED IN THE PREVIOUS SECTION, THE FOLLOWING PRACTICES SHALL BE FOLLOWED FOR SPILL PREVENTION AND CLEANUP:
 - a. MANUFACTURER'S RECOMMENDED METHODS FOR SPILL CLEANUP SHALL BE CLEARLY POSTED AND SITE PERSONNEL SHALL BE MADE AWARE OF THE PROCEDURES AND THE LOCATION OF THE INFORMATION AND CLEANUP SUPPLIES;
 - b. MATERIALS AND EQUIPMENT NECESSARY FOR SPILL CLEANUP SHALL BE KEPT IN THE MATERIAL STORAGE AREA ON SITE. EQUIPMENT AND MATERIALS SHALL INCLUDE BUT NOT BE LIMITED TO BROOMS, DUSTPANS, MOPS, RAGS, GLOVES, GOGGLES, KITTY LITTER, SAND, SAWDUST AND PLASTIC OR METAL TRASH CONTAINERS SPECIFICALLY FOR THIS PURPOSE;
 - c. ALL SPILLS SHALL BE CLEANED UP IMMEDIATELY AFTER DISCOVERY AND REPORTED TO PEASE DEVELOPMENT AUTHORITY;
 - d. THE SPILL AREA SHALL BE KEPT WELL VENTILATED AND PERSONNEL SHALL WEAR APPROPRIATE PROTECTIVE CLOTHING TO PREVENT INJURY FROM CONTACT WITH A HAZARDOUS SUBSTANCE;
 - e. SPILLS OF TOXIC OR HAZARDOUS MATERIAL SHALL BE REPORTED TO THE APPROPRIATE LOCAL, STATE OR FEDERAL AGENCIES AS REQUIRED;
 - f. THE SITE SUPERINTENDENT RESPONSIBLE FOR DAY-TO-DAY SITE OPERATIONS SHALL BE THE SPILL PREVENTION AND CLEANUP COORDINATOR.
 - E. VEHICLE FUELING AND MAINTENANCE PRACTICE:
 - a. CONTRACTOR SHALL MAKE AN EFFORT TO PERFORM EQUIPMENT/VEHICLE FUELING AND MAINTENANCE AT AN OFF-SITE FACILITY;
 - b. CONTRACTOR SHALL PROVIDE AN ON-SITE FUELING AND MAINTENANCE AREA THAT IS CLEAN AND DRY;
 - c. IF POSSIBLE THE CONTRACTOR SHALL KEEP AREA COVERED;
 - d. CONTRACTOR SHALL KEEP A SPILL KIT AT THE FUELING AND MAINTENANCE AREA;
 - e. CONTRACTOR SHALL REGULARLY INSPECT VEHICLES FOR LEAKS AND DAMAGE;
 - f. CONTRACTOR SHALL USE DRIP PANS, DRIP CLOTHS, OR ABSORBENT PADS WHEN REPLACING SPENT FLUID.

EROSION CONTROL OBSERVATIONS AND MAINTENANCE PRACTICES

THIS PROJECT DOES NOT EXCEED ONE (1) ACRE OF DISTURBANCE AND THUS DOES NOT REQUIRE A SWPPP.

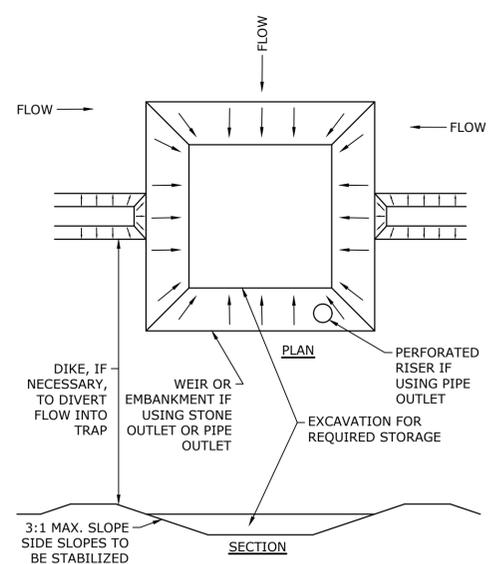


NOTES:

- 1. THE TRAP SHALL BE INSTALLED AS CLOSE TO THE DISTURBED AREA AS POSSIBLE.
- 2. THE MAXIMUM CONTRIBUTING AREA TO A SINGLE TRAP SHALL BE LESS THAN 5 ACRES.
- 3. THE MINIMUM VOLUME OF THE TRAP SHALL BE 3,600 CUBIC FEET OF STORAGE FOR EACH ACRE OF DRAINAGE AREA.
- 4. TRAP OUTLET SHALL BE MINIMUM OF ONE FOOT BELOW THE CREST OF THE TRAP.
- 5. TRAP SHALL DISCHARGE TO A STABILIZED AREA.
- 6. TRAP SHALL BE CLEANED WHEN 50 PERCENT OF THE ORIGINAL VOLUME IS FILLED.
- 7. MATERIALS REMOVED FROM THE TRAP SHALL BE PROPERLY DISPOSED OF AND STABILIZED.

SEDIMENT TRAP

NO SCALE

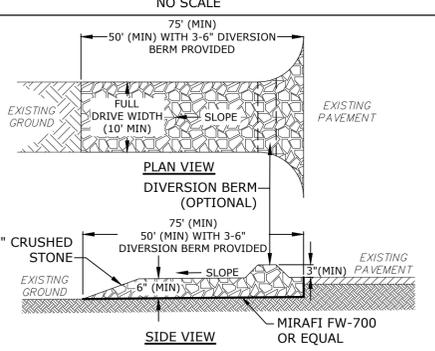


NOTES:

- 1. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OF SEDIMENT FROM THE SITE. WHEN WASHING IS REQUIRED, IT SHALL BE DONE SO RUNOFF DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING STORM DRAINS, DITCHES, OR WATERWAYS

STABILIZED CONSTRUCTION EXIT

NO SCALE

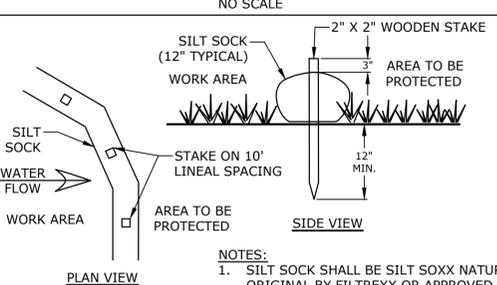


NOTES:

- 1. SILT SOCK SHALL BE SILT SOCKS NATURAL ORIGINAL BY FILTREXX OR APPROVED EQUAL.
- 2. INSTALL SILT SOCK IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

SILT SOCK

NO SCALE

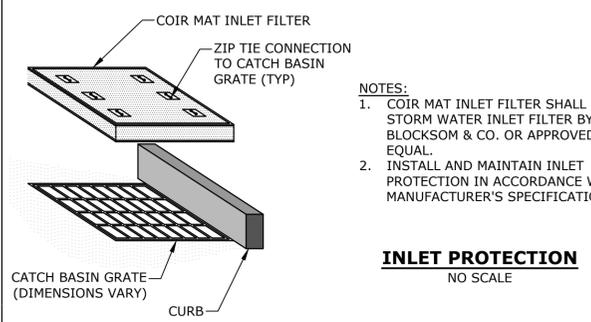


NOTES:

- 1. COIR MAT INLET FILTER SHALL BE STORM WATER INLET FILTER BY BLOCKSOM & CO. OR APPROVED EQUAL.
- 2. INSTALL AND MAINTAIN INLET PROTECTION IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

INLET PROTECTION

NO SCALE





MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission

PROJECT NO:	L-0700-023
DATE:	June 27, 2022
FILE:	L-0700-023-C-DTLS.DWG
DRAWN BY:	CKJ/NHW
CHECKED BY:	NAH
APPROVED BY:	PMC

EROSION CONTROL NOTES & DETAILS


SCALE: AS SHOWN

Last Saved: 7/19/2022, 11:28am By: CKJ/naah
Project: 06/30/21, 2:07pm By: CKJ/naah
Tighe & Bond\21\10700 - Lonza Biologics Expansion - Figures\AutoCAD\1-0700-023-C-DTLS.dwg

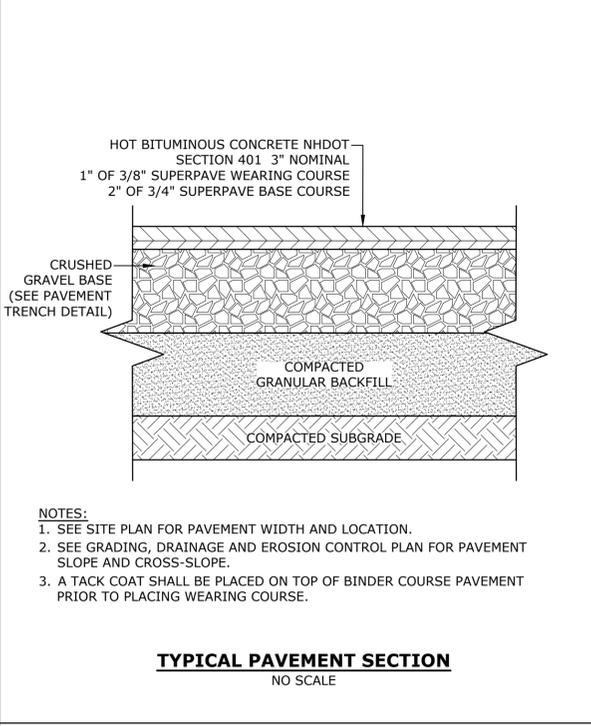


- NOTES:**
- SEE SITE PLAN FOR PAVEMENT WIDTH AND LOCATION.
 - SEE GRADING, DRAINAGE AND EROSION CONTROL PLAN FOR PAVEMENT SLOPE AND CROSS-SLOPE.
 - A TACK COAT SHALL BE PLACED ON TOP OF BINDER COURSE PAVEMENT PRIOR TO PLACING WEARING COURSE.

TYPICAL PAVEMENT SECTION
NO SCALE

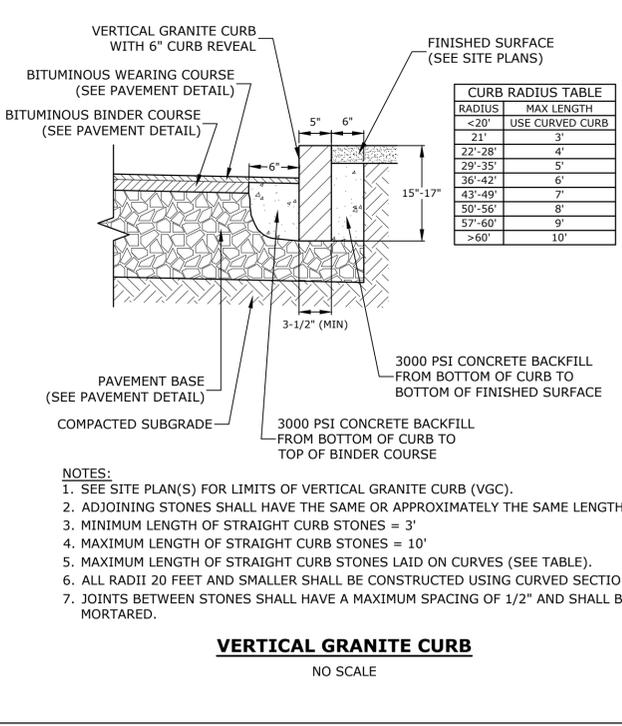


- NOTES:**
- SEE SITE PLAN(S) FOR LIMITS OF VERTICAL GRANITE CURB (VGC).
 - ADJOINING STONES SHALL HAVE THE SAME OR APPROXIMATELY THE SAME LENGTH.
 - MINIMUM LENGTH OF STRAIGHT CURB STONES = 3'
 - MAXIMUM LENGTH OF STRAIGHT CURB STONES = 10'
 - MAXIMUM LENGTH OF STRAIGHT CURB STONES LAID ON CURVES (SEE TABLE).
 - ALL RADII 20 FEET AND SMALLER SHALL BE CONSTRUCTED USING CURVED SECTIONS.
 - JOINTS BETWEEN STONES SHALL HAVE A MAXIMUM SPACING OF 1/2" AND SHALL BE MORTARED.

VERTICAL GRANITE CURB
NO SCALE

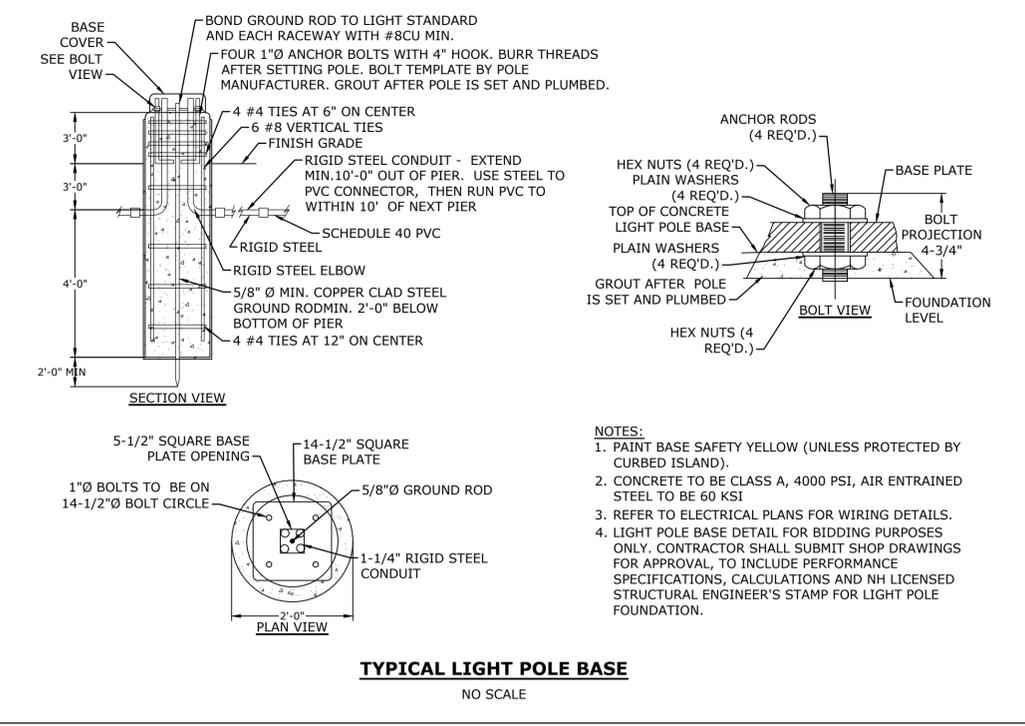


- NOTES:**
- PAINT BASE SAFETY YELLOW (UNLESS PROTECTED BY CURBED ISLAND).
 - CONCRETE TO BE CLASS A, 4000 PSI, AIR ENTRAINED STEEL TO BE 60 KSI
 - REFER TO ELECTRICAL PLANS FOR WIRING DETAILS.
 - LIGHT POLE BASE DETAIL FOR BIDDING PURPOSES ONLY. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR APPROVAL, TO INCLUDE PERFORMANCE SPECIFICATIONS, CALCULATIONS AND NH LICENSED STRUCTURAL ENGINEER'S STAMP FOR LIGHT POLE FOUNDATION.

TYPICAL LIGHT POLE BASE
NO SCALE

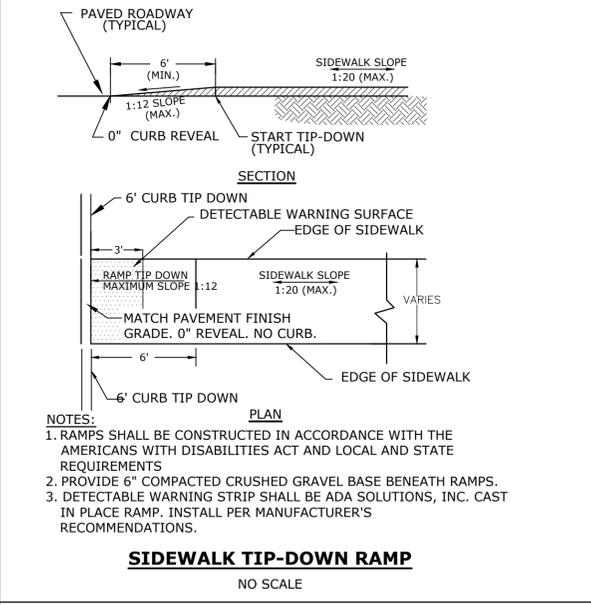


- NOTES:**
- RAMPS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE AMERICANS WITH DISABILITIES ACT AND LOCAL AND STATE REQUIREMENTS
 - PROVIDE 6" COMPACTED CRUSHED GRAVEL BASE BENEATH RAMPS.
 - DETECTABLE WARNING STRIP SHALL BE ADA SOLUTIONS, INC. CAST IN PLACE RAMP. INSTALL PER MANUFACTURER'S RECOMMENDATIONS.

SIDEWALK TIP-DOWN RAMP
NO SCALE

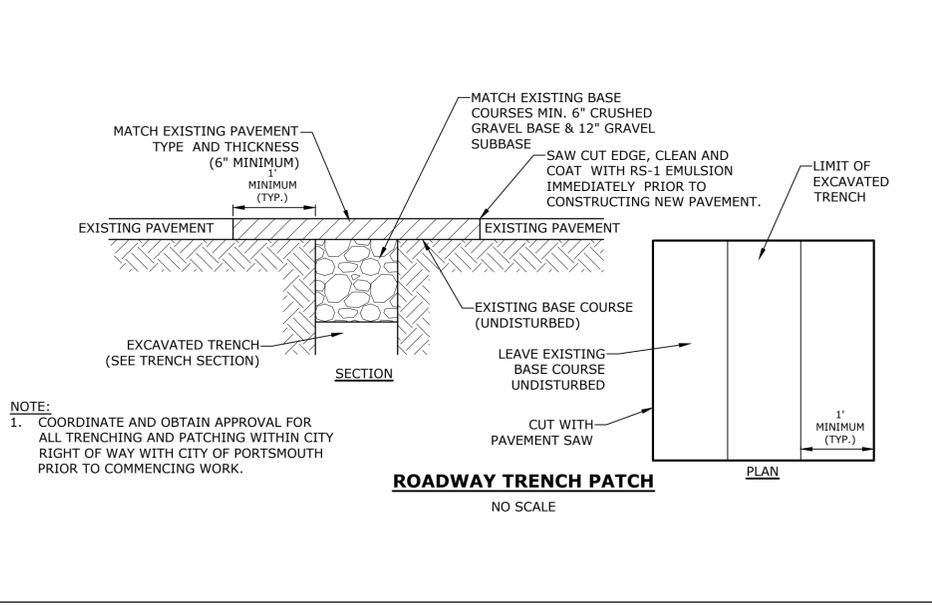


- NOTE:**
- COORDINATE AND OBTAIN APPROVAL FOR ALL TRENCHING AND PATCHING WITHIN CITY RIGHT OF WAY WITH CITY OF PORTSMOUTH PRIOR TO COMMENCING WORK.

ROADWAY TRENCH PATCH
NO SCALE

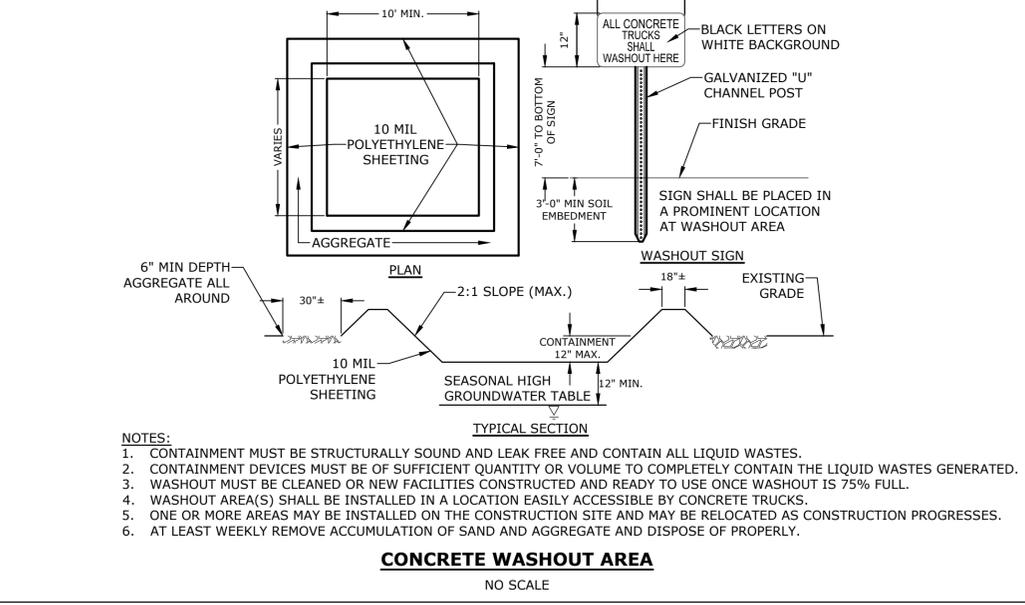


- NOTES:**
- CONTAINMENT MUST BE STRUCTURALLY SOUND AND LEAK FREE AND CONTAIN ALL LIQUID WASTES.
 - CONTAINMENT DEVICES MUST BE OF SUFFICIENT QUANTITY OR VOLUME TO COMPLETELY CONTAIN THE LIQUID WASTES GENERATED.
 - WASHOUT MUST BE CLEANED OR NEW FACILITIES CONSTRUCTED AND READY TO USE ONCE WASHOUT IS 75% FULL.
 - WASHOUT AREA(S) SHALL BE INSTALLED IN A LOCATION EASILY ACCESSIBLE BY CONCRETE TRUCKS.
 - ONE OR MORE AREAS MAY BE INSTALLED ON THE CONSTRUCTION SITE AND MAY BE RELOCATED AS CONSTRUCTION PROGRESSES.
 - AT LEAST WEEKLY REMOVE ACCUMULATION OF SAND AND AGGREGATE AND DISPOSE OF PROPERLY.

CONCRETE WASHOUT AREA
NO SCALE

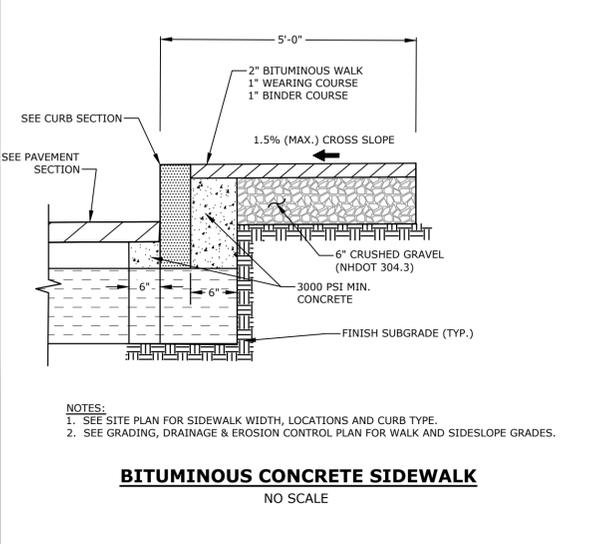


- NOTES:**
- SEE SITE PLAN FOR SIDEWALK WIDTH, LOCATIONS AND CURB TYPE.
 - SEE GRADING, DRAINAGE & EROSION CONTROL PLAN FOR WALK AND SIDESLOPE GRADES.

BITUMINOUS CONCRETE SIDEWALK
NO SCALE

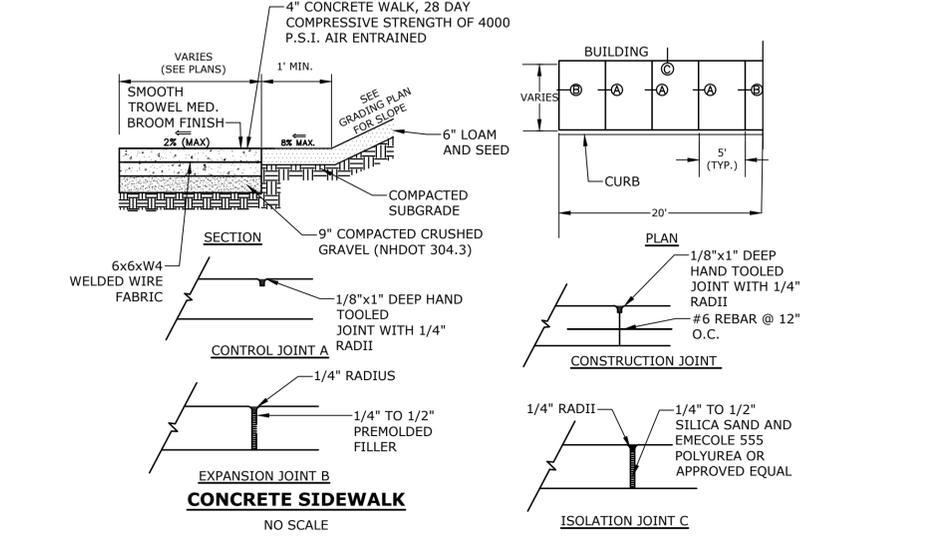

- CONTROL JOINT A**
- EXPANSION JOINT B**
- ISOLATION JOINT C**

CONCRETE SIDEWALK
NO SCALE

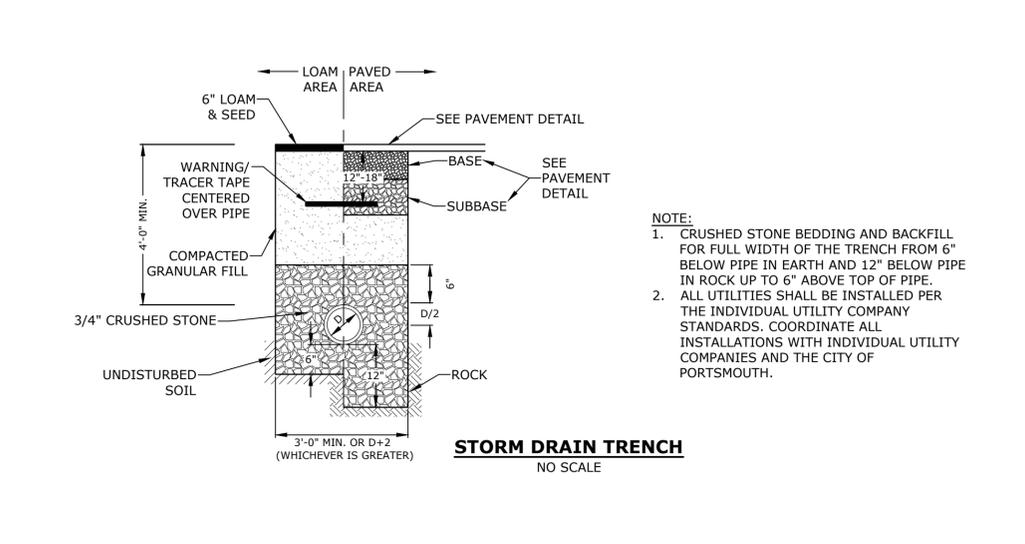

- NOTE:**
- CRUSHED STONE BEDDING AND BACKFILL FOR FULL WIDTH OF THE TRENCH FROM 6" BELOW PIPE IN EARTH AND 12" BELOW PIPE IN ROCK UP TO 6" ABOVE TOP OF PIPE.
 - ALL UTILITIES SHALL BE INSTALLED PER THE INDIVIDUAL UTILITY COMPANY STANDARDS. COORDINATE ALL INSTALLATIONS WITH INDIVIDUAL UTILITY COMPANIES AND THE CITY OF PORTSMOUTH.

STORM DRAIN TRENCH
NO SCALE

Cafe Expansion

Lonza Biologics

Portsmouth, New Hampshire

MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission

PROJECT NO: L-0700-023
DATE: June 27, 2022
FILE: L-0700-023-C-DTLS.DWG
DRAWN BY: CLK/NHW
CHECKED BY: NAH
APPROVED BY: PMC


DETAILS

SCALE: AS SHOWN

C-502


Last Saved: 7/19/2022, 11:28am By: CLK/CLK
Project: 07-21-2022, 11:28am By: CLK/CLK
Figure & Detail: L-0700-023-C-DTLS.DWG
Figure: AutoCAD, L-0700-023-C-DTLS.dwg

NHDOT ITEM No. 304.4 (CRUSHED STONE - FINE)	
SIEVE SIZE	% PASSING
2"	100
1-1/2"	85-100
3/4"	45-75
#4	10-45
#200	0-5

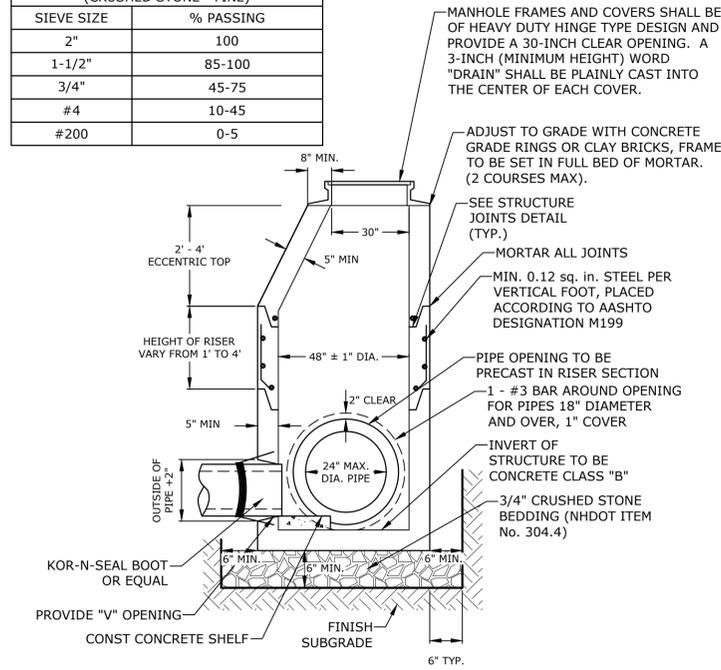


- NOTES:
- ALL SECTIONS SHALL BE 4,000 PSI CONCRETE.
 - CIRCUMFERENTIAL REINFORCEMENT SHALL BE 0.12 SQUARE INCHES PER LINEAR FOOT IN ALL SECTIONS AND SHALL BE PLACED IN THE CENTER THIRD OF THE WALL.
 - THE TONGUE AND THE GROOVE OF THE JOINT SHALL CONTAIN ONE LINE OF CIRCUMFERENTIAL REINFORCEMENT EQUAL TO 0.12 SQUARE INCHES PER LINEAR FOOT.
 - THE STRUCTURES SHALL BE DESIGNED FOR H2O LOADING.
 - CONSTRUCT CRUSHED STONE BEDDING AND BACKFILL UNDER (6" MINIMUM THICKNESS)
 - THE TONGUE AND GROOVE JOINT SHALL BE SEALED WITH ONE STRIP OF BUTYL RUBBER SEALANT.
 - PIPE ELEVATIONS SHOWN ON PLANS SHALL BE FIELD VERIFIED PRIOR TO PRECASTING.
 - OUTSIDE EDGES OF PIPES SHALL PROJECT NO MORE THAN 3" BEYOND INSIDE WALL OF STRUCTURE.
 - PRECAST SECTIONS SHALL HAVE A TONGUE AND GROOVE JOINT 4" HIGH AT AN 11° ANGLE CENTERED IN THE WIDTH OF THE WALL AND SHALL BE ASSEMBLED USING AN APPROVED FLEXIBLE SEALANT IN JOINTS.
 - ALL STRUCTURES WITH MULTIPLE PIPES SHALL HAVE A MINIMUM OF 12" OF INSIDE SURFACE BETWEEN HOLES, NO MORE THAN 75% OF A HORIZONTAL CROSS SECTION SHALL BE HOLES, AND THERE SHALL BE NO HOLES CLOSER THAN 3" TO JOINTS.

4' DIAMETER DRAIN MANHOLE
NO SCALE

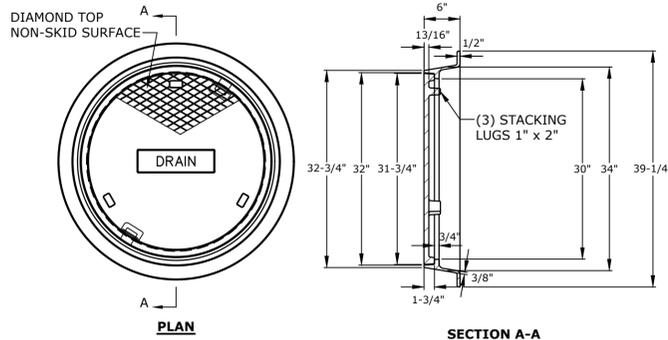

- NOTES:
- ALL DIMENSIONS ARE NOMINAL.
 - FRAMES USING NARROWER DIMENSIONS FOR THICKNESS ARE ALLOWED PROVIDED:
 - THE FRAMES MEET OR EXCEED THE SPECIFIED LOAD RATING.
 - THE INTERIOR PERIMETER (SEAT AREA) DIMENSIONS OF THE FRAMES REMAIN THE SAME TO ALLOW CONTINUED USE OF EXISTING GRATES/COVERS AS THE EXISTING FRAMES ALLOW, WITHOUT SHIMS OR OTHER MODIFICATIONS OR ACCOMMODATIONS.
 - ALL OTHER PERTINENT REQUIREMENTS OF THE SPECIFICATIONS ARE MET.
 - LABEL TYPE OF MANHOLE WITH 3" HIGH LETTERS IN THE CENTER OF THE COVER.


DRAIN MANHOLE FRAME & COVER
NO SCALE

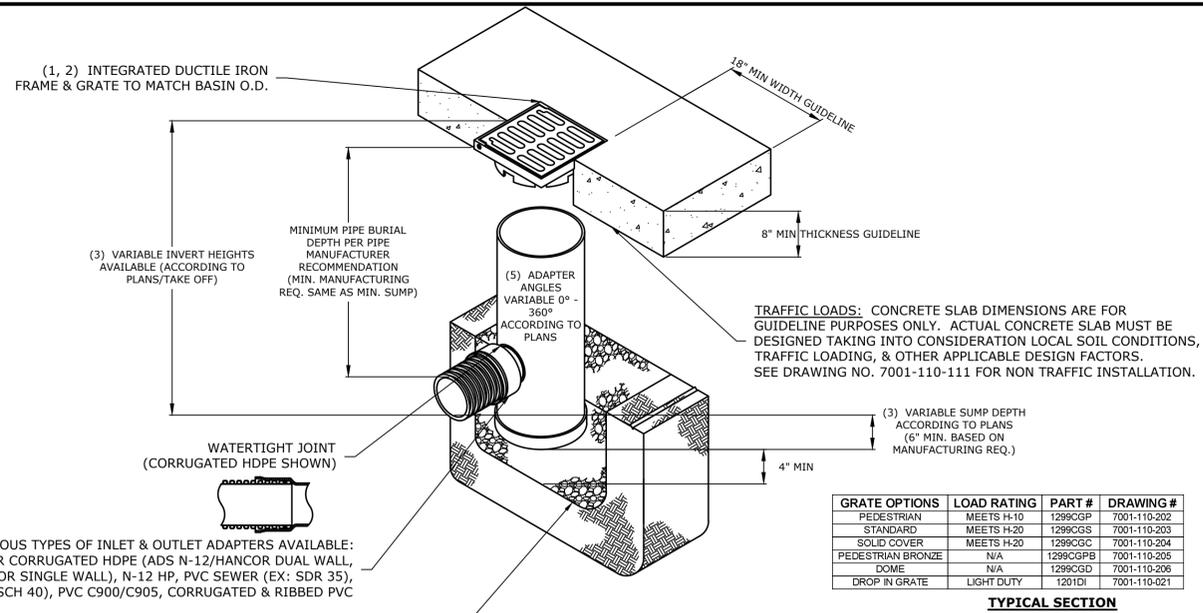

- (4) VARIOUS TYPES OF INLET & OUTLET ADAPTERS AVAILABLE: 4" - 12" FOR CORRUGATED HDPE (ADS N-12/HANCOR DUAL WALL, ADS/HANCOR SINGLE WALL), N-12 HP, PVC SEWER (EX: SDR 35), PVC DWV (EX: SCH 40), PVC C900/C905, CORRUGATED & RIBBED PVC
- THE BACKFILL MATERIAL SHALL BE CRUSHED STONE OR OTHER GRANULAR MATERIAL MEETING THE REQUIREMENTS OF CLASS I, CLASS II, OR CLASS III MATERIAL AS DEFINED IN ASTM D2321. BEDDING & BACKFILL FOR SURFACE DRAINAGE INLETS SHALL BE PLACED & COMPACTED UNIFORMLY IN ACCORDANCE WITH ASTM D2321.

YARD DRAIN
NO SCALE


- NOTES:
- GRATES/SOLID COVER SHALL BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05, WITH THE EXCEPTION OF THE BRONZE GRATE.
 - FRAMES SHALL BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05
 - DRAIN BASIN TO BE CUSTOM MANUFACTURED ACCORDING TO PLAN DETAILS. RISERS ARE NEEDED FOR BASINS OVER 84" DUE TO SHIPPING RESTRICTIONS. SEE DRAWING NO. 7001-110-065
 - DRAINAGE CONNECTION STUB JOINT TIGHTNESS SHALL CONFORM TO ASTM D3212 FOR CORRUGATED HDPE (ADS N-12/HANCOR DUAL WALL), N-12 HP, & PVC SEWER.
 - ADAPTERS CAN BE MOUNTED ON ANY ANGLE 0° TO 360°. TO DETERMINE MINIMUM ANGLE BETWEEN ADAPTERS SEE DRAWING NO. 7001-110-012.

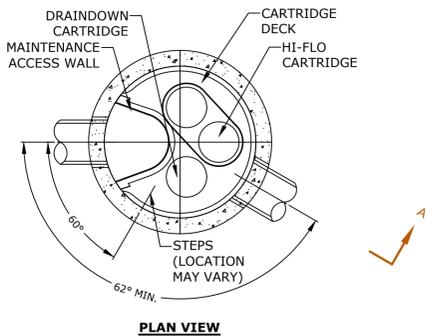

JELLYFISH TREATMENT CAPACITY IS A FUNCTION OF THE CARTRIDGE SELECTION AND THE NUMBER OF CARTRIDGES. THE STANDARD MANHOLE STYLE IS SHOWN. Ø48" MANHOLE JELLYFISH PEAK TREATMENT CAPACITY IS 0.45 CFS. IF THE SITE CONDITIONS EXCEED 0.45 CFS AN UPSTREAM BYPASS STRUCTURE IS REQUIRED.


CARTRIDGE SELECTION	
CARTRIDGE DEPTH	54"
OUTLET INVERT TO STRUCTURE INVERT (A)	6'-5"
FLOW RATE HIGH-FLO / DRAINDOWN (cfs) (per cart)	0.18 / 0.09
MAX. CARTS HIGH-FLO / DRAINDOWN	2 / 1

SITE SPECIFIC DATA REQUIREMENTS	
STRUCTURE ID	4'
WATER QUALITY FLOW RATE (cfs)	0.15
# OF CARTRIDGES REQUIRED (HF / DD)	(1/1)
CARTRIDGE SIZE	54"

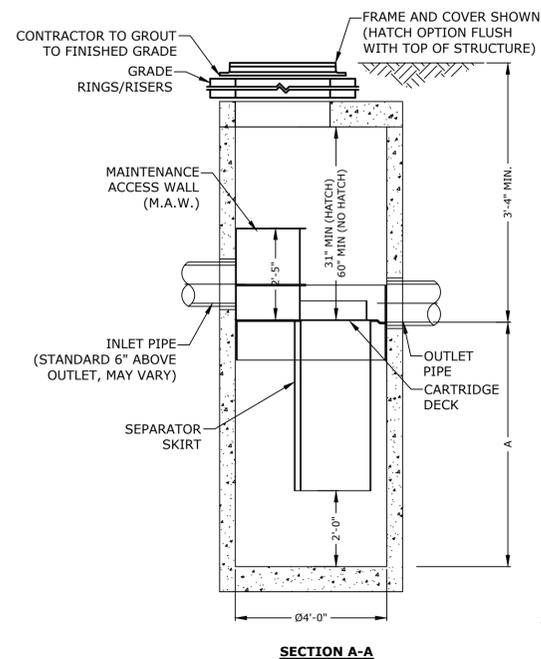

CONTECH JELLYFISH JF4-1-1
NO SCALE

- GENERAL NOTES:
- CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
 - FOR SITE SPECIFIC DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHT, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS REPRESENTATIVE. www.ContechES.com
 - JELLYFISH WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING. CONTRACTOR TO CONFIRM STRUCTURE MEETS REQUIREMENTS OF PROJECT.
 - STRUCTURE SHALL MEET AASHTO HS-20 OR PER APPROVING JURISDICTION REQUIREMENTS, WHICHEVER IS MORE STRINGENT, ASSUMING EARTH COVER OF 0' - 3', AND GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION. CASTINGS SHALL MEET AASHTO M308 LOAD RATING AND BE CAST WITH THE CONTECH LOGO.
 - STRUCTURE SHALL BE PRECAST CONCRETE CONFORMING TO ASTM C-478 AND AASHTO LOAD FACTOR DESIGN METHOD.
 - NO PRODUCT SUBSTITUTIONS SHALL BE ACCEPTED UNLESS SUBMITTED 10 DAYS PRIOR TO PROJECT BID DATE, OR AS DIRECTED BY THE ENGINEER OF RECORD.
- INSTALLATION NOTES:
- ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
 - CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE STRUCTURE (LIFTING CLUTCHES PROVIDED)
 - CONTRACTOR WILL INSTALL AND LEVEL THE STRUCTURE, SEALING THE JOINTS, LINE ENTRY AND EXIT POINTS (NON-SHRINK GROUT WITH APPROVED WATERSTOP OR FLEXIBLE BOOT)
 - CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION-RELATED EROSION RUNOFF.
 - CARTRIDGE INSTALLATION, BY CONTECH, SHALL OCCUR ONLY AFTER SITE HAS BEEN STABILIZED AND THE JELLYFISH UNIT IS CLEAN AND FREE OF DEBRIS. CONTACT CONTECH TO COORDINATE CARTRIDGE INSTALLATION WITH SITE STABILIZATION AT (866) 740-3318.




- NOTES:
- ALL CATCH BASIN OUTLETS TO HAVE "ELIMINATOR" OIL AND FLOATING DEBRIS TRAP MANUFACTURED BY KLEANSTREAM (NO EQUAL)
 - INSTALL DEBRIS TRAP TIGHT TO INSIDE OF STRUCTURE.
 - 1/4" HOLE SHALL BE DRILLED IN TOP OF DEBRIS TRAP

**"ELIMINATOR" OIL
"FLOATING DEBRIS TRAP"**
NO SCALE



MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission

PROJECT NO: L-0700-023
DATE: June 27, 2022
FILE: L-0700-023-C-DTLS.DWG
DRAWN BY: CLK/NHW
CHECKED BY: NAH
APPROVED BY: PMC

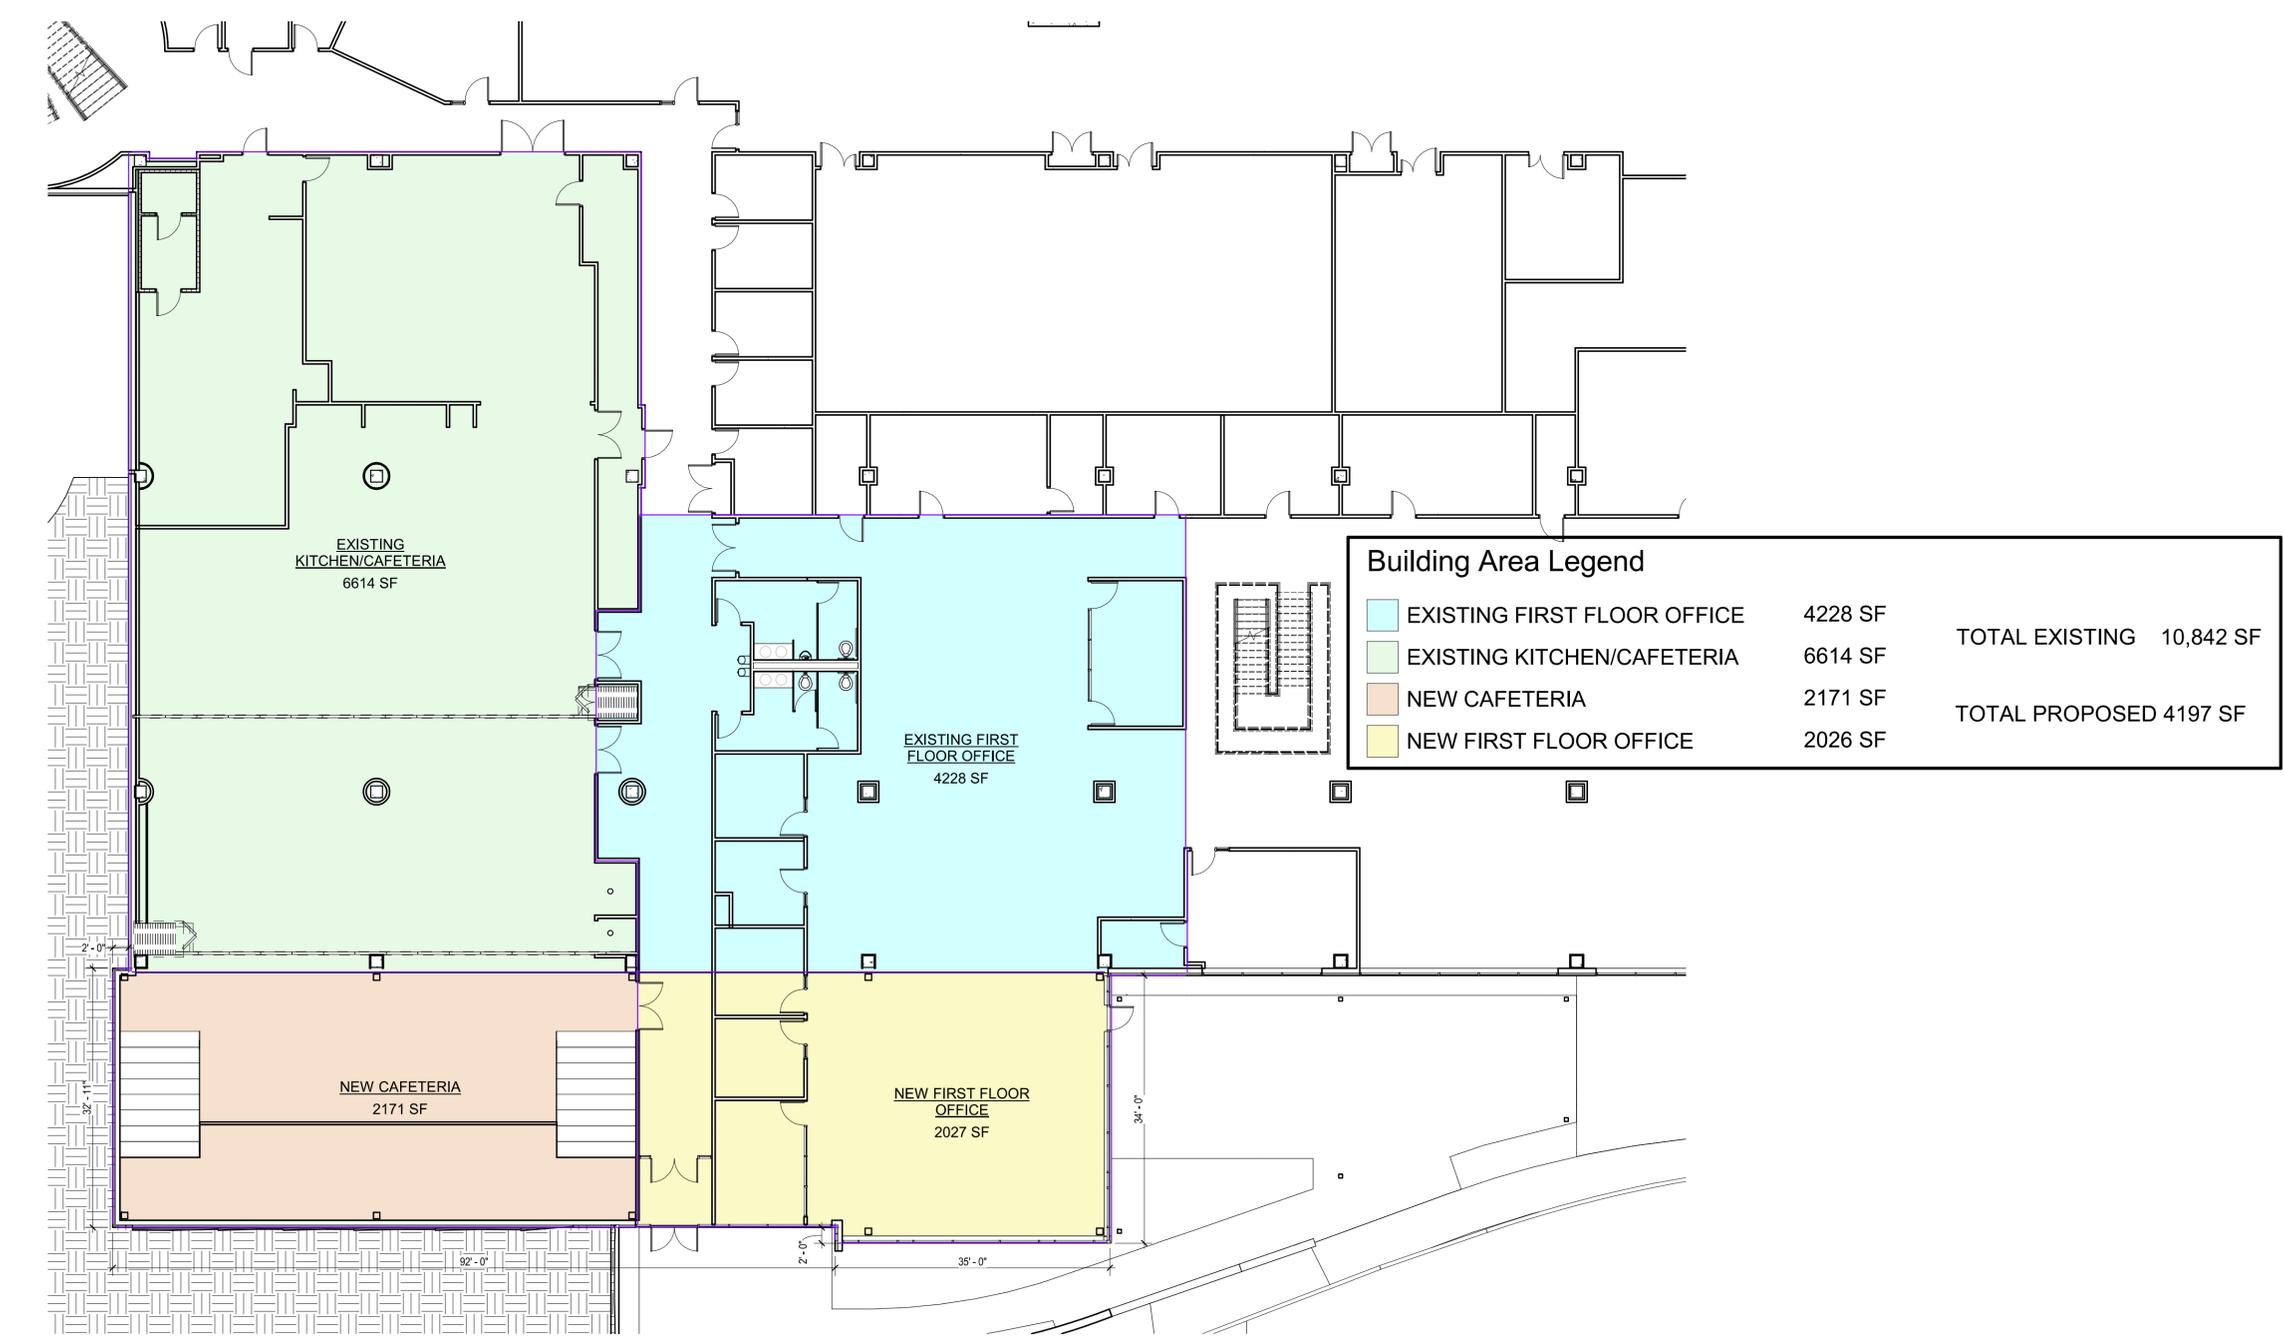


Building Area Legend		
EXISTING FIRST FLOOR OFFICE	4228 SF	TOTAL EXISTING 10,842 SF
EXISTING KITCHEN/CAFETERIA	6614 SF	
NEW CAFETERIA	2171 SF	TOTAL PROPOSED 4197 SF
NEW FIRST FLOOR OFFICE	2026 SF	

1 PROPOSED FIRST FLOOR - AREA PLAN
SCALE: 3/32" = 1'-0"

Notes:

Key Plan:



Architect's Stamp:

Project:
Lonza Addition

Street Address:
City, ST 00000

Client:
Lonza

Street, City

Project #: 22xxxx

Scale: 3/32" = 1'-0"

Issue:	Date:
Schematic Design	06/07/2022

Revisions:	Date:


Drawing Title:
FIRST FLOOR AREA PLAN

Sheet Number:

AP-101

MAUGEL ARCHITECTS
200 AVER ROAD | SUITE 200
HAIRFORD, MA 01451
978 456 2800
MAUGEL.COM

THESE DOCUMENTS AND ALL REVISIONS, AMENDMENTS, DESIGNS AND PLANS INDICATED THEREON OR REFERENCED THEREIN ARE OWNED BY AND REMAIN THE PROPERTY OF MAUGEL ARCHITECTS, INC. AND NO PART THEREOF SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF MAUGEL ARCHITECTS, INC.

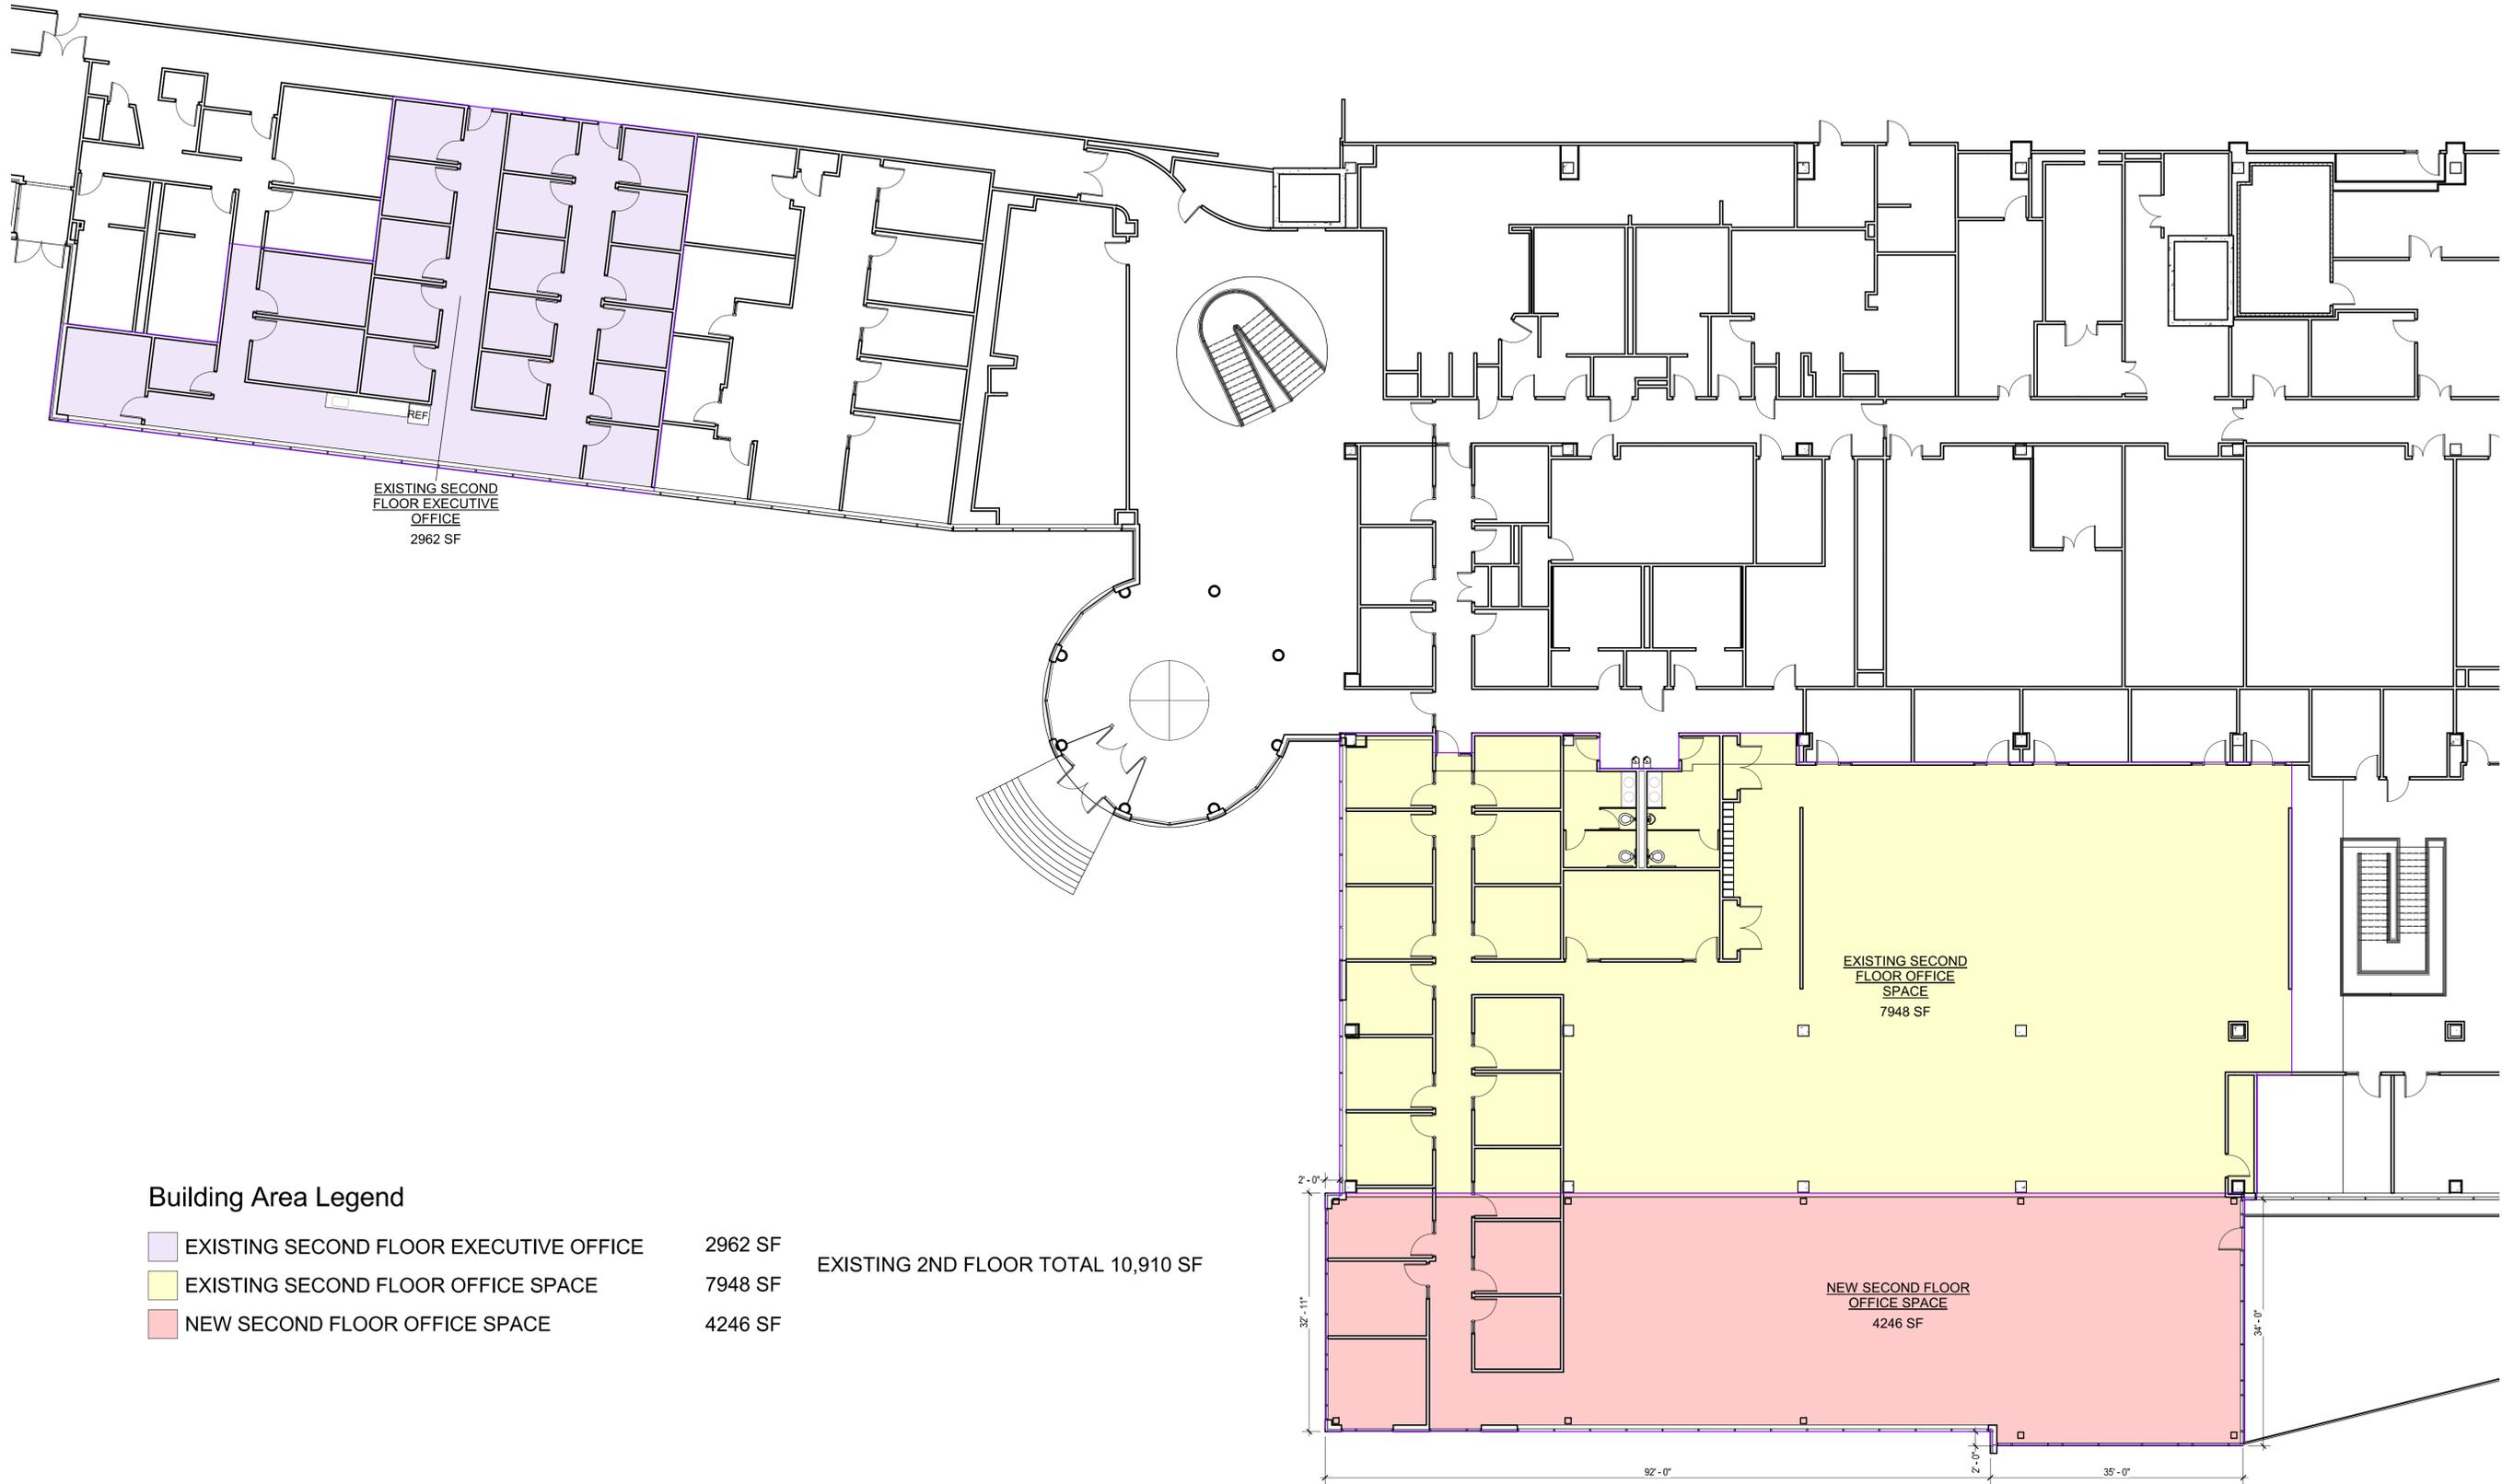

EXISTING SECOND FLOOR EXECUTIVE OFFICE
2962 SF

EXISTING SECOND FLOOR OFFICE SPACE
7948 SF

NEW SECOND FLOOR OFFICE SPACE
4246 SF


Building Area Legend

- EXISTING SECOND FLOOR EXECUTIVE OFFICE 2962 SF
- EXISTING SECOND FLOOR OFFICE SPACE 7948 SF
- NEW SECOND FLOOR OFFICE SPACE 4246 SF

EXISTING 2ND FLOOR TOTAL 10,910 SF

Notes:

Key Plan:



Architect's Stamp:

Project:
Lonza Addition

Street Address:
City, ST 00000

Client:
Lonza

Street, City

Project #: 22xxxx

Scale: 3/32" = 1'-0"

Issue: Schematic Design Date: 06/07/2022

Revisions: Date:


Drawing Title:
SECOND FLOOR AREA PLAN

Sheet Number:


AP-102

MAUGEL ARCHITECTS
200 AVER ROAD | SUITE 200
HAIRFORD, MA 01451
978 456 2800
MAUGEL.COM

THESE DOCUMENTS AND ALL REVISIONS ARE THE PROPERTY OF MAUGEL ARCHITECTS, INC. AND NO PART THEREOF SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF MAUGEL ARCHITECTS, INC.

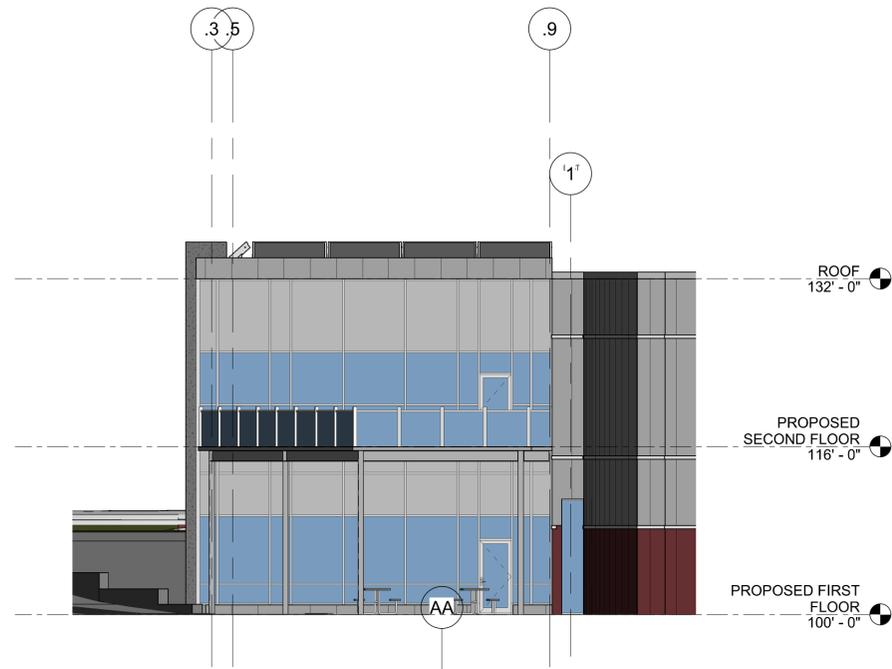

2 EAST ELEVATION
SCALE: 1/8" = 1'-0"

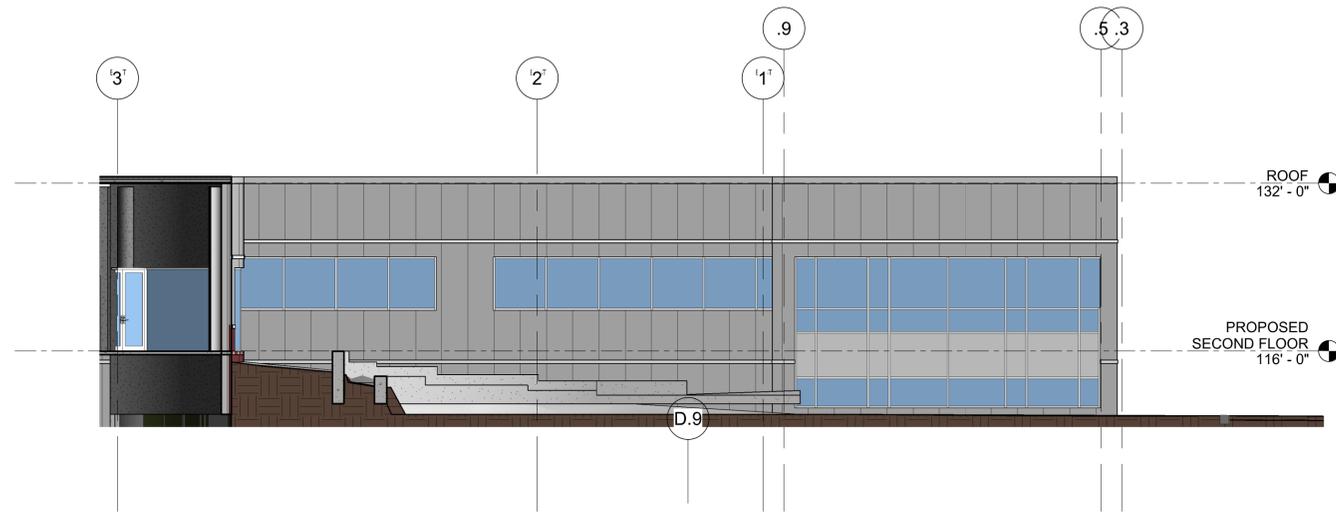

3 WEST ELEVATION
SCALE: 1/8" = 1'-0"




1 SOUTH ELEVATION
SCALE: 1/8" = 1'-0"

City of Portsmouth TAC, July 5, 2022:			
	<u>TAC Stipulation</u>	<u>Applicant Response</u>	<u>Sheet</u>
TAC Stipulations from 7/6 Letter of Decision:			
1	Solid material couplings must be used in connection to sewer and approved by Sewer Department prior to installation.	Plan has been revised to specify solid couplings be used in connection to the existing sewer. Utility note 17 has also been added noting couplings shall be approved by the Sewer Department prior to installation.	C-104
2	A note is to be added to plan instructing the contractor to appropriately dispose of asbestos cement pipes should any be found during construction.	Utility note 18 has been added stating that the contractor shall appropriately dispose of asbestos cement pipes should any be found during construction.	C-104

Drainage Analysis

To: City of Portsmouth Planning Board (PB)
FROM: Neil A. Hansen, PE
 Patrick M. Crimmins, PE
COPY: Lonza Biologics
DATE: July 21, 2022

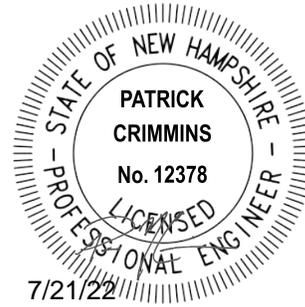

1.0 Project Description

The proposed project is located at 101 International Drive which is identified as Map 305 Lot 6 on the City of Portsmouth Tax Maps. The proposed project includes a 4,200 SF expansion to the existing Lonza café. The proposed work includes drainage improvements, relocation of the existing grease trap, landscaping improvements and miscellaneous sidewalks and concrete pads.

Runoff from the proposed surfaces will be directed to a stormwater treatment system prior to entering the existing on-site drainage system. Runoff from the proposed expansion and associated sidewalks is proposed to be treated by a Contech Jellyfish Filter filtration system.

2.0 Drainage Analysis



The stormwater management system for the proposed expansion has been designed to provide stormwater treatment for the additional impervious area, as well as an equivalent amount of existing untreated impervious area as required by the Pease Development Authority (PDA) (Table 2.0).

Table 2.0 – Treatment Area Requirements	
Proposed Increase in Impervious Area	2,278 sf
Required Impervious Area to be Treated (2x Increase)	4,556 sf
Proposed Treated Impervious Area	6,526 sf

The watershed area that directs runoff to the proposed stormwater management system was analyzed to determine the Water Quality Volume (WQV) or Water Quality Flow (WQF) required to size the systems. The proposed limit of work was also analyzed for the pre- and post-development peak runoff rates for the 2-year, 10-year, 25-year and 50-year storm events.

LEGEND

-  PRE-DEVELOPMENT WATERSHED BOUNDARY
-  LONGEST FLOW PATH
-  PRE DEVELOPMENT WATERSHED AREA DESIGNATION
-  POINT OF ANALYSIS

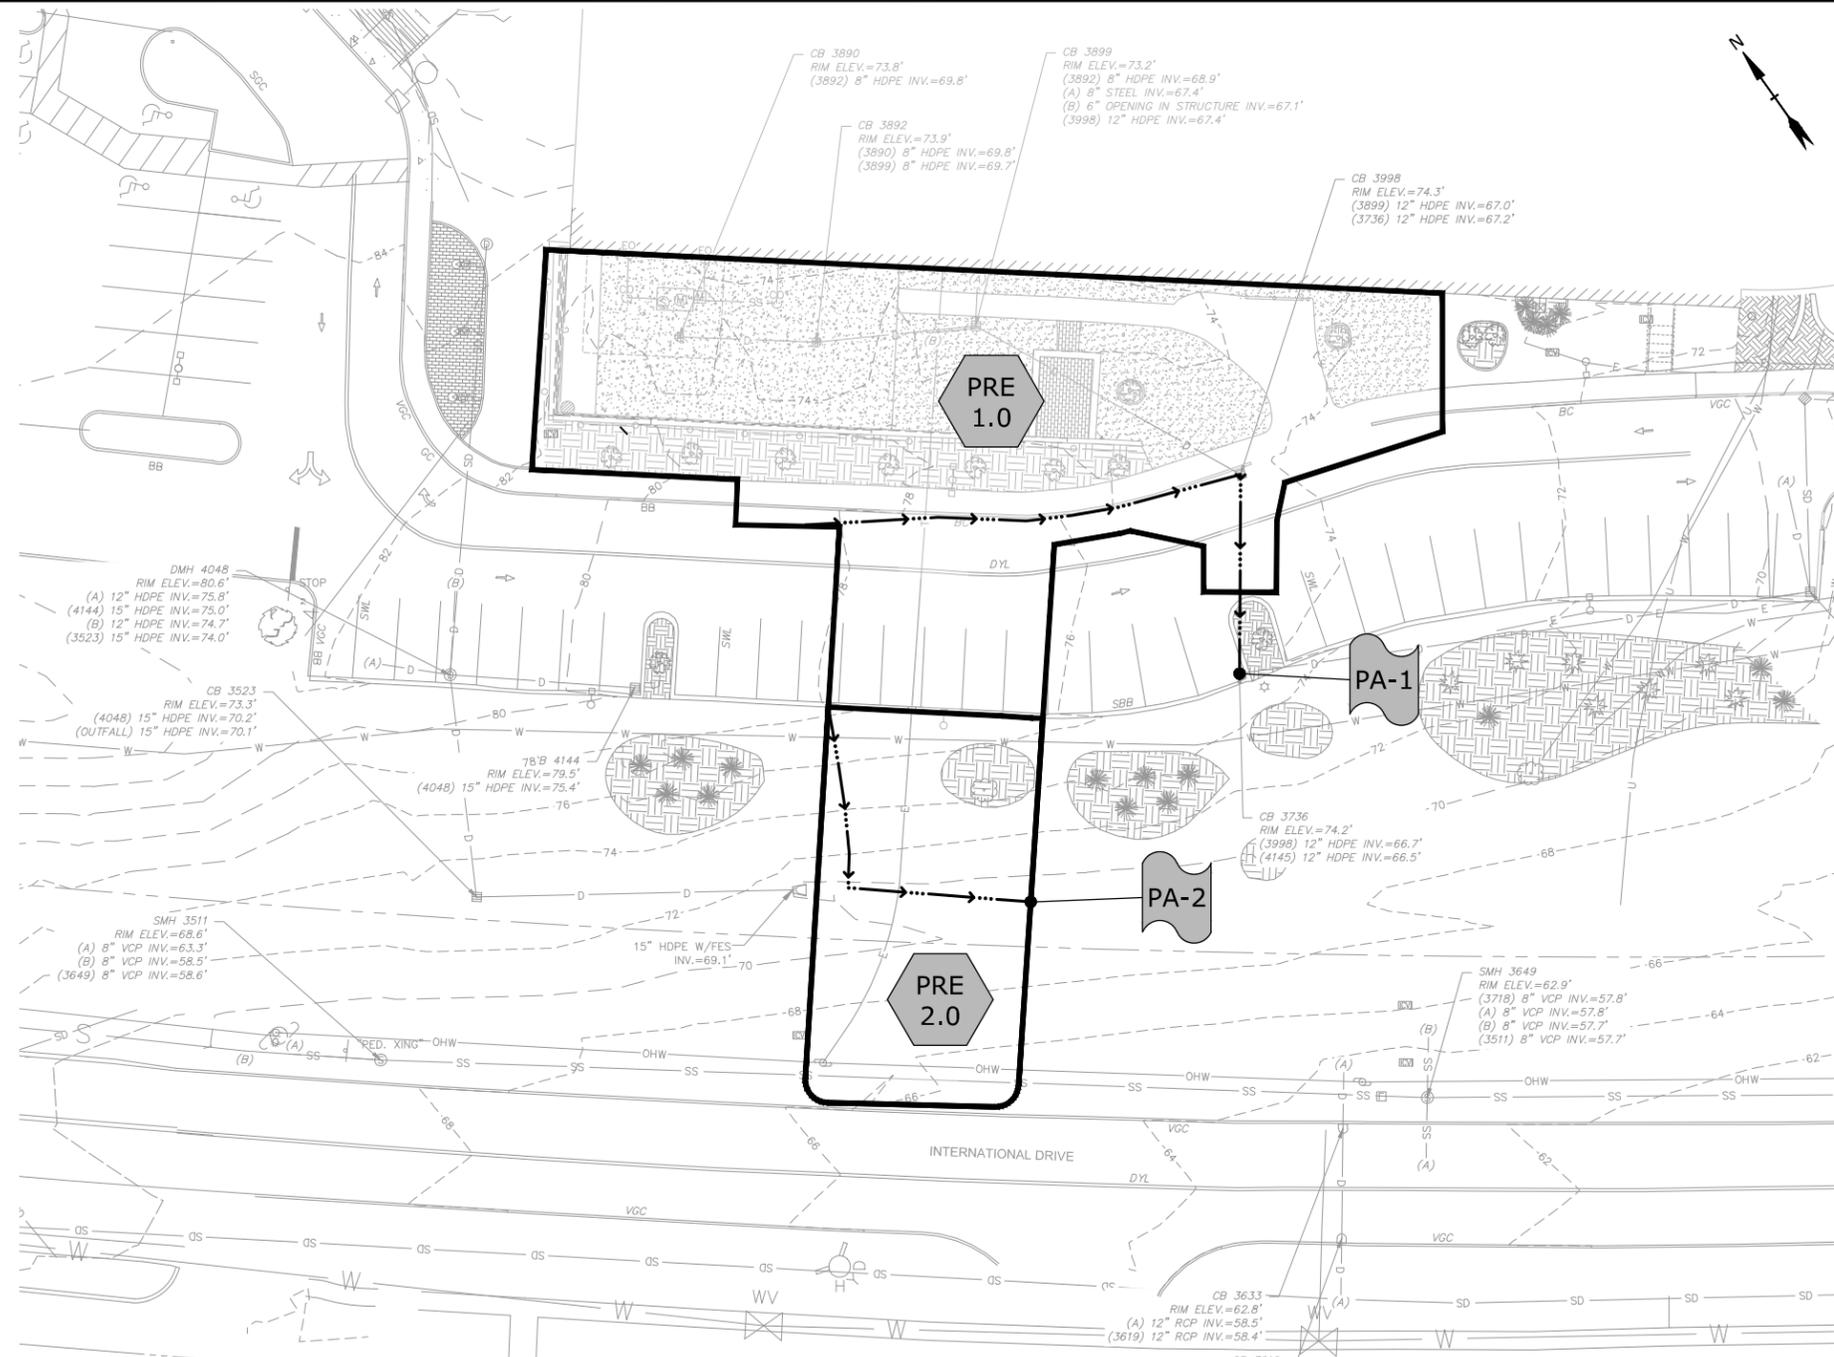

Cafe Expansion

Lonza Biologics

Portsmouth,
New Hampshire


MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission

PROJECT NO: L-0700-023
DATE: June 27, 2022
FILE: L-0700-023-C-DSGN,DWG
DRAWN BY: CIK/NHW
CHECKED BY: NAH
APPROVED BY: PMC


PRE-DEVELOPMENT WATERSHED PLAN

SCALE: AS SHOWN



C-801

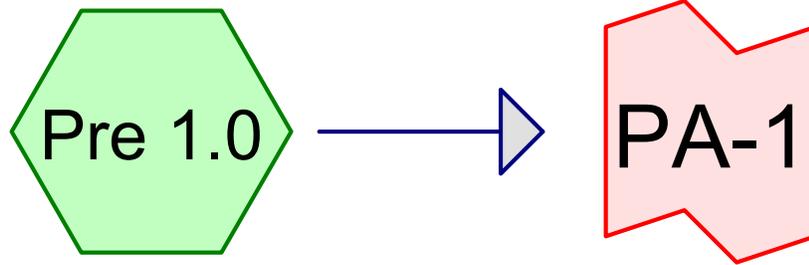

Point of Analysis 1

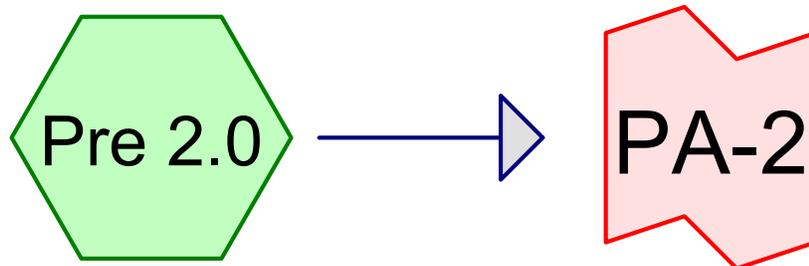

Point of Analysis 1



Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
5,410	80	>75% Grass cover, Good, HSG D (Pre 1.0, Pre 2.0)
2,569	96	Gravel surface, HSG D (Pre 1.0)
8,240	98	Paved parking, HSG D (Pre 1.0)
16,219	92	TOTAL AREA

Soil Listing (all nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
0	HSG A	
0	HSG B	
0	HSG C	
16,219	HSG D	Pre 1.0, Pre 2.0
0	Other	
16,219		TOTAL AREA

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentPre 1.0: Runoff Area=12,215 sf 67.46% Impervious Runoff Depth>3.22"
Flow Length=139' Tc=5.0 min CN=96 Runoff=0.98 cfs 3,279 cf

SubcatchmentPre 2.0: Runoff Area=4,004 sf 0.00% Impervious Runoff Depth>1.78"
Flow Length=79' Tc=5.0 min CN=80 Runoff=0.19 cfs 594 cf

Link PA-1: Point of Analysis 1 Inflow=0.98 cfs 3,279 cf
Primary=0.98 cfs 3,279 cf

Link PA-2: Point of Analysis 1 Inflow=0.19 cfs 594 cf
Primary=0.19 cfs 594 cf

Total Runoff Area = 16,219 sf Runoff Volume = 3,873 cf Average Runoff Depth = 2.87"
49.20% Pervious = 7,979 sf 50.80% Impervious = 8,240 sf

L-0700-023-PRE

Type III 24-hr 10 Year Storm Rainfall=5.59"

Prepared by Tighe & Bond

Printed 7/21/2022

HydroCAD® 10.00-20 s/n 03436 © 2017 HydroCAD Software Solutions LLC

Page 5

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentPre 1.0: Runoff Area=12,215 sf 67.46% Impervious Runoff Depth>5.12"
Flow Length=139' Tc=5.0 min CN=96 Runoff=1.52 cfs 5,208 cf

SubcatchmentPre 2.0: Runoff Area=4,004 sf 0.00% Impervious Runoff Depth>3.41"
Flow Length=79' Tc=5.0 min CN=80 Runoff=0.37 cfs 1,138 cf

Link PA-1: Point of Analysis 1 Inflow=1.52 cfs 5,208 cf
Primary=1.52 cfs 5,208 cf

Link PA-2: Point of Analysis 1 Inflow=0.37 cfs 1,138 cf
Primary=0.37 cfs 1,138 cf

Total Runoff Area = 16,219 sf Runoff Volume = 6,347 cf Average Runoff Depth = 4.70"
49.20% Pervious = 7,979 sf 50.80% Impervious = 8,240 sf

Summary for Subcatchment Pre 1.0:

[49] Hint: Tc<2dt may require smaller dt

Runoff = 1.52 cfs @ 12.07 hrs, Volume= 5,208 cf, Depth> 5.12"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs
Type III 24-hr 10 Year Storm Rainfall=5.59"

Area (sf)	CN	Description
1,406	80	>75% Grass cover, Good, HSG D
2,569	96	Gravel surface, HSG D
8,240	98	Paved parking, HSG D
12,215	96	Weighted Average
3,975		32.54% Pervious Area
8,240		67.46% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	96	0.0410	1.95		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.68"
0.1	43	0.0116	6.35	4.99	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.010
0.9	139	Total, Increased to minimum Tc = 5.0 min			

Summary for Subcatchment Pre 2.0:

[49] Hint: Tc<2dt may require smaller dt

Runoff = 0.37 cfs @ 12.08 hrs, Volume= 1,138 cf, Depth> 3.41"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs
Type III 24-hr 10 Year Storm Rainfall=5.59"

Area (sf)	CN	Description
4,004	80	>75% Grass cover, Good, HSG D
4,004		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.7	39	0.2051	0.38		Sheet Flow, Grass: Short n= 0.150 P2= 3.68"
0.5	40	0.0089	1.42		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
2.2	79	Total, Increased to minimum Tc = 5.0 min			

Summary for Link PA-1: Point of Analysis 1

Inflow Area = 12,215 sf, 67.46% Impervious, Inflow Depth > 5.12" for 10 Year Storm event
Inflow = 1.52 cfs @ 12.07 hrs, Volume= 5,208 cf
Primary = 1.52 cfs @ 12.07 hrs, Volume= 5,208 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs

Summary for Link PA-2: Point of Analysis 1

Inflow Area = 4,004 sf, 0.00% Impervious, Inflow Depth > 3.41" for 10 Year Storm event
Inflow = 0.37 cfs @ 12.08 hrs, Volume= 1,138 cf
Primary = 0.37 cfs @ 12.08 hrs, Volume= 1,138 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentPre 1.0: Runoff Area=12,215 sf 67.46% Impervious Runoff Depth>6.60"
Flow Length=139' Tc=5.0 min CN=96 Runoff=1.94 cfs 6,719 cf

SubcatchmentPre 2.0: Runoff Area=4,004 sf 0.00% Impervious Runoff Depth>4.77"
Flow Length=79' Tc=5.0 min CN=80 Runoff=0.51 cfs 1,590 cf

Link PA-1: Point of Analysis 1 Inflow=1.94 cfs 6,719 cf
Primary=1.94 cfs 6,719 cf

Link PA-2: Point of Analysis 1 Inflow=0.51 cfs 1,590 cf
Primary=0.51 cfs 1,590 cf

Total Runoff Area = 16,219 sf Runoff Volume = 8,309 cf Average Runoff Depth = 6.15"
49.20% Pervious = 7,979 sf 50.80% Impervious = 8,240 sf

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentPre 1.0: Runoff Area=12,215 sf 67.46% Impervious Runoff Depth>8.01"
Flow Length=139' Tc=5.0 min CN=96 Runoff=2.34 cfs 8,149 cf

SubcatchmentPre 2.0: Runoff Area=4,004 sf 0.00% Impervious Runoff Depth>6.08"
Flow Length=79' Tc=5.0 min CN=80 Runoff=0.65 cfs 2,029 cf

Link PA-1: Point of Analysis 1 Inflow=2.34 cfs 8,149 cf
Primary=2.34 cfs 8,149 cf


Link PA-2: Point of Analysis 1 Inflow=0.65 cfs 2,029 cf
Primary=0.65 cfs 2,029 cf

Total Runoff Area = 16,219 sf Runoff Volume = 10,179 cf Average Runoff Depth = 7.53"
49.20% Pervious = 7,979 sf 50.80% Impervious = 8,240 sf



LEGEND

- POST-DEVELOPMENT WATERSHED BOUNDARY
- LONGEST FLOW PATH
- PRE-DEVELOPMENT WATERSHED AREA DESIGNATION
- POST-DEVELOPMENT POND DESIGNATION
- POINT OF ANALYSIS



Cafe Expansion

Lonza Biologics

Portsmouth, New Hampshire

MARK	DATE	DESCRIPTION
A	7/21/2022	PB Submission






PROJECT NO: L-0700-023
 DATE: June 27, 2022
 FILE: L-0700-023-C-DSGN.DWG
 DRAWN BY: CIK/NHW
 CHECKED BY: NAH
 APPROVED BY: PMC

POST-DEVELOPMENT WATERSHED PLAN

SCALE: AS SHOWN

C-802

Last Saved: 7/21/2022 10:33am By: CKZcaik
 Plotted On: Jul 21, 2022 10:33am
 Title & Content: L-0700 Lonza Biologics Expansion was 1576F1023_Cafe Expansion\Drawings_Figures\AutoCAD\L-0700-023-C-DSGN.dwg

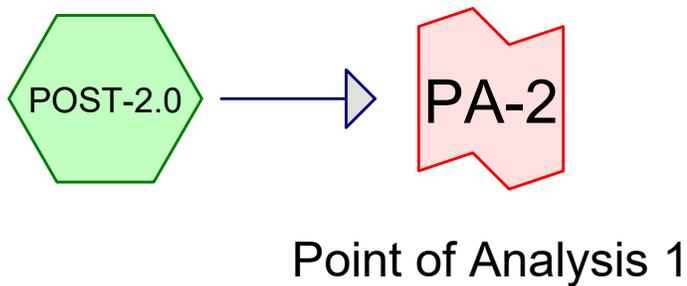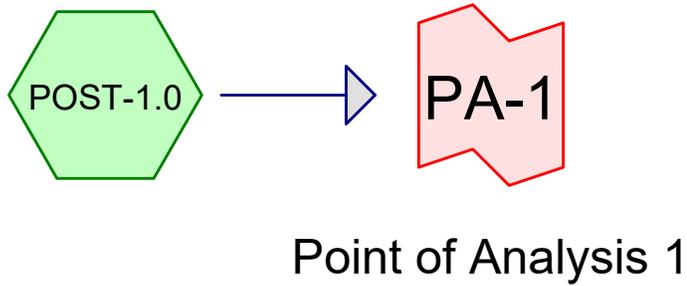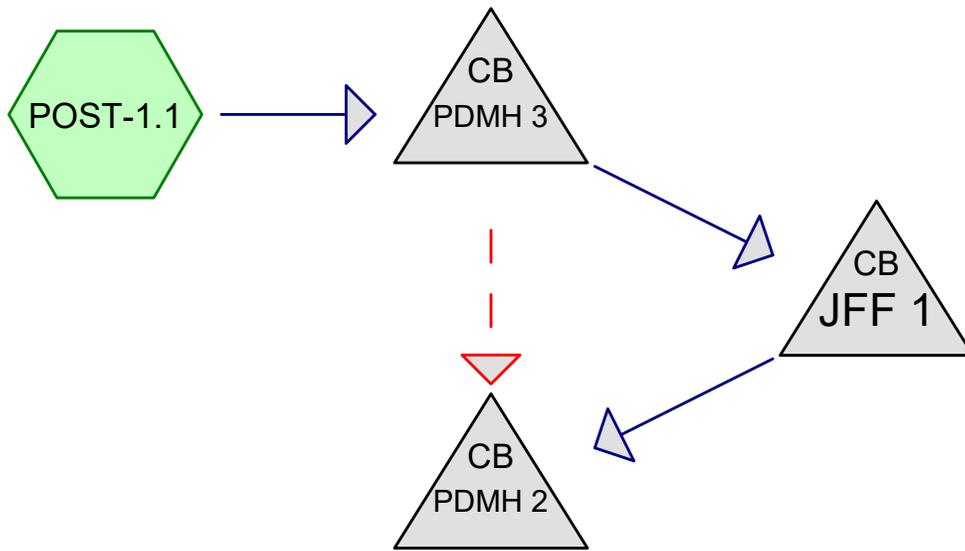

L-0700-023-POST

Prepared by Tighe & Bond

HydroCAD® 10.00-20 s/n 03436 © 2017 HydroCAD Software Solutions LLC

Printed 7/21/2022

Page 2

Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
5,701	80	>75% Grass cover, Good, HSG D (POST-1.0, POST-1.1, POST-2.0)
5,628	98	Paved parking, HSG D (POST-1.0, POST-1.1)
4,890	98	Roofs, HSG D (POST-1.1)
16,219	92	TOTAL AREA

L-0700-023-POST

Prepared by Tighe & Bond

HydroCAD® 10.00-20 s/n 03436 © 2017 HydroCAD Software Solutions LLC

Printed 7/21/2022

Page 3

Soil Listing (all nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
0	HSG A	
0	HSG B	
0	HSG C	
16,219	HSG D	POST-1.0, POST-1.1, POST-2.0
0	Other	
16,219		TOTAL AREA

L-0700-023-POST

Type III 24-hr 2 Year Storm Rainfall=3.68"

Prepared by Tighe & Bond

Printed 7/21/2022

HydroCAD® 10.00-20 s/n 03436 © 2017 HydroCAD Software Solutions LLC

Page 4

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentPOST-1.0: Runoff Area=5,120 sf 77.97% Impervious Runoff Depth>3.01"
Flow Length=139' Tc=5.0 min CN=94 Runoff=0.40 cfs 1,284 cf

SubcatchmentPOST-1.1: Runoff Area=7,095 sf 91.98% Impervious Runoff Depth>3.33"
Flow Length=200' Tc=5.0 min CN=97 Runoff=0.58 cfs 1,970 cf

SubcatchmentPOST-2.0: Runoff Area=4,004 sf 0.00% Impervious Runoff Depth>1.78"
Flow Length=79' Tc=5.0 min CN=80 Runoff=0.19 cfs 594 cf

Pond JFF 1: Peak Elev=68.01' Inflow=0.58 cfs 1,970 cf
12.0" Round Culvert n=0.013 L=4.0' S=0.0125 '/ Outflow=0.58 cfs 1,970 cf

Pond PDMH 2: Peak Elev=67.88' Inflow=0.58 cfs 1,970 cf
12.0" Round Culvert n=0.013 L=12.0' S=0.0250 '/ Outflow=0.58 cfs 1,970 cf

Pond PDMH 3: Peak Elev=69.08' Inflow=0.58 cfs 1,970 cf
Primary=0.58 cfs 1,970 cf Secondary=0.00 cfs 0 cf Outflow=0.58 cfs 1,970 cf

Link PA-1: Point of Analysis 1 Inflow=0.98 cfs 3,254 cf
Primary=0.98 cfs 3,254 cf

Link PA-2: Point of Analysis 1 Inflow=0.19 cfs 594 cf
Primary=0.19 cfs 594 cf

Total Runoff Area = 16,219 sf Runoff Volume = 3,848 cf Average Runoff Depth = 2.85"
35.15% Pervious = 5,701 sf 64.85% Impervious = 10,518 sf

L-0700-023-POST

Type III 24-hr 10 Year Storm Rainfall=5.59"

Prepared by Tighe & Bond

Printed 7/21/2022

HydroCAD® 10.00-20 s/n 03436 © 2017 HydroCAD Software Solutions LLC

Page 5

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentPOST-1.0: Runoff Area=5,120 sf 77.97% Impervious Runoff Depth>4.89"
Flow Length=139' Tc=5.0 min CN=94 Runoff=0.63 cfs 2,086 cf

SubcatchmentPOST-1.1: Runoff Area=7,095 sf 91.98% Impervious Runoff Depth>5.23"
Flow Length=200' Tc=5.0 min CN=97 Runoff=0.89 cfs 3,094 cf

SubcatchmentPOST-2.0: Runoff Area=4,004 sf 0.00% Impervious Runoff Depth>3.41"
Flow Length=79' Tc=5.0 min CN=80 Runoff=0.37 cfs 1,138 cf

Pond JFF 1: Peak Elev=68.13' Inflow=0.85 cfs 3,081 cf
12.0" Round Culvert n=0.013 L=4.0' S=0.0125 '/ Outflow=0.85 cfs 3,081 cf

Pond PDMH 2: Peak Elev=67.98' Inflow=0.89 cfs 3,094 cf
12.0" Round Culvert n=0.013 L=12.0' S=0.0250 '/ Outflow=0.89 cfs 3,094 cf

Pond PDMH 3: Peak Elev=69.21' Inflow=0.89 cfs 3,094 cf
Primary=0.85 cfs 3,081 cf Secondary=0.04 cfs 12 cf Outflow=0.89 cfs 3,094 cf

Link PA-1: Point of Analysis 1 Inflow=1.52 cfs 5,180 cf
Primary=1.52 cfs 5,180 cf

Link PA-2: Point of Analysis 1 Inflow=0.37 cfs 1,138 cf
Primary=0.37 cfs 1,138 cf

Total Runoff Area = 16,219 sf Runoff Volume = 6,318 cf Average Runoff Depth = 4.67"
35.15% Pervious = 5,701 sf 64.85% Impervious = 10,518 sf

L-0700-023-POST

Type III 24-hr 10 Year Storm Rainfall=5.59"

Prepared by Tighe & Bond

Printed 7/21/2022

HydroCAD® 10.00-20 s/n 03436 © 2017 HydroCAD Software Solutions LLC

Page 6

Summary for Subcatchment POST-1.0:

[49] Hint: Tc<2dt may require smaller dt

Runoff = 0.63 cfs @ 12.07 hrs, Volume= 2,086 cf, Depth> 4.89"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs
Type III 24-hr 10 Year Storm Rainfall=5.59"

Area (sf)	CN	Description
1,128	80	>75% Grass cover, Good, HSG D
* 0	89	Gravel roads, HSG D
3,992	98	Paved parking, HSG D
5,120	94	Weighted Average
1,128		22.03% Pervious Area
3,992		77.97% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	96	0.0410	1.95		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.68"
0.1	43	0.0116	6.35	4.99	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.010
0.9	139	Total, Increased to minimum Tc = 5.0 min			

Summary for Subcatchment POST-1.1:

[49] Hint: Tc<2dt may require smaller dt

Runoff = 0.89 cfs @ 12.07 hrs, Volume= 3,094 cf, Depth> 5.23"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs
Type III 24-hr 10 Year Storm Rainfall=5.59"

Area (sf)	CN	Description
569	80	>75% Grass cover, Good, HSG D
* 0	89	Gravel roads, HSG D
1,636	98	Paved parking, HSG D
4,890	98	Roofs, HSG D
7,095	97	Weighted Average
569		8.02% Pervious Area
6,526		91.98% Impervious Area

L-0700-023-POST

Type III 24-hr 10 Year Storm Rainfall=5.59"

Prepared by Tighe & Bond

Printed 7/21/2022

HydroCAD® 10.00-20 s/n 03436 © 2017 HydroCAD Software Solutions LLC

Page 7

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0	100	0.0050	0.85		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.68"
0.2	12	0.0050	1.14		Shallow Concentrated Flow, Unpaved Kv= 16.1 fps
0.1	38	0.0250	8.26	4.50	Pipe Channel, 10.0" Round Area= 0.5 sf Perim= 2.6' r= 0.21' n= 0.010
0.1	50	0.0170	5.91	4.65	Pipe Channel, 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.013
2.4	200	Total, Increased to minimum Tc = 5.0 min			

Summary for Subcatchment POST-2.0:

[49] Hint: Tc<2dt may require smaller dt

Runoff = 0.37 cfs @ 12.08 hrs, Volume= 1,138 cf, Depth> 3.41"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs
Type III 24-hr 10 Year Storm Rainfall=5.59"

Area (sf)	CN	Description
4,004	80	>75% Grass cover, Good, HSG D
4,004		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.7	39	0.2051	0.38		Sheet Flow, Grass: Short n= 0.150 P2= 3.68"
0.5	40	0.0089	1.42		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
2.2	79	Total, Increased to minimum Tc = 5.0 min			

Summary for Pond JFF 1:

Inflow Area = 7,095 sf, 91.98% Impervious, Inflow Depth > 5.21" for 10 Year Storm event
 Inflow = 0.85 cfs @ 12.07 hrs, Volume= 3,081 cf
 Outflow = 0.85 cfs @ 12.07 hrs, Volume= 3,081 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.85 cfs @ 12.07 hrs, Volume= 3,081 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs
 Peak Elev= 68.13' @ 12.09 hrs
 Flood Elev= 73.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	67.55'	12.0" Round Culvert L= 4.0' Ke= 0.500 Inlet / Outlet Invert= 67.55' / 67.50' S= 0.0125 ' / Cc= 0.900 n= 0.013, Flow Area= 0.79 sf

Primary OutFlow Max=0.74 cfs @ 12.07 hrs HW=68.11' TW=67.97' (Dynamic Tailwater)

↑1=Culvert (Outlet Controls 0.74 cfs @ 2.35 fps)

Summary for Pond PDMH 2:

Inflow Area = 7,095 sf, 91.98% Impervious, Inflow Depth > 5.23" for 10 Year Storm event
 Inflow = 0.89 cfs @ 12.07 hrs, Volume= 3,094 cf
 Outflow = 0.89 cfs @ 12.07 hrs, Volume= 3,094 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.89 cfs @ 12.07 hrs, Volume= 3,094 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs
 Peak Elev= 67.98' @ 12.07 hrs
 Flood Elev= 73.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	67.50'	12.0" Round Culvert L= 12.0' Ke= 0.500 Inlet / Outlet Invert= 67.50' / 67.20' S= 0.0250 '/ Cc= 0.900 n= 0.013, Flow Area= 0.79 sf

Primary OutFlow Max=0.86 cfs @ 12.07 hrs HW=67.97' TW=0.00' (Dynamic Tailwater)

↑1=Culvert (Inlet Controls 0.86 cfs @ 2.34 fps)

Summary for Pond PDMH 3:

Inflow Area = 7,095 sf, 91.98% Impervious, Inflow Depth > 5.23" for 10 Year Storm event
 Inflow = 0.89 cfs @ 12.07 hrs, Volume= 3,094 cf
 Outflow = 0.89 cfs @ 12.07 hrs, Volume= 3,094 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.85 cfs @ 12.07 hrs, Volume= 3,081 cf
 Secondary = 0.04 cfs @ 12.07 hrs, Volume= 12 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs
 Peak Elev= 69.21' @ 12.07 hrs
 Flood Elev= 73.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	68.60'	10.0" Round Culvert L= 4.0' Ke= 0.500 Inlet / Outlet Invert= 68.60' / 68.55' S= 0.0125 '/ Cc= 0.900 n= 0.013, Flow Area= 0.55 sf
#2	Secondary	69.10'	10.0" Round Culvert L= 6.0' Ke= 0.500 Inlet / Outlet Invert= 69.10' / 68.85' S= 0.0417 '/ Cc= 0.900 n= 0.013, Flow Area= 0.55 sf

Primary OutFlow Max=0.82 cfs @ 12.07 hrs HW=69.19' TW=68.11' (Dynamic Tailwater)

↑1=Culvert (Barrel Controls 0.82 cfs @ 2.78 fps)

Secondary OutFlow Max=0.04 cfs @ 12.07 hrs HW=69.19' TW=67.97' (Dynamic Tailwater)

↑2=Culvert (Inlet Controls 0.04 cfs @ 1.04 fps)

Summary for Link PA-1: Point of Analysis 1

Inflow Area = 12,215 sf, 86.11% Impervious, Inflow Depth > 5.09" for 10 Year Storm event
Inflow = 1.52 cfs @ 12.07 hrs, Volume= 5,180 cf
Primary = 1.52 cfs @ 12.07 hrs, Volume= 5,180 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs

Summary for Link PA-2: Point of Analysis 1

Inflow Area = 4,004 sf, 0.00% Impervious, Inflow Depth > 3.41" for 10 Year Storm event
Inflow = 0.37 cfs @ 12.08 hrs, Volume= 1,138 cf
Primary = 0.37 cfs @ 12.08 hrs, Volume= 1,138 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.05 hrs

L-0700-023-POST

Type III 24-hr 25 Year Storm Rainfall=7.08"

Prepared by Tighe & Bond

Printed 7/21/2022

HydroCAD® 10.00-20 s/n 03436 © 2017 HydroCAD Software Solutions LLC

Page 10

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentPOST-1.0: Runoff Area=5,120 sf 77.97% Impervious Runoff Depth>6.36"
Flow Length=139' Tc=5.0 min CN=94 Runoff=0.80 cfs 2,716 cf

SubcatchmentPOST-1.1: Runoff Area=7,095 sf 91.98% Impervious Runoff Depth>6.72"
Flow Length=200' Tc=5.0 min CN=97 Runoff=1.13 cfs 3,972 cf

SubcatchmentPOST-2.0: Runoff Area=4,004 sf 0.00% Impervious Runoff Depth>4.77"
Flow Length=79' Tc=5.0 min CN=80 Runoff=0.51 cfs 1,590 cf

Pond JFF 1: Peak Elev=68.21' Inflow=1.02 cfs 3,929 cf
12.0" Round Culvert n=0.013 L=4.0' S=0.0125 '/ Outflow=1.02 cfs 3,929 cf

Pond PDMH 2: Peak Elev=68.06' Inflow=1.13 cfs 3,972 cf
12.0" Round Culvert n=0.013 L=12.0' S=0.0250 '/ Outflow=1.13 cfs 3,972 cf

Pond PDMH 3: Peak Elev=69.28' Inflow=1.13 cfs 3,972 cf
Primary=1.02 cfs 3,929 cf Secondary=0.12 cfs 44 cf Outflow=1.13 cfs 3,972 cf

Link PA-1: Point of Analysis 1 Inflow=1.94 cfs 6,688 cf
Primary=1.94 cfs 6,688 cf

Link PA-2: Point of Analysis 1 Inflow=0.51 cfs 1,590 cf
Primary=0.51 cfs 1,590 cf

Total Runoff Area = 16,219 sf Runoff Volume = 8,278 cf Average Runoff Depth = 6.12"
35.15% Pervious = 5,701 sf 64.85% Impervious = 10,518 sf

L-0700-023-POST

Type III 24-hr 50 Year Storm Rainfall=8.49"

Prepared by Tighe & Bond

Printed 7/21/2022

HydroCAD® 10.00-20 s/n 03436 © 2017 HydroCAD Software Solutions LLC

Page 11

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentPOST-1.0: Runoff Area=5,120 sf 77.97% Impervious Runoff Depth>7.77"
Flow Length=139' Tc=5.0 min CN=94 Runoff=0.97 cfs 3,313 cf

SubcatchmentPOST-1.1: Runoff Area=7,095 sf 91.98% Impervious Runoff Depth>8.13"
Flow Length=200' Tc=5.0 min CN=97 Runoff=1.36 cfs 4,805 cf

SubcatchmentPOST-2.0: Runoff Area=4,004 sf 0.00% Impervious Runoff Depth>6.08"
Flow Length=79' Tc=5.0 min CN=80 Runoff=0.65 cfs 2,029 cf

Pond JFF 1: Peak Elev=68.27' Inflow=1.16 cfs 4,717 cf
12.0" Round Culvert n=0.013 L=4.0' S=0.0125 '/ Outflow=1.16 cfs 4,717 cf

Pond PDMH 2: Peak Elev=68.12' Inflow=1.36 cfs 4,805 cf
12.0" Round Culvert n=0.013 L=12.0' S=0.0250 '/ Outflow=1.36 cfs 4,805 cf

Pond PDMH 3: Peak Elev=69.33' Inflow=1.36 cfs 4,805 cf
Primary=1.16 cfs 4,717 cf Secondary=0.20 cfs 88 cf Outflow=1.36 cfs 4,805 cf

Link PA-1: Point of Analysis 1 Inflow=2.33 cfs 8,118 cf
Primary=2.33 cfs 8,118 cf

Link PA-2: Point of Analysis 1 Inflow=0.65 cfs 2,029 cf
Primary=0.65 cfs 2,029 cf

Total Runoff Area = 16,219 sf Runoff Volume = 10,147 cf Average Runoff Depth = 7.51"
35.15% Pervious = 5,701 sf 64.85% Impervious = 10,518 sf

2.1 Peak Rate Comparisons

The following table summarizes and compares the pre- and post-development peak runoff rates for the 2-year, 10-year, 25-year and 50-year storm events at each point of analysis. Point of Analysis 1 (PA1) is located at the inlet of the existing closed drainage system and Point of Analysis 2 (PA2) is located along International Drive.

Point of Analysis	Pre/ Post 2-Year Storm (cfs)	Pre/ Post 10-Year Storm (cfs)	Pre/ Post 25-Year Storm (cfs)	Pre/ Post 50-Year Storm (cfs)
PA1	0.98/0.98	1.52/ 1.52	1.94/ 1.94	2.34/ 2.33
PA2	0.19/ 0.19	0.37/ 0.37	0.51/ 0.51	0.65/ 0.65

2.2 Stormwater Treatment

The stormwater management system has been designed to provide stormwater treatment to meet NHDES AoT Regulations as required by the Pease Development Authority. Stormwater treatment for the development area is detailed below.

Runoff generated from the proposed impervious areas within the café expansion will be treated by a Contech Jellyfish Filter filtration system. The Jellyfish Filter was sized to treat the Water Quality Flow (WQF), as shown in Table 2.2. The Jellyfish Filter Design Summary prepared by Contech Engineered Solutions is also provided. The subcatchment area (POST-1.1) for this expansion can be referenced on the post-development watershed plan (Sheet C-802).

Table 2.2 - Treatment Area Proposed Filtration System Water Quality Flow Calculations		
VARIABLE	DESCRIPTION	VALUE
P	1 Inch of Rainfall	1 inch
A	Total Area Draining to Design Structure	0.16 AC
A _i	Impervious Area Draining to Design Structure	0.15 AC
I	% Impervious Area Draining to Design Structures	94%
R _v	Runoff Coefficient, $R_v = 0.05 + (0.9 \cdot I)$	0.89
WQV	Water Quality Volume, $WQV = P \cdot A \cdot R_v$	519 cf
T _c	Time of Concentration (min.)	5.0
q _u	Unit Peak Discharge (cfs/mi ² /in)	655
WQF	Total Treatment Flow, $WQF = WQV \cdot q_u$	0.146 cfs

2.3 Contech Sizing Memo



CONTECH Stormwater Solutions Inc. Engineer:
Date Prepared:

DRA
6/16/2022

Site Information

Project Name	Lonza Biologics - Café Expansion
Project State	NH
Project City	Portsmouth
Site Designation	JF-1
Total Drainage Area, Ad	0.16 ac
Post Development Impervious Area, Ai	0.15 ac
Pervious Area, Ap	0.01 ac
% Impervious	94%
Runoff Coefficient, Rc	0.89

Mass Loading Calculations

Mean Annual Rainfall, P	50 in
Agency Required % Removal	80%
Percent Runoff Capture	90%
Mean Annual Runoff, Vt	29,040 ft³
Event Mean Concentration of Pollutant, EMC	75 mg/l
Annual Mass Load, M total	136 lbs

Filter System

Filtration Brand	Jelly Fish
Cartridge Length	54 in

Jelly Fish Sizing Parameters

Water Quality Flow to be treated by Filter Vault	0.15 cfs
--	-----------------



Method to Use

FLOW BASED

Summary		
Flow	Required Size	JF4-1-1
	Treatment Flow Rate provided:	0.27 cfs

3.0 Conclusion

The proposed project will result in no change to the post-development peak runoff rates from the pre-development condition. The net increase in impervious areas resulting from the proposed project and an equivalent amount of existing impervious area will be treated as required by the Pease Development Authority. The proposed stormwater filtration system will treat the surface runoff from the expansion area prior to discharging to the existing on-site stormwater system.

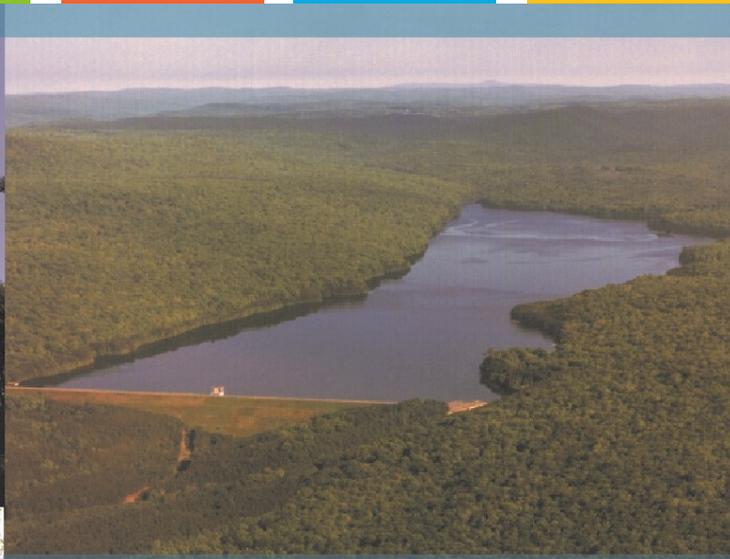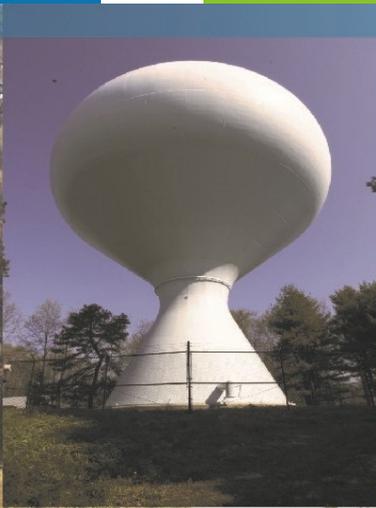

Café Expansion Project
101 International Drive
Portsmouth, NH

Long-Term Operation & Maintenance Plan

Lonza Biologics

June 21, 2022

Tighe&Bond

Section 1 Long-Term Operation & Maintenance Plan

1.1 Contact/Responsible Party1-1

1.2 Maintenance Items1-1

1.3 Overall Site Operation & Maintenance Schedule1-2

 1.3.1 Disposal Requirements.....1-2

1.4 Contech Jellyfish Filter System Maintenance Requirements.....1-3

1.5 Snow & Ice Management for Standard Asphalt and Walkways.....1-4

Section 2 Chloride Management Plan

2.1 Background Information.....2-1

2.2 Operational Guidelines – Chloride Management.....2-1

 2.2.1 Winter Operator Certification Requirements2-1

 2.2.2 Improved Weather Monitoring.....2-2

 2.2.3 Equipment Calibration Requirements2-2

 2.2.4 Increased Mechanical Removal Capabilities.....2-2

2.3 Salt Usage Evaluation and Monitoring2-3

2.4 Summary2-3

Section 3 Invasive Species

Section 4 Annual Updates and Log Requirements

Section 1

Long-Term Operation & Maintenance Plan

It is the intent of this Operation and Maintenance Plan to identify the areas of this site that need special attention and consideration, as well as implementing a plan to assure routine maintenance. By identifying the areas of concern as well as implementing a frequent and routine maintenance schedule the site will maintain a high-quality stormwater runoff.

1.1 Contact/Responsible Party

Lonza Biologics
101 International Drive
Portsmouth, NH 03801

(Note: The contact information for the Contact/Responsible Party shall be kept current. If ownership changes, the Operation and Maintenance Plan must be transferred to the new party.)

1.2 Maintenance Items

Maintenance of the following items shall be recorded:

- Litter/Debris Removal
- Landscaping
- Catchbasin Cleaning
- Pavement Sweeping
- Contech Jellyfish Filtration System

The following maintenance items and schedule represent the minimum action required. Periodic site inspections shall be conducted, and all measures must be maintained in effective operating condition. The following items shall be observed during site inspection and maintenance:

- Inspect vegetated areas, particularly slopes and embankments for areas of erosion. Replant and restore as necessary
- Inspect catch basins for sediment buildup
- Inspect site for trash and debris

1.3 Overall Site Operation & Maintenance Schedule

Maintenance Item	Frequency of Maintenance
Litter/Debris Removal	Weekly
Pavement Sweeping - Sweep impervious areas to remove sand and litter.	Annually
Landscaping - Landscaped islands to be maintained and mulched.	Maintained as required and mulched each Spring
Catch Basin (CB) Cleaning - CB to be cleaned of solids and oils.	Annually
Contech Jelly Fish Units	In accordance with Manufacturer's Recommendations

1.3.1 Disposal Requirements

Disposal of debris, trash, sediment and other waste material should be done at suitable disposal/recycling sites and in compliance with all applicable local, state and federal waste regulations.

1.4 Contech Jellyfish Filter System Maintenance Requirements

Contech Jellyfish Filter System Inspection/Maintenance Requirements		
Inspection/ Maintenance	Frequency	Action
Inspect vault for sediment build up, static water, plugged media and bypass condition	One (1) time annually and after any rainfall event exceeding 2.5" in a 24-hr period	Maintenance required for any of the following: - >4" of sediment on the vault floor - >1/4" of sediment on top of the cartridge - .4" of static water above the cartridge bottom more than 24 hours after a rain event - If pore space between media is absent. - If vault is in bypass condition during an average rainfall event.
Replace Cartridges	As required by inspection, 1-5 years.	- Remove filter cartridges per manufacturer methods. - Vacuum sediment from vault. - Install new cartridges per manufacturer methods

**Jellyfish[®] Filter
Owner's Manual**



Table of Contents


Chapter 1	1.0 Owner Specific Jellyfish Product Information.....	4
Chapter 2	2.0 Jellyfish Filter System Operations & Functions	5
	2.1 Components & Cartridges	6
	2.2 Jellyfish Membrane Filtration Cartridges Assembly	7
	2.3 Installation of Jellyfish Membrane Filtration Cartridges.....	7
Chapter 3	3.0 Inspection and Maintenance Overview	8
Chapter 4	4.0 Inspection Timing	8
Chapter 5	5.0 Inspection Procedure.....	8
	5.1 Dry Weather Inspections	8
	5.1 Wet Weather Inspections	9
Chapter 6	6.0 Maintenance Requirements.....	9
Chapter 7	7.0 Maintenance Procedure	9
	7.1 Filter Cartridge Removal	9
	7.2 Filter Cartridge Rinsing	9
	7.3 Sediment and Flotables Extraction	10
	7.4 Filter Cartridge Reinstallation and Replacement.....	10
	7.5 Chemical Spills.....	10
	5.6 Material Disposal	10
	Jellyfish Filter Inspection and Maintenance Log	12

THANK YOU FOR PURCHASING THE JELLYFISH® FILTER!

Contech Engineered Solutions would like to thank you for selecting the Jellyfish Filter to meet your project’s stormwater treatment needs. With proper inspection and maintenance, the Jellyfish Filter is designed to deliver ongoing, high levels of stormwater pollutant removal.

If you have any questions, please feel free to call us or e-mail us:

Contech Engineered Solutions
9025 Centre Pointe Drive, Suite 400 | West Chester, OH 45069
513-645-7000 | 800-338-1122
www.ContechES.com
info@conteches.com

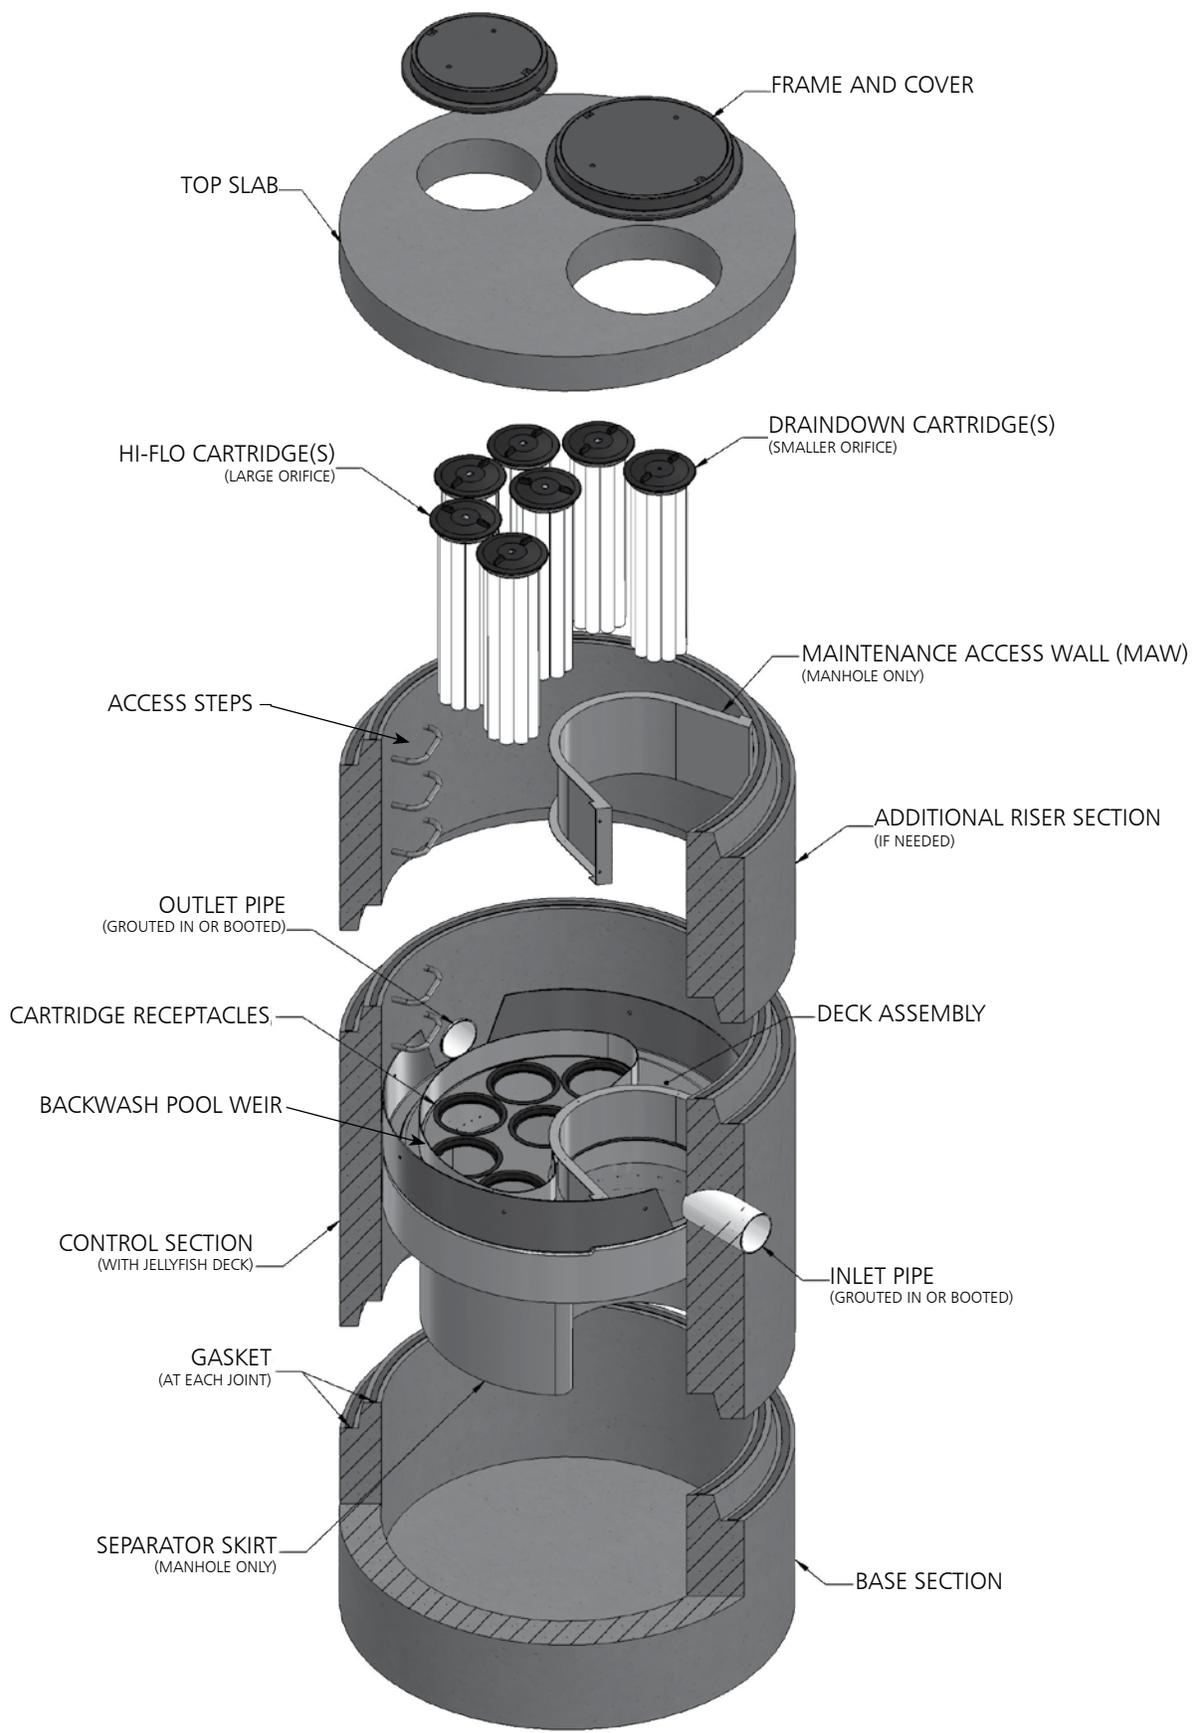

WARNINGS / CAUTION

1. FALL PROTECTION may be required.
2. WATCH YOUR STEP if standing on the Jellyfish Filter Deck at any time; Great care and safety must be taken while walking or maneuvering on the Jellyfish Filter Deck. Attentive care must be taken while standing on the Jellyfish Filter Deck at all times to prevent stepping onto a lid, into or through a cartridge hole or slipping on the deck.
3. The Jellyfish Filter Deck can be SLIPPERY WHEN WET.
4. If the Top Slab, Covers or Hatches have not yet been installed, or are removed for any reason, great care must be taken to NOT DROP ANYTHING ONTO THE JELLYFISH FILTER DECK. The Jellyfish Filter Deck and Cartridge Receptacle Rings can be damaged under high impact loads. This type of activity voids all warranties. All damaged items to be replaced at owner's expense.
5. Maximum deck load 2 persons, total weight 450 lbs.

Safety Notice

Jobsite safety is a topic and practice addressed comprehensively by others. The inclusions here are intended to be reminders to whole areas of Safety Practice that are the responsibility of the Owner(s), Manager(s) and Contractor(s). OSHA and Canadian OSH, and Federal, State/Provincial, and Local Jurisdiction Safety Standards apply on any given site or project. The knowledge and applicability of those responsibilities is the Contractor's responsibility and outside the scope of Contech Engineered Solutions.

Confined Space Entry

Secure all equipment and perform all training to meet applicable local and OSHA regulations regarding confined space entry. It is the Contractor's or entry personnel's responsibility to proceed safely at all times.

Personal Safety Equipment

Contractor is responsible to provide and wear appropriate personal protection equipment as needed including, but not limited to safety boots, hard hat, reflective vest, protective eyewear, gloves and fall protection equipment as necessary. Make sure all equipment is staffed with trained and/or certified personnel, and all equipment is checked for proper operation and safety features prior to use.

- Fall protection equipment
- Eye protection
- Safety boots
- Ear protection
- Gloves
- Ventilation and respiratory protection
- Hard hat
- Maintenance and protection of traffic plan

Chapter 1

1.0 – Owner Specific Jellyfish Filter Product Information

Below you will find a reference page that can be filled out according to your Jellyfish Filter specification to help you easily inspect, maintain and order parts for your system.

Owner Name:	
Phone Number:	
Site Address:	
Site GPS Coordinates/unit location:	
Unit Location Description:	
Jellyfish Filter Model No.:	
Contech Project & Sequence Number	
No. of Hi-Flo Cartridges	
No. of Cartridges:	
Length of Draindown Cartridges:	
No. of Blank Cartridge Lids:	
Bypass Configuration (Online/Offline):	


Notes:

Chapter 2

2.0 – Jellyfish Filter System Operations and Functions

The Jellyfish Filter is an engineered stormwater quality treatment technology that removes a high level and wide variety of stormwater pollutants. Each Jellyfish Filter cartridge consists of eleven membrane - encased filter elements (“filtration tentacles”) attached to a cartridge head plate. The filtration tentacles provide a large filtration surface area, resulting in high flow and high pollutant removal capacity.

The Jellyfish Filter functions are depicted in Figure 1 below.

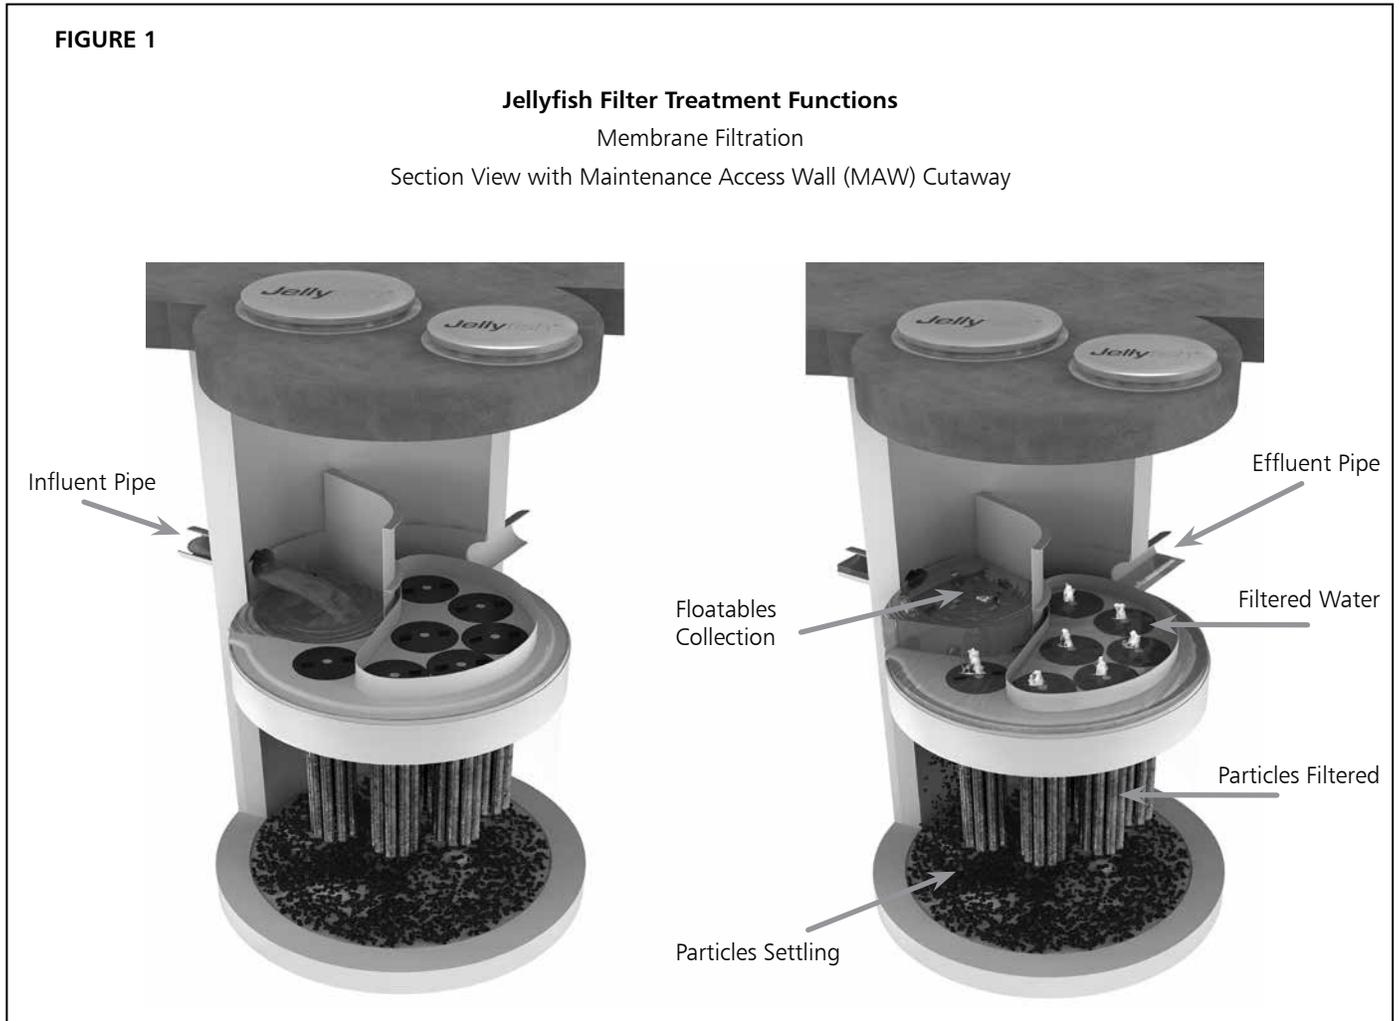

Jellyfish Filter cartridges are backwashed after each peak storm event, which removes accumulated sediment from the membranes. This backwash process extends the service life of the cartridges and increases the time between maintenance events.


For additional details on the operation and pollutant capabilities of the Jellyfish Filter please refer to additional details on our website at www.ContechES.com.

2.1 – Components and Cartridges

The Jellyfish Filter and components are depicted in Figure 2 below.

FIGURE 2

Jellyfish Filter Components

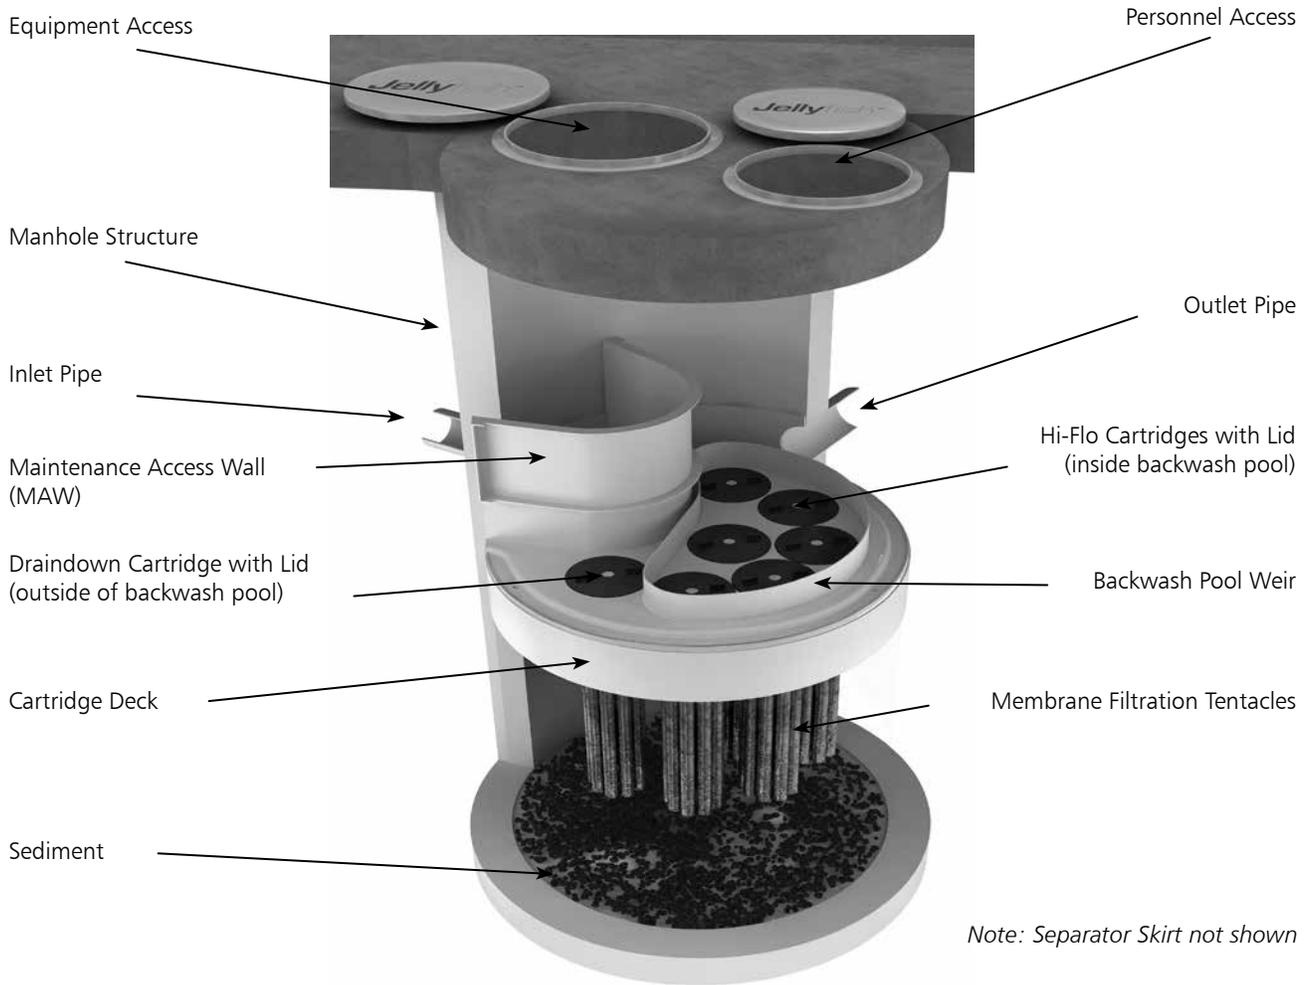

Tentacles are available in various lengths as depicted in Table 1 below.

Table 1 – Cartridge Lengths / Weights and Cartridge Lid Orifice Diameters

Cartridge Lengths	Dry Weight	Hi-Flo Orifice Diameter	Draindown Orifice Diameter
15 inches (381 mm)	10 lbs (4.5 kg)	35 mm	20 mm
27 inches (686 mm)	14.5 lbs (6.6 kg)	45 mm	25 mm
40 inches (1,016 mm)	19.5 lbs (8.9 kg)	55 mm	30 mm
54 inches (1,372 mm)	25 lbs (11.4 kg)	70 mm	35 mm

2.2 – Jellyfish Membrane Filtration Cartridge Assembly

The Jellyfish Filter utilizes multiple membrane filtration cartridges. Each cartridge consists of removable cylindrical filtration “tentacles” attached to a cartridge head plate. Each filtration tentacle has a threaded pipe nipple and o-ring. To attach, insert the top pipe nipples with the o-ring through the head plate holes and secure with locking nuts. Hex nuts to be hand tightened and checked with a wrench as shown below.

2.3 – Jellyfish Membrane Filtration Cartridge Installation

- Cartridge installation will be performed by trained individuals and coordinated with the installing site Contractor. Flow diversion devices are required to be in place until the site is stabilized (final paving and landscaping in place). Failure to address this step completely will reduce the time between required maintenance.
- Descend to the cartridge deck (see Safety Notice and page 3).
- Refer to Contech's submittal drawings to determine proper quantity and placement of Hi-Flo, Draindown and Blank cartridges with appropriate lids. Lower the Jellyfish membrane filtration cartridges into the cartridge receptacles within the cartridge deck. It is possible that not all cartridge receptacles will be filled with a filter cartridge. In that case, a blank headplate and blank cartridge lid (no orifice) would be installed.



Cartridge Assembly

Do not force the tentacles down into the cartridge receptacle, as this may damage the membranes. Apply downward pressure on the cartridge head plate to seat the lubricated rim gasket (thick circular gasket surrounding the circumference of the head plate) into the cartridge receptacle. (See Figure 3 for details on approved lubricants for use with rim gasket.)

- Examine the cartridge lids to differentiate lids with a small orifice, a large orifice, and no orifice.
 - Lids with a small orifice are to be inserted into the Draindown cartridge receptacles, outside of the backwash pool weir.
 - Lids with a large orifice are to be inserted into the Hi-Flo cartridge receptacles within the backwash pool weir.
 - Lids with no orifice (blank cartridge lids) and a blank headplate are to be inserted into unoccupied cartridge receptacles.
- To install a cartridge lid, align both cartridge lid male threads with the cartridge receptacle female threads before rotating approximately 1/3 of a full rotation until firmly seated. Use of an approved rim gasket lubricant may facilitate installation.

3.0 Inspection and Maintenance Overview

The primary purpose of the Jellyfish® Filter is to capture and remove pollutants from stormwater runoff. As with any filtration system, these pollutants must be removed to maintain the filter's maximum treatment performance. Regular inspection and maintenance are required to insure proper functioning of the system. Maintenance frequencies and requirements are site specific and vary depending on pollutant loading. Additional maintenance activities may be required in the event of non-storm event runoff, such as base-flow or seasonal flow, an upstream chemical spill or due to excessive sediment loading from site erosion or extreme runoff events. It is a good practice to inspect the system after major storm events.

Inspection activities are typically conducted from surface observations and include:


- Observe if standing water is present
- Observe if there is any physical damage to the deck or cartridge lids
- Observe the amount of debris in the Maintenance Access Wall (MAW) or inlet bay for vault systems

Maintenance activities include:

- Removal of oil, floatable trash and debris
- Removal of collected sediments
- Rinsing and re-installing the filter cartridges
- Replace filter cartridge tentacles, as needed

4.0 Inspection Timing

Inspection of the Jellyfish Filter is key in determining the maintenance requirements for, and to develop a history of, the site's pollutant loading characteristics. In general, inspections should be performed at the times indicated below; *or per the approved project stormwater quality documents (if applicable), whichever is more frequent.*

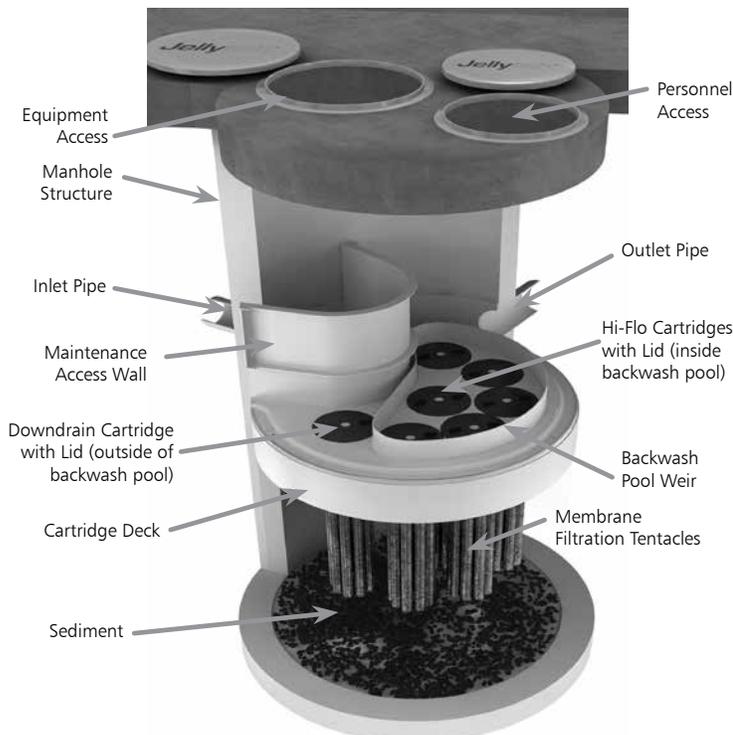

Note: Separator Skirt not shown

1. A minimum of quarterly inspections during the first year of operation to assess the sediment and floatable pollutant accumulation, and to ensure proper functioning of the system.
2. Inspection frequency in subsequent years is based on the inspection and maintenance plan developed in the first year of operation. Minimum frequency should be once per year.
3. Inspection is recommended after each major storm event.
4. Inspection is required immediately after an upstream oil, fuel or other chemical spill.


5.0 Inspection Procedure

The following procedure is recommended when performing inspections:

1. Provide traffic control measures as necessary.
2. Inspect the MAW or inlet bay for floatable pollutants such as trash, debris, and oil sheen.
3. Measure oil and sediment depth in several locations, by lowering a sediment probe until contact is made with the floor of the structure. Record sediment depth, and presences of any oil layers.
4. Inspect cartridge lids. Missing or damaged cartridge lids to be replaced.
5. Inspect the MAW (where appropriate), cartridge deck and receptacles, and backwash pool weir, for damaged or broken components.

5.1 Dry weather inspections

- Inspect the cartridge deck for standing water, and/or sediment on the deck.
- No standing water under normal operating conditions.
- Standing water inside the backwash pool, but not outside the backwash pool indicates, that the filter cartridges need to be rinsed.

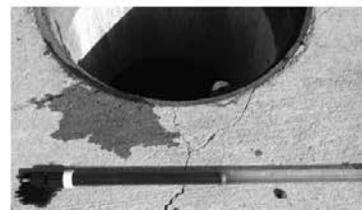

Inspection Utilizing Sediment Probe

- Standing water outside the backwash pool is not anticipated and may indicate a backwater condition caused by high water elevation in the receiving water body, or possibly a blockage in downstream infrastructure.
- Any appreciable sediment ($\geq 1/16''$) accumulated on the deck surface should be removed.

5.2 Wet weather inspections

- Observe the rate and movement of water in the unit. Note the depth of water above deck elevation within the MAW or inlet bay.
- Less than 6 inches, flow should be exiting the cartridge lids of each of the draindown cartridges (i.e. cartridges located outside the backwash pool).
- Greater than 6 inches, flow should be exiting the cartridge lids of each of the draindown cartridges and each of the hi-flo cartridges (i.e. cartridges located inside the backwash pool), and water should be overflowing the backwash pool weir.
- 18 inches or greater and relatively little flow is exiting the cartridge lids and outlet pipe, this condition indicates that the filter cartridges need to be rinsed.

6.0 Maintenance Requirements

Required maintenance for the Jellyfish Filter is based upon results of the most recent inspection, historical maintenance records, or the site specific water quality management plan; whichever is more frequent. In general, maintenance requires some combination of the following:

1. Sediment removal for depths reaching 12 inches or greater, or within 3 years of the most recent sediment cleaning, whichever occurs sooner.
2. Floatable trash, debris, and oil removal.
3. Deck cleaned and free from sediment.
4. Filter cartridges rinsed and re-installed as required by the most recent inspection results, or within 12 months of the most recent filter rinsing, whichever occurs sooner.
5. Replace tentacles if rinsing does not restore adequate hydraulic capacity, remove accumulated sediment, or if damaged or missing. It is recommended that tentacles should remain in service no longer than 5 years before replacement.
6. Damaged or missing cartridge deck components must be repaired or replaced as indicated by results of the most recent inspection.
7. The unit must be cleaned out and filter cartridges inspected immediately after an upstream oil, fuel, or chemical spill. Filter cartridge tentacles should be replaced if damaged or compromised by the spill.

7.0 Maintenance Procedure

The following procedures are recommended when maintaining the Jellyfish Filter:

1. Provide traffic control measures as necessary.
2. Open all covers and hatches. Use ventilation equipment as required, according to confined space entry procedures. *Caution: Dropping objects onto the cartridge deck may cause damage.*
3. Perform Inspection Procedure prior to maintenance activity.

4. To access the cartridge deck for filter cartridge service, descend into the structure and step directly onto the deck. *Caution: Do not step onto the maintenance access wall (MAW) or backwash pool weir, as damage may result. Note that the cartridge deck may be slippery.*
5. Maximum weight of maintenance crew and equipment on the cartridge deck not to exceed 450 lbs.

7.1 Filter Cartridge Removal

1. Remove a cartridge lid.
2. Remove cartridges from the deck using the lifting loops in the cartridge head plate. Rope or a lifting device (available from Contech) should be used. *Caution: Should a snag occur, do not force the cartridge upward as damage to the tentacles may result. Wet cartridges typically weigh between 100 and 125 lbs.*
3. Replace and secure the cartridge lid on the exposed empty receptacle as a safety precaution. Contech does not recommend exposing more than one empty cartridge receptacle at a time.

7.2 Filter Cartridge Rinsing

1. Remove all 11 tentacles from the cartridge head plate. Take care not to lose or damage the O-ring seal as well as the plastic threaded nut and connector.
2. Position tentacles in a container (or over the MAW), with the



Cartridge Removal & Lifting Device



threaded connector (open end) facing down, so rinse water is flushed through the membrane and captured in the container.

3. Using the Jellyfish rinse tool (available from Contech) or a low-pressure garden hose sprayer, direct water spray onto the tentacle membrane, sweeping from top to bottom along the length of the tentacle. Rinse until all sediment is removed from the membrane. *Caution: Do not use a high pressure sprayer or focused stream of water on the membrane. Excessive water pressure may damage the membrane.*
4. Collected rinse water is typically removed by vacuum hose.

5. Reassemble cartridges as detailed later in this document. Reuse O-rings and nuts, ensuring proper placement on each tentacle.

7.3 Sediment and Floatables Extraction

1. Perform vacuum cleaning of the Jellyfish Filter only after filter cartridges have been removed from the system. Access the lower chamber for vacuum cleaning only through the maintenance access wall (MAW) opening. Be careful not to damage the flexible plastic separator skirt that is attached to the underside of the deck on manhole systems. Do not lower the vacuum wand through a cartridge receptacle, as damage to the receptacle will result.
2. Vacuum floatable trash, debris, and oil, from the MAW opening or inlet bay. Alternatively, floatable solids may be removed by a net or skimmer.
3. Pressure wash cartridge deck and receptacles to remove all



Rinsing Cartridge with Contech Rinse Tool

sediment and debris. Sediment should be rinsed into the sump area. Take care not to flush rinse water into the outlet pipe.

4. Remove water from the sump area. Vacuum or pump equipment should only be introduced through the MAW or inlet bay.
5. Remove the sediment from the bottom of the unit through the MAW or inlet bay opening.
6. For larger diameter Jellyfish Filter manholes (≥ 8 -ft) and some



Vacuuming Sump Through MAW

vaults complete sediment removal may be facilitated by removing a cartridge lid from an empty receptacle and inserting a jetting wand (not a vacuum wand) through the receptacle. Use the sprayer to rinse loosened sediment toward the vacuum hose in the MAW opening, being careful not to damage the receptacle.

7.4 Filter Cartridge Reinstallation and Replacement

1. Cartridges should be installed after the deck has been cleaned. It is important that the receptacle surfaces be free from grit and debris.
2. Remove cartridge lid from deck and carefully lower the filter cartridge into the receptacle until head plate gasket is seated squarely in receptacle. *Caution: Do not force the cartridge downward; damage may occur.*
3. Replace the cartridge lid and check to see that both male threads are properly seated before rotating approximately 1/3 of a full rotation until firmly seated. Use of an approved rim gasket lubricant may facilitate installation. See next page for additional details.
4. If rinsing is ineffective in removing sediment from the tentacles, or if tentacles are damaged, provisions must be made to replace the spent or damaged tentacles with new tentacles. Contact Contech to order replacement tentacles.

7.5 Chemical Spills

Caution: If a chemical spill has been captured, do not attempt maintenance. Immediately contact the local hazard response agency and contact Contech.

7.6 Material Disposal

The accumulated sediment found in stormwater treatment and conveyance systems must be handled and disposed of in accordance with regulatory protocols. It is possible for sediments to contain measurable concentrations of heavy metals and organic chemicals (such as pesticides and petroleum products). Areas with the greatest potential for high pollutant loading include industrial areas and heavily traveled roads. Sediments and water must be disposed of in accordance with all applicable waste disposal regulations. When scheduling maintenance, consideration must be made for the disposal of solid and liquid wastes. This typically requires coordination with a local landfill for solid waste disposal. For liquid waste disposal a number of options are available including a municipal vacuum truck decant facility, local waste water treatment plant or on-site treatment and discharge.

Jellyfish Filter Components & Filter Cartridge Assembly and Installation

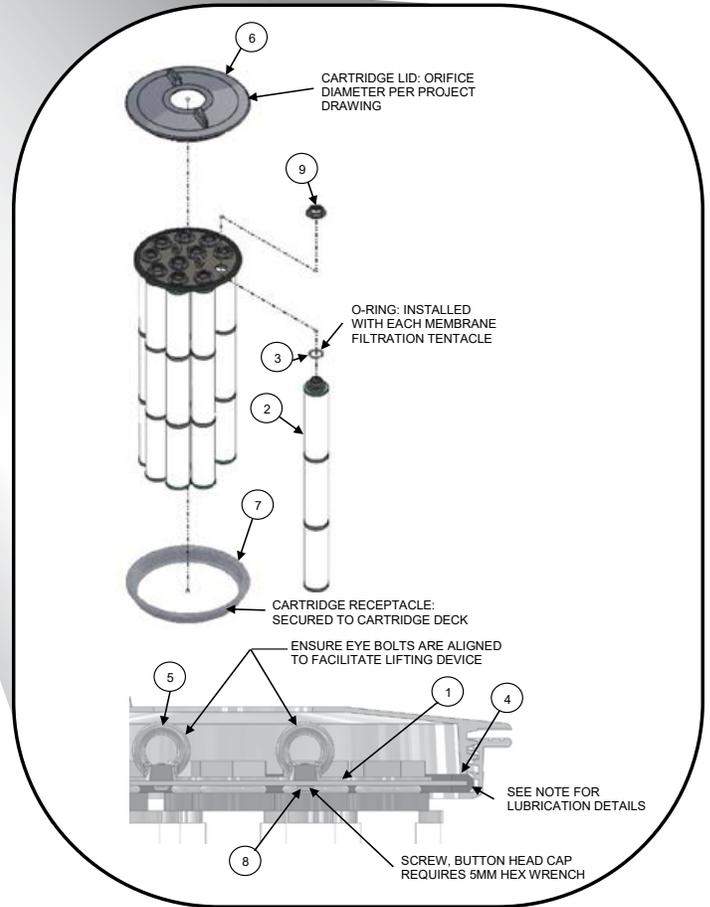
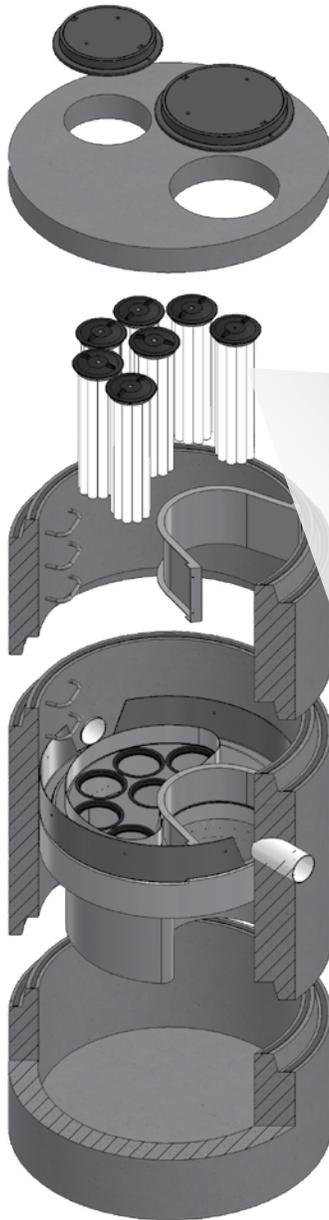


TABLE 1: BOM

ITEM NO.	DESCRIPTION
1	JF HEAD PLATE
2	JF TENTACLE
3	JF O-RING
4	JF HEAD PLATE GASKET
5	JF CARTRIDGE EYELET
6	JF 14IN COVER
7	JF RECEPTACLE
8	BUTTON HEAD CAP SCREW M6X14MM SS
9	JF CARTRIDGE NUT

TABLE 2: APPROVED GASKET LUBRICANTS

PART NO.	MFR	DESCRIPTION
78713	LA-CO	LUBRI-JOINT
40501	HERCULES	DUCK BUTTER
30600	OATEY	PIPE LUBRICANT
PSLUBXL1Q	PROSELECT	PIPE JOINT LUBRICANT

NOTES:

Head Plate Gasket Installation:

Install Head Plate Gasket (Item 4) onto the Head Plate (Item 1) and liberally apply a lubricant from Table 2: Approved Gasket Lubricants onto the gasket where it contacts the Receptacle (Item 7) and Cartridge Lid (Item 6). Follow Lubricant manufacturer's instructions.

Lid Assembly:

Rotate Cartridge Lid counter-clockwise until both male threads drop down and properly seat. Then rotate Cartridge Lid clock-wise approximately one-third of a full rotation until Cartridge Lid is firmly secured, creating a watertight seal.

Jellyfish Filter Inspection and Maintenance Log

Owner: _____ Jellyfish Model No.: _____

Location: _____ GPS Coordinates: _____

Land Use: Commercial: _____ Industrial: _____ Service Station: _____

 Road/Highway: _____ Airport: _____ Residential: _____ Parking Lot: _____

Date/Time:					
Inspector:					
Maintenance Contractor:					
Visible Oil Present: (Y/N)					
Oil Quantity Removed					
Floatable Debris Present: (Y/N)					
Floatable Debris removed: (Y/N)					
Water Depth in Backwash Pool					
Cartridges externally rinsed/re-commissioned: (Y/N)					
New tentacles put on Cartridges: (Y/N)					
Sediment Depth Measured: (Y/N)					
Sediment Depth (inches or mm):					
Sediment Removed: (Y/N)					
Cartridge Lids intact: (Y/N)					
Observed Damage:					
Comments:					

1.5 Snow & Ice Management for Standard Asphalt and Walkways

Snow storage areas shall be located such that no direct untreated discharges are possible to receiving waters from the storage site. Salt storage areas shall be covered or located such that no direct untreated discharges are possible to receiving waters from the storage site. Salt and sand shall be used to the minimum extent practical (refer to the attached for de-icing application rate guideline from the New Hampshire Stormwater Management Manual, Volume 2,).

Deicing Application Rate Guidelines

24' of pavement (typical two-lane road)

These rates are not fixed values, but rather the middle of a range to be selected and adjusted by an agency according to its local conditions and experience.

Pavement Temp. (°F) and Trend (↑↓)	Weather Condition	Maintenance Actions	Pounds per two-lane mile			
			Salt Prewetted / Pretreated with Salt Brine	Salt Prewetted / Pretreated with Other Blends	Dry Salt*	Winter Sand (abrasives)
> 30° ↑	Snow	Plow, treat intersections only	80	70	100*	Not recommended
	Freezing Rain	Apply Chemical	80 - 160	70 - 140	100 - 200*	Not recommended
30° ↓	Snow	Plow and apply chemical	80 - 160	70 - 140	100 - 200*	Not recommended
	Freezing Rain	Apply Chemical	150 - 200	130 - 180	180 - 240*	Not recommended
25° - 30° ↑	Snow	Plow and apply chemical	120 - 160	100 - 140	150 - 200*	Not recommended
	Freezing Rain	Apply Chemical	150 - 200	130 - 180	180 - 240*	Not recommended
25° - 30° ↓	Snow	Plow and apply chemical	120 - 160	100 - 140	150 - 200*	Not recommended
	Freezing Rain	Apply Chemical	160 - 240	140 - 210	200 - 300*	400
20° - 25° ↑	Snow or Freezing Rain	Plow and apply chemical	160 - 240	140 - 210	200 - 300*	400
20° - 25° ↓	Snow	Plow and apply chemical	200 - 280	175 - 250	250 - 350*	Not recommended
	Freezing Rain	Apply Chemical	240 - 320	210 - 280	300 - 400*	400
15° - 20° ↑	Snow	Plow and apply chemical	200 - 280	175 - 250	250 - 350*	Not recommended
	Freezing Rain	Apply Chemical	240 - 320	210 - 280	300 - 400*	400
15° - 20° ↓	Snow or Freezing Rain	Plow and apply chemical	240 - 320	210 - 280	300 - 400*	500 for freezing rain
0° - 15° ↑↓	Snow	Plow, treat with blends, sand hazardous areas	Not recommended	300 - 400	Not recommended	500 - 750 spot treatment as needed
< 0°	Snow	Plow, treat with blends, sand hazardous areas	Not recommended	400 - 600**	Not recommended	500 - 750 spot treatment as needed

* Dry salt is not recommended. It is likely to blow off the road before it melts ice.

** A blend of 6 - 8 gal/ton MgCl₂ or CaCl₂ added to NaCl can melt ice as low as -10°.

Anti-icing Route Data Form				
Truck Station:				
Date:				
Air Temperature	Pavement Temperature	Relative Humidity	Dew Point	Sky
Reason for applying:				
Route:				
Chemical:				
Application Time:				
Application Amount:				
Observation (first day):				
Observation (after event):				
Observation (before next application):				
Name:				

Section 2

Chloride Management Plan

Winter Operational Guidelines

The following Chloride Management Plan is for the Lonza Biologics – Lynx Parking Expansion in Portsmouth, New Hampshire. The Plan includes operational guidelines including: winter operator certification requirements, weather monitoring, equipment calibration requirements, mechanical removal, and salt usage evaluation and monitoring. Due to the evolving nature of chloride management efforts, the Chlorides Management Plan will be reviewed annually, in advance of the winter season, to reflect the current management standards.

2.1 Background Information

The Lonza Biologics – Lynx Parking Expansion located within the Upper Hodgson Brook Watershed in Newington and Portsmouth, New Hampshire. The Upper Hodgson Brook is identified as a chloride-impaired waterbody.

2.2 Operational Guidelines – Chloride Management

All Lonza Biologics private contractors engaged at the Lonza Biologics premises for the purposes of winter operational snow removal and surface maintenance, are responsible for assisting in meeting compliance for the following protocols. Lonza Biologics private contractors are expected to minimize the effects of the use of de-icing, anti-icing and pretreatment materials by adhering to the strict guidelines outlined below.

The Lonza Biologics winter operational de-icing, anti-icing and pretreatment materials will adhere to the following protocols:

2.2.1 Winter Operator Certification Requirements

All private contractors engaged at the Lonza Biologics premises for the purpose of winter operational snow removal and surface maintenance must be current UNHT2 Green SnowPro Certified operators or equivalent and will use only pre-approved methods for spreading abrasives on private roadways and parking lots. All private contractors engaged at the Lonza Biologics premises for the purpose of winter operational snow removal and surface maintenance shall provide to Lonza Biologics management two copies of the annual UNHT2 Green SnowPro certificate or equivalent for each operator utilized on the Lonza Biologics premises. The annual UNHT2 Green SnowPro certificate or equivalent for each operator will be available on file in the Lonza Biologics Facilities Management office and be present in the vehicle/carrier at all times.

2.2.2 Improved Weather Monitoring

Lonza Biologics will coordinate weather information for use by winter maintenance contractors. This information in conjunction with site specific air/ground surface temperature monitoring will ensure that private contractors engaged at the Lonza Biologics premises for the purpose of winter operational snow removal and surface maintenance will make more informed decisions as to when and to what extent de-icing, anti-icing and pretreatment materials are applied to private roadways, sidewalks, and parking lots.

2.2.3 Equipment Calibration Requirements

All equipment utilized on the Lonza Biologics premises for the purpose of winter operational snow removal and surface maintenance will conform to the following calibration requirements.

2.2.3.1 Annual Calibration Requirements

All private contractors engaged at the Lonza Biologics premises for the purpose of winter operational snow removal and surface maintenance shall provide two copies of the annual calibration report for each piece of equipment utilized on the Lonza Biologics premises. Each calibration report shall include the vehicle/carrier VIN number and the serial numbers for each component including, but not limited to, spreader control units, salt aggregate spreader equipment, brining/pre-wetting equipment, ground speed orientation unit, and air/ground surface temperature monitor. Annual calibration reports will be available on file in the Lonza Biologics Facilities Management office and be present in the vehicle/carrier at all times.

Prior to each use, each vehicle/carrier operator will perform a systems check to verify that unit settings remain within the guidelines established by the Lonza Biologics Management Team in order to accurately dispense material. All private contractors engaged at the Lonza Biologics premises for the purpose of winter operational snow removal and surface maintenance will be subject to spot inspections by members of the Lonza Biologics Management Team to ensure that each vehicle/carrier is operating in a manner consistent with the guidelines set herein or State and Municipal regulations. All units will be recalibrated, and the updated calibration reports will be provided each time repairs or maintenance procedures affect the hydraulic system of the vehicle/carrier.

2.2.4 Increased Mechanical Removal Capabilities

All private contractors engaged at the Lonza Biologics premises will endeavor to use mechanical removal means on a more frequent basis for roadways, parking lots and sidewalks. Dedicating more manpower and equipment to increase snow removal frequencies prevents the buildup of snow and the corresponding need for de-icing, anti-icing and pretreatment materials. Shortened maintenance

routes, with shorter service intervals, will be used to stay ahead of snowfall. Minimized snow and ice packing will reduce the need for abrasives, salt aggregates, and/or brining solution to restore surfaces back to bare surface states after winter precipitation events.

After storm events the Lonza Biologics management team will be responsible for having the streets swept to recapture un-melted de-icing materials, when practical.

2.3 Salt Usage Evaluation and Monitoring

All private contractors engaged at the Lonza Biologics premises for the purpose of winter operational snow removal and surface maintenance shall provide two copies of a storm report, which includes detailed information regarding treatment areas and the use of de-icing, anti-icing and pretreatment materials applied for the removal of snow and surface maintenance on the Lonza Biologics premises. Lonza Biologics will maintain copies of Summary Documents, including copies of the Storm Reports, operator certifications, equipment used for roadway and sidewalk winter maintenance, calibration reports and amount of de-icing materials used.

2.4 Summary

The above-described methodologies are incorporated into the Lonza Biologics Operational Manual and are to be used to qualify and retain all private contractors engaged at the Lonza Biologics premises for the purpose of winter operational snow removal and surface maintenance. This section of the Manual, is intended to be an adaptive management document that is modified as required based on experience gained from past practices and technological advancements that reflect chloride BMP standards. All Lonza Biologics employees directly involved with winter operational activities are required to review this document and the current standard Best Management Practices published by the UNH Technology Transfer (T2) program annually. All Lonza Biologics employees directly involved with winter operational activities, and all private contractors engaged at the Lonza Biologics premises for the purposes of winter operational snow removal and surface maintenance, must be current UNHT2 Green SnowPro Certified operators or equivalent and undergo the necessary requirements to maintain this certification annually.


Section 3

Invasive Species

With respect to a particular ecosystem, any species, including its seeds, eggs, spores, or other biological material capable of propagating that species, that is not native to that ecosystem is classified as an invasive species. Refer to the following fact sheet prepared by the University of New Hampshire Cooperative Extension entitled Methods for Disposing Non-Native Invasive Plants for recommended methods to dispose of invasive plant species.



Prepared by the Invasives Species Outreach Group, volunteers interested in helping people control invasive plants. Assistance provided by the Piscataquog Land Conservancy and the NH Invasives Species Committee. Edited by Karen Bennett, Extension Forestry Professor and Specialist.

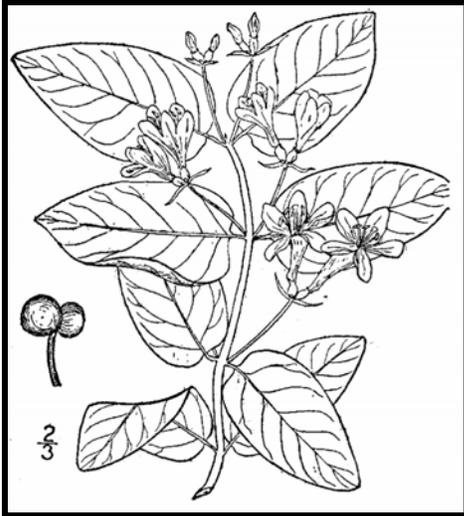

Tatarian honeysuckle

Lonicera tatarica

USDA-NRCS PLANTS Database / Britton, N.L., and A. Brown. 1913. *An illustrated flora of the northern United States, Canada and the British Possessions*. Vol. 3: 282.

Non-native invasive plants crowd out natives in natural and managed landscapes. They cost taxpayers billions of dollars each year from lost agricultural and forest crops, decreased biodiversity, impacts to natural resources and the environment, and the cost to control and eradicate them.

Invasive plants grow well even in less than desirable conditions such as sandy soils along roadsides, shaded wooded areas, and in wetlands. In ideal conditions, they grow and spread even faster. There are many ways to remove these non-native invasives, but once removed, care is needed to dispose the removed plant material so the plants don't grow where disposed.

Knowing how a particular plant reproduces indicates its method of spread and helps determine

the appropriate disposal method. Most are spread by seed and are dispersed by wind, water, animals, or people. Some reproduce by vegetative means from pieces of stems or roots forming new plants. Others spread through both seed and vegetative means.

Because movement and disposal of viable plant parts is restricted (see NH Regulations), viable invasive parts can't be brought to most transfer stations in the state. Check with your transfer station to see if there is an approved, designated area for invasives disposal. This fact sheet gives recommendations for rendering plant parts non-viable.

Control of invasives is beyond the scope of this fact sheet. For information about control visit www.nhinvasives.org or contact your UNH Cooperative Extension office.

New Hampshire Regulations

Prohibited invasive species shall only be disposed of in a manner that renders them nonliving and nonviable. (Agr. 3802.04)

No person shall collect, transport, import, export, move, buy, sell, distribute, propagate or transplant any living and viable portion of any plant species, which includes all of their cultivars and varieties, listed in Table 3800.1 of the New Hampshire prohibited invasive species list. (Agr 3802.01)

How and When to Dispose of Invasives?

To prevent seed from spreading remove invasive plants before seeds are set (produced). Some plants continue to grow, flower and set seed even after pulling or cutting. Seeds can remain viable in the ground for many years. If the plant has flowers or seeds, place the flowers and seeds in a heavy plastic bag “head first” at the weeding site and transport to the disposal site. The following are general descriptions of disposal methods. See the chart for recommendations by species.

Burning: Large woody branches and trunks can be used as firewood or burned in piles. For outside burning, a written fire permit from the local forest fire warden is required unless the ground is covered in snow. Brush larger than 5 inches in diameter can't be burned. Invasive plants with easily airborne seeds like black swallow-wort with mature seed pods (indicated by their brown color) shouldn't be burned as the seeds may disperse by the hot air created by the fire.

Bagging (solarization): Use this technique with softer-tissue plants. Use heavy black or clear plastic bags (contractor grade), making sure that no parts of the plants poke through. Allow the bags to sit in the sun for several weeks and on dark pavement for the best effect.

Tarping and Drying: Pile material on a sheet of plastic and cover with a tarp, fastening the tarp to the ground and monitoring it for escapes. Let the material dry for several weeks, or until it is clearly nonviable.

Chipping: Use this method for woody plants that don't reproduce vegetatively.

Burying: This is risky, but can be done with watchful diligence. Lay thick plastic in a deep pit before placing the cut up plant material in the hole. Place the material away from the edge of the plastic before covering it with more heavy plastic. Eliminate as much air as possible and toss in soil to weight down the material in the pit. Note that the top of the buried material should be at least three feet underground. Japanese knotweed should be at least 5 feet underground!

Drowning: Fill a large barrel with water and place soft-tissue plants in the water. Check after a few weeks and look for rotted plant material (roots, stems, leaves, flowers). Well-rotted plant material may be composted. A word of caution- seeds may still be viable after using this method. Do this before seeds are set. This method isn't used often. Be prepared for an awful stink!

Composting: Invasive plants can take root in compost. Don't compost any invasives unless you know there is no viable (living) plant material left. Use one of the above techniques (bagging, tarping, drying, chipping, or drowning) to render the plants nonviable before composting. Closely examine the plant before composting and avoid composting seeds.



Japanese knotweed
Polygonum cuspidatum
USDA-NRCS PLANTS Database /
Britton, N.L., and A. Brown. 1913. *An illustrated flora of the northern United States, Canada and the British Possessions*. Vol. 1: 676.

Be diligent looking for seedlings for years in areas where removal and disposal took place.

Suggested Disposal Methods for Non-Native Invasive Plants

This table provides information concerning the disposal of removed invasive plant material. If the infestation is treated with herbicide and left in place, these guidelines don't apply. Don't bring invasives to a local transfer station, unless there is a designated area for their disposal, or they have been rendered non-viable. This listing includes wetland and upland plants from the New Hampshire Prohibited Invasive Species List. The disposal of aquatic plants isn't addressed.

Woody Plants	Method of Reproducing	Methods of Disposal
Norway maple <i>(Acer platanoides)</i> European barberry <i>(Berberis vulgaris)</i> Japanese barberry <i>(Berberis thunbergii)</i> autumn olive <i>(Elaeagnus umbellata)</i> burning bush <i>(Euonymus alatus)</i> Morrow's honeysuckle <i>(Lonicera morrowii)</i> Tatarian honeysuckle <i>(Lonicera tatarica)</i> showy bush honeysuckle <i>(Lonicera x bella)</i> common buckthorn <i>(Rhamnus cathartica)</i> glossy buckthorn <i>(Frangula alnus)</i>	Fruit and Seeds 	<p>Prior to fruit/seed ripening</p> <p>Seedlings and small plants</p> <ul style="list-style-type: none"> ▪ Pull or cut and leave on site with roots exposed. No special care needed. <p>Larger plants</p> <ul style="list-style-type: none"> ▪ Use as firewood. ▪ Make a brush pile. ▪ Chip. ▪ Burn. <hr/> <p>After fruit/seed is ripe</p> <p>Don't remove from site.</p> <ul style="list-style-type: none"> ▪ Burn. ▪ Make a covered brush pile. ▪ Chip once all fruit has dropped from branches. ▪ Leave resulting chips on site and monitor.
oriental bittersweet <i>(Celastrus orbiculatus)</i> multiflora rose <i>(Rosa multiflora)</i>	Fruits, Seeds, Plant Fragments 	<p>Prior to fruit/seed ripening</p> <p>Seedlings and small plants</p> <ul style="list-style-type: none"> ▪ Pull or cut and leave on site with roots exposed. No special care needed. <p>Larger plants</p> <ul style="list-style-type: none"> ▪ Make a brush pile. ▪ Burn. <hr/> <p>After fruit/seed is ripe</p> <p>Don't remove from site.</p> <ul style="list-style-type: none"> ▪ Burn. ▪ Make a covered brush pile. ▪ Chip – only after material has fully dried (1 year) and all fruit has dropped from branches. Leave resulting chips on site and monitor.

Non-Woody Plants	Method of Reproducing	Methods of Disposal
<p>garlic mustard (<i>Alliaria petiolata</i>)</p> <p>spotted knapweed (<i>Centaurea maculosa</i>)</p> <ul style="list-style-type: none"> ▪ Sap of related knapweed can cause skin irritation and tumors. Wear gloves when handling. <p>black swallow-wort (<i>Cynanchum nigrum</i>)</p> <ul style="list-style-type: none"> ▪ May cause skin rash. Wear gloves and long sleeves when handling. <p>pale swallow-wort (<i>Cynanchum rossicum</i>)</p> <p>giant hogweed (<i>Heracleum mantegazzianum</i>)</p> <ul style="list-style-type: none"> ▪ Can cause major skin rash. Wear gloves and long sleeves when handling. <p>dame's rocket (<i>Hesperis matronalis</i>)</p> <p>perennial pepperweed (<i>Lepidium latifolium</i>)</p> <p>purple loosestrife (<i>Lythrum salicaria</i>)</p> <p>Japanese stilt grass (<i>Microstegium vimineum</i>)</p> <p>mile-a-minute weed (<i>Polygonum perfoliatum</i>)</p>	<p>Fruits and Seeds</p> 	<p>Prior to flowering</p> <p>Depends on scale of infestation</p> <p>Small infestation</p> <ul style="list-style-type: none"> ▪ Pull or cut plant and leave on site with roots exposed. <p>Large infestation</p> <ul style="list-style-type: none"> ▪ Pull or cut plant and pile. (You can pile onto or cover with plastic sheeting). ▪ Monitor. Remove any re-sprouting material. <hr/> <p>During and following flowering</p> <p>Do nothing until the following year or remove flowering heads and bag and let rot.</p> <p>Small infestation</p> <ul style="list-style-type: none"> ▪ Pull or cut plant and leave on site with roots exposed. <p>Large infestation</p> <ul style="list-style-type: none"> ▪ Pull or cut plant and pile remaining material. (You can pile onto plastic or cover with plastic sheeting). ▪ Monitor. Remove any re-sprouting material.
<p>common reed (<i>Phragmites australis</i>)</p> <p>Japanese knotweed (<i>Polygonum cuspidatum</i>)</p> <p>Bohemian knotweed (<i>Polygonum x bohemicum</i>)</p>	<p>Fruits, Seeds, Plant Fragments</p> <p>Primary means of spread in these species is by plant parts. Although all care should be given to preventing the dispersal of seed during control activities, the presence of seed doesn't materially influence disposal activities.</p>	<p>Small infestation</p> <ul style="list-style-type: none"> ▪ Bag all plant material and let rot. ▪ Never pile and use resulting material as compost. ▪ Burn. <p>Large infestation</p> <ul style="list-style-type: none"> ▪ Remove material to unsuitable habitat (dry, hot and sunny or dry and shaded location) and scatter or pile. ▪ Monitor and remove any sprouting material. ▪ Pile, let dry, and burn.

January 2010

UNH Cooperative Extension programs and policies are consistent with pertinent Federal and State laws and regulations, and prohibits discrimination in its programs, activities and employment on the basis of race, color, national origin, gender, religion, age, disability, political beliefs, sex, sexual orientation, or veteran's, marital or family status. College of Life Sciences and Agriculture, County Governments, NH Dept. of Resources and Economic Development, Division of Forests and Lands, NH Fish and Game, and U.S. Dept. of Agriculture cooperating.

Managing Invasive Plants

Methods of Control

by Christopher Mattrick

They're out there. The problem of invasive plants is as close as your own backyard.

Maybe a favorite dogwood tree is struggling in the clutches of an Oriental bittersweet vine. Clawlike canes of multiflora rose are scratching at the side of your house. That handsome burning bush you planted few years ago has become a whole clump in practically no time ... but what happened to the azalea that used to grow right next to it?

If you think controlling or managing invasive plants on your property is a daunting task, you're not alone. Though this topic is getting lots of attention from federal, state, and local government agencies, as well as the media, the basic question for most homeowners is simply, "How do I get rid of the invasive plants in my own landscape?" Fortunately, the best place to begin to tackle this complex issue is in our own backyards and on local conservation lands. We hope the information provided here will help you take back your yard. We won't kid you—there's some work involved, but the payoff in beauty, wildlife habitat, and peace of mind makes it all worthwhile.

PLAN OF ATTACK

Three broad categories cover most invasive plant control: mechanical, chemical, and biological. Mechanical control means physically removing plants from the environment



Spraying chemicals to control invasive plants.

through cutting or pulling. Chemical control uses herbicides to kill plants and inhibit regrowth. Techniques and chemicals used will vary depending on the species. Biological controls use plant diseases or insect predators, typically from the targeted species' home range. Several techniques may be effective in controlling a single species, but there is usually one preferred method—the one that is most resource efficient with minimal impact on non-target species and the environment.

MECHANICAL CONTROL METHODS

Mechanical treatments are usually the first ones to look at when evaluating an invasive plant removal project. These procedures do not require special licensing or introduce chemicals into the environment. They do require permits in some situations, such as wetland zones. [See sidebar on page 23.] Mechanical removal is highly labor intensive and creates a significant amount of site disturbance, which can lead to rapid reinvasion if not handled properly.

Pulling and digging

Many herbaceous plants and some woody species (up to about one inch in diameter), if present in limited quantities, can be pulled out or dug up. It's important to remove as much of the root system as possible; even a small portion can restart the infestation. Pull plants by hand or use a digging fork, as shovels can shear off portions of the root system, allowing for regrowth. To remove larger woody stems (up to about three inches in diameter), use a Weed Wrench™, Root Jack, or Root Talon. These tools, available from several manufacturers, are designed to remove the aboveground portion of the plant as well as the entire root system. It's easiest to undertake this type of control in the spring or early summer when soils are moist and plants come out more easily.



Using tools to remove woody stems.



Volunteers hand pulling invasive plants.

Suffocation

Try suffocating small seedlings and herbaceous plants. Place double or triple layers of thick UV-stabilized plastic sheeting, either clear or black (personally I like clear), over the infestation and secure the plastic with stakes or weights. Make sure the plastic extends at least five feet past the edge of infestation on all sides. Leave the plastic in place for at least two years. This technique will kill everything beneath the plastic—invasive and non-invasive plants alike. Once the plastic is removed, sow a cover crop such as annual rye to prevent new invasions.

Cutting or mowing

This technique is best suited for locations you can visit and treat often. To be effective, you will need to mow or cut infested areas three or four times a year for up to five years. The goal is to interrupt the plant's ability to photosynthesize by removing as much leafy material as possible. Cut the plants at ground level and remove all resulting debris from the site. With this treatment, the infestation may actually appear to get worse at first, so you will need to be as persistent as the invasive plants themselves. Each time you cut the plants back, the root system gets slightly larger, but must also rely on its energy reserves to push up new growth. Eventually, you will exhaust these reserves and the plants will die. This may take many years, so you have to remain committed to this process once you start; otherwise the treatment can backfire, making the problem worse.

CHEMICAL CONTROL METHODS

Herbicides are among the most effective and resource-efficient tools to treat invasive species. Most of the commonly known invasive plants can be treated using only two herbicides—glyphosate (the active ingredient in Roundup™ and Rodeo™) and triclopyr (the active ingredient in Brush-B-Gone™ and Garlon™). Glyphosate is non-selective, meaning it kills everything it contacts. Triclopyr is selective and does not injure monocots (grasses, orchids, lilies, etc.). Please read labels and follow directions precisely for both environmental and personal safety. These are relatively benign herbicides, but improperly used they can still cause both short- and long-term health and environmental problems. Special aquatic formulations are required when working in wetland zones. You are required to have a state-issued pesticide applicator license when applying these chemicals on land you do not own. To learn more about the pesticide regulations in your state, visit or call your state's pesticide control division, usually part of the state's Department of Agriculture. In wetland areas, additional permits are usually required by the Wetlands Protection Act. [See sidebar on page 23.]


Foliar applications

When problems are on a small scale, this type of treatment is usually applied with a backpack sprayer or even a small handheld spray bottle. It is an excellent way to treat large monocultures of herbaceous plants, or to spot-treat individual plants that are difficult to remove mechanically, such as goutweed, swallowwort, or purple loosestrife. It is also an effective treatment for some woody species, such as Japanese barberry, multiflora rose, Japanese honeysuckle, and Oriental bittersweet that grow in dense masses or large numbers over many acres. The herbicide mixture should contain no more than five percent of the active ingredient, but it is important to follow the instructions on the product label. This treatment is most effective when the plants are actively growing, ideally when they are flowering or beginning to form fruit. It has been shown that plants are often more susceptible to this type of treatment if the existing stems are cut off and the regrowth is treated. This is especially true for Japanese knotweed. The target plants should be thoroughly wetted with the herbicide on a day when there is no rain in the forecast for the next 24 to 48 hours.

Cut stem treatments

There are several different types of cut stem treatments, but here we will review only the one most commonly used. All treatments of this type require a higher concentration of the active ingredient than is used in foliar applications. A 25 to 35 percent solution of the active ingredient should be used for cut stem treatments, but read and follow all label instructions. In most cases, the appropriate herbicide is glyphosate, except for Oriental bittersweet, on which triclopyr should be used. This treatment can be used on all woody stems, as well as phragmites and Japanese knotweed.

For woody stems, treatments are most effective when applied in the late summer and autumn—between late August and November. Stems should be cut close to the ground, but not so close that you will lose track of them. Apply herbicide directly to the cut surface as soon as possible after cutting. Delaying the application will reduce the effectiveness of the treatment. The herbicide can be applied with a sponge, paintbrush, or spray bottle.

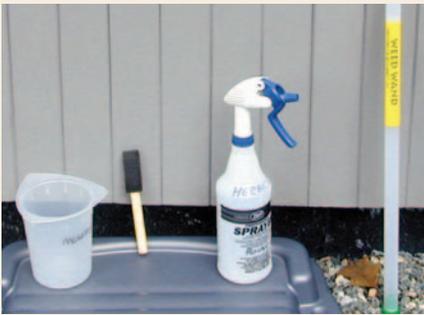

Cut stem treatment tools.

For phragmites and Japanese knotweed, treatment is the same, but the timing and equipment are different. Plants should be treated anytime from mid-July through September, but the hottest, most humid days of the summer are best

for this method. Cut the stems halfway between two leaf nodes at a comfortable height. Inject (or squirt) herbicide into the exposed hollow stem. All stems in an infestation should be treated. A wash bottle is the most effective application tool, but you can also use an eyedropper, spray bottle, or one of the recently developed high-tech injection systems.

It is helpful to mix a dye in with the herbicide solution. The dye will stain the treated surface and mark the areas that have been treated, preventing unnecessary reapplication. You can buy a specially formulated herbicide dye, or use food coloring or laundry dye.

There is not enough space in this article to describe all the possible ways to control invasive plants. You can find other treatments, along with more details on the above-described methods, and species-specific recommendations on The Nature Conservancy Web site (tncweeds.ucdavis.edu). An upcoming posting on the Invasive Plant Atlas of New England (www.ipane.org) and the New England Wild Flower Society (www.newfs.org) Web sites will also provide further details.



Hollow stem injection tools.

Biological controls—still on the horizon

Biological controls are moving into the forefront of control methodology, but currently the only widely available and applied biocontrol relates to purple loosestrife. More information on purple loosestrife and other biological control projects can be found at www.invasiveplants.net.

DISPOSAL OF INVASIVE PLANTS

Proper disposal of removed invasive plant material is critical to the control process. Leftover plant material can cause new infestations or reinfest the existing project area. There are many appropriate ways to dispose of invasive plant debris. I've listed them here in order of preference.

- 1. Burn it**—Make a brush pile and burn the material following local safety regulations and restrictions, or haul it to your town's landfill and place it in their burn pile.
- 2. Pile it**—Make a pile of the woody debris. This technique will provide shelter for wildlife as well.
- 3. Compost it**—Place all your herbaceous invasive plant debris in a pile and process as compost. Watch the pile closely for resprouts and remove as necessary. Do not use the resulting compost in your garden. The pile is for invasive plants only.



Injecting herbicide into the hollow stem of phragmites.

4. Dry it/cook it—Place woody debris out on your driveway or any asphalt surface and let it dry out for a month. Place herbaceous material in a doubled-up black trash bag and let it cook in the sun for one month. At the end of the month, the material should be non-viable and you can dump it or dispose of it with the trash. The method assumes there is no viable seed mixed in with the removed material.

Care should be taken in the disposal of all invasive plants, but several species need extra attention. These are the ones that have the ability to sprout vigorously from plant fragments and should ideally be burned or dried prior to disposal: Oriental bittersweet, multiflora rose, Japanese honeysuckle, phragmites, and Japanese knotweed.

Christopher Mattrick is the former Senior Conservation Programs Manager for New England Wild Flower Society, where he managed conservation volunteer and invasive and rare plant management programs. Today, Chris and his family work and play in the White Mountains of New Hampshire, where he is the Forest Botanist and Invasive Species Coordinator for the White Mountain National Forest.



Controlling Invasive Plants in Wetlands

Special concerns; special precautions

Control of invasive plants in or around wetlands or bodies of water requires a unique set of considerations. Removal projects in wetland zones can be legal and effective if handled appropriately. In many cases, herbicides may be the least disruptive tools with which to remove invasive plants. You will need a state-issued pesticide license to apply herbicide on someone else's property, but all projects in wetland or aquatic systems fall under the jurisdiction of the Wetlands Protection Act and therefore require a permit. *Yes, even hand-pulling that colony of glossy buckthorn plants from your own swampland requires a permit.* Getting a permit for legal removal is fairly painless if you plan your project carefully.

1. Investigate and understand the required permits and learn how to obtain them. The entity charged with the enforcement of the Wetlands Protection Act varies from state to state. For more information in your state, contact:

ME: Department of Environmental Protection
www.state.me.us/dep/blwq/docstand/nrapage.htm

NH: Department of Environmental Services
www.des.state.nh.us/wetlands/

VT: Department of Environmental Conservation
www.anr.state.vt.us/dec/waterq/permits/htm/pm_cud.htm

MA: Consult your local town conservation commission

RI: Department of Environmental Management
www.dem.ri.gov/programs/benviron/water/permits/fresh/index.htm

CT: Consult your local town Inland Wetland and Conservation Commission

2. Consult an individual or organization with experience in this area. Firsthand experience in conducting projects in wetland zones and navigating the permitting process is priceless. Most states have wetland scientist societies whose members are experienced in working in wetlands and navigating the regulations affecting them. A simple Web search will reveal the contact point for these societies. Additionally, most environmental consulting firms and some nonprofit organizations have skills in this area.

3. Develop a well-written and thorough project plan. You are more likely to be successful in obtaining a permit for your project if you submit a project plan along with your permit application. The plan should include the reasons for the project, your objectives in completing the project, how you plan to reach those objectives, and how you will monitor the outcome.

4. Ensure that the herbicides you plan to use are approved for aquatic use. Experts consider most herbicides harmful to water quality or aquatic organisms, but rate some formulations as safe for aquatic use. Do the research and select an approved herbicide, and then closely follow the instructions on the label.

5. If you are unsure—research, study, and most of all, ask for help. Follow the rules. The damage caused to aquatic systems by the use of an inappropriate herbicide or the misapplication of an appropriate herbicide not only damages the environment, but also may reduce public support for safe, well-planned projects.

Section 4

Annual Updates and Log Requirements

The Owner and/or Contact/Responsible Party shall review this Operation and Maintenance Plan once per year for its effectiveness and adjust the plan and deed as necessary.

A log of all preventative and corrective measures for the stormwater system shall be kept on-site and be made available upon request by any public entity with administrative, health environmental or safety authority over the site including NHDES.

Copies of the Stormwater Maintenance report shall be submitted to the Pease Development Authority on an annual basis.

Stormwater Management Report						
Lynx Parking Expansion			101 International Drive			
BMP Description	Date of Inspection	Inspector	BMP Installed and Operating Properly?	Cleaning / Corrective Action Needed	Date of Cleaning / Repair	Performed By
Jellyfish Filter 1			<input type="checkbox"/> Yes <input type="checkbox"/> No			

