

# Stormwater Management Report

## West End Yards


Cate Street/Route 1  
Portsmouth, NH 03801

APPLICANT & OWNER

## Cate Street Development, LLC

11 Elkins Street  
Suite 420  
Boston, MA 02127

REVISION 2  
July 24, 2019

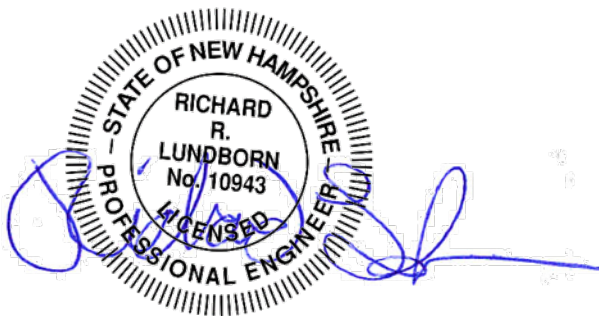

**FUSS & O'NEILL**

Libby House  
5 Fletcher Street, Suite 1  
Kennebunk, ME 04043





# Table of Contents

## Stormwater Management Report West End Yards

---

1	Executive Summary .....	1
1.1	Revisions .....	2
2	Project Description .....	2
2.1	Existing Conditions.....	2
2.1.1	Site Parameters.....	2
2.1.2	Soils.....	3
2.2	Proposed Conditions.....	3
2.2.1	Design Elements.....	3
3	Hydrologic Analysis .....	4
3.1	Existing Watershed Summary.....	4
3.2	Proposed Watershed Summary .....	5
3.3	Best Management Practices.....	5
3.3.1	Off-line Closed Drainage System.....	5
3.3.2	Bioretention Basins (Rain Gardens) .....	6
3.3.3	Subsurface Infiltration Chambers .....	6
3.3.4	Water Quality Unit (WQU).....	7
3.3.5	Treatment Swale with Level Spreader .....	7
3.3.6	Vegetated Buffer .....	7
3.4	Hydrologic Analysis Results .....	7
3.4.1	Groundwater Recharge Volume.....	9
4	Soil Erosion and Sedimentation Control .....	9
4.1	Construction Support Activities .....	10
5	Summary .....	10

Tables

	Page
1.1 AP 1 Peak Flow Results	8
1.2 AP1 Total Volume Results	8
2.1 AP2 Peak Flow Results	8
2.2 AP2 Total Volume Results	8
3.1 AP3 Peak Flow Results	8
3.2 AP3 Total Volume Results	

Appendices

A	NHDES WebGIS; Surface Water Impairments NHDES WebGIS; AOT Screening layers
B	NHB Data Check
C	NRCS Soil Survey Report
D	Aerial Photograph Site Photos
E	Groundwater Recharge Calculations BMP Worksheets
F	NRCC Extreme Precipitation Tables
F2.1	Pre-Development Hydrologic Analysis 10-yr
F2.2	Pre-Development Hydrologic Analysis 2, 25 & 50-yr
F3.1	Post-Development Hydrologic Analysis 10-yr
F3.2	Post-Development Hydrologic Analysis 2, 25 & 50-yr
G	RipRap Apron Calculations
H	Site Specific Soils Mapping
I	Infiltration Feasibility Report
J	UIC Registrations
K	Inspection and Maintenance Plan

End of Report

Figures

1	Site Location Map
2	FEMA Flood Insurance Rate Map
3	Pre-Development Subwatershed Plan
4	Post-Development Subwatershed Plan

End of Report

# 1 Executive Summary

This Stormwater Management Report describes proposed work and stormwater management associated with the re-development of the Frank Jones Center Property as well as a collection of other properties along Cate Street, located between Route 1 Bypass and Bartlett Street, Portsmouth, New Hampshire (Site). The Site is identified on the Site Location Map, Figure 1.

The results of the redevelopment of these parcels of land are as follows:

- 1) 1.8 Acre reduction of impervious surfaces on the 13.31 Acres being redeveloped
  - a. Equivalent to a 13.6% reduction
- 2) 0.35 Acre reduction of impervious surface in the wetland buffer along Hodgson Brook
  - a. Equivalent to a 24% reduction of impervious surface in the buffer
- 3) 100% Stormwater pre-treatment
  - a. Currently stormwater is not pre-treated
- 4) 50%-100% Stormwater Treatment
  - a. Currently stormwater is not treated
- 5) Provision of a 25 to 30-ft wide vegetated wetland buffer along the top of bank to Hodgson Brook
  - a. Currently only a short section of the wetland and brook has a vegetated buffer at the top of bank
- 6) Increased Stormwater Infiltration both passively through restoration of vegetated areas and actively through Stormwater Management Practices such as, bioretention areas and Infiltration Chamber Galleries
- 7) Net reduction on stormwater runoff to Hodgson Brook and the Watershed points of Analysis, both in Flow Rate and Volume

The proposal consists of the construction of:

- 1) A new City Street, in essence an extension of Cate Street to Route 1 Bypass at the current intersection of Route 1 Bypass, Borthwick Avenue and the Frank Jones Center driveway
- 2) A multi-use / Bike Trail along the alignment of the new City Street from Route 1 Bypass to Bartlett Street.
- 3) A Dog Park
- 4) New greenspaces throughout the site

- 5) A 20,000-sf footprint Retail / Commercial / Office Building in the current location of the Frank Jones Center. Gross floor space of 40,000-sf over 2 floors
- 6) 2, 4 story Apartment Buildings providing a total of 325 apartment units
- 7) 23 Townhomes
- 8) Parking for all of the uses above Commercial, Office and Residential

Existing and proposed hydrologic conditions for the development of the project Site were evaluated to compare existing and proposed stormwater peak discharges and volumes. The evaluation demonstrates a net decrease in peak stormwater discharge and volume for the 2-year, 10-year, 25-year, and 100-year storm events.

---

## 1.1 Revisions

The following revisions are present in this Stormwater Management Report:

1. Tables 1.1, 1.2 and Tables 2.1 and 2.2 summarizing the results at the Analyses Points.
2. Appendix E - BMP Work Sheets
3. Appendix F - Revised HydroCAD Calculations
4. Appendix G - Rip Rap Outlet Protection Calculations
5. Appendix I - Infiltration Feasibility Report Items have been provided in Appendix I. These consist of a Test Pits with ESHWT, and Ksat calculations by McPhail Associates.
6. The drainage along the last few hundred feet of Cate Street into the intersection with Bartlett Street has been modeled and flows to analysis Point 3 (AP3).

## 2 Project Description

---

### 2.1 Existing Conditions

The Site, 13.3 Acres of commercial land, is located east of U.S. Route 1 Bypass in Portsmouth, New Hampshire (Refer to Figure 1). Existing Site features include the Frank Jones Center and an accessory building on Tax Map 172 Lot 1, parking area on Tax Map 173 Lot 2, 2 industrial buildings on Tax Map 165 Lot 2, The PK Brown contractor yard and buildings on Tax Map 163 Lot 34, a House and outbuildings on Tax Map 163 Lot 33, and City Land occupied by Cate Street and a pocket of woods.

#### 2.1.1 Site Parameters

A review of Federal, state, and local requirements for the Site generated the following results:

- The Site lies outside the 500-year flood plain, denoted as "Zone X" on the Federal Emergency Management Agency (FEMA) Flood Insurance Rate Map Community Panel Number 33015C0259E, May 17, 2005.

- The Site is free of Endangered Flora or Fauna Habitat that would be directly affected by the project per the New Hampshire Natural Heritage Bureau (NHB). Refer to Appendix C.
- Freshwater wetland resources exist on and adjacent to the property. Resource area delineations were completed by Luke Hurley, CWS, CSS of Gove Environmental Services, Inc. and are included on the plans. These Wetlands are subject to a 100-ft wetland buffer.

### 2.1.2 Soils

The Site is characterized by Natural Resources Conservation Service (NRCS, formerly SCS) as Urban land-Canton complex, which is classified as Hydrological Soil Group (HSG) D. A websoil survey of the soils within the Site can be found in Appendix C.

A Site Specific Soils Mapping (SSSM) has been prepared for the site by Luke Hurley, CWS, CSS of Gove Environmental Services, Inc. Based upon the mapping the site has been mapped as:

#### *400A Udorthents, sandy or gravelly*

This map unit typically includes the following concepts: 1) very gravelly (> 35%) sand or very gravelly loamy sand; Or 2) sand or loamy sand textures that may have lenses of loamy very fine sand or finer somewhere in the particle-size class control section (25 - 100 cm or 10 - 40"). Saturated hydraulic conductivity (Ksat) is high or very high. Drainage class ranges from excessively drained to somewhat poorly drained. Typical gravel pit.

Mr. Hurley has offered that this would equate to an Eldridge NRCS, 38 Hydrologic Soils Group (HSG) C. According to this guidance we have used HSG C for the drainage analysis.

Hydraulic conductivity has been confirmed by McPhail Associates, Inc., the team Geotechnical Engineers.

ESHWT has been confirmed by Testpit in each stormwater practice using infiltration.

---

## 2.2 Proposed Conditions

The redevelopment of the site, will reduce impervious cover by 13.6% over the entire site area and greatly improve the stormwater collection, conveyance, treatment and ability to provide groundwater recharge on site. The practices implemented to accomplish this are discussed further in section 3.3.

### 2.2.1 Design Elements

The following measures have been incorporated in the project design to control the peak stormwater runoff rate, provide recharge, and treat stormwater generated by the site:

- Best Management Practices Designed in accordance with the City of Portsmouth regulations and the NHDES Stormwater Manual;
- An Erosion and Sediment Control plan has been developed that will prevent direct discharges to wetlands, and avoid or minimize channelized stormwater flow directly into wetland resource areas;
- Land disturbance and grading shall be conducted in a selective manner and appropriate construction BMPs are incorporated to preclude construction period runoff/erosion;
- Top soil is preserved or supplemented sufficient to maintain vegetation cover;
- All conveyances and outfalls are dissipated outside of wetland areas; and
- No work is proposed in Essential or Significant Wildlife Habitats or fisheries habitats, as identified by the NHB.

### 3 Hydrologic Analysis

The hydrologic analyses for existing and proposed conditions were completed using HydroCAD version 10.00-20 to determine peak runoff flow rates and total runoff volumes for the watershed models. HydroCAD is based on the NRCS Technical Release 20 and Technical Release 55, and is subject to cumulative rainfall/volume dependent routing calculations. Hydrographs are prepared for each element of the watershed and routed through the dynamic-storage-indication method to produce various time-based results. Labeling on the drainage plans and HydroCAD diagrams is as follows:

- Subcatchments – represented by hexagons
- Ponds – represented by triangles
- Reaches and Analysis Points – represented by squares
- Time of Concentration – represented by circles with letters and flow lines

The Pre and Post-Development hydrologic analysis has been included in Appendix F.

---

#### 3.1 Existing Watershed Summary

The majority of stormwater runoff from the existing on-site development is conveyed via the cities stormwater runoff system which runs south to north along U.S. Route 1 Bypass. The stormwater system and the outfalls into Hodgson Brook are designated as Analysis Point AP1. A small portion of stormwater flows offsite and is designated as Analysis Point AP2. The portion of Cate Street east of the site and the intersection with Bartlett Street is modeled and flows to AP3. All soils on Site are hydrologic soils group C.

14 subwatersheds have been established for the project's pre-development conditions. Refer to the Pre-Development Subwatershed Plan included as Figure 3.

---

## 3.2 Proposed Watershed Summary

Post-development stormwater management features have been located and designed to imitate a more natural distribution of stormwater over the site than what exists today due to the extreme amount of impervious coverage. Stormwater is conveyed via closed drainage system to one of the following:

- Water Quality Unit followed by a vegetated swale and level spreader
- Bioretention areas
- Subsurface Infiltration Chamber galleries

Overflow stormwater leaves the infiltration practices in large storm events and flows to either Hodgson Brook or the City closed Drainage system on Bartlett Street via overflow pipes tied to the proposed closed drainage system.

52 subwatersheds have been established for the project's post-development conditions. Refer to the Post-Development Subwatershed Plan included as Figure 4.

---

## 3.3 Best Management Practices

BMPs have been incorporated into the proposed Site improvements in order to protect natural resources from point source stormwater releases associated with the development. The following sections discuss the various BMP's employed.

### 3.3.1 Off-line Closed Drainage System

A project of this size will inevitably require a closed drainage stormwater collection system employing catch basins, drain manholes and pipe to route stormwater to locations on site available to treat and control it prior to release to downstream areas in the watershed.

There are two common types of closed drainage systems employed In-line and Off-line.

In an in-line closed drainage system, stormwater is collected by catch basins that are connected to each other in series as the system moves down gradient across the site. This type of system re-suspends any solids that settle in the downstream catch basin sumps as flow from upstream catch basins are conveyed through them. Ultimately, this provides little to no pre-treatment of suspended solids.

The proposal utilizes an off-line closed drainage system. In an off-line system, stormwater is collected by catch basins that are then connected to a “drain main” via drain manholes. The sump of each catch basin is then able to retain the suspended solids that enter the catch basin without being re-suspended by flow from another catch basin flowing through it. The proposal also implements catch basins that are “hooded”. The hoods are accessories that are mounted to the wall of the catch basin over the invert out that extend about 1-ft below the invert which help to retain floating solids and help settle sediment in the sump of the catch basin.

### 3.3.2 Bioretention Basins (Rain Gardens)

Bioretention areas are being employed to treat and control stormwater along the new City Street on the north side. The bioretention areas are located at the curve in the road at the east end of the site.

Bioretention basins utilize biologic actions that take place in all soil cross sections to treat stormwater. The soil in a bioretention basin, commonly referred to as a rain garden is a specific tested mix of soils components that create a soil with a very specific infiltration rate and organic soil / sand mix. Bioretention basins can be constructed in any existing soil condition.

Due to high

The proposal employs bioretention basins that provide some infiltration and groundwater recharge and are also equipped with underdrains to ensure that stormwater does not remain ponded for more than 72 hours.

### 3.3.3 Subsurface Infiltration Chambers

Subsurface Chambers are being used by this proposal. Particularly, Stormtech SC740 chambers. These chambers consist of high density poly ethylene (HDPE) arches embedded in clean washed stone. The chambers provide superior storage and the stone provides both storage and a stable interface with the in-situ soils the chamber gallery is constructed in. Stormtech Chamber systems provide an additional amount of pre-treatment in one row of chambers called the isolator row. Stormwater is directed to the isolator row first and flows laterally through perforations to the chambers and stone adjacent to it. The isolator row is constructed on top of filter fabric allowing any sediment finding its way to the chambers to be trapped and kept out of the stone. With adequate separation to ESHWT and acceptable Ksat rates, infiltration can be employed to allow the stormwater to recharge the groundwater.

After extensive soils mapping efforts, including a joint site visit for test pits and logging by the Soils Scientist from Gove Environmental Services and the Geotechnical Engineer from McPhail Associates, Infiltration Basin locations have been selected. Infiltration Basins 1, 2 and 3 take advantage of the outwash material in the center area of the site. The 3 infiltration basins have been sized using an average Ksat from the 3 test pits in their vicinity. Test pits 108, Test pit 109 and Test pit 110. See below for summary of Ksats and the Ksat(design) used.

Ksat108 = 3.47243 in/hr

Ksat109 = 0.52016 in/hr



$K_{sat110} = 1.82834 \text{ in/hr}$

$K_{sat(avg)} = 1.19031 \text{ in/hr}$       Factor of safety = 2.0       $K_{sat(design)} = 0.97 \text{ in/hr}$

It should be noted that the infiltration basins will all be within the native soils represented by Test pit 108. All fill material will be excavated out. The implementation of design using  $K_{sat}$  based on an average of the 3 test pit rates accounts for possible contamination.

The area of surface drainage at the Townhouse portion of the project is in a clayey area of the property and due to this will employ lined subsurface chamber fields for detention. The chamber fields will have underdrains to ensure they drain fully.

### 3.3.4 Water Quality Unit (WQU)

A Water Quality Unit is being provided in the design just prior to the treatment swale and level spreader that allows discharge of stormwater from the closed drainage system to outlet to Hodgson Brook. The WQU will ensure maximum suspended solids removal ahead of stormwater release to the brook.

### 3.3.5 Swale with Level Spreader

A swale and level spreader are provided at the outfall of the closed drainage system ahead of Hodgson Brook to ensure energy in the stormwater is dissipated prior to release.

### 3.3.6 Vegetated Buffer

The design as proposed provides a vegetated buffer along the alignment of the new City Street between the multi-use / bike trail and the top of bank to Hodgson Brook. While this is an improvement, it cannot be claimed as a treatment practice under the NHDES Stormwater rules because it is not deep enough.

---

## 3.4 Hydrologic Analysis Results

Today the stormwater generated on site either flows to Hodgson Brook at Analysis Point AP1 or to the City Closed Drainage system in Cate Street that is connected to the system in Bartlett Street denoted by Analysis Point AP2. The Pre development site is highly impervious, developed with buildings and paved areas.

The post-development decrease in impervious ground cover and proposed BMPs will attenuate peak flows from the Site. The proposed improvements will result in a net decrease to the Analysis Points AP 1, AP2 and AP3 in peak stormwater discharge for the 2-year, 10-year, 25-year, and 100-year 24-hour storm events, as compared to the existing conditions peak stormwater flowrate. The following tables summarize existing vs. proposed stormwater flows for the watershed analysis.

Table 1.1: AP1 Peak Stormwater Flowrate Results at Analysis Point

Design Storm	Existing Flow (cfs)	Proposed Flow (cfs)	Net Change (cfs)
2-year	22.40	20.53	-1.87
10-year	37.02	34.99	-2.03
25-year	48.62	45.49	-3.13
50-year	59.48	55.15	-4.33
100-year	72.55	67.61	-4.94

Table 1.2: AP1 Total Stormwater Volume Results at Analysis Point

Design Storm	Existing Volume (cf)	Proposed Volume (cf)	Net Change (cf)
2-year	85,142	71,906	-13,236
10-year	140,865	123,435	-17,430
25-year	185,670	165,248	-20,422
50-year	227,940	204,925	-23,015
100-year	279,330	253,373	-25,957

Table 2.1: AP2 Peak Stormwater Flowrate Results at Analysis Point

Design Storm	Existing Flow (cfs)	Proposed Flow (cfs)	Net Change (cfs)
2-year	16.28	7.27	-9.01
10-year	26.23	14.18	-12.05
25-year	33.98	19.94	-14.04
50-year	41.17	25.02	-16.12
100-year	49.81	42.54	-7.27

Table 2.2: AP2 Total Stormwater Volume Results at Analysis Point

Design Storm	Existing Volume (cf)	Proposed Volume (cf)	Net Change (cf)
2-year	56,249	39,690	-16,559
10-year	92,749	72,394	-20,355
25-year	121,770	99,315	-22,455
50-year	148,993	124,799	-24,194
100-year	181,956	153,971	-27,985

Table 3.1: AP3 Peak Stormwater Flowrate Results at Analysis Point

Design Storm	Existing Flow (cfs)	Proposed Flow (cfs)	Net Change (cfs)
2-year	2.99	2.57	-0.42
10-year	4.61	3.99	-0.62
25-year	5.87	5.04	-0.83
50-year	7.04	5.98	-1.06
100-year	8.46	7.10	-1.36

Table 3.2: AP3 Total Stormwater Volume Results at Analysis Point

Design Storm	Existing Volume (cf)	Proposed Volume (cf)	Net Change (cf)
2-year	10,938	9,970	-968
10-year	17,283	16,368	-915
25-year	22,274	21,388	-886
50-year	26,935	26,046	-889
100-year	32,568	31,766	-802

As can be seen the re-development of the site affords a unique opportunity to reduce stormwater flows both in rate and volume to a taxed waterway and an existing City Storm Drain.

### 3.4.1 Groundwater Recharge Volume

The Groundwater Recharge Volume (GRV) required for this project is very small. The Impervious surface areas used to calculate the value were taken directly from HydroCAD. HydroCAD did not consider the large gravel area on the eastern side of the site to be impervious. If it were the project would have a negative GRV requirement. The paved, buildings and sidewalk surfaces in the post-development are almost an even match to the pre-development. GRV(required) is equal to 60-cf. See Appendix E.

The subsurface infiltration basins proposed far exceed the 60-cf of GRV in infiltrated stormwater.

## 4 Soil Erosion and Sedimentation Control

Soil erosion and sedimentation control details and narratives for construction periods are provided in the Site plans and the Stormwater Pollution Prevention Plan (SWPPP) which will be prepared and provided as the project is submitted to NHDES for an AoT Permit. Soil erosion and sedimentation control details and procedures are consistent with the NHDES best management Practices for Erosion and Sediment Control.

Erosion and sedimentation controls used on the Site during construction will include silt fence, check dams, hay bales, a construction entrance, and water for dust control. Additional erosion and sediment controls will be utilized as required. Silt fence and hay bales will be placed down-gradient of disturbed areas and up-gradient of wetlands. A construction entrance will be installed to ensure sediment does not get tracked onto US Route 1 Bypass or Bartlett Street.

Water will be applied to exposed soils to provide dust control as needed.

The schedule for the commencement or cessation of construction activities, grading, and soil stabilization measures ceased on a portion of the Site, and stabilization measures initiated, shall be recorded and maintained as part of the SWPPP.

## 4.1 Construction Support Activities

Waste materials generated from construction activities will include excavated soil, brush, asphalt, and building demo debris. All excavation debris and other waste will be transported to an approved disposal facility. If required, materials may be temporarily stockpiled within designated staging areas. Details and procedures are provided in the construction Site plans. Construction materials will be present on-site during various stages of construction. All materials will be temporarily stored within designated staging or lay-down areas and will be transported to the Site as needed. Construction vehicle fueling will take place at a designated staging area only. Staging areas will be located within the limit of work, outside the wetlands located on-site.

## 5 Summary

This Stormwater Management Report describes proposed work and stormwater management associated with the re-development of the Frank Jones Center and assembled properties.

The proposed Site improvements will decrease post-development peak stormwater runoff rates and volumes. 2 bioretention areas and 3 subsurface infiltration galleries, as well as an offline closed drainage system and a vegetated swale and level spreader all work together to accomplish the improvements.

## Appendix A

---

NHDES WebGIS Printouts; Surface Water Impairments





NHDES WebGIS Printouts; AOT Screening Layers





# Surface Water Impairments

## Legend

-  Designated Rivers Quarter Mil Buffer
-  All Lakes, with a Quarter Mil Buffer
-  Surface Waters with Impair 2016 with Quarter Mile Buffer
-  Watersheds with Chloride Impairments 2016

Map Scale

1: 24,000

© NH DES, <http://des.nh.gov>

Map Generated: 5/19/2019



## Notes

-70°48'      -70°47'20"      -70°46'40"      -70°46'      -70°45'20"      -70°44'40"

43°5'25"

43°5'25"

43°5'

43°5'

43°4'35"

43°4'35"

43°4'10"


43°4'10"

43°3'45"

43°3'45"



3'      -70°47'20"      -70°46'40"      -70°46'      -70°45'20"      -70°44'40"

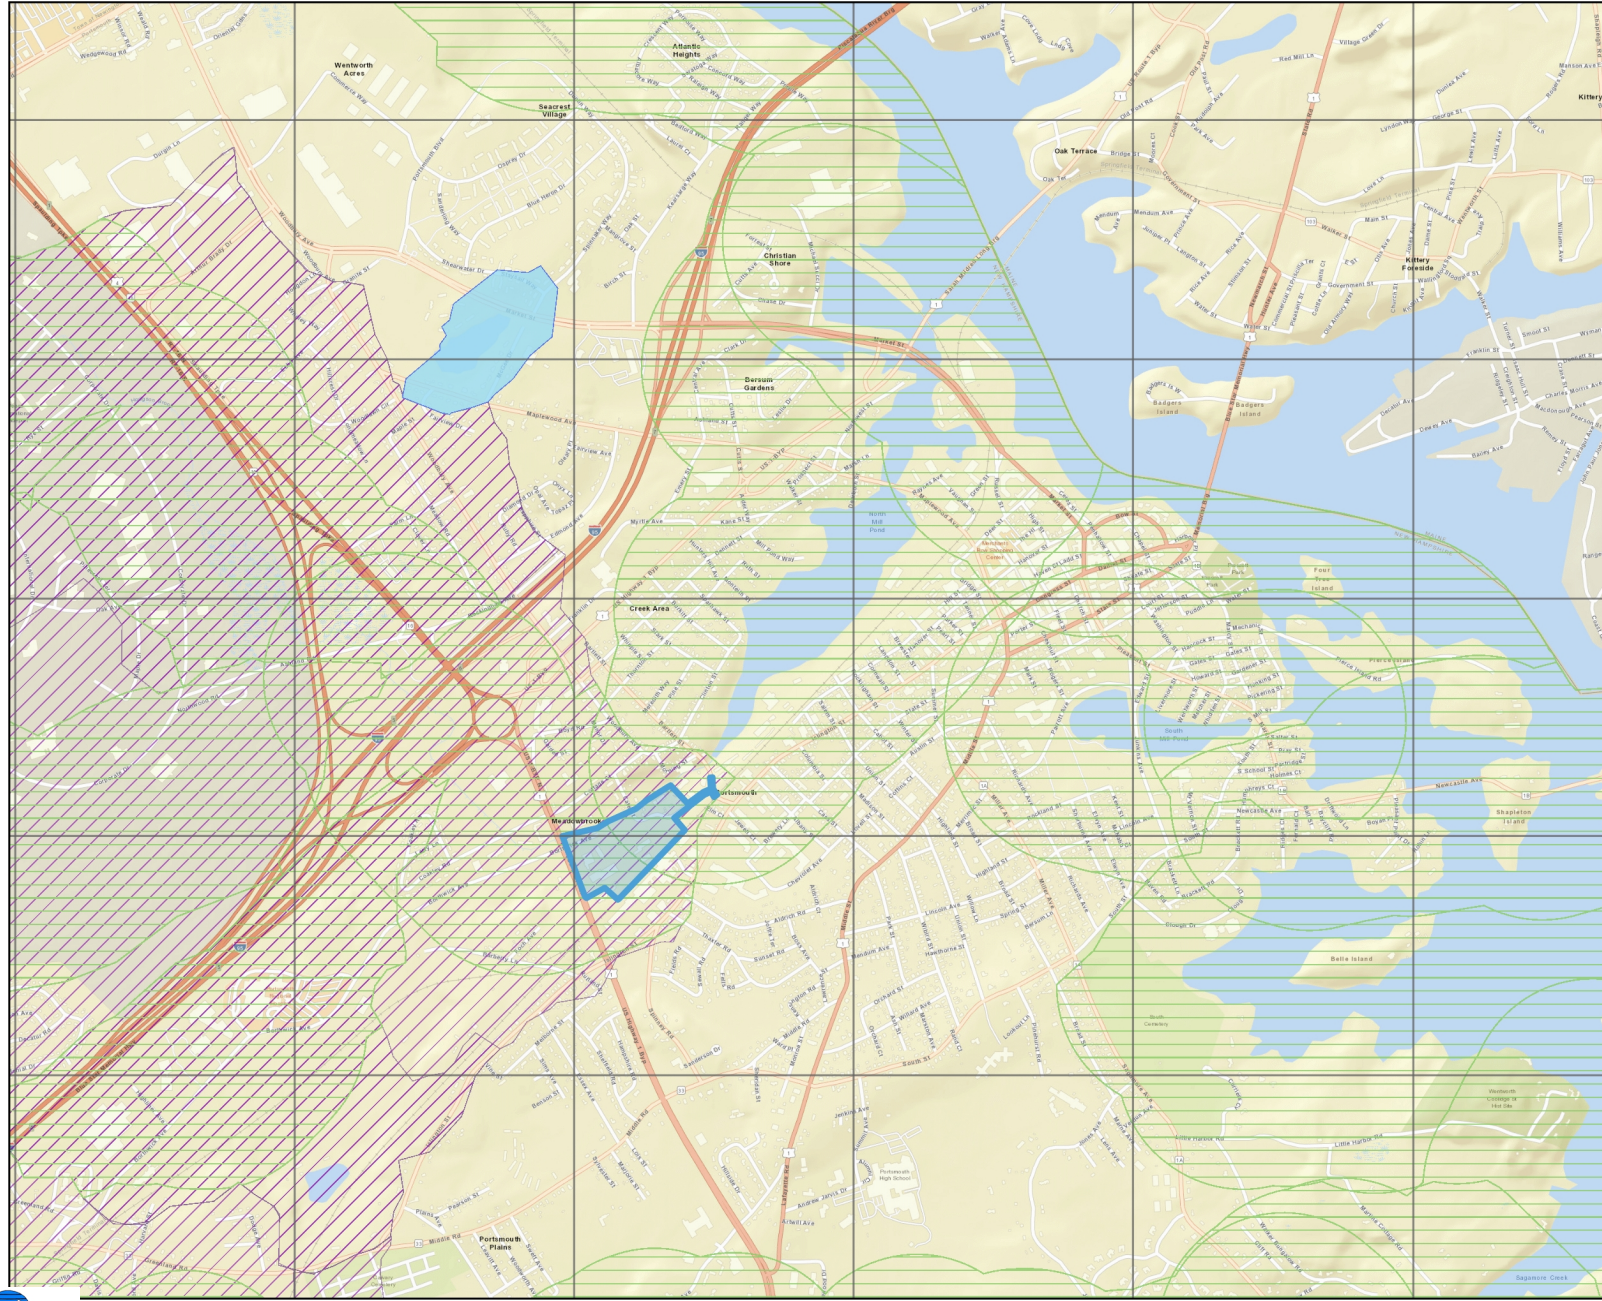

## Details

- AUID  
NHRIV600031001-04

- Shape

N/A

- FID

388

- Waterbodyi

NHRIV600031001-04

- Beach

N

- Waterbodyn

LOWER HODGSON BROOK



- Impairment

Benthic-Macroinvertebrate Bioassessments (Streams), Chloride, Dissolved oxygen saturation, Escherichia coli, Dissolved Oxygen (mg/L)



# Coastal and Great Bay Communities

## Legend


-  Coastal and Great Bay Regi Communities
-  Designated Rivers Quarter Buffer

Map Scale  
1: 24,000



© NH DES, <http://des.nh.gov>  
Map Generated: 5/19/2019

## Notes

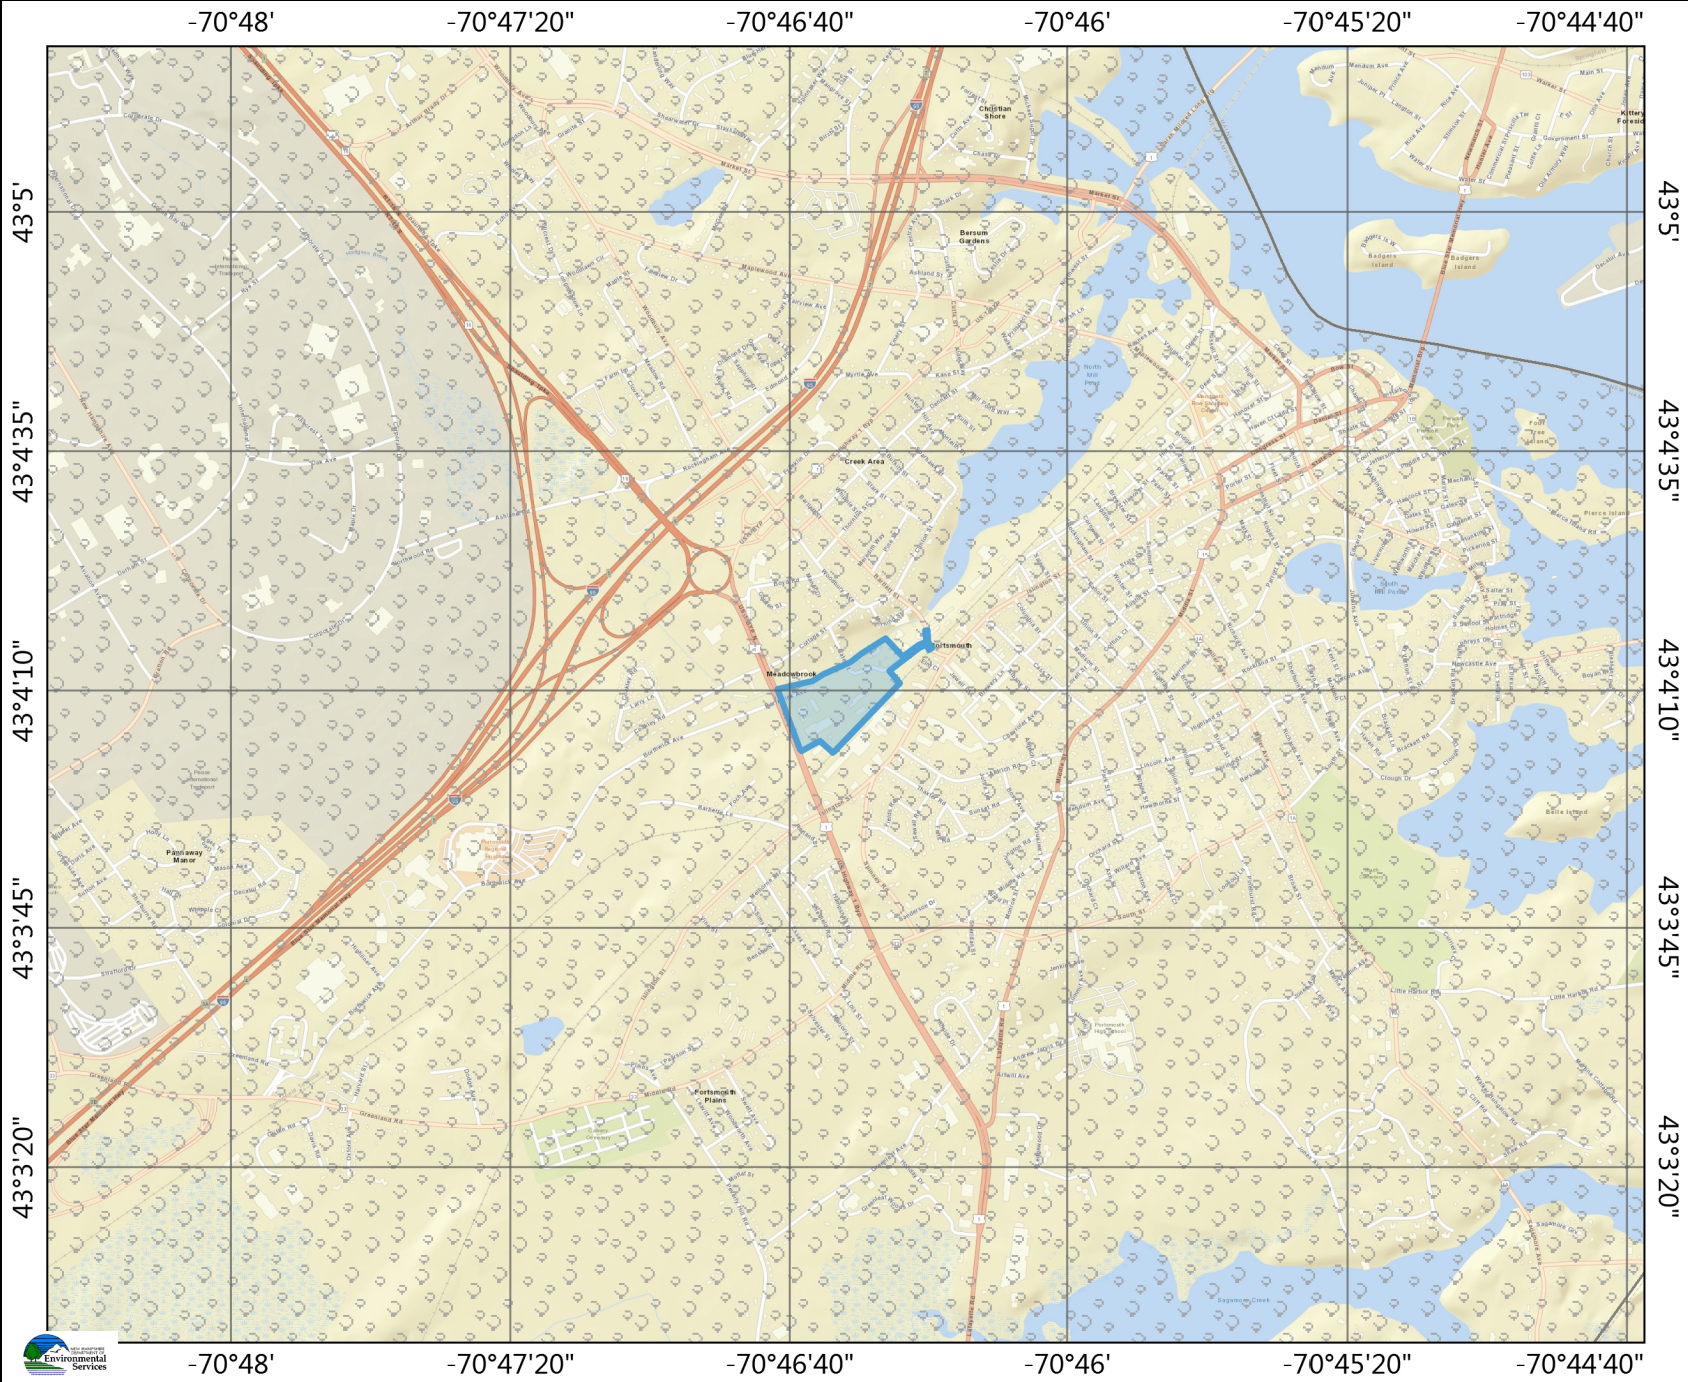




# Groundwater Protection Areas

## Legend

-  Designated Rivers Quarterm Buffer
-  Public Water Supply Wells
-  Groundwater Classification / GA1
-  Groundwater Classification / GA2
-  Water Supply Intake Protect Areas
-  Wellhead Protection Areas

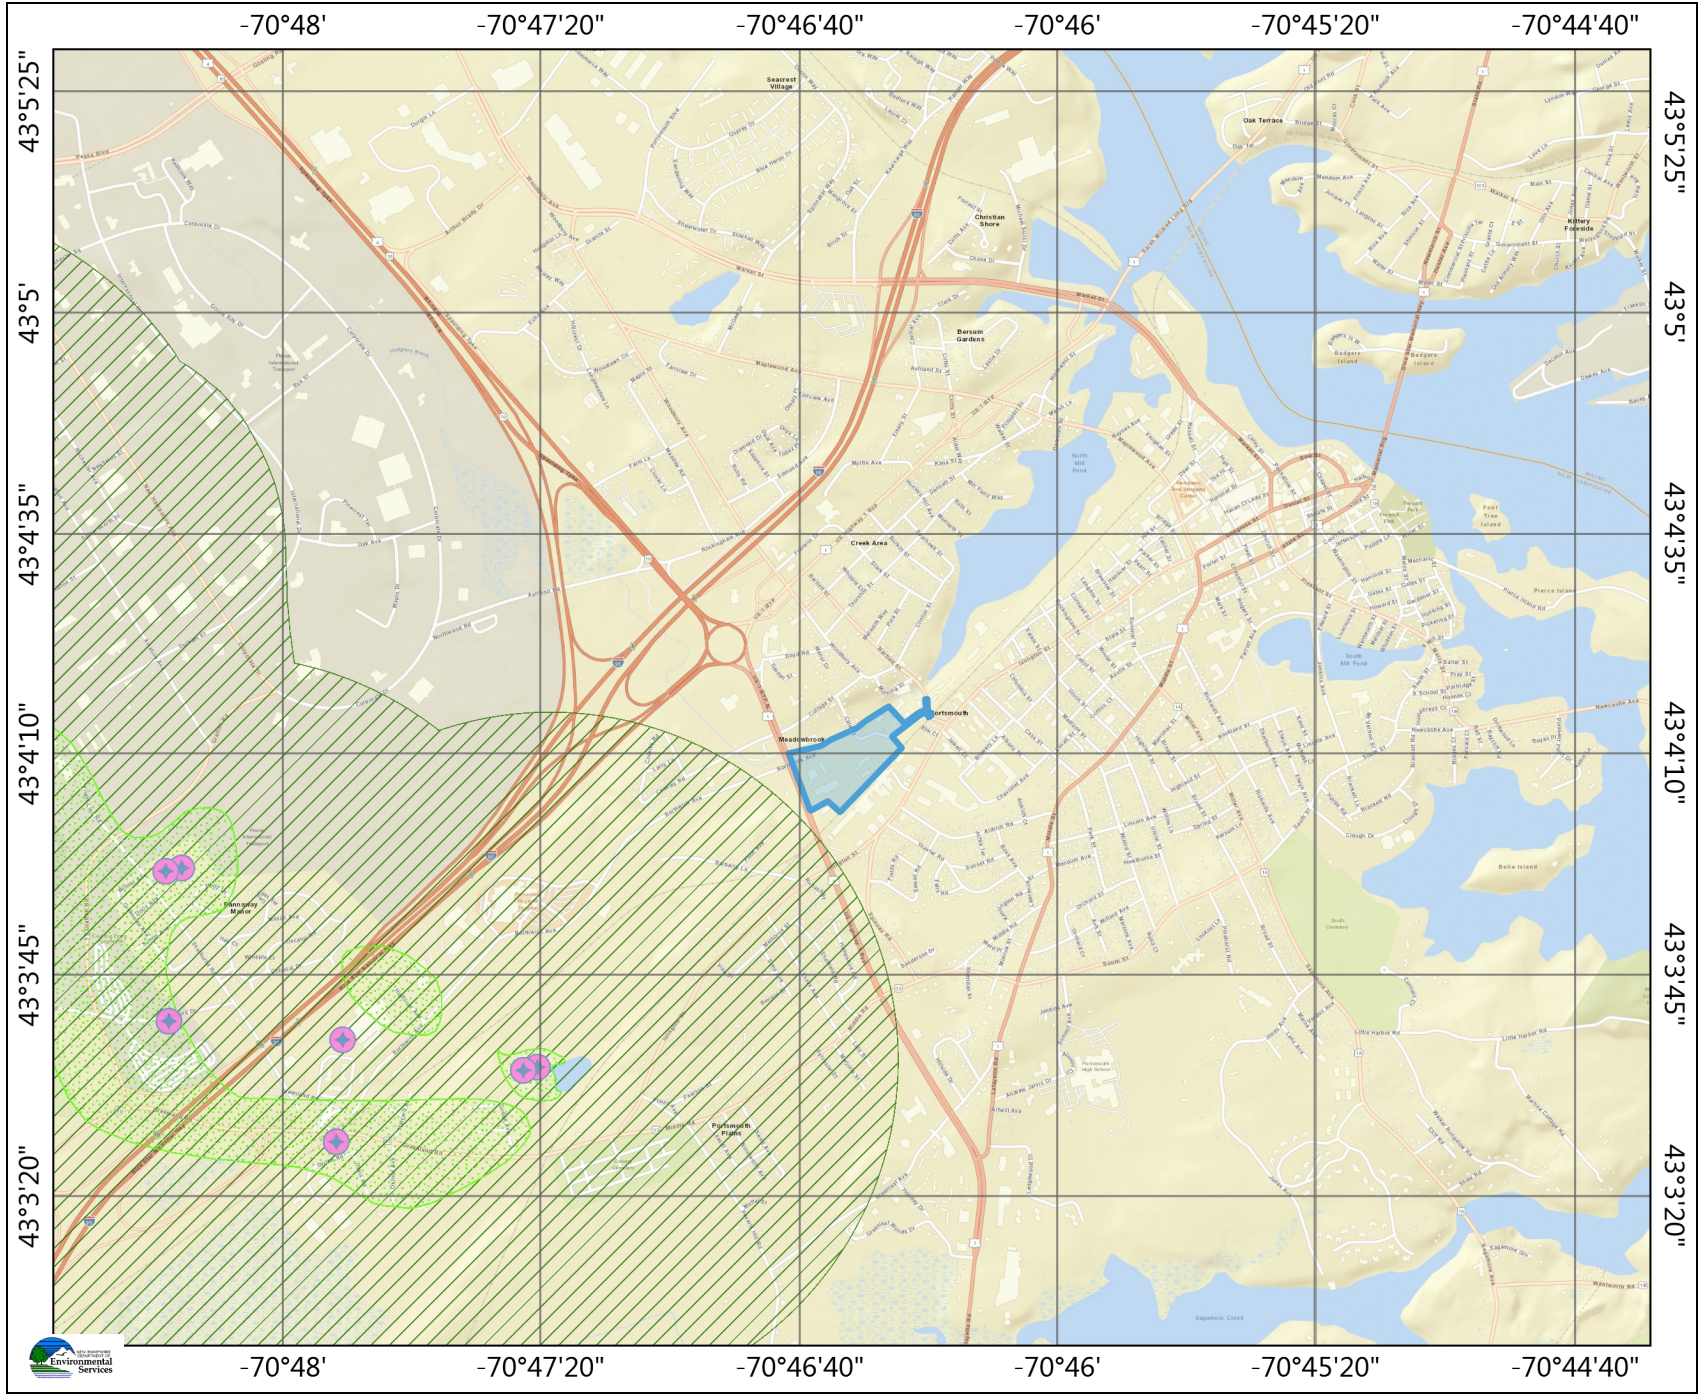

Map Scale  
 1: 25,977

© NH DES, <http://des.nh.gov>  
 Map Generated: 5/19/2019



**Notes**



## Appendix B

---

NHB Letter





**To:** James Andretta  
14 High Street  
Wiscasset, ME 04578

**Date:** 4/13/2018

**From:** NH Natural Heritage Bureau

**Re:** Review by NH Natural Heritage Bureau of request dated 4/13/2018  
NHB File ID: NHB18-1167

Applicant: Rick Lundborn

Location: Tax Map(s)/Lot(s): 172 Lot 1, 165 Lot 2, 163 Lot 34, 163 Lot 33,  
173 Lot 2  
Portsmouth

Project Description: Cate Street Development

The NH Natural Heritage database has been checked for records of rare species and exemplary natural communities near the area mapped below. The species considered include those listed as Threatened or Endangered by either the state of New Hampshire or the federal government. We currently have no recorded occurrences for sensitive species near this project area.


A negative result (no record in our database) does not mean that a sensitive species is not present. Our data can only tell you of known occurrences, based on information gathered by qualified biologists and reported to our office. However, many areas have never been surveyed, or have only been surveyed for certain species. An on-site survey would provide better information on what species and communities are indeed present.

This report is valid through 4/12/2019.





MAP OF PROJECT BOUNDARIES FOR NHB FILE ID: NHB18-1167

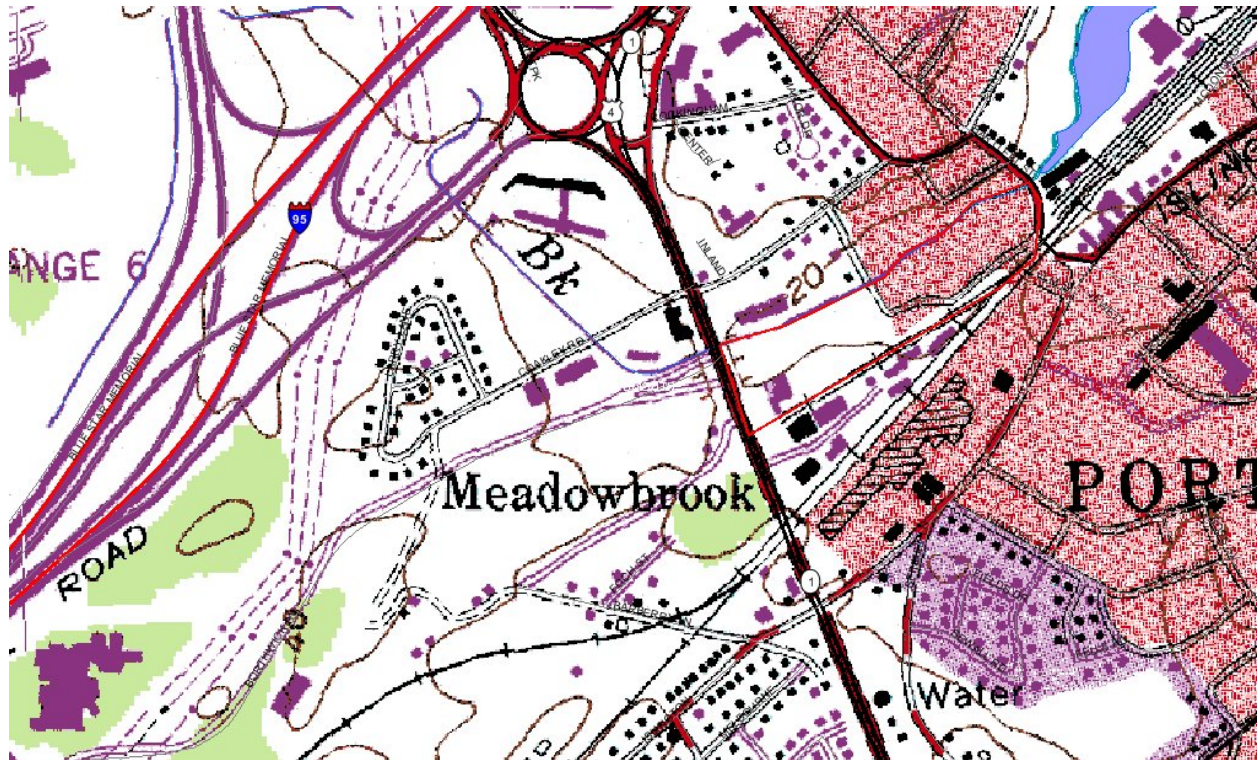

## Appendix C

---

### NRCS Soil Survey Report







United States  
Department of  
Agriculture

**NRCS**

Natural  
Resources  
Conservation  
Service

A product of the National  
Cooperative Soil Survey,  
a joint effort of the United  
States Department of  
Agriculture and other  
Federal agencies, State  
agencies including the  
Agricultural Experiment  
Stations, and local  
participants

# Custom Soil Resource Report for Rockingham County, New Hampshire



# Preface

---

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist ([http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2\\_053951](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951)).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

# Contents

---

<b>Preface</b> .....	2
<b>How Soil Surveys Are Made</b> .....	5
<b>Soil Map</b> .....	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
Rockingham County, New Hampshire.....	13
799—Urban land-Canton complex, 3 to 15 percent slopes.....	13
<b>References</b> .....	15

# How Soil Surveys Are Made

---

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

## Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

## Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.


# Soil Map

---

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.



# Custom Soil Resource Report Soil Map

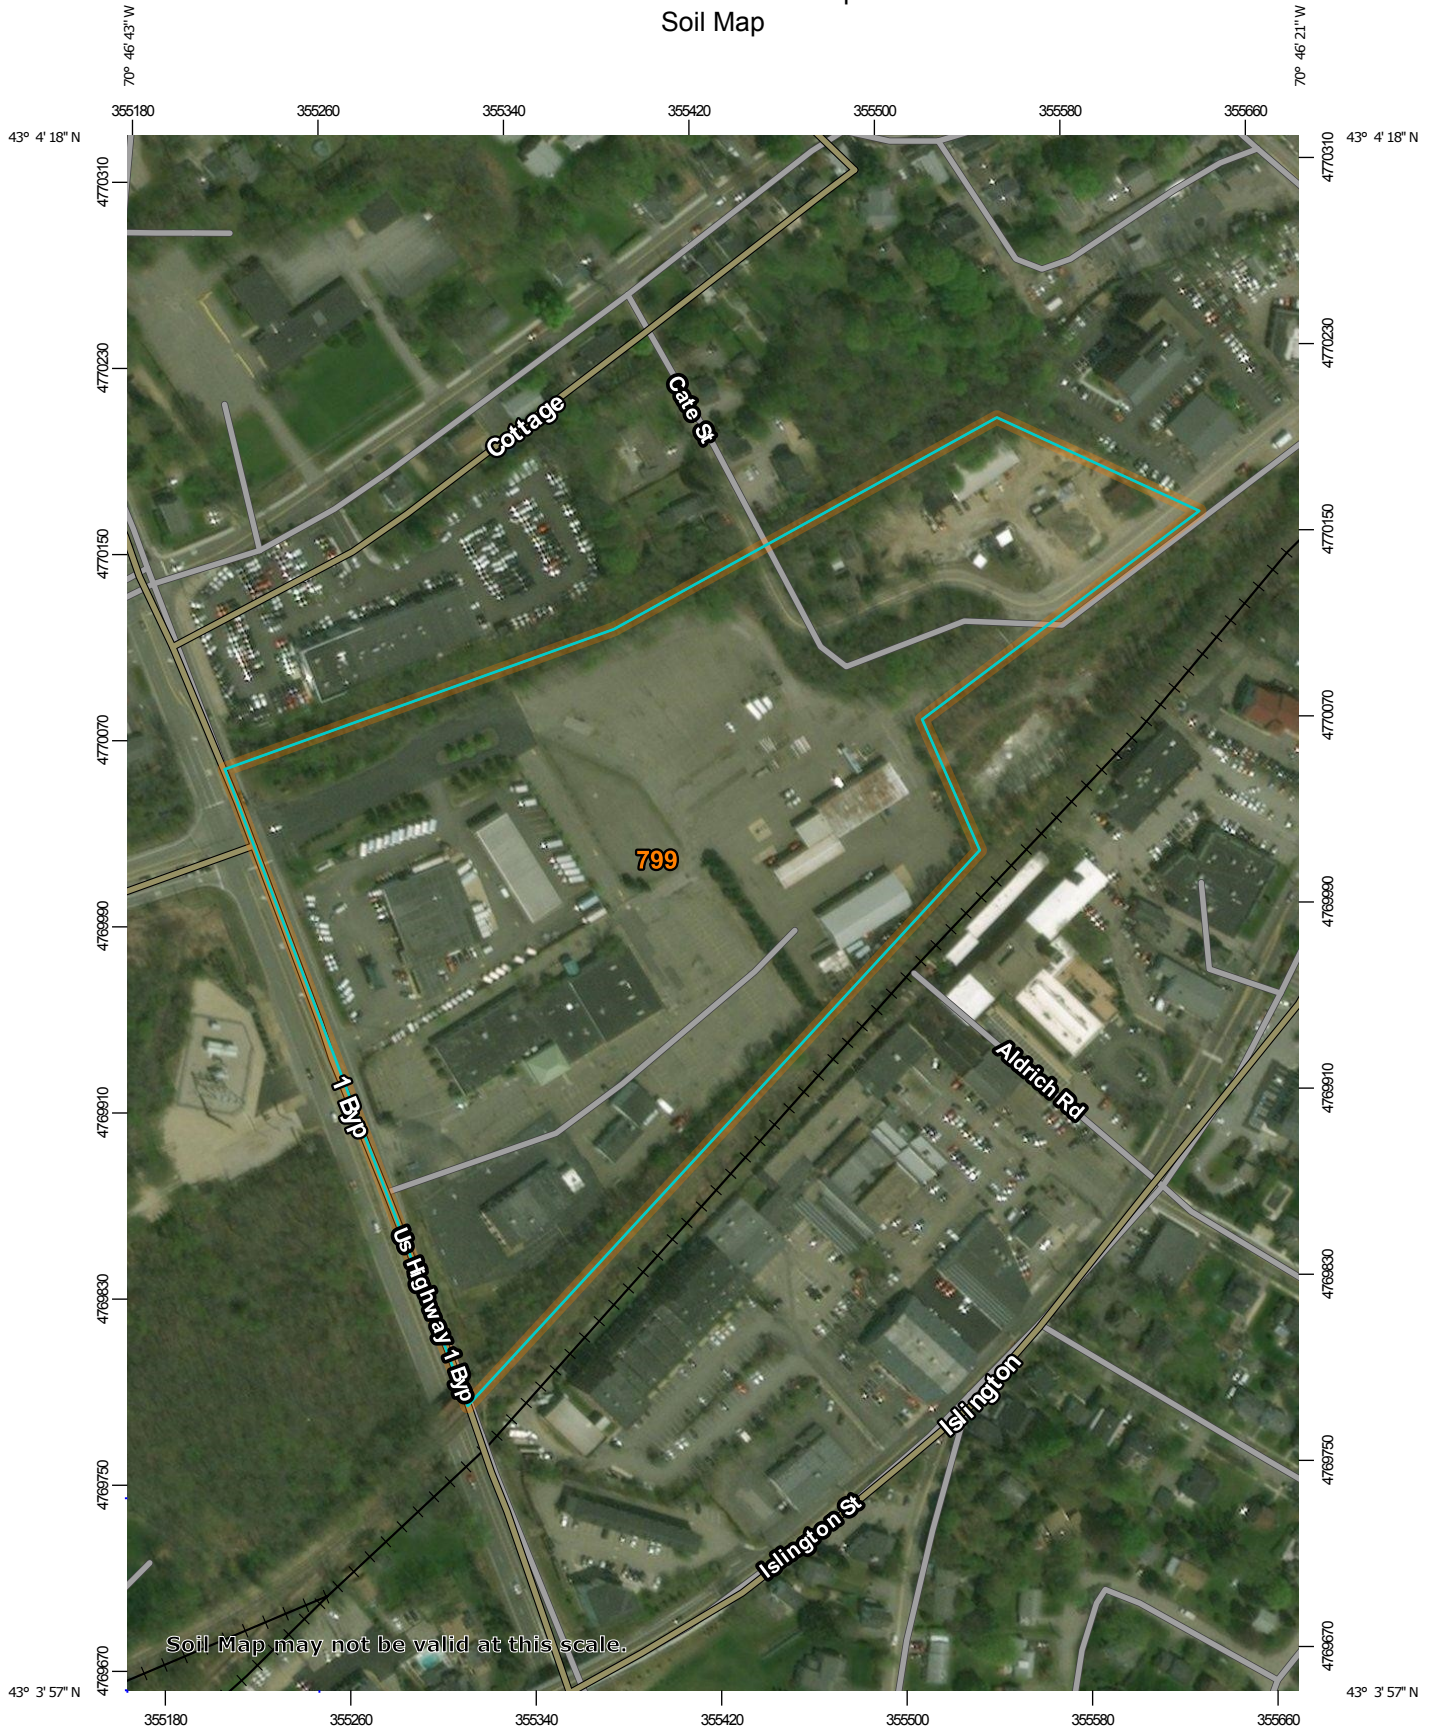


Map Scale: 1:3,260 if printed on A portrait (8.5" x 11") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 19N WGS84

### MAP LEGEND

**Area of Interest (AOI)**

 Area of Interest (AOI)




















**Soils**







 Soil Map Unit Polygons

 Soil Map Unit Lines


 Soil Map Unit Points

**Special Point Features**






-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features


**Water Features**

 Streams and Canals

**Transportation**

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

**Background**

 Aerial Photography

### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Rockingham County, New Hampshire  
 Survey Area Data: Version 19, Sep 11, 2017

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Dec 31, 2009—Sep 12, 2016

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
799	Urban land-Canton complex, 3 to 15 percent slopes	18.4	100.0%
<b>Totals for Area of Interest</b>		<b>18.4</b>	<b>100.0%</b>

## Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

## Custom Soil Resource Report

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

## Rockingham County, New Hampshire

### 799—Urban land-Canton complex, 3 to 15 percent slopes

#### Map Unit Setting

*National map unit symbol:* 9cq0  
*Elevation:* 0 to 1,000 feet  
*Mean annual precipitation:* 42 to 46 inches  
*Mean annual air temperature:* 45 to 48 degrees F  
*Frost-free period:* 120 to 160 days  
*Farmland classification:* Not prime farmland

#### Map Unit Composition

*Urban land:* 55 percent  
*Canton and similar soils:* 20 percent  
*Minor components:* 25 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### Description of Canton

##### Setting

*Parent material:* Till

##### Typical profile

*H1 - 0 to 5 inches:* gravelly fine sandy loam  
*H2 - 5 to 21 inches:* gravelly fine sandy loam  
*H3 - 21 to 60 inches:* loamy sand

##### Properties and qualities

*Slope:* 3 to 8 percent  
*Depth to restrictive feature:* More than 80 inches  
*Natural drainage class:* Well drained  
*Runoff class:* Low  
*Capacity of the most limiting layer to transmit water (Ksat):* High (2.00 to 6.00 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Available water storage in profile:* Low (about 5.3 inches)

##### Interpretive groups

*Land capability classification (irrigated):* None specified  
*Land capability classification (nonirrigated):* 2e  
*Hydrologic Soil Group:* A  
*Hydric soil rating:* No

#### Minor Components

##### Udorthents

*Percent of map unit:* 5 percent  
*Hydric soil rating:* No

##### Boxford and eldridge

*Percent of map unit:* 4 percent  
*Hydric soil rating:* No

## Custom Soil Resource Report

### **Squamscott and scitico**

*Percent of map unit: 4 percent*

*Landform: Marine terraces*

*Hydric soil rating: Yes*

### **Chatfield**

*Percent of map unit: 4 percent*

*Hydric soil rating: No*

### **Scituate and newfields**

*Percent of map unit: 4 percent*

*Hydric soil rating: No*

### **Walpole**

*Percent of map unit: 4 percent*

*Landform: Depressions*

*Hydric soil rating: Yes*



# References

---

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_054262](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262)
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053577](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577)
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053580](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580)
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2\\_053374](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374)
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

## Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2\\_054242](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242)

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053624](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624)

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. [http://www.nrcs.usda.gov/Internet/FSE\\_DOCUMENTS/nrcs142p2\\_052290.pdf](http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf)



---

## Appendix D

Aerial Photograph

Site Photographs





File Path: F:\P2018\0317A10\Civil3D\20180317A10\_COV01.dwg Layout: FIGURE 2 Plotted: Wed, July 24, 2019 - 12:10 PM User: jandretta  
 MS VIEW: Layer State: Plotter: DWG TO PDF-PC3 CTB File: FO.STB



**MAP REFERENCE:**

2015 USGS US TOPO 7.5-MINUTE MAP FOR PORTSMOUTH, NH QUADRANGLE

<b>SCALE:</b>	
HORZ.: 1" = 2000'	
VERT.: 1" = 2000'	
<b>DATUM:</b>	
HORZ.: NAD83	
VERT.: NAVD88	
<b>GRAPHIC SCALE</b>	



**FUSS & O'NEILL**  
 UPPER SQUARE BUSINESS CENTER  
 5 FLETCHER STREET, SUITE 1  
 KENNEBUNK, MAINE 04043  
 207.363.0669  
 www.fando.com

CATE STREET DEVELOPMENT, LLC

**SITE LOCATION MAP**

WEST END YARDS

PORTSMOUTH NEW HAMPSHIRE

PROJ. No.: 20180317 A10  
 DATE: 07/17/2019

**FIGURE 2**





# Cate Street Redevelopment: Existing Conditions Photo Key

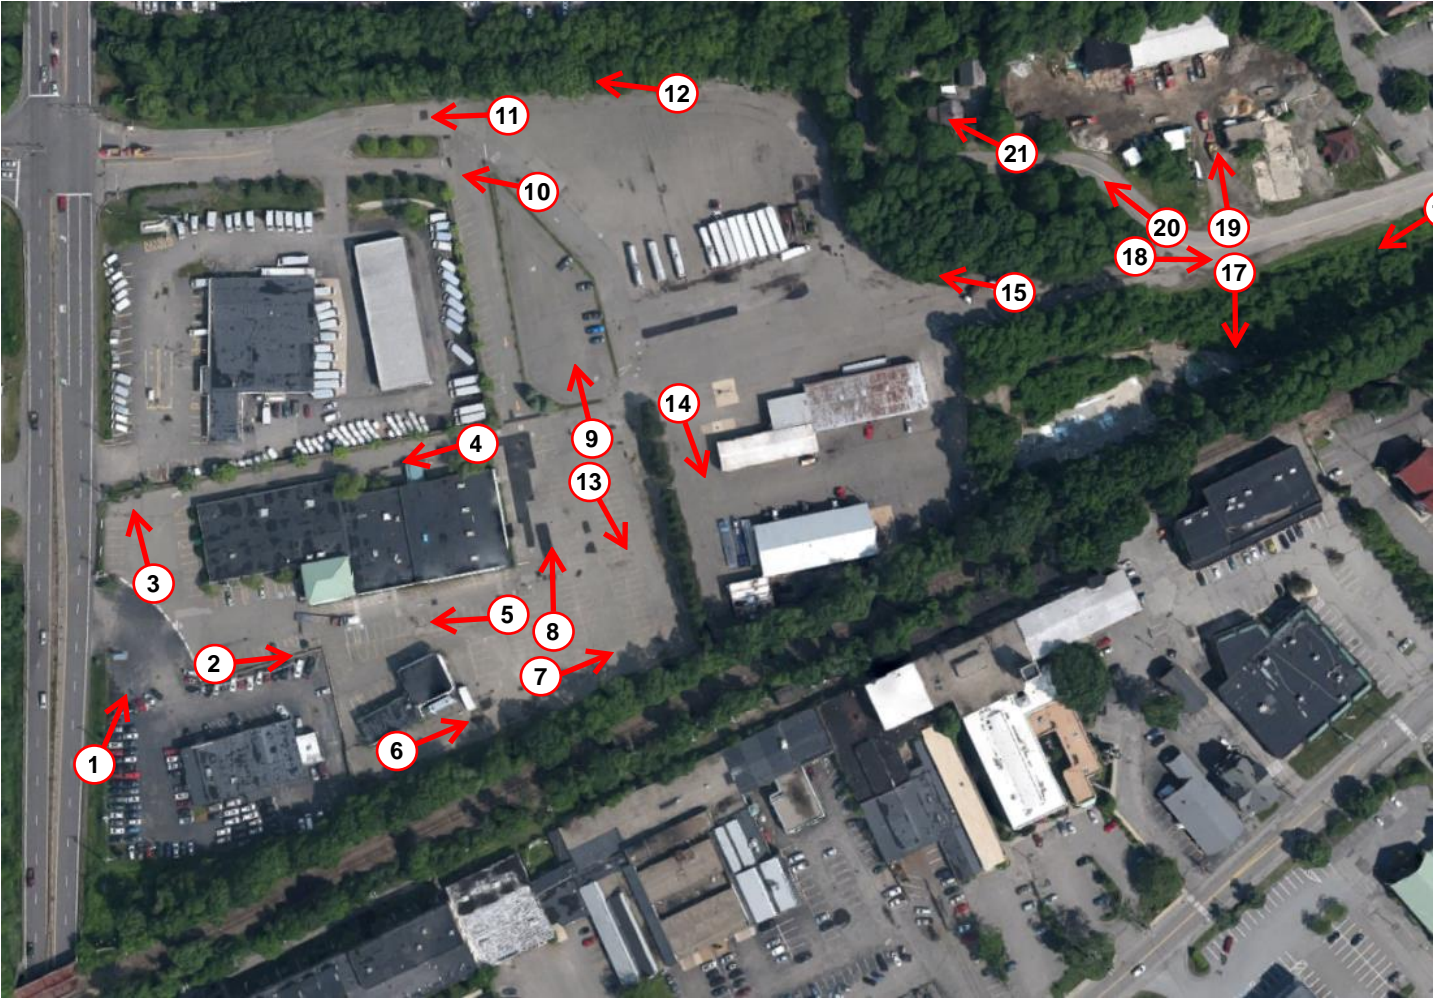






Photo 1  
View looking north at Frank Jones Center



Photo 2  
Rear of Frank Jones Center looking northeast





Photo 3

Parking area between Frank Jones center and Route 1 looking northwest



Photo 4

Front side of Frank Jones Center looking southwest towards Route 1





Photo 5

Rear of Frank Jones Center looking southwest towards Route 1



Photo 6

Building behind Frank Jones Center and railroad tracks looking northeast





Photo 7

Main parking lot at Frank Jones Center looking northeast



Photo 8

Main parking lot at Frank Jones Center looking northwest





Photo 9  
Middle Parking area looking northwest



Photo 10  
Looking west on Borthwick Ave towards Route 1





Photo 11  
View from Borthwick Ave looking towards Route 1



Photo 12  
View of Hodgson Brook looking west





Photo 13

Main parking lot at Frank Jones Center looking southeast



Photo 14

View of existing buildings looking southeast





Photo 15  
Access road off Cate Street looing west



Photo 16  
Current construction south of Cate Street looing southwest





Photo 17

Current construction south of Cate Street looing southeast



Photo 18

Current construction south of Cate Street looing northeast





Photo 19  
Existing buildings north of Cate Street



Photo 20  
Cate Street looking northeast



Photo 21  
Existing house on Cate Street



## Appendix E

---

### Groundwater Recharge Volume Calculations

### BMP Worksheets









## FILTRATION PRACTICE DESIGN CRITERIA (Env-Wq 1508.07)

Type/Node Name: \_\_\_\_\_

### BIORETENTION BASIN 1

Enter the type of filtration practice (e.g., bioretention system) and the node name in the drainage analysis, if applicable

YES		Have you reviewed the restrictions on unlined systems outlined in Env-Wq 1508.07(a)?	
0.12	ac	A = Area draining to the practice	
0.06	ac	A <sub>I</sub> = Impervious area draining to the practice	
0.50	decimal	I = percent impervious area draining to the practice, in decimal form	
0.50	unitless	R <sub>v</sub> = Runoff coefficient = 0.05 + (0.9 x I)	
0.06	ac-in	WQV = 1" x R <sub>v</sub> x A	
214	cf	WQV conversion (ac-in x 43,560 sf/ac x 1ft/12")	
53	cf	25% x WQV (check calc for sediment forebay volume)	
160	cf	75% x WQV (check calc for surface sand filter volume)	
Flow-Through Device		Method of Pretreatment? (not required for clean or roof runoff)	
53	cf	V <sub>SED</sub> = sediment forebay volume, if used for pretreatment	← ≥ 25%WQV
1,962	sf	A <sub>SA</sub> = surface area of the practice	
2.41	iph	I <sub>DESIGN</sub> = design infiltration rate <sup>1</sup>	
YES	Yes/No	If I <sub>DESIGN</sub> is < 0.50 iph, has an underdrain been provided?	
0.5	hours	T <sub>DRAIN</sub> = drain time = V / (A <sub>SA</sub> * I <sub>DESIGN</sub> )	← ≤ 72-hrs
13.67	feet	E <sub>FC</sub> = elevation of the bottom of the filter course material <sup>2</sup>	
12.67	feet	E <sub>UD</sub> = invert elevation of the underdrain (UD), if applicable	
16.40	feet	E <sub>SHWT</sub> = elevation of SHWT (if none found, enter the lowest elevation of the test pit)	
12.40	feet	E <sub>ROCK</sub> = elevation of bedrock (if none found, enter the lowest elevation of the test pit)	
1.00	feet	D <sub>FC to UD</sub> = depth to UD from the bottom of the filter course	← ≥ 1'
1.27	feet	D <sub>FC to ROCK</sub> = depth to bedrock from the bottom of the filter course	← ≥ 1'
(2.73)	feet	D <sub>FC to SHWT</sub> = depth to SHWT from the bottom of the filter course	← ≥ 1'
16.11	ft	Peak elevation of the 50-year storm event (infiltration can be used in analysis)	
17.00	ft	Elevation of the top of the practice	
YES		50 peak elevation ≤ Elevation of the top of the practice	← yes

**If a surface sand filter or underground sand filter is proposed:**

YES	ac	Drainage Area check.	← < 10 ac
	cf	V = volume of storage <sup>3</sup> (attach a stage-storage table)	← ≥ 75%WQV
	inches	D <sub>FC</sub> = filter course thickness	← 18", or 24" if within GPA
Sheet		Note what sheet in the plan set contains the filter course specification	
	Yes/No	Access grate provided?	← yes





**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/24/2019

**Stage-Area-Storage for Pond 27 BRB1:**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
15.50	1,013	0	16.24	1,304	856	16.98	1,611	1,934
15.52	1,021	20	16.26	1,312	882	17.00	<b>1,620</b>	<b>1,966</b>
15.54	1,028	41	16.28	1,320	909			
15.56	1,036	61	16.30	1,328	935			
15.58	1,043	82	16.32	1,336	962			
15.60	1,051	103	16.34	1,345	989			
15.62	1,058	124	16.36	1,353	1,016			
15.64	1,066	146	16.38	1,361	1,043			
15.66	1,074	167	16.40	1,369	1,070			
15.68	1,082	188	16.42	1,378	1,098			
15.70	1,089	210	16.44	1,386	1,125			
15.72	1,097	232	16.46	1,394	1,153			
15.74	1,105	254	16.48	1,403	1,181			
15.76	1,113	276	16.50	1,411	1,209			
15.78	1,121	299	16.52	1,419	1,237			
15.80	1,129	321	16.54	1,427	1,266			
15.82	1,136	344	16.56	1,435	1,295			
15.84	1,144	367	16.58	1,443	1,323			
15.86	1,152	389	16.60	1,452	1,352			
15.88	1,160	413	16.62	1,460	1,381			
15.90	1,168	436	16.64	1,468	1,411			
15.92	1,176	459	16.66	1,476	1,440			
15.94	1,185	483	16.68	1,485	1,470			
15.96	1,193	507	16.70	1,493	1,499			
15.98	1,201	531	16.72	1,501	1,529			
16.00	1,209	555	16.74	1,510	1,560			
16.02	1,217	579	16.76	1,518	1,590			
16.04	1,225	603	16.78	1,526	1,620			
16.06	1,232	628	16.80	1,535	1,651			
16.08	1,240	653	16.82	1,543	1,682			
16.10	1,248	678	16.84	1,552	1,713			
16.12	1,256	703	16.86	1,560	1,744			
16.14	1,264	728	16.88	1,569	1,775			
16.16	1,272	753	16.90	1,577	1,806			
16.18	1,280	779	16.92	1,586	1,838			
16.20	1,288	804	16.94	1,594	1,870			
16.22	1,296	830	16.96	1,603	1,902			





## FILTRATION PRACTICE DESIGN CRITERIA (Env-Wq 1508.07)

Type/Node Name: \_\_\_\_\_

### BIORETENTION BASIN 2

Enter the type of filtration practice (e.g., bioretention system) and the node name in the drainage analysis, if applicable

yes		Have you reviewed the restrictions on unlined systems outlined in Env-Wq 1508.07(a)?	
0.29	ac	A = Area draining to the practice	
0.19	ac	A <sub>I</sub> = Impervious area draining to the practice	
0.65	decimal	I = percent impervious area draining to the practice, in decimal form	
0.64	unitless	R <sub>v</sub> = Runoff coefficient = 0.05 + (0.9 x I)	
0.19	ac-in	WQV = 1" x R <sub>v</sub> x A	
675	cf	WQV conversion (ac-in x 43,560 sf/ac x 1ft/12")	
169	cf	25% x WQV (check calc for sediment forebay volume)	
506	cf	75% x WQV (check calc for surface sand filter volume)	
<b>Flow-Through Device</b>			
Method of Pretreatment? (not required for clean or roof runoff)			
169	cf	V <sub>SED</sub> = sediment forebay volume, if used for pretreatment	← ≥ 25%WQV
2,826	sf	A <sub>SA</sub> = surface area of the practice	
2.41	iph	I <sub>DESIGN</sub> = design infiltration rate <sup>1</sup>	
YES	Yes/No	If I <sub>DESIGN</sub> is < 0.50 iph, has an underdrain been provided?	
1.2	hours	T <sub>DRAIN</sub> = drain time = V / (A <sub>SA</sub> * I <sub>DESIGN</sub> )	← ≤ 72-hrs
16.67	feet	E <sub>FC</sub> = elevation of the bottom of the filter course material <sup>2</sup>	
15.67	feet	E <sub>UD</sub> = invert elevation of the underdrain (UD), if applicable	
20.40	feet	E <sub>SHWT</sub> = elevation of SHWT (if none found, enter the lowest elevation of the test pit)	
17.73	feet	E <sub>ROCK</sub> = elevation of bedrock (if none found, enter the lowest elevation of the test pit)	
1.00	feet	D <sub>FC to UD</sub> = depth to UD from the bottom of the filter course	← ≥ 1'
(1.06)	feet	D <sub>FC to ROCK</sub> = depth to bedrock from the bottom of the filter course	← ≥ 1'
(3.73)	feet	D <sub>FC to SHWT</sub> = depth to SHWT from the bottom of the filter course	← ≥ 1'
18.28	ft	Peak elevation of the 50-year storm event (infiltration can be used in analysis)	
19.00	ft	Elevation of the top of the practice	
YES		50 peak elevation ≤ Elevation of the top of the practice	← yes

**If a surface sand filter or underground sand filter is proposed:**

YES	ac	Drainage Area check.	← < 10 ac
	cf	V = volume of storage <sup>3</sup> (attach a stage-storage table)	← ≥ 75%WQV
	inches	D <sub>FC</sub> = filter course thickness	← 18", or 24" if within GPA
Sheet		Note what sheet in the plan set contains the filter course specification	
	Yes/No	Access grate provided?	← yes

**If a bioretention area is proposed:**

YES	ac	Drainage Area no larger than 5 ac?	← yes
1,774	cf	V = volume of storage <sup>3</sup> (attach a stage-storage table)	← ≥ WQV
18.0	inches	D <sub>FC</sub> = filter course thickness	← 18", or 24" if within GPA
Sheet	CD511	Note what sheet in the plan set contains the filter course specification	
3.0	:1	Pond side slopes	← ≥3:1
Sheet	L SHTS	Note what sheet in the plan set contains the planting plans and surface cover	

**If porous pavement is proposed:**

		Type of pavement proposed (concrete? Asphalt? Pavers? Etc)	
	acres	A <sub>SA</sub> = surface area of the pervious pavement	
#DIV/0!	:1	ratio of the contributing area to the pervious surface area	← 5:1
	inches	D <sub>FC</sub> = filter course thickness	← 12", or 18" if within GPA
Sheet		Note what sheet in the plan set contains the filter course spec.	← 304.1 sand

1. Rate of the limiting layer (either the filter course or the underlying soil). See Env-Wq 1504.14 for guidance on determining the infiltration rate.
2. See lines 34, 40 and 48 for required depths of filter media.
3. Volume without depending on infiltration. The volume includes the storage above the filter (but below the invert of the outlet structure, if any), the filter media voids, and the pretreatment area. The storage above the filter media shall not include the volume above the outlet structure, if any.

Designer's Notes:

---



---



---



---



---



---



---



---



---



---



---



---



---



---



---



---



---



---



---



---



---



---

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/24/2019

**Stage-Area-Storage for Pond 41 BRB2:**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
17.50	1,563	0	18.24	1,877	1,272	18.98	2,206	2,782
17.52	1,571	31	18.26	1,886	1,309	19.00	<b>2,215</b>	<b>2,826</b>
17.54	1,579	63	18.28	1,895	1,347	19.02	2,215	2,826
17.56	1,588	95	18.30	1,903	1,385	19.04	2,215	2,826
17.58	1,596	126	18.32	1,912	1,423	19.06	2,215	2,826
17.60	1,604	158	18.34	1,921	1,462	19.08	2,215	2,826
17.62	1,612	191	18.36	1,930	1,500	19.10	2,215	2,826
17.64	1,621	223	18.38	1,939	1,539	19.12	2,215	2,826
17.66	1,629	255	18.40	1,947	1,578	19.14	2,215	2,826
17.68	1,637	288	18.42	1,956	1,617	19.16	2,215	2,826
17.70	1,646	321	18.44	1,965	1,656	19.18	2,215	2,826
17.72	1,654	354	18.46	1,974	1,695	19.20	2,215	2,826
17.74	1,663	387	18.48	1,983	1,735	19.22	2,215	2,826
17.76	1,671	420	18.50	1,992	1,775	19.24	2,215	2,826
17.78	1,680	454	18.52	2,001	1,815	19.26	2,215	2,826
17.80	1,688	488	18.54	2,009	1,855	19.28	2,215	2,826
17.82	1,697	521	18.56	2,018	1,895	19.30	2,215	2,826
17.84	1,705	555	18.58	2,027	1,935	19.32	2,215	2,826
17.86	1,714	590	18.60	2,036	1,976	19.34	2,215	2,826
17.88	1,722	624	18.62	2,044	2,017	19.36	2,215	2,826
17.90	1,731	658	18.64	2,053	2,058	19.38	2,215	2,826
17.92	1,739	693	18.66	2,062	2,099	19.40	2,215	2,826
17.94	1,748	728	18.68	2,071	2,140	19.42	2,215	2,826
17.96	1,757	763	18.70	2,080	2,182	19.44	2,215	2,826
17.98	1,765	798	18.72	2,089	2,223	19.46	2,215	2,826
18.00	1,774	834	18.74	2,098	2,265	19.48	2,215	2,826
18.02	1,782	869	18.76	2,106	2,307	19.50	2,215	2,826
18.04	1,791	905	18.78	2,115	2,350			
18.06	1,799	941	18.80	2,124	2,392			
18.08	1,808	977	18.82	2,133	2,435			
18.10	1,817	1,013	18.84	2,142	2,477			
18.12	1,825	1,050	18.86	2,151	2,520			
18.14	1,834	1,086	18.88	2,160	2,563			
18.16	1,842	1,123	18.90	2,169	2,607			
18.18	1,851	1,160	18.92	2,179	2,650			
18.20	1,860	1,197	18.94	2,188	2,694			
18.22	1,868	1,234	18.96	2,197	2,738			







## INFILTRATION PRACTICE CRITERIA (Env-Wq 1508.06)

**Type/Node Name: Underground Infiltration Basin #1**

Enter the type of infiltration practice (e.g., basin, trench) and the node name in the drainage analysis, if applicable

<b>Yes</b>	Have you reviewed Env-Wq 1508.06(a) to ensure that infiltration is allowed?	
0.85 ac	A = Area draining to the practice	
0.85 ac	$A_I$ = Impervious area draining to the practice	
1.00 decimal	I = percent impervious area draining to the practice, in decimal form	
0.95 unitless	$R_v$ = Runoff coefficient = $0.05 + (0.9 \times I)$	
0.81 ac-in	$WQV = 1'' \times R_v \times A$	
2,940 cf	WQV conversion (ac-in x 43,560 sf/ac x 1ft/12")	
735 cf	25% x WQV (check calc for sediment forebay volume)	
N/A	Method of pretreatment? (not required for clean or roof runoff)	
- cf	$V_{SED}$ = sediment forebay volume, if used for pretreatment	← $\geq 25\%WQV$
1,100 cf	V = volume <sup>1</sup> (attach a stage-storage table)	← $\geq WQV$
3,889 sf	$A_{SA}$ = surface area of the bottom of the pond	
0.97 iph	$I_{DESIGN}$ = design infiltration rate <sup>2</sup>	
3.5 hours	$T_{DRAIN}$ = drain time = $V / (A_{SA} * I_{DESIGN})$	← $\leq 1/2$ -nrs
20.50 feet	$E_{BTM}$ = elevation of the bottom of the basin	
17.00 feet	$E_{SHWT}$ = elevation of SHWT (if none found, enter the lowest elevation of the test pit)	
13.80 feet	$E_{ROCK}$ = elevation of bedrock (if none found, enter the lowest elevation of the test pit)	
3.50 feet	$D_{SHWT}$ = separation from SHWT	← $\geq *^3$
6.7 feet	$D_{ROCK}$ = separation from bedrock	← $\geq *^3$
N/A ft	$D_{amend}$ = Depth of amended soil, if applicable due high infiltration rate	← $\geq 24''$
N/A ft	$D_T$ = depth of trench, if trench proposed	← 4 - 10 ft
Yes Yes/No	If a trench or underground system is proposed, observation well provided <sup>4</sup>	
N/A	If a trench is proposed, material in trench	
Stone	If a basin is proposed, basin floor material	
No Yes/No	If a basin is proposed, the perimeter should be curvilinear, basin floor shall be flat.	
0.0 :1	If a basin is proposed, pond side slopes	← $\geq 3:1$
22.20 ft	Peak elevation of the 10-year storm event (infiltration can be used in analysis)	
23.48 ft	Peak elevation of the 50-year storm event (infiltration can be used in analysis)	
24.00 ft	Elevation of the top of the practice (if a basin, this is the elevation of the berm)	
YES	10 peak elevation $\leq$ Elevation of the top of the trench? <sup>5</sup>	← yes
YES	If a basin is proposed, 50-year peak elevation $\leq$ Elevation of berm?	← yes

1. Volume below the lowest invert of the outlet structure and excludes forebay volume
2. See Env-Wq 1504.14 for requirements for determining the infiltration rate
3. 1' separation if treatment not required; 4' for treatment in GPAs & WSIPAs; & 3' in all other areas.
4. Clean, washed well graded diameter of 1.5 to 3 inches above the in-situ soil.
5. If 50-year peak elevation exceeds top of trench, the overflow must be routed in HydroCAD as secondary discharge.

**Designer's Notes:** \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_



## INFILTRATION PRACTICE CRITERIA (Env-Wq 1508.06)

**Type/Node Name:** **Underground Infiltration Basin #2**

Enter the type of infiltration practice (e.g., basin, trench) and the node name in the drainage analysis, if applicable

<b>Yes</b>	Have you reviewed Env-Wq 1508.06(a) to ensure that infiltration is allowed?	
0.65 ac	A = Area draining to the practice	
0.65 ac	$A_I$ = Impervious area draining to the practice	
1.00 decimal	I = percent impervious area draining to the practice, in decimal form	
0.95 unitless	$R_v$ = Runoff coefficient = $0.05 + (0.9 \times I)$	
0.62 ac-in	$WQV = 1'' \times R_v \times A$	
2,258 cf	WQV conversion (ac-in x 43,560 sf/ac x 1ft/12")	
564 cf	25% x WQV (check calc for sediment forebay volume)	
N/A	Method of pretreatment? (not required for clean or roof runoff)	
- cf	$V_{SED}$ = sediment forebay volume, if used for pretreatment	← $\geq 25\%WQV$
639 cf	V = volume <sup>1</sup> (attach a stage-storage table)	← $\geq WQV$
2,264 sf	$A_{SA}$ = surface area of the bottom of the pond	
0.97 iph	$I_{DESIGN}$ = design infiltration rate <sup>2</sup>	
3.5 hours	$T_{DRAIN}$ = drain time = $V / (A_{SA} * I_{DESIGN})$	← $\leq 1/2$ -nrs
18.00 feet	$E_{BTM}$ = elevation of the bottom of the basin	
17.00 feet	$E_{SHWT}$ = elevation of SHWT (if none found, enter the lowest elevation of the test pit)	
16.20 feet	$E_{ROCK}$ = elevation of bedrock (if none found, enter the lowest elevation of the test pit)	
1.00 feet	$D_{SHWT}$ = separation from SHWT	← $\geq *^3$
1.8 feet	$D_{ROCK}$ = separation from bedrock	← $\geq *^3$
N/A ft	$D_{amend}$ = Depth of amended soil, if applicable due high infiltration rate	← $\geq 24''$
N/A ft	$D_T$ = depth of trench, if trench proposed	← 4 - 10 ft
Yes Yes/No	If a trench or underground system is proposed, observation well provided <sup>4</sup>	
N/A	If a trench is proposed, material in trench	
Stone	If a basin is proposed, basin floor material	
No Yes/No	If a basin is proposed, the perimeter should be curvilinear, basin floor shall be flat.	
0.0 :1	If a basin is proposed, pond side slopes	← $\geq 3:1$
19.64 ft	Peak elevation of the 10-year storm event (infiltration can be used in analysis)	
20.46 ft	Peak elevation of the 50-year storm event (infiltration can be used in analysis)	
21.50 ft	Elevation of the top of the practice (if a basin, this is the elevation of the berm)	
YES	10 peak elevation $\leq$ Elevation of the top of the trench? <sup>5</sup>	← yes
YES	If a basin is proposed, 50-year peak elevation $\leq$ Elevation of berm?	← yes

1. Volume below the lowest invert of the outlet structure and excludes forebay volume
2. See Env-Wq 1504.14 for requirements for determining the infiltration rate
3. 1' separation if treatment not required; 4' for treatment in GPAs & WSIPAs; & 3' in all other areas.
4. Clean, washed well graded diameter of 1.5 to 3 inches above the in-situ soil.
5. If 50-year peak elevation exceeds top of trench, the overflow must be routed in HydroCAD as secondary discharge.

**Designer's Notes:** \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_



## INFILTRATION PRACTICE CRITERIA (Env-Wq 1508.06)

**Type/Node Name: Underground Infiltration Basin #3**

Enter the type of infiltration practice (e.g., basin, trench) and the node name in the drainage analysis, if applicable

<b>Yes</b>	Have you reviewed Env-Wq 1508.06(a) to ensure that infiltration is allowed?		
2.10	ac	A = Area draining to the practice	
1.48	ac	$A_I$ = Impervious area draining to the practice	
0.71	decimal	I = percent impervious area draining to the practice, in decimal form	
0.68	unitless	$R_v$ = Runoff coefficient = $0.05 + (0.9 \times I)$	
1.44	ac-in	$WQV = 1'' \times R_v \times A$	
5,216	cf	WQV conversion (ac-in x 43,560 sf/ac x 1ft/12")	
1,304	cf	25% x WQV (check calc for sediment forebay volume)	
<b>Deep Sump CB</b> Method of pretreatment? (not required for clean or roof runoff)			
-	cf	$V_{SED}$ = sediment forebay volume, if used for pretreatment	← $\geq 25\%WQV$
2,469	cf	V = volume <sup>1</sup> (attach a stage-storage table)	← $\geq WQV$
8,686	sf	$A_{SA}$ = surface area of the bottom of the pond	
0.97	iph	$I_{DESIGN}$ = design infiltration rate <sup>2</sup>	
3.5	hours	$T_{DRAIN}$ = drain time = $V / (A_{SA} * I_{DESIGN})$	← $\leq 1/2$ -nrs
18.00	feet	$E_{BTM}$ = elevation of the bottom of the basin	
17.00	feet	$E_{SHWT}$ = elevation of SHWT (if none found, enter the lowest elevation of the test pit)	
16.20	feet	$E_{ROCK}$ = elevation of bedrock (if none found, enter the lowest elevation of the test pit)	
1.00	feet	$D_{SHWT}$ = separation from SHWT	← $\geq *^3$
1.8	feet	$D_{ROCK}$ = separation from bedrock	← $\geq *^3$
N/A	ft	$D_{amend}$ = Depth of amended soil, if applicable due high infiltration rate	← $\geq 24''$
N/A	ft	$D_T$ = depth of trench, if trench proposed	← 4 - 10 ft
Yes	Yes/No	If a trench or underground system is proposed, observation well provided <sup>4</sup>	
N/A		If a trench is proposed, material in trench	
Stone		If a basin is proposed, basin floor material	
No	Yes/No	If a basin is proposed, the perimeter should be curvilinear, basin floor shall be flat.	
0.0	:1	If a basin is proposed, pond side slopes	← $\geq 3:1$
19.92	ft	Peak elevation of the 10-year storm event (infiltration can be used in analysis)	
21.42	ft	Peak elevation of the 50-year storm event (infiltration can be used in analysis)	
21.50	ft	Elevation of the top of the practice (if a basin, this is the elevation of the berm)	
YES		10 peak elevation $\leq$ Elevation of the top of the trench? <sup>5</sup>	← yes
YES		If a basin is proposed, 50-year peak elevation $\leq$ Elevation of berm?	← yes

1. Volume below the lowest invert of the outlet structure and excludes forebay volume
2. See Env-Wq 1504.14 for requirements for determining the infiltration rate
3. 1' separation if treatment not required; 4' for treatment in GPAs & WSIPAs; & 3' in all other areas.
4. Clean, washed well graded diameter of 1.5 to 3 inches above the in-situ soil.
5. If 50-year peak elevation exceeds top of trench, the overflow must be routed in HydroCAD as secondary discharge.

**Designer's Notes:** \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_



# Appendix F

---

## Hydrologic Analysis



## Appendix F1

---

### NRCC Extreme Precipitation Tables





# Extreme Precipitation Tables

## Northeast Regional Climate Center

Data represents point estimates calculated from partial duration series. All precipitation amounts are displayed in inches.

<b>Smoothing</b>	Yes
<b>State</b>	New Hampshire
<b>Location</b>	
<b>Longitude</b>	70.776 degrees West
<b>Latitude</b>	43.068 degrees North
<b>Elevation</b>	0 feet
<b>Date/Time</b>	Thu, 12 Apr 2018 14:10:02 -0400

### Extreme Precipitation Estimates

	5min	10min	15min	30min	60min	120min		1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
<b>1yr</b>	0.26	0.40	0.50	0.65	0.81	1.04	<b>1yr</b>	0.70	0.98	1.21	1.56	2.00	2.66	3.92	<b>1yr</b>	2.35	2.81	3.22	3.94	4.55	<b>1yr</b>
<b>2yr</b>	0.32	0.50	0.62	0.81	1.02	1.30	<b>2yr</b>	0.88	1.18	1.52	1.94	2.49	3.21	4.57	<b>2yr</b>	2.84	3.43	3.94	4.68	5.33	<b>2yr</b>
<b>5yr</b>	0.37	0.58	0.73	0.97	1.25	1.60	<b>5yr</b>	1.08	1.46	1.88	2.43	3.14	4.07	5.58	<b>5yr</b>	3.60	4.40	5.04	5.93	6.70	<b>5yr</b>
<b>10yr</b>	0.41	0.65	0.82	1.11	1.45	1.89	<b>10yr</b>	1.25	1.72	2.23	2.89	3.73	4.87	6.53	<b>10yr</b>	4.31	5.32	6.08	7.11	7.98	<b>10yr</b>
<b>25yr</b>	0.48	0.76	0.96	1.33	1.77	2.33	<b>25yr</b>	1.53	2.14	2.77	3.62	4.74	6.17	8.10	<b>25yr</b>	5.46	6.83	7.80	9.02	10.05	<b>25yr</b>
<b>50yr</b>	0.53	0.86	1.10	1.53	2.06	2.75	<b>50yr</b>	1.78	2.52	3.28	4.32	5.66	7.39	9.58	<b>50yr</b>	6.54	8.25	9.42	10.81	11.98	<b>50yr</b>
<b>100yr</b>	0.59	0.96	1.24	1.76	2.41	3.24	<b>100yr</b>	2.08	2.97	3.89	5.15	6.76	8.86	11.38	<b>100yr</b>	7.84	9.98	11.37	12.96	14.28	<b>100yr</b>
<b>200yr</b>	0.67	1.10	1.42	2.04	2.81	3.82	<b>200yr</b>	2.43	3.50	4.60	6.11	8.07	10.61	13.55	<b>200yr</b>	9.39	12.07	13.74	15.55	17.04	<b>200yr</b>
<b>500yr</b>	0.79	1.31	1.70	2.47	3.46	4.74	<b>500yr</b>	2.98	4.36	5.74	7.68	10.22	13.49	17.15	<b>500yr</b>	11.94	15.53	17.65	19.78	21.52	<b>500yr</b>

### Lower Confidence Limits

	5min	10min	15min	30min	60min	120min		1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
<b>1yr</b>	0.23	0.36	0.44	0.59	0.73	0.89	<b>1yr</b>	0.63	0.87	0.92	1.32	1.67	2.22	2.51	<b>1yr</b>	1.97	2.41	2.86	3.16	3.88	<b>1yr</b>
<b>2yr</b>	0.31	0.49	0.60	0.81	1.00	1.19	<b>2yr</b>	0.86	1.16	1.37	1.82	2.34	3.06	3.45	<b>2yr</b>	2.70	3.32	3.82	4.55	5.08	<b>2yr</b>
<b>5yr</b>	0.35	0.54	0.67	0.92	1.17	1.40	<b>5yr</b>	1.01	1.37	1.61	2.12	2.74	3.79	4.20	<b>5yr</b>	3.36	4.04	4.72	5.54	6.25	<b>5yr</b>
<b>10yr</b>	0.39	0.59	0.73	1.03	1.33	1.60	<b>10yr</b>	1.14	1.56	1.81	2.39	3.06	4.38	4.87	<b>10yr</b>	3.87	4.69	5.45	6.42	7.21	<b>10yr</b>
<b>25yr</b>	0.44	0.67	0.83	1.19	1.56	1.90	<b>25yr</b>	1.35	1.86	2.10	2.76	3.54	4.70	5.91	<b>25yr</b>	4.16	5.69	6.67	7.81	8.70	<b>25yr</b>
<b>50yr</b>	0.48	0.73	0.91	1.31	1.77	2.17	<b>50yr</b>	1.52	2.12	2.35	3.08	3.94	5.31	6.83	<b>50yr</b>	4.70	6.57	7.76	9.07	10.04	<b>50yr</b>
<b>100yr</b>	0.54	0.81	1.02	1.47	2.01	2.47	<b>100yr</b>	1.74	2.42	2.63	3.43	4.37	5.96	7.89	<b>100yr</b>	5.27	7.59	9.02	10.54	11.59	<b>100yr</b>
<b>200yr</b>	0.59	0.89	1.13	1.64	2.28	2.82	<b>200yr</b>	1.97	2.75	2.94	3.80	4.82	6.67	9.12	<b>200yr</b>	5.90	8.77	10.49	12.27	13.41	<b>200yr</b>
<b>500yr</b>	0.69	1.02	1.32	1.91	2.72	3.37	<b>500yr</b>	2.35	3.29	3.41	4.34	5.49	7.75	11.03	<b>500yr</b>	6.86	10.61	12.81	15.02	16.23	<b>500yr</b>

### Upper Confidence Limits

	5min	10min	15min	30min	60min	120min		1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
<b>1yr</b>	0.28	0.44	0.54	0.72	0.89	1.08	<b>1yr</b>	0.77	1.06	1.26	1.74	2.21	2.99	3.15	<b>1yr</b>	2.65	3.03	3.58	4.38	5.05	<b>1yr</b>
<b>2yr</b>	0.34	0.52	0.64	0.86	1.06	1.27	<b>2yr</b>	0.92	1.24	1.48	1.96	2.51	3.43	3.70	<b>2yr</b>	3.03	3.56	4.08	4.83	5.64	<b>2yr</b>
<b>5yr</b>	0.40	0.62	0.76	1.05	1.33	1.62	<b>5yr</b>	1.15	1.58	1.88	2.53	3.25	4.34	4.95	<b>5yr</b>	3.84	4.76	5.37	6.36	7.14	<b>5yr</b>
<b>10yr</b>	0.47	0.72	0.89	1.24	1.61	1.97	<b>10yr</b>	1.39	1.93	2.28	3.10	3.94	5.34	6.19	<b>10yr</b>	4.72	5.95	6.79	7.82	8.74	<b>10yr</b>
<b>25yr</b>	0.57	0.87	1.09	1.55	2.04	2.56	<b>25yr</b>	1.76	2.50	2.95	4.06	5.13	7.81	8.31	<b>25yr</b>	6.91	7.99	9.10	10.31	11.39	<b>25yr</b>
<b>50yr</b>	0.67	1.02	1.27	1.82	2.45	3.12	<b>50yr</b>	2.11	3.05	3.59	4.99	6.29	9.78	10.41	<b>50yr</b>	8.66	10.01	11.37	12.69	13.93	<b>50yr</b>
<b>100yr</b>	0.78	1.19	1.49	2.15	2.94	3.79	<b>100yr</b>	2.54	3.71	4.36	6.14	7.72	12.25	13.04	<b>100yr</b>	10.84	12.54	14.20	15.65	17.05	<b>100yr</b>
<b>200yr</b>	0.92	1.38	1.75	2.53	3.53	4.63	<b>200yr</b>	3.05	4.52	5.32	7.55	9.47	15.38	16.35	<b>200yr</b>	13.61	15.72	17.75	19.28	20.87	<b>200yr</b>
<b>500yr</b>	1.14	1.69	2.18	3.16	4.50	6.00	<b>500yr</b>	3.88	5.87	6.90	9.98	12.44	20.79	22.06	<b>500yr</b>	18.40	21.21	23.87	25.41	27.28	<b>500yr</b>








## Appendix F2.1

---

Pre-Development Hydrologic Analysis:  
Drainage Diagram, Area Listing & Soil Listing



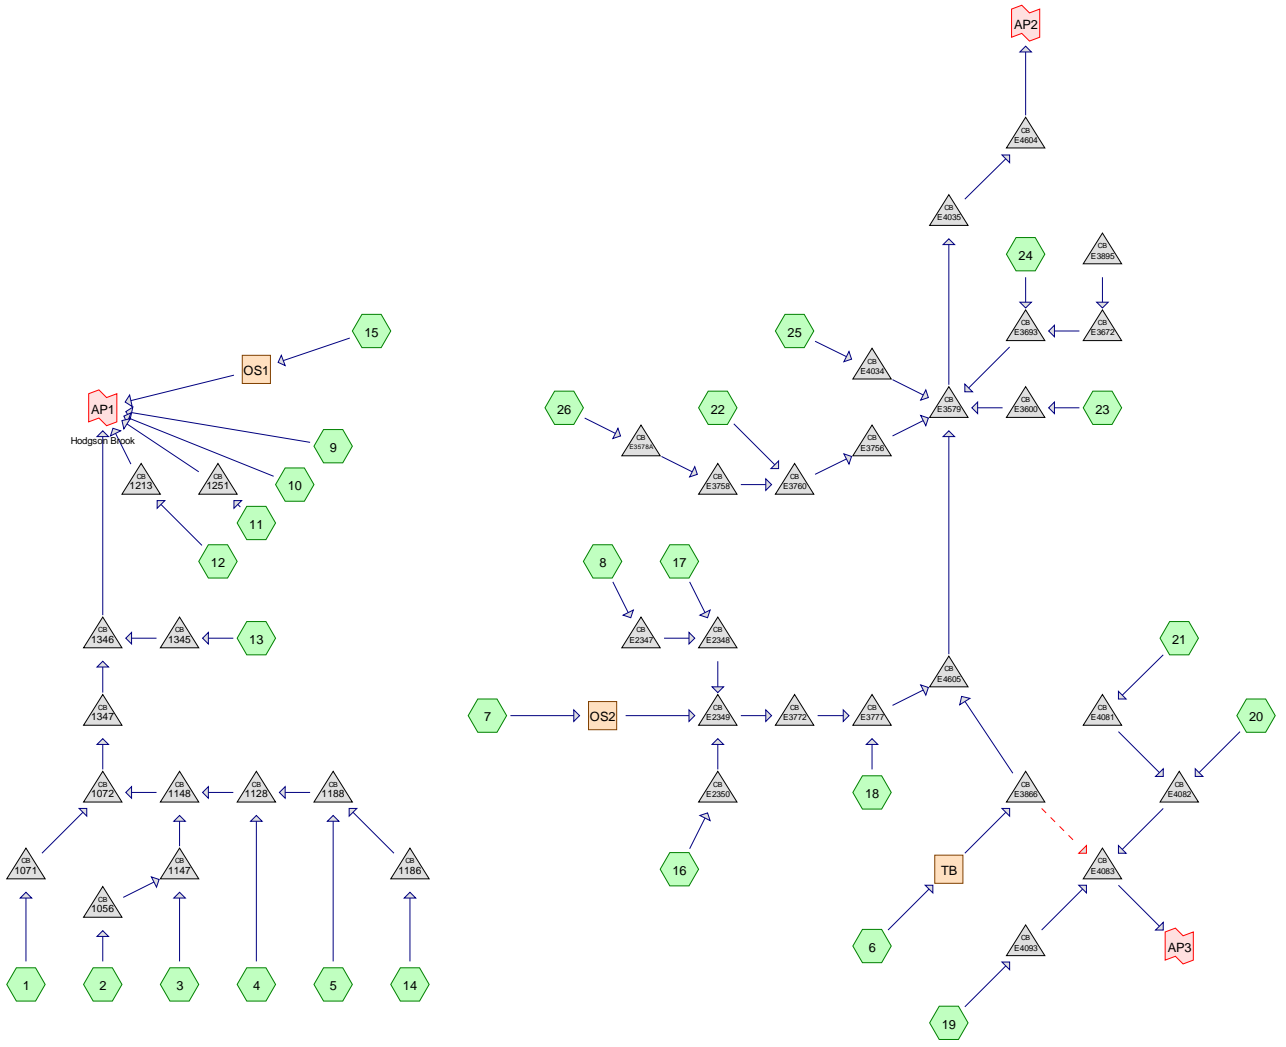

**Routing Diagram for Existing**  
 Prepared by Fuss & O'Neill Inc., Printed 7/23/2019  
 HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

## Existing

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 2

### Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
484	86	<50% Grass cover, Poor, HSG C (7)
87,893	74	>75% Grass cover, Good, HSG C (1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 16, 18, 21, 22)
38,670	96	Gravel surface, HSG C (8, 9, 15)
391,636	98	Paved parking, HSG C (1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25)
54,274	98	Roofs, HSG C (1, 2, 3, 5, 6, 7, 14, 26)
75,567	70	Woods, Good, HSG C (8, 9, 10, 14, 15)
<b>648,524</b>	<b>91</b>	<b>TOTAL AREA</b>



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 3

**Soil Listing (all nodes)**

Area (sq-ft)	Soil Group	Subcatchment Numbers
0	HSG A	
0	HSG B	
648,524	HSG C	1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26
0	HSG D	
0	Other	
<b>648,524</b>		<b>TOTAL AREA</b>

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 4

**Ground Covers (all nodes)**

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Subcatchment Numbers
0	0	484	0	0	484	<50% Grass cover, Poor	
0	0	87,893	0	0	87,893	>75% Grass cover, Good	
0	0	38,670	0	0	38,670	Gravel surface	
0	0	391,636	0	0	391,636	Paved parking	
0	0	54,274	0	0	54,274	Roofs	
0	0	75,567	0	0	75,567	Woods, Good	
<b>0</b>	<b>0</b>	<b>648,524</b>	<b>0</b>	<b>0</b>	<b>648,524</b>	<b>TOTAL AREA</b>	

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 5

**Pipe Listing (all nodes)**

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Diam/Width (inches)	Height (inches)	Inside-Fill (inches)
1	1056	18.30	17.70	128.5	0.0047	0.025	12.0	0.0	0.0
2	1071	17.50	17.30	31.0	0.0065	0.025	12.0	0.0	0.0
3	1072	17.10	15.90	31.0	0.0387	0.025	15.0	0.0	0.0
4	1128	22.90	14.70	860.0	0.0095	0.025	12.0	0.0	0.0
5	1147	18.30	18.20	36.0	0.0028	0.025	12.0	0.0	0.0
6	1148	18.20	17.50	311.5	0.0022	0.025	12.0	0.0	0.0
7	1186	22.30	21.00	161.5	0.0080	0.025	12.0	0.0	0.0
8	1188	20.00	18.90	191.0	0.0058	0.025	12.0	0.0	0.0
9	1213	17.60	14.60	150.0	0.0200	0.025	12.0	0.0	0.0
10	1251	16.50	14.70	82.0	0.0220	0.025	18.0	0.0	0.0
11	1345	19.10	17.40	915.0	0.0019	0.025	12.0	0.0	0.0
12	1346	15.70	14.70	143.0	0.0070	0.025	15.0	0.0	0.0
13	1347	15.90	15.80	204.0	0.0005	0.025	15.0	0.0	0.0
14	E2347	9.70	9.80	72.5	-0.0014	0.013	15.0	0.0	0.0
15	E2348	9.80	9.10	15.1	0.0464	0.013	15.0	0.0	0.0
16	E2349	9.10	8.70	86.7	0.0046	0.013	15.0	0.0	0.0
17	E2350	10.40	10.30	19.3	0.0052	0.013	15.0	0.0	0.0
18	E3578A	9.00	7.90	11.2	0.0982	0.012	8.0	0.0	0.0
19	E3579	2.00	1.80	205.5	0.0010	0.015	36.0	0.0	0.0
20	E3600	7.50	2.00	21.4	0.2570	0.012	12.0	0.0	0.0
21	E3672	8.20	8.20	13.9	0.0000	0.012	4.0	0.0	0.0
22	E3693	7.90	2.00	27.1	0.2177	0.012	12.0	0.0	0.0
23	E3756	7.80	2.00	23.2	0.2500	0.012	12.0	0.0	0.0
24	E3758	8.00	8.00	10.2	0.0000	0.012	12.0	0.0	0.0
25	E3760	8.00	7.80	32.7	0.0061	0.012	12.0	0.0	0.0
26	E3772	8.60	7.70	48.0	0.0187	0.013	15.0	0.0	0.0
27	E3777	7.60	7.50	28.2	0.0035	0.013	15.0	0.0	0.0
28	E3866	5.40	4.60	35.7	0.0224	0.012	24.0	0.0	0.0
29	E3866	5.30	5.00	83.8	0.0036	0.012	42.0	24.0	0.0
30	E3895	9.70	8.70	37.1	0.0270	0.012	4.0	0.0	0.0
31	E4034	7.50	2.00	14.8	0.3716	0.012	12.0	0.0	0.0
32	E4035	1.80	1.00	139.6	0.0057	0.012	42.0	0.0	0.0
33	E4081	5.80	5.70	13.0	0.0077	0.013	12.0	0.0	0.0
34	E4082	5.90	5.70	11.1	0.0180	0.013	12.0	0.0	0.0
35	E4083	5.00	4.75	25.4	0.0098	0.025	42.0	24.0	0.0
36	E4093	5.90	5.60	13.7	0.0219	0.013	12.0	0.0	0.0
37	E4604	1.20	1.00	18.1	0.0110	0.012	42.0	0.0	0.0
38	E4605	4.40	4.20	22.2	0.0090	0.012	24.0	0.0	0.0



## Appendix F2.2

---

Pre-Development Hydrologic Analysis:  
Node listing for 2-year, 25-year & 50-year



**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 6

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>Subcatchment 1:</b>	Runoff Area=62,857 sf 94.73% Impervious Runoff Depth=3.34" Flow Length=505' Tc=8.9 min CN=97 Runoff=4.65 cfs 17,512 cf
<b>Subcatchment 2:</b>	Runoff Area=36,669 sf 98.09% Impervious Runoff Depth=3.46" Flow Length=369' Tc=10.9 min CN=98 Runoff=2.59 cfs 10,560 cf
<b>Subcatchment 3:</b>	Runoff Area=17,703 sf 90.15% Impervious Runoff Depth=3.23" Tc=6.0 min CN=96 Runoff=1.42 cfs 4,770 cf
<b>Subcatchment 4:</b>	Runoff Area=38,050 sf 94.05% Impervious Runoff Depth=3.34" Tc=6.0 min CN=97 Runoff=3.10 cfs 10,601 cf
<b>Subcatchment 5:</b>	Runoff Area=41,493 sf 97.25% Impervious Runoff Depth=3.34" Tc=0.0 min CN=97 Runoff=4.13 cfs 11,560 cf
<b>Subcatchment 6:</b>	Runoff Area=30,394 sf 95.76% Impervious Runoff Depth=3.34" Tc=6.0 min CN=97 Runoff=2.48 cfs 8,468 cf
<b>Subcatchment 7:</b>	Runoff Area=113,910 sf 73.61% Impervious Runoff Depth=2.82" Tc=6.0 min CN=92 Runoff=8.37 cfs 26,759 cf
<b>Subcatchment 8:</b>	Runoff Area=78,622 sf 37.70% Impervious Runoff Depth=2.92" Tc=0.0 min CN=93 Runoff=7.24 cfs 19,123 cf
<b>Subcatchment 9:</b>	Runoff Area=12,536 sf 52.67% Impervious Runoff Depth=2.44" Tc=6.0 min CN=88 Runoff=0.82 cfs 2,552 cf
<b>Subcatchment 10:</b>	Runoff Area=110,643 sf 28.77% Impervious Runoff Depth=1.64" Tc=6.0 min CN=78 Runoff=4.85 cfs 15,151 cf
<b>Subcatchment 11:</b>	Runoff Area=28,184 sf 92.95% Impervious Runoff Depth=3.23" Tc=6.0 min CN=96 Runoff=2.26 cfs 7,594 cf
<b>Subcatchment 12:</b>	Runoff Area=9,264 sf 21.99% Impervious Runoff Depth=1.71" Tc=6.0 min CN=79 Runoff=0.43 cfs 1,324 cf
<b>Subcatchment 13:</b>	Runoff Area=6,003 sf 66.57% Impervious Runoff Depth=2.63" Tc=6.0 min CN=90 Runoff=0.42 cfs 1,314 cf
<b>Subcatchment 14:</b>	Runoff Area=3,932 sf 93.59% Impervious Runoff Depth=3.23" Tc=6.0 min CN=96 Runoff=0.32 cfs 1,059 cf
<b>Subcatchment 15:</b>	Runoff Area=5,252 sf 12.11% Impervious Runoff Depth=2.63" Tc=0.0 min CN=90 Runoff=0.45 cfs 1,149 cf
<b>Subcatchment 16:</b>	Runoff Area=3,719 sf 88.76% Impervious Runoff Depth=3.13" Tc=0.0 min CN=95 Runoff=0.36 cfs 969 cf

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 7

<b>Subcatchment 17:</b>	Runoff Area=3,261 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.33 cfs 939 cf
<b>Subcatchment 18:</b>	Runoff Area=18,344 sf 45.09% Impervious Runoff Depth=2.18" Tc=0.0 min CN=85 Runoff=1.32 cfs 3,337 cf
<b>Subcatchment 19:</b>	Runoff Area=216 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.02 cfs 62 cf
<b>Subcatchment 20:</b>	Runoff Area=609 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.06 cfs 175 cf
<b>Subcatchment 21:</b>	Runoff Area=8,913 sf 83.17% Impervious Runoff Depth=3.02" Tc=0.0 min CN=94 Runoff=0.84 cfs 2,244 cf
<b>Subcatchment 22:</b>	Runoff Area=6,196 sf 95.11% Impervious Runoff Depth=3.34" Tc=0.0 min CN=97 Runoff=0.62 cfs 1,726 cf
<b>Subcatchment 23:</b>	Runoff Area=417 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.04 cfs 120 cf
<b>Subcatchment 24:</b>	Runoff Area=3,520 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.35 cfs 1,014 cf
<b>Subcatchment 25:</b>	Runoff Area=3,436 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.35 cfs 990 cf
<b>Subcatchment 26:</b>	Runoff Area=4,381 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.44 cfs 1,262 cf
<b>Reach OS1:</b>	Inflow=0.45 cfs 1,149 cf Outflow=0.45 cfs 1,149 cf
<b>Reach OS2:</b>	Inflow=8.37 cfs 26,759 cf Outflow=8.37 cfs 26,759 cf
<b>Reach TB:</b>	Inflow=2.48 cfs 8,468 cf Outflow=2.48 cfs 8,468 cf
<b>Pond 1056:</b>	Peak Elev=165.79' Inflow=2.59 cfs 10,560 cf 12.0" Round Culvert n=0.025 L=128.5' S=0.0047 '/ Outflow=2.59 cfs 10,560 cf
<b>Pond 1071:</b>	Peak Elev=89.10' Inflow=4.65 cfs 17,512 cf 12.0" Round Culvert n=0.025 L=31.0' S=0.0065 '/ Outflow=4.65 cfs 17,512 cf
<b>Pond 1072:</b>	Peak Elev=86.35' Inflow=13.44 cfs 56,059 cf 15.0" Round Culvert n=0.025 L=31.0' S=0.0387 '/ Outflow=13.44 cfs 56,059 cf
<b>Pond 1128:</b>	Peak Elev=241.25' Inflow=6.32 cfs 23,217 cf 12.0" Round Culvert n=0.025 L=860.0' S=0.0095 '/ Outflow=6.32 cfs 23,217 cf



**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 8

<b>Pond 1147:</b>	Peak Elev=163.40' Inflow=3.82 cfs 15,330 cf 12.0" Round Culvert n=0.025 L=36.0' S=0.0028 '/ Outflow=3.82 cfs 15,330 cf
<b>Pond 1148:</b>	Peak Elev=161.42' Inflow=9.24 cfs 38,547 cf 12.0" Round Culvert n=0.025 L=311.5' S=0.0022 '/ Outflow=9.24 cfs 38,547 cf
<b>Pond 1186:</b>	Peak Elev=245.54' Inflow=0.32 cfs 1,059 cf 12.0" Round Culvert n=0.025 L=161.5' S=0.0080 '/ Outflow=0.33 cfs 1,057 cf
<b>Pond 1188:</b>	Peak Elev=245.48' Inflow=4.34 cfs 12,616 cf 12.0" Round Culvert n=0.025 L=191.0' S=0.0058 '/ Outflow=4.34 cfs 12,616 cf
<b>Pond 1213:</b>	Peak Elev=17.97' Inflow=0.43 cfs 1,324 cf 12.0" Round Culvert n=0.025 L=150.0' S=0.0200 '/ Outflow=0.43 cfs 1,324 cf
<b>Pond 1251:</b>	Peak Elev=17.24' Inflow=2.26 cfs 7,594 cf 18.0" Round Culvert n=0.025 L=82.0' S=0.0220 '/ Outflow=2.26 cfs 7,594 cf
<b>Pond 1345:</b>	Peak Elev=43.80' Inflow=0.42 cfs 1,314 cf 12.0" Round Culvert n=0.025 L=915.0' S=0.0019 '/ Outflow=0.42 cfs 1,314 cf
<b>Pond 1346:</b>	Peak Elev=43.34' Inflow=13.86 cfs 57,373 cf 15.0" Round Culvert n=0.025 L=143.0' S=0.0070 '/ Outflow=13.86 cfs 57,373 cf
<b>Pond 1347:</b>	Peak Elev=78.68' Inflow=13.44 cfs 56,059 cf 15.0" Round Culvert n=0.025 L=204.0' S=0.0005 '/ Outflow=13.44 cfs 56,059 cf
<b>Pond E2347:</b>	Peak Elev=27.63' Inflow=7.24 cfs 19,123 cf 15.0" Round Culvert n=0.013 L=72.5' S=-0.0014 '/ Outflow=7.24 cfs 19,123 cf
<b>Pond E2348:</b>	Peak Elev=26.64' Inflow=7.57 cfs 20,062 cf 15.0" Round Culvert n=0.013 L=15.1' S=0.0464 '/ Outflow=7.57 cfs 20,062 cf
<b>Pond E2349:</b>	Peak Elev=25.58' Inflow=13.27 cfs 47,790 cf 15.0" Round Culvert n=0.013 L=86.7' S=0.0046 '/ Outflow=13.27 cfs 47,790 cf
<b>Pond E2350:</b>	Peak Elev=25.58' Inflow=0.36 cfs 969 cf 15.0" Round Culvert n=0.013 L=19.3' S=0.0052 '/ Outflow=0.36 cfs 969 cf
<b>Pond E3578A:</b>	Peak Elev=9.38' Inflow=0.44 cfs 1,262 cf 8.0" Round Culvert n=0.012 L=11.2' S=0.0982 '/ Outflow=0.44 cfs 1,262 cf
<b>Pond E3579:</b>	Peak Elev=4.36' Inflow=16.28 cfs 56,249 cf 36.0" Round Culvert n=0.015 L=205.5' S=0.0010 '/ Outflow=16.28 cfs 56,249 cf
<b>Pond E3600:</b>	Peak Elev=7.60' Inflow=0.04 cfs 120 cf 12.0" Round Culvert n=0.012 L=21.4' S=0.2570 '/ Outflow=0.04 cfs 120 cf
<b>Pond E3672:</b>	Peak Elev=8.20' Inflow=0.00 cfs 0 cf 4.0" Round Culvert n=0.012 L=13.9' S=0.0000 '/ Outflow=0.00 cfs 0 cf

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 9

<b>Pond E3693:</b>	Peak Elev=8.19' Inflow=0.35 cfs 1,014 cf 12.0" Round Culvert n=0.012 L=27.1' S=0.2177 1/ Outflow=0.35 cfs 1,014 cf
<b>Pond E3756:</b>	Peak Elev=8.33' Inflow=1.06 cfs 2,988 cf 12.0" Round Culvert n=0.012 L=23.2' S=0.2500 1/ Outflow=1.06 cfs 2,988 cf
<b>Pond E3758:</b>	Peak Elev=8.66' Inflow=0.44 cfs 1,262 cf 12.0" Round Culvert n=0.012 L=10.2' S=0.0000 1/ Outflow=0.44 cfs 1,262 cf
<b>Pond E3760:</b>	Peak Elev=8.63' Inflow=1.06 cfs 2,988 cf 12.0" Round Culvert n=0.012 L=32.7' S=0.0061 1/ Outflow=1.06 cfs 2,988 cf
<b>Pond E3772:</b>	Peak Elev=19.18' Inflow=13.27 cfs 47,790 cf 15.0" Round Culvert n=0.013 L=48.0' S=0.0187 1/ Outflow=13.27 cfs 47,790 cf
<b>Pond E3777:</b>	Peak Elev=14.19' Inflow=14.44 cfs 51,127 cf 15.0" Round Culvert n=0.013 L=28.2' S=0.0035 1/ Outflow=14.44 cfs 51,127 cf
<b>Pond E3866:</b>	Peak Elev=5.73' Inflow=2.48 cfs 8,468 cf Primary=0.02 cfs 11 cf Secondary=2.48 cfs 8,457 cf Outflow=2.48 cfs 8,468 cf
<b>Pond E3895:</b>	Peak Elev=0.00' 4.0" Round Culvert n=0.012 L=37.1' S=0.0270 1/ Primary=0.00 cfs 0 cf
<b>Pond E4034:</b>	Peak Elev=7.79' Inflow=0.35 cfs 990 cf 12.0" Round Culvert n=0.012 L=14.8' S=0.3716 1/ Outflow=0.35 cfs 990 cf
<b>Pond E4035:</b>	Peak Elev=3.67' Inflow=16.28 cfs 56,249 cf 42.0" Round Culvert n=0.012 L=139.6' S=0.0057 1/ Outflow=16.28 cfs 56,249 cf
<b>Pond E4081:</b>	Peak Elev=6.51' Inflow=0.84 cfs 2,244 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0077 1/ Outflow=0.84 cfs 2,244 cf
<b>Pond E4082:</b>	Peak Elev=6.41' Inflow=0.90 cfs 2,419 cf 12.0" Round Culvert n=0.013 L=11.1' S=0.0180 1/ Outflow=0.90 cfs 2,419 cf
<b>Pond E4083:</b>	Peak Elev=5.46' Inflow=2.99 cfs 10,938 cf 42.0" x 24.0" Box Culvert n=0.025 L=25.4' S=0.0098 1/ Outflow=2.99 cfs 10,938 cf
<b>Pond E4093:</b>	Peak Elev=5.97' Inflow=0.02 cfs 62 cf 12.0" Round Culvert n=0.013 L=13.7' S=0.0219 1/ Outflow=0.02 cfs 62 cf
<b>Pond E4604:</b>	Peak Elev=2.93' Inflow=16.28 cfs 56,249 cf 42.0" Round Culvert n=0.012 L=18.1' S=0.0110 1/ Outflow=16.28 cfs 56,249 cf
<b>Pond E4605:</b>	Peak Elev=6.55' Inflow=14.44 cfs 51,138 cf 24.0" Round Culvert n=0.012 L=22.2' S=0.0090 1/ Outflow=14.44 cfs 51,138 cf
<b>Link AP1: Hodgson Brook</b>	Inflow=22.40 cfs 85,142 cf Primary=22.40 cfs 85,142 cf

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 10

**Link AP2:**

Inflow=16.28 cfs 56,249 cf  
Primary=16.28 cfs 56,249 cf

**Link AP3:**

Inflow=2.99 cfs 10,938 cf  
Primary=2.99 cfs 10,938 cf

**Total Runoff Area = 648,524 sf   Runoff Volume = 152,332 cf   Average Runoff Depth = 2.82"**  
**31.24% Pervious = 202,614 sf   68.76% Impervious = 445,910 sf**

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 11

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>Subcatchment 1:</b>	Runoff Area=62,857 sf 94.73% Impervious Runoff Depth=6.74" Flow Length=505' Tc=8.9 min CN=97 Runoff=9.10 cfs 35,315 cf
<b>Subcatchment 2:</b>	Runoff Area=36,669 sf 98.09% Impervious Runoff Depth=6.86" Flow Length=369' Tc=10.9 min CN=98 Runoff=5.01 cfs 20,965 cf
<b>Subcatchment 3:</b>	Runoff Area=17,703 sf 90.15% Impervious Runoff Depth=6.62" Tc=6.0 min CN=96 Runoff=2.81 cfs 9,771 cf
<b>Subcatchment 4:</b>	Runoff Area=38,050 sf 94.05% Impervious Runoff Depth=6.74" Tc=6.0 min CN=97 Runoff=6.06 cfs 21,377 cf
<b>Subcatchment 5:</b>	Runoff Area=41,493 sf 97.25% Impervious Runoff Depth=6.74" Tc=0.0 min CN=97 Runoff=8.07 cfs 23,312 cf
<b>Subcatchment 6:</b>	Runoff Area=30,394 sf 95.76% Impervious Runoff Depth=6.74" Tc=6.0 min CN=97 Runoff=4.84 cfs 17,076 cf
<b>Subcatchment 7:</b>	Runoff Area=113,910 sf 73.61% Impervious Runoff Depth=6.15" Tc=6.0 min CN=92 Runoff=17.49 cfs 58,412 cf
<b>Subcatchment 8:</b>	Runoff Area=78,622 sf 37.70% Impervious Runoff Depth=6.27" Tc=0.0 min CN=93 Runoff=14.88 cfs 41,082 cf
<b>Subcatchment 9:</b>	Runoff Area=12,536 sf 52.67% Impervious Runoff Depth=5.69" Tc=6.0 min CN=88 Runoff=1.83 cfs 5,945 cf
<b>Subcatchment 10:</b>	Runoff Area=110,643 sf 28.77% Impervious Runoff Depth=4.57" Tc=6.0 min CN=78 Runoff=13.52 cfs 42,096 cf
<b>Subcatchment 11:</b>	Runoff Area=28,184 sf 92.95% Impervious Runoff Depth=6.62" Tc=6.0 min CN=96 Runoff=4.47 cfs 15,556 cf
<b>Subcatchment 12:</b>	Runoff Area=9,264 sf 21.99% Impervious Runoff Depth=4.68" Tc=6.0 min CN=79 Runoff=1.16 cfs 3,610 cf
<b>Subcatchment 13:</b>	Runoff Area=6,003 sf 66.57% Impervious Runoff Depth=5.92" Tc=6.0 min CN=90 Runoff=0.90 cfs 2,962 cf
<b>Subcatchment 14:</b>	Runoff Area=3,932 sf 93.59% Impervious Runoff Depth=6.62" Tc=6.0 min CN=96 Runoff=0.62 cfs 2,170 cf
<b>Subcatchment 15:</b>	Runoff Area=5,252 sf 12.11% Impervious Runoff Depth=5.92" Tc=0.0 min CN=90 Runoff=0.96 cfs 2,592 cf
<b>Subcatchment 16:</b>	Runoff Area=3,719 sf 88.76% Impervious Runoff Depth=6.51" Tc=0.0 min CN=95 Runoff=0.71 cfs 2,016 cf

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 12

<b>Subcatchment 17:</b>	Runoff Area=3,261 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.64 cfs 1,864 cf
<b>Subcatchment 18:</b>	Runoff Area=18,344 sf 45.09% Impervious Runoff Depth=5.35" Tc=0.0 min CN=85 Runoff=3.14 cfs 8,176 cf
<b>Subcatchment 19:</b>	Runoff Area=216 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.04 cfs 123 cf
<b>Subcatchment 20:</b>	Runoff Area=609 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.12 cfs 348 cf
<b>Subcatchment 21:</b>	Runoff Area=8,913 sf 83.17% Impervious Runoff Depth=6.39" Tc=0.0 min CN=94 Runoff=1.70 cfs 4,744 cf
<b>Subcatchment 22:</b>	Runoff Area=6,196 sf 95.11% Impervious Runoff Depth=6.74" Tc=0.0 min CN=97 Runoff=1.20 cfs 3,481 cf
<b>Subcatchment 23:</b>	Runoff Area=417 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.08 cfs 238 cf
<b>Subcatchment 24:</b>	Runoff Area=3,520 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.69 cfs 2,013 cf
<b>Subcatchment 25:</b>	Runoff Area=3,436 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.67 cfs 1,964 cf
<b>Subcatchment 26:</b>	Runoff Area=4,381 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.85 cfs 2,505 cf
<b>Reach OS1:</b>	Inflow=0.96 cfs 2,592 cf Outflow=0.96 cfs 2,592 cf
<b>Reach OS2:</b>	Inflow=17.49 cfs 58,412 cf Outflow=17.49 cfs 58,412 cf
<b>Reach TB:</b>	Inflow=4.84 cfs 17,076 cf Outflow=4.84 cfs 17,076 cf
<b>Pond 1056:</b>	Peak Elev=588.74' Inflow=5.01 cfs 20,965 cf 12.0" Round Culvert n=0.025 L=128.5' S=0.0047 '/ Outflow=5.01 cfs 20,965 cf
<b>Pond 1071:</b>	Peak Elev=296.21' Inflow=9.10 cfs 35,315 cf 12.0" Round Culvert n=0.025 L=31.0' S=0.0065 '/ Outflow=9.10 cfs 35,315 cf
<b>Pond 1072:</b>	Peak Elev=285.68' Inflow=26.27 cfs 112,909 cf 15.0" Round Culvert n=0.025 L=31.0' S=0.0387 '/ Outflow=26.27 cfs 112,909 cf
<b>Pond 1128:</b>	Peak Elev=877.62' Inflow=12.29 cfs 46,858 cf 12.0" Round Culvert n=0.025 L=860.0' S=0.0095 '/ Outflow=12.29 cfs 46,858 cf



**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 13

<b>Pond 1147:</b>	Peak Elev=579.60' Inflow=7.44 cfs 30,736 cf 12.0" Round Culvert n=0.025 L=36.0' S=0.0028 '/ Outflow=7.44 cfs 30,736 cf
<b>Pond 1148:</b>	Peak Elev=571.99' Inflow=18.06 cfs 77,594 cf 12.0" Round Culvert n=0.025 L=311.5' S=0.0022 '/ Outflow=18.06 cfs 77,594 cf
<b>Pond 1186:</b>	Peak Elev=894.05' Inflow=0.62 cfs 2,170 cf 12.0" Round Culvert n=0.025 L=161.5' S=0.0080 '/ Outflow=0.63 cfs 2,169 cf
<b>Pond 1188:</b>	Peak Elev=893.86' Inflow=8.45 cfs 25,481 cf 12.0" Round Culvert n=0.025 L=191.0' S=0.0058 '/ Outflow=8.45 cfs 25,481 cf
<b>Pond 1213:</b>	Peak Elev=18.23' Inflow=1.16 cfs 3,610 cf 12.0" Round Culvert n=0.025 L=150.0' S=0.0200 '/ Outflow=1.16 cfs 3,610 cf
<b>Pond 1251:</b>	Peak Elev=17.60' Inflow=4.47 cfs 15,556 cf 18.0" Round Culvert n=0.025 L=82.0' S=0.0220 '/ Outflow=4.47 cfs 15,556 cf
<b>Pond 1345:</b>	Peak Elev=123.38' Inflow=0.90 cfs 2,962 cf 12.0" Round Culvert n=0.025 L=915.0' S=0.0019 '/ Outflow=0.90 cfs 2,962 cf
<b>Pond 1346:</b>	Peak Elev=121.22' Inflow=27.17 cfs 115,871 cf 15.0" Round Culvert n=0.025 L=143.0' S=0.0070 '/ Outflow=27.17 cfs 115,871 cf
<b>Pond 1347:</b>	Peak Elev=256.49' Inflow=26.27 cfs 112,909 cf 15.0" Round Culvert n=0.025 L=204.0' S=0.0005 '/ Outflow=26.27 cfs 112,909 cf
<b>Pond E2347:</b>	Peak Elev=93.22' Inflow=14.88 cfs 41,082 cf 15.0" Round Culvert n=0.013 L=72.5' S=0.0014 '/ Outflow=14.88 cfs 41,082 cf
<b>Pond E2348:</b>	Peak Elev=89.02' Inflow=15.51 cfs 42,947 cf 15.0" Round Culvert n=0.013 L=15.1' S=0.0464 '/ Outflow=15.51 cfs 42,947 cf
<b>Pond E2349:</b>	Peak Elev=85.21' Inflow=27.53 cfs 103,375 cf 15.0" Round Culvert n=0.013 L=86.7' S=0.0046 '/ Outflow=27.53 cfs 103,375 cf
<b>Pond E2350:</b>	Peak Elev=85.22' Inflow=0.71 cfs 2,016 cf 15.0" Round Culvert n=0.013 L=19.3' S=0.0052 '/ Outflow=0.71 cfs 2,016 cf
<b>Pond E3578A:</b>	Peak Elev=9.59' Inflow=0.85 cfs 2,505 cf 8.0" Round Culvert n=0.012 L=11.2' S=0.0982 '/ Outflow=0.85 cfs 2,505 cf
<b>Pond E3579:</b>	Peak Elev=5.89' Inflow=33.98 cfs 121,770 cf 36.0" Round Culvert n=0.015 L=205.5' S=0.0010 '/ Outflow=33.98 cfs 121,770 cf
<b>Pond E3600:</b>	Peak Elev=7.64' Inflow=0.08 cfs 238 cf 12.0" Round Culvert n=0.012 L=21.4' S=0.2570 '/ Outflow=0.08 cfs 238 cf
<b>Pond E3672:</b>	Peak Elev=8.31' Inflow=0.00 cfs 0 cf 4.0" Round Culvert n=0.012 L=13.9' S=0.0000 '/ Outflow=0.00 cfs 0 cf

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 14

<b>Pond E3693:</b>	Peak Elev=8.32' Inflow=0.69 cfs 2,013 cf 12.0" Round Culvert n=0.012 L=27.1' S=0.2177 '/ Outflow=0.69 cfs 2,013 cf
<b>Pond E3756:</b>	Peak Elev=8.60' Inflow=2.06 cfs 5,986 cf 12.0" Round Culvert n=0.012 L=23.2' S=0.2500 '/ Outflow=2.06 cfs 5,986 cf
<b>Pond E3758:</b>	Peak Elev=9.01' Inflow=0.85 cfs 2,505 cf 12.0" Round Culvert n=0.012 L=10.2' S=0.0000 '/ Outflow=0.85 cfs 2,505 cf
<b>Pond E3760:</b>	Peak Elev=8.97' Inflow=2.06 cfs 5,986 cf 12.0" Round Culvert n=0.012 L=32.7' S=0.0061 '/ Outflow=2.06 cfs 5,986 cf
<b>Pond E3772:</b>	Peak Elev=57.69' Inflow=27.53 cfs 103,375 cf 15.0" Round Culvert n=0.013 L=48.0' S=0.0187 '/ Outflow=27.53 cfs 103,375 cf
<b>Pond E3777:</b>	Peak Elev=36.05' Inflow=30.36 cfs 111,551 cf 15.0" Round Culvert n=0.013 L=28.2' S=0.0035 '/ Outflow=30.36 cfs 111,551 cf
<b>Pond E3866:</b>	Peak Elev=6.01' Inflow=4.84 cfs 17,076 cf Primary=0.01 cfs 18 cf Secondary=4.84 cfs 17,058 cf Outflow=4.84 cfs 17,076 cf
<b>Pond E3895:</b>	Peak Elev=0.00' 4.0" Round Culvert n=0.012 L=37.1' S=0.0270 '/ Primary=0.00 cfs 0 cf
<b>Pond E4034:</b>	Peak Elev=7.91' Inflow=0.67 cfs 1,964 cf 12.0" Round Culvert n=0.012 L=14.8' S=0.3716 '/ Outflow=0.67 cfs 1,964 cf
<b>Pond E4035:</b>	Peak Elev=4.76' Inflow=33.98 cfs 121,770 cf 42.0" Round Culvert n=0.012 L=139.6' S=0.0057 '/ Outflow=33.98 cfs 121,770 cf
<b>Pond E4081:</b>	Peak Elev=6.88' Inflow=1.70 cfs 4,744 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0077 '/ Outflow=1.70 cfs 4,744 cf
<b>Pond E4082:</b>	Peak Elev=6.69' Inflow=1.82 cfs 5,093 cf 12.0" Round Culvert n=0.013 L=11.1' S=0.0180 '/ Outflow=1.82 cfs 5,093 cf
<b>Pond E4083:</b>	Peak Elev=5.73' Inflow=5.87 cfs 22,274 cf 42.0" x 24.0" Box Culvert n=0.025 L=25.4' S=0.0098 '/ Outflow=5.87 cfs 22,274 cf
<b>Pond E4093:</b>	Peak Elev=6.00' Inflow=0.04 cfs 123 cf 12.0" Round Culvert n=0.013 L=13.7' S=0.0219 '/ Outflow=0.04 cfs 123 cf
<b>Pond E4604:</b>	Peak Elev=3.88' Inflow=33.98 cfs 121,770 cf 42.0" Round Culvert n=0.012 L=18.1' S=0.0110 '/ Outflow=33.98 cfs 121,770 cf
<b>Pond E4605:</b>	Peak Elev=9.87' Inflow=30.36 cfs 111,569 cf 24.0" Round Culvert n=0.012 L=22.2' S=0.0090 '/ Outflow=30.36 cfs 111,569 cf
<b>Link AP1: Hodgson Brook</b>	Inflow=48.62 cfs 185,670 cf Primary=48.62 cfs 185,670 cf

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 15

**Link AP2:**

Inflow=33.98 cfs 121,770 cf  
Primary=33.98 cfs 121,770 cf

**Link AP3:**

Inflow=5.87 cfs 22,274 cf  
Primary=5.87 cfs 22,274 cf

**Total Runoff Area = 648,524 sf   Runoff Volume = 329,715 cf   Average Runoff Depth = 6.10"**  
**31.24% Pervious = 202,614 sf   68.76% Impervious = 445,910 sf**

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 16

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>Subcatchment 1:</b>	Runoff Area=62,857 sf 94.73% Impervious Runoff Depth=8.14" Flow Length=505' Tc=8.9 min CN=97 Runoff=10.91 cfs 42,637 cf
<b>Subcatchment 2:</b>	Runoff Area=36,669 sf 98.09% Impervious Runoff Depth=8.26" Flow Length=369' Tc=10.9 min CN=98 Runoff=6.01 cfs 25,240 cf
<b>Subcatchment 3:</b>	Runoff Area=17,703 sf 90.15% Impervious Runoff Depth=8.02" Tc=6.0 min CN=96 Runoff=3.37 cfs 11,831 cf
<b>Subcatchment 4:</b>	Runoff Area=38,050 sf 94.05% Impervious Runoff Depth=8.14" Tc=6.0 min CN=97 Runoff=7.27 cfs 25,810 cf
<b>Subcatchment 5:</b>	Runoff Area=41,493 sf 97.25% Impervious Runoff Depth=8.14" Tc=0.0 min CN=97 Runoff=9.67 cfs 28,145 cf
<b>Subcatchment 6:</b>	Runoff Area=30,394 sf 95.76% Impervious Runoff Depth=8.14" Tc=6.0 min CN=97 Runoff=5.81 cfs 20,617 cf
<b>Subcatchment 7:</b>	Runoff Area=113,910 sf 73.61% Impervious Runoff Depth=7.54" Tc=6.0 min CN=92 Runoff=21.19 cfs 71,562 cf
<b>Subcatchment 8:</b>	Runoff Area=78,622 sf 37.70% Impervious Runoff Depth=7.66" Tc=0.0 min CN=93 Runoff=17.97 cfs 50,181 cf
<b>Subcatchment 9:</b>	Runoff Area=12,536 sf 52.67% Impervious Runoff Depth=7.06" Tc=6.0 min CN=88 Runoff=2.25 cfs 7,373 cf
<b>Subcatchment 10:</b>	Runoff Area=110,643 sf 28.77% Impervious Runoff Depth=5.85" Tc=6.0 min CN=78 Runoff=17.21 cfs 53,984 cf
<b>Subcatchment 11:</b>	Runoff Area=28,184 sf 92.95% Impervious Runoff Depth=8.02" Tc=6.0 min CN=96 Runoff=5.37 cfs 18,835 cf
<b>Subcatchment 12:</b>	Runoff Area=9,264 sf 21.99% Impervious Runoff Depth=5.98" Tc=6.0 min CN=79 Runoff=1.47 cfs 4,613 cf
<b>Subcatchment 13:</b>	Runoff Area=6,003 sf 66.57% Impervious Runoff Depth=7.30" Tc=6.0 min CN=90 Runoff=1.10 cfs 3,651 cf
<b>Subcatchment 14:</b>	Runoff Area=3,932 sf 93.59% Impervious Runoff Depth=8.02" Tc=6.0 min CN=96 Runoff=0.75 cfs 2,628 cf
<b>Subcatchment 15:</b>	Runoff Area=5,252 sf 12.11% Impervious Runoff Depth=7.30" Tc=0.0 min CN=90 Runoff=1.17 cfs 3,194 cf
<b>Subcatchment 16:</b>	Runoff Area=3,719 sf 88.76% Impervious Runoff Depth=7.90" Tc=0.0 min CN=95 Runoff=0.86 cfs 2,448 cf

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 17

<b>Subcatchment 17:</b>	Runoff Area=3,261 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.76 cfs 2,245 cf
<b>Subcatchment 18:</b>	Runoff Area=18,344 sf 45.09% Impervious Runoff Depth=6.70" Tc=0.0 min CN=85 Runoff=3.88 cfs 10,237 cf
<b>Subcatchment 19:</b>	Runoff Area=216 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.05 cfs 149 cf
<b>Subcatchment 20:</b>	Runoff Area=609 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.14 cfs 419 cf
<b>Subcatchment 21:</b>	Runoff Area=8,913 sf 83.17% Impervious Runoff Depth=7.78" Tc=0.0 min CN=94 Runoff=2.05 cfs 5,778 cf
<b>Subcatchment 22:</b>	Runoff Area=6,196 sf 95.11% Impervious Runoff Depth=8.14" Tc=0.0 min CN=97 Runoff=1.44 cfs 4,203 cf
<b>Subcatchment 23:</b>	Runoff Area=417 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.10 cfs 287 cf
<b>Subcatchment 24:</b>	Runoff Area=3,520 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.82 cfs 2,423 cf
<b>Subcatchment 25:</b>	Runoff Area=3,436 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.80 cfs 2,365 cf
<b>Subcatchment 26:</b>	Runoff Area=4,381 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=1.02 cfs 3,016 cf
<b>Reach OS1:</b>	Inflow=1.17 cfs 3,194 cf Outflow=1.17 cfs 3,194 cf
<b>Reach OS2:</b>	Inflow=21.19 cfs 71,562 cf Outflow=21.19 cfs 71,562 cf
<b>Reach TB:</b>	Inflow=5.81 cfs 20,617 cf Outflow=5.81 cfs 20,617 cf
<b>Pond 1056:</b>	Peak Elev=840.39' Inflow=6.01 cfs 25,240 cf 12.0" Round Culvert n=0.025 L=128.5' S=0.0047 '/ Outflow=6.01 cfs 25,240 cf
<b>Pond 1071:</b>	Peak Elev=419.37' Inflow=10.91 cfs 42,637 cf 12.0" Round Culvert n=0.025 L=31.0' S=0.0065 '/ Outflow=10.91 cfs 42,637 cf
<b>Pond 1072:</b>	Peak Elev=404.23' Inflow=31.51 cfs 136,289 cf 15.0" Round Culvert n=0.025 L=31.0' S=0.0387 '/ Outflow=31.51 cfs 136,289 cf
<b>Pond 1128:</b>	Peak Elev=1,256.78' Inflow=14.84 cfs 56,581 cf 12.0" Round Culvert n=0.025 L=860.0' S=0.0095 '/ Outflow=14.84 cfs 56,581 cf

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 18

<b>Pond 1147:</b>	Peak Elev=827.43' Inflow=8.93 cfs 37,071 cf 12.0" Round Culvert n=0.025 L=36.0' S=0.0028 '/ Outflow=8.93 cfs 37,071 cf
<b>Pond 1148:</b>	Peak Elev=816.57' Inflow=21.66 cfs 93,652 cf 12.0" Round Culvert n=0.025 L=311.5' S=0.0022 '/ Outflow=21.66 cfs 93,652 cf
<b>Pond 1186:</b>	Peak Elev=1,280.49' Inflow=0.75 cfs 2,628 cf 12.0" Round Culvert n=0.025 L=161.5' S=0.0080 '/ Outflow=0.76 cfs 2,626 cf
<b>Pond 1188:</b>	Peak Elev=1,280.19' Inflow=10.16 cfs 30,771 cf 12.0" Round Culvert n=0.025 L=191.0' S=0.0058 '/ Outflow=10.16 cfs 30,771 cf
<b>Pond 1213:</b>	Peak Elev=18.32' Inflow=1.47 cfs 4,613 cf 12.0" Round Culvert n=0.025 L=150.0' S=0.0200 '/ Outflow=1.47 cfs 4,613 cf
<b>Pond 1251:</b>	Peak Elev=17.74' Inflow=5.37 cfs 18,835 cf 18.0" Round Culvert n=0.025 L=82.0' S=0.0220 '/ Outflow=5.37 cfs 18,835 cf
<b>Pond 1345:</b>	Peak Elev=170.80' Inflow=1.10 cfs 3,651 cf 12.0" Round Culvert n=0.025 L=915.0' S=0.0019 '/ Outflow=1.10 cfs 3,651 cf
<b>Pond 1346:</b>	Peak Elev=167.59' Inflow=32.61 cfs 139,940 cf 15.0" Round Culvert n=0.025 L=143.0' S=0.0070 '/ Outflow=32.61 cfs 139,940 cf
<b>Pond 1347:</b>	Peak Elev=362.13' Inflow=31.51 cfs 136,289 cf 15.0" Round Culvert n=0.025 L=204.0' S=0.0005 '/ Outflow=31.51 cfs 136,289 cf
<b>Pond E2347:</b>	Peak Elev=135.00' Inflow=17.97 cfs 50,181 cf 15.0" Round Culvert n=0.013 L=72.5' S=0.0014 '/ Outflow=17.97 cfs 50,181 cf
<b>Pond E2348:</b>	Peak Elev=128.81' Inflow=18.74 cfs 52,425 cf 15.0" Round Culvert n=0.013 L=15.1' S=0.0464 '/ Outflow=18.74 cfs 52,425 cf
<b>Pond E2349:</b>	Peak Elev=123.16' Inflow=33.31 cfs 126,434 cf 15.0" Round Culvert n=0.013 L=86.7' S=0.0046 '/ Outflow=33.31 cfs 126,434 cf
<b>Pond E2350:</b>	Peak Elev=123.17' Inflow=0.86 cfs 2,448 cf 15.0" Round Culvert n=0.013 L=19.3' S=0.0052 '/ Outflow=0.86 cfs 2,447 cf
<b>Pond E3578A:</b>	Peak Elev=9.70' Inflow=1.02 cfs 3,016 cf 8.0" Round Culvert n=0.012 L=11.2' S=0.0982 '/ Outflow=1.02 cfs 3,016 cf
<b>Pond E3579:</b>	Peak Elev=6.94' Inflow=41.17 cfs 148,993 cf 36.0" Round Culvert n=0.015 L=205.5' S=0.0010 '/ Outflow=41.17 cfs 148,993 cf
<b>Pond E3600:</b>	Peak Elev=7.65' Inflow=0.10 cfs 287 cf 12.0" Round Culvert n=0.012 L=21.4' S=0.2570 '/ Outflow=0.10 cfs 287 cf
<b>Pond E3672:</b>	Peak Elev=8.35' Inflow=0.00 cfs 0 cf 4.0" Round Culvert n=0.012 L=13.9' S=0.0000 '/ Outflow=0.00 cfs 0 cf



**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 19

<b>Pond E3693:</b>	Peak Elev=8.36' Inflow=0.82 cfs 2,423 cf 12.0" Round Culvert n=0.012 L=27.1' S=0.2177 '/ Outflow=0.82 cfs 2,423 cf
<b>Pond E3756:</b>	Peak Elev=8.72' Inflow=2.47 cfs 7,218 cf 12.0" Round Culvert n=0.012 L=23.2' S=0.2500 '/ Outflow=2.47 cfs 7,218 cf
<b>Pond E3758:</b>	Peak Elev=9.18' Inflow=1.02 cfs 3,016 cf 12.0" Round Culvert n=0.012 L=10.2' S=0.0000 '/ Outflow=1.02 cfs 3,016 cf
<b>Pond E3760:</b>	Peak Elev=9.12' Inflow=2.47 cfs 7,218 cf 12.0" Round Culvert n=0.012 L=32.7' S=0.0061 '/ Outflow=2.47 cfs 7,218 cf
<b>Pond E3772:</b>	Peak Elev=82.87' Inflow=33.31 cfs 126,434 cf 15.0" Round Culvert n=0.013 L=48.0' S=0.0187 '/ Outflow=33.31 cfs 126,434 cf
<b>Pond E3777:</b>	Peak Elev=51.20' Inflow=36.83 cfs 136,671 cf 15.0" Round Culvert n=0.013 L=28.2' S=0.0035 '/ Outflow=36.83 cfs 136,671 cf
<b>Pond E3866:</b>	Peak Elev=6.12' Inflow=5.81 cfs 20,617 cf Primary=0.01 cfs 28 cf Secondary=5.81 cfs 20,589 cf Outflow=5.81 cfs 20,617 cf
<b>Pond E3895:</b>	Peak Elev=0.00' 4.0" Round Culvert n=0.012 L=37.1' S=0.0270 '/ Primary=0.00 cfs 0 cf
<b>Pond E4034:</b>	Peak Elev=7.96' Inflow=0.80 cfs 2,365 cf 12.0" Round Culvert n=0.012 L=14.8' S=0.3716 '/ Outflow=0.80 cfs 2,365 cf
<b>Pond E4035:</b>	Peak Elev=5.17' Inflow=41.17 cfs 148,993 cf 42.0" Round Culvert n=0.012 L=139.6' S=0.0057 '/ Outflow=41.17 cfs 148,993 cf
<b>Pond E4081:</b>	Peak Elev=7.07' Inflow=2.05 cfs 5,778 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0077 '/ Outflow=2.05 cfs 5,778 cf
<b>Pond E4082:</b>	Peak Elev=6.80' Inflow=2.19 cfs 6,197 cf 12.0" Round Culvert n=0.013 L=11.1' S=0.0180 '/ Outflow=2.19 cfs 6,197 cf
<b>Pond E4083:</b>	Peak Elev=5.83' Inflow=7.04 cfs 26,935 cf 42.0" x 24.0" Box Culvert n=0.025 L=25.4' S=0.0098 '/ Outflow=7.04 cfs 26,935 cf
<b>Pond E4093:</b>	Peak Elev=6.01' Inflow=0.05 cfs 149 cf 12.0" Round Culvert n=0.013 L=13.7' S=0.0219 '/ Outflow=0.05 cfs 149 cf
<b>Pond E4604:</b>	Peak Elev=4.22' Inflow=41.17 cfs 148,993 cf 42.0" Round Culvert n=0.012 L=18.1' S=0.0110 '/ Outflow=41.17 cfs 148,993 cf
<b>Pond E4605:</b>	Peak Elev=12.79' Inflow=36.83 cfs 136,699 cf 24.0" Round Culvert n=0.012 L=22.2' S=0.0090 '/ Outflow=36.83 cfs 136,699 cf
<b>Link AP1: Hodgson Brook</b>	Inflow=59.48 cfs 227,940 cf Primary=59.48 cfs 227,940 cf

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

*Type III 24-hr 50 yr Rainfall=8.50"*

Printed 7/23/2019

Page 20

---

**Link AP2:**

Inflow=41.17 cfs 148,993 cf  
Primary=41.17 cfs 148,993 cf

**Link AP3:**

Inflow=7.04 cfs 26,935 cf  
Primary=7.04 cfs 26,935 cf

**Total Runoff Area = 648,524 sf   Runoff Volume = 403,870 cf   Average Runoff Depth = 7.47"**  
**31.24% Pervious = 202,614 sf   68.76% Impervious = 445,910 sf**



## Appendix F2.3

---

Pre-Development Hydrologic Analysis:  
Full summary for 10-year storm



**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 6

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>Subcatchment 1:</b>	Runoff Area=62,857 sf 94.73% Impervious Runoff Depth=5.25" Flow Length=505' Tc=8.9 min CN=97 Runoff=7.15 cfs 27,475 cf
<b>Subcatchment 2:</b>	Runoff Area=36,669 sf 98.09% Impervious Runoff Depth=5.36" Flow Length=369' Tc=10.9 min CN=98 Runoff=3.95 cfs 16,386 cf
<b>Subcatchment 3:</b>	Runoff Area=17,703 sf 90.15% Impervious Runoff Depth=5.13" Tc=6.0 min CN=96 Runoff=2.20 cfs 7,567 cf
<b>Subcatchment 4:</b>	Runoff Area=38,050 sf 94.05% Impervious Runoff Depth=5.25" Tc=6.0 min CN=97 Runoff=4.76 cfs 16,632 cf
<b>Subcatchment 5:</b>	Runoff Area=41,493 sf 97.25% Impervious Runoff Depth=5.25" Tc=0.0 min CN=97 Runoff=6.34 cfs 18,137 cf
<b>Subcatchment 6:</b>	Runoff Area=30,394 sf 95.76% Impervious Runoff Depth=5.25" Tc=6.0 min CN=97 Runoff=3.81 cfs 13,285 cf
<b>Subcatchment 7:</b>	Runoff Area=113,910 sf 73.61% Impervious Runoff Depth=4.68" Tc=6.0 min CN=92 Runoff=13.50 cfs 44,393 cf
<b>Subcatchment 8:</b>	Runoff Area=78,622 sf 37.70% Impervious Runoff Depth=4.79" Tc=0.0 min CN=93 Runoff=11.54 cfs 31,371 cf
<b>Subcatchment 9:</b>	Runoff Area=12,536 sf 52.67% Impervious Runoff Depth=4.24" Tc=6.0 min CN=88 Runoff=1.39 cfs 4,431 cf
<b>Subcatchment 10:</b>	Runoff Area=110,643 sf 28.77% Impervious Runoff Depth=3.23" Tc=6.0 min CN=78 Runoff=9.61 cfs 29,763 cf
<b>Subcatchment 11:</b>	Runoff Area=28,184 sf 92.95% Impervious Runoff Depth=5.13" Tc=6.0 min CN=96 Runoff=3.50 cfs 12,047 cf
<b>Subcatchment 12:</b>	Runoff Area=9,264 sf 21.99% Impervious Runoff Depth=3.32" Tc=6.0 min CN=79 Runoff=0.83 cfs 2,567 cf
<b>Subcatchment 13:</b>	Runoff Area=6,003 sf 66.57% Impervious Runoff Depth=4.46" Tc=6.0 min CN=90 Runoff=0.69 cfs 2,230 cf
<b>Subcatchment 14:</b>	Runoff Area=3,932 sf 93.59% Impervious Runoff Depth=5.13" Tc=6.0 min CN=96 Runoff=0.49 cfs 1,681 cf
<b>Subcatchment 15:</b>	Runoff Area=5,252 sf 12.11% Impervious Runoff Depth=4.46" Tc=0.0 min CN=90 Runoff=0.74 cfs 1,951 cf
<b>Subcatchment 16:</b>	Runoff Area=3,719 sf 88.76% Impervious Runoff Depth=5.01" Tc=0.0 min CN=95 Runoff=0.56 cfs 1,554 cf



**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 7

<b>Subcatchment 17:</b>	Runoff Area=3,261 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.50 cfs 1,457 cf
<b>Subcatchment 18:</b>	Runoff Area=18,344 sf 45.09% Impervious Runoff Depth=3.93" Tc=0.0 min CN=85 Runoff=2.33 cfs 6,002 cf
<b>Subcatchment 19:</b>	Runoff Area=216 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.03 cfs 97 cf
<b>Subcatchment 20:</b>	Runoff Area=609 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.09 cfs 272 cf
<b>Subcatchment 21:</b>	Runoff Area=8,913 sf 83.17% Impervious Runoff Depth=4.90" Tc=0.0 min CN=94 Runoff=1.32 cfs 3,640 cf
<b>Subcatchment 22:</b>	Runoff Area=6,196 sf 95.11% Impervious Runoff Depth=5.25" Tc=0.0 min CN=97 Runoff=0.95 cfs 2,708 cf
<b>Subcatchment 23:</b>	Runoff Area=417 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.06 cfs 186 cf
<b>Subcatchment 24:</b>	Runoff Area=3,520 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.54 cfs 1,573 cf
<b>Subcatchment 25:</b>	Runoff Area=3,436 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.53 cfs 1,535 cf
<b>Subcatchment 26:</b>	Runoff Area=4,381 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.67 cfs 1,958 cf
<b>Reach OS1:</b>	Inflow=0.74 cfs 1,951 cf Outflow=0.74 cfs 1,951 cf
<b>Reach OS2:</b>	Inflow=13.50 cfs 44,393 cf Outflow=13.50 cfs 44,393 cf
<b>Reach TB:</b>	Inflow=3.81 cfs 13,285 cf Outflow=3.81 cfs 13,285 cf
<b>Pond 1056:</b>	Peak Elev=369.43' Inflow=3.95 cfs 16,386 cf 12.0" Round Culvert n=0.025 L=128.5' S=0.0047 '/' Outflow=3.95 cfs 16,386 cf
<b>Pond 1071:</b>	Peak Elev=188.86' Inflow=7.15 cfs 27,475 cf 12.0" Round Culvert n=0.025 L=31.0' S=0.0065 '/' Outflow=7.15 cfs 27,475 cf
<b>Pond 1072:</b>	Peak Elev=182.36' Inflow=20.64 cfs 87,878 cf 15.0" Round Culvert n=0.025 L=31.0' S=0.0387 '/' Outflow=20.64 cfs 87,878 cf
<b>Pond 1128:</b>	Peak Elev=547.72' Inflow=9.65 cfs 36,450 cf 12.0" Round Culvert n=0.025 L=860.0' S=0.0095 '/' Outflow=9.65 cfs 36,450 cf

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 8

<b>Pond 1147:</b>	Peak Elev=363.77' Inflow=5.85 cfs 23,953 cf 12.0" Round Culvert n=0.025 L=36.0' S=0.0028 '/ Outflow=5.85 cfs 23,953 cf
<b>Pond 1148:</b>	Peak Elev=359.07' Inflow=14.19 cfs 60,403 cf 12.0" Round Culvert n=0.025 L=311.5' S=0.0022 '/ Outflow=14.19 cfs 60,403 cf
<b>Pond 1186:</b>	Peak Elev=557.85' Inflow=0.49 cfs 1,681 cf 12.0" Round Culvert n=0.025 L=161.5' S=0.0080 '/ Outflow=0.49 cfs 1,680 cf
<b>Pond 1188:</b>	Peak Elev=557.73' Inflow=6.64 cfs 19,817 cf 12.0" Round Culvert n=0.025 L=191.0' S=0.0058 '/ Outflow=6.64 cfs 19,818 cf
<b>Pond 1213:</b>	Peak Elev=18.12' Inflow=0.83 cfs 2,567 cf 12.0" Round Culvert n=0.025 L=150.0' S=0.0200 '/ Outflow=0.83 cfs 2,567 cf
<b>Pond 1251:</b>	Peak Elev=17.45' Inflow=3.50 cfs 12,047 cf 18.0" Round Culvert n=0.025 L=82.0' S=0.0220 '/ Outflow=3.50 cfs 12,047 cf
<b>Pond 1345:</b>	Peak Elev=82.08' Inflow=0.69 cfs 2,230 cf 12.0" Round Culvert n=0.025 L=915.0' S=0.0019 '/ Outflow=0.69 cfs 2,230 cf
<b>Pond 1346:</b>	Peak Elev=80.82' Inflow=21.33 cfs 90,107 cf 15.0" Round Culvert n=0.025 L=143.0' S=0.0070 '/ Outflow=21.33 cfs 90,107 cf
<b>Pond 1347:</b>	Peak Elev=164.33' Inflow=20.64 cfs 87,878 cf 15.0" Round Culvert n=0.025 L=204.0' S=0.0005 '/ Outflow=20.64 cfs 87,878 cf
<b>Pond E2347:</b>	Peak Elev=58.45' Inflow=11.54 cfs 31,371 cf 15.0" Round Culvert n=0.013 L=72.5' S=0.0014 '/ Outflow=11.54 cfs 31,371 cf
<b>Pond E2348:</b>	Peak Elev=55.97' Inflow=12.04 cfs 32,828 cf 15.0" Round Culvert n=0.013 L=15.1' S=0.0464 '/ Outflow=12.04 cfs 32,828 cf
<b>Pond E2349:</b>	Peak Elev=53.21' Inflow=21.30 cfs 78,775 cf 15.0" Round Culvert n=0.013 L=86.7' S=0.0046 '/ Outflow=21.30 cfs 78,775 cf
<b>Pond E2350:</b>	Peak Elev=53.22' Inflow=0.56 cfs 1,554 cf 15.0" Round Culvert n=0.013 L=19.3' S=0.0052 '/ Outflow=0.56 cfs 1,554 cf
<b>Pond E3578A:</b>	Peak Elev=9.50' Inflow=0.67 cfs 1,958 cf 8.0" Round Culvert n=0.012 L=11.2' S=0.0982 '/ Outflow=0.67 cfs 1,958 cf
<b>Pond E3579:</b>	Peak Elev=5.17' Inflow=26.23 cfs 92,749 cf 36.0" Round Culvert n=0.015 L=205.5' S=0.0010 '/ Outflow=26.23 cfs 92,749 cf
<b>Pond E3600:</b>	Peak Elev=7.62' Inflow=0.06 cfs 186 cf 12.0" Round Culvert n=0.012 L=21.4' S=0.2570 '/ Outflow=0.06 cfs 186 cf
<b>Pond E3672:</b>	Peak Elev=8.24' Inflow=0.00 cfs 0 cf 4.0" Round Culvert n=0.012 L=13.9' S=0.0000 '/ Outflow=0.00 cfs 0 cf

**Existing**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 9

<b>Pond E3693:</b>	Peak Elev=8.27' Inflow=0.54 cfs 1,573 cf 12.0" Round Culvert n=0.012 L=27.1' S=0.2177 1/8" Outflow=0.54 cfs 1,573 cf
<b>Pond E3756:</b>	Peak Elev=8.49' Inflow=1.62 cfs 4,666 cf 12.0" Round Culvert n=0.012 L=23.2' S=0.2500 1/8" Outflow=1.62 cfs 4,666 cf
<b>Pond E3758:</b>	Peak Elev=8.86' Inflow=0.67 cfs 1,958 cf 12.0" Round Culvert n=0.012 L=10.2' S=0.0000 1/8" Outflow=0.67 cfs 1,958 cf
<b>Pond E3760:</b>	Peak Elev=8.82' Inflow=1.62 cfs 4,666 cf 12.0" Round Culvert n=0.012 L=32.7' S=0.0061 1/8" Outflow=1.62 cfs 4,666 cf
<b>Pond E3772:</b>	Peak Elev=36.77' Inflow=21.30 cfs 78,775 cf 15.0" Round Culvert n=0.013 L=48.0' S=0.0187 1/8" Outflow=21.30 cfs 78,775 cf
<b>Pond E3777:</b>	Peak Elev=23.90' Inflow=23.40 cfs 84,777 cf 15.0" Round Culvert n=0.013 L=28.2' S=0.0035 1/8" Outflow=23.40 cfs 84,777 cf
<b>Pond E3866:</b>	Peak Elev=5.89' Inflow=3.81 cfs 13,285 cf Primary=0.02 cfs 11 cf Secondary=3.81 cfs 13,275 cf Outflow=3.81 cfs 13,285 cf
<b>Pond E3895:</b>	Peak Elev=0.00' 4.0" Round Culvert n=0.012 L=37.1' S=0.0270 1/8" Primary=0.00 cfs 0 cf
<b>Pond E4034:</b>	Peak Elev=7.86' Inflow=0.53 cfs 1,535 cf 12.0" Round Culvert n=0.012 L=14.8' S=0.3716 1/8" Outflow=0.53 cfs 1,535 cf
<b>Pond E4035:</b>	Peak Elev=4.31' Inflow=26.23 cfs 92,749 cf 42.0" Round Culvert n=0.012 L=139.6' S=0.0057 1/8" Outflow=26.23 cfs 92,749 cf
<b>Pond E4081:</b>	Peak Elev=6.71' Inflow=1.32 cfs 3,640 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0077 1/8" Outflow=1.32 cfs 3,640 cf
<b>Pond E4082:</b>	Peak Elev=6.57' Inflow=1.42 cfs 3,912 cf 12.0" Round Culvert n=0.013 L=11.1' S=0.0180 1/8" Outflow=1.42 cfs 3,912 cf
<b>Pond E4083:</b>	Peak Elev=5.62' Inflow=4.61 cfs 17,283 cf 42.0" x 24.0" Box Culvert n=0.025 L=25.4' S=0.0098 1/8" Outflow=4.61 cfs 17,283 cf
<b>Pond E4093:</b>	Peak Elev=5.99' Inflow=0.03 cfs 97 cf 12.0" Round Culvert n=0.013 L=13.7' S=0.0219 1/8" Outflow=0.03 cfs 97 cf
<b>Pond E4604:</b>	Peak Elev=3.49' Inflow=26.23 cfs 92,749 cf 42.0" Round Culvert n=0.012 L=18.1' S=0.0110 1/8" Outflow=26.23 cfs 92,749 cf
<b>Pond E4605:</b>	Peak Elev=7.79' Inflow=23.40 cfs 84,788 cf 24.0" Round Culvert n=0.012 L=22.2' S=0.0090 1/8" Outflow=23.40 cfs 84,788 cf
<b>Link AP1: Hodgson Brook</b>	Inflow=37.02 cfs 140,865 cf Primary=37.02 cfs 140,865 cf

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 10

**Link AP2:**

Inflow=26.23 cfs 92,749 cf  
Primary=26.23 cfs 92,749 cf

**Link AP3:**

Inflow=4.61 cfs 17,283 cf  
Primary=4.61 cfs 17,283 cf

**Total Runoff Area = 648,524 sf   Runoff Volume = 250,896 cf   Average Runoff Depth = 4.64"**  
**31.24% Pervious = 202,614 sf   68.76% Impervious = 445,910 sf**

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 11

**Summary for Subcatchment 1:**

Runoff = 7.15 cfs @ 12.12 hrs, Volume= 27,475 cf, Depth= 5.25"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,311	74	>75% Grass cover, Good, HSG C
19,506	98	Roofs, HSG C
40,040	98	Paved parking, HSG C
62,857	97	Weighted Average
3,311		5.27% Pervious Area
59,546		94.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.4	50	0.1600	0.16		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.21"
3.5	455	0.0114	2.17		<b>Shallow Concentrated Flow, B-C</b>
					Paved Kv= 20.3 fps
8.9	505	Total			

**Subcatchment 1:**

**Hydrograph**

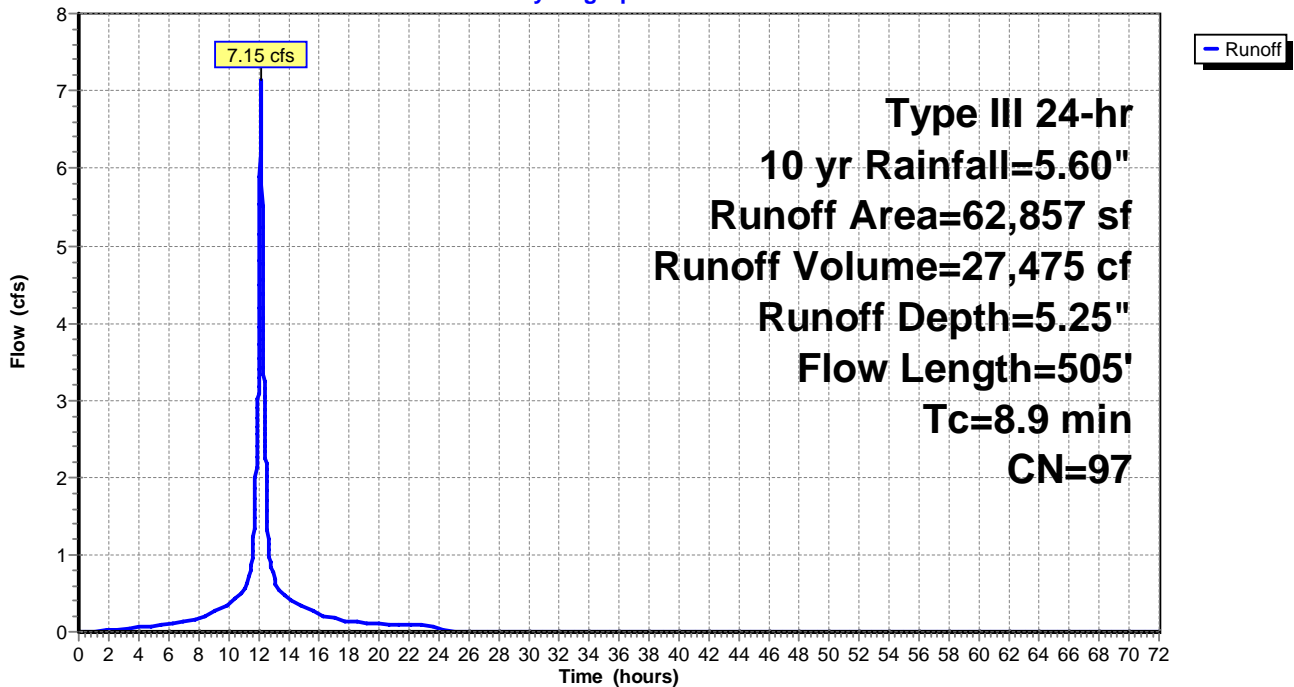

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 12

**Summary for Subcatchment 2:**

Runoff = 3.95 cfs @ 12.15 hrs, Volume= 16,386 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"


Area (sf)	CN	Description
700	74	>75% Grass cover, Good, HSG C
2,984	98	Roofs, HSG C
32,985	98	Paved parking, HSG C
36,669	98	Weighted Average
700		1.91% Pervious Area
35,969		98.09% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.3	50	0.0400	0.09		<b>Sheet Flow, A-B</b>
1.6	319	0.0257	3.25		Woods: Light underbrush n= 0.400 P2= 3.21" <b>Shallow Concentrated Flow, B-C</b>
10.9	369	Total			Paved Kv= 20.3 fps

**Subcatchment 2:**

Hydrograph



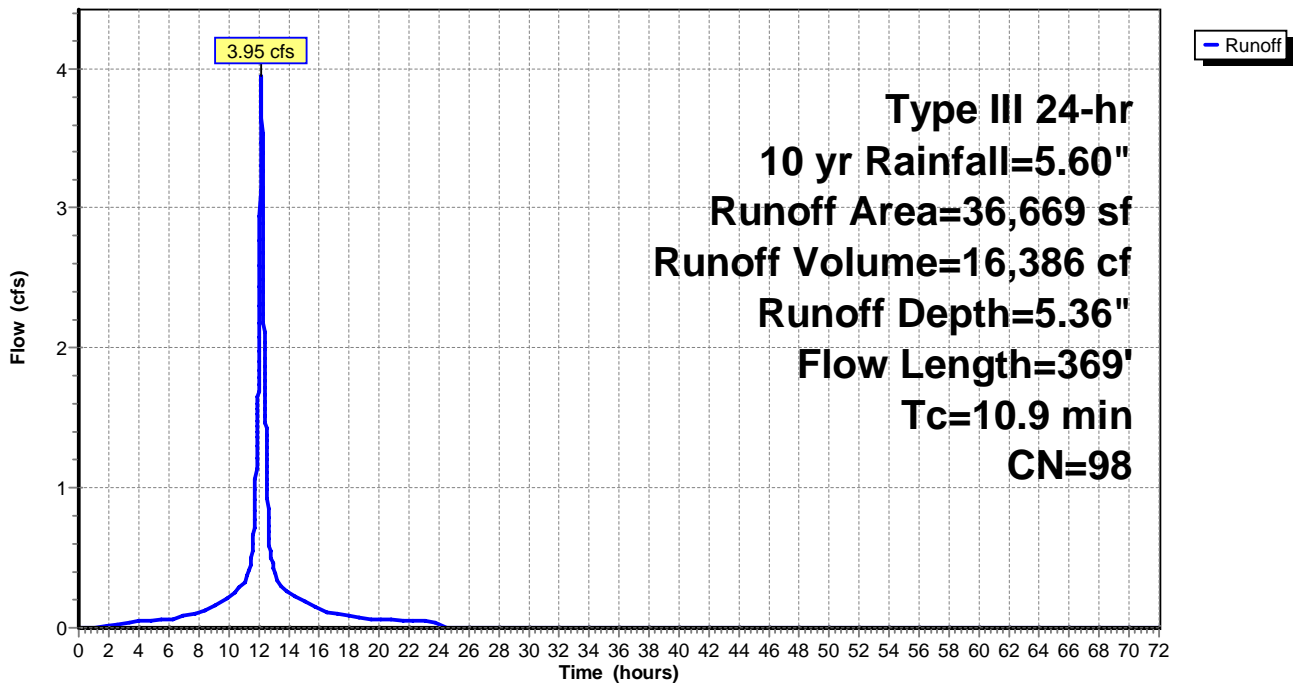

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 13

**Summary for Subcatchment 3:**

Runoff = 2.20 cfs @ 12.08 hrs, Volume= 7,567 cf, Depth= 5.13"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,743	74	>75% Grass cover, Good, HSG C
10,382	98	Roofs, HSG C
5,578	98	Paved parking, HSG C
17,703	96	Weighted Average
1,743		9.85% Pervious Area
15,960		90.15% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 3:**

**Hydrograph**

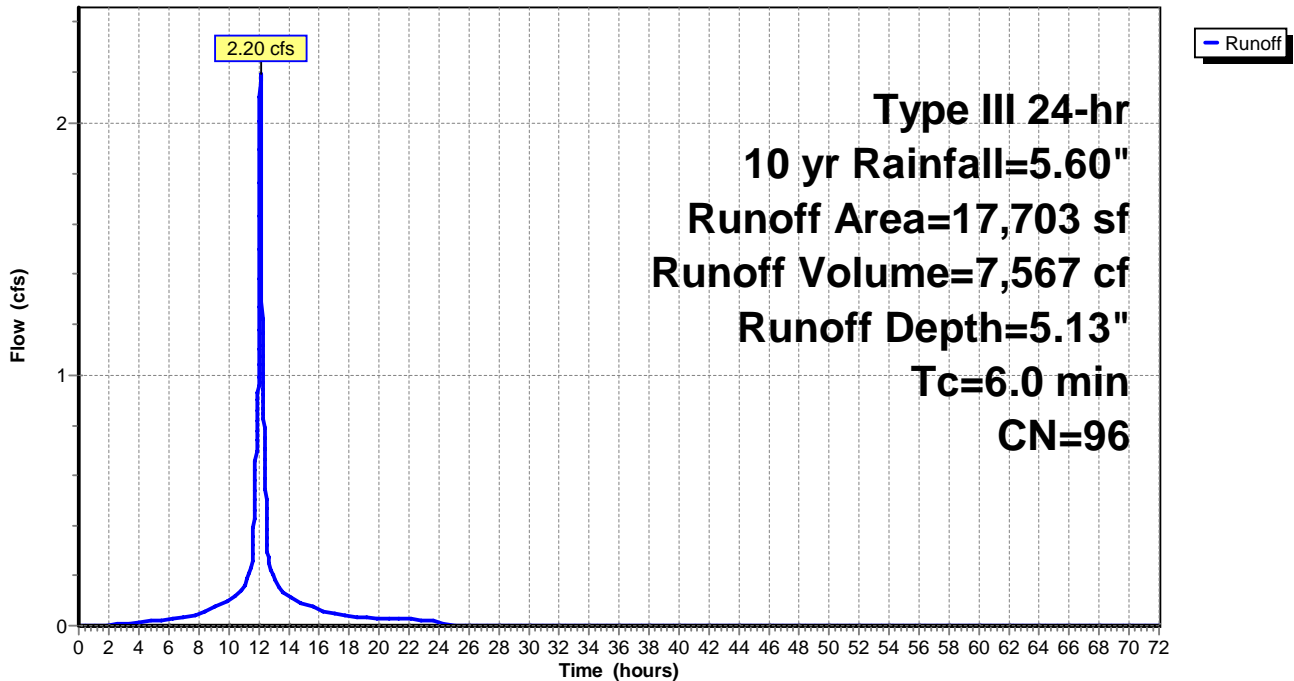

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 14

**Summary for Subcatchment 4:**

Runoff = 4.76 cfs @ 12.08 hrs, Volume= 16,632 cf, Depth= 5.25"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
2,263	74	>75% Grass cover, Good, HSG C
35,787	98	Paved parking, HSG C
38,050	97	Weighted Average
2,263		5.95% Pervious Area
35,787		94.05% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 4:**

**Hydrograph**

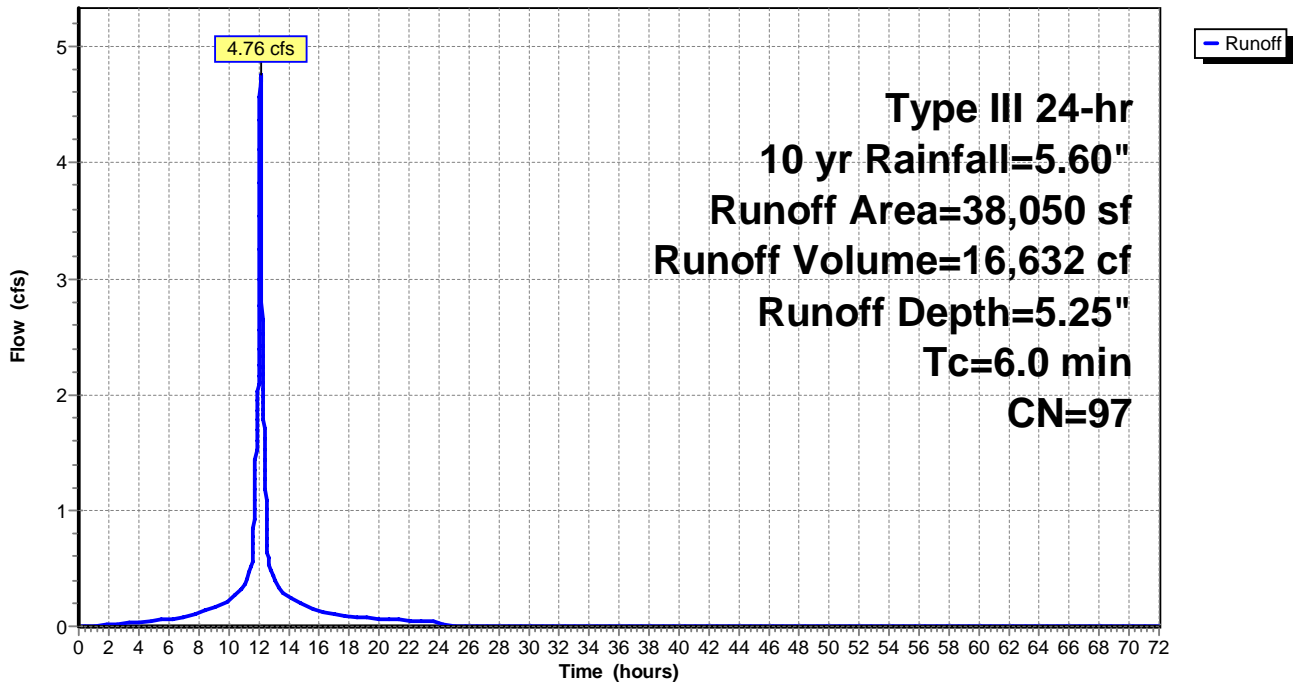

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 15

**Summary for Subcatchment 5:**


Runoff = 6.34 cfs @ 12.00 hrs, Volume= 18,137 cf, Depth= 5.25"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,139	74	>75% Grass cover, Good, HSG C
2,890	98	Roofs, HSG C
37,464	98	Paved parking, HSG C
41,493	97	Weighted Average
1,139		2.75% Pervious Area
40,354		97.25% Impervious Area

**Subcatchment 5:**

**Hydrograph**

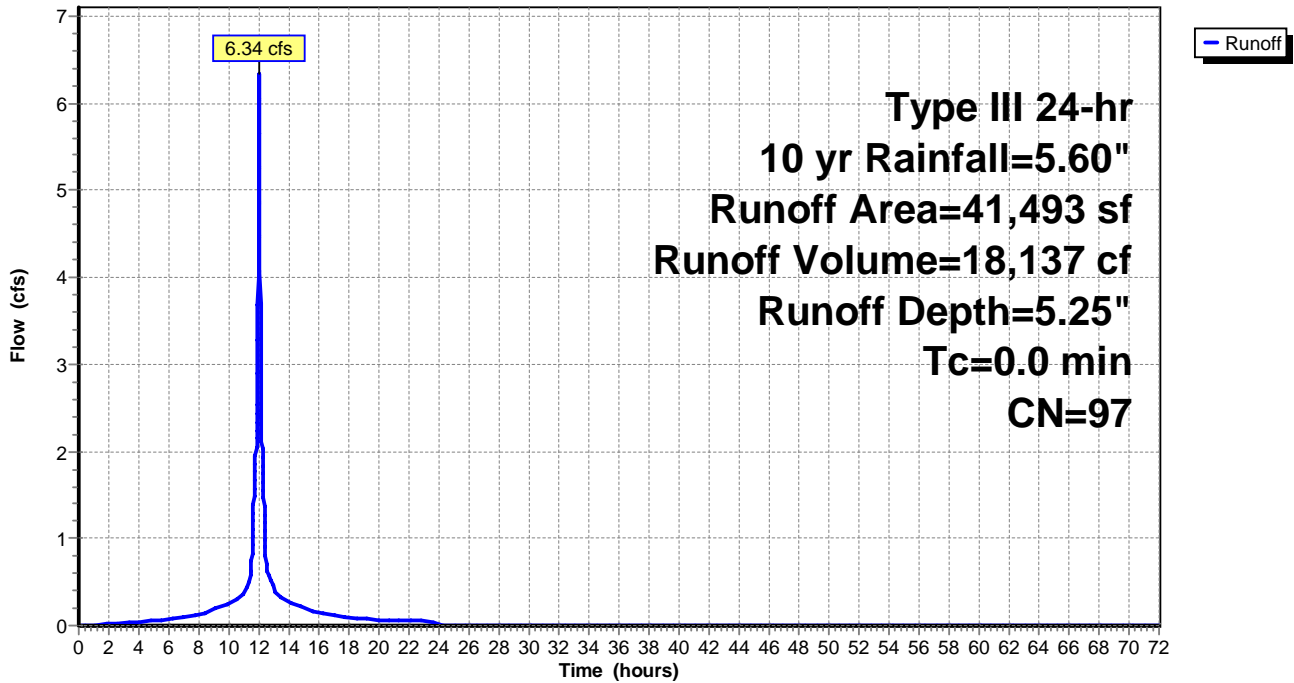

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 16

**Summary for Subcatchment 6:**

Runoff = 3.81 cfs @ 12.08 hrs, Volume= 13,285 cf, Depth= 5.25"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,290	74	>75% Grass cover, Good, HSG C
4,065	98	Roofs, HSG C
25,039	98	Paved parking, HSG C
30,394	97	Weighted Average
1,290		4.24% Pervious Area
29,104		95.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 6:**

**Hydrograph**

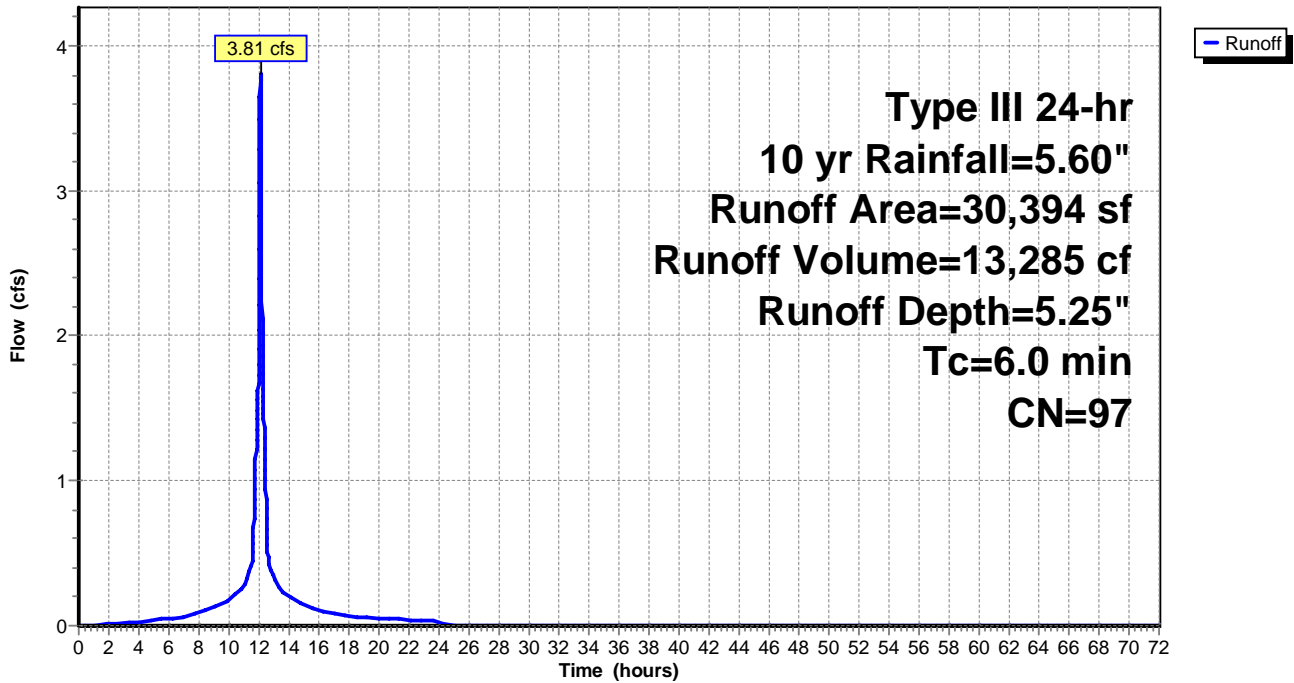

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 17

**Summary for Subcatchment 7:**

Runoff = 13.50 cfs @ 12.08 hrs, Volume= 44,393 cf, Depth= 4.68"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
29,577	74	>75% Grass cover, Good, HSG C
8,271	98	Roofs, HSG C
70,081	98	Paved parking, HSG C
5,497	98	Paved parking, HSG C
484	86	<50% Grass cover, Poor, HSG C
113,910	92	Weighted Average
30,061		26.39% Pervious Area
83,849		73.61% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 7:**

**Hydrograph**

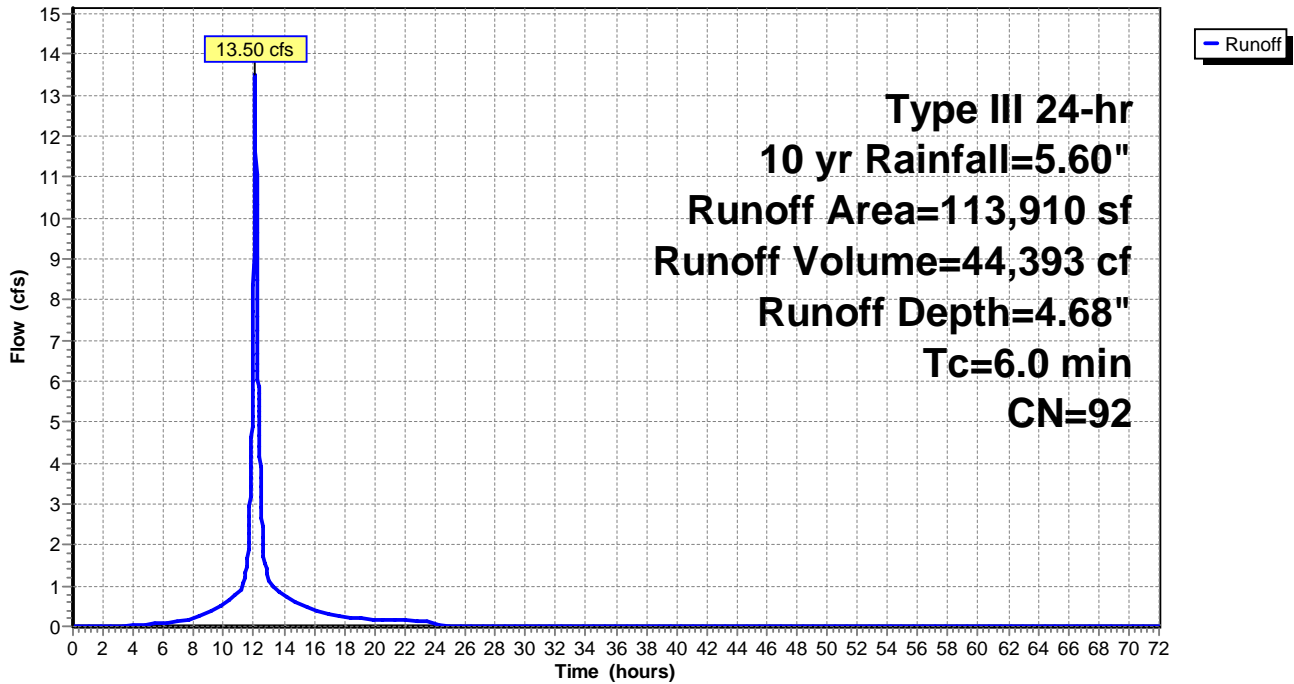

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 18

**Summary for Subcatchment 8:**


Runoff = 11.54 cfs @ 12.00 hrs, Volume= 31,371 cf, Depth= 4.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
11,870	74	>75% Grass cover, Good, HSG C
2,647	70	Woods, Good, HSG C
34,463	96	Gravel surface, HSG C
29,642	98	Paved parking, HSG C
78,622	93	Weighted Average
48,980		62.30% Pervious Area
29,642		37.70% Impervious Area

**Subcatchment 8:**

**Hydrograph**

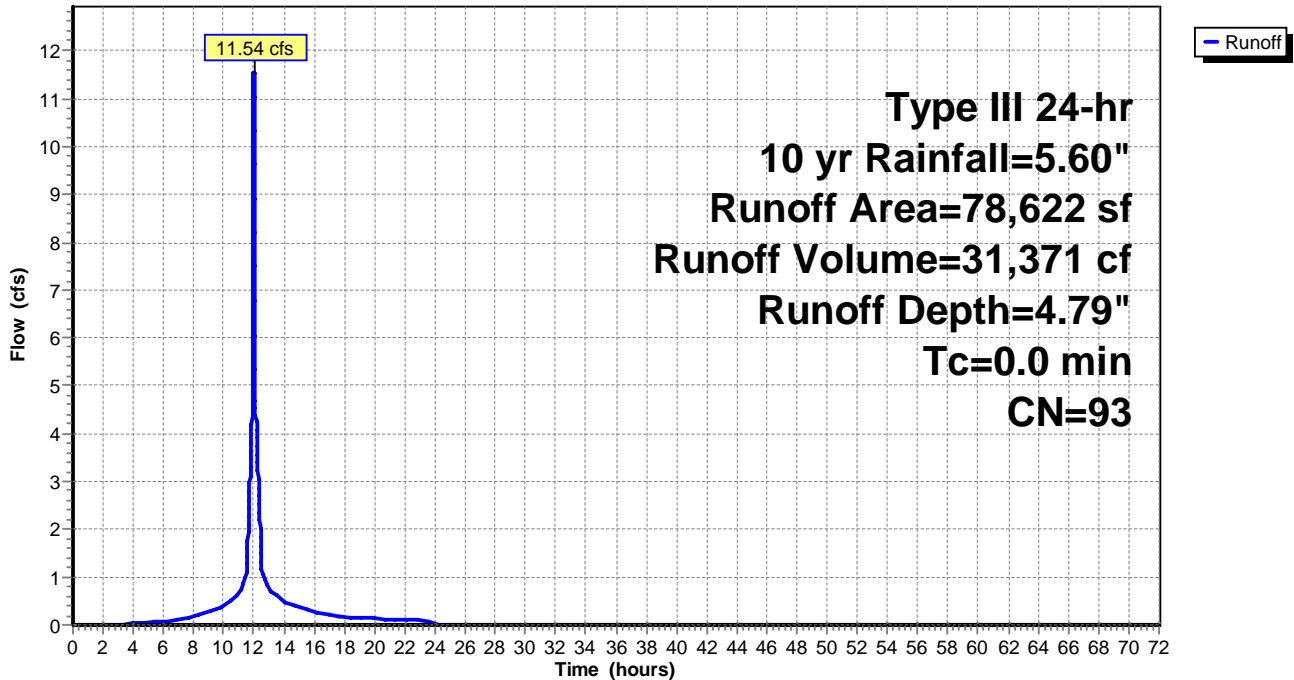



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 19

**Summary for Subcatchment 9:**

Runoff = 1.39 cfs @ 12.09 hrs, Volume= 4,431 cf, Depth= 4.24"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,710	74	>75% Grass cover, Good, HSG C
1,203	70	Woods, Good, HSG C
235	70	Woods, Good, HSG C
2,236	98	Paved parking, HSG C
4,367	98	Paved parking, HSG C
785	96	Gravel surface, HSG C
12,536	88	Weighted Average
5,933		47.33% Pervious Area
6,603		52.67% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 9:**

**Hydrograph**

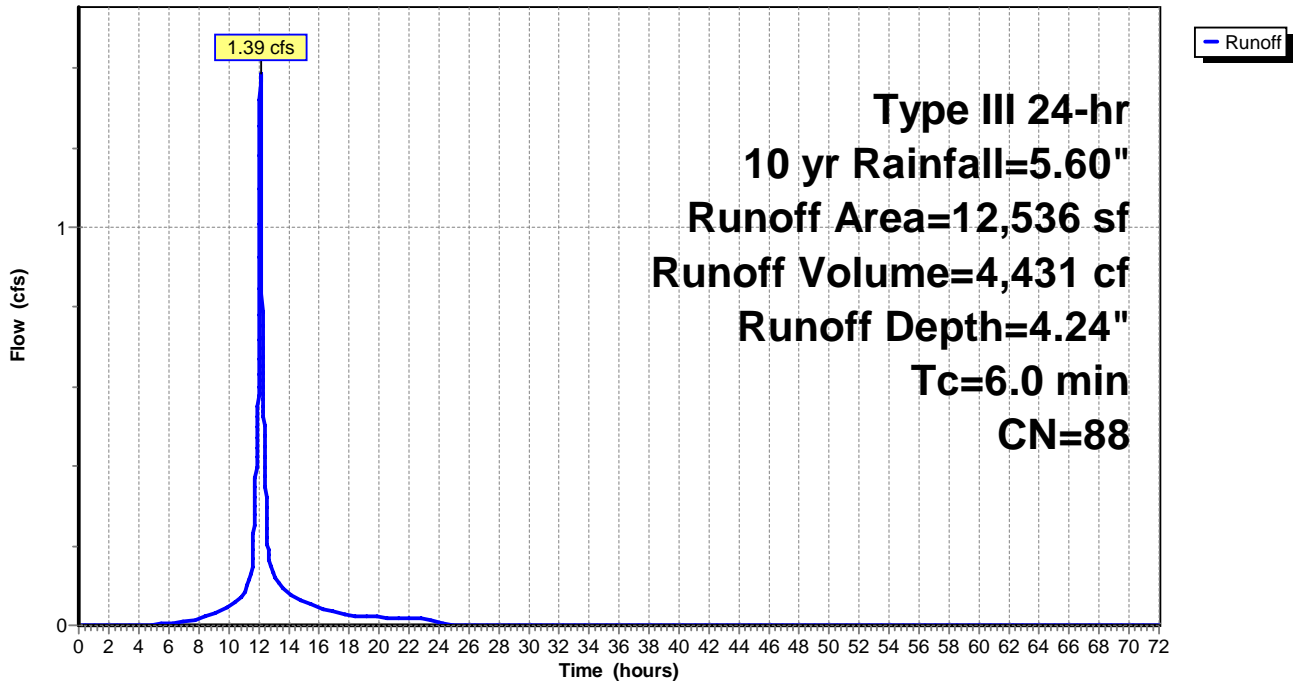

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 20

**Summary for Subcatchment 10:**

Runoff = 9.61 cfs @ 12.09 hrs, Volume= 29,763 cf, Depth= 3.23"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
8,775	74	>75% Grass cover, Good, HSG C
70,036	70	Woods, Good, HSG C
31,832	98	Paved parking, HSG C
110,643	78	Weighted Average
78,811		71.23% Pervious Area
31,832		28.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 10:**

Hydrograph

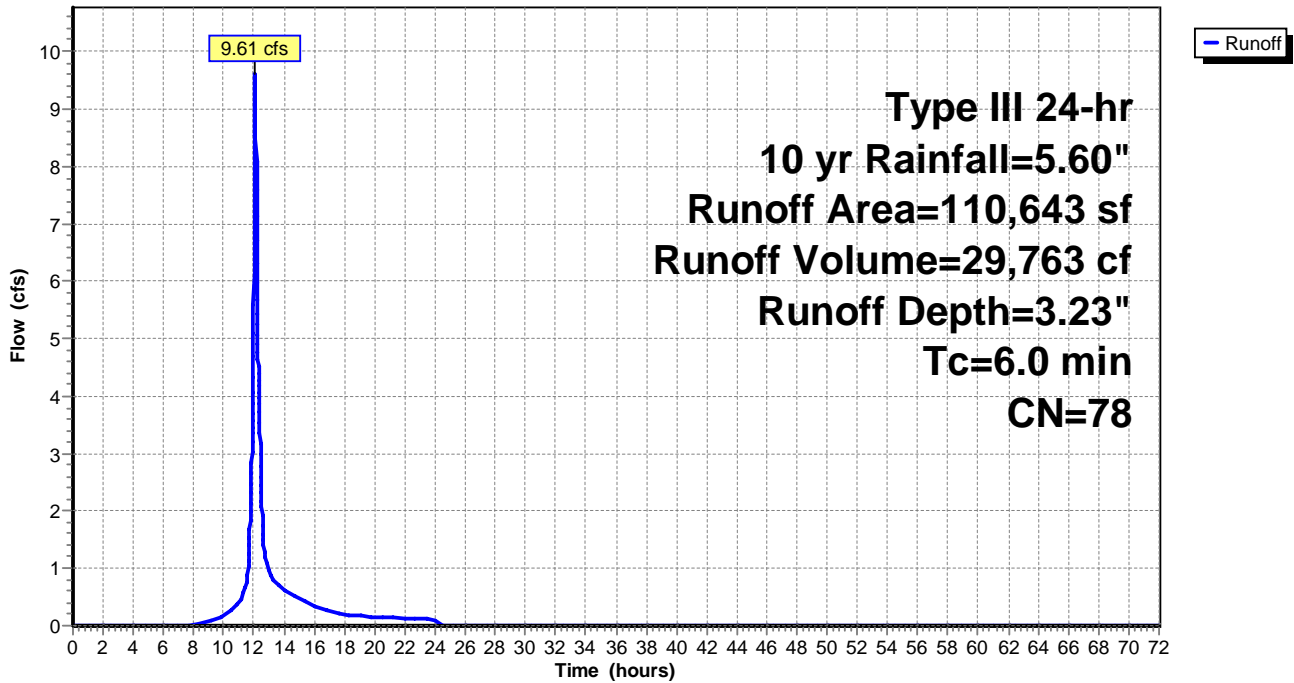

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 21

**Summary for Subcatchment 11:**

Runoff = 3.50 cfs @ 12.08 hrs, Volume= 12,047 cf, Depth= 5.13"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,988	74	>75% Grass cover, Good, HSG C
26,196	98	Paved parking, HSG C
28,184	96	Weighted Average
1,988		7.05% Pervious Area
26,196		92.95% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 11:**

**Hydrograph**

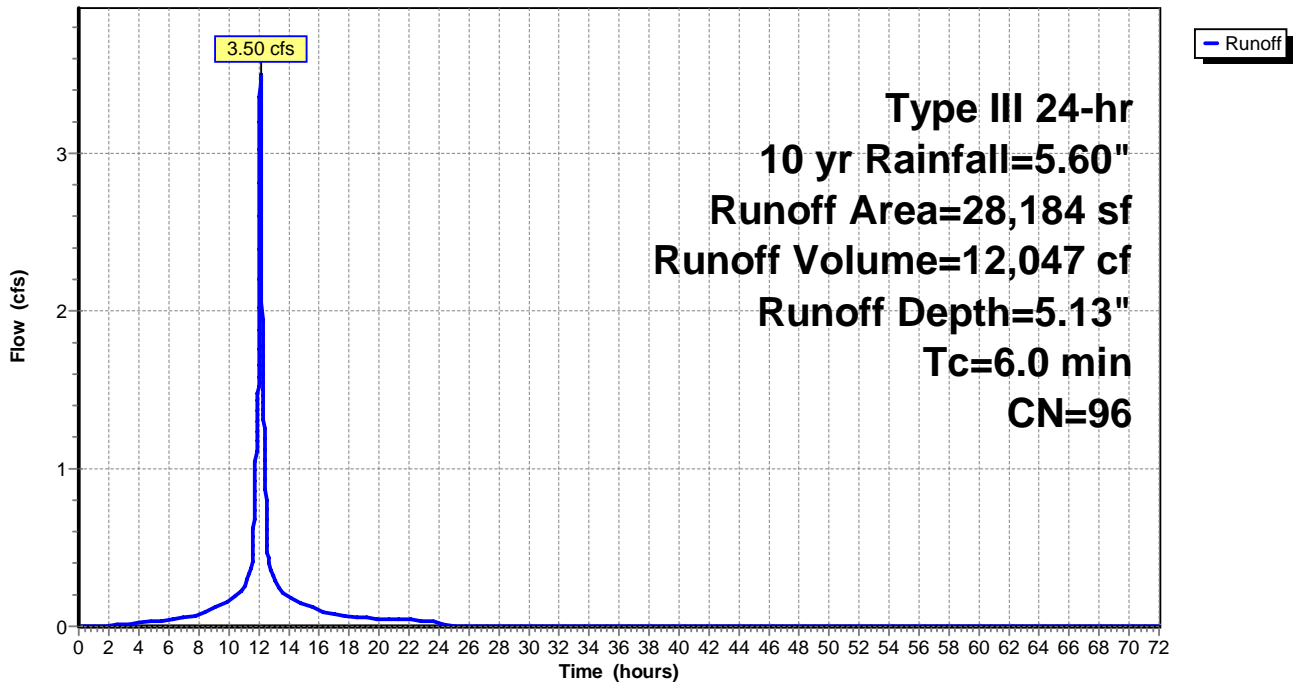

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 22

**Summary for Subcatchment 12:**

Runoff = 0.83 cfs @ 12.09 hrs, Volume= 2,567 cf, Depth= 3.32"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
7,227	74	>75% Grass cover, Good, HSG C
2,037	98	Paved parking, HSG C
9,264	79	Weighted Average
7,227		78.01% Pervious Area
2,037		21.99% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 12:**

**Hydrograph**

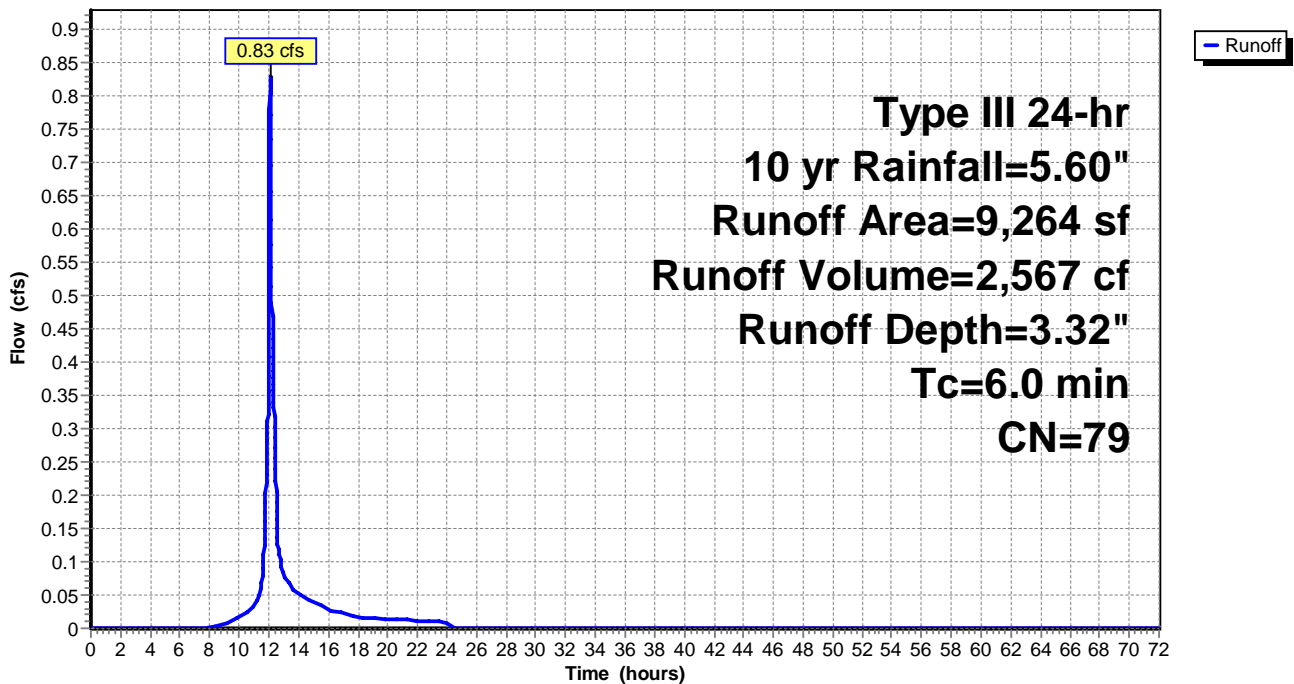

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 23

**Summary for Subcatchment 13:**

Runoff = 0.69 cfs @ 12.08 hrs, Volume= 2,230 cf, Depth= 4.46"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
2,007	74	>75% Grass cover, Good, HSG C
3,996	98	Paved parking, HSG C
6,003	90	Weighted Average
2,007		33.43% Pervious Area
3,996		66.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 13:**

**Hydrograph**

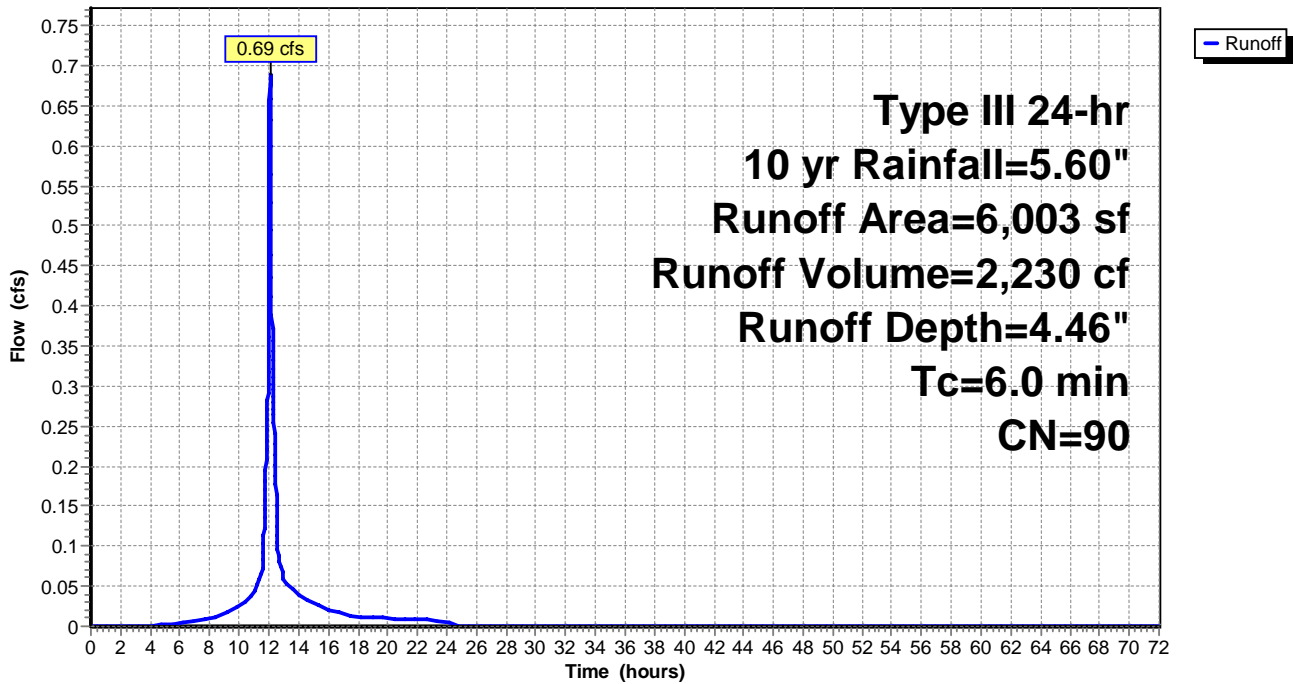

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 24

**Summary for Subcatchment 14:**

Runoff = 0.49 cfs @ 12.08 hrs, Volume= 1,681 cf, Depth= 5.13"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,795	98	Roofs, HSG C
252	70	Woods, Good, HSG C
1,885	98	Paved parking, HSG C
3,932	96	Weighted Average
252		6.41% Pervious Area
3,680		93.59% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 14:**

**Hydrograph**

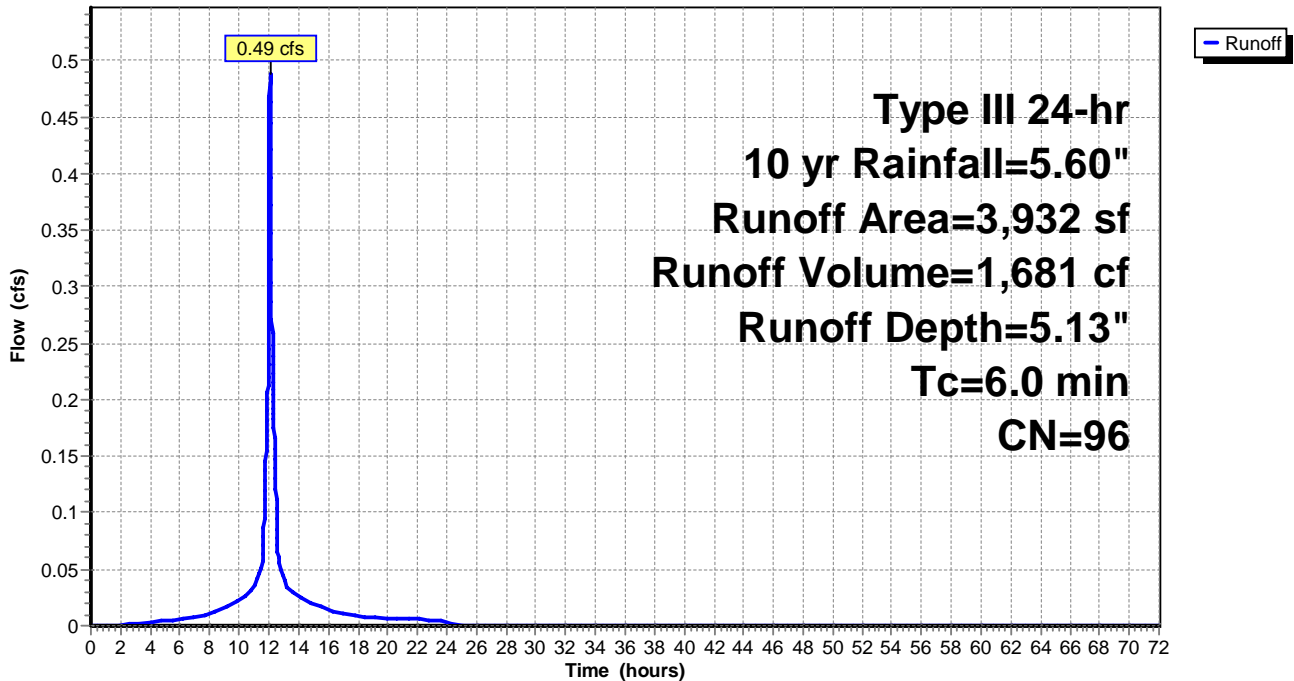

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 25

**Summary for Subcatchment 15:**


Runoff = 0.74 cfs @ 12.00 hrs, Volume= 1,951 cf, Depth= 4.46"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,194	70	Woods, Good, HSG C
3,422	96	Gravel surface, HSG C
636	98	Paved parking, HSG C
5,252	90	Weighted Average
4,616		87.89% Pervious Area
636		12.11% Impervious Area

**Subcatchment 15:**

Hydrograph

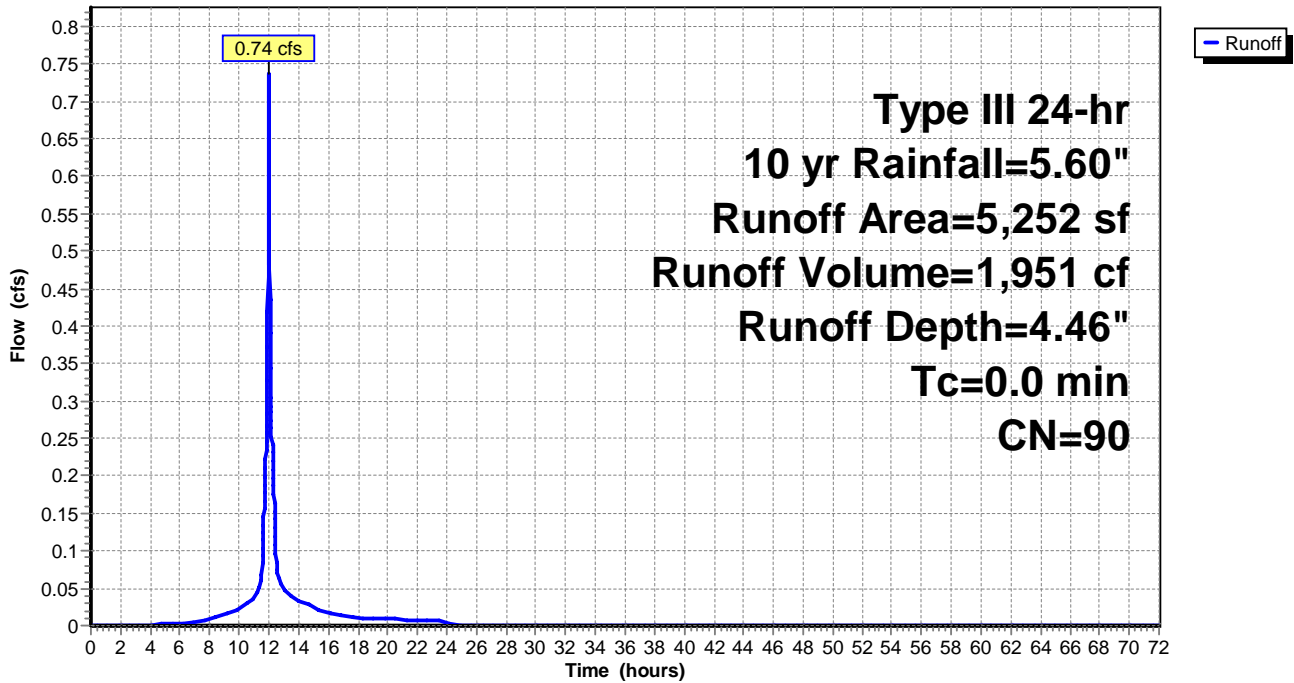



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 26

**Summary for Subcatchment 16:**


Runoff = 0.56 cfs @ 12.00 hrs, Volume= 1,554 cf, Depth= 5.01"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,301	98	Paved parking, HSG C
418	74	>75% Grass cover, Good, HSG C
3,719	95	Weighted Average
418		11.24% Pervious Area
3,301		88.76% Impervious Area

**Subcatchment 16:**

**Hydrograph**

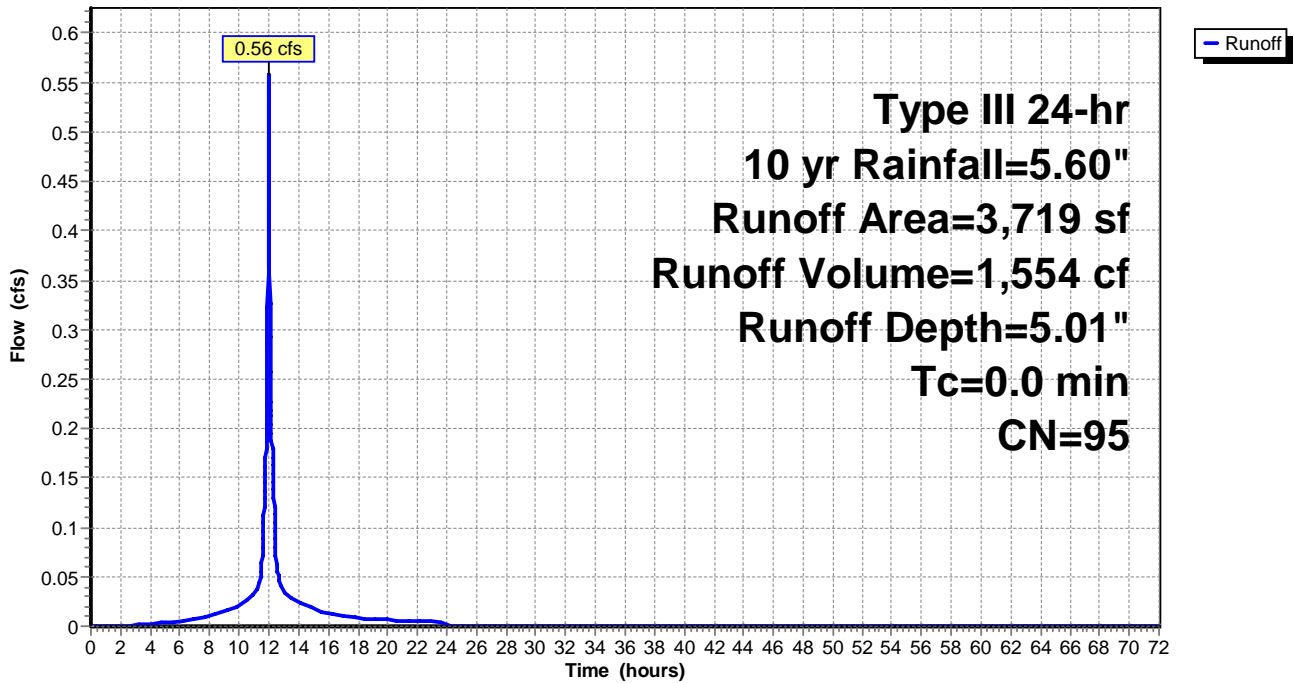

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 27

**Summary for Subcatchment 17:**


Runoff = 0.50 cfs @ 12.00 hrs, Volume= 1,457 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,261	98	Paved parking, HSG C
3,261		100.00% Impervious Area

**Subcatchment 17:**

Hydrograph

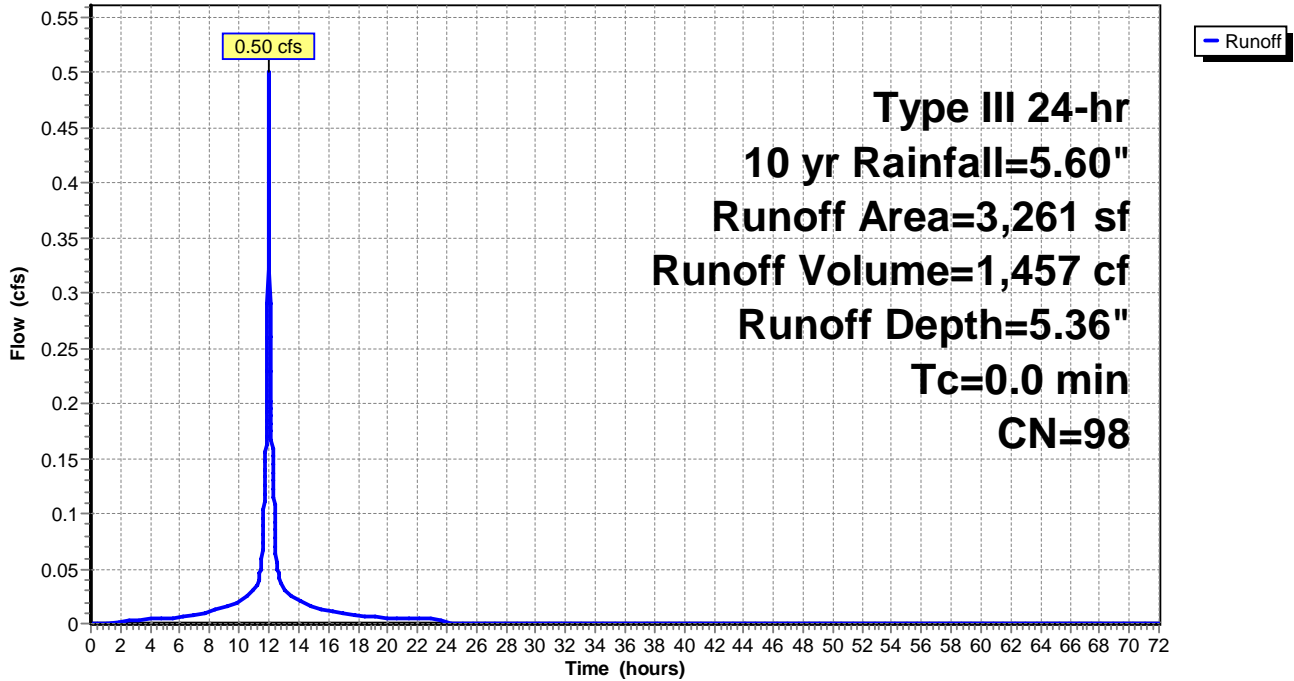

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 28

**Summary for Subcatchment 18:**


Runoff = 2.33 cfs @ 12.00 hrs, Volume= 6,002 cf, Depth= 3.93"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
8,272	98	Paved parking, HSG C
10,072	74	>75% Grass cover, Good, HSG C
18,344	85	Weighted Average
10,072		54.91% Pervious Area
8,272		45.09% Impervious Area

**Subcatchment 18:**

**Hydrograph**

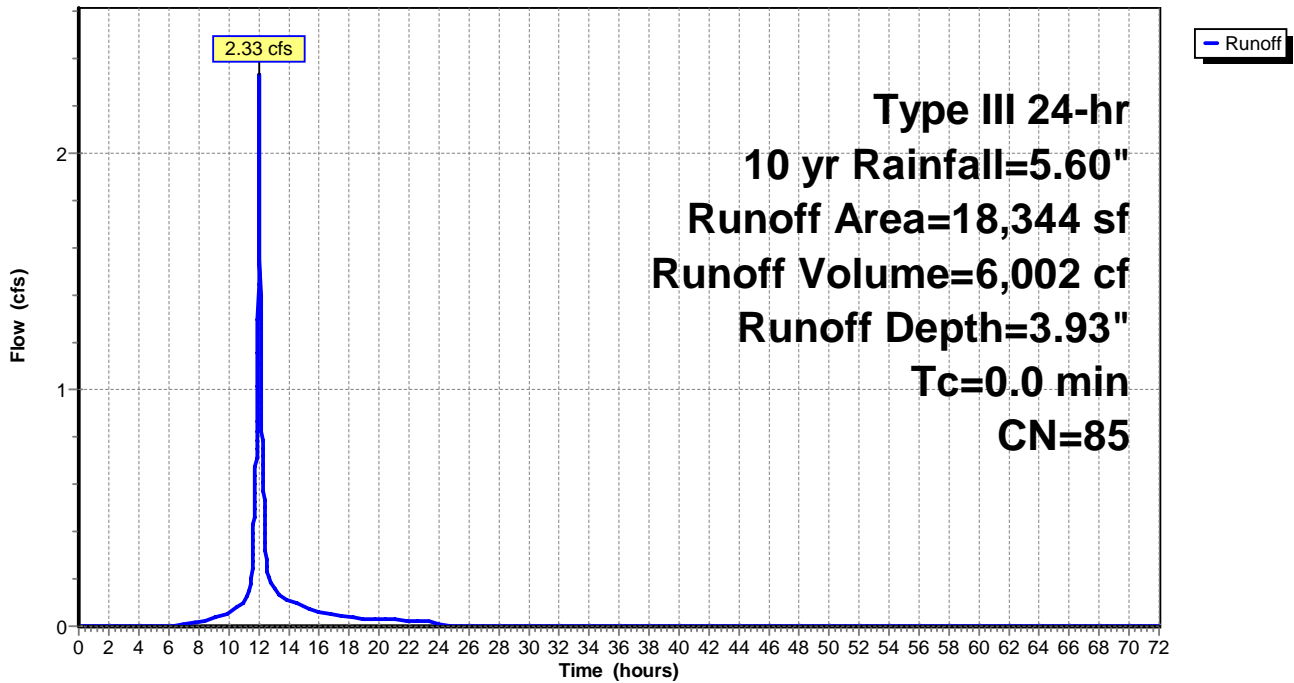

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 29

**Summary for Subcatchment 19:**


Runoff = 0.03 cfs @ 12.00 hrs, Volume= 97 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
216	98	Paved parking, HSG C
216		100.00% Impervious Area

**Subcatchment 19:**

**Hydrograph**

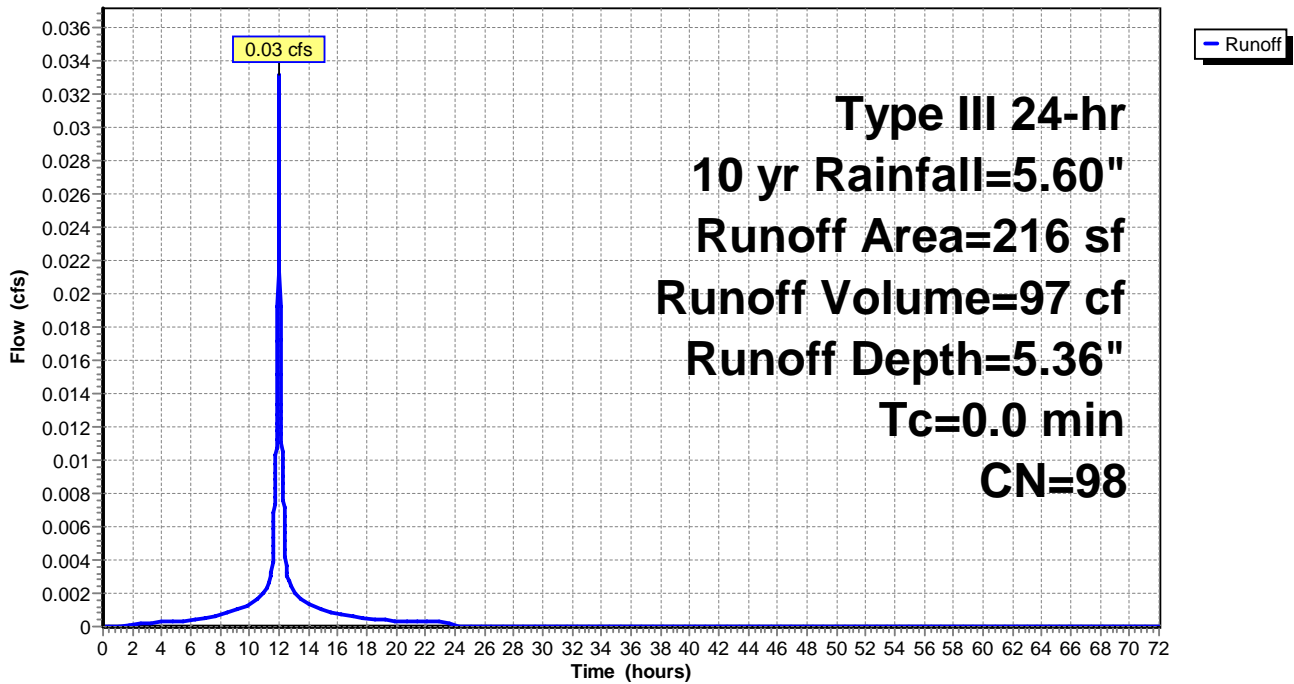

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 30

**Summary for Subcatchment 20:**


Runoff = 0.09 cfs @ 12.00 hrs, Volume= 272 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
609	98	Paved parking, HSG C
609		100.00% Impervious Area

**Subcatchment 20:**

**Hydrograph**

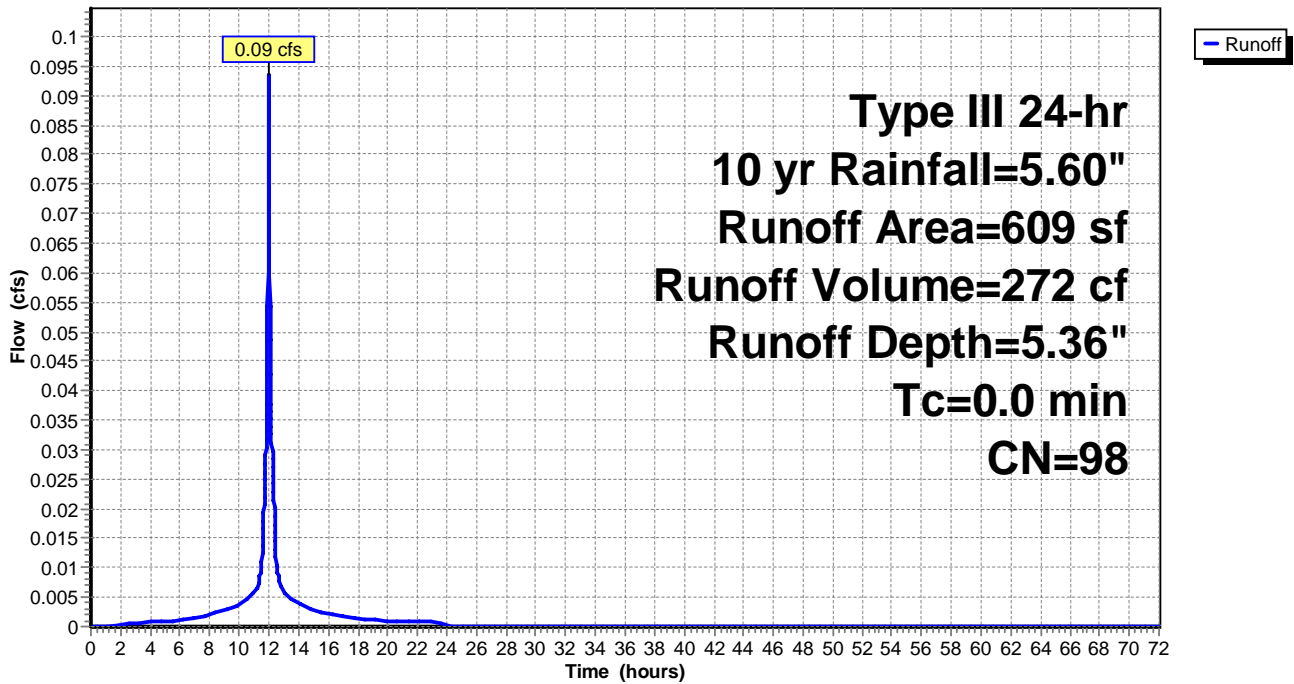

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 31

**Summary for Subcatchment 21:**


Runoff = 1.32 cfs @ 12.00 hrs, Volume= 3,640 cf, Depth= 4.90"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
7,413	98	Paved parking, HSG C
1,500	74	>75% Grass cover, Good, HSG C
8,913	94	Weighted Average
1,500		16.83% Pervious Area
7,413		83.17% Impervious Area

**Subcatchment 21:**

Hydrograph

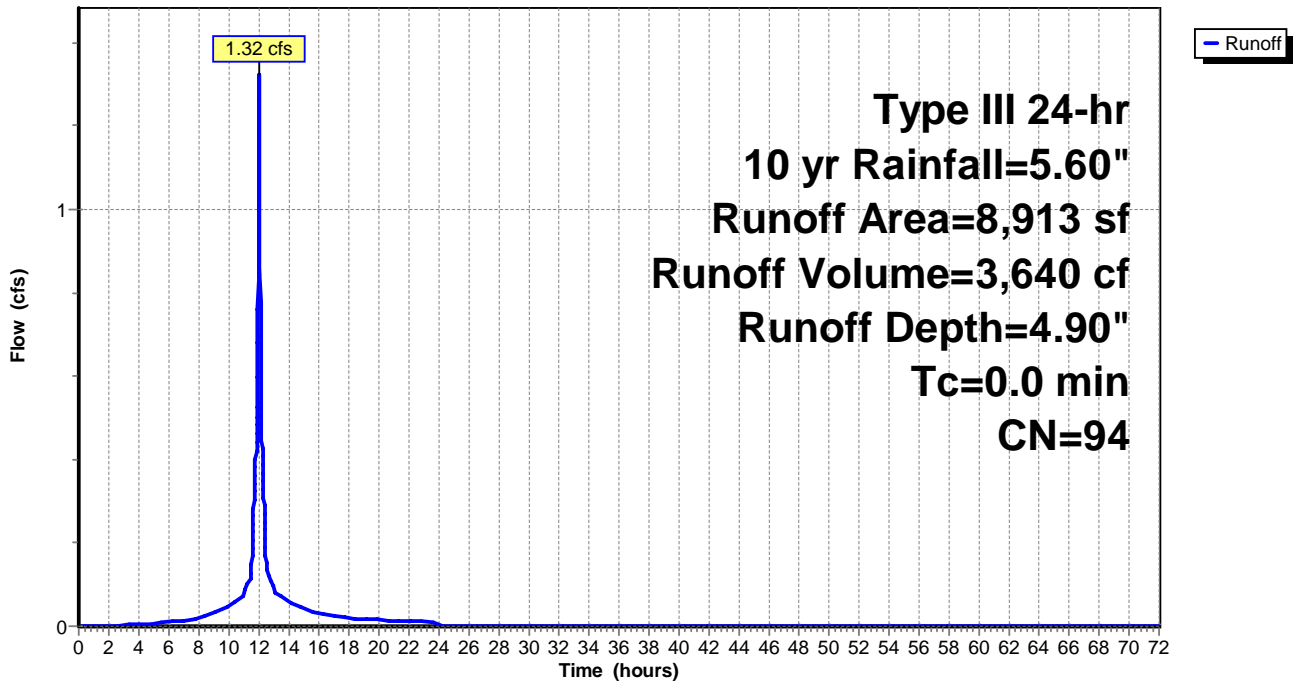

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 32

**Summary for Subcatchment 22:**


Runoff = 0.95 cfs @ 12.00 hrs, Volume= 2,708 cf, Depth= 5.25"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
5,893	98	Paved parking, HSG C
303	74	>75% Grass cover, Good, HSG C
6,196	97	Weighted Average
303		4.89% Pervious Area
5,893		95.11% Impervious Area

**Subcatchment 22:**

Hydrograph

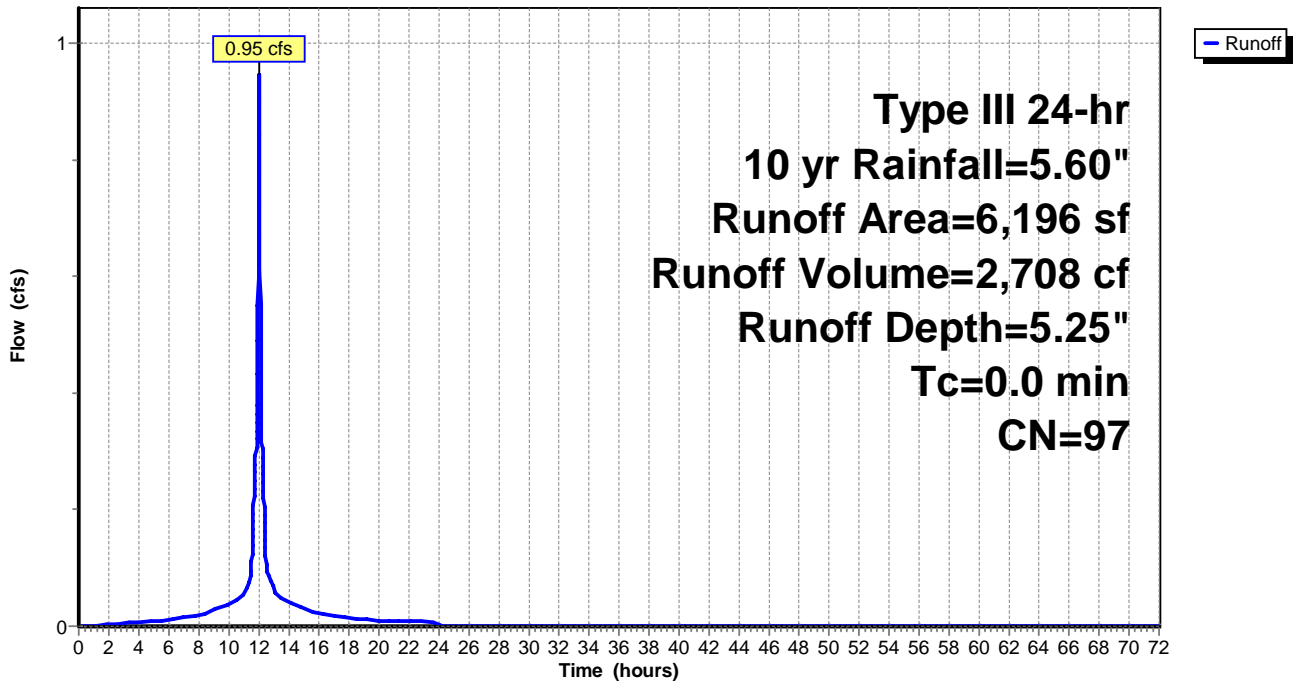



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 33

**Summary for Subcatchment 23:**


Runoff = 0.06 cfs @ 12.00 hrs, Volume= 186 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
417	98	Paved parking, HSG C
417		100.00% Impervious Area

**Subcatchment 23:**

**Hydrograph**

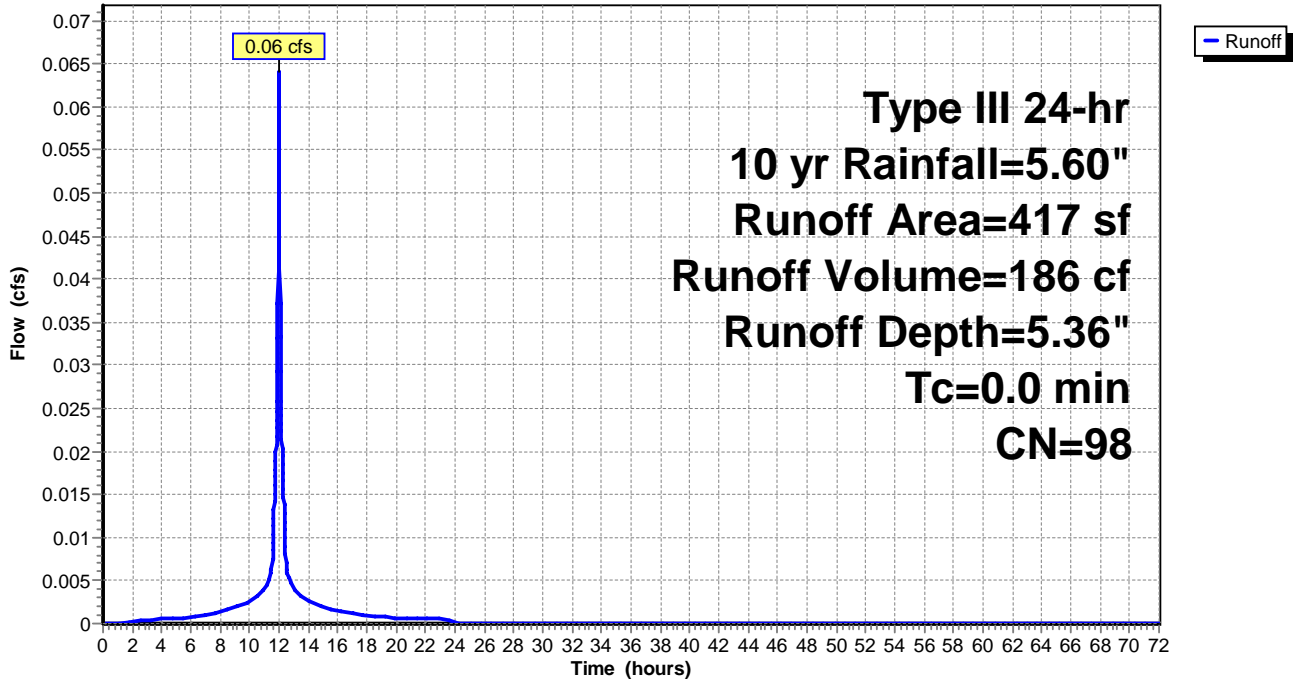

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 34

**Summary for Subcatchment 24:**


Runoff = 0.54 cfs @ 12.00 hrs, Volume= 1,573 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,520	98	Paved parking, HSG C
3,520		100.00% Impervious Area

**Subcatchment 24:**

**Hydrograph**

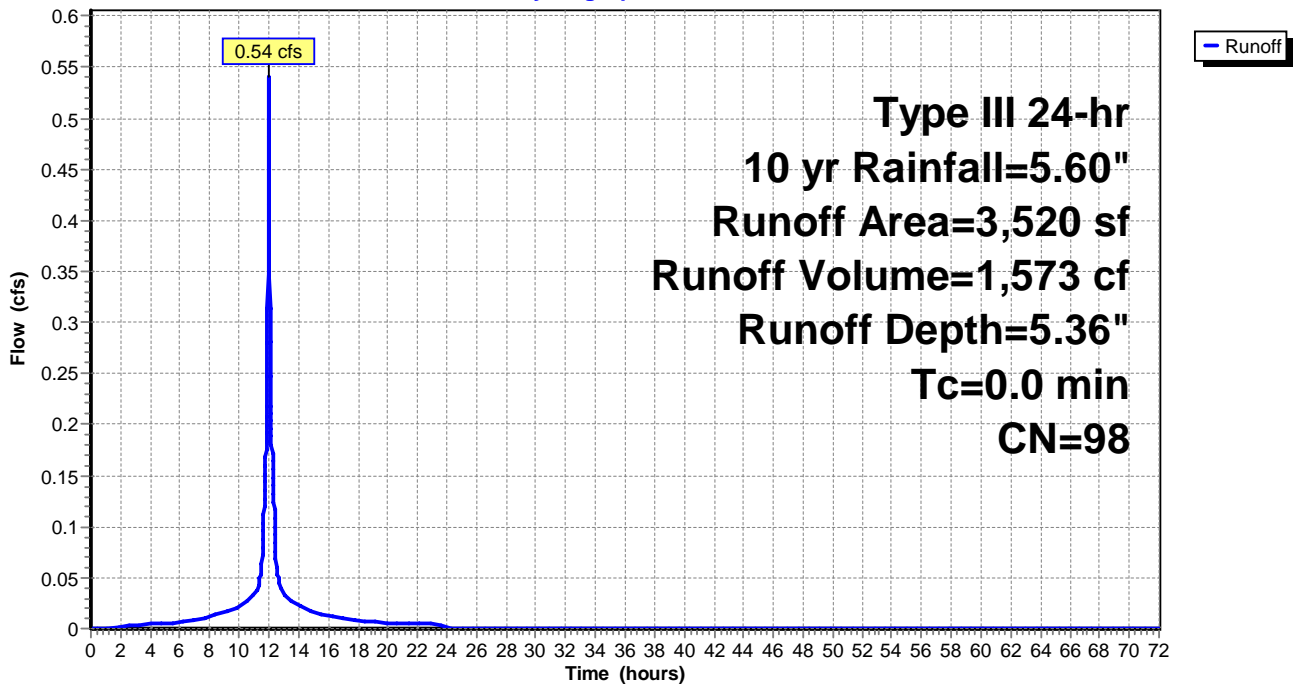

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 35

**Summary for Subcatchment 25:**


Runoff = 0.53 cfs @ 12.00 hrs, Volume= 1,535 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,436	98	Paved parking, HSG C
3,436		100.00% Impervious Area

**Subcatchment 25:**

**Hydrograph**

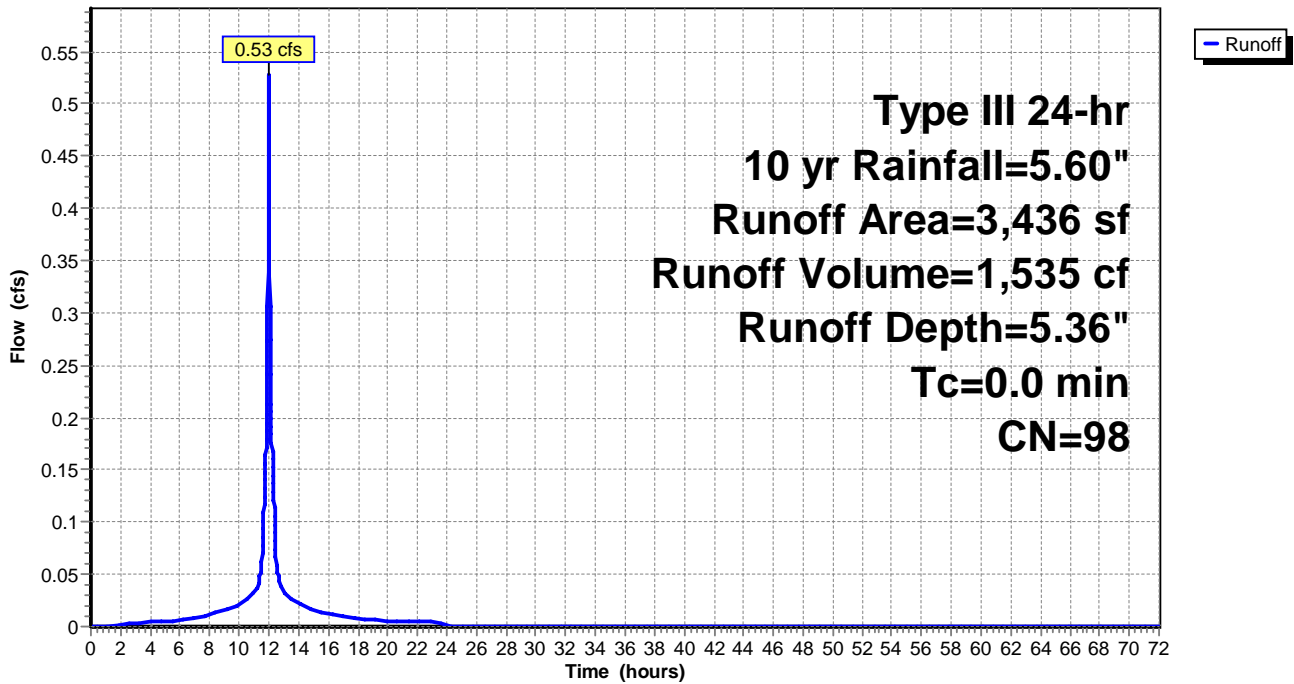

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 36

**Summary for Subcatchment 26:**


Runoff = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
4,381	98	Roofs, HSG C
4,381		100.00% Impervious Area

**Subcatchment 26:**

**Hydrograph**

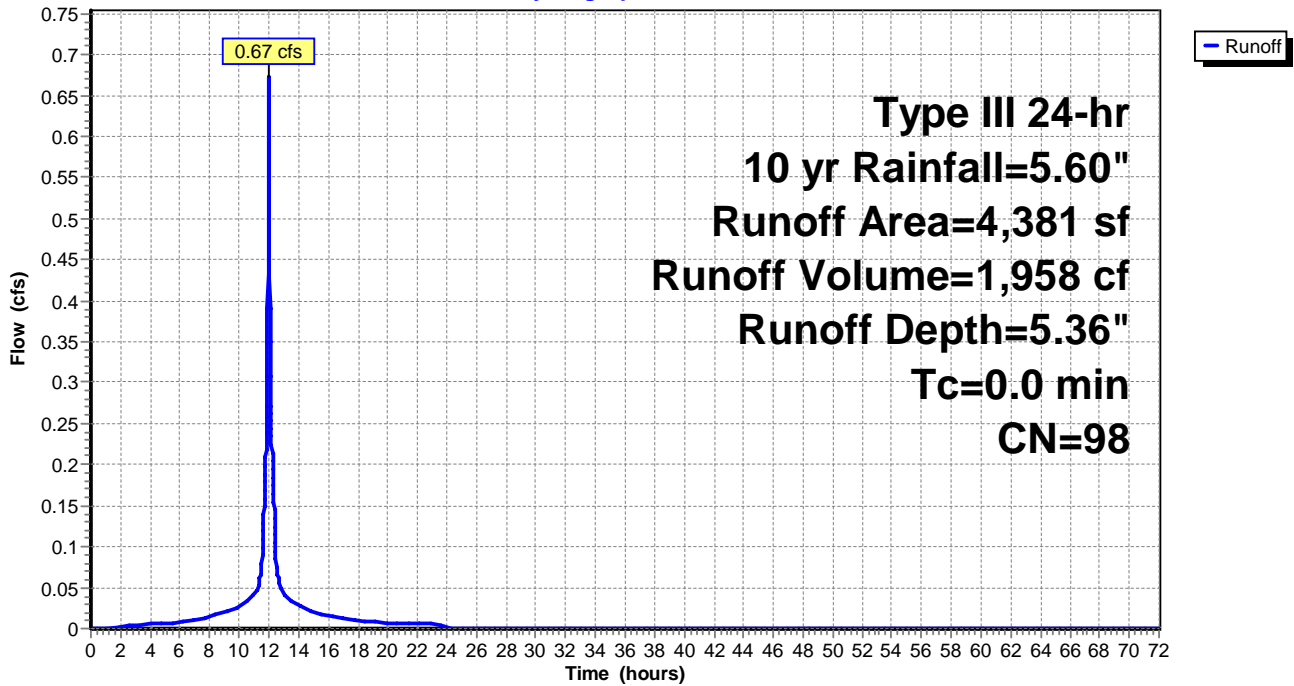

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 37


**Summary for Reach OS1:**

Inflow Area = 5,252 sf, 12.11% Impervious, Inflow Depth = 4.46" for 10 yr event  
Inflow = 0.74 cfs @ 12.00 hrs, Volume= 1,951 cf  
Outflow = 0.74 cfs @ 12.00 hrs, Volume= 1,951 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Reach OS1:**

Hydrograph

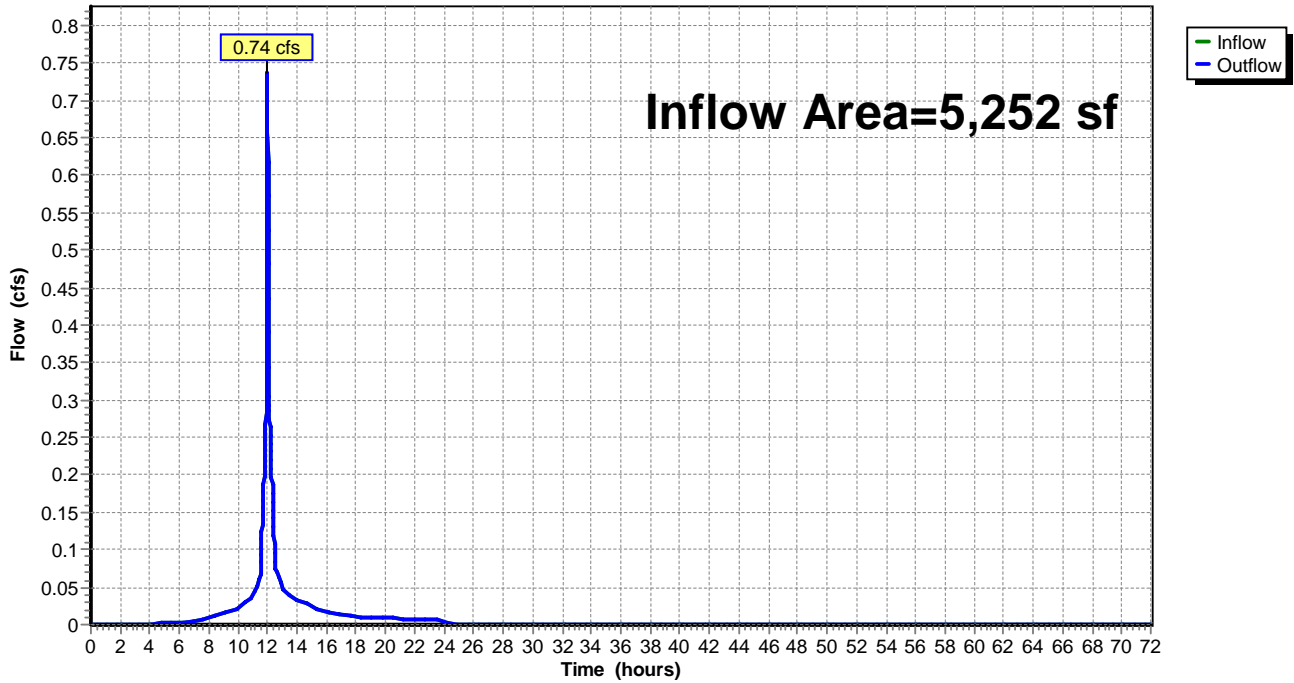

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 38


**Summary for Reach OS2:**

Inflow Area = 113,910 sf, 73.61% Impervious, Inflow Depth = 4.68" for 10 yr event  
Inflow = 13.50 cfs @ 12.08 hrs, Volume= 44,393 cf  
Outflow = 13.50 cfs @ 12.08 hrs, Volume= 44,393 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Reach OS2:**

Hydrograph

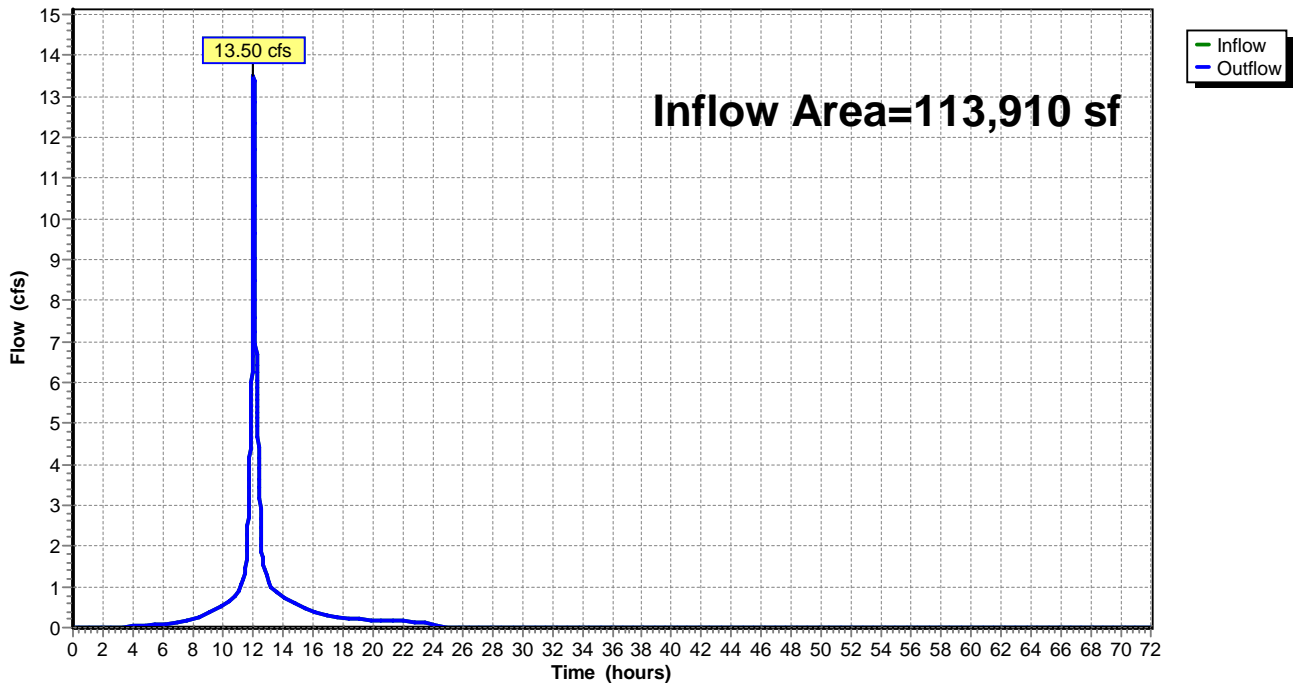

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 39


**Summary for Reach TB:**

Inflow Area = 30,394 sf, 95.76% Impervious, Inflow Depth = 5.25" for 10 yr event  
Inflow = 3.81 cfs @ 12.08 hrs, Volume= 13,285 cf  
Outflow = 3.81 cfs @ 12.08 hrs, Volume= 13,285 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Reach TB:**

Hydrograph

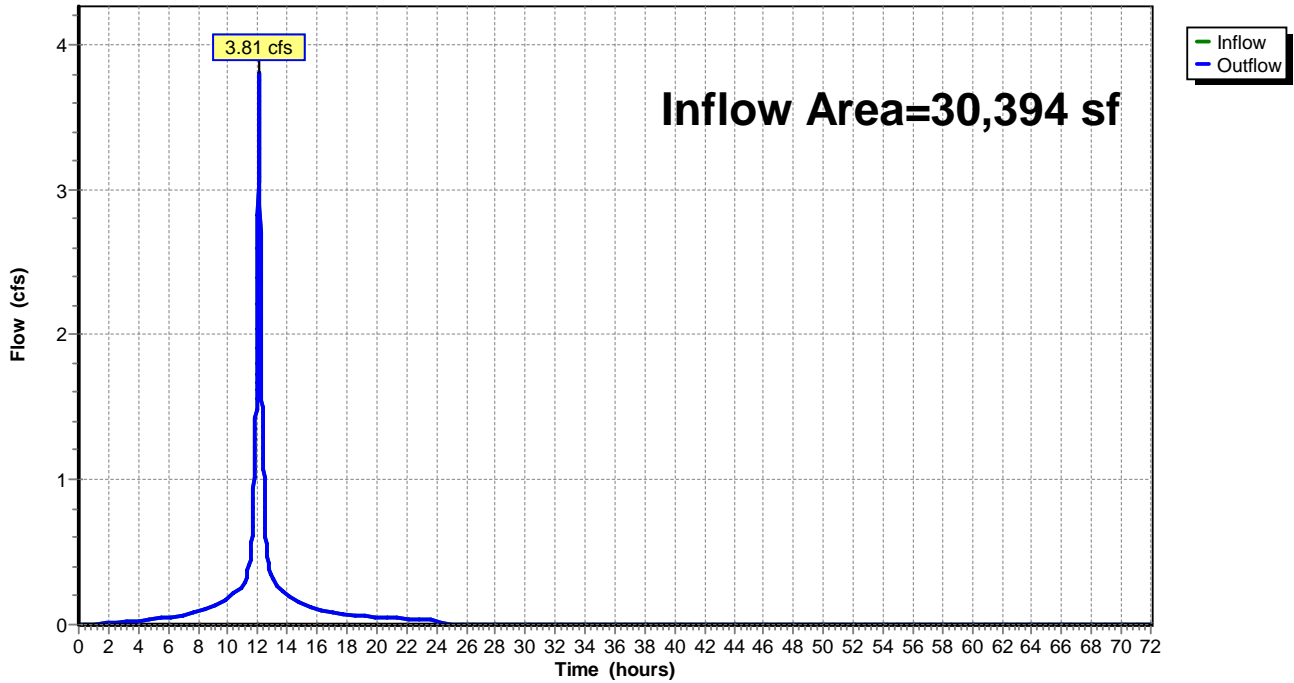



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 40

**Summary for Pond 1056:**

Inflow Area = 36,669 sf, 98.09% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 3.95 cfs @ 12.15 hrs, Volume= 16,386 cf  
 Outflow = 3.95 cfs @ 12.15 hrs, Volume= 16,386 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 3.95 cfs @ 12.15 hrs, Volume= 16,386 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 369.43' @ 12.11 hrs


Flood Elev= 23.30'

Device #1	Routing	Invert	Outlet Devices
	Primary	18.30'	<b>12.0" Round Culvert</b> L= 128.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.30' / 17.70' S= 0.0047 '/' Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=6.56 cfs @ 12.15 hrs HW=348.61' TW=330.85' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 6.56 cfs @ 8.35 fps)

**Pond 1056:**

Hydrograph

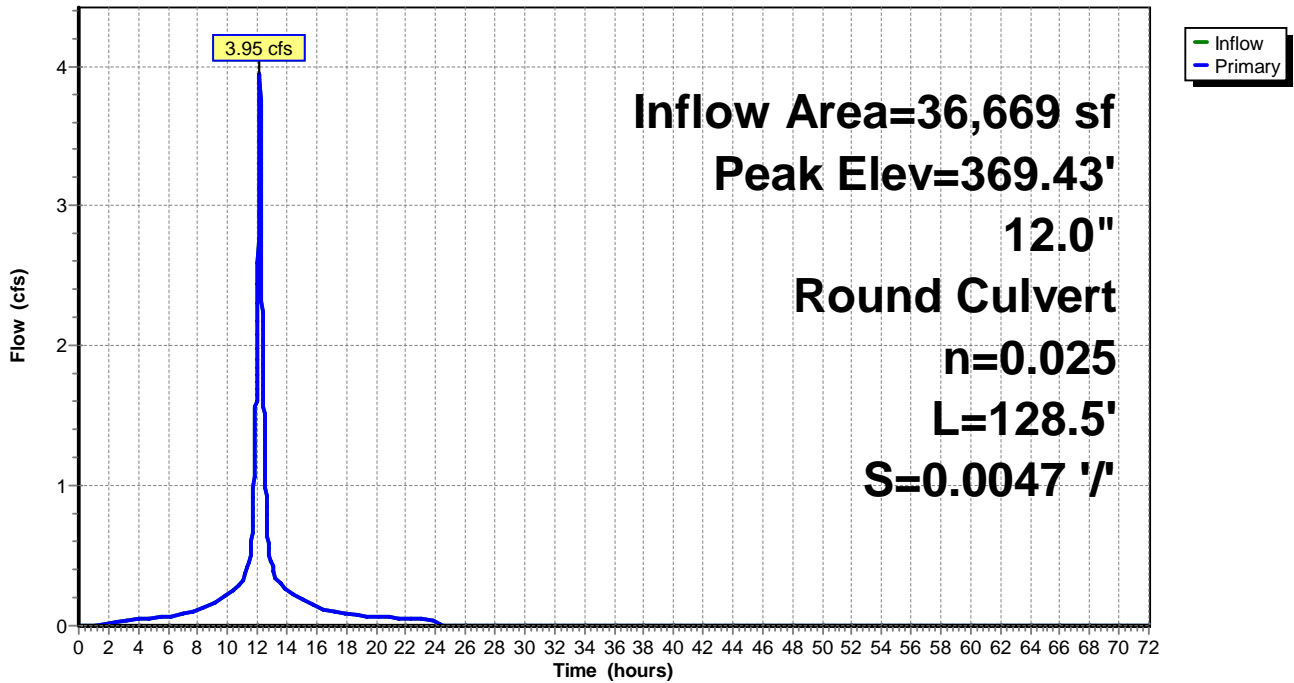

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 41

**Summary for Pond 1071:**

Inflow Area = 62,857 sf, 94.73% Impervious, Inflow Depth = 5.25" for 10 yr event  
 Inflow = 7.15 cfs @ 12.12 hrs, Volume= 27,475 cf  
 Outflow = 7.15 cfs @ 12.12 hrs, Volume= 27,475 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 7.15 cfs @ 12.12 hrs, Volume= 27,475 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 188.86' @ 12.11 hrs  
 Flood Elev= 22.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	17.50'	<b>12.0" Round Culvert</b> L= 31.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.50' / 17.30' S= 0.0065 '/' Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=8.08 cfs @ 12.12 hrs HW=187.80' TW=179.41' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 8.08 cfs @ 10.29 fps)

**Pond 1071:**

Hydrograph

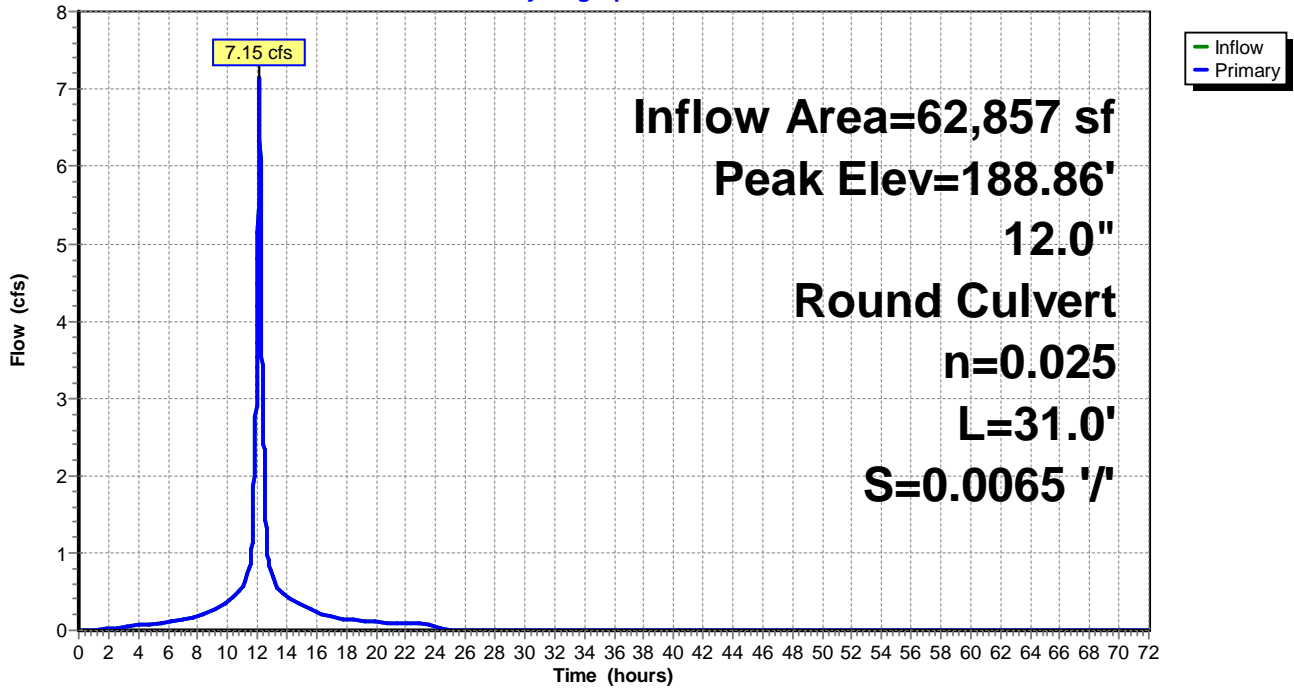

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 42

**Summary for Pond 1072:**

Inflow Area = 200,704 sf, 95.31% Impervious, Inflow Depth = 5.25" for 10 yr event  
 Inflow = 20.64 cfs @ 12.09 hrs, Volume= 87,878 cf  
 Outflow = 20.64 cfs @ 12.09 hrs, Volume= 87,878 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 20.64 cfs @ 12.09 hrs, Volume= 87,878 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 182.36' @ 12.10 hrs  
 Flood Elev= 22.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	17.10'	<b>15.0" Round Culvert</b> L= 31.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.10' / 15.90' S= 0.0387 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 1.23 sf

**Primary OutFlow** Max=19.37 cfs @ 12.09 hrs HW=180.01' TW=163.87' (Dynamic Tailwater)  
 ← **1=Culvert** (Outlet Controls 19.37 cfs @ 15.78 fps)

**Pond 1072:**

Hydrograph

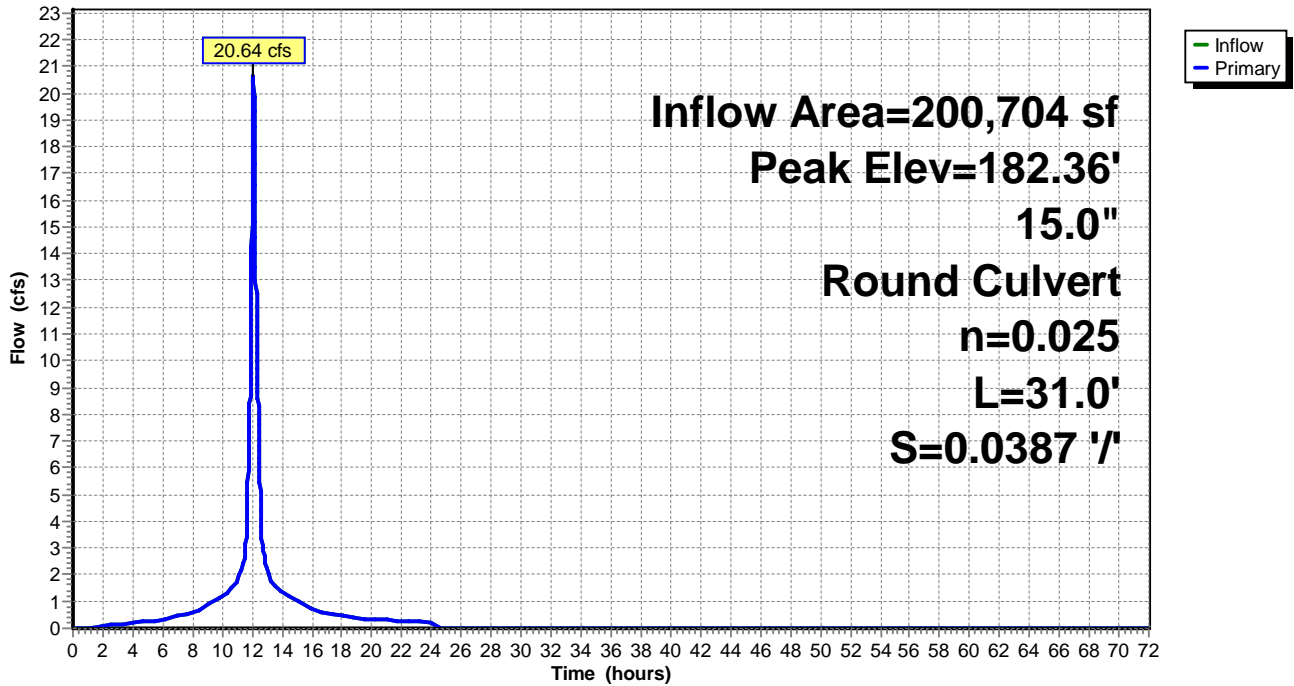

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 43

**Summary for Pond 1128:**

Inflow Area = 83,475 sf, 95.62% Impervious, Inflow Depth = 5.24" for 10 yr event  
 Inflow = 9.65 cfs @ 12.01 hrs, Volume= 36,450 cf  
 Outflow = 9.65 cfs @ 12.01 hrs, Volume= 36,450 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 9.65 cfs @ 12.01 hrs, Volume= 36,450 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 547.72' @ 12.06 hrs  
 Flood Elev= 22.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	22.90'	<b>12.0" Round Culvert</b> L= 860.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 22.90' / 14.70' S= 0.0095 '/' Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=9.20 cfs @ 12.01 hrs HW=490.86' TW=274.92' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 9.20 cfs @ 11.71 fps)

**Pond 1128:**

Hydrograph

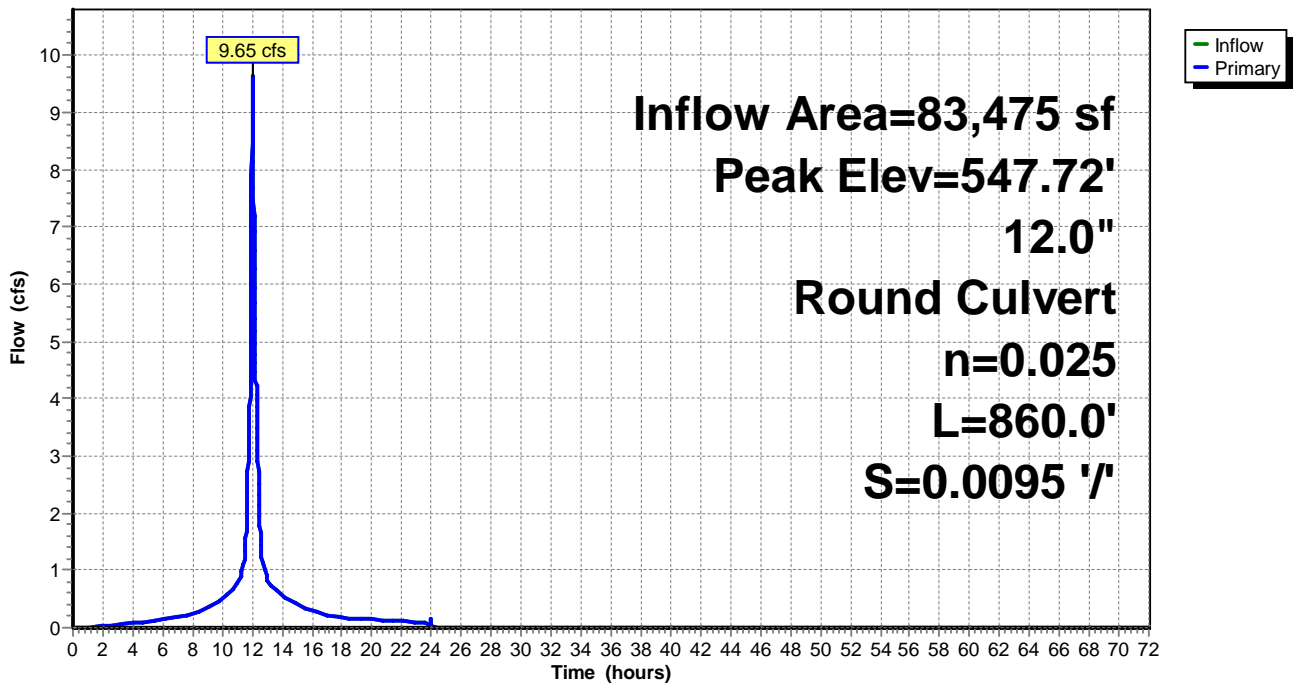

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 44

**Summary for Pond 1147:**

Inflow Area = 54,372 sf, 95.51% Impervious, Inflow Depth = 5.29" for 10 yr event  
 Inflow = 5.85 cfs @ 12.12 hrs, Volume= 23,953 cf  
 Outflow = 5.85 cfs @ 12.12 hrs, Volume= 23,953 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 5.85 cfs @ 12.12 hrs, Volume= 23,953 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 363.77' @ 12.10 hrs  
 Flood Elev= 22.20'

Device #1	Routing	Invert	Outlet Devices
	Primary	18.30'	<b>12.0" Round Culvert</b> L= 36.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.30' / 18.20' S= 0.0028 '/' Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=8.93 cfs @ 12.12 hrs HW=355.86' TW=344.45' (Dynamic Tailwater)  
 1=Culvert (Outlet Controls 8.93 cfs @ 11.37 fps)

**Pond 1147:**

Hydrograph

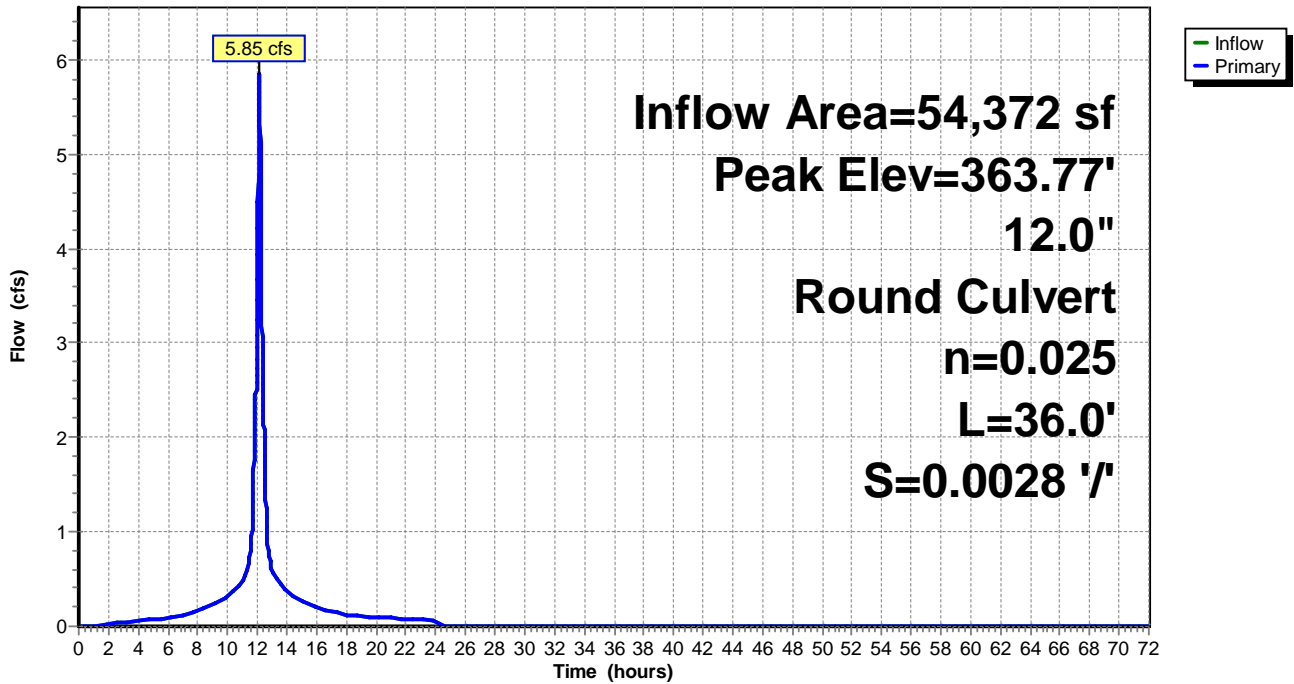

# Existing

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 45

## Summary for Pond 1148:

Inflow Area = 137,847 sf, 95.58% Impervious, Inflow Depth = 5.26" for 10 yr event  
Inflow = 14.19 cfs @ 12.07 hrs, Volume= 60,403 cf  
Outflow = 14.19 cfs @ 12.07 hrs, Volume= 60,403 cf, Atten= 0%, Lag= 0.0 min  
Primary = 14.19 cfs @ 12.07 hrs, Volume= 60,403 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 359.07' @ 12.09 hrs


Flood Elev= 22.40'

Device #1	Routing	Invert	Outlet Devices
	Primary	18.20'	<b>12.0" Round Culvert</b> L= 311.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.20' / 17.50' S= 0.0022 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=13.88 cfs @ 12.07 hrs HW=351.10' TW=168.48' (Dynamic Tailwater)  
↑ **1=Culvert** (Outlet Controls 13.88 cfs @ 17.67 fps)

## Pond 1148:

### Hydrograph

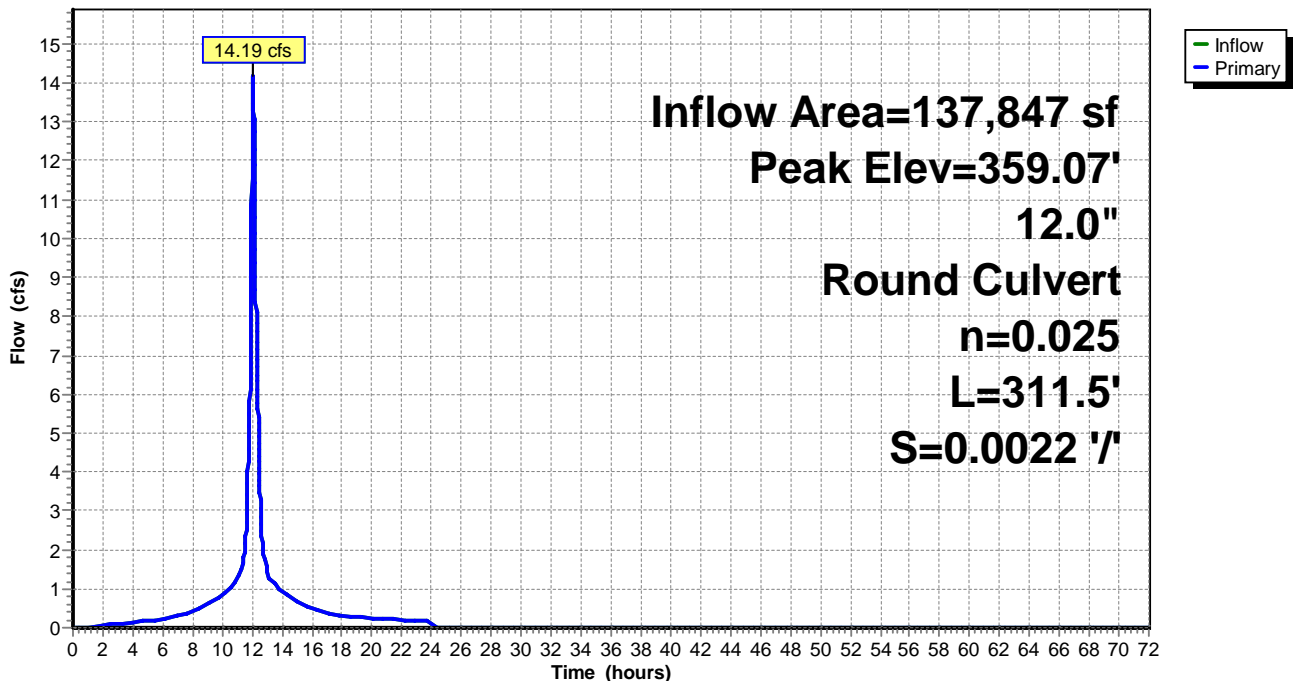

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 46

**Summary for Pond 1186:**

Inflow Area = 3,932 sf, 93.59% Impervious, Inflow Depth = 5.13" for 10 yr event  
 Inflow = 0.49 cfs @ 12.08 hrs, Volume= 1,681 cf  
 Outflow = 0.49 cfs @ 12.09 hrs, Volume= 1,680 cf, Atten= 0%, Lag= 0.3 min  
 Primary = 0.49 cfs @ 12.09 hrs, Volume= 1,680 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 557.85' @ 12.08 hrs  
 Flood Elev= 23.50'

Device #1	Routing	Invert	Outlet Devices
	Primary	22.30'	<b>12.0" Round Culvert</b> L= 161.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 22.30' / 21.00' S= 0.0080 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=3.84 cfs @ 12.09 hrs HW=556.08' TW=548.57' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 3.84 cfs @ 4.88 fps)

**Pond 1186:**

**Hydrograph**

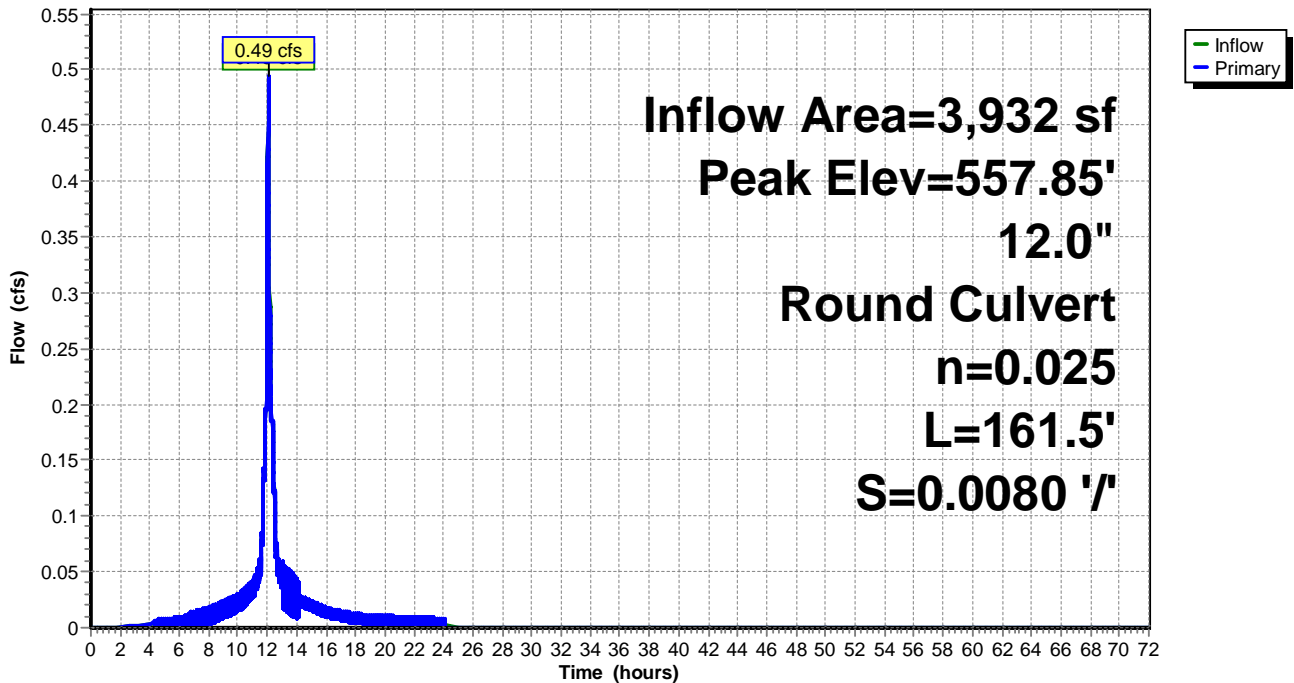



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 47

**Summary for Pond 1188:**

Inflow Area = 45,425 sf, 96.94% Impervious, Inflow Depth = 5.24" for 10 yr event  
 Inflow = 6.64 cfs @ 12.00 hrs, Volume= 19,817 cf  
 Outflow = 6.64 cfs @ 12.00 hrs, Volume= 19,818 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 6.64 cfs @ 12.00 hrs, Volume= 19,818 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 557.73' @ 12.07 hrs  
 Flood Elev= 25.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	20.00'	<b>12.0" Round Culvert</b> L= 191.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.00' / 18.90' S= 0.0058 '/' Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.00 hrs HW=450.62' TW=475.27' (Dynamic Tailwater)  
 ↑1=Culvert ( Controls 0.00 cfs)

**Pond 1188:**

Hydrograph

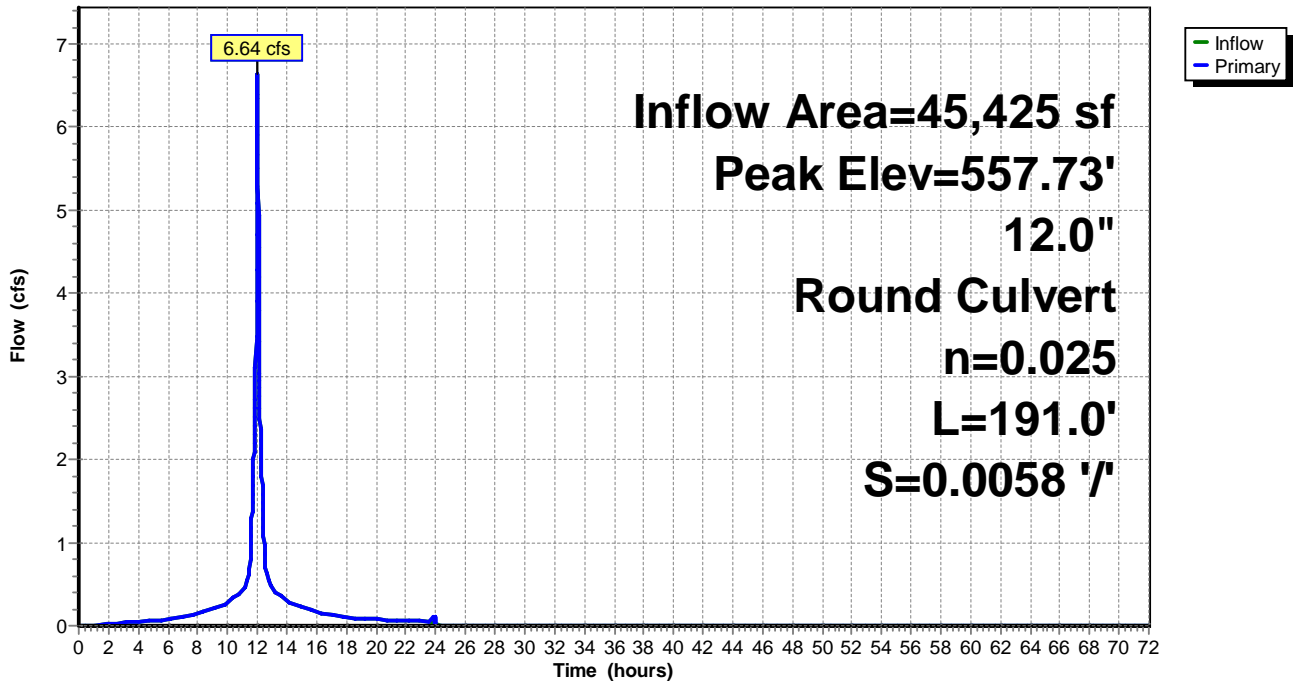

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 48

**Summary for Pond 1213:**

Inflow Area = 9,264 sf, 21.99% Impervious, Inflow Depth = 3.32" for 10 yr event  
 Inflow = 0.83 cfs @ 12.09 hrs, Volume= 2,567 cf  
 Outflow = 0.83 cfs @ 12.09 hrs, Volume= 2,567 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.83 cfs @ 12.09 hrs, Volume= 2,567 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 18.12' @ 12.09 hrs  
 Flood Elev= 20.30'

Device #	Routing	Invert	Outlet Devices
#1	Primary	17.60'	<b>12.0" Round Culvert</b> L= 150.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.60' / 14.60' S= 0.0200 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.83 cfs @ 12.09 hrs HW=18.12' TW=0.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 0.83 cfs @ 2.93 fps)

**Pond 1213:**

**Hydrograph**

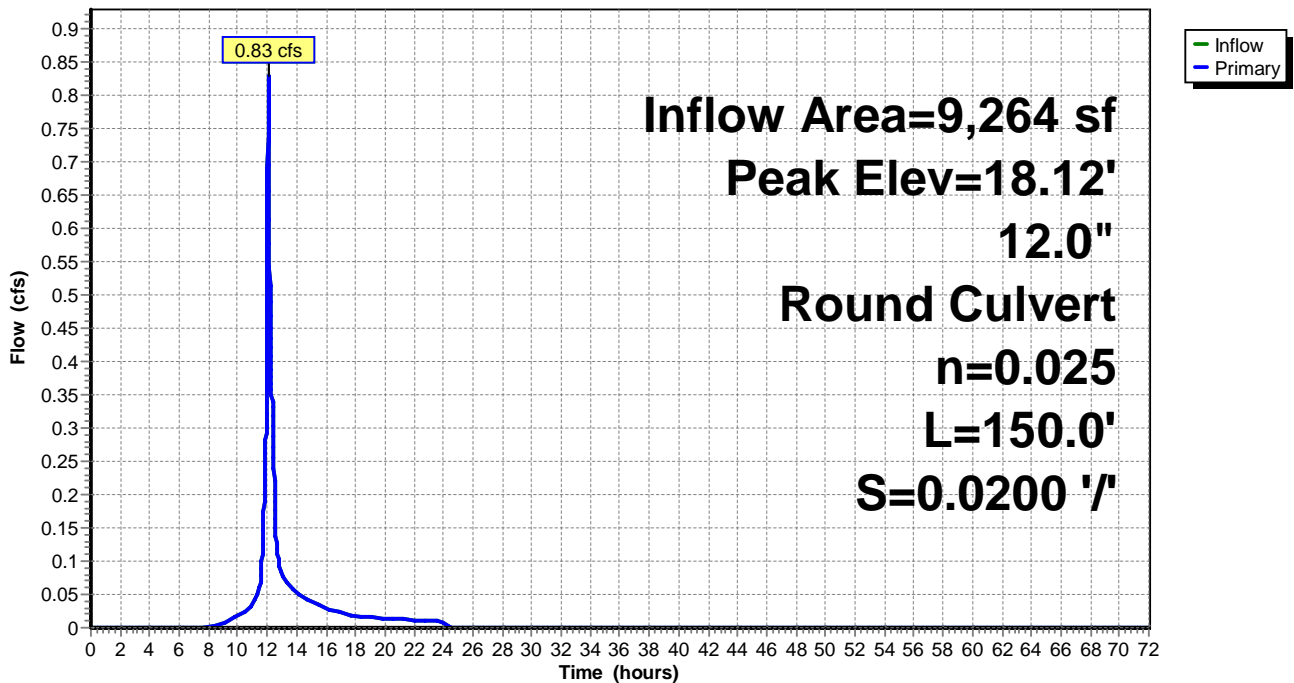

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 49

**Summary for Pond 1251:**

Inflow Area = 28,184 sf, 92.95% Impervious, Inflow Depth = 5.13" for 10 yr event  
 Inflow = 3.50 cfs @ 12.08 hrs, Volume= 12,047 cf  
 Outflow = 3.50 cfs @ 12.08 hrs, Volume= 12,047 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 3.50 cfs @ 12.08 hrs, Volume= 12,047 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 17.45' @ 12.08 hrs


Flood Elev= 20.90'

Device	Routing	Invert	Outlet Devices
#1	Primary	16.50'	<b>18.0" Round Culvert</b> L= 82.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 16.50' / 14.70' S= 0.0220 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 1.77 sf

**Primary OutFlow** Max=3.50 cfs @ 12.08 hrs HW=17.45' TW=0.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 3.50 cfs @ 4.24 fps)

**Pond 1251:**

Hydrograph

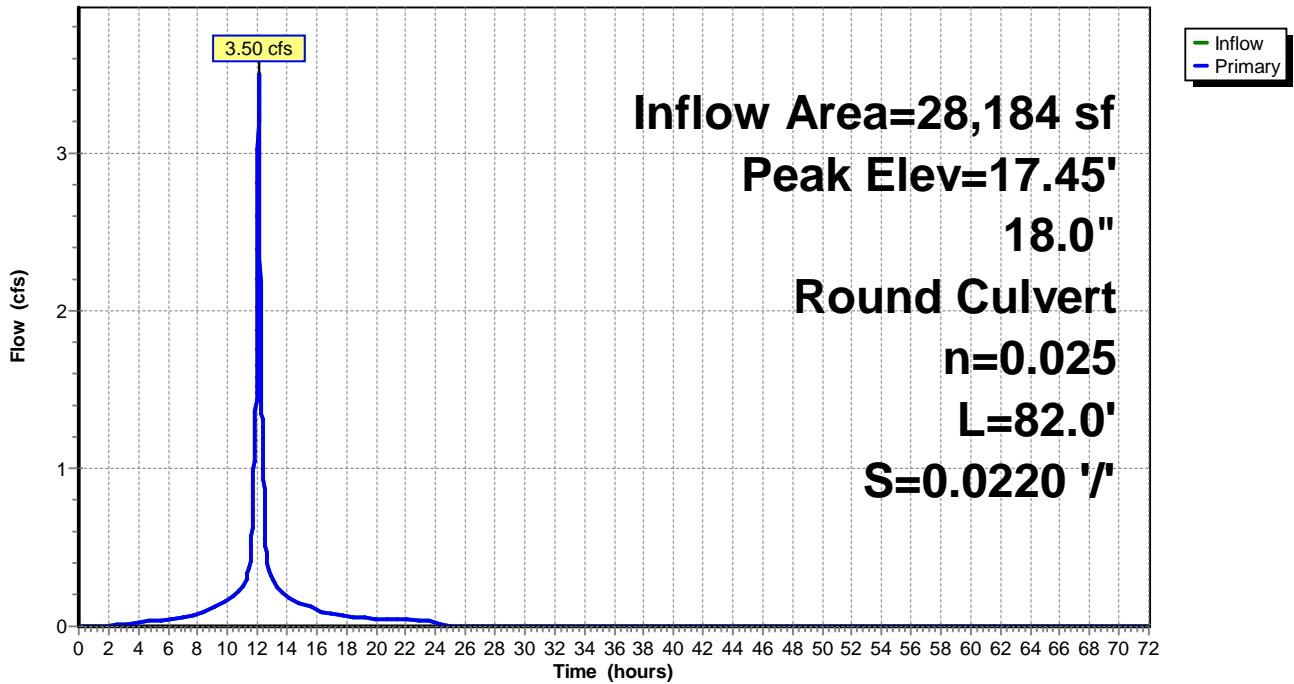

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 50

**Summary for Pond 1345:**

Inflow Area = 6,003 sf, 66.57% Impervious, Inflow Depth = 4.46" for 10 yr event  
 Inflow = 0.69 cfs @ 12.08 hrs, Volume= 2,230 cf  
 Outflow = 0.69 cfs @ 12.08 hrs, Volume= 2,230 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.69 cfs @ 12.08 hrs, Volume= 2,230 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 82.08' @ 12.10 hrs  
 Flood Elev= 23.30'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.10'	<b>12.0" Round Culvert</b> L= 915.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.10' / 17.40' S= 0.0019 '/' Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.48 cfs @ 12.08 hrs HW=81.27' TW=80.65' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 0.48 cfs @ 0.61 fps)

**Pond 1345:**

Hydrograph

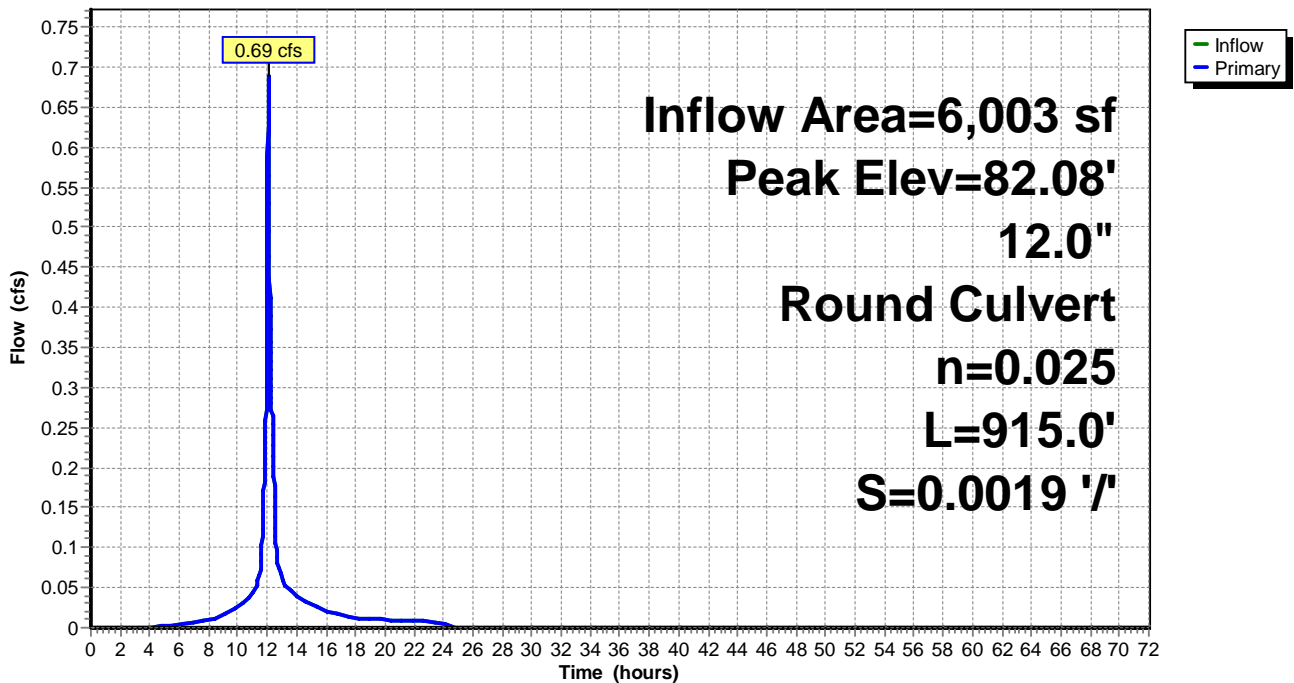

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 51

**Summary for Pond 1346:**

Inflow Area = 206,707 sf, 94.48% Impervious, Inflow Depth = 5.23" for 10 yr event  
 Inflow = 21.33 cfs @ 12.09 hrs, Volume= 90,107 cf  
 Outflow = 21.33 cfs @ 12.09 hrs, Volume= 90,107 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 21.33 cfs @ 12.09 hrs, Volume= 90,107 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 80.82' @ 12.09 hrs

Flood Elev= 25.00'


Device #1	Routing	Invert	Outlet Devices
	Primary	15.70'	<b>15.0" Round Culvert</b> L= 143.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 15.70' / 14.70' S= 0.0070 '/' Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 1.23 sf

**Primary OutFlow** Max=21.30 cfs @ 12.09 hrs HW=80.68' TW=0.00' (Dynamic Tailwater)

↑ **1=Culvert** (Barrel Controls 21.30 cfs @ 17.36 fps)

**Pond 1346:**

Hydrograph

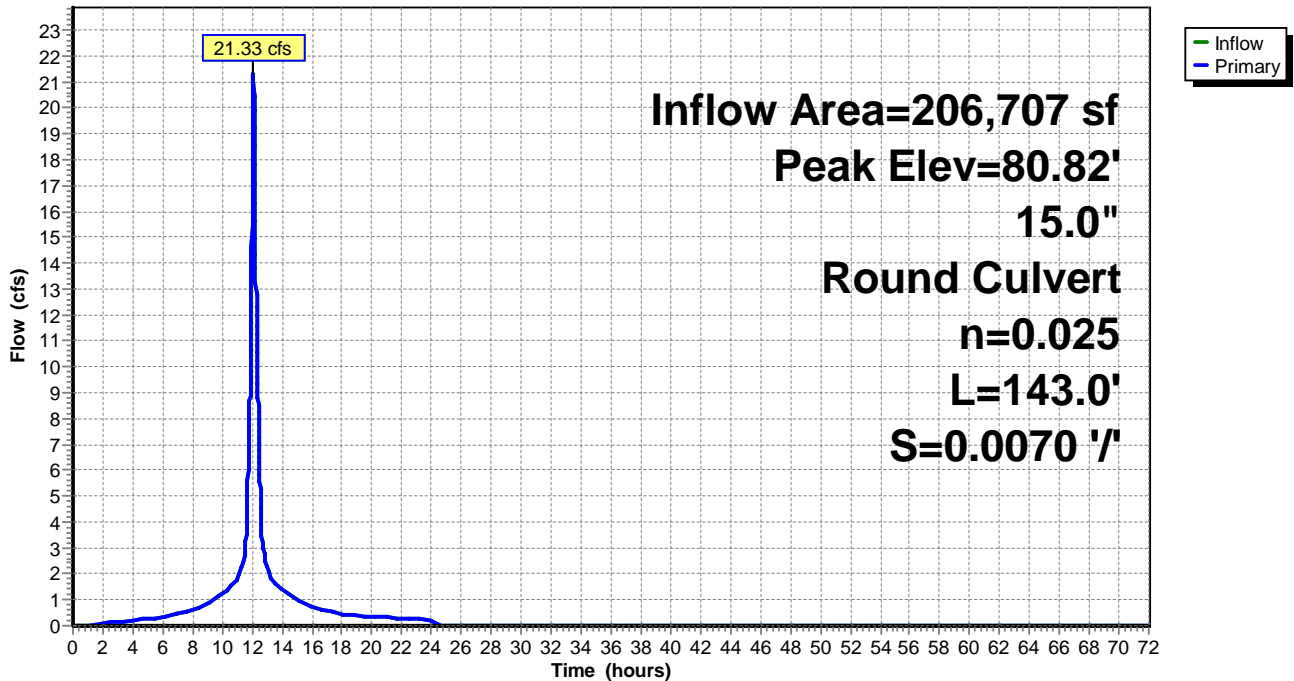

# Existing

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 52

## Summary for Pond 1347:

Inflow Area = 200,704 sf, 95.31% Impervious, Inflow Depth = 5.25" for 10 yr event  
Inflow = 20.64 cfs @ 12.09 hrs, Volume= 87,878 cf  
Outflow = 20.64 cfs @ 12.09 hrs, Volume= 87,878 cf, Atten= 0%, Lag= 0.0 min  
Primary = 20.64 cfs @ 12.09 hrs, Volume= 87,878 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 164.33' @ 12.09 hrs


Flood Elev= 23.90'

Device #1	Routing	Invert	Outlet Devices
	Primary	15.90'	<b>15.0" Round Culvert</b> L= 204.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 15.90' / 15.80' S= 0.0005 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 1.23 sf

**Primary OutFlow** Max=20.56 cfs @ 12.09 hrs HW=163.87' TW=80.69' (Dynamic Tailwater)  
↑ **1=Culvert** (Outlet Controls 20.56 cfs @ 16.75 fps)

## Pond 1347:

### Hydrograph

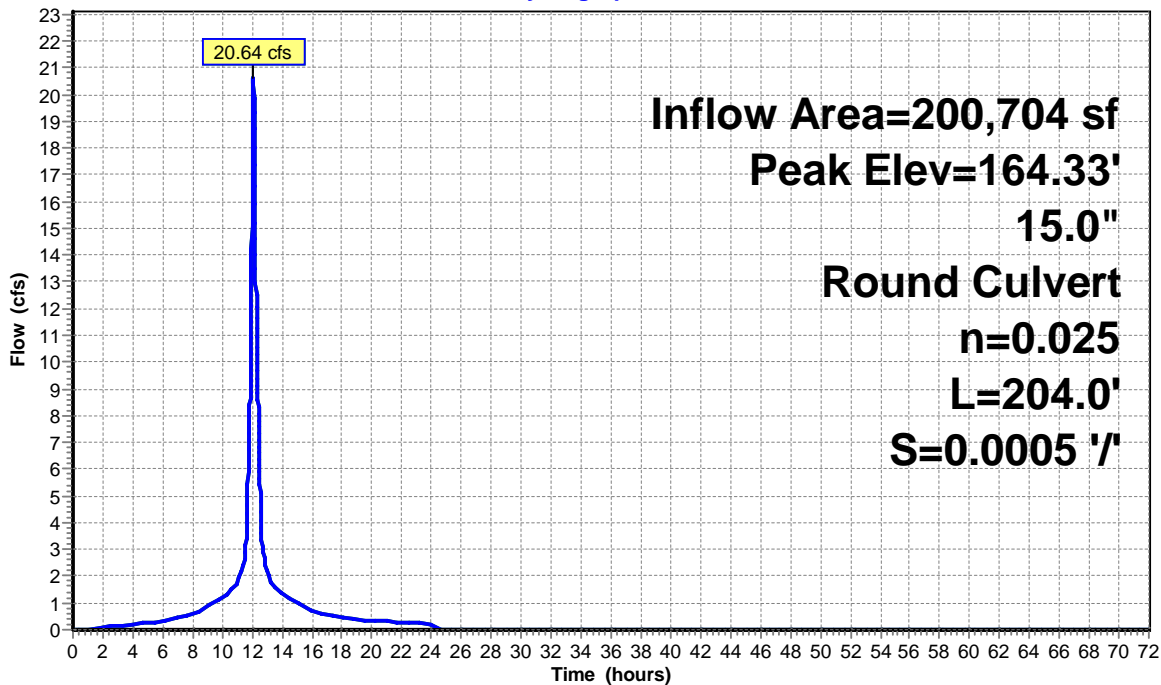

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 53

**Summary for Pond E2347:**

Inflow Area = 78,622 sf, 37.70% Impervious, Inflow Depth = 4.79" for 10 yr event  
 Inflow = 11.54 cfs @ 12.00 hrs, Volume= 31,371 cf  
 Outflow = 11.54 cfs @ 12.00 hrs, Volume= 31,371 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 11.54 cfs @ 12.00 hrs, Volume= 31,371 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 58.45' @ 12.04 hrs  
 Flood Elev= 13.80'

Device #1	Routing	Invert	Outlet Devices
	Primary	9.80'	<b>15.0" Round Culvert</b> L= 72.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.70' / 9.80' S= -0.0014 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.00 cfs @ 12.00 hrs HW=45.84' TW=46.44' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond E2347:**

Hydrograph

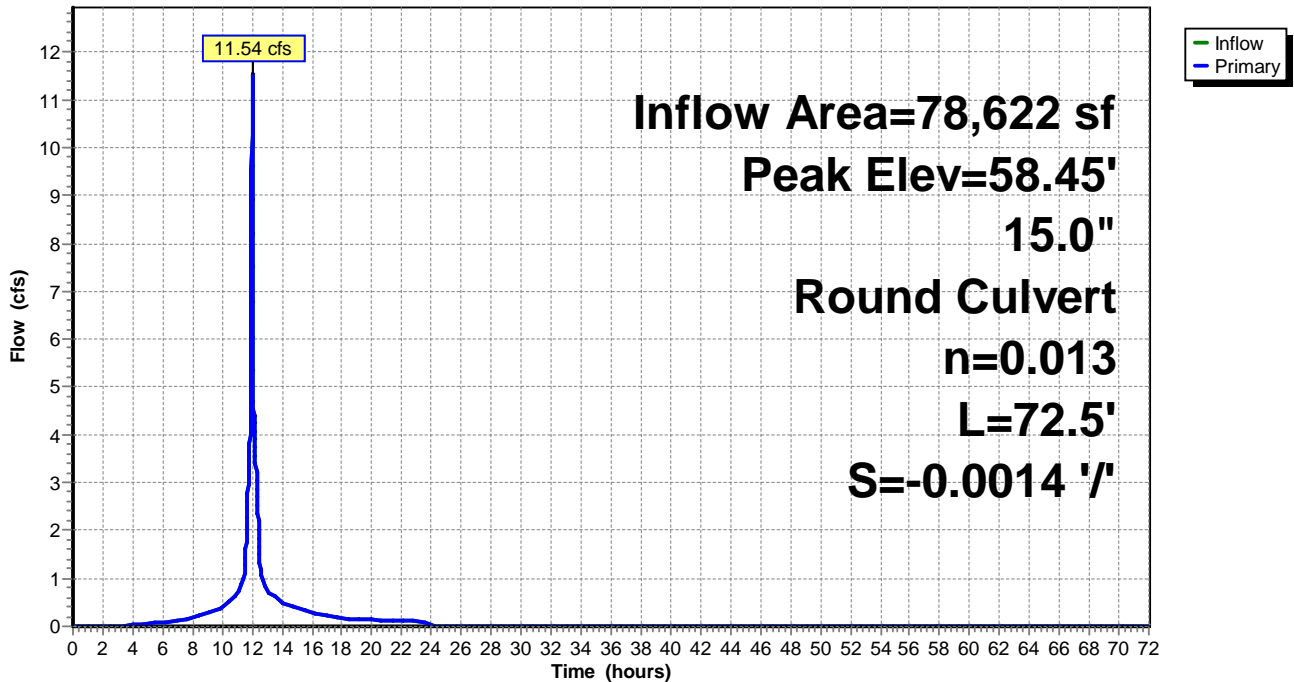



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 54

**Summary for Pond E2348:**

Inflow Area = 81,883 sf, 40.18% Impervious, Inflow Depth = 4.81" for 10 yr event  
 Inflow = 12.04 cfs @ 12.00 hrs, Volume= 32,828 cf  
 Outflow = 12.04 cfs @ 12.00 hrs, Volume= 32,828 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 12.04 cfs @ 12.00 hrs, Volume= 32,828 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 55.97' @ 12.03 hrs


Flood Elev= 13.60'

Device #1	Routing	Invert	Outlet Devices
	Primary	9.80'	<b>15.0" Round Culvert</b> L= 15.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.80' / 9.10' S= 0.0464 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.00 cfs @ 12.00 hrs HW=46.44' TW=47.26' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond E2348:**

Hydrograph

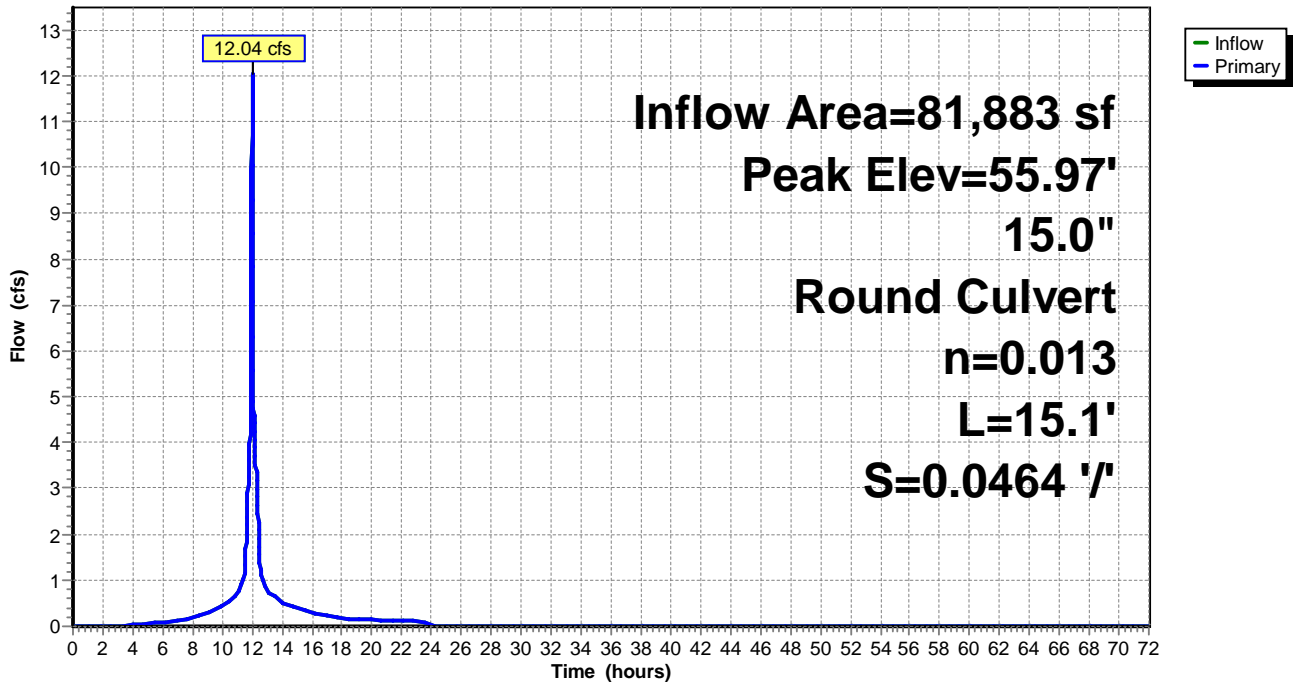

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 55

**Summary for Pond E2349:**

Inflow Area = 199,512 sf, 60.17% Impervious, Inflow Depth = 4.74" for 10 yr event  
 Inflow = 21.30 cfs @ 12.04 hrs, Volume= 78,775 cf  
 Outflow = 21.30 cfs @ 12.04 hrs, Volume= 78,775 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 21.30 cfs @ 12.04 hrs, Volume= 78,775 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 53.21' @ 12.04 hrs


Flood Elev= 13.80'

Device #1	Routing	Invert	Outlet Devices
	Primary	9.10'	<b>15.0" Round Culvert</b> L= 86.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.10' / 8.70' S= 0.0046 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=21.33 cfs @ 12.04 hrs HW=53.20' TW=36.68' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 21.33 cfs @ 17.38 fps)

**Pond E2349:**

Hydrograph

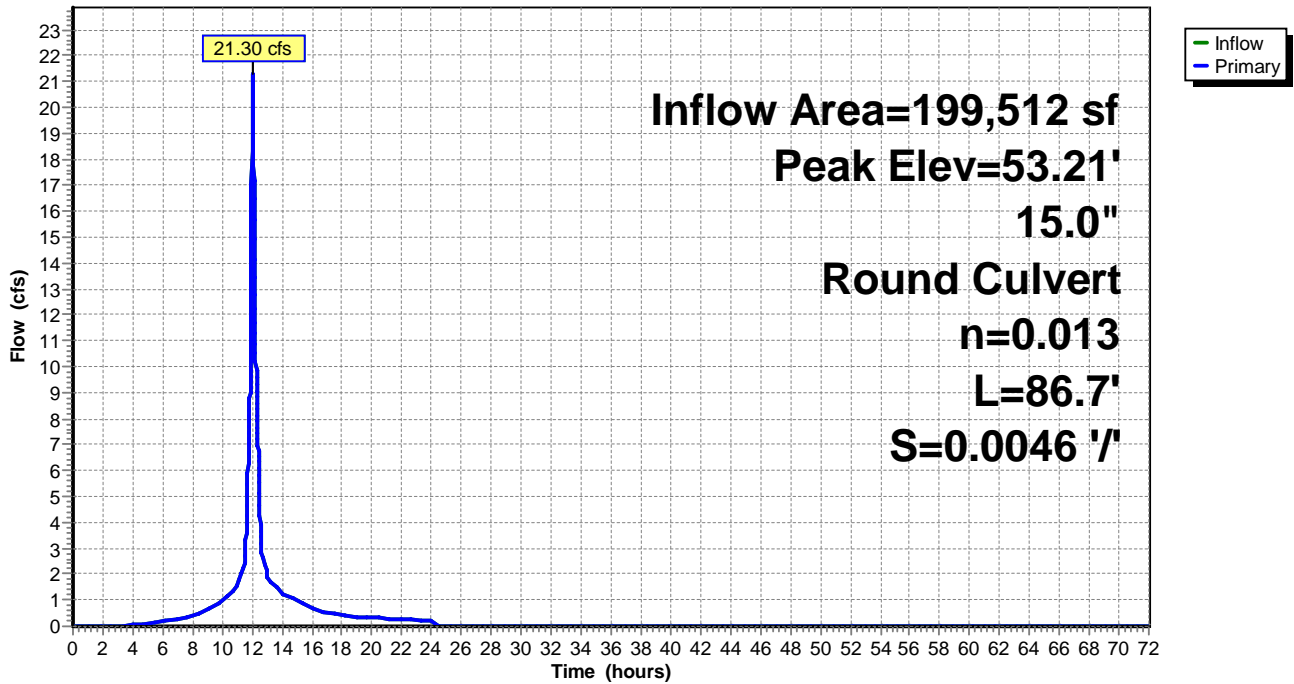

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 56

**Summary for Pond E2350:**

Inflow Area = 3,719 sf, 88.76% Impervious, Inflow Depth = 5.01" for 10 yr event  
 Inflow = 0.56 cfs @ 12.00 hrs, Volume= 1,554 cf  
 Outflow = 0.56 cfs @ 12.00 hrs, Volume= 1,554 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.56 cfs @ 12.00 hrs, Volume= 1,554 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 53.22' @ 12.05 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	10.40'	<b>15.0" Round Culvert</b> L= 19.3' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 10.40' / 10.30' S= 0.0052 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.00 cfs @ 12.00 hrs HW=42.26' TW=47.23' (Dynamic Tailwater)  
 ↑1=Culvert ( Controls 0.00 cfs)

**Pond E2350:**

Hydrograph

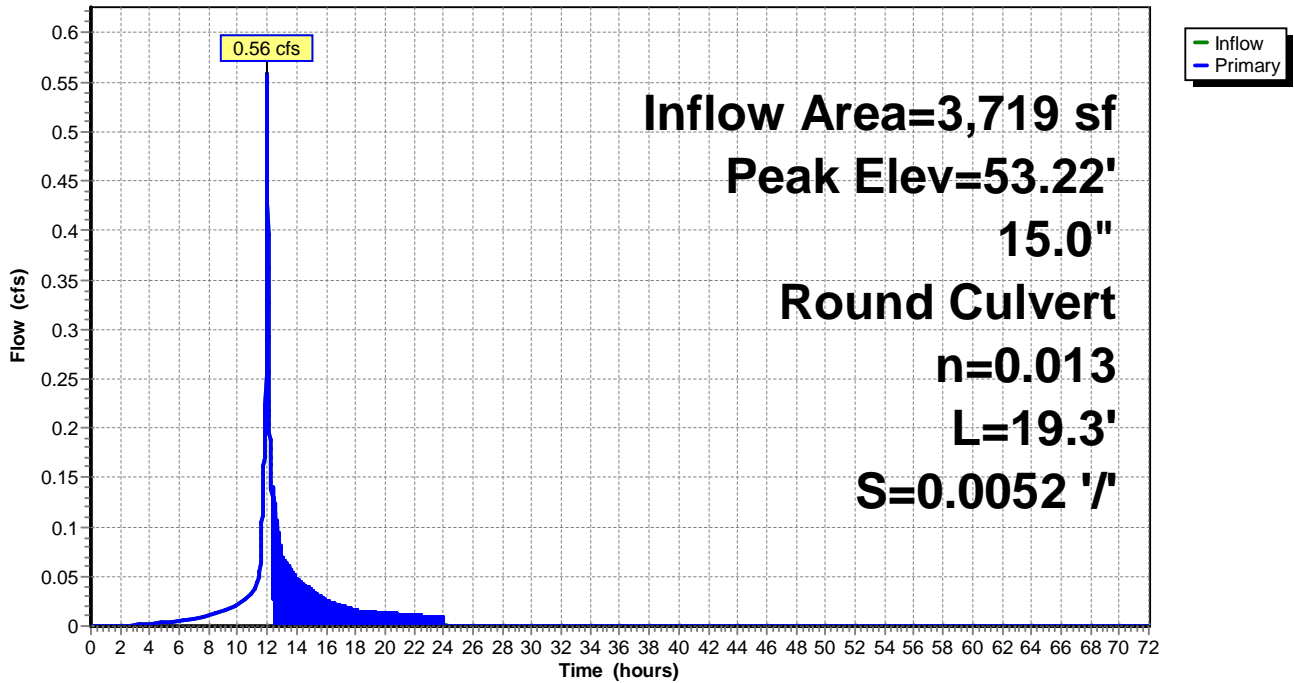

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 57

**Summary for Pond E3578A:**

Inflow Area = 4,381 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf  
 Outflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 9.50' @ 12.00 hrs


Device #1	Routing	Invert	Outlet Devices
	Primary	9.00'	<b>8.0" Round Culvert</b> L= 11.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.00' / 7.90' S= 0.0982 '/ Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.35 sf

**Primary OutFlow** Max=0.67 cfs @ 12.00 hrs HW=9.50' TW=8.84' (Dynamic Tailwater)

↑ **1=Culvert** (Inlet Controls 0.67 cfs @ 2.40 fps)

**Pond E3578A:**

Hydrograph

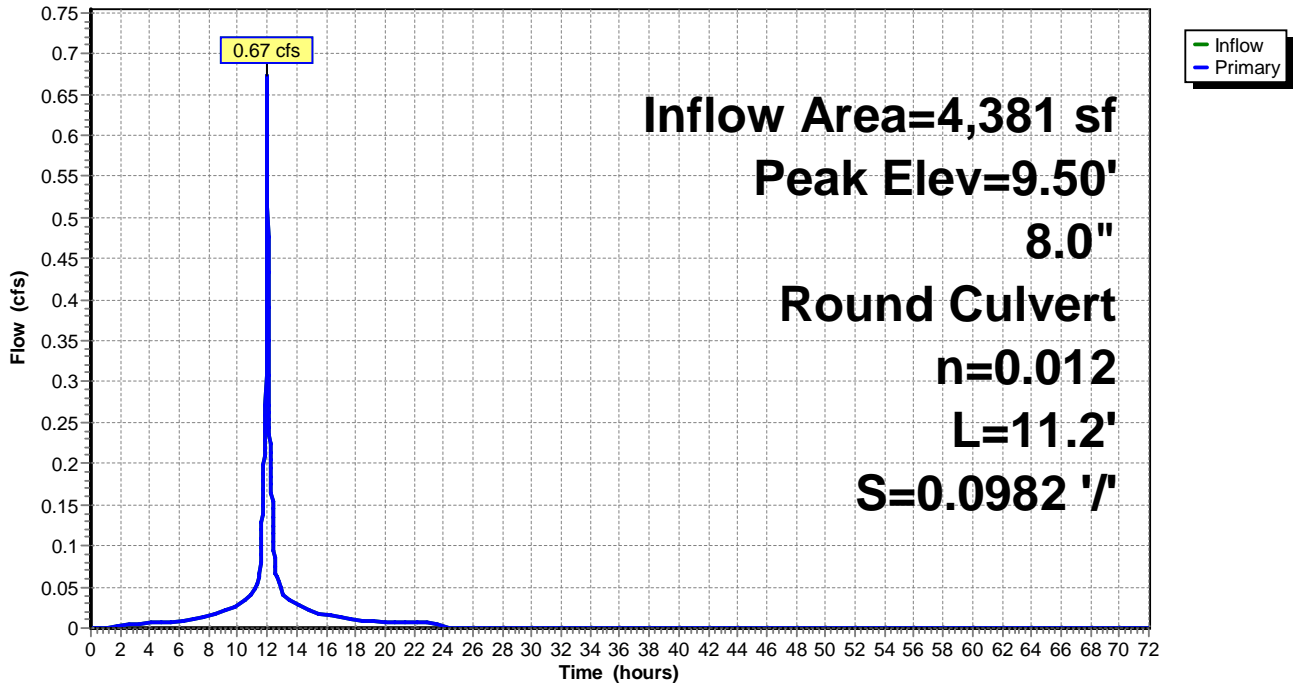

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 58

**Summary for Pond E3579:**

Inflow Area = 266,200 sf, 65.77% Impervious, Inflow Depth = 4.18" for 10 yr event  
 Inflow = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf  
 Outflow = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 5.17' @ 12.02 hrs  
 Flood Elev= 11.20'

Device #1	Routing	Invert	Outlet Devices
	Primary	2.00'	<b>36.0" Round Culvert</b> L= 205.5' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2.00' / 1.80' S= 0.0010 '/' Cc= 0.900 n= 0.015 Brickwork, Flow Area= 7.07 sf

**Primary OutFlow** Max=25.01 cfs @ 12.00 hrs HW=5.12' TW=4.28' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 25.01 cfs @ 4.22 fps)

**Pond E3579:**

Hydrograph

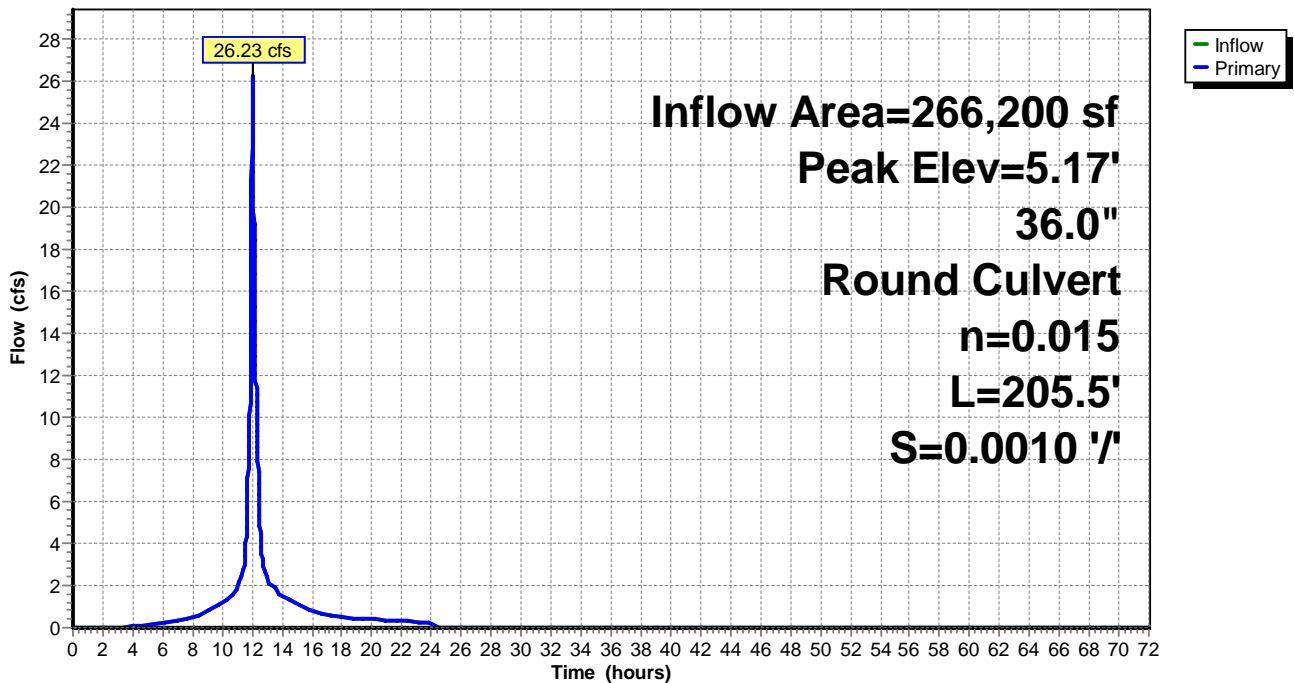

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 59

**Summary for Pond E3600:**

Inflow Area = 417 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.06 cfs @ 12.00 hrs, Volume= 186 cf  
 Outflow = 0.06 cfs @ 12.00 hrs, Volume= 186 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.06 cfs @ 12.00 hrs, Volume= 186 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 7.62' @ 12.00 hrs  
 Flood Elev= 11.10'

Device #1	Routing	Invert	Outlet Devices
	Primary	7.50'	<b>12.0" Round Culvert</b> L= 21.4' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.50' / 2.00' S= 0.2570 '/ Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.06 cfs @ 12.00 hrs HW=7.62' TW=5.09' (Dynamic Tailwater)  
 ← **1=Culvert** (Inlet Controls 0.06 cfs @ 1.18 fps)

**Pond E3600:**

Hydrograph

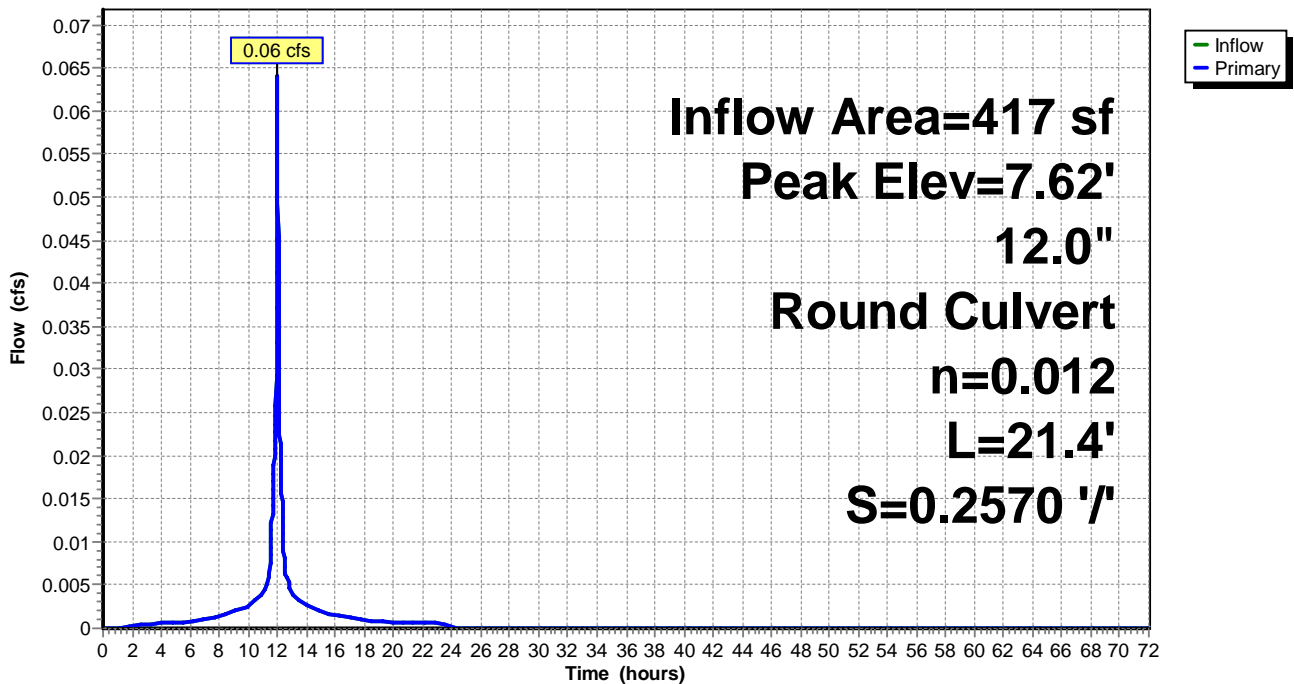

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 60

**Summary for Pond E3672:**

Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0 cf  
 Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 8.24' @ 11.99 hrs  
 Flood Elev= 11.90'


Device	Routing	Invert	Outlet Devices
#1	Primary	8.20'	<b>4.0" Round Culvert</b> L= 13.9' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 8.20' / 8.20' S= 0.0000 1' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

**Primary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=8.20' TW=7.90' (Dynamic Tailwater)

↑**1=Culvert** ( Controls 0.00 cfs)

**Pond E3672:**

Hydrograph

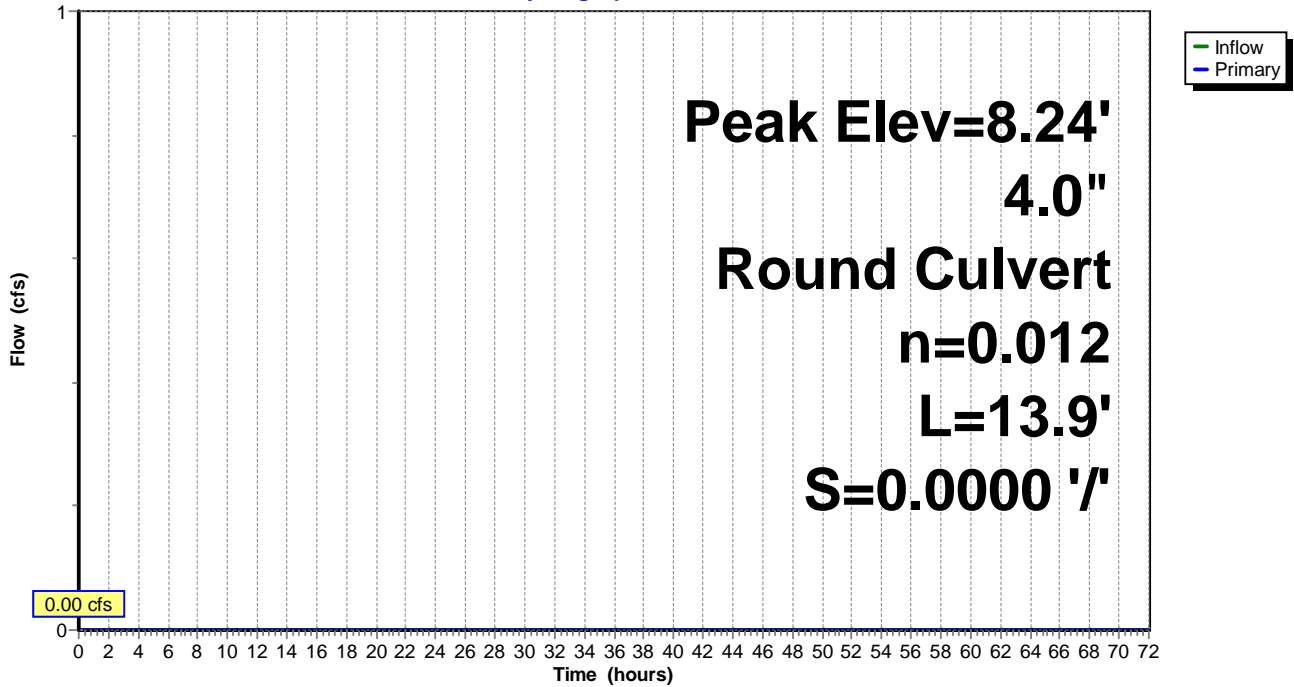



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 61

**Summary for Pond E3693:**

Inflow Area = 3,520 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.54 cfs @ 12.00 hrs, Volume= 1,573 cf  
 Outflow = 0.54 cfs @ 12.00 hrs, Volume= 1,573 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.54 cfs @ 12.00 hrs, Volume= 1,573 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 8.27' @ 12.00 hrs


Flood Elev= 11.00'

Device #1	Routing	Invert	Outlet Devices
	Primary	7.90'	<b>12.0" Round Culvert</b> L= 27.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.90' / 2.00' S= 0.2177 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.54 cfs @ 12.00 hrs HW=8.27' TW=5.09' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 0.54 cfs @ 2.06 fps)

**Pond E3693:**

Hydrograph

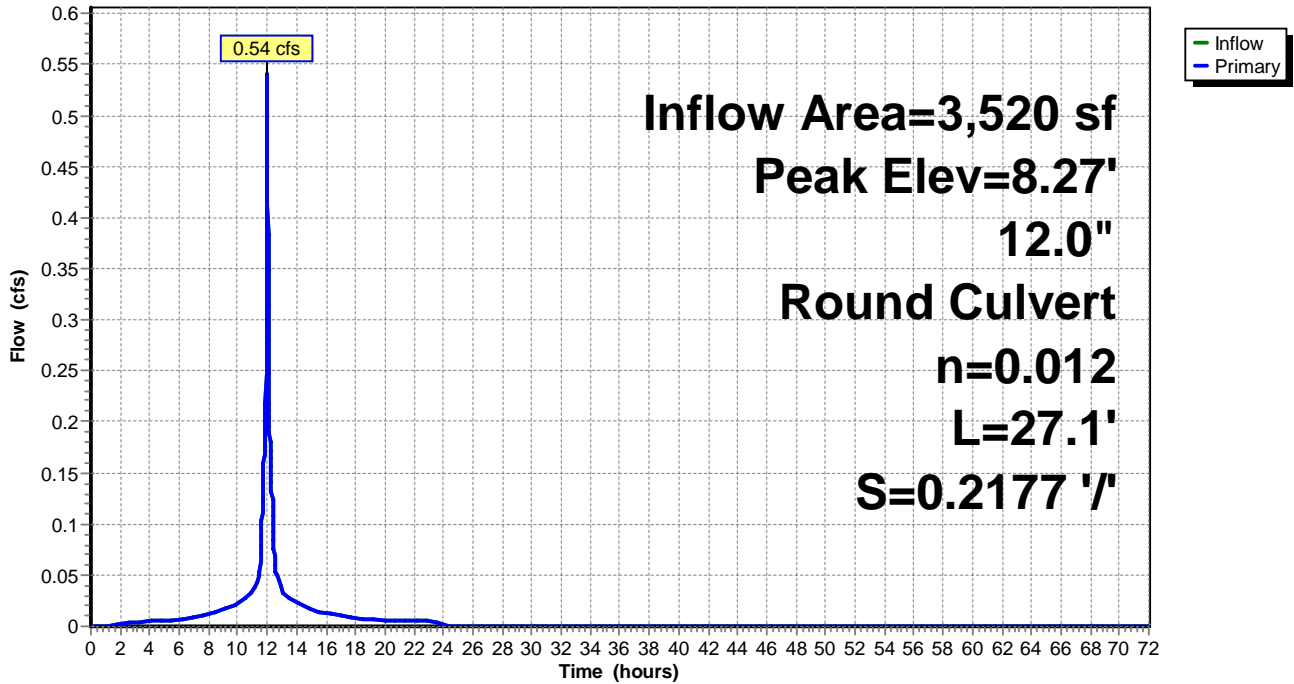

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 62

**Summary for Pond E3756:**

Inflow Area = 10,577 sf, 97.14% Impervious, Inflow Depth = 5.29" for 10 yr event  
 Inflow = 1.62 cfs @ 12.00 hrs, Volume= 4,666 cf  
 Outflow = 1.62 cfs @ 12.00 hrs, Volume= 4,666 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.62 cfs @ 12.00 hrs, Volume= 4,666 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 8.49' @ 12.00 hrs


Flood Elev= 11.60'

Device	Routing	Invert	Outlet Devices
#1	Primary	7.80'	<b>12.0" Round Culvert</b> L= 23.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.80' / 2.00' S= 0.2500 '/ Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.62 cfs @ 12.00 hrs HW=8.49' TW=5.09' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 1.62 cfs @ 2.82 fps)

**Pond E3756:**

Hydrograph

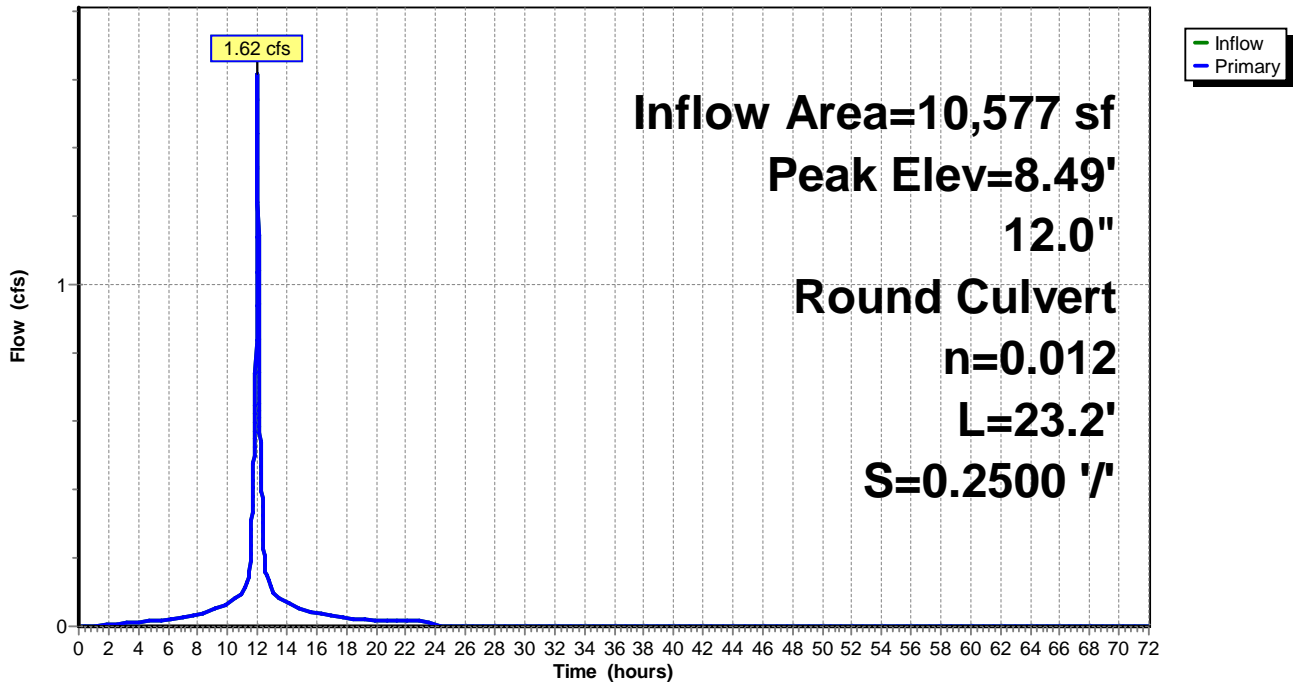

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 63

**Summary for Pond E3758:**

Inflow Area = 4,381 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf  
 Outflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 8.86' @ 12.01 hrs  
 Flood Elev= 10.90'

Device #1	Routing	Invert	Outlet Devices
	Primary	8.00'	<b>12.0" Round Culvert</b> L= 10.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 8.00' / 8.00' S= 0.0000 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.41 cfs @ 12.00 hrs HW=8.84' TW=8.82' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 0.41 cfs @ 0.79 fps)

**Pond E3758:**

Hydrograph

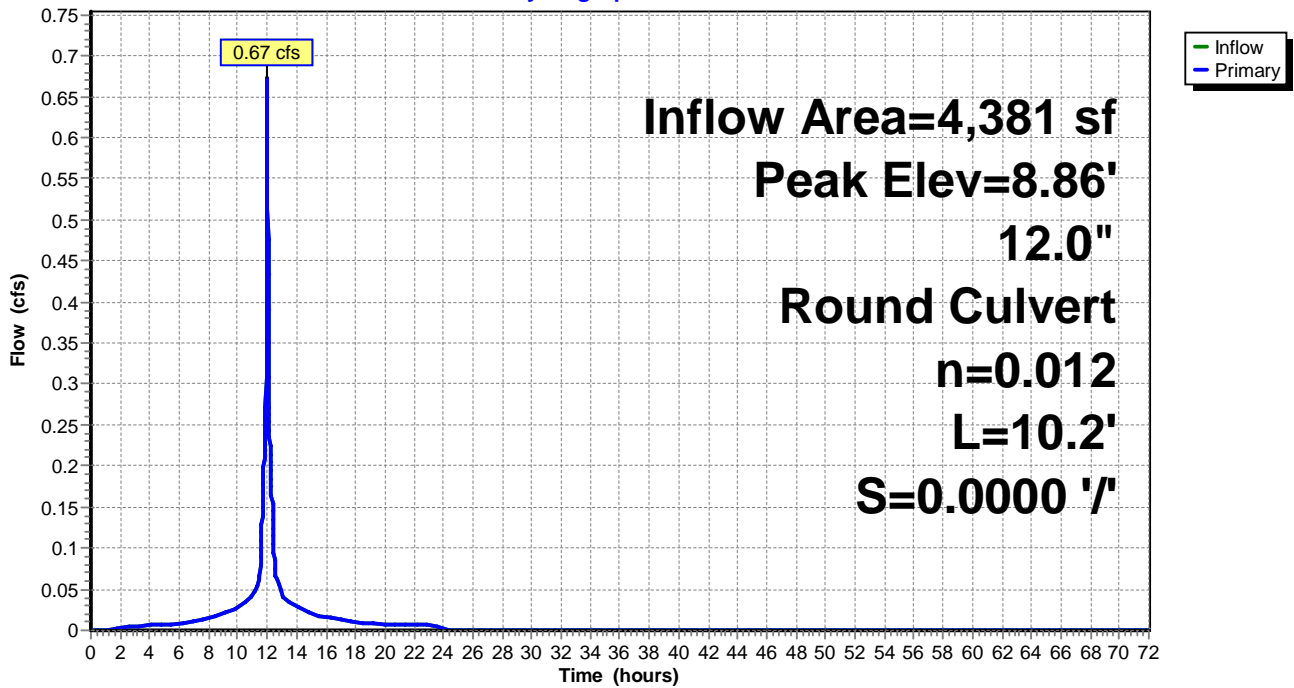

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 64

**Summary for Pond E3760:**

Inflow Area = 10,577 sf, 97.14% Impervious, Inflow Depth = 5.29" for 10 yr event  
 Inflow = 1.62 cfs @ 12.00 hrs, Volume= 4,666 cf  
 Outflow = 1.62 cfs @ 12.00 hrs, Volume= 4,666 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.62 cfs @ 12.00 hrs, Volume= 4,666 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 8.82' @ 12.00 hrs


Flood Elev= 10.70'

Device	Routing	Invert	Outlet Devices
#1	Primary	8.00'	<b>12.0" Round Culvert</b> L= 32.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 8.00' / 7.80' S= 0.0061 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.57 cfs @ 12.00 hrs HW=8.82' TW=8.49' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 1.57 cfs @ 3.10 fps)

**Pond E3760:**

Hydrograph

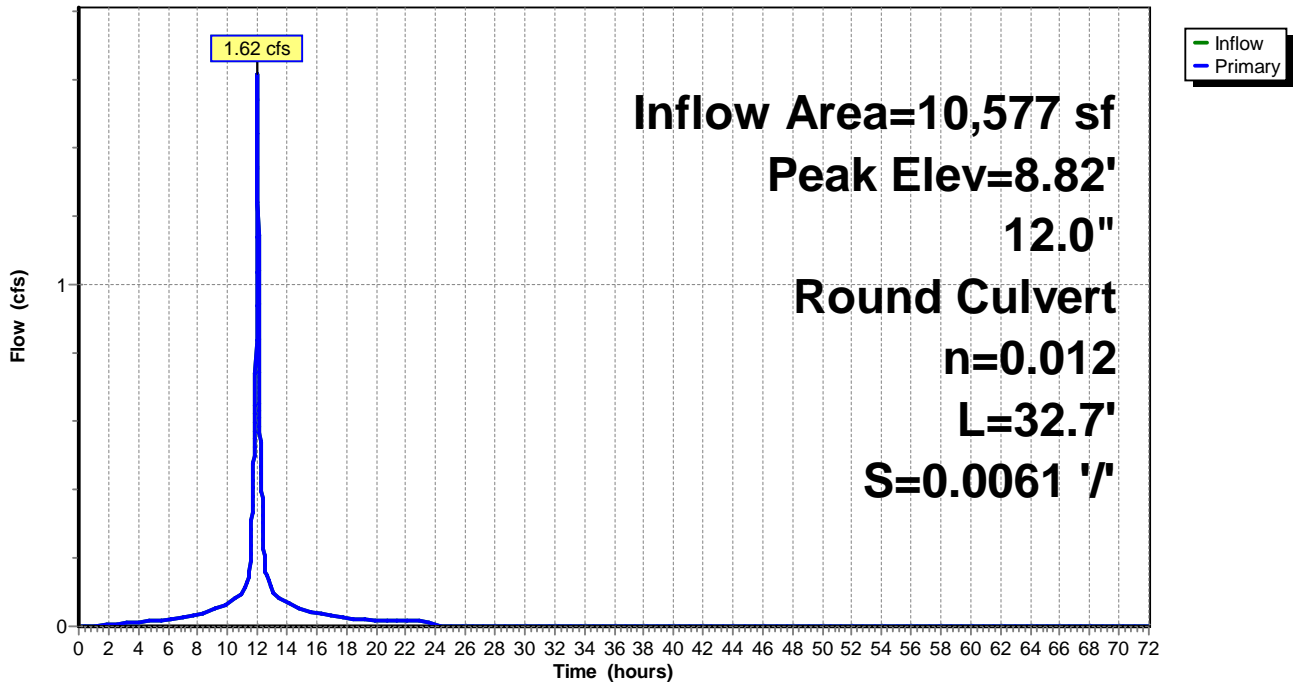

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 65

**Summary for Pond E3772:**

Inflow Area = 199,512 sf, 60.17% Impervious, Inflow Depth = 4.74" for 10 yr event  
 Inflow = 21.30 cfs @ 12.04 hrs, Volume= 78,775 cf  
 Outflow = 21.30 cfs @ 12.04 hrs, Volume= 78,775 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 21.30 cfs @ 12.04 hrs, Volume= 78,775 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 36.77' @ 12.02 hrs


Flood Elev= 12.20'

Device #1	Routing	Invert	Outlet Devices
	Primary	8.60'	<b>15.0" Round Culvert</b> L= 48.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 8.60' / 7.70' S= 0.0187 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=21.41 cfs @ 12.04 hrs HW=36.68' TW=23.55' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 21.41 cfs @ 17.44 fps)

**Pond E3772:**

Hydrograph

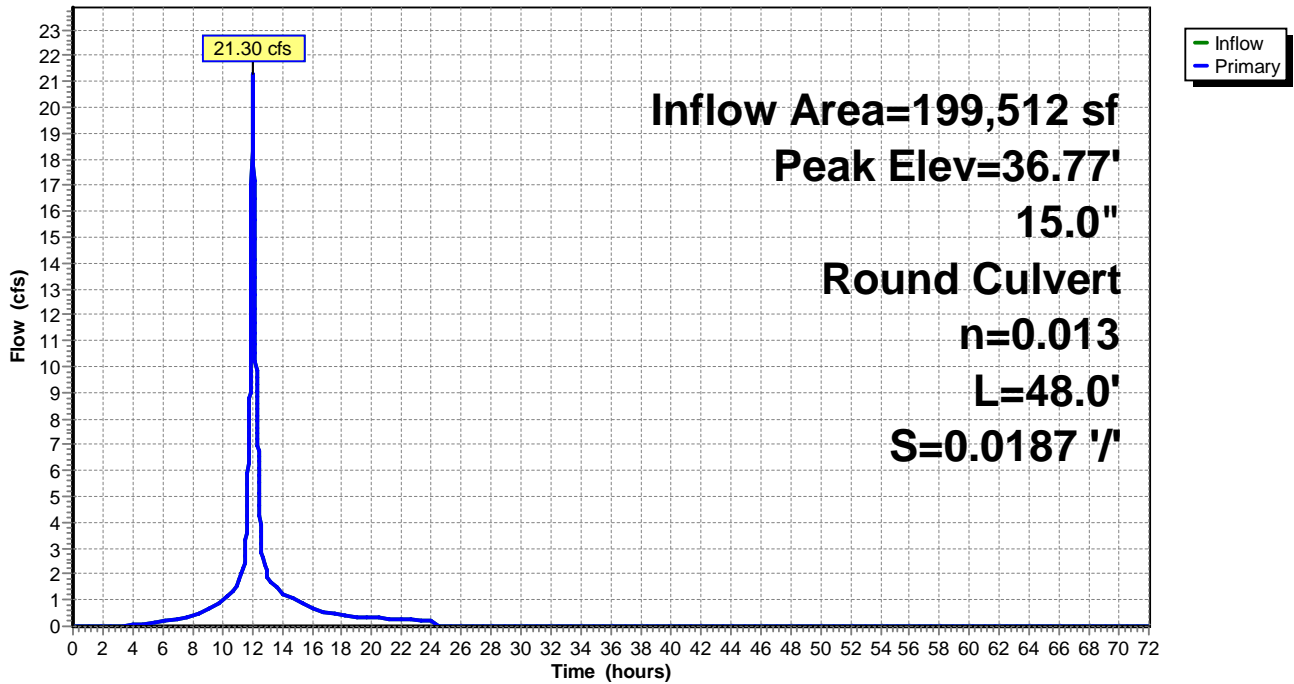

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 66

**Summary for Pond E3777:**

Inflow Area = 217,856 sf, 58.90% Impervious, Inflow Depth = 4.67" for 10 yr event  
 Inflow = 23.40 cfs @ 12.01 hrs, Volume= 84,777 cf  
 Outflow = 23.40 cfs @ 12.01 hrs, Volume= 84,777 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 23.40 cfs @ 12.01 hrs, Volume= 84,777 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 23.90' @ 12.01 hrs


Flood Elev= 10.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	7.60'	<b>15.0" Round Culvert</b> L= 28.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.60' / 7.50' S= 0.0035 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=23.40 cfs @ 12.01 hrs HW=23.90' TW=7.79' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 23.40 cfs @ 19.06 fps)

**Pond E3777:**

Hydrograph

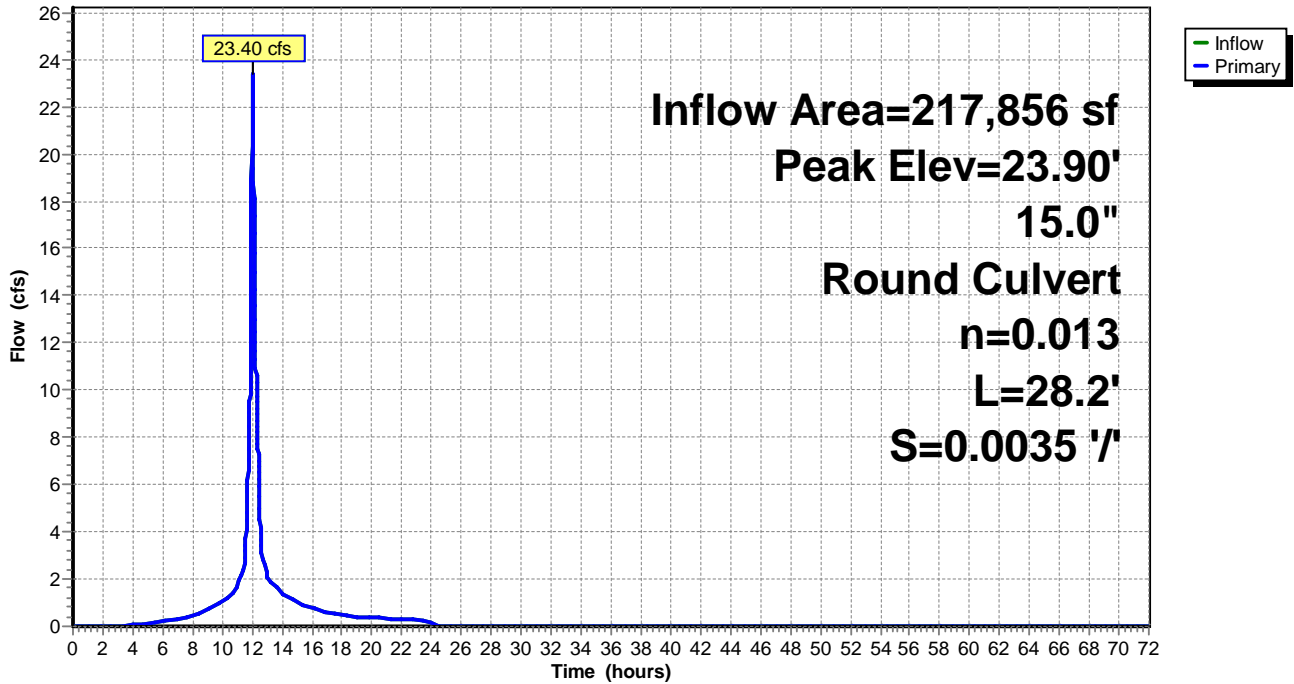

# Existing

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 67

## Summary for Pond E3866:

Inflow Area = 30,394 sf, 95.76% Impervious, Inflow Depth = 5.25" for 10 yr event  
Inflow = 3.81 cfs @ 12.08 hrs, Volume= 13,285 cf  
Outflow = 3.81 cfs @ 12.08 hrs, Volume= 13,285 cf, Atten= 0%, Lag= 0.0 min  
Primary = 0.02 cfs @ 12.51 hrs, Volume= 11 cf  
Secondary = 3.81 cfs @ 12.08 hrs, Volume= 13,275 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 5.89' @ 12.08 hrs

Flood Elev= 10.20'

Device	Routing	Invert	Outlet Devices
#1	Primary	5.40'	<b>24.0" Round Culvert</b> L= 35.7' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.40' / 4.60' S= 0.0224 1' Cc= 0.900 n= 0.012 Concrete pipe, finished, Flow Area= 3.14 sf
#2	Secondary	5.30'	<b>42.0" W x 24.0" H Box Culvert</b> L= 83.8' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.30' / 5.00' S= 0.0036 1' Cc= 0.900 n= 0.012 Concrete pipe, finished, Flow Area= 7.00 sf

**Primary OutFlow** Max=0.02 cfs @ 12.51 hrs HW=5.48' TW=5.40' (Dynamic Tailwater)


↳ **1=Culvert** (Outlet Controls 0.02 cfs @ 0.64 fps)

**Secondary OutFlow** Max=3.84 cfs @ 12.08 hrs HW=5.89' TW=5.61' (Dynamic Tailwater)

↳ **2=Culvert** (Outlet Controls 3.84 cfs @ 2.48 fps)

## Pond E3866:

### Hydrograph

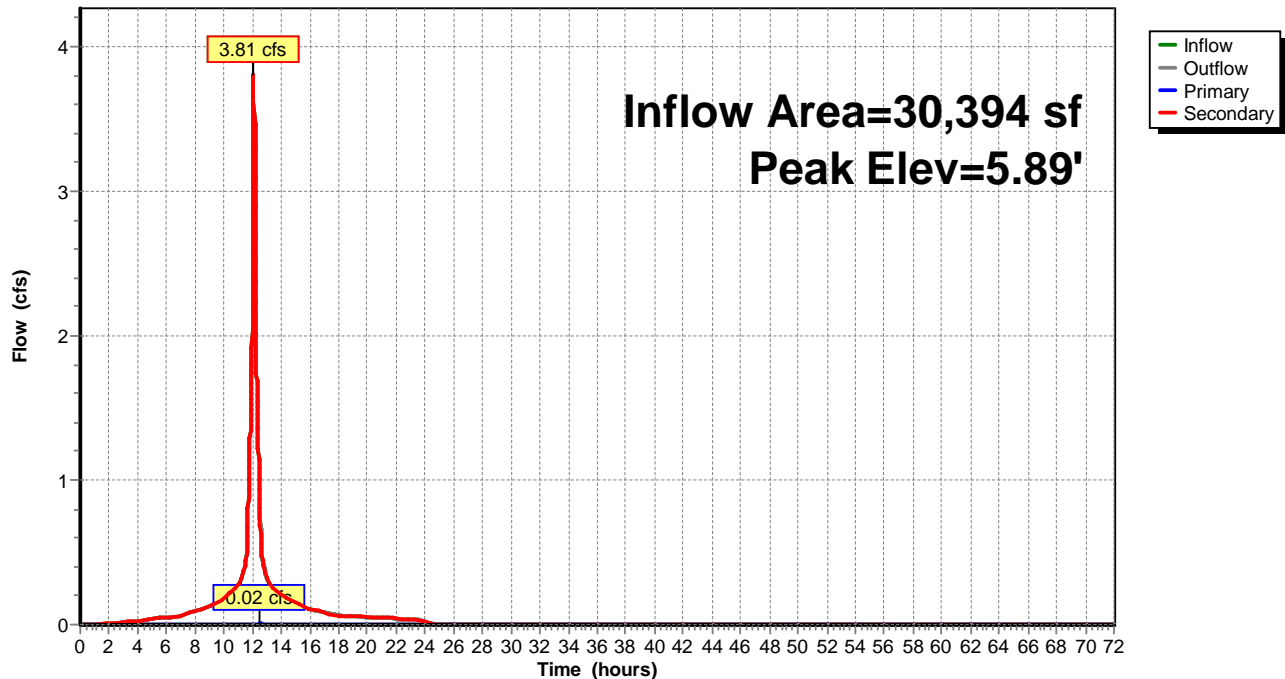



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 68

**Summary for Pond E3895:**


Device	Routing	Invert	Outlet Devices
#1	Primary	9.70'	<b>4.0" Round Culvert</b> L= 37.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.70' / 8.70' S= 0.0270 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

**Primary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=0.00' TW=8.20' (Dynamic Tailwater)

↑1=Culvert ( Controls 0.00 cfs)

**Pond E3895:**

Hydrograph

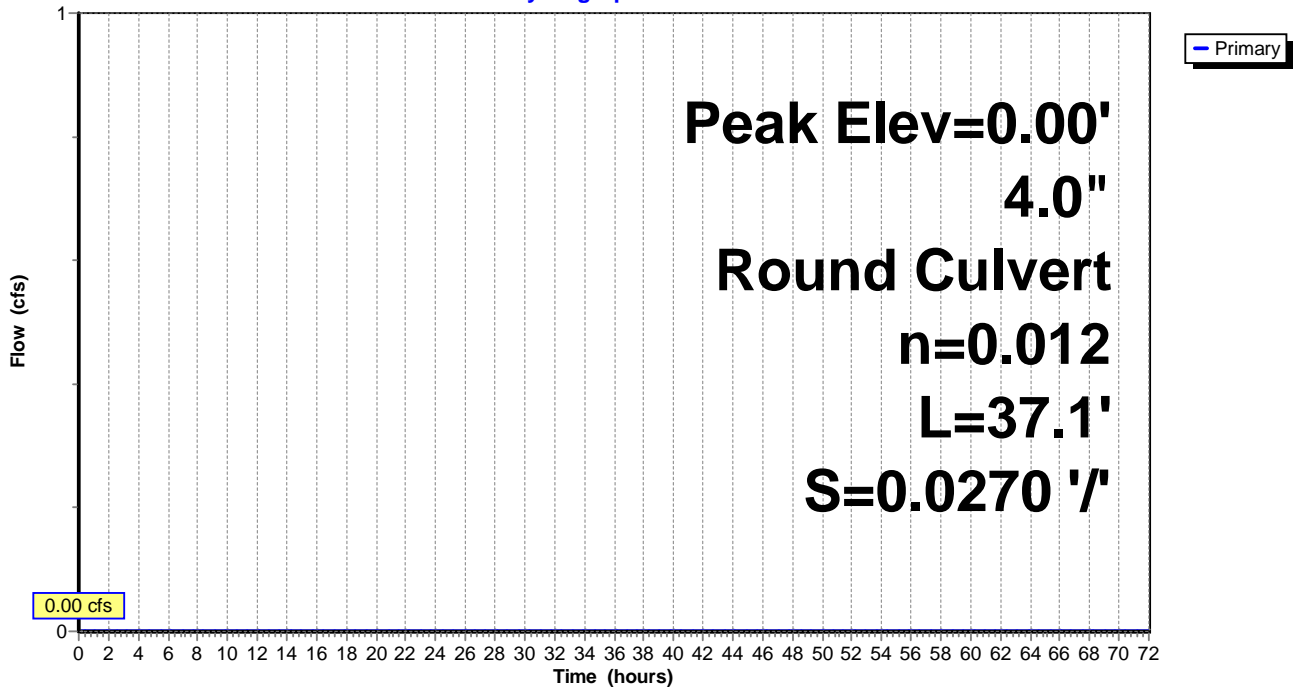

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 69

**Summary for Pond E4034:**

Inflow Area = 3,436 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.53 cfs @ 12.00 hrs, Volume= 1,535 cf  
 Outflow = 0.53 cfs @ 12.00 hrs, Volume= 1,535 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.53 cfs @ 12.00 hrs, Volume= 1,535 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 7.86' @ 12.00 hrs  
 Flood Elev= 10.80'

Device #1	Routing	Invert	Outlet Devices
	Primary	7.50'	<b>12.0" Round Culvert</b> L= 14.8' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.50' / 2.00' S= 0.3716 '/ Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.53 cfs @ 12.00 hrs HW=7.86' TW=5.09' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 0.53 cfs @ 2.05 fps)

**Pond E4034:**

Hydrograph

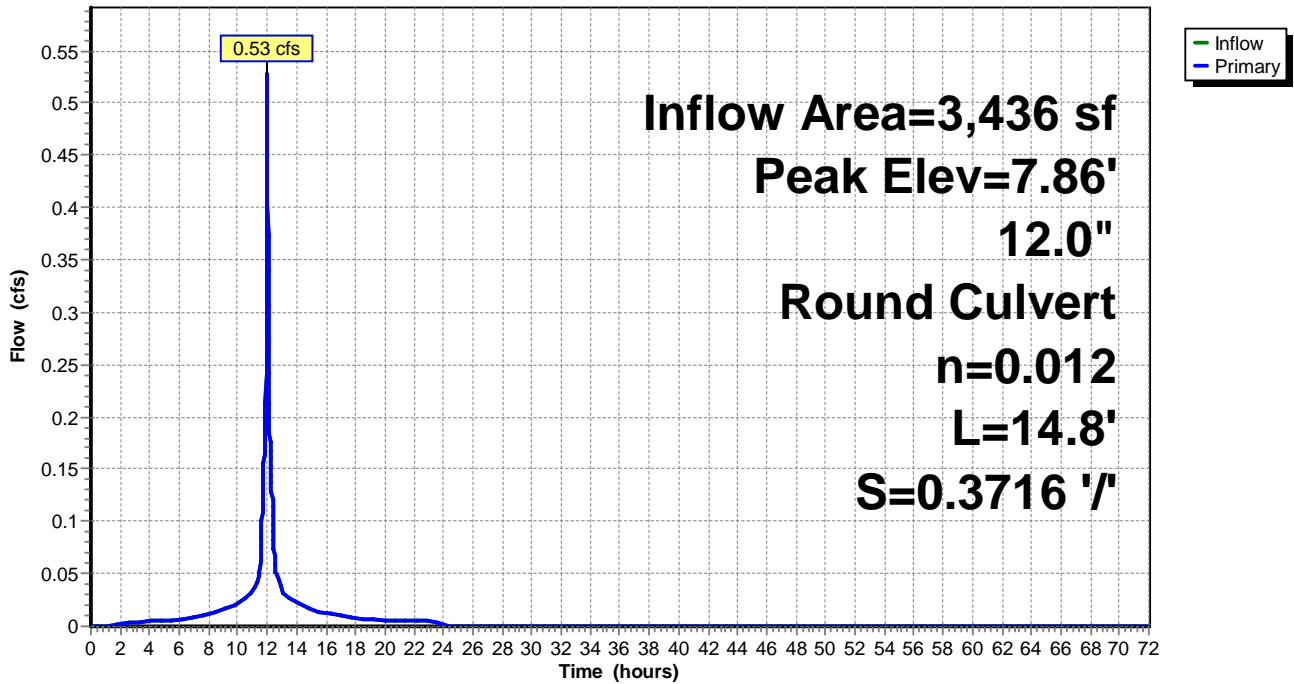

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 70

**Summary for Pond E4035:**

Inflow Area = 266,200 sf, 65.77% Impervious, Inflow Depth = 4.18" for 10 yr event  
 Inflow = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf  
 Outflow = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 4.31' @ 12.01 hrs  
 Flood Elev= 11.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	1.80'	<b>42.0" Round Culvert</b> L= 139.6' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1.80' / 1.00' S= 0.0057 '/ Cc= 0.900 n= 0.012 Concrete pipe, finished, Flow Area= 9.62 sf

**Primary OutFlow** Max=25.40 cfs @ 12.00 hrs HW=4.28' TW=3.48' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 25.40 cfs @ 4.88 fps)

**Pond E4035:**

Hydrograph

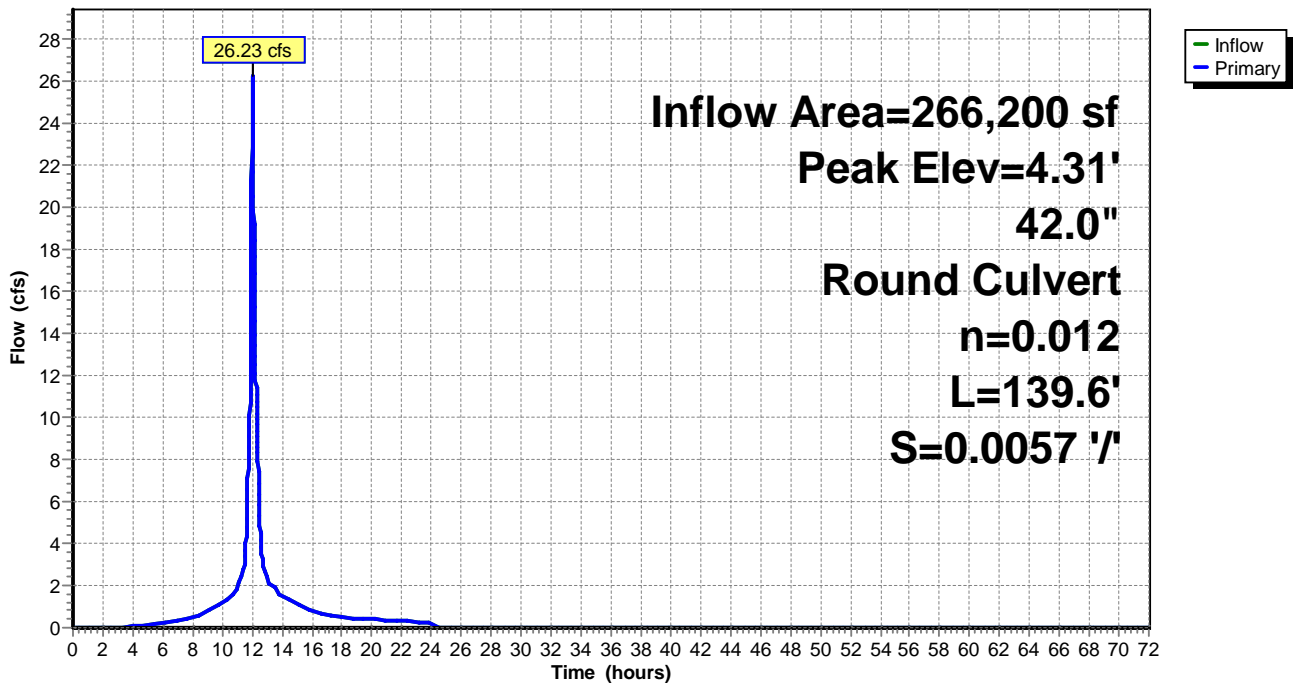

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 71

**Summary for Pond E4081:**

Inflow Area = 8,913 sf, 83.17% Impervious, Inflow Depth = 4.90" for 10 yr event  
 Inflow = 1.32 cfs @ 12.00 hrs, Volume= 3,640 cf  
 Outflow = 1.32 cfs @ 12.00 hrs, Volume= 3,640 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.32 cfs @ 12.00 hrs, Volume= 3,640 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 6.71' @ 12.01 hrs


Flood Elev= 8.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	5.80'	<b>12.0" Round Culvert</b> L= 13.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.80' / 5.70' S= 0.0077 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.24 cfs @ 12.00 hrs HW=6.71' TW=6.57' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 1.24 cfs @ 2.18 fps)

**Pond E4081:**

Hydrograph

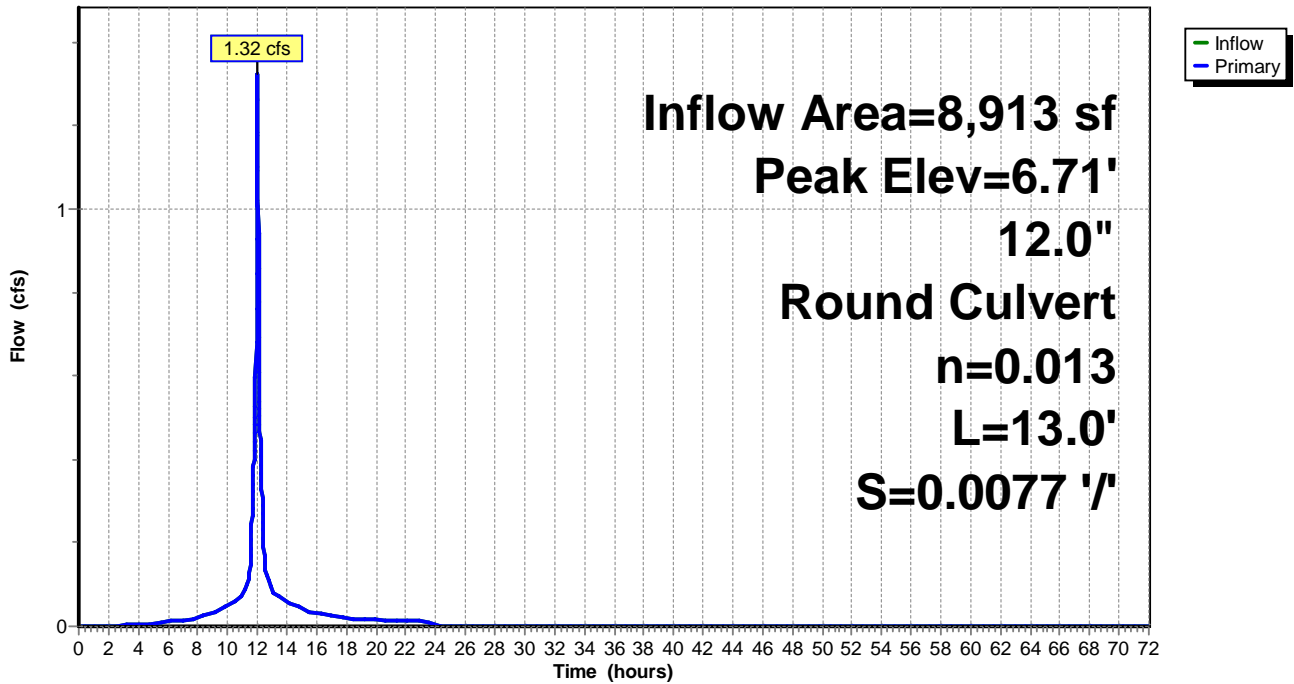

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 72

**Summary for Pond E4082:**

Inflow Area = 9,522 sf, 84.25% Impervious, Inflow Depth = 4.93" for 10 yr event  
 Inflow = 1.42 cfs @ 12.00 hrs, Volume= 3,912 cf  
 Outflow = 1.42 cfs @ 12.00 hrs, Volume= 3,912 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.42 cfs @ 12.00 hrs, Volume= 3,912 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 6.57' @ 12.00 hrs


Flood Elev= 8.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	5.90'	<b>12.0" Round Culvert</b> L= 11.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.90' / 5.70' S= 0.0180 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.42 cfs @ 12.00 hrs HW=6.57' TW=5.55' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 1.42 cfs @ 3.58 fps)

**Pond E4082:**

Hydrograph

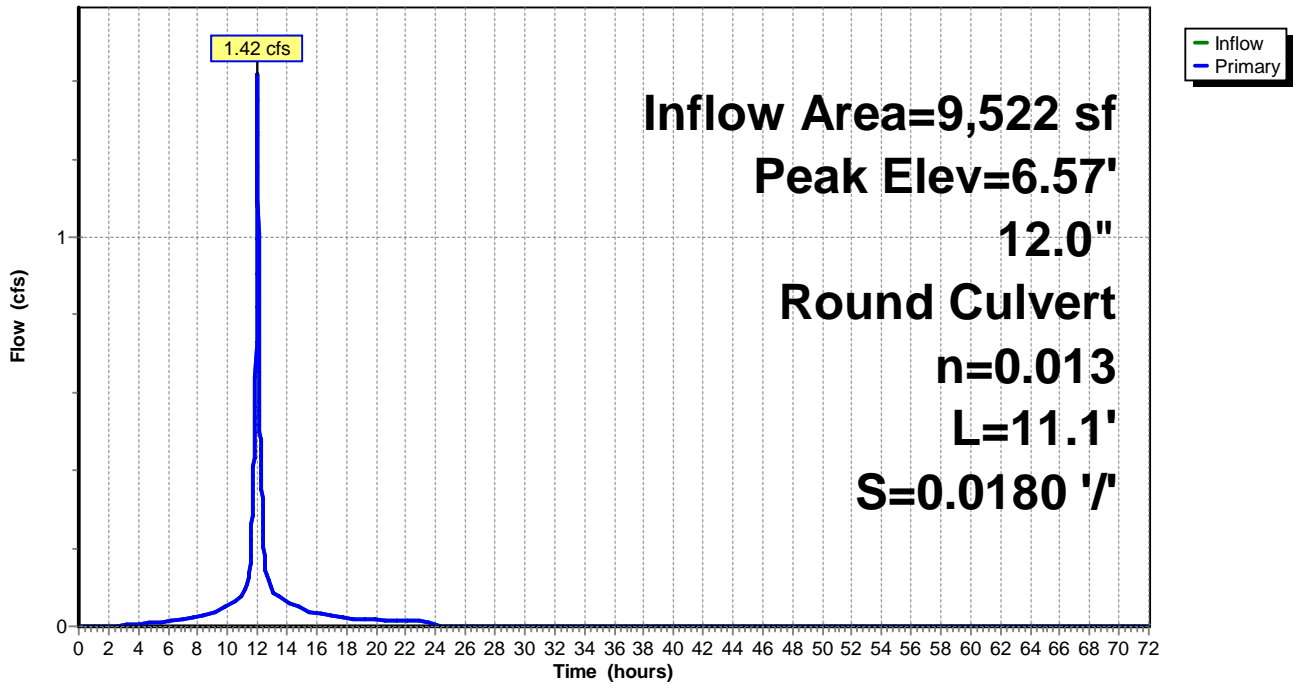

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 73

**Summary for Pond E4083:**

Inflow Area = 9,738 sf, 84.60% Impervious, Inflow Depth = 21.30" for 10 yr event  
 Inflow = 4.61 cfs @ 12.07 hrs, Volume= 17,283 cf  
 Outflow = 4.61 cfs @ 12.07 hrs, Volume= 17,283 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 4.61 cfs @ 12.07 hrs, Volume= 17,283 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 5.62' @ 12.07 hrs  
 Flood Elev= 8.90'

Device #1	Routing	Invert	Outlet Devices
	Primary	5.00'	<b>42.0" W x 24.0" H Box Culvert</b> L= 25.4' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.00' / 4.75' S= 0.0098 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 7.00 sf

**Primary OutFlow** Max=4.60 cfs @ 12.07 hrs HW=5.62' TW=0.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 4.60 cfs @ 2.83 fps)

**Pond E4083:**

Hydrograph

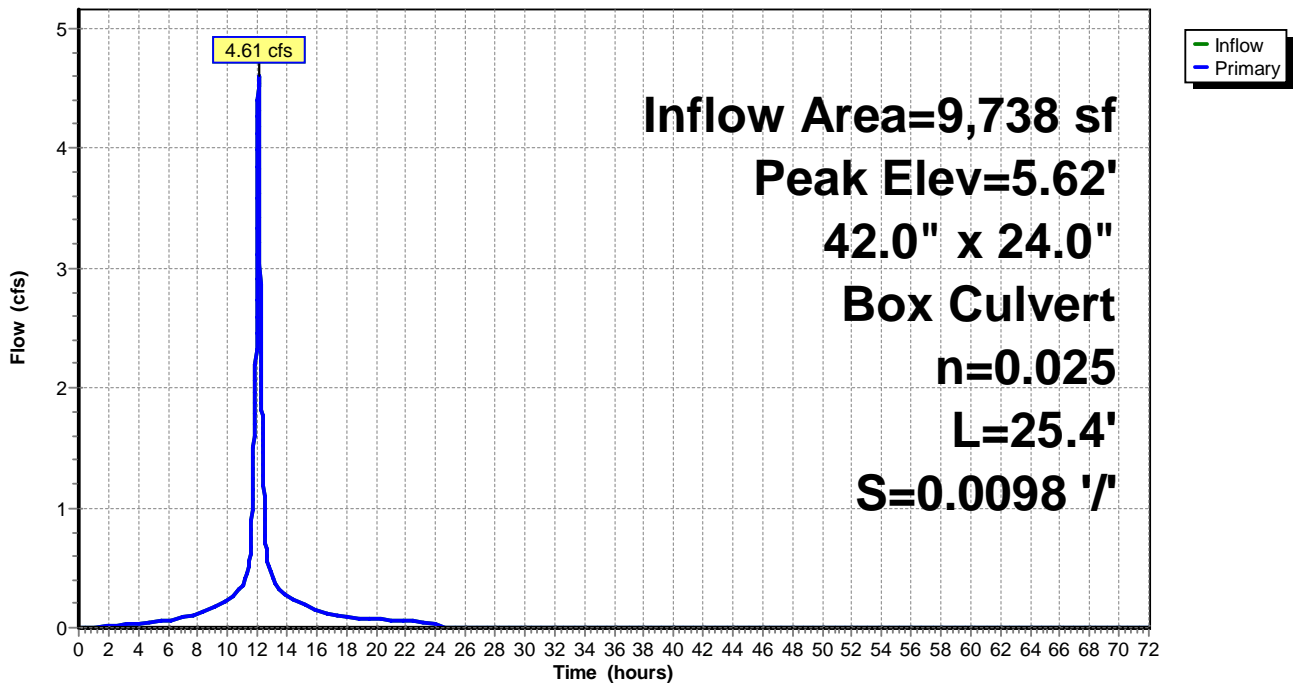

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 74

**Summary for Pond E4093:**

Inflow Area = 216 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.03 cfs @ 12.00 hrs, Volume= 97 cf  
 Outflow = 0.03 cfs @ 12.00 hrs, Volume= 97 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.03 cfs @ 12.00 hrs, Volume= 97 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 5.99' @ 12.00 hrs  
 Flood Elev= 9.00'

Device #1	Routing	Invert	Outlet Devices
	Primary	5.90'	<b>12.0" Round Culvert</b> L= 13.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.90' / 5.60' S= 0.0219 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.03 cfs @ 12.00 hrs HW=5.99' TW=5.55' (Dynamic Tailwater)  
 ← **1=Culvert** (Inlet Controls 0.03 cfs @ 1.00 fps)

**Pond E4093:**

Hydrograph

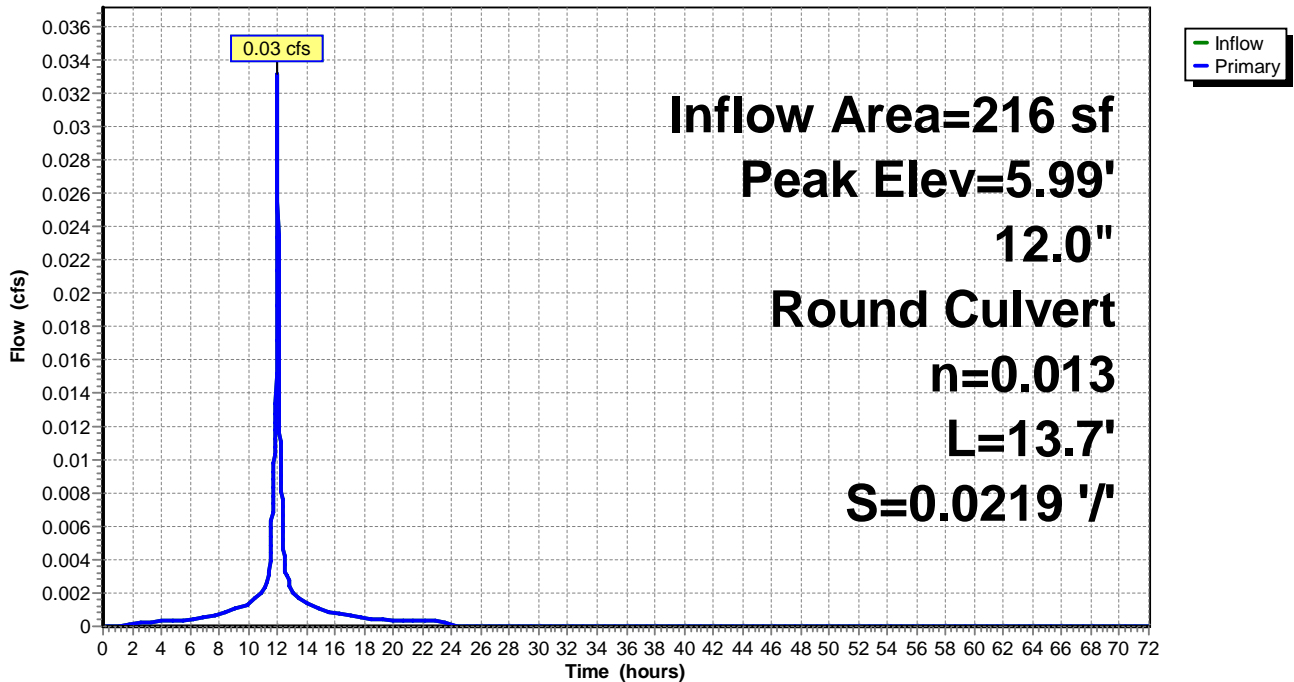



**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 75

**Summary for Pond E4604:**

Inflow Area = 266,200 sf, 65.77% Impervious, Inflow Depth = 4.18" for 10 yr event  
 Inflow = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf  
 Outflow = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 3.49' @ 12.00 hrs

Flood Elev= 10.30'


Device #1	Routing Primary	Invert 1.20'	Outlet Devices
			<b>42.0" Round Culvert</b> L= 18.1' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1.20' / 1.00' S= 0.0110 '/' Cc= 0.900 n= 0.012 Concrete pipe, finished, Flow Area= 9.62 sf

**Primary OutFlow** Max=26.04 cfs @ 12.00 hrs HW=3.48' TW=0.00' (Dynamic Tailwater)

↑ **1=Culvert** (Barrel Controls 26.04 cfs @ 5.58 fps)

**Pond E4604:**

Hydrograph

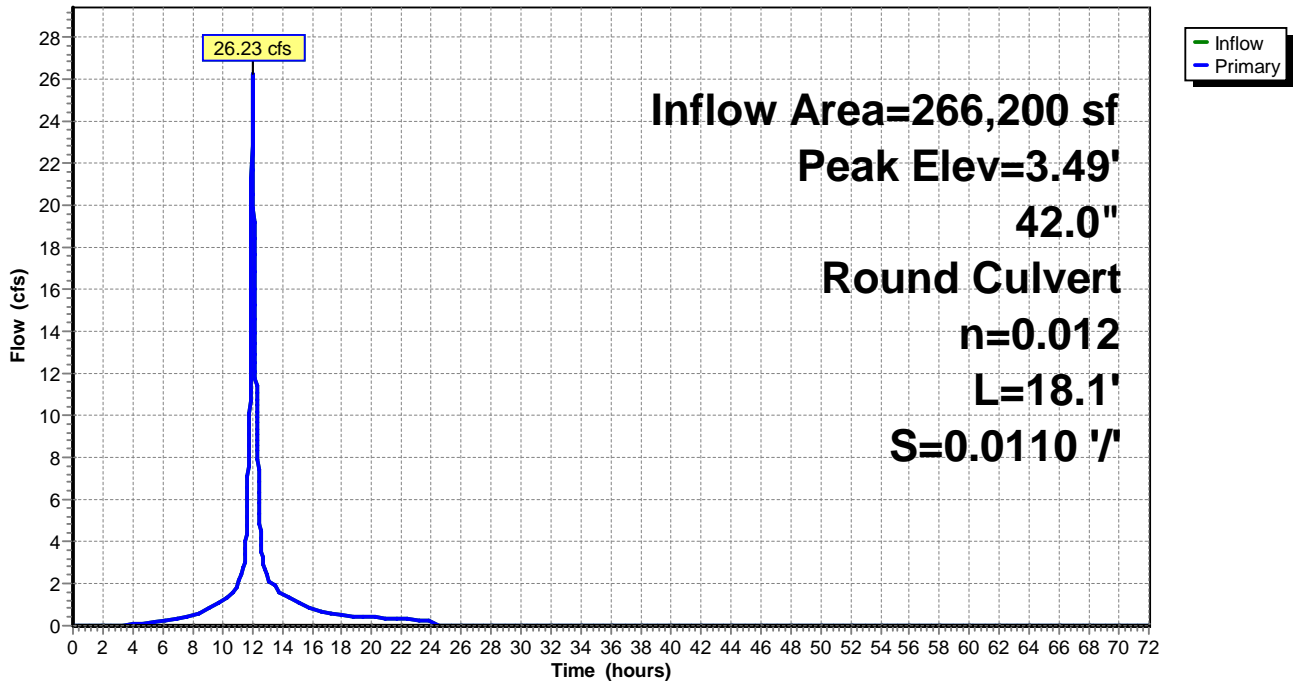

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 76

**Summary for Pond E4605:**

Inflow Area = 248,250 sf, 63.42% Impervious, Inflow Depth = 4.10" for 10 yr event  
 Inflow = 23.40 cfs @ 12.01 hrs, Volume= 84,788 cf  
 Outflow = 23.40 cfs @ 12.01 hrs, Volume= 84,788 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 23.40 cfs @ 12.01 hrs, Volume= 84,788 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 7.79' @ 12.01 hrs

Flood Elev= 11.00'


Device #1	Routing	Invert	Outlet Devices
	Primary	4.40'	<b>24.0" Round Culvert</b> L= 22.2' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 4.40' / 4.20' S= 0.0090 '/ Cc= 0.900 n= 0.012 Concrete pipe, finished, Flow Area= 3.14 sf

**Primary OutFlow** Max=23.40 cfs @ 12.01 hrs HW=7.79' TW=5.15' (Dynamic Tailwater)

↑1=Culvert (Inlet Controls 23.40 cfs @ 7.45 fps)

**Pond E4605:**

Hydrograph

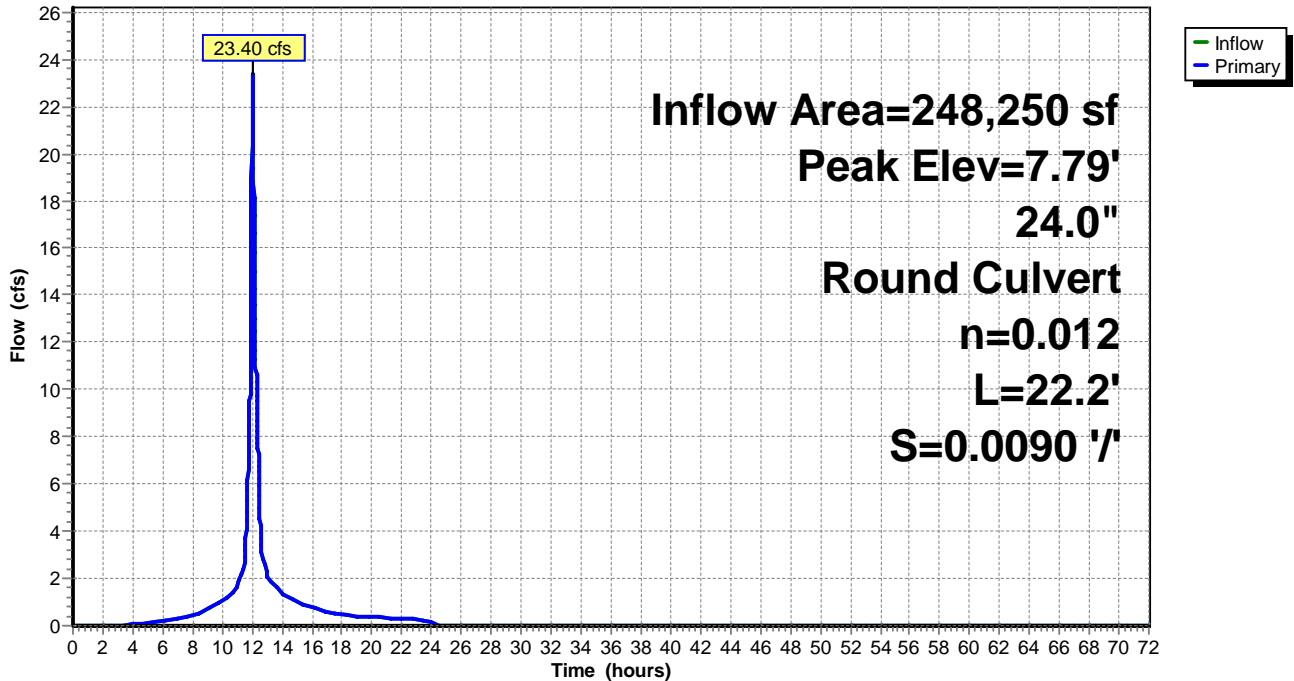

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 77


**Summary for Link AP1: Hodgson Brook**

Inflow Area = 372,586 sf, 70.48% Impervious, Inflow Depth = 4.54" for 10 yr event  
Inflow = 37.02 cfs @ 12.09 hrs, Volume= 140,865 cf  
Primary = 37.02 cfs @ 12.09 hrs, Volume= 140,865 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Link AP1: Hodgson Brook**

Hydrograph

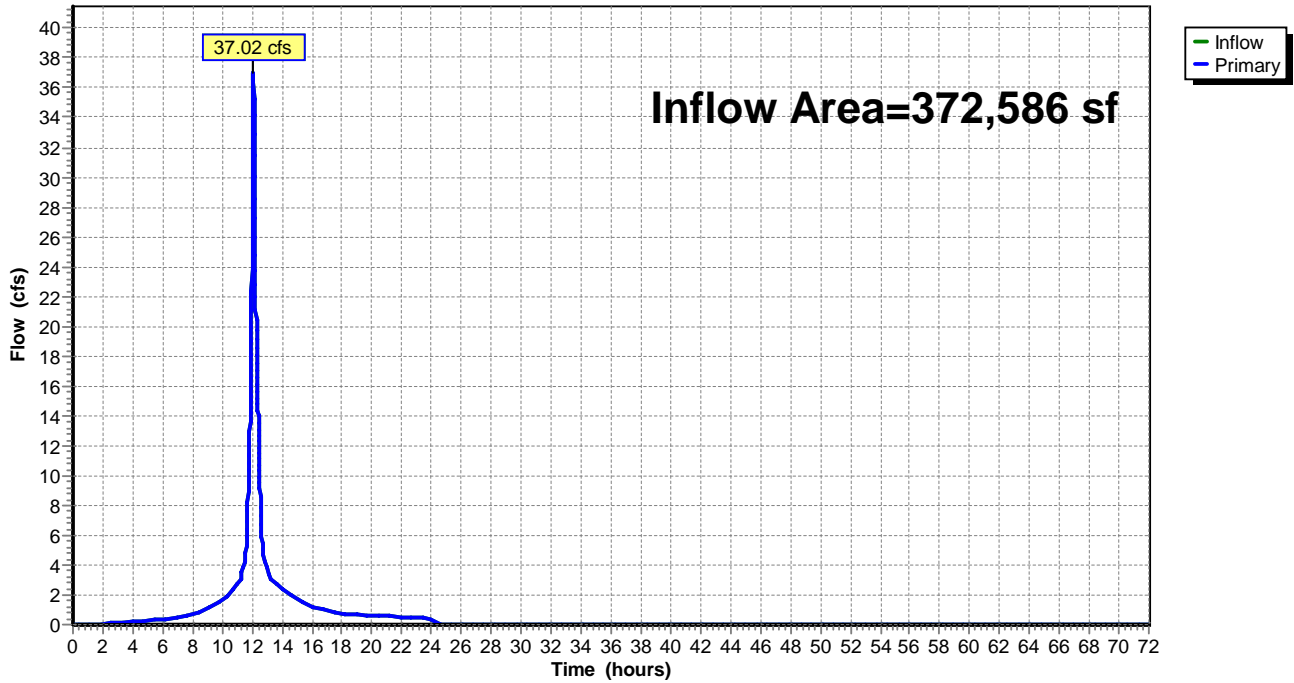

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 78


**Summary for Link AP2:**

Inflow Area = 266,200 sf, 65.77% Impervious, Inflow Depth = 4.18" for 10 yr event  
Inflow = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf  
Primary = 26.23 cfs @ 12.00 hrs, Volume= 92,749 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Link AP2:**

Hydrograph

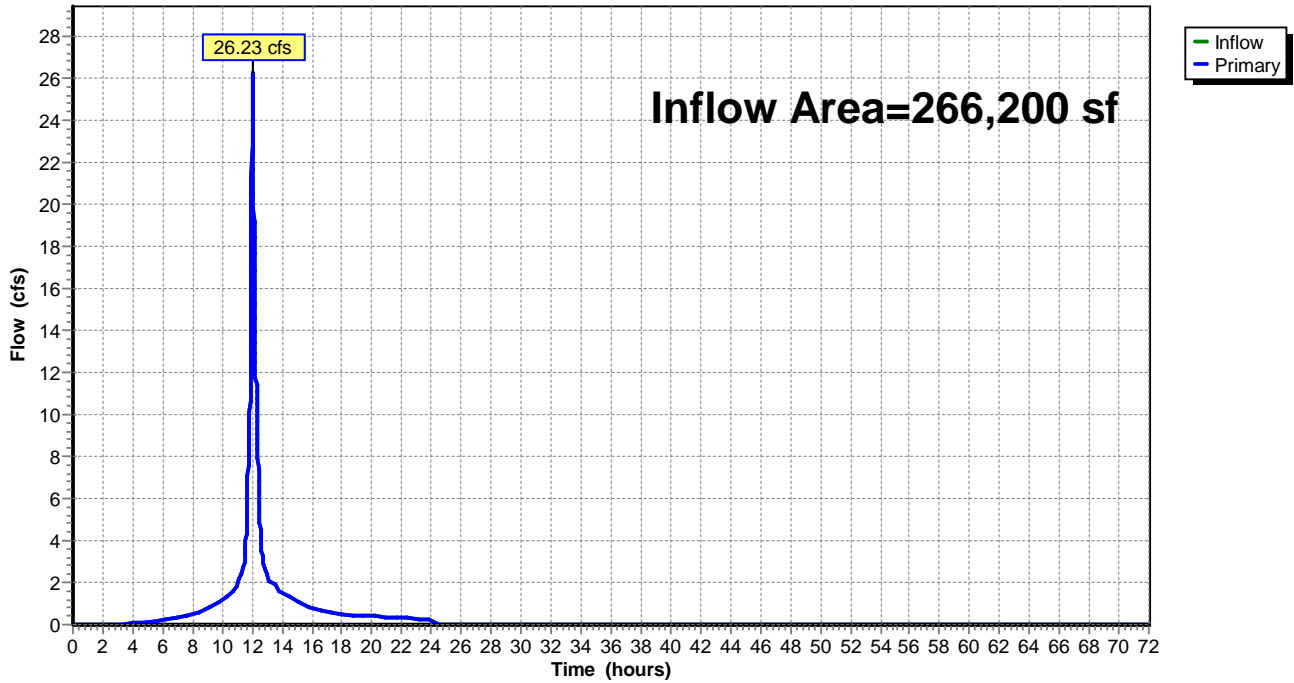

**Existing**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 79


**Summary for Link AP3:**

Inflow Area = 9,738 sf, 84.60% Impervious, Inflow Depth = 21.30" for 10 yr event  
Inflow = 4.61 cfs @ 12.07 hrs, Volume= 17,283 cf  
Primary = 4.61 cfs @ 12.07 hrs, Volume= 17,283 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Link AP3:**

Hydrograph

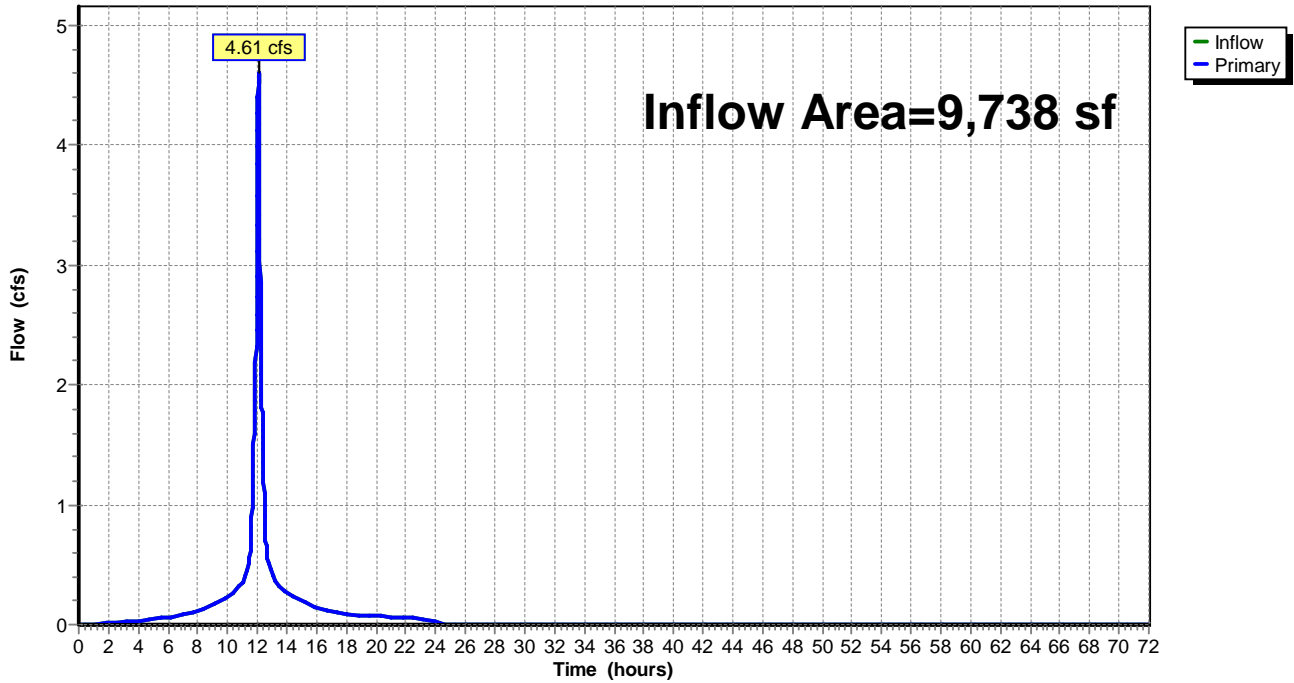




## Appendix F3.1

---

Post-Development Hydrologic Analysis:  
Drainage Diagram, Area Listing & Soil Listing





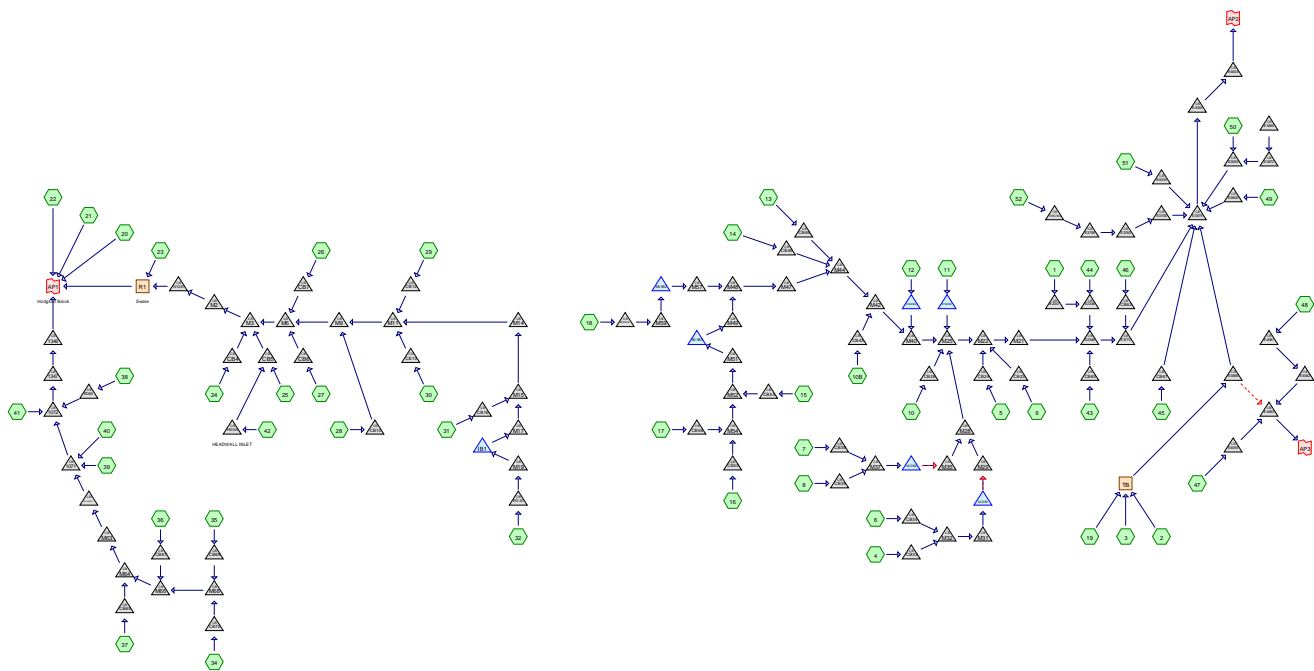

**Routing Diagram for Proposed**  
 Prepared by Fuss & O'Neill Inc., Printed 7/23/2019  
 HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

## Proposed

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 2

### Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
205,286	74	>75% Grass cover, Good, HSG C (1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 10B, 11, 12, 13, 14, 15, 16, 17, 19, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 34, 35, 36, 37, 39, 40, 41, 42, 43, 45, 47)
351,051	98	Paved parking, HSG C (1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 10B, 11, 12, 13, 14, 15, 16, 17, 19, 20, 21, 22, 24, 25, 26, 27, 28, 29, 30, 31, 34, 35, 36, 37, 39, 40, 41, 43, 44, 45, 46, 47, 48, 49, 50, 51)
32,899	98	Roofs, HSG C (18, 52)
59,288	98	Unconnected roofs, HSG C (32, 38)
<b>648,524</b>	<b>90</b>	<b>TOTAL AREA</b>

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 3

**Soil Listing (all nodes)**

Area (sq-ft)	Soil Group	Subcatchment Numbers
0	HSG A	
0	HSG B	
648,524	HSG C	1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 10B, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52
0	HSG D	
0	Other	
<b>648,524</b>		<b>TOTAL AREA</b>

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 4

**Ground Covers (all nodes)**

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Subcatchment Numbers
0	0	205,286	0	0	205,286	>75% Grass cover, Good	
0	0	351,051	0	0	351,051	Paved parking	
0	0	32,899	0	0	32,899	Roofs	
0	0	59,288	0	0	59,288	Unconnected roofs	
<b>0</b>	<b>0</b>	<b>648,524</b>	<b>0</b>	<b>0</b>	<b>648,524</b>	<b>TOTAL AREA</b>	

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 5

**Pipe Listing (all nodes)**

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Diam/Width (inches)	Height (inches)	Inside-Fill (inches)
1	27 BRB1	12.43	12.30	26.5	0.0049	0.013	12.0	0.0	0.0
2	30 DB1	13.80	13.75	2.0	0.0250	0.013	12.0	0.0	0.0
3	30 DB1	12.80	12.80	2.0	0.0000	0.013	6.0	0.0	0.0
4	36 DB2	17.79	17.75	2.0	0.0200	0.013	12.0	0.0	0.0
5	36 DB2	16.25	16.25	2.0	0.0000	0.013	6.0	0.0	0.0
6	41 BRB2	14.43	14.33	20.0	0.0050	0.013	12.0	0.0	0.0
7	50 IB3	18.60	18.55	2.0	0.0250	0.013	12.0	0.0	0.0
8	58 IB2	18.60	18.55	2.0	0.0250	0.013	12.0	0.0	0.0
9	60 RD B	20.78	20.20	116.0	0.0050	0.013	6.0	0.0	0.0
10	60 WQU 2	18.05	17.60	90.0	0.0050	0.013	12.0	0.0	0.0
11	1071	17.50	17.30	31.0	0.0065	0.025	12.0	0.0	0.0
12	1072	17.10	15.90	31.0	0.0387	0.025	15.0	0.0	0.0
13	1346	15.70	14.70	143.0	0.0070	0.025	15.0	0.0	0.0
14	1347	15.90	15.80	204.0	0.0005	0.025	15.0	0.0	0.0
15	CB10	18.87	18.37	56.0	0.0089	0.013	12.0	0.0	0.0
16	CB12	19.30	18.87	7.5	0.0573	0.013	12.0	0.0	0.0
17	CB13	19.30	18.87	7.5	0.0573	0.013	12.0	0.0	0.0
18	CB16	20.82	20.50	65.0	0.0049	0.013	12.0	0.0	0.0
19	CB23	13.20	13.13	15.5	0.0045	0.013	12.0	0.0	0.0
20	CB24	13.92	13.53	39.5	0.0099	0.013	12.0	0.0	0.0
21	CB26	13.00	12.20	14.0	0.0571	0.013	12.0	0.0	0.0
22	CB33	15.00	14.65	63.5	0.0055	0.013	12.0	0.0	0.0
23	CB34	15.50	15.15	24.0	0.0146	0.013	12.0	0.0	0.0
24	CB38	18.00	17.95	5.0	0.0100	0.013	12.0	0.0	0.0
25	CB39	19.00	18.74	53.0	0.0049	0.013	12.0	0.0	0.0
26	CB4	18.56	17.71	24.5	0.0347	0.013	12.0	0.0	0.0
27	CB43	13.84	13.35	9.9	0.0495	0.013	12.0	0.0	0.0
28	CB45	19.50	18.50	15.0	0.0667	0.013	12.0	0.0	0.0
29	CB46	19.50	18.50	15.0	0.0667	0.013	12.0	0.0	0.0
30	CB5	17.60	17.43	33.5	0.0051	0.010	12.0	0.0	0.0
31	CB53	20.38	19.95	86.0	0.0050	0.013	12.0	0.0	0.0
32	CB55	20.24	20.02	44.0	0.0050	0.013	12.0	0.0	0.0
33	CB56	20.86	20.02	69.0	0.0122	0.013	12.0	0.0	0.0
34	CB6	17.83	17.49	13.0	0.0262	0.013	12.0	0.0	0.0
35	CB61	7.00	6.38	65.0	0.0095	0.013	12.0	0.0	0.0
36	CB62	4.48	4.41	6.7	0.0104	0.013	12.0	0.0	0.0
37	CB63	5.05	4.92	13.4	0.0097	0.013	12.0	0.0	0.0
38	CB65	19.37	19.12	50.0	0.0050	0.013	12.0	0.0	0.0
39	CB67	20.60	20.57	3.5	0.0086	0.013	12.0	0.0	0.0
40	CB69	20.93	20.89	7.5	0.0053	0.013	12.0	0.0	0.0
41	CB7	18.28	17.49	16.5	0.0479	0.013	12.0	0.0	0.0
42	CB70	21.15	20.89	52.0	0.0050	0.013	12.0	0.0	0.0

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 6

**Pipe Listing (all nodes) (continued)**

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Diam/Width (inches)	Height (inches)	Inside-Fill (inches)
43	E2347	9.70	9.80	72.5	-0.0014	0.013	15.0	0.0	0.0
44	E2348	9.80	9.10	15.1	0.0464	0.013	15.0	0.0	0.0
45	E2349	3.92	3.51	82.7	0.0050	0.013	24.0	0.0	0.0
46	E3578A	9.00	7.90	11.2	0.0982	0.012	8.0	0.0	0.0
47	E3579	2.00	1.80	205.5	0.0010	0.015	36.0	0.0	0.0
48	E3600	7.50	2.00	21.4	0.2570	0.012	12.0	0.0	0.0
49	E3672	8.20	8.20	13.9	0.0000	0.012	4.0	0.0	0.0
50	E3693	7.90	2.00	27.1	0.2177	0.012	12.0	0.0	0.0
51	E3756	7.80	2.00	23.2	0.2500	0.012	12.0	0.0	0.0
52	E3758	8.00	8.00	10.2	0.0000	0.012	12.0	0.0	0.0
53	E3760	8.00	7.80	32.7	0.0061	0.012	12.0	0.0	0.0
54	E3772	3.41	3.00	81.8	0.0050	0.013	24.0	0.0	0.0
55	E3866	5.40	3.00	49.0	0.0490	0.013	24.0	0.0	0.0
56	E3866	5.30	5.00	83.8	0.0036	0.012	42.0	24.0	0.0
57	E3895	9.70	8.70	37.1	0.0270	0.012	4.0	0.0	0.0
58	E4034	7.50	2.00	14.8	0.3716	0.012	12.0	0.0	0.0
59	E4035	1.80	1.00	139.6	0.0057	0.012	42.0	0.0	0.0
60	E4081	5.80	5.70	13.0	0.0077	0.013	12.0	0.0	0.0
61	E4082	5.90	5.70	11.1	0.0180	0.013	12.0	0.0	0.0
62	E4083	5.00	4.75	25.4	0.0098	0.025	42.0	24.0	0.0
63	E4093	5.90	5.60	13.7	0.0219	0.013	12.0	0.0	0.0
64	E4604	1.20	1.00	18.1	0.0110	0.012	42.0	0.0	0.0
65	HW5A	19.00	17.70	39.0	0.0333	0.013	12.0	0.0	0.0
66	IB1	21.10	21.00	6.0	0.0167	0.013	12.0	0.0	0.0
67	M11	18.37	17.87	101.0	0.0050	0.013	18.0	0.0	0.0
68	M14	19.27	18.47	160.0	0.0050	0.013	18.0	0.0	0.0
69	M15	20.00	19.37	122.0	0.0052	0.013	18.0	0.0	0.0
70	M17	20.90	20.50	81.0	0.0049	0.013	12.0	0.0	0.0
71	M19	22.60	22.54	2.0	0.0300	0.013	6.0	0.0	0.0
72	M2	16.26	16.22	10.0	0.0040	0.013	24.0	0.0	0.0
73	M21	9.79	4.02	116.8	0.0494	0.013	24.0	0.0	0.0
74	M22	10.73	9.89	67.1	0.0125	0.013	24.0	0.0	0.0
75	M25	11.10	10.83	54.0	0.0050	0.013	24.0	0.0	0.0
76	M28	12.57	12.31	51.5	0.0050	0.013	18.0	0.0	0.0
77	M29	12.70	12.67	6.0	0.0050	0.013	12.0	0.0	0.0
78	M3	16.71	16.36	70.5	0.0050	0.013	24.0	0.0	0.0
79	M31	14.40	14.34	2.0	0.0300	0.013	12.0	0.0	0.0
80	M32	14.55	14.50	5.0	0.0100	0.013	12.0	0.0	0.0
81	M35	16.15	15.94	43.0	0.0049	0.013	12.0	0.0	0.0
82	M37	17.85	17.79	2.0	0.0300	0.013	12.0	0.0	0.0
83	M40	11.78	11.20	116.5	0.0050	0.013	24.0	0.0	0.0
84	M42	12.35	11.88	93.5	0.0050	0.013	18.0	0.0	0.0

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Printed 7/23/2019

Page 7

**Pipe Listing (all nodes) (continued)**

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Diam/Width (inches)	Height (inches)	Inside-Fill (inches)
85	M44	13.11	12.45	133.0	0.0050	0.013	18.0	0.0	0.0
86	M47	14.21	13.61	119.5	0.0050	0.013	18.0	0.0	0.0
87	M48	14.48	14.31	34.5	0.0049	0.013	18.0	0.0	0.0
88	M49	15.10	15.00	6.5	0.0154	0.013	12.0	0.0	0.0
89	M51	18.92	18.92	2.0	0.0000	0.013	18.0	0.0	0.0
90	M52	18.97	18.92	5.0	0.0100	0.013	18.0	0.0	0.0
91	M54	19.52	19.07	91.0	0.0049	0.013	18.0	0.0	0.0
92	M57	15.80	15.00	160.5	0.0050	0.013	12.0	0.0	0.0
93	M59	20.10	20.04	3.0	0.0200	0.013	6.0	0.0	0.0
94	M6	16.99	16.81	36.0	0.0050	0.013	24.0	0.0	0.0
95	M63	18.18	18.15	3.0	0.0100	0.013	12.0	0.0	0.0
96	M64	19.02	18.28	147.5	0.0050	0.013	12.0	0.0	0.0
97	M66	20.47	19.12	269.5	0.0050	0.013	12.0	0.0	0.0
98	M68	20.79	20.57	45.0	0.0049	0.013	12.0	0.0	0.0
99	M9	17.37	17.09	56.5	0.0050	0.013	24.0	0.0	0.0
100	RD 20	22.78	22.70	15.5	0.0052	0.013	6.0	0.0	0.0
101	RD69	18.16	18.00	31.0	0.0052	0.013	6.0	0.0	0.0
102	WQS1	16.12	16.00	25.0	0.0048	0.013	24.0	0.0	0.0





## Appendix F3.2

---

Post-Development Hydrologic Analysis:  
Node listing for 2-year, 25-year & 50-year storms



**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 8

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>Subcatchment 1:</b>	Runoff Area=11,648 sf 68.94% Impervious Runoff Depth=2.72" Tc=0.0 min CN=91 Runoff=1.02 cfs 2,642 cf
<b>Subcatchment 2:</b>	Runoff Area=6,355 sf 44.36% Impervious Runoff Depth=2.18" Tc=6.0 min CN=85 Runoff=0.37 cfs 1,156 cf
<b>Subcatchment 3:</b>	Runoff Area=17,966 sf 63.26% Impervious Runoff Depth=2.53" Tc=6.0 min CN=89 Runoff=1.21 cfs 3,793 cf
<b>Subcatchment 4:</b>	Runoff Area=14,022 sf 87.36% Impervious Runoff Depth=3.13" Tc=6.0 min CN=95 Runoff=1.10 cfs 3,653 cf
<b>Subcatchment 5:</b>	Runoff Area=1,801 sf 96.84% Impervious Runoff Depth=3.34" Tc=6.0 min CN=97 Runoff=0.15 cfs 502 cf
<b>Subcatchment 6:</b>	Runoff Area=7,003 sf 96.19% Impervious Runoff Depth=3.34" Tc=6.0 min CN=97 Runoff=0.57 cfs 1,951 cf
<b>Subcatchment 7:</b>	Runoff Area=2,462 sf 89.85% Impervious Runoff Depth=3.23" Tc=6.0 min CN=96 Runoff=0.20 cfs 663 cf
<b>Subcatchment 8:</b>	Runoff Area=6,973 sf 92.96% Impervious Runoff Depth=3.23" Tc=6.0 min CN=96 Runoff=0.56 cfs 1,879 cf
<b>Subcatchment 9:</b>	Runoff Area=3,616 sf 86.12% Impervious Runoff Depth=3.13" Tc=6.0 min CN=95 Runoff=0.28 cfs 942 cf
<b>Subcatchment 10:</b>	Runoff Area=8,901 sf 80.64% Impervious Runoff Depth=2.92" Tc=6.0 min CN=93 Runoff=0.67 cfs 2,165 cf
<b>Subcatchment 10B:</b>	Runoff Area=8,377 sf 79.03% Impervious Runoff Depth=2.92" Tc=6.0 min CN=93 Runoff=0.63 cfs 2,038 cf
<b>Subcatchment 11:</b>	Runoff Area=5,132 sf 50.00% Impervious Runoff Depth=2.27" Tc=6.0 min CN=86 Runoff=0.31 cfs 970 cf
<b>Subcatchment 12:</b>	Runoff Area=12,705 sf 65.30% Impervious Runoff Depth=2.63" Tc=6.0 min CN=90 Runoff=0.88 cfs 2,781 cf
<b>Subcatchment 13:</b>	Runoff Area=2,486 sf 78.32% Impervious Runoff Depth=2.92" Tc=6.0 min CN=93 Runoff=0.19 cfs 605 cf
<b>Subcatchment 14:</b>	Runoff Area=5,742 sf 40.56% Impervious Runoff Depth=2.10" Tc=6.0 min CN=84 Runoff=0.32 cfs 1,005 cf
<b>Subcatchment 15:</b>	Runoff Area=27,997 sf 82.23% Impervious Runoff Depth=3.02" Tc=6.0 min CN=94 Runoff=2.16 cfs 7,048 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 9

<b>Subcatchment 16:</b>	Runoff Area=44,751 sf 69.67% Impervious Runoff Depth=2.72" Tc=6.0 min CN=91 Runoff=3.20 cfs 10,149 cf
<b>Subcatchment 17:</b>	Runoff Area=18,629 sf 55.15% Impervious Runoff Depth=2.35" Tc=6.0 min CN=87 Runoff=1.17 cfs 3,654 cf
<b>Subcatchment 18:</b>	Runoff Area=28,518 sf 100.00% Impervious Runoff Depth=3.46" Tc=6.0 min CN=98 Runoff=2.35 cfs 8,213 cf
<b>Subcatchment 19:</b>	Runoff Area=4,108 sf 17.31% Impervious Runoff Depth=1.64" Tc=6.0 min CN=78 Runoff=0.18 cfs 563 cf
<b>Subcatchment 20:</b>	Runoff Area=1,524 sf 100.00% Impervious Runoff Depth=3.46" Tc=6.0 min CN=98 Runoff=0.13 cfs 439 cf
<b>Subcatchment 21:</b>	Runoff Area=792 sf 66.04% Impervious Runoff Depth=2.63" Tc=6.0 min CN=90 Runoff=0.05 cfs 173 cf
<b>Subcatchment 22:</b>	Runoff Area=41,854 sf 1.22% Impervious Runoff Depth=1.37" Tc=6.0 min CN=74 Runoff=1.50 cfs 4,788 cf
<b>Subcatchment 23:</b>	Runoff Area=14,462 sf 0.00% Impervious Runoff Depth=1.37" Flow Length=115' Slope=0.0011 '/ Tc=6.0 min CN=74 Runoff=0.52 cfs 1,654 cf
<b>Subcatchment 24:</b>	Runoff Area=6,729 sf 56.26% Impervious Runoff Depth=2.44" Flow Length=176' Tc=6.0 min CN=88 Runoff=0.44 cfs 1,370 cf
<b>Subcatchment 25:</b>	Runoff Area=6,442 sf 34.31% Impervious Runoff Depth=1.94" Tc=0.0 min CN=82 Runoff=0.41 cfs 1,042 cf
<b>Subcatchment 26:</b>	Runoff Area=14,265 sf 86.53% Impervious Runoff Depth=3.13" Tc=0.0 min CN=95 Runoff=1.37 cfs 3,716 cf
<b>Subcatchment 27:</b>	Runoff Area=5,289 sf 76.01% Impervious Runoff Depth=2.82" Flow Length=71' Slope=0.1342 '/ Tc=7.7 min CN=92 Runoff=0.37 cfs 1,242 cf
<b>Subcatchment 28:</b>	Runoff Area=18,464 sf 86.68% Impervious Runoff Depth=3.13" Tc=6.0 min CN=95 Runoff=1.45 cfs 4,810 cf
<b>Subcatchment 29:</b>	Runoff Area=8,912 sf 80.50% Impervious Runoff Depth=2.92" Tc=0.0 min CN=93 Runoff=0.82 cfs 2,168 cf
<b>Subcatchment 30:</b>	Runoff Area=18,830 sf 38.59% Impervious Runoff Depth=2.02" Flow Length=349' Slope=0.0138 '/ Tc=6.0 min CN=83 Runoff=1.02 cfs 3,169 cf
<b>Subcatchment 31:</b>	Runoff Area=15,371 sf 10.01% Impervious Runoff Depth=1.50" Tc=6.0 min CN=76 Runoff=0.61 cfs 1,927 cf
<b>Subcatchment 32:</b>	Runoff Area=37,137 sf 100.00% Impervious Runoff Depth=3.46" Tc=6.0 min CN=98 Runoff=3.06 cfs 10,695 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

*Type III 24-hr 2 yr Rainfall=3.69"*

Printed 7/23/2019

Page 10

---

<b>Subcatchment 34:</b>	Runoff Area=10,350 sf 83.59% Impervious Runoff Depth=3.02" Tc=6.0 min CN=94 Runoff=0.80 cfs 2,606 cf
<b>Subcatchment 35:</b>	Runoff Area=10,664 sf 91.11% Impervious Runoff Depth=3.23" Tc=6.0 min CN=96 Runoff=0.86 cfs 2,873 cf
<b>Subcatchment 36:</b>	Runoff Area=35,753 sf 88.57% Impervious Runoff Depth=3.13" Tc=6.0 min CN=95 Runoff=2.82 cfs 9,313 cf
<b>Subcatchment 37:</b>	Runoff Area=49,536 sf 84.69% Impervious Runoff Depth=3.02" Tc=6.0 min CN=94 Runoff=3.82 cfs 12,471 cf
<b>Subcatchment 38:</b>	Runoff Area=22,151 sf 100.00% Impervious Runoff Depth=3.46" Tc=6.0 min CN=98 Runoff=1.83 cfs 6,379 cf
<b>Subcatchment 39:</b>	Runoff Area=11,218 sf 43.45% Impervious Runoff Depth=2.10" Tc=6.0 min CN=84 Runoff=0.63 cfs 1,963 cf
<b>Subcatchment 40:</b>	Runoff Area=13,195 sf 78.02% Impervious Runoff Depth=2.92" Tc=6.0 min CN=93 Runoff=0.99 cfs 3,209 cf
<b>Subcatchment 41:</b>	Runoff Area=7,175 sf 49.39% Impervious Runoff Depth=2.27" Tc=6.0 min CN=86 Runoff=0.44 cfs 1,356 cf
<b>Subcatchment 42:</b>	Runoff Area=6,762 sf 0.00% Impervious Runoff Depth=1.37" Tc=6.0 min CN=74 Runoff=0.24 cfs 774 cf
<b>Subcatchment 43:</b>	Runoff Area=2,510 sf 79.04% Impervious Runoff Depth=2.92" Tc=0.0 min CN=93 Runoff=0.23 cfs 611 cf
<b>Subcatchment 44:</b>	Runoff Area=3,738 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.38 cfs 1,077 cf
<b>Subcatchment 45:</b>	Runoff Area=16,888 sf 28.75% Impervious Runoff Depth=1.86" Tc=0.0 min CN=81 Runoff=1.04 cfs 2,623 cf
<b>Subcatchment 46:</b>	Runoff Area=2,200 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.22 cfs 634 cf
<b>Subcatchment 47:</b>	Runoff Area=2,924 sf 67.78% Impervious Runoff Depth=2.63" Tc=0.0 min CN=90 Runoff=0.25 cfs 640 cf
<b>Subcatchment 48:</b>	Runoff Area=14,033 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=1.41 cfs 4,041 cf
<b>Subcatchment 49:</b>	Runoff Area=417 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.04 cfs 120 cf
<b>Subcatchment 50:</b>	Runoff Area=3,520 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.35 cfs 1,014 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 11

<b>Subcatchment 51:</b>	Runoff Area=1,846 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.19 cfs 532 cf
<b>Subcatchment 52:</b>	Runoff Area=4,381 sf 100.00% Impervious Runoff Depth=3.46" Tc=0.0 min CN=98 Runoff=0.44 cfs 1,262 cf
<b>Reach R1: Swale</b>	Avg. Flow Depth=0.43' Max Vel=2.92 fps Inflow=6.70 cfs 26,335 cf n=0.035 L=100.0' S=0.0200 '/ Capacity=333.24 cfs Outflow=6.68 cfs 26,335 cf
<b>Reach TB:</b>	Inflow=1.76 cfs 5,511 cf Outflow=1.76 cfs 5,511 cf
<b>Pond 27 BRB1:</b>	Peak Elev=15.74' Storage=253 cf Inflow=0.31 cfs 970 cf Outflow=0.07 cfs 970 cf
<b>Pond 30 DB1:</b>	Peak Elev=14.00' Storage=881 cf Inflow=1.68 cfs 5,604 cf Primary=0.14 cfs 95 cf Secondary=0.76 cfs 5,506 cf Outflow=0.90 cfs 5,602 cf
<b>Pond 36 DB2:</b>	Peak Elev=16.93' Storage=282 cf Inflow=0.76 cfs 2,542 cf Primary=0.00 cfs 0 cf Secondary=0.52 cfs 2,541 cf Outflow=0.52 cfs 2,541 cf
<b>Pond 41 BRB2:</b>	Peak Elev=18.04' Storage=900 cf Inflow=0.88 cfs 2,781 cf Outflow=0.20 cfs 2,781 cf
<b>Pond 50 IB3:</b>	Peak Elev=19.29' Storage=7,403 cf Inflow=6.53 cfs 20,852 cf Discarded=0.46 cfs 14,699 cf Primary=1.25 cfs 6,153 cf Outflow=1.71 cfs 20,852 cf
<b>Pond 58 IB2:</b>	Peak Elev=19.33' Storage=1,965 cf Inflow=2.35 cfs 8,213 cf Discarded=0.12 cfs 4,561 cf Primary=1.37 cfs 3,653 cf Outflow=1.49 cfs 8,213 cf
<b>Pond 60 RD B:</b>	Peak Elev=50.26' Inflow=2.35 cfs 8,213 cf 6.0" Round Culvert n=0.013 L=116.0' S=0.0050 '/ Outflow=2.35 cfs 8,213 cf
<b>Pond 60 WQU 2:</b>	Peak Elev=90.95' Inflow=8.29 cfs 27,263 cf 12.0" Round Culvert n=0.013 L=90.0' S=0.0050 '/ Outflow=8.29 cfs 27,263 cf
<b>Pond 1071:</b>	Peak Elev=84.26' Inflow=9.92 cfs 32,436 cf 12.0" Round Culvert n=0.025 L=31.0' S=0.0065 '/ Outflow=9.92 cfs 32,436 cf
<b>Pond 1072:</b>	Peak Elev=72.38' Inflow=12.18 cfs 40,171 cf 15.0" Round Culvert n=0.025 L=31.0' S=0.0387 '/ Outflow=12.18 cfs 40,171 cf
<b>Pond 1346:</b>	Peak Elev=37.12' Inflow=12.18 cfs 40,171 cf 15.0" Round Culvert n=0.025 L=143.0' S=0.0070 '/ Outflow=12.18 cfs 40,171 cf
<b>Pond 1347:</b>	Peak Elev=66.17' Inflow=12.18 cfs 40,171 cf 15.0" Round Culvert n=0.025 L=204.0' S=0.0005 '/ Outflow=12.18 cfs 40,171 cf
<b>Pond CB10:</b>	Peak Elev=19.55' Inflow=1.45 cfs 4,810 cf 12.0" Round Culvert n=0.013 L=56.0' S=0.0089 '/ Outflow=1.45 cfs 4,810 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 12

<b>Pond CB12:</b>	Peak Elev=19.76' Inflow=0.82 cfs 2,168 cf 12.0" Round Culvert n=0.013 L=7.5' S=0.0573 '/ Outflow=0.82 cfs 2,168 cf
<b>Pond CB13:</b>	Peak Elev=19.82' Inflow=1.02 cfs 3,169 cf 12.0" Round Culvert n=0.013 L=7.5' S=0.0573 '/ Outflow=1.02 cfs 3,169 cf
<b>Pond CB16:</b>	Peak Elev=21.28' Inflow=0.61 cfs 1,927 cf 12.0" Round Culvert n=0.013 L=65.0' S=0.0049 '/ Outflow=0.61 cfs 1,927 cf
<b>Pond CB23:</b>	Peak Elev=13.52' Inflow=0.28 cfs 942 cf 12.0" Round Culvert n=0.013 L=15.5' S=0.0045 '/ Outflow=0.28 cfs 942 cf
<b>Pond CB24:</b>	Peak Elev=14.11' Inflow=0.15 cfs 502 cf 12.0" Round Culvert n=0.013 L=39.5' S=0.0099 '/ Outflow=0.15 cfs 502 cf
<b>Pond CB26:</b>	Peak Elev=13.41' Inflow=0.67 cfs 2,165 cf 12.0" Round Culvert n=0.013 L=14.0' S=0.0571 '/ Outflow=0.67 cfs 2,165 cf
<b>Pond CB33:</b>	Peak Elev=15.75' Inflow=1.10 cfs 3,653 cf 12.0" Round Culvert n=0.013 L=63.5' S=0.0055 '/ Outflow=1.10 cfs 3,653 cf
<b>Pond CB34:</b>	Peak Elev=15.88' Inflow=0.57 cfs 1,951 cf 12.0" Round Culvert n=0.013 L=24.0' S=0.0146 '/ Outflow=0.57 cfs 1,951 cf
<b>Pond CB38:</b>	Peak Elev=18.39' Inflow=0.20 cfs 663 cf 12.0" Round Culvert n=0.013 L=5.0' S=0.0100 '/ Outflow=0.20 cfs 663 cf
<b>Pond CB39:</b>	Peak Elev=19.44' Inflow=0.56 cfs 1,879 cf 12.0" Round Culvert n=0.013 L=53.0' S=0.0049 '/ Outflow=0.56 cfs 1,879 cf
<b>Pond CB4:</b>	Peak Elev=18.89' Inflow=0.44 cfs 1,370 cf 12.0" Round Culvert n=0.013 L=24.5' S=0.0347 '/ Outflow=0.44 cfs 1,370 cf
<b>Pond CB43:</b>	Peak Elev=14.24' Inflow=0.63 cfs 2,038 cf 12.0" Round Culvert n=0.013 L=9.9' S=0.0495 '/ Outflow=0.63 cfs 2,038 cf
<b>Pond CB45:</b>	Peak Elev=19.78' Inflow=0.32 cfs 1,005 cf 12.0" Round Culvert n=0.013 L=15.0' S=0.0667 '/ Outflow=0.32 cfs 1,005 cf
<b>Pond CB46:</b>	Peak Elev=19.71' Inflow=0.19 cfs 605 cf 12.0" Round Culvert n=0.013 L=15.0' S=0.0667 '/ Outflow=0.19 cfs 605 cf
<b>Pond CB5:</b>	Peak Elev=18.32' Inflow=0.54 cfs 1,815 cf 12.0" Round Culvert n=0.010 L=33.5' S=0.0051 '/ Outflow=0.54 cfs 1,815 cf
<b>Pond CB53:</b>	Peak Elev=21.61' Inflow=2.16 cfs 7,048 cf 12.0" Round Culvert n=0.013 L=86.0' S=0.0050 '/ Outflow=2.16 cfs 7,048 cf
<b>Pond CB55:</b>	Peak Elev=22.14' Inflow=3.20 cfs 10,149 cf 12.0" Round Culvert n=0.013 L=44.0' S=0.0050 '/ Outflow=3.20 cfs 10,149 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 13

<b>Pond CB56:</b>	Peak Elev=21.69' Inflow=1.17 cfs 3,654 cf 12.0" Round Culvert n=0.013 L=69.0' S=0.0122 '/ Outflow=1.17 cfs 3,654 cf
<b>Pond CB6:</b>	Peak Elev=18.54' Inflow=0.37 cfs 1,242 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0262 '/ Outflow=0.37 cfs 1,242 cf
<b>Pond CB61:</b>	Peak Elev=7.54' Inflow=1.04 cfs 2,623 cf 12.0" Round Culvert n=0.013 L=65.0' S=0.0095 '/ Outflow=1.04 cfs 2,623 cf
<b>Pond CB62:</b>	Peak Elev=4.74' Inflow=0.22 cfs 634 cf 12.0" Round Culvert n=0.013 L=6.7' S=0.0104 '/ Outflow=0.22 cfs 634 cf
<b>Pond CB63:</b>	Peak Elev=5.31' Inflow=0.23 cfs 611 cf 12.0" Round Culvert n=0.013 L=13.4' S=0.0097 '/ Outflow=0.23 cfs 611 cf
<b>Pond CB65:</b>	Peak Elev=104.02' Inflow=3.82 cfs 12,471 cf 12.0" Round Culvert n=0.013 L=50.0' S=0.0050 '/ Outflow=3.82 cfs 12,471 cf
<b>Pond CB67:</b>	Peak Elev=107.16' Inflow=2.82 cfs 9,313 cf 12.0" Round Culvert n=0.013 L=3.5' S=0.0086 '/ Outflow=2.82 cfs 9,313 cf
<b>Pond CB69:</b>	Peak Elev=106.96' Inflow=0.86 cfs 2,873 cf 12.0" Round Culvert n=0.013 L=7.5' S=0.0053 '/ Outflow=0.86 cfs 2,873 cf
<b>Pond CB7:</b>	Peak Elev=18.90' Inflow=1.37 cfs 3,716 cf 12.0" Round Culvert n=0.013 L=16.5' S=0.0479 '/ Outflow=1.37 cfs 3,716 cf
<b>Pond CB70:</b>	Peak Elev=106.96' Inflow=0.80 cfs 2,606 cf 12.0" Round Culvert n=0.013 L=52.0' S=0.0050 '/ Outflow=0.80 cfs 2,606 cf
<b>Pond E2347:</b>	Peak Elev=10.51' Inflow=1.02 cfs 2,642 cf 15.0" Round Culvert n=0.013 L=72.5' S=-0.0014 '/ Outflow=1.02 cfs 2,642 cf
<b>Pond E2348:</b>	Peak Elev=10.37' Inflow=1.39 cfs 3,718 cf 15.0" Round Culvert n=0.013 L=15.1' S=0.0464 '/ Outflow=1.39 cfs 3,718 cf
<b>Pond E2349:</b>	Peak Elev=5.23' Inflow=5.91 cfs 33,283 cf 24.0" Round Culvert n=0.013 L=82.7' S=0.0050 '/ Outflow=5.91 cfs 33,283 cf
<b>Pond E3578A:</b>	Peak Elev=9.38' Inflow=0.44 cfs 1,262 cf 8.0" Round Culvert n=0.012 L=11.2' S=0.0982 '/ Outflow=0.44 cfs 1,262 cf
<b>Pond E3579:</b>	Peak Elev=3.52' Inflow=7.27 cfs 39,689 cf 36.0" Round Culvert n=0.015 L=205.5' S=0.0010 '/ Outflow=7.27 cfs 39,689 cf
<b>Pond E3600:</b>	Peak Elev=7.60' Inflow=0.04 cfs 120 cf 12.0" Round Culvert n=0.012 L=21.4' S=0.2570 '/ Outflow=0.04 cfs 120 cf
<b>Pond E3672:</b>	Peak Elev=8.20' Inflow=0.00 cfs 0 cf 4.0" Round Culvert n=0.012 L=13.9' S=0.0000 '/ Outflow=0.00 cfs 0 cf



**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 14

<b>Pond E3693:</b>	Peak Elev=8.19' Inflow=0.35 cfs 1,014 cf 12.0" Round Culvert n=0.012 L=27.1' S=0.2177 '/ Outflow=0.35 cfs 1,014 cf
<b>Pond E3756:</b>	Peak Elev=8.13' Inflow=0.44 cfs 1,262 cf 12.0" Round Culvert n=0.012 L=23.2' S=0.2500 '/ Outflow=0.44 cfs 1,262 cf
<b>Pond E3758:</b>	Peak Elev=8.47' Inflow=0.44 cfs 1,262 cf 12.0" Round Culvert n=0.012 L=10.2' S=0.0000 '/ Outflow=0.44 cfs 1,262 cf
<b>Pond E3760:</b>	Peak Elev=8.38' Inflow=0.44 cfs 1,262 cf 12.0" Round Culvert n=0.012 L=32.7' S=0.0061 '/ Outflow=0.44 cfs 1,262 cf
<b>Pond E3772:</b>	Peak Elev=4.64' Inflow=6.00 cfs 33,917 cf 24.0" Round Culvert n=0.013 L=81.8' S=0.0050 '/ Outflow=6.00 cfs 33,917 cf
<b>Pond E3866:</b>	Peak Elev=5.62' Inflow=1.76 cfs 5,511 cf Primary=0.29 cfs 223 cf Secondary=1.48 cfs 5,289 cf Outflow=1.76 cfs 5,511 cf
<b>Pond E3895:</b>	Peak Elev=0.00' 4.0" Round Culvert n=0.012 L=37.1' S=0.0270 '/ Primary=0.00 cfs 0 cf
<b>Pond E4034:</b>	Peak Elev=7.71' Inflow=0.19 cfs 532 cf 12.0" Round Culvert n=0.012 L=14.8' S=0.3716 '/ Outflow=0.19 cfs 532 cf
<b>Pond E4035:</b>	Peak Elev=2.97' Inflow=7.27 cfs 39,689 cf 42.0" Round Culvert n=0.012 L=139.6' S=0.0057 '/ Outflow=7.27 cfs 39,689 cf
<b>Pond E4081:</b>	Peak Elev=6.72' Inflow=1.41 cfs 4,041 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0077 '/ Outflow=1.41 cfs 4,041 cf
<b>Pond E4082:</b>	Peak Elev=6.57' Inflow=1.41 cfs 4,041 cf 12.0" Round Culvert n=0.013 L=11.1' S=0.0180 '/ Outflow=1.41 cfs 4,041 cf
<b>Pond E4083:</b>	Peak Elev=5.42' Inflow=2.57 cfs 9,970 cf 42.0" x 24.0" Box Culvert n=0.025 L=25.4' S=0.0098 '/ Outflow=2.57 cfs 9,970 cf
<b>Pond E4093:</b>	Peak Elev=6.14' Inflow=0.25 cfs 640 cf 12.0" Round Culvert n=0.013 L=13.7' S=0.0219 '/ Outflow=0.25 cfs 640 cf
<b>Pond E4604:</b>	Peak Elev=2.29' Inflow=7.27 cfs 39,689 cf 42.0" Round Culvert n=0.012 L=18.1' S=0.0110 '/ Outflow=7.27 cfs 39,690 cf
<b>Pond HW5A: HEADWALL INLET</b>	Peak Elev=19.24' Inflow=0.24 cfs 774 cf 12.0" Round Culvert n=0.013 L=39.0' S=0.0333 '/ Outflow=0.24 cfs 774 cf
<b>Pond IB1:</b>	Peak Elev=21.78' Storage=3,246 cf Inflow=3.06 cfs 10,695 cf Discarded=0.12 cfs 6,232 cf Primary=1.17 cfs 4,463 cf Outflow=1.29 cfs 10,695 cf
<b>Pond M11:</b>	Peak Elev=19.33' Inflow=2.77 cfs 11,727 cf 18.0" Round Culvert n=0.013 L=101.0' S=0.0050 '/ Outflow=2.77 cfs 11,727 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 15

<b>Pond M14:</b>	Peak Elev=19.97' Inflow=1.53 cfs 6,391 cf 18.0" Round Culvert n=0.013 L=160.0' S=0.0050 '/ Outflow=1.53 cfs 6,391 cf
<b>Pond M15:</b>	Peak Elev=20.66' Inflow=1.53 cfs 6,391 cf 18.0" Round Culvert n=0.013 L=122.0' S=0.0052 '/ Outflow=1.53 cfs 6,391 cf
<b>Pond M17:</b>	Peak Elev=21.56' Inflow=1.17 cfs 4,463 cf 12.0" Round Culvert n=0.013 L=81.0' S=0.0049 '/ Outflow=1.17 cfs 4,463 cf
<b>Pond M19:</b>	Peak Elev=33.35' Inflow=3.06 cfs 10,695 cf 6.0" Round Culvert n=0.013 L=2.0' S=0.0300 '/ Outflow=3.06 cfs 10,695 cf
<b>Pond M2:</b>	Peak Elev=17.93' Inflow=6.19 cfs 24,680 cf 24.0" Round Culvert n=0.013 L=10.0' S=0.0040 '/ Outflow=6.19 cfs 24,680 cf
<b>Pond M21:</b>	Peak Elev=10.78' Inflow=5.30 cfs 28,954 cf 24.0" Round Culvert n=0.013 L=116.8' S=0.0494 '/ Outflow=5.30 cfs 28,954 cf
<b>Pond M22:</b>	Peak Elev=11.74' Inflow=5.30 cfs 28,954 cf 24.0" Round Culvert n=0.013 L=67.1' S=0.0125 '/ Outflow=5.30 cfs 28,954 cf
<b>Pond M25:</b>	Peak Elev=12.25' Inflow=4.96 cfs 27,510 cf 24.0" Round Culvert n=0.013 L=54.0' S=0.0050 '/ Outflow=4.96 cfs 27,511 cf
<b>Pond M28:</b>	Peak Elev=13.20' Inflow=1.41 cfs 8,142 cf 18.0" Round Culvert n=0.013 L=51.5' S=0.0050 '/ Outflow=1.41 cfs 8,143 cf
<b>Pond M29:</b>	Peak Elev=13.35' Inflow=0.90 cfs 5,602 cf 12.0" Round Culvert n=0.013 L=6.0' S=0.0050 '/ Outflow=0.90 cfs 5,602 cf
<b>Pond M3:</b>	Peak Elev=18.28' Inflow=6.19 cfs 24,680 cf 24.0" Round Culvert n=0.013 L=70.5' S=0.0050 '/ Outflow=6.19 cfs 24,680 cf
<b>Pond M31:</b>	Peak Elev=15.22' Inflow=1.68 cfs 5,604 cf 12.0" Round Culvert n=0.013 L=2.0' S=0.0300 '/ Outflow=1.68 cfs 5,604 cf
<b>Pond M32:</b>	Peak Elev=15.44' Inflow=1.68 cfs 5,604 cf 12.0" Round Culvert n=0.013 L=5.0' S=0.0100 '/ Outflow=1.68 cfs 5,604 cf
<b>Pond M35:</b>	Peak Elev=16.58' Inflow=0.52 cfs 2,541 cf 12.0" Round Culvert n=0.013 L=43.0' S=0.0049 '/ Outflow=0.52 cfs 2,541 cf
<b>Pond M37:</b>	Peak Elev=18.36' Inflow=0.76 cfs 2,542 cf 12.0" Round Culvert n=0.013 L=2.0' S=0.0300 '/ Outflow=0.76 cfs 2,542 cf
<b>Pond M40:</b>	Peak Elev=12.74' Inflow=3.03 cfs 16,233 cf 24.0" Round Culvert n=0.013 L=116.5' S=0.0050 '/ Outflow=3.03 cfs 16,233 cf
<b>Pond M42:</b>	Peak Elev=13.32' Inflow=2.92 cfs 13,453 cf 18.0" Round Culvert n=0.013 L=93.5' S=0.0050 '/ Outflow=2.92 cfs 13,453 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 16

<b>Pond M44:</b>	Peak Elev=14.02'	Inflow=2.55 cfs	11,415 cf
18.0" Round Culvert	n=0.013	L=133.0'	S=0.0050 '/ Outflow=2.55 cfs 11,415 cf
<b>Pond M47:</b>	Peak Elev=15.01'	Inflow=2.31 cfs	9,806 cf
18.0" Round Culvert	n=0.013	L=119.5'	S=0.0050 '/ Outflow=2.31 cfs 9,806 cf
<b>Pond M48:</b>	Peak Elev=15.35'	Inflow=2.31 cfs	9,806 cf
18.0" Round Culvert	n=0.013	L=34.5'	S=0.0049 '/ Outflow=2.31 cfs 9,806 cf
<b>Pond M49:</b>	Peak Elev=15.77'	Inflow=1.25 cfs	6,153 cf
12.0" Round Culvert	n=0.013	L=6.5'	S=0.0154 '/ Outflow=1.25 cfs 6,153 cf
<b>Pond M51:</b>	Peak Elev=20.58'	Inflow=6.53 cfs	20,852 cf
18.0" Round Culvert	n=0.013	L=2.0'	S=0.0000 '/ Outflow=6.53 cfs 20,852 cf
<b>Pond M52:</b>	Peak Elev=21.16'	Inflow=6.53 cfs	20,852 cf
18.0" Round Culvert	n=0.013	L=5.0'	S=0.0100 '/ Outflow=6.53 cfs 20,852 cf
<b>Pond M54:</b>	Peak Elev=21.44'	Inflow=4.37 cfs	13,803 cf
18.0" Round Culvert	n=0.013	L=91.0'	S=0.0049 '/ Outflow=4.37 cfs 13,803 cf
<b>Pond M57:</b>	Peak Elev=16.52'	Inflow=1.37 cfs	3,653 cf
12.0" Round Culvert	n=0.013	L=160.5'	S=0.0050 '/ Outflow=1.37 cfs 3,653 cf
<b>Pond M59:</b>	Peak Elev=26.54'	Inflow=2.35 cfs	8,213 cf
6.0" Round Culvert	n=0.013	L=3.0'	S=0.0200 '/ Outflow=2.35 cfs 8,213 cf
<b>Pond M6:</b>	Peak Elev=18.52'	Inflow=5.28 cfs	21,495 cf
24.0" Round Culvert	n=0.013	L=36.0'	S=0.0050 '/ Outflow=5.28 cfs 21,495 cf
<b>Pond M63:</b>	Peak Elev=94.96'	Inflow=8.29 cfs	27,263 cf
12.0" Round Culvert	n=0.013	L=3.0'	S=0.0100 '/ Outflow=8.29 cfs 27,263 cf
<b>Pond M64:</b>	Peak Elev=103.20'	Inflow=8.29 cfs	27,263 cf
12.0" Round Culvert	n=0.013	L=147.5'	S=0.0050 '/ Outflow=8.29 cfs 27,263 cf
<b>Pond M66:</b>	Peak Elev=106.80'	Inflow=4.47 cfs	14,792 cf
12.0" Round Culvert	n=0.013	L=269.5'	S=0.0050 '/ Outflow=4.47 cfs 14,792 cf
<b>Pond M68:</b>	Peak Elev=106.93'	Inflow=1.65 cfs	5,479 cf
12.0" Round Culvert	n=0.013	L=45.0'	S=0.0049 '/ Outflow=1.65 cfs 5,479 cf
<b>Pond M9:</b>	Peak Elev=18.74'	Inflow=4.21 cfs	16,537 cf
24.0" Round Culvert	n=0.013	L=56.5'	S=0.0050 '/ Outflow=4.21 cfs 16,537 cf
<b>Pond RD 20:</b>	Peak Elev=43.77'	Inflow=3.06 cfs	10,695 cf
6.0" Round Culvert	n=0.013	L=15.5'	S=0.0052 '/ Outflow=3.06 cfs 10,695 cf
<b>Pond RD69:</b>	Peak Elev=77.30'	Inflow=1.83 cfs	6,379 cf
6.0" Round Culvert	n=0.013	L=31.0'	S=0.0052 '/ Outflow=1.83 cfs 6,379 cf

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 2 yr Rainfall=3.69"

Printed 7/23/2019

Page 17

**Pond WQS1:**

Peak Elev=17.71' Inflow=6.19 cfs 24,680 cf  
24.0" Round Culvert n=0.013 L=25.0' S=0.0048 '/ Outflow=6.19 cfs 24,680 cf

**Link AP1: Hodgson Brook**

Inflow=20.53 cfs 71,906 cf  
Primary=20.53 cfs 71,906 cf

**Link AP2:**

Inflow=7.27 cfs 39,690 cf  
Primary=7.27 cfs 39,690 cf

**Link AP3:**

Inflow=2.57 cfs 9,970 cf  
Primary=2.57 cfs 9,970 cf

**Total Runoff Area = 648,524 sf Runoff Volume = 147,058 cf Average Runoff Depth = 2.72"**  
**31.65% Pervious = 205,286 sf 68.35% Impervious = 443,238 sf**

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 18

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>Subcatchment 1:</b>	Runoff Area=11,648 sf 68.94% Impervious Runoff Depth=6.04" Tc=0.0 min CN=91 Runoff=2.16 cfs 5,860 cf
<b>Subcatchment 2:</b>	Runoff Area=6,355 sf 44.36% Impervious Runoff Depth=5.35" Tc=6.0 min CN=85 Runoff=0.89 cfs 2,832 cf
<b>Subcatchment 3:</b>	Runoff Area=17,966 sf 63.26% Impervious Runoff Depth=5.81" Tc=6.0 min CN=89 Runoff=2.66 cfs 8,692 cf
<b>Subcatchment 4:</b>	Runoff Area=14,022 sf 87.36% Impervious Runoff Depth=6.51" Tc=6.0 min CN=95 Runoff=2.21 cfs 7,601 cf
<b>Subcatchment 5:</b>	Runoff Area=1,801 sf 96.84% Impervious Runoff Depth=6.74" Tc=6.0 min CN=97 Runoff=0.29 cfs 1,012 cf
<b>Subcatchment 6:</b>	Runoff Area=7,003 sf 96.19% Impervious Runoff Depth=6.74" Tc=6.0 min CN=97 Runoff=1.12 cfs 3,934 cf
<b>Subcatchment 7:</b>	Runoff Area=2,462 sf 89.85% Impervious Runoff Depth=6.62" Tc=6.0 min CN=96 Runoff=0.39 cfs 1,359 cf
<b>Subcatchment 8:</b>	Runoff Area=6,973 sf 92.96% Impervious Runoff Depth=6.62" Tc=6.0 min CN=96 Runoff=1.11 cfs 3,849 cf
<b>Subcatchment 9:</b>	Runoff Area=3,616 sf 86.12% Impervious Runoff Depth=6.51" Tc=6.0 min CN=95 Runoff=0.57 cfs 1,960 cf
<b>Subcatchment 10:</b>	Runoff Area=8,901 sf 80.64% Impervious Runoff Depth=6.27" Tc=6.0 min CN=93 Runoff=1.38 cfs 4,651 cf
<b>Subcatchment 10B:</b>	Runoff Area=8,377 sf 79.03% Impervious Runoff Depth=6.27" Tc=6.0 min CN=93 Runoff=1.30 cfs 4,377 cf
<b>Subcatchment 11:</b>	Runoff Area=5,132 sf 50.00% Impervious Runoff Depth=5.46" Tc=6.0 min CN=86 Runoff=0.73 cfs 2,336 cf
<b>Subcatchment 12:</b>	Runoff Area=12,705 sf 65.30% Impervious Runoff Depth=5.92" Tc=6.0 min CN=90 Runoff=1.91 cfs 6,269 cf
<b>Subcatchment 13:</b>	Runoff Area=2,486 sf 78.32% Impervious Runoff Depth=6.27" Tc=6.0 min CN=93 Runoff=0.39 cfs 1,299 cf
<b>Subcatchment 14:</b>	Runoff Area=5,742 sf 40.56% Impervious Runoff Depth=5.23" Tc=6.0 min CN=84 Runoff=0.79 cfs 2,505 cf
<b>Subcatchment 15:</b>	Runoff Area=27,997 sf 82.23% Impervious Runoff Depth=6.39" Tc=6.0 min CN=94 Runoff=4.38 cfs 14,903 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 19

<b>Subcatchment 16:</b>	Runoff Area=44,751 sf 69.67% Impervious Runoff Depth=6.04" Tc=6.0 min CN=91 Runoff=6.80 cfs 22,514 cf
<b>Subcatchment 17:</b>	Runoff Area=18,629 sf 55.15% Impervious Runoff Depth=5.58" Tc=6.0 min CN=87 Runoff=2.69 cfs 8,656 cf
<b>Subcatchment 18:</b>	Runoff Area=28,518 sf 100.00% Impervious Runoff Depth=6.86" Tc=6.0 min CN=98 Runoff=4.56 cfs 16,305 cf
<b>Subcatchment 19:</b>	Runoff Area=4,108 sf 17.31% Impervious Runoff Depth=4.57" Tc=6.0 min CN=78 Runoff=0.50 cfs 1,563 cf
<b>Subcatchment 20:</b>	Runoff Area=1,524 sf 100.00% Impervious Runoff Depth=6.86" Tc=6.0 min CN=98 Runoff=0.24 cfs 871 cf
<b>Subcatchment 21:</b>	Runoff Area=792 sf 66.04% Impervious Runoff Depth=5.92" Tc=6.0 min CN=90 Runoff=0.12 cfs 391 cf
<b>Subcatchment 22:</b>	Runoff Area=41,854 sf 1.22% Impervious Runoff Depth=4.13" Tc=6.0 min CN=74 Runoff=4.65 cfs 14,403 cf
<b>Subcatchment 23:</b>	Runoff Area=14,462 sf 0.00% Impervious Runoff Depth=4.13" Flow Length=115' Slope=0.0011 '/ Tc=6.0 min CN=74 Runoff=1.61 cfs 4,977 cf
<b>Subcatchment 24:</b>	Runoff Area=6,729 sf 56.26% Impervious Runoff Depth=5.69" Flow Length=176' Tc=6.0 min CN=88 Runoff=0.98 cfs 3,191 cf
<b>Subcatchment 25:</b>	Runoff Area=6,442 sf 34.31% Impervious Runoff Depth=5.01" Tc=0.0 min CN=82 Runoff=1.04 cfs 2,690 cf
<b>Subcatchment 26:</b>	Runoff Area=14,265 sf 86.53% Impervious Runoff Depth=6.51" Tc=0.0 min CN=95 Runoff=2.74 cfs 7,733 cf
<b>Subcatchment 27:</b>	Runoff Area=5,289 sf 76.01% Impervious Runoff Depth=6.15" Flow Length=71' Slope=0.1342 '/ Tc=7.7 min CN=92 Runoff=0.77 cfs 2,712 cf
<b>Subcatchment 28:</b>	Runoff Area=18,464 sf 86.68% Impervious Runoff Depth=6.51" Tc=6.0 min CN=95 Runoff=2.91 cfs 10,009 cf
<b>Subcatchment 29:</b>	Runoff Area=8,912 sf 80.50% Impervious Runoff Depth=6.27" Tc=0.0 min CN=93 Runoff=1.69 cfs 4,657 cf
<b>Subcatchment 30:</b>	Runoff Area=18,830 sf 38.59% Impervious Runoff Depth=5.12" Flow Length=349' Slope=0.0138 '/ Tc=6.0 min CN=83 Runoff=2.54 cfs 8,038 cf
<b>Subcatchment 31:</b>	Runoff Area=15,371 sf 10.01% Impervious Runoff Depth=4.35" Tc=6.0 min CN=76 Runoff=1.79 cfs 5,567 cf
<b>Subcatchment 32:</b>	Runoff Area=37,137 sf 100.00% Impervious Runoff Depth=6.86" Tc=6.0 min CN=98 Runoff=5.94 cfs 21,233 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

*Type III 24-hr 25 yr Rainfall=7.10"*

Printed 7/23/2019

Page 20

---

<b>Subcatchment 34:</b>	Runoff Area=10,350 sf 83.59% Impervious Runoff Depth=6.39" Tc=6.0 min CN=94 Runoff=1.62 cfs 5,509 cf
<b>Subcatchment 35:</b>	Runoff Area=10,664 sf 91.11% Impervious Runoff Depth=6.62" Tc=6.0 min CN=96 Runoff=1.69 cfs 5,886 cf
<b>Subcatchment 36:</b>	Runoff Area=35,753 sf 88.57% Impervious Runoff Depth=6.51" Tc=6.0 min CN=95 Runoff=5.63 cfs 19,382 cf
<b>Subcatchment 37:</b>	Runoff Area=49,536 sf 84.69% Impervious Runoff Depth=6.39" Tc=6.0 min CN=94 Runoff=7.75 cfs 26,368 cf
<b>Subcatchment 38:</b>	Runoff Area=22,151 sf 100.00% Impervious Runoff Depth=6.86" Tc=6.0 min CN=98 Runoff=3.54 cfs 12,665 cf
<b>Subcatchment 39:</b>	Runoff Area=11,218 sf 43.45% Impervious Runoff Depth=5.23" Tc=6.0 min CN=84 Runoff=1.54 cfs 4,894 cf
<b>Subcatchment 40:</b>	Runoff Area=13,195 sf 78.02% Impervious Runoff Depth=6.27" Tc=6.0 min CN=93 Runoff=2.05 cfs 6,895 cf
<b>Subcatchment 41:</b>	Runoff Area=7,175 sf 49.39% Impervious Runoff Depth=5.46" Tc=6.0 min CN=86 Runoff=1.02 cfs 3,266 cf
<b>Subcatchment 42:</b>	Runoff Area=6,762 sf 0.00% Impervious Runoff Depth=4.13" Tc=6.0 min CN=74 Runoff=0.75 cfs 2,327 cf
<b>Subcatchment 43:</b>	Runoff Area=2,510 sf 79.04% Impervious Runoff Depth=6.27" Tc=0.0 min CN=93 Runoff=0.47 cfs 1,312 cf
<b>Subcatchment 44:</b>	Runoff Area=3,738 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.73 cfs 2,137 cf
<b>Subcatchment 45:</b>	Runoff Area=16,888 sf 28.75% Impervious Runoff Depth=4.90" Tc=0.0 min CN=81 Runoff=2.69 cfs 6,893 cf
<b>Subcatchment 46:</b>	Runoff Area=2,200 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.43 cfs 1,258 cf
<b>Subcatchment 47:</b>	Runoff Area=2,924 sf 67.78% Impervious Runoff Depth=5.92" Tc=0.0 min CN=90 Runoff=0.54 cfs 1,443 cf
<b>Subcatchment 48:</b>	Runoff Area=14,033 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=2.74 cfs 8,023 cf
<b>Subcatchment 49:</b>	Runoff Area=417 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.08 cfs 238 cf
<b>Subcatchment 50:</b>	Runoff Area=3,520 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.69 cfs 2,013 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 21

<b>Subcatchment 51:</b>	Runoff Area=1,846 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.36 cfs 1,055 cf
<b>Subcatchment 52:</b>	Runoff Area=4,381 sf 100.00% Impervious Runoff Depth=6.86" Tc=0.0 min CN=98 Runoff=0.85 cfs 2,505 cf
<b>Reach R1: Swale</b>	Avg. Flow Depth=0.70' Max Vel=3.80 fps Inflow=16.15 cfs 64,719 cf n=0.035 L=100.0' S=0.0200 '/ Capacity=333.24 cfs Outflow=16.08 cfs 64,719 cf
<b>Reach TB:</b>	Inflow=4.06 cfs 13,087 cf Outflow=4.06 cfs 13,087 cf
<b>Pond 27 BRB1:</b>	Peak Elev=16.07' Storage=637 cf Inflow=0.73 cfs 2,336 cf Outflow=0.30 cfs 2,336 cf
<b>Pond 30 DB1:</b>	Peak Elev=14.71' Storage=1,497 cf Inflow=3.32 cfs 11,536 cf Primary=1.91 cfs 2,001 cf Secondary=0.85 cfs 9,533 cf Outflow=2.43 cfs 11,534 cf
<b>Pond 36 DB2:</b>	Peak Elev=17.51' Storage=646 cf Inflow=1.50 cfs 5,208 cf Primary=0.00 cfs 0 cf Secondary=0.85 cfs 5,206 cf Outflow=0.85 cfs 5,206 cf
<b>Pond 41 BRB2:</b>	Peak Elev=18.23' Storage=1,256 cf Inflow=1.91 cfs 6,269 cf Outflow=1.55 cfs 6,269 cf
<b>Pond 50 IB3:</b>	Peak Elev=20.47' Storage=14,787 cf Inflow=13.86 cfs 46,073 cf Discarded=0.71 cfs 22,269 cf Primary=4.43 cfs 23,804 cf Outflow=5.14 cfs 46,073 cf
<b>Pond 58 IB2:</b>	Peak Elev=19.90' Storage=2,915 cf Inflow=4.56 cfs 16,305 cf Discarded=0.15 cfs 6,380 cf Primary=3.09 cfs 9,925 cf Outflow=3.24 cfs 16,305 cf
<b>Pond 60 RD B:</b>	Peak Elev=132.78' Inflow=4.56 cfs 16,305 cf 6.0" Round Culvert n=0.013 L=116.0' S=0.0050 '/ Outflow=4.56 cfs 16,305 cf
<b>Pond 60 WQU 2:</b>	Peak Elev=327.16' Inflow=16.69 cfs 57,145 cf 12.0" Round Culvert n=0.013 L=90.0' S=0.0050 '/ Outflow=16.69 cfs 57,145 cf
<b>Pond 1071:</b>	Peak Elev=300.04' Inflow=20.28 cfs 68,934 cf 12.0" Round Culvert n=0.025 L=31.0' S=0.0065 '/ Outflow=20.28 cfs 68,934 cf
<b>Pond 1072:</b>	Peak Elev=250.44' Inflow=24.84 cfs 84,864 cf 15.0" Round Culvert n=0.025 L=31.0' S=0.0387 '/ Outflow=24.84 cfs 84,864 cf
<b>Pond 1346:</b>	Peak Elev=103.93' Inflow=24.84 cfs 84,864 cf 15.0" Round Culvert n=0.025 L=143.0' S=0.0070 '/ Outflow=24.84 cfs 84,864 cf
<b>Pond 1347:</b>	Peak Elev=224.62' Inflow=24.84 cfs 84,864 cf 15.0" Round Culvert n=0.025 L=204.0' S=0.0005 '/ Outflow=24.84 cfs 84,864 cf
<b>Pond CB10:</b>	Peak Elev=22.13' Inflow=2.91 cfs 10,009 cf 12.0" Round Culvert n=0.013 L=56.0' S=0.0089 '/ Outflow=2.91 cfs 10,009 cf



**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 22

---

<b>Pond CB12:</b>	Peak Elev=22.12'	Inflow=1.69 cfs	4,657 cf
	12.0" Round Culvert n=0.013 L=7.5' S=0.0573 1/'	Outflow=1.69 cfs	4,657 cf
<b>Pond CB13:</b>	Peak Elev=22.52'	Inflow=2.54 cfs	8,038 cf
	12.0" Round Culvert n=0.013 L=7.5' S=0.0573 1/'	Outflow=2.54 cfs	8,038 cf
<b>Pond CB16:</b>	Peak Elev=22.61'	Inflow=1.79 cfs	5,567 cf
	12.0" Round Culvert n=0.013 L=65.0' S=0.0049 1/'	Outflow=1.79 cfs	5,567 cf
<b>Pond CB23:</b>	Peak Elev=13.66'	Inflow=0.57 cfs	1,960 cf
	12.0" Round Culvert n=0.013 L=15.5' S=0.0045 1/'	Outflow=0.57 cfs	1,960 cf
<b>Pond CB24:</b>	Peak Elev=14.19'	Inflow=0.29 cfs	1,012 cf
	12.0" Round Culvert n=0.013 L=39.5' S=0.0099 1/'	Outflow=0.29 cfs	1,012 cf
<b>Pond CB26:</b>	Peak Elev=14.00'	Inflow=1.38 cfs	4,651 cf
	12.0" Round Culvert n=0.013 L=14.0' S=0.0571 1/'	Outflow=1.38 cfs	4,651 cf
<b>Pond CB33:</b>	Peak Elev=16.96'	Inflow=2.21 cfs	7,601 cf
	12.0" Round Culvert n=0.013 L=63.5' S=0.0055 1/'	Outflow=2.21 cfs	7,601 cf
<b>Pond CB34:</b>	Peak Elev=16.63'	Inflow=1.12 cfs	3,934 cf
	12.0" Round Culvert n=0.013 L=24.0' S=0.0146 1/'	Outflow=1.12 cfs	3,934 cf
<b>Pond CB38:</b>	Peak Elev=18.64'	Inflow=0.39 cfs	1,359 cf
	12.0" Round Culvert n=0.013 L=5.0' S=0.0100 1/'	Outflow=0.39 cfs	1,359 cf
<b>Pond CB39:</b>	Peak Elev=19.65'	Inflow=1.11 cfs	3,849 cf
	12.0" Round Culvert n=0.013 L=53.0' S=0.0049 1/'	Outflow=1.11 cfs	3,849 cf
<b>Pond CB4:</b>	Peak Elev=20.52'	Inflow=0.98 cfs	3,191 cf
	12.0" Round Culvert n=0.013 L=24.5' S=0.0347 1/'	Outflow=0.98 cfs	3,191 cf
<b>Pond CB43:</b>	Peak Elev=15.73'	Inflow=1.30 cfs	4,377 cf
	12.0" Round Culvert n=0.013 L=9.9' S=0.0495 1/'	Outflow=1.30 cfs	4,377 cf
<b>Pond CB45:</b>	Peak Elev=19.95'	Inflow=0.79 cfs	2,505 cf
	12.0" Round Culvert n=0.013 L=15.0' S=0.0667 1/'	Outflow=0.79 cfs	2,505 cf
<b>Pond CB46:</b>	Peak Elev=19.81'	Inflow=0.39 cfs	1,299 cf
	12.0" Round Culvert n=0.013 L=15.0' S=0.0667 1/'	Outflow=0.39 cfs	1,299 cf
<b>Pond CB5:</b>	Peak Elev=20.58'	Inflow=1.48 cfs	5,016 cf
	12.0" Round Culvert n=0.010 L=33.5' S=0.0051 1/'	Outflow=1.48 cfs	5,016 cf
<b>Pond CB53:</b>	Peak Elev=27.06'	Inflow=4.38 cfs	14,903 cf
	12.0" Round Culvert n=0.013 L=86.0' S=0.0050 1/'	Outflow=4.38 cfs	14,903 cf
<b>Pond CB55:</b>	Peak Elev=29.63'	Inflow=6.80 cfs	22,514 cf
	12.0" Round Culvert n=0.013 L=44.0' S=0.0050 1/'	Outflow=6.80 cfs	22,514 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 23

<b>Pond CB56:</b>	Peak Elev=27.09'	Inflow=2.69 cfs	8,656 cf
	12.0" Round Culvert	n=0.013 L=69.0'	S=0.0122 1/8' Outflow=2.69 cfs 8,656 cf
<b>Pond CB6:</b>	Peak Elev=21.10'	Inflow=0.77 cfs	2,712 cf
	12.0" Round Culvert	n=0.013 L=13.0'	S=0.0262 1/8' Outflow=0.77 cfs 2,712 cf
<b>Pond CB61:</b>	Peak Elev=8.01'	Inflow=2.69 cfs	6,893 cf
	12.0" Round Culvert	n=0.013 L=65.0'	S=0.0095 1/8' Outflow=2.69 cfs 6,893 cf
<b>Pond CB62:</b>	Peak Elev=6.17'	Inflow=0.43 cfs	1,258 cf
	12.0" Round Culvert	n=0.013 L=6.7'	S=0.0104 1/8' Outflow=0.43 cfs 1,258 cf
<b>Pond CB63:</b>	Peak Elev=7.43'	Inflow=0.47 cfs	1,312 cf
	12.0" Round Culvert	n=0.013 L=13.4'	S=0.0097 1/8' Outflow=0.47 cfs 1,312 cf
<b>Pond CB65:</b>	Peak Elev=380.10'	Inflow=7.75 cfs	26,368 cf
	12.0" Round Culvert	n=0.013 L=50.0'	S=0.0050 1/8' Outflow=7.75 cfs 26,368 cf
<b>Pond CB67:</b>	Peak Elev=392.56'	Inflow=5.63 cfs	19,382 cf
	12.0" Round Culvert	n=0.013 L=3.5'	S=0.0086 1/8' Outflow=5.63 cfs 19,382 cf
<b>Pond CB69:</b>	Peak Elev=391.76'	Inflow=1.69 cfs	5,886 cf
	12.0" Round Culvert	n=0.013 L=7.5'	S=0.0053 1/8' Outflow=1.69 cfs 5,886 cf
<b>Pond CB7:</b>	Peak Elev=21.20'	Inflow=2.74 cfs	7,733 cf
	12.0" Round Culvert	n=0.013 L=16.5'	S=0.0479 1/8' Outflow=2.74 cfs 7,733 cf
<b>Pond CB70:</b>	Peak Elev=391.77'	Inflow=1.62 cfs	5,509 cf
	12.0" Round Culvert	n=0.013 L=52.0'	S=0.0050 1/8' Outflow=1.62 cfs 5,509 cf
<b>Pond E2347:</b>	Peak Elev=10.89'	Inflow=2.16 cfs	5,860 cf
	15.0" Round Culvert	n=0.013 L=72.5'	S=-0.0014 1/8' Outflow=2.16 cfs 5,860 cf
<b>Pond E2348:</b>	Peak Elev=10.67'	Inflow=2.89 cfs	7,997 cf
	15.0" Round Culvert	n=0.013 L=15.1'	S=0.0464 1/8' Outflow=2.89 cfs 7,997 cf
<b>Pond E2349:</b>	Peak Elev=7.43'	Inflow=17.01 cfs	84,188 cf
	24.0" Round Culvert	n=0.013 L=82.7'	S=0.0050 1/8' Outflow=17.01 cfs 84,188 cf
<b>Pond E3578A:</b>	Peak Elev=9.59'	Inflow=0.85 cfs	2,505 cf
	8.0" Round Culvert	n=0.012 L=11.2'	S=0.0982 1/8' Outflow=0.85 cfs 2,505 cf
<b>Pond E3579:</b>	Peak Elev=4.68'	Inflow=19.94 cfs	99,315 cf
	36.0" Round Culvert	n=0.015 L=205.5'	S=0.0010 1/8' Outflow=19.94 cfs 99,315 cf
<b>Pond E3600:</b>	Peak Elev=7.64'	Inflow=0.08 cfs	238 cf
	12.0" Round Culvert	n=0.012 L=21.4'	S=0.2570 1/8' Outflow=0.08 cfs 238 cf
<b>Pond E3672:</b>	Peak Elev=8.31'	Inflow=0.00 cfs	0 cf
	4.0" Round Culvert	n=0.012 L=13.9'	S=0.0000 1/8' Outflow=0.00 cfs 0 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 24

<b>Pond E3693:</b>	Peak Elev=8.32' Inflow=0.69 cfs 2,013 cf 12.0" Round Culvert n=0.012 L=27.1' S=0.2177 1/ Outflow=0.69 cfs 2,013 cf
<b>Pond E3756:</b>	Peak Elev=8.27' Inflow=0.85 cfs 2,505 cf 12.0" Round Culvert n=0.012 L=23.2' S=0.2500 1/ Outflow=0.85 cfs 2,505 cf
<b>Pond E3758:</b>	Peak Elev=8.67' Inflow=0.85 cfs 2,505 cf 12.0" Round Culvert n=0.012 L=10.2' S=0.0000 1/ Outflow=0.85 cfs 2,505 cf
<b>Pond E3760:</b>	Peak Elev=8.56' Inflow=0.85 cfs 2,505 cf 12.0" Round Culvert n=0.012 L=32.7' S=0.0061 1/ Outflow=0.85 cfs 2,505 cf
<b>Pond E3772:</b>	Peak Elev=6.17' Inflow=17.17 cfs 85,446 cf 24.0" Round Culvert n=0.013 L=81.8' S=0.0050 1/ Outflow=17.17 cfs 85,446 cf
<b>Pond E3866:</b>	Peak Elev=5.84' Inflow=4.06 cfs 13,087 cf Primary=1.14 cfs 1,165 cf Secondary=2.93 cfs 11,922 cf Outflow=4.06 cfs 13,087 cf
<b>Pond E3895:</b>	Peak Elev=0.00' 4.0" Round Culvert n=0.012 L=37.1' S=0.0270 1/ Primary=0.00 cfs 0 cf
<b>Pond E4034:</b>	Peak Elev=7.80' Inflow=0.36 cfs 1,055 cf 12.0" Round Culvert n=0.012 L=14.8' S=0.3716 1/ Outflow=0.36 cfs 1,055 cf
<b>Pond E4035:</b>	Peak Elev=3.92' Inflow=19.94 cfs 99,315 cf 42.0" Round Culvert n=0.012 L=139.6' S=0.0057 1/ Outflow=19.94 cfs 99,315 cf
<b>Pond E4081:</b>	Peak Elev=7.45' Inflow=2.74 cfs 8,023 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0077 1/ Outflow=2.74 cfs 8,023 cf
<b>Pond E4082:</b>	Peak Elev=6.95' Inflow=2.74 cfs 8,023 cf 12.0" Round Culvert n=0.013 L=11.1' S=0.0180 1/ Outflow=2.74 cfs 8,023 cf
<b>Pond E4083:</b>	Peak Elev=5.66' Inflow=5.04 cfs 21,388 cf 42.0" x 24.0" Box Culvert n=0.025 L=25.4' S=0.0098 1/ Outflow=5.04 cfs 21,388 cf
<b>Pond E4093:</b>	Peak Elev=6.27' Inflow=0.54 cfs 1,443 cf 12.0" Round Culvert n=0.013 L=13.7' S=0.0219 1/ Outflow=0.54 cfs 1,443 cf
<b>Pond E4604:</b>	Peak Elev=3.15' Inflow=19.94 cfs 99,315 cf 42.0" Round Culvert n=0.012 L=18.1' S=0.0110 1/ Outflow=19.94 cfs 99,315 cf
<b>Pond HW5A: HEADWALL INLET</b>	Peak Elev=20.61' Inflow=0.75 cfs 2,327 cf 12.0" Round Culvert n=0.013 L=39.0' S=0.0333 1/ Outflow=0.75 cfs 2,327 cf
<b>Pond IB1:</b>	Peak Elev=22.75' Storage=5,981 cf Inflow=5.94 cfs 21,233 cf Discarded=0.14 cfs 8,415 cf Primary=4.05 cfs 12,819 cf Outflow=4.19 cfs 21,233 cf
<b>Pond M11:</b>	Peak Elev=22.07' Inflow=7.07 cfs 31,080 cf 18.0" Round Culvert n=0.013 L=101.0' S=0.0050 1/ Outflow=7.07 cfs 31,080 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 25

<b>Pond M14:</b>	Peak Elev=22.23'	Inflow=4.88 cfs	18,386 cf
18.0" Round Culvert	n=0.013 L=160.0'	S=0.0050 '/	Outflow=4.88 cfs 18,386 cf
<b>Pond M15:</b>	Peak Elev=22.32'	Inflow=4.88 cfs	18,386 cf
18.0" Round Culvert	n=0.013 L=122.0'	S=0.0052 '/	Outflow=4.88 cfs 18,386 cf
<b>Pond M17:</b>	Peak Elev=23.17'	Inflow=4.05 cfs	12,819 cf
12.0" Round Culvert	n=0.013 L=81.0'	S=0.0049 '/	Outflow=4.05 cfs 12,819 cf
<b>Pond M19:</b>	Peak Elev=62.31'	Inflow=5.94 cfs	21,233 cf
6.0" Round Culvert	n=0.013 L=2.0'	S=0.0300 '/	Outflow=5.94 cfs 21,233 cf
<b>Pond M2:</b>	Peak Elev=19.54'	Inflow=14.64 cfs	59,743 cf
24.0" Round Culvert	n=0.013 L=10.0'	S=0.0040 '/	Outflow=14.65 cfs 59,743 cf
<b>Pond M21:</b>	Peak Elev=11.87'	Inflow=15.73 cfs	74,879 cf
24.0" Round Culvert	n=0.013 L=116.8'	S=0.0494 '/	Outflow=15.73 cfs 74,879 cf
<b>Pond M22:</b>	Peak Elev=12.95'	Inflow=15.73 cfs	74,879 cf
24.0" Round Culvert	n=0.013 L=67.1'	S=0.0125 '/	Outflow=15.73 cfs 74,879 cf
<b>Pond M25:</b>	Peak Elev=13.92'	Inflow=14.99 cfs	71,907 cf
24.0" Round Culvert	n=0.013 L=54.0'	S=0.0050 '/	Outflow=14.99 cfs 71,907 cf
<b>Pond M28:</b>	Peak Elev=14.09'	Inflow=3.27 cfs	16,740 cf
18.0" Round Culvert	n=0.013 L=51.5'	S=0.0050 '/	Outflow=3.27 cfs 16,740 cf
<b>Pond M29:</b>	Peak Elev=14.47'	Inflow=2.43 cfs	11,534 cf
12.0" Round Culvert	n=0.013 L=6.0'	S=0.0050 '/	Outflow=2.43 cfs 11,534 cf
<b>Pond M3:</b>	Peak Elev=20.45'	Inflow=14.64 cfs	59,743 cf
24.0" Round Culvert	n=0.013 L=70.5'	S=0.0050 '/	Outflow=14.64 cfs 59,743 cf
<b>Pond M31:</b>	Peak Elev=15.77'	Inflow=3.32 cfs	11,536 cf
12.0" Round Culvert	n=0.013 L=2.0'	S=0.0300 '/	Outflow=3.32 cfs 11,536 cf
<b>Pond M32:</b>	Peak Elev=16.54'	Inflow=3.32 cfs	11,536 cf
12.0" Round Culvert	n=0.013 L=5.0'	S=0.0100 '/	Outflow=3.32 cfs 11,536 cf
<b>Pond M35:</b>	Peak Elev=16.71'	Inflow=0.85 cfs	5,206 cf
12.0" Round Culvert	n=0.013 L=43.0'	S=0.0049 '/	Outflow=0.85 cfs 5,207 cf
<b>Pond M37:</b>	Peak Elev=18.61'	Inflow=1.50 cfs	5,208 cf
12.0" Round Culvert	n=0.013 L=2.0'	S=0.0300 '/	Outflow=1.50 cfs 5,208 cf
<b>Pond M40:</b>	Peak Elev=14.41'	Inflow=10.50 cfs	48,179 cf
24.0" Round Culvert	n=0.013 L=116.5'	S=0.0050 '/	Outflow=10.50 cfs 48,179 cf
<b>Pond M42:</b>	Peak Elev=15.66'	Inflow=8.97 cfs	41,910 cf
18.0" Round Culvert	n=0.013 L=93.5'	S=0.0050 '/	Outflow=8.97 cfs 41,910 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 26

<b>Pond M44:</b>	Peak Elev=16.85'	Inflow=8.05 cfs	37,533 cf
18.0" Round Culvert	n=0.013	L=133.0'	S=0.0050 '/ Outflow=8.05 cfs 37,533 cf
<b>Pond M47:</b>	Peak Elev=17.67'	Inflow=7.43 cfs	33,729 cf
18.0" Round Culvert	n=0.013	L=119.5'	S=0.0050 '/ Outflow=7.43 cfs 33,729 cf
<b>Pond M48:</b>	Peak Elev=18.31'	Inflow=7.43 cfs	33,729 cf
18.0" Round Culvert	n=0.013	L=34.5'	S=0.0049 '/ Outflow=7.43 cfs 33,729 cf
<b>Pond M49:</b>	Peak Elev=19.38'	Inflow=4.43 cfs	23,804 cf
12.0" Round Culvert	n=0.013	L=6.5'	S=0.0154 '/ Outflow=4.43 cfs 23,804 cf
<b>Pond M51:</b>	Peak Elev=22.52'	Inflow=13.86 cfs	46,073 cf
18.0" Round Culvert	n=0.013	L=2.0'	S=0.0000 '/ Outflow=13.86 cfs 46,073 cf
<b>Pond M52:</b>	Peak Elev=25.12'	Inflow=13.86 cfs	46,073 cf
18.0" Round Culvert	n=0.013	L=5.0'	S=0.0100 '/ Outflow=13.86 cfs 46,073 cf
<b>Pond M54:</b>	Peak Elev=26.48'	Inflow=9.49 cfs	31,170 cf
18.0" Round Culvert	n=0.013	L=91.0'	S=0.0049 '/ Outflow=9.49 cfs 31,170 cf
<b>Pond M57:</b>	Peak Elev=19.74'	Inflow=3.09 cfs	9,925 cf
12.0" Round Culvert	n=0.013	L=160.5'	S=0.0050 '/ Outflow=3.09 cfs 9,925 cf
<b>Pond M59:</b>	Peak Elev=43.62'	Inflow=4.56 cfs	16,305 cf
6.0" Round Culvert	n=0.013	L=3.0'	S=0.0200 '/ Outflow=4.56 cfs 16,305 cf
<b>Pond M6:</b>	Peak Elev=21.06'	Inflow=12.31 cfs	51,535 cf
24.0" Round Culvert	n=0.013	L=36.0'	S=0.0050 '/ Outflow=12.31 cfs 51,535 cf
<b>Pond M63:</b>	Peak Elev=343.40'	Inflow=16.69 cfs	57,145 cf
12.0" Round Culvert	n=0.013	L=3.0'	S=0.0100 '/ Outflow=16.69 cfs 57,145 cf
<b>Pond M64:</b>	Peak Elev=376.80'	Inflow=16.69 cfs	57,145 cf
12.0" Round Culvert	n=0.013	L=147.5'	S=0.0050 '/ Outflow=16.69 cfs 57,145 cf
<b>Pond M66:</b>	Peak Elev=391.14'	Inflow=8.94 cfs	30,777 cf
12.0" Round Culvert	n=0.013	L=269.5'	S=0.0050 '/ Outflow=8.94 cfs 30,777 cf
<b>Pond M68:</b>	Peak Elev=391.65'	Inflow=3.31 cfs	11,395 cf
12.0" Round Culvert	n=0.013	L=45.0'	S=0.0049 '/ Outflow=3.31 cfs 11,395 cf
<b>Pond M9:</b>	Peak Elev=21.43'	Inflow=9.83 cfs	41,090 cf
24.0" Round Culvert	n=0.013	L=56.5'	S=0.0050 '/ Outflow=9.83 cfs 41,090 cf
<b>Pond RD 20:</b>	Peak Elev=101.48'	Inflow=5.94 cfs	21,233 cf
6.0" Round Culvert	n=0.013	L=15.5'	S=0.0052 '/ Outflow=5.94 cfs 21,233 cf
<b>Pond RD69:</b>	Peak Elev=269.04'	Inflow=3.54 cfs	12,665 cf
6.0" Round Culvert	n=0.013	L=31.0'	S=0.0052 '/ Outflow=3.54 cfs 12,665 cf

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 25 yr Rainfall=7.10"

Printed 7/23/2019

Page 27

**Pond WQS1:**

Peak Elev=18.63' Inflow=14.65 cfs 59,743 cf  
24.0" Round Culvert n=0.013 L=25.0' S=0.0048 '/ Outflow=14.65 cfs 59,743 cf

**Link AP1: Hodgson Brook**

Inflow=45.49 cfs 165,248 cf  
Primary=45.49 cfs 165,248 cf

**Link AP2:**

Inflow=19.94 cfs 99,315 cf  
Primary=19.94 cfs 99,315 cf

**Link AP3:**

Inflow=5.04 cfs 21,388 cf  
Primary=5.04 cfs 21,388 cf

**Total Runoff Area = 648,524 sf Runoff Volume = 323,017 cf Average Runoff Depth = 5.98"**  
**31.65% Pervious = 205,286 sf 68.35% Impervious = 443,238 sf**

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 28

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>Subcatchment 1:</b>	Runoff Area=11,648 sf 68.94% Impervious Runoff Depth=7.42" Tc=0.0 min CN=91 Runoff=2.62 cfs 7,201 cf
<b>Subcatchment 2:</b>	Runoff Area=6,355 sf 44.36% Impervious Runoff Depth=6.70" Tc=6.0 min CN=85 Runoff=1.10 cfs 3,546 cf
<b>Subcatchment 3:</b>	Runoff Area=17,966 sf 63.26% Impervious Runoff Depth=7.18" Tc=6.0 min CN=89 Runoff=3.25 cfs 10,746 cf
<b>Subcatchment 4:</b>	Runoff Area=14,022 sf 87.36% Impervious Runoff Depth=7.90" Tc=6.0 min CN=95 Runoff=2.66 cfs 9,231 cf
<b>Subcatchment 5:</b>	Runoff Area=1,801 sf 96.84% Impervious Runoff Depth=8.14" Tc=6.0 min CN=97 Runoff=0.34 cfs 1,222 cf
<b>Subcatchment 6:</b>	Runoff Area=7,003 sf 96.19% Impervious Runoff Depth=8.14" Tc=6.0 min CN=97 Runoff=1.34 cfs 4,750 cf
<b>Subcatchment 7:</b>	Runoff Area=2,462 sf 89.85% Impervious Runoff Depth=8.02" Tc=6.0 min CN=96 Runoff=0.47 cfs 1,645 cf
<b>Subcatchment 8:</b>	Runoff Area=6,973 sf 92.96% Impervious Runoff Depth=8.02" Tc=6.0 min CN=96 Runoff=1.33 cfs 4,660 cf
<b>Subcatchment 9:</b>	Runoff Area=3,616 sf 86.12% Impervious Runoff Depth=7.90" Tc=6.0 min CN=95 Runoff=0.69 cfs 2,380 cf
<b>Subcatchment 10:</b>	Runoff Area=8,901 sf 80.64% Impervious Runoff Depth=7.66" Tc=6.0 min CN=93 Runoff=1.67 cfs 5,681 cf
<b>Subcatchment 10B:</b>	Runoff Area=8,377 sf 79.03% Impervious Runoff Depth=7.66" Tc=6.0 min CN=93 Runoff=1.57 cfs 5,347 cf
<b>Subcatchment 11:</b>	Runoff Area=5,132 sf 50.00% Impervious Runoff Depth=6.82" Tc=6.0 min CN=86 Runoff=0.90 cfs 2,915 cf
<b>Subcatchment 12:</b>	Runoff Area=12,705 sf 65.30% Impervious Runoff Depth=7.30" Tc=6.0 min CN=90 Runoff=2.32 cfs 7,727 cf
<b>Subcatchment 13:</b>	Runoff Area=2,486 sf 78.32% Impervious Runoff Depth=7.66" Tc=6.0 min CN=93 Runoff=0.47 cfs 1,587 cf
<b>Subcatchment 14:</b>	Runoff Area=5,742 sf 40.56% Impervious Runoff Depth=6.58" Tc=6.0 min CN=84 Runoff=0.98 cfs 3,147 cf
<b>Subcatchment 15:</b>	Runoff Area=27,997 sf 82.23% Impervious Runoff Depth=7.78" Tc=6.0 min CN=94 Runoff=5.28 cfs 18,150 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 29

<b>Subcatchment 16:</b>	Runoff Area=44,751 sf 69.67% Impervious Runoff Depth=7.42" Tc=6.0 min CN=91 Runoff=8.26 cfs 27,665 cf
<b>Subcatchment 17:</b>	Runoff Area=18,629 sf 55.15% Impervious Runoff Depth=6.94" Tc=6.0 min CN=87 Runoff=3.30 cfs 10,769 cf
<b>Subcatchment 18:</b>	Runoff Area=28,518 sf 100.00% Impervious Runoff Depth=8.26" Tc=6.0 min CN=98 Runoff=5.46 cfs 19,630 cf
<b>Subcatchment 19:</b>	Runoff Area=4,108 sf 17.31% Impervious Runoff Depth=5.85" Tc=6.0 min CN=78 Runoff=0.64 cfs 2,004 cf
<b>Subcatchment 20:</b>	Runoff Area=1,524 sf 100.00% Impervious Runoff Depth=8.26" Tc=6.0 min CN=98 Runoff=0.29 cfs 1,049 cf
<b>Subcatchment 21:</b>	Runoff Area=792 sf 66.04% Impervious Runoff Depth=7.30" Tc=6.0 min CN=90 Runoff=0.14 cfs 482 cf
<b>Subcatchment 22:</b>	Runoff Area=41,854 sf 1.22% Impervious Runoff Depth=5.38" Tc=6.0 min CN=74 Runoff=6.03 cfs 18,748 cf
<b>Subcatchment 23:</b>	Runoff Area=14,462 sf 0.00% Impervious Runoff Depth=5.38" Flow Length=115' Slope=0.0011 '/' Tc=6.0 min CN=74 Runoff=2.08 cfs 6,478 cf
<b>Subcatchment 24:</b>	Runoff Area=6,729 sf 56.26% Impervious Runoff Depth=7.06" Flow Length=176' Tc=6.0 min CN=88 Runoff=1.21 cfs 3,958 cf
<b>Subcatchment 25:</b>	Runoff Area=6,442 sf 34.31% Impervious Runoff Depth=6.34" Tc=0.0 min CN=82 Runoff=1.31 cfs 3,401 cf
<b>Subcatchment 26:</b>	Runoff Area=14,265 sf 86.53% Impervious Runoff Depth=7.90" Tc=0.0 min CN=95 Runoff=3.30 cfs 9,390 cf
<b>Subcatchment 27:</b>	Runoff Area=5,289 sf 76.01% Impervious Runoff Depth=7.54" Flow Length=71' Slope=0.1342 '/' Tc=7.7 min CN=92 Runoff=0.93 cfs 3,323 cf
<b>Subcatchment 28:</b>	Runoff Area=18,464 sf 86.68% Impervious Runoff Depth=7.90" Tc=6.0 min CN=95 Runoff=3.50 cfs 12,155 cf
<b>Subcatchment 29:</b>	Runoff Area=8,912 sf 80.50% Impervious Runoff Depth=7.66" Tc=0.0 min CN=93 Runoff=2.04 cfs 5,688 cf
<b>Subcatchment 30:</b>	Runoff Area=18,830 sf 38.59% Impervious Runoff Depth=6.46" Flow Length=349' Slope=0.0138 '/' Tc=6.0 min CN=83 Runoff=3.17 cfs 10,130 cf
<b>Subcatchment 31:</b>	Runoff Area=15,371 sf 10.01% Impervious Runoff Depth=5.61" Tc=6.0 min CN=76 Runoff=2.30 cfs 7,192 cf
<b>Subcatchment 32:</b>	Runoff Area=37,137 sf 100.00% Impervious Runoff Depth=8.26" Tc=6.0 min CN=98 Runoff=7.12 cfs 25,562 cf



**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

*Type III 24-hr 50 yr Rainfall=8.50"*

Printed 7/23/2019

Page 30

---

<b>Subcatchment 34:</b>	Runoff Area=10,350 sf 83.59% Impervious Runoff Depth=7.78" Tc=6.0 min CN=94 Runoff=1.95 cfs 6,710 cf
<b>Subcatchment 35:</b>	Runoff Area=10,664 sf 91.11% Impervious Runoff Depth=8.02" Tc=6.0 min CN=96 Runoff=2.03 cfs 7,127 cf
<b>Subcatchment 36:</b>	Runoff Area=35,753 sf 88.57% Impervious Runoff Depth=7.90" Tc=6.0 min CN=95 Runoff=6.78 cfs 23,536 cf
<b>Subcatchment 37:</b>	Runoff Area=49,536 sf 84.69% Impervious Runoff Depth=7.78" Tc=6.0 min CN=94 Runoff=9.34 cfs 32,113 cf
<b>Subcatchment 38:</b>	Runoff Area=22,151 sf 100.00% Impervious Runoff Depth=8.26" Tc=6.0 min CN=98 Runoff=4.24 cfs 15,247 cf
<b>Subcatchment 39:</b>	Runoff Area=11,218 sf 43.45% Impervious Runoff Depth=6.58" Tc=6.0 min CN=84 Runoff=1.92 cfs 6,148 cf
<b>Subcatchment 40:</b>	Runoff Area=13,195 sf 78.02% Impervious Runoff Depth=7.66" Tc=6.0 min CN=93 Runoff=2.47 cfs 8,422 cf
<b>Subcatchment 41:</b>	Runoff Area=7,175 sf 49.39% Impervious Runoff Depth=6.82" Tc=6.0 min CN=86 Runoff=1.26 cfs 4,076 cf
<b>Subcatchment 42:</b>	Runoff Area=6,762 sf 0.00% Impervious Runoff Depth=5.38" Tc=6.0 min CN=74 Runoff=0.97 cfs 3,029 cf
<b>Subcatchment 43:</b>	Runoff Area=2,510 sf 79.04% Impervious Runoff Depth=7.66" Tc=0.0 min CN=93 Runoff=0.57 cfs 1,602 cf
<b>Subcatchment 44:</b>	Runoff Area=3,738 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.87 cfs 2,573 cf
<b>Subcatchment 45:</b>	Runoff Area=16,888 sf 28.75% Impervious Runoff Depth=6.22" Tc=0.0 min CN=81 Runoff=3.38 cfs 8,747 cf
<b>Subcatchment 46:</b>	Runoff Area=2,200 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.51 cfs 1,514 cf
<b>Subcatchment 47:</b>	Runoff Area=2,924 sf 67.78% Impervious Runoff Depth=7.30" Tc=0.0 min CN=90 Runoff=0.65 cfs 1,778 cf
<b>Subcatchment 48:</b>	Runoff Area=14,033 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=3.28 cfs 9,659 cf
<b>Subcatchment 49:</b>	Runoff Area=417 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.10 cfs 287 cf
<b>Subcatchment 50:</b>	Runoff Area=3,520 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.82 cfs 2,423 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 31

<b>Subcatchment 51:</b>	Runoff Area=1,846 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=0.43 cfs 1,271 cf
<b>Subcatchment 52:</b>	Runoff Area=4,381 sf 100.00% Impervious Runoff Depth=8.26" Tc=0.0 min CN=98 Runoff=1.02 cfs 3,016 cf
<b>Reach R1: Swale</b>	Avg. Flow Depth=0.77' Max Vel=4.00 fps Inflow=20.73 cfs 81,269 cf n=0.035 L=100.0' S=0.0200 '/ Capacity=333.24 cfs Outflow=19.40 cfs 81,269 cf
<b>Reach TB:</b>	Inflow=4.99 cfs 16,297 cf Outflow=4.99 cfs 16,297 cf
<b>Pond 27 BRB1:</b>	Peak Elev=16.11' Storage=690 cf Inflow=0.90 cfs 2,915 cf Outflow=0.55 cfs 2,915 cf
<b>Pond 30 DB1:</b>	Peak Elev=15.29' Storage=1,936 cf Inflow=4.00 cfs 13,981 cf Primary=3.68 cfs 3,144 cf Secondary=0.99 cfs 10,835 cf Outflow=4.60 cfs 13,979 cf
<b>Pond 36 DB2:</b>	Peak Elev=17.80' Storage=823 cf Inflow=1.80 cfs 6,305 cf Primary=0.00 cfs 0 cf Secondary=0.97 cfs 6,304 cf Outflow=0.97 cfs 6,304 cf
<b>Pond 41 BRB2:</b>	Peak Elev=18.28' Storage=1,348 cf Inflow=2.32 cfs 7,727 cf Outflow=2.03 cfs 7,727 cf
<b>Pond 50 IB3:</b>	Peak Elev=21.42' Storage=18,554 cf Inflow=16.84 cfs 56,584 cf Discarded=0.92 cfs 25,069 cf Primary=5.76 cfs 31,515 cf Outflow=6.68 cfs 56,584 cf
<b>Pond 58 IB2:</b>	Peak Elev=20.46' Storage=3,765 cf Inflow=5.46 cfs 19,630 cf Discarded=0.18 cfs 6,958 cf Primary=4.42 cfs 12,672 cf Outflow=4.59 cfs 19,630 cf
<b>Pond 60 RD B:</b>	Peak Elev=181.78' Inflow=5.46 cfs 19,630 cf 6.0" Round Culvert n=0.013 L=116.0' S=0.0050 '/ Outflow=5.46 cfs 19,630 cf
<b>Pond 60 WQU 2:</b>	Peak Elev=469.46' Inflow=20.10 cfs 69,485 cf 12.0" Round Culvert n=0.013 L=90.0' S=0.0050 '/ Outflow=20.10 cfs 69,485 cf
<b>Pond 1071:</b>	Peak Elev=430.13' Inflow=24.49 cfs 84,054 cf 12.0" Round Culvert n=0.025 L=31.0' S=0.0065 '/ Outflow=24.49 cfs 84,054 cf
<b>Pond 1072:</b>	Peak Elev=357.79' Inflow=29.99 cfs 103,377 cf 15.0" Round Culvert n=0.025 L=31.0' S=0.0387 '/ Outflow=29.99 cfs 103,378 cf
<b>Pond 1346:</b>	Peak Elev=144.21' Inflow=29.99 cfs 103,378 cf 15.0" Round Culvert n=0.025 L=143.0' S=0.0070 '/ Outflow=29.99 cfs 103,378 cf
<b>Pond 1347:</b>	Peak Elev=320.14' Inflow=29.99 cfs 103,378 cf 15.0" Round Culvert n=0.025 L=204.0' S=0.0005 '/ Outflow=29.99 cfs 103,378 cf
<b>Pond CB10:</b>	Peak Elev=23.77' Inflow=3.50 cfs 12,155 cf 12.0" Round Culvert n=0.013 L=56.0' S=0.0089 '/ Outflow=3.50 cfs 12,155 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 32

<b>Pond CB12:</b>	Peak Elev=24.13' Inflow=2.04 cfs 5,688 cf 12.0" Round Culvert n=0.013 L=7.5' S=0.0573 '/ Outflow=2.04 cfs 5,688 cf
<b>Pond CB13:</b>	Peak Elev=24.72' Inflow=3.17 cfs 10,130 cf 12.0" Round Culvert n=0.013 L=7.5' S=0.0573 '/ Outflow=3.17 cfs 10,130 cf
<b>Pond CB16:</b>	Peak Elev=24.71' Inflow=2.30 cfs 7,192 cf 12.0" Round Culvert n=0.013 L=65.0' S=0.0049 '/ Outflow=2.30 cfs 7,192 cf
<b>Pond CB23:</b>	Peak Elev=13.77' Inflow=0.69 cfs 2,380 cf 12.0" Round Culvert n=0.013 L=15.5' S=0.0045 '/ Outflow=0.69 cfs 2,380 cf
<b>Pond CB24:</b>	Peak Elev=14.22' Inflow=0.34 cfs 1,222 cf 12.0" Round Culvert n=0.013 L=39.5' S=0.0099 '/ Outflow=0.34 cfs 1,222 cf
<b>Pond CB26:</b>	Peak Elev=15.03' Inflow=1.67 cfs 5,681 cf 12.0" Round Culvert n=0.013 L=14.0' S=0.0571 '/ Outflow=1.67 cfs 5,681 cf
<b>Pond CB33:</b>	Peak Elev=17.73' Inflow=2.66 cfs 9,231 cf 12.0" Round Culvert n=0.013 L=63.5' S=0.0055 '/ Outflow=2.66 cfs 9,231 cf
<b>Pond CB34:</b>	Peak Elev=17.25' Inflow=1.34 cfs 4,750 cf 12.0" Round Culvert n=0.013 L=24.0' S=0.0146 '/ Outflow=1.34 cfs 4,750 cf
<b>Pond CB38:</b>	Peak Elev=18.73' Inflow=0.47 cfs 1,645 cf 12.0" Round Culvert n=0.013 L=5.0' S=0.0100 '/ Outflow=0.47 cfs 1,645 cf
<b>Pond CB39:</b>	Peak Elev=19.72' Inflow=1.33 cfs 4,660 cf 12.0" Round Culvert n=0.013 L=53.0' S=0.0049 '/ Outflow=1.33 cfs 4,660 cf
<b>Pond CB4:</b>	Peak Elev=21.62' Inflow=1.21 cfs 3,958 cf 12.0" Round Culvert n=0.013 L=24.5' S=0.0347 '/ Outflow=1.21 cfs 3,958 cf
<b>Pond CB43:</b>	Peak Elev=17.08' Inflow=1.57 cfs 5,347 cf 12.0" Round Culvert n=0.013 L=9.9' S=0.0495 '/ Outflow=1.57 cfs 5,347 cf
<b>Pond CB45:</b>	Peak Elev=20.01' Inflow=0.98 cfs 3,147 cf 12.0" Round Culvert n=0.013 L=15.0' S=0.0667 '/ Outflow=0.98 cfs 3,147 cf
<b>Pond CB46:</b>	Peak Elev=19.84' Inflow=0.47 cfs 1,587 cf 12.0" Round Culvert n=0.013 L=15.0' S=0.0667 '/ Outflow=0.47 cfs 1,587 cf
<b>Pond CB5:</b>	Peak Elev=21.73' Inflow=1.89 cfs 6,430 cf 12.0" Round Culvert n=0.010 L=33.5' S=0.0051 '/ Outflow=1.89 cfs 6,430 cf
<b>Pond CB53:</b>	Peak Elev=30.81' Inflow=5.28 cfs 18,150 cf 12.0" Round Culvert n=0.013 L=86.0' S=0.0050 '/ Outflow=5.28 cfs 18,150 cf
<b>Pond CB55:</b>	Peak Elev=34.65' Inflow=8.26 cfs 27,665 cf 12.0" Round Culvert n=0.013 L=44.0' S=0.0050 '/ Outflow=8.26 cfs 27,665 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 33

<b>Pond CB56:</b>	Peak Elev=30.93'	Inflow=3.30 cfs	10,769 cf
	12.0" Round Culvert n=0.013 L=69.0'	S=0.0122 1/'	Outflow=3.30 cfs 10,769 cf
<b>Pond CB6:</b>	Peak Elev=22.36'	Inflow=0.93 cfs	3,323 cf
	12.0" Round Culvert n=0.013 L=13.0'	S=0.0262 1/'	Outflow=0.93 cfs 3,323 cf
<b>Pond CB61:</b>	Peak Elev=8.40'	Inflow=3.38 cfs	8,747 cf
	12.0" Round Culvert n=0.013 L=65.0'	S=0.0095 1/'	Outflow=3.38 cfs 8,747 cf
<b>Pond CB62:</b>	Peak Elev=6.90'	Inflow=0.51 cfs	1,514 cf
	12.0" Round Culvert n=0.013 L=6.7'	S=0.0104 1/'	Outflow=0.51 cfs 1,514 cf
<b>Pond CB63:</b>	Peak Elev=8.64'	Inflow=0.57 cfs	1,602 cf
	12.0" Round Culvert n=0.013 L=13.4'	S=0.0097 1/'	Outflow=0.57 cfs 1,602 cf
<b>Pond CB65:</b>	Peak Elev=546.26'	Inflow=9.34 cfs	32,113 cf
	12.0" Round Culvert n=0.013 L=50.0'	S=0.0050 1/'	Outflow=9.34 cfs 32,113 cf
<b>Pond CB67:</b>	Peak Elev=564.28'	Inflow=6.78 cfs	23,536 cf
	12.0" Round Culvert n=0.013 L=3.5'	S=0.0086 1/'	Outflow=6.78 cfs 23,536 cf
<b>Pond CB69:</b>	Peak Elev=563.14'	Inflow=2.03 cfs	7,127 cf
	12.0" Round Culvert n=0.013 L=7.5'	S=0.0053 1/'	Outflow=2.03 cfs 7,127 cf
<b>Pond CB7:</b>	Peak Elev=22.55'	Inflow=3.30 cfs	9,390 cf
	12.0" Round Culvert n=0.013 L=16.5'	S=0.0479 1/'	Outflow=3.30 cfs 9,390 cf
<b>Pond CB70:</b>	Peak Elev=563.14'	Inflow=1.95 cfs	6,710 cf
	12.0" Round Culvert n=0.013 L=52.0'	S=0.0050 1/'	Outflow=1.95 cfs 6,710 cf
<b>Pond E2347:</b>	Peak Elev=11.03'	Inflow=2.62 cfs	7,201 cf
	15.0" Round Culvert n=0.013 L=72.5'	S=-0.0014 1/'	Outflow=2.62 cfs 7,201 cf
<b>Pond E2348:</b>	Peak Elev=10.78'	Inflow=3.50 cfs	9,774 cf
	15.0" Round Culvert n=0.013 L=15.1'	S=0.0464 1/'	Outflow=3.50 cfs 9,774 cf
<b>Pond E2349:</b>	Peak Elev=8.64'	Inflow=20.99 cfs	105,852 cf
	24.0" Round Culvert n=0.013 L=82.7'	S=0.0050 1/'	Outflow=20.99 cfs 105,852 cf
<b>Pond E3578A:</b>	Peak Elev=9.70'	Inflow=1.02 cfs	3,016 cf
	8.0" Round Culvert n=0.012 L=11.2'	S=0.0982 1/'	Outflow=1.02 cfs 3,016 cf
<b>Pond E3579:</b>	Peak Elev=5.09'	Inflow=25.02 cfs	124,799 cf
	36.0" Round Culvert n=0.015 L=205.5'	S=0.0010 1/'	Outflow=25.02 cfs 124,799 cf
<b>Pond E3600:</b>	Peak Elev=7.65'	Inflow=0.10 cfs	287 cf
	12.0" Round Culvert n=0.012 L=21.4'	S=0.2570 1/'	Outflow=0.10 cfs 287 cf
<b>Pond E3672:</b>	Peak Elev=8.35'	Inflow=0.00 cfs	0 cf
	4.0" Round Culvert n=0.012 L=13.9'	S=0.0000 1/'	Outflow=0.00 cfs 0 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 34

<b>Pond E3693:</b>	Peak Elev=8.36' Inflow=0.82 cfs 2,423 cf 12.0" Round Culvert n=0.012 L=27.1' S=0.2177 '/ Outflow=0.82 cfs 2,423 cf
<b>Pond E3756:</b>	Peak Elev=8.32' Inflow=1.02 cfs 3,016 cf 12.0" Round Culvert n=0.012 L=23.2' S=0.2500 '/ Outflow=1.02 cfs 3,016 cf
<b>Pond E3758:</b>	Peak Elev=8.75' Inflow=1.02 cfs 3,016 cf 12.0" Round Culvert n=0.012 L=10.2' S=0.0000 '/ Outflow=1.02 cfs 3,016 cf
<b>Pond E3760:</b>	Peak Elev=8.62' Inflow=1.02 cfs 3,016 cf 12.0" Round Culvert n=0.012 L=32.7' S=0.0061 '/ Outflow=1.02 cfs 3,016 cf
<b>Pond E3772:</b>	Peak Elev=6.90' Inflow=21.17 cfs 107,366 cf 24.0" Round Culvert n=0.013 L=81.8' S=0.0050 '/ Outflow=21.17 cfs 107,366 cf
<b>Pond E3866:</b>	Peak Elev=5.91' Inflow=4.99 cfs 16,297 cf Primary=1.56 cfs 1,689 cf Secondary=3.46 cfs 14,608 cf Outflow=4.99 cfs 16,297 cf
<b>Pond E3895:</b>	Peak Elev=0.00' 4.0" Round Culvert n=0.012 L=37.1' S=0.0270 '/ Primary=0.00 cfs 0 cf
<b>Pond E4034:</b>	Peak Elev=7.83' Inflow=0.43 cfs 1,271 cf 12.0" Round Culvert n=0.012 L=14.8' S=0.3716 '/ Outflow=0.43 cfs 1,271 cf
<b>Pond E4035:</b>	Peak Elev=4.24' Inflow=25.02 cfs 124,799 cf 42.0" Round Culvert n=0.012 L=139.6' S=0.0057 '/ Outflow=25.02 cfs 124,799 cf
<b>Pond E4081:</b>	Peak Elev=7.86' Inflow=3.28 cfs 9,659 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0077 '/ Outflow=3.28 cfs 9,659 cf
<b>Pond E4082:</b>	Peak Elev=7.15' Inflow=3.28 cfs 9,659 cf 12.0" Round Culvert n=0.013 L=11.1' S=0.0180 '/ Outflow=3.28 cfs 9,659 cf
<b>Pond E4083:</b>	Peak Elev=5.74' Inflow=5.98 cfs 26,046 cf 42.0" x 24.0" Box Culvert n=0.025 L=25.4' S=0.0098 '/ Outflow=5.98 cfs 26,046 cf
<b>Pond E4093:</b>	Peak Elev=6.31' Inflow=0.65 cfs 1,778 cf 12.0" Round Culvert n=0.013 L=13.7' S=0.0219 '/ Outflow=0.65 cfs 1,778 cf
<b>Pond E4604:</b>	Peak Elev=3.43' Inflow=25.02 cfs 124,799 cf 42.0" Round Culvert n=0.012 L=18.1' S=0.0110 '/ Outflow=25.02 cfs 124,799 cf
<b>Pond HW5A: HEADWALL INLET</b>	Peak Elev=21.80' Inflow=0.97 cfs 3,029 cf 12.0" Round Culvert n=0.013 L=39.0' S=0.0333 '/ Outflow=0.97 cfs 3,029 cf
<b>Pond IB1:</b>	Peak Elev=23.48' Storage=7,524 cf Inflow=7.12 cfs 25,562 cf Discarded=0.16 cfs 9,039 cf Primary=5.17 cfs 16,525 cf Outflow=5.33 cfs 25,563 cf
<b>Pond M11:</b>	Peak Elev=24.04' Inflow=9.56 cfs 39,536 cf 18.0" Round Culvert n=0.013 L=101.0' S=0.0050 '/ Outflow=9.56 cfs 39,536 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 35

<b>Pond M14:</b>	Peak Elev=24.14'	Inflow=6.38 cfs	23,717 cf
18.0" Round Culvert	n=0.013	L=160.0'	S=0.0050 '/ Outflow=6.38 cfs 23,717 cf
<b>Pond M15:</b>	Peak Elev=24.24'	Inflow=6.38 cfs	23,717 cf
18.0" Round Culvert	n=0.013	L=122.0'	S=0.0052 '/ Outflow=6.38 cfs 23,717 cf
<b>Pond M17:</b>	Peak Elev=24.52'	Inflow=5.17 cfs	16,525 cf
12.0" Round Culvert	n=0.013	L=81.0'	S=0.0049 '/ Outflow=5.17 cfs 16,525 cf
<b>Pond M19:</b>	Peak Elev=79.51'	Inflow=7.12 cfs	25,562 cf
6.0" Round Culvert	n=0.013	L=2.0'	S=0.0300 '/ Outflow=7.12 cfs 25,562 cf
<b>Pond M2:</b>	Peak Elev=20.40'	Inflow=18.78 cfs	74,791 cf
24.0" Round Culvert	n=0.013	L=10.0'	S=0.0040 '/ Outflow=18.79 cfs 74,791 cf
<b>Pond M21:</b>	Peak Elev=12.47'	Inflow=19.61 cfs	94,476 cf
24.0" Round Culvert	n=0.013	L=116.8'	S=0.0494 '/ Outflow=19.61 cfs 94,476 cf
<b>Pond M22:</b>	Peak Elev=13.62'	Inflow=19.61 cfs	94,476 cf
24.0" Round Culvert	n=0.013	L=67.1'	S=0.0125 '/ Outflow=19.61 cfs 94,476 cf
<b>Pond M25:</b>	Peak Elev=14.85'	Inflow=19.16 cfs	90,874 cf
24.0" Round Culvert	n=0.013	L=54.0'	S=0.0050 '/ Outflow=19.16 cfs 90,874 cf
<b>Pond M28:</b>	Peak Elev=14.93'	Inflow=5.56 cfs	20,283 cf
18.0" Round Culvert	n=0.013	L=51.5'	S=0.0050 '/ Outflow=5.56 cfs 20,283 cf
<b>Pond M29:</b>	Peak Elev=16.13'	Inflow=4.60 cfs	13,979 cf
12.0" Round Culvert	n=0.013	L=6.0'	S=0.0050 '/ Outflow=4.60 cfs 13,979 cf
<b>Pond M3:</b>	Peak Elev=21.52'	Inflow=18.78 cfs	74,791 cf
24.0" Round Culvert	n=0.013	L=70.5'	S=0.0050 '/ Outflow=18.78 cfs 74,791 cf
<b>Pond M31:</b>	Peak Elev=16.02'	Inflow=4.00 cfs	13,981 cf
12.0" Round Culvert	n=0.013	L=2.0'	S=0.0300 '/ Outflow=4.00 cfs 13,981 cf
<b>Pond M32:</b>	Peak Elev=17.13'	Inflow=4.00 cfs	13,981 cf
12.0" Round Culvert	n=0.013	L=5.0'	S=0.0100 '/ Outflow=4.00 cfs 13,981 cf
<b>Pond M35:</b>	Peak Elev=16.75'	Inflow=0.97 cfs	6,304 cf
12.0" Round Culvert	n=0.013	L=43.0'	S=0.0049 '/ Outflow=0.97 cfs 6,304 cf
<b>Pond M37:</b>	Peak Elev=18.71'	Inflow=1.80 cfs	6,305 cf
12.0" Round Culvert	n=0.013	L=2.0'	S=0.0300 '/ Outflow=1.80 cfs 6,305 cf
<b>Pond M40:</b>	Peak Elev=15.48'	Inflow=12.61 cfs	61,994 cf
24.0" Round Culvert	n=0.013	L=116.5'	S=0.0050 '/ Outflow=12.61 cfs 61,994 cf
<b>Pond M42:</b>	Peak Elev=16.93'	Inflow=11.30 cfs	54,267 cf
18.0" Round Culvert	n=0.013	L=93.5'	S=0.0050 '/ Outflow=11.30 cfs 54,267 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 36

<b>Pond M44:</b>	Peak Elev=18.06'	Inflow=10.65 cfs	48,921 cf
	18.0" Round Culvert n=0.013 L=133.0' S=0.0050 '/'	Outflow=10.65 cfs	48,921 cf
<b>Pond M47:</b>	Peak Elev=18.77'	Inflow=10.08 cfs	44,187 cf
	18.0" Round Culvert n=0.013 L=119.5' S=0.0050 '/'	Outflow=10.08 cfs	44,187 cf
<b>Pond M48:</b>	Peak Elev=19.20'	Inflow=10.08 cfs	44,187 cf
	18.0" Round Culvert n=0.013 L=34.5' S=0.0049 '/'	Outflow=10.08 cfs	44,187 cf
<b>Pond M49:</b>	Peak Elev=20.98'	Inflow=5.76 cfs	31,515 cf
	12.0" Round Culvert n=0.013 L=6.5' S=0.0154 '/'	Outflow=5.76 cfs	31,515 cf
<b>Pond M51:</b>	Peak Elev=24.13'	Inflow=16.84 cfs	56,584 cf
	18.0" Round Culvert n=0.013 L=2.0' S=0.0000 '/'	Outflow=16.84 cfs	56,584 cf
<b>Pond M52:</b>	Peak Elev=27.97'	Inflow=16.84 cfs	56,584 cf
	18.0" Round Culvert n=0.013 L=5.0' S=0.0100 '/'	Outflow=16.84 cfs	56,584 cf
<b>Pond M54:</b>	Peak Elev=30.00'	Inflow=11.56 cfs	38,435 cf
	18.0" Round Culvert n=0.013 L=91.0' S=0.0049 '/'	Outflow=11.56 cfs	38,435 cf
<b>Pond M57:</b>	Peak Elev=22.22'	Inflow=4.42 cfs	12,672 cf
	12.0" Round Culvert n=0.013 L=160.5' S=0.0050 '/'	Outflow=4.42 cfs	12,672 cf
<b>Pond M59:</b>	Peak Elev=53.76'	Inflow=5.46 cfs	19,630 cf
	6.0" Round Culvert n=0.013 L=3.0' S=0.0200 '/'	Outflow=5.46 cfs	19,630 cf
<b>Pond M6:</b>	Peak Elev=22.31'	Inflow=15.85 cfs	64,403 cf
	24.0" Round Culvert n=0.013 L=36.0' S=0.0050 '/'	Outflow=15.85 cfs	64,403 cf
<b>Pond M63:</b>	Peak Elev=493.03'	Inflow=20.10 cfs	69,485 cf
	12.0" Round Culvert n=0.013 L=3.0' S=0.0100 '/'	Outflow=20.10 cfs	69,485 cf
<b>Pond M64:</b>	Peak Elev=541.48'	Inflow=20.10 cfs	69,485 cf
	12.0" Round Culvert n=0.013 L=147.5' S=0.0050 '/'	Outflow=20.10 cfs	69,485 cf
<b>Pond M66:</b>	Peak Elev=562.23'	Inflow=10.76 cfs	37,372 cf
	12.0" Round Culvert n=0.013 L=269.5' S=0.0050 '/'	Outflow=10.76 cfs	37,372 cf
<b>Pond M68:</b>	Peak Elev=562.98'	Inflow=3.98 cfs	13,836 cf
	12.0" Round Culvert n=0.013 L=45.0' S=0.0049 '/'	Outflow=3.98 cfs	13,836 cf
<b>Pond M9:</b>	Peak Elev=22.78'	Inflow=12.91 cfs	51,690 cf
	24.0" Round Culvert n=0.013 L=56.5' S=0.0050 '/'	Outflow=12.91 cfs	51,690 cf
<b>Pond RD 20:</b>	Peak Elev=135.76'	Inflow=7.12 cfs	25,562 cf
	6.0" Round Culvert n=0.013 L=15.5' S=0.0052 '/'	Outflow=7.12 cfs	25,562 cf
<b>Pond RD69:</b>	Peak Elev=384.52'	Inflow=4.24 cfs	15,247 cf
	6.0" Round Culvert n=0.013 L=31.0' S=0.0052 '/'	Outflow=4.24 cfs	15,247 cf

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 50 yr Rainfall=8.50"

Printed 7/23/2019

Page 37

**Pond WQS1:**

Peak Elev=19.27' Inflow=18.79 cfs 74,791 cf  
24.0" Round Culvert n=0.013 L=25.0' S=0.0048 '/ Outflow=18.76 cfs 74,791 cf

**Link AP1: Hodgson Brook**

Inflow=55.15 cfs 204,925 cf  
Primary=55.15 cfs 204,925 cf

**Link AP2:**

Inflow=25.02 cfs 124,799 cf  
Primary=25.02 cfs 124,799 cf

**Link AP3:**

Inflow=5.98 cfs 26,046 cf  
Primary=5.98 cfs 26,046 cf

**Total Runoff Area = 648,524 sf Runoff Volume = 396,837 cf Average Runoff Depth = 7.34"**  
**31.65% Pervious = 205,286 sf 68.35% Impervious = 443,238 sf**



## Appendix F3.3

---

Post-Development Hydrologic Analysis:  
Full summary for 10-year storm



**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 8

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>Subcatchment 1:</b>	Runoff Area=11,648 sf 68.94% Impervious Runoff Depth=4.57" Tc=0.0 min CN=91 Runoff=1.66 cfs 4,432 cf
<b>Subcatchment 2:</b>	Runoff Area=6,355 sf 44.36% Impervious Runoff Depth=3.93" Tc=6.0 min CN=85 Runoff=0.66 cfs 2,079 cf
<b>Subcatchment 3:</b>	Runoff Area=17,966 sf 63.26% Impervious Runoff Depth=4.35" Tc=6.0 min CN=89 Runoff=2.03 cfs 6,511 cf
<b>Subcatchment 4:</b>	Runoff Area=14,022 sf 87.36% Impervious Runoff Depth=5.01" Tc=6.0 min CN=95 Runoff=1.73 cfs 5,859 cf
<b>Subcatchment 5:</b>	Runoff Area=1,801 sf 96.84% Impervious Runoff Depth=5.25" Tc=6.0 min CN=97 Runoff=0.23 cfs 787 cf
<b>Subcatchment 6:</b>	Runoff Area=7,003 sf 96.19% Impervious Runoff Depth=5.25" Tc=6.0 min CN=97 Runoff=0.88 cfs 3,061 cf
<b>Subcatchment 7:</b>	Runoff Area=2,462 sf 89.85% Impervious Runoff Depth=5.13" Tc=6.0 min CN=96 Runoff=0.31 cfs 1,052 cf
<b>Subcatchment 8:</b>	Runoff Area=6,973 sf 92.96% Impervious Runoff Depth=5.13" Tc=6.0 min CN=96 Runoff=0.87 cfs 2,981 cf
<b>Subcatchment 9:</b>	Runoff Area=3,616 sf 86.12% Impervious Runoff Depth=5.01" Tc=6.0 min CN=95 Runoff=0.45 cfs 1,511 cf
<b>Subcatchment 10:</b>	Runoff Area=8,901 sf 80.64% Impervious Runoff Depth=4.79" Tc=6.0 min CN=93 Runoff=1.07 cfs 3,552 cf
<b>Subcatchment 10B:</b>	Runoff Area=8,377 sf 79.03% Impervious Runoff Depth=4.79" Tc=6.0 min CN=93 Runoff=1.01 cfs 3,343 cf
<b>Subcatchment 11:</b>	Runoff Area=5,132 sf 50.00% Impervious Runoff Depth=4.03" Tc=6.0 min CN=86 Runoff=0.55 cfs 1,724 cf
<b>Subcatchment 12:</b>	Runoff Area=12,705 sf 65.30% Impervious Runoff Depth=4.46" Tc=6.0 min CN=90 Runoff=1.46 cfs 4,719 cf
<b>Subcatchment 13:</b>	Runoff Area=2,486 sf 78.32% Impervious Runoff Depth=4.79" Tc=6.0 min CN=93 Runoff=0.30 cfs 992 cf
<b>Subcatchment 14:</b>	Runoff Area=5,742 sf 40.56% Impervious Runoff Depth=3.82" Tc=6.0 min CN=84 Runoff=0.58 cfs 1,830 cf
<b>Subcatchment 15:</b>	Runoff Area=27,997 sf 82.23% Impervious Runoff Depth=4.90" Tc=6.0 min CN=94 Runoff=3.41 cfs 11,434 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 9

<b>Subcatchment 16:</b>	Runoff Area=44,751 sf 69.67% Impervious Runoff Depth=4.57" Tc=6.0 min CN=91 Runoff=5.23 cfs 17,029 cf
<b>Subcatchment 17:</b>	Runoff Area=18,629 sf 55.15% Impervious Runoff Depth=4.14" Tc=6.0 min CN=87 Runoff=2.02 cfs 6,420 cf
<b>Subcatchment 18:</b>	Runoff Area=28,518 sf 100.00% Impervious Runoff Depth=5.36" Tc=6.0 min CN=98 Runoff=3.59 cfs 12,744 cf
<b>Subcatchment 19:</b>	Runoff Area=4,108 sf 17.31% Impervious Runoff Depth=3.23" Tc=6.0 min CN=78 Runoff=0.36 cfs 1,105 cf
<b>Subcatchment 20:</b>	Runoff Area=1,524 sf 100.00% Impervious Runoff Depth=5.36" Tc=6.0 min CN=98 Runoff=0.19 cfs 681 cf
<b>Subcatchment 21:</b>	Runoff Area=792 sf 66.04% Impervious Runoff Depth=4.46" Tc=6.0 min CN=90 Runoff=0.09 cfs 294 cf
<b>Subcatchment 22:</b>	Runoff Area=41,854 sf 1.22% Impervious Runoff Depth=2.85" Tc=6.0 min CN=74 Runoff=3.21 cfs 9,946 cf
<b>Subcatchment 23:</b>	Runoff Area=14,462 sf 0.00% Impervious Runoff Depth=2.85" Flow Length=115' Slope=0.0011 '/ Tc=6.0 min CN=74 Runoff=1.11 cfs 3,437 cf
<b>Subcatchment 24:</b>	Runoff Area=6,729 sf 56.26% Impervious Runoff Depth=4.24" Flow Length=176' Tc=6.0 min CN=88 Runoff=0.75 cfs 2,378 cf
<b>Subcatchment 25:</b>	Runoff Area=6,442 sf 34.31% Impervious Runoff Depth=3.62" Tc=0.0 min CN=82 Runoff=0.76 cfs 1,944 cf
<b>Subcatchment 26:</b>	Runoff Area=14,265 sf 86.53% Impervious Runoff Depth=5.01" Tc=0.0 min CN=95 Runoff=2.14 cfs 5,961 cf
<b>Subcatchment 27:</b>	Runoff Area=5,289 sf 76.01% Impervious Runoff Depth=4.68" Flow Length=71' Slope=0.1342 '/ Tc=7.7 min CN=92 Runoff=0.59 cfs 2,061 cf
<b>Subcatchment 28:</b>	Runoff Area=18,464 sf 86.68% Impervious Runoff Depth=5.01" Tc=6.0 min CN=95 Runoff=2.27 cfs 7,716 cf
<b>Subcatchment 29:</b>	Runoff Area=8,912 sf 80.50% Impervious Runoff Depth=4.79" Tc=0.0 min CN=93 Runoff=1.31 cfs 3,556 cf
<b>Subcatchment 30:</b>	Runoff Area=18,830 sf 38.59% Impervious Runoff Depth=3.72" Flow Length=349' Slope=0.0138 '/ Tc=6.0 min CN=83 Runoff=1.87 cfs 5,840 cf
<b>Subcatchment 31:</b>	Runoff Area=15,371 sf 10.01% Impervious Runoff Depth=3.04" Tc=6.0 min CN=76 Runoff=1.26 cfs 3,891 cf
<b>Subcatchment 32:</b>	Runoff Area=37,137 sf 100.00% Impervious Runoff Depth=5.36" Tc=6.0 min CN=98 Runoff=4.68 cfs 16,595 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 10

<b>Subcatchment 34:</b>	Runoff Area=10,350 sf 83.59% Impervious Runoff Depth=4.90" Tc=6.0 min CN=94 Runoff=1.26 cfs 4,227 cf
<b>Subcatchment 35:</b>	Runoff Area=10,664 sf 91.11% Impervious Runoff Depth=5.13" Tc=6.0 min CN=96 Runoff=1.32 cfs 4,558 cf
<b>Subcatchment 36:</b>	Runoff Area=35,753 sf 88.57% Impervious Runoff Depth=5.01" Tc=6.0 min CN=95 Runoff=4.40 cfs 14,940 cf
<b>Subcatchment 37:</b>	Runoff Area=49,536 sf 84.69% Impervious Runoff Depth=4.90" Tc=6.0 min CN=94 Runoff=6.03 cfs 20,230 cf
<b>Subcatchment 38:</b>	Runoff Area=22,151 sf 100.00% Impervious Runoff Depth=5.36" Tc=6.0 min CN=98 Runoff=2.79 cfs 9,898 cf
<b>Subcatchment 39:</b>	Runoff Area=11,218 sf 43.45% Impervious Runoff Depth=3.82" Tc=6.0 min CN=84 Runoff=1.14 cfs 3,574 cf
<b>Subcatchment 40:</b>	Runoff Area=13,195 sf 78.02% Impervious Runoff Depth=4.79" Tc=6.0 min CN=93 Runoff=1.59 cfs 5,265 cf
<b>Subcatchment 41:</b>	Runoff Area=7,175 sf 49.39% Impervious Runoff Depth=4.03" Tc=6.0 min CN=86 Runoff=0.76 cfs 2,410 cf
<b>Subcatchment 42:</b>	Runoff Area=6,762 sf 0.00% Impervious Runoff Depth=2.85" Tc=6.0 min CN=74 Runoff=0.52 cfs 1,607 cf
<b>Subcatchment 43:</b>	Runoff Area=2,510 sf 79.04% Impervious Runoff Depth=4.79" Tc=0.0 min CN=93 Runoff=0.37 cfs 1,002 cf
<b>Subcatchment 44:</b>	Runoff Area=3,738 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.57 cfs 1,670 cf
<b>Subcatchment 45:</b>	Runoff Area=16,888 sf 28.75% Impervious Runoff Depth=3.52" Tc=0.0 min CN=81 Runoff=1.95 cfs 4,955 cf
<b>Subcatchment 46:</b>	Runoff Area=2,200 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.34 cfs 983 cf
<b>Subcatchment 47:</b>	Runoff Area=2,924 sf 67.78% Impervious Runoff Depth=4.46" Tc=0.0 min CN=90 Runoff=0.41 cfs 1,086 cf
<b>Subcatchment 48:</b>	Runoff Area=14,033 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=2.16 cfs 6,271 cf
<b>Subcatchment 49:</b>	Runoff Area=417 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.06 cfs 186 cf
<b>Subcatchment 50:</b>	Runoff Area=3,520 sf 100.00% Impervious Runoff Depth=5.36" Tc=0.0 min CN=98 Runoff=0.54 cfs 1,573 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 11

**Subcatchment 51:** Runoff Area=1,846 sf 100.00% Impervious Runoff Depth=5.36"  
Tc=0.0 min CN=98 Runoff=0.28 cfs 825 cf

**Subcatchment 52:** Runoff Area=4,381 sf 100.00% Impervious Runoff Depth=5.36"  
Tc=0.0 min CN=98 Runoff=0.67 cfs 1,958 cf

**Reach R1: Swale** Avg. Flow Depth=0.60' Max Vel=3.51 fps Inflow=12.27 cfs 47,410 cf  
n=0.035 L=100.0' S=0.0200 '/ Capacity=333.24 cfs Outflow=12.23 cfs 47,410 cf

**Reach TB:** Inflow=3.05 cfs 9,695 cf  
Outflow=3.05 cfs 9,695 cf

**Pond 27 BRB1:** Peak Elev=16.01' Storage=565 cf Inflow=0.55 cfs 1,724 cf  
Outflow=0.09 cfs 1,724 cf

**Pond 30 DB1:** Peak Elev=14.42' Storage=1,250 cf Inflow=2.60 cfs 8,920 cf  
Primary=1.03 cfs 957 cf Secondary=0.83 cfs 7,961 cf Outflow=1.84 cfs 8,918 cf

**Pond 36 DB2:** Peak Elev=17.23' Storage=470 cf Inflow=1.17 cfs 4,033 cf  
Primary=0.00 cfs 0 cf Secondary=0.71 cfs 4,032 cf Outflow=0.71 cfs 4,032 cf

**Pond 41 BRB2:** Peak Elev=18.15' Storage=1,113 cf Inflow=1.46 cfs 4,719 cf  
Outflow=0.89 cfs 4,719 cf

**Pond 50 IB3:** Peak Elev=19.92' Storage=11,574 cf Inflow=10.66 cfs 34,882 cf  
Discarded=0.60 cfs 19,218 cf Primary=3.11 cfs 15,665 cf Outflow=3.71 cfs 34,882 cf

**Pond 58 IB2:** Peak Elev=19.64' Storage=2,492 cf Inflow=3.59 cfs 12,744 cf  
Discarded=0.13 cfs 5,691 cf Primary=2.36 cfs 7,053 cf Outflow=2.49 cfs 12,744 cf

**Pond 60 RD B:** Peak Elev=90.05' Inflow=3.59 cfs 12,744 cf  
6.0" Round Culvert n=0.013 L=116.0' S=0.0050 '/ Outflow=3.59 cfs 12,744 cf

**Pond 60 WQU 2:** Peak Elev=203.84' Inflow=13.02 cfs 43,956 cf  
12.0" Round Culvert n=0.013 L=90.0' S=0.0050 '/ Outflow=13.02 cfs 43,956 cf

**Pond 1071:** Peak Elev=187.35' Inflow=15.74 cfs 52,795 cf  
12.0" Round Culvert n=0.025 L=31.0' S=0.0065 '/ Outflow=15.74 cfs 52,795 cf

**Pond 1072:** Peak Elev=157.45' Inflow=19.29 cfs 65,104 cf  
15.0" Round Culvert n=0.025 L=31.0' S=0.0387 '/ Outflow=19.29 cfs 65,104 cf

**Pond 1346:** Peak Elev=69.04' Inflow=19.29 cfs 65,104 cf  
15.0" Round Culvert n=0.025 L=143.0' S=0.0070 '/ Outflow=19.29 cfs 65,104 cf

**Pond 1347:** Peak Elev=141.87' Inflow=19.29 cfs 65,104 cf  
15.0" Round Culvert n=0.025 L=204.0' S=0.0005 '/ Outflow=19.29 cfs 65,104 cf

**Pond CB10:** Peak Elev=20.25' Inflow=2.27 cfs 7,716 cf  
12.0" Round Culvert n=0.013 L=56.0' S=0.0089 '/ Outflow=2.27 cfs 7,716 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 12

<b>Pond CB12:</b>	Peak Elev=20.34' Inflow=1.31 cfs 3,556 cf 12.0" Round Culvert n=0.013 L=7.5' S=0.0573 '/' Outflow=1.31 cfs 3,556 cf
<b>Pond CB13:</b>	Peak Elev=20.54' Inflow=1.87 cfs 5,840 cf 12.0" Round Culvert n=0.013 L=7.5' S=0.0573 '/' Outflow=1.87 cfs 5,840 cf
<b>Pond CB16:</b>	Peak Elev=21.54' Inflow=1.26 cfs 3,891 cf 12.0" Round Culvert n=0.013 L=65.0' S=0.0049 '/' Outflow=1.26 cfs 3,891 cf
<b>Pond CB23:</b>	Peak Elev=13.61' Inflow=0.45 cfs 1,511 cf 12.0" Round Culvert n=0.013 L=15.5' S=0.0045 '/' Outflow=0.45 cfs 1,511 cf
<b>Pond CB24:</b>	Peak Elev=14.16' Inflow=0.23 cfs 787 cf 12.0" Round Culvert n=0.013 L=39.5' S=0.0099 '/' Outflow=0.23 cfs 787 cf
<b>Pond CB26:</b>	Peak Elev=13.54' Inflow=1.07 cfs 3,552 cf 12.0" Round Culvert n=0.013 L=14.0' S=0.0571 '/' Outflow=1.07 cfs 3,552 cf
<b>Pond CB33:</b>	Peak Elev=16.22' Inflow=1.73 cfs 5,859 cf 12.0" Round Culvert n=0.013 L=63.5' S=0.0055 '/' Outflow=1.73 cfs 5,859 cf
<b>Pond CB34:</b>	Peak Elev=16.15' Inflow=0.88 cfs 3,061 cf 12.0" Round Culvert n=0.013 L=24.0' S=0.0146 '/' Outflow=0.88 cfs 3,061 cf
<b>Pond CB38:</b>	Peak Elev=18.54' Inflow=0.31 cfs 1,052 cf 12.0" Round Culvert n=0.013 L=5.0' S=0.0100 '/' Outflow=0.31 cfs 1,052 cf
<b>Pond CB39:</b>	Peak Elev=19.56' Inflow=0.87 cfs 2,981 cf 12.0" Round Culvert n=0.013 L=53.0' S=0.0049 '/' Outflow=0.87 cfs 2,981 cf
<b>Pond CB4:</b>	Peak Elev=19.30' Inflow=0.75 cfs 2,378 cf 12.0" Round Culvert n=0.013 L=24.5' S=0.0347 '/' Outflow=0.75 cfs 2,378 cf
<b>Pond CB43:</b>	Peak Elev=14.36' Inflow=1.01 cfs 3,343 cf 12.0" Round Culvert n=0.013 L=9.9' S=0.0495 '/' Outflow=1.01 cfs 3,343 cf
<b>Pond CB45:</b>	Peak Elev=19.88' Inflow=0.58 cfs 1,830 cf 12.0" Round Culvert n=0.013 L=15.0' S=0.0667 '/' Outflow=0.58 cfs 1,830 cf
<b>Pond CB46:</b>	Peak Elev=19.77' Inflow=0.30 cfs 992 cf 12.0" Round Culvert n=0.013 L=15.0' S=0.0667 '/' Outflow=0.30 cfs 992 cf
<b>Pond CB5:</b>	Peak Elev=19.26' Inflow=1.06 cfs 3,551 cf 12.0" Round Culvert n=0.010 L=33.5' S=0.0051 '/' Outflow=1.06 cfs 3,551 cf
<b>Pond CB53:</b>	Peak Elev=24.05' Inflow=3.41 cfs 11,434 cf 12.0" Round Culvert n=0.013 L=86.0' S=0.0050 '/' Outflow=3.41 cfs 11,434 cf
<b>Pond CB55:</b>	Peak Elev=25.56' Inflow=5.23 cfs 17,029 cf 12.0" Round Culvert n=0.013 L=44.0' S=0.0050 '/' Outflow=5.23 cfs 17,029 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 13

<b>Pond CB56:</b>	Peak Elev=24.02' Inflow=2.02 cfs 6,420 cf 12.0" Round Culvert n=0.013 L=69.0' S=0.0122 '/ Outflow=2.02 cfs 6,420 cf
<b>Pond CB6:</b>	Peak Elev=19.61' Inflow=0.59 cfs 2,061 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0262 '/ Outflow=0.59 cfs 2,061 cf
<b>Pond CB61:</b>	Peak Elev=7.79' Inflow=1.95 cfs 4,955 cf 12.0" Round Culvert n=0.013 L=65.0' S=0.0095 '/ Outflow=1.95 cfs 4,955 cf
<b>Pond CB62:</b>	Peak Elev=5.36' Inflow=0.34 cfs 983 cf 12.0" Round Culvert n=0.013 L=6.7' S=0.0104 '/ Outflow=0.34 cfs 983 cf
<b>Pond CB63:</b>	Peak Elev=6.07' Inflow=0.37 cfs 1,002 cf 12.0" Round Culvert n=0.013 L=13.4' S=0.0097 '/ Outflow=0.37 cfs 1,002 cf
<b>Pond CB65:</b>	Peak Elev=236.04' Inflow=6.03 cfs 20,230 cf 12.0" Round Culvert n=0.013 L=50.0' S=0.0050 '/ Outflow=6.03 cfs 20,230 cf
<b>Pond CB67:</b>	Peak Elev=243.66' Inflow=4.40 cfs 14,940 cf 12.0" Round Culvert n=0.013 L=3.5' S=0.0086 '/ Outflow=4.40 cfs 14,940 cf
<b>Pond CB69:</b>	Peak Elev=243.17' Inflow=1.32 cfs 4,558 cf 12.0" Round Culvert n=0.013 L=7.5' S=0.0053 '/ Outflow=1.32 cfs 4,558 cf
<b>Pond CB7:</b>	Peak Elev=19.64' Inflow=2.14 cfs 5,961 cf 12.0" Round Culvert n=0.013 L=16.5' S=0.0479 '/ Outflow=2.14 cfs 5,961 cf
<b>Pond CB70:</b>	Peak Elev=243.17' Inflow=1.26 cfs 4,227 cf 12.0" Round Culvert n=0.013 L=52.0' S=0.0050 '/ Outflow=1.26 cfs 4,227 cf
<b>Pond E2347:</b>	Peak Elev=10.73' Inflow=1.66 cfs 4,432 cf 15.0" Round Culvert n=0.013 L=72.5' S=-0.0014 '/ Outflow=1.66 cfs 4,432 cf
<b>Pond E2348:</b>	Peak Elev=10.54' Inflow=2.24 cfs 6,103 cf 15.0" Round Culvert n=0.013 L=15.1' S=0.0464 '/ Outflow=2.24 cfs 6,103 cf
<b>Pond E2349:</b>	Peak Elev=6.07' Inflow=12.19 cfs 61,228 cf 24.0" Round Culvert n=0.013 L=82.7' S=0.0050 '/ Outflow=12.19 cfs 61,228 cf
<b>Pond E3578A:</b>	Peak Elev=9.50' Inflow=0.67 cfs 1,958 cf 8.0" Round Culvert n=0.012 L=11.2' S=0.0982 '/ Outflow=0.67 cfs 1,958 cf
<b>Pond E3579:</b>	Peak Elev=4.19' Inflow=14.18 cfs 72,393 cf 36.0" Round Culvert n=0.015 L=205.5' S=0.0010 '/ Outflow=14.18 cfs 72,393 cf
<b>Pond E3600:</b>	Peak Elev=7.62' Inflow=0.06 cfs 186 cf 12.0" Round Culvert n=0.012 L=21.4' S=0.2570 '/ Outflow=0.06 cfs 186 cf
<b>Pond E3672:</b>	Peak Elev=8.24' Inflow=0.00 cfs 0 cf 4.0" Round Culvert n=0.012 L=13.9' S=0.0000 '/ Outflow=0.00 cfs 0 cf



**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 14

<b>Pond E3693:</b>	Peak Elev=8.27' Inflow=0.54 cfs 1,573 cf 12.0" Round Culvert n=0.012 L=27.1' S=0.2177 '/ Outflow=0.54 cfs 1,573 cf
<b>Pond E3756:</b>	Peak Elev=8.21' Inflow=0.67 cfs 1,958 cf 12.0" Round Culvert n=0.012 L=23.2' S=0.2500 '/ Outflow=0.67 cfs 1,958 cf
<b>Pond E3758:</b>	Peak Elev=8.59' Inflow=0.67 cfs 1,958 cf 12.0" Round Culvert n=0.012 L=10.2' S=0.0000 '/ Outflow=0.67 cfs 1,958 cf
<b>Pond E3760:</b>	Peak Elev=8.49' Inflow=0.67 cfs 1,958 cf 12.0" Round Culvert n=0.012 L=32.7' S=0.0061 '/ Outflow=0.67 cfs 1,958 cf
<b>Pond E3772:</b>	Peak Elev=5.36' Inflow=12.31 cfs 62,212 cf 24.0" Round Culvert n=0.013 L=81.8' S=0.0050 '/ Outflow=12.31 cfs 62,212 cf
<b>Pond E3866:</b>	Peak Elev=5.75' Inflow=3.05 cfs 9,695 cf Primary=0.73 cfs 684 cf Secondary=2.33 cfs 9,011 cf Outflow=3.05 cfs 9,695 cf
<b>Pond E3895:</b>	Peak Elev=0.00' 4.0" Round Culvert n=0.012 L=37.1' S=0.0270 '/ Primary=0.00 cfs 0 cf
<b>Pond E4034:</b>	Peak Elev=7.76' Inflow=0.28 cfs 825 cf 12.0" Round Culvert n=0.012 L=14.8' S=0.3716 '/ Outflow=0.28 cfs 825 cf
<b>Pond E4035:</b>	Peak Elev=3.53' Inflow=14.18 cfs 72,393 cf 42.0" Round Culvert n=0.012 L=139.6' S=0.0057 '/ Outflow=14.18 cfs 72,393 cf
<b>Pond E4081:</b>	Peak Elev=7.09' Inflow=2.16 cfs 6,271 cf 12.0" Round Culvert n=0.013 L=13.0' S=0.0077 '/ Outflow=2.15 cfs 6,271 cf
<b>Pond E4082:</b>	Peak Elev=6.78' Inflow=2.15 cfs 6,271 cf 12.0" Round Culvert n=0.013 L=11.1' S=0.0180 '/ Outflow=2.15 cfs 6,271 cf
<b>Pond E4083:</b>	Peak Elev=5.56' Inflow=3.99 cfs 16,368 cf 42.0" x 24.0" Box Culvert n=0.025 L=25.4' S=0.0098 '/ Outflow=3.99 cfs 16,368 cf
<b>Pond E4093:</b>	Peak Elev=6.22' Inflow=0.41 cfs 1,086 cf 12.0" Round Culvert n=0.013 L=13.7' S=0.0219 '/ Outflow=0.41 cfs 1,086 cf
<b>Pond E4604:</b>	Peak Elev=2.80' Inflow=14.18 cfs 72,393 cf 42.0" Round Culvert n=0.012 L=18.1' S=0.0110 '/ Outflow=14.18 cfs 72,394 cf
<b>Pond HW5A: HEADWALL INLET</b>	Peak Elev=19.47' Inflow=0.52 cfs 1,607 cf 12.0" Round Culvert n=0.013 L=39.0' S=0.0333 '/ Outflow=0.52 cfs 1,607 cf
<b>Pond IB1:</b>	Peak Elev=22.20' Storage=4,500 cf Inflow=4.68 cfs 16,595 cf Discarded=0.13 cfs 7,576 cf Primary=2.39 cfs 9,020 cf Outflow=2.52 cfs 16,596 cf
<b>Pond M11:</b>	Peak Elev=20.32' Inflow=5.52 cfs 22,307 cf 18.0" Round Culvert n=0.013 L=101.0' S=0.0050 '/ Outflow=5.52 cfs 22,307 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 15

<b>Pond M14:</b>	Peak Elev=20.66'	Inflow=3.16 cfs	12,911 cf
	18.0" Round Culvert n=0.013 L=160.0' S=0.0050 '/'	Outflow=3.16 cfs	12,911 cf
<b>Pond M15:</b>	Peak Elev=21.15'	Inflow=3.16 cfs	12,911 cf
	18.0" Round Culvert n=0.013 L=122.0' S=0.0052 '/'	Outflow=3.16 cfs	12,911 cf
<b>Pond M17:</b>	Peak Elev=21.97'	Inflow=2.39 cfs	9,020 cf
	12.0" Round Culvert n=0.013 L=81.0' S=0.0049 '/'	Outflow=2.39 cfs	9,020 cf
<b>Pond M19:</b>	Peak Elev=47.31'	Inflow=4.68 cfs	16,595 cf
	6.0" Round Culvert n=0.013 L=2.0' S=0.0300 '/'	Outflow=4.68 cfs	16,595 cf
<b>Pond M2:</b>	Peak Elev=18.68'	Inflow=11.16 cfs	43,974 cf
	24.0" Round Culvert n=0.013 L=10.0' S=0.0040 '/'	Outflow=11.18 cfs	43,974 cf
<b>Pond M21:</b>	Peak Elev=11.35'	Inflow=11.22 cfs	54,124 cf
	24.0" Round Culvert n=0.013 L=116.8' S=0.0494 '/'	Outflow=11.22 cfs	54,124 cf
<b>Pond M22:</b>	Peak Elev=12.38'	Inflow=11.22 cfs	54,124 cf
	24.0" Round Culvert n=0.013 L=67.1' S=0.0125 '/'	Outflow=11.22 cfs	54,124 cf
<b>Pond M25:</b>	Peak Elev=13.01'	Inflow=10.71 cfs	51,826 cf
	24.0" Round Culvert n=0.013 L=54.0' S=0.0050 '/'	Outflow=10.71 cfs	51,826 cf
<b>Pond M28:</b>	Peak Elev=13.46'	Inflow=2.55 cfs	12,950 cf
	18.0" Round Culvert n=0.013 L=51.5' S=0.0050 '/'	Outflow=2.55 cfs	12,950 cf
<b>Pond M29:</b>	Peak Elev=13.69'	Inflow=1.84 cfs	8,918 cf
	12.0" Round Culvert n=0.013 L=6.0' S=0.0050 '/'	Outflow=1.84 cfs	8,918 cf
<b>Pond M3:</b>	Peak Elev=19.21'	Inflow=11.16 cfs	43,974 cf
	24.0" Round Culvert n=0.013 L=70.5' S=0.0050 '/'	Outflow=11.16 cfs	43,974 cf
<b>Pond M31:</b>	Peak Elev=15.50'	Inflow=2.60 cfs	8,920 cf
	12.0" Round Culvert n=0.013 L=2.0' S=0.0300 '/'	Outflow=2.60 cfs	8,920 cf
<b>Pond M32:</b>	Peak Elev=15.98'	Inflow=2.60 cfs	8,920 cf
	12.0" Round Culvert n=0.013 L=5.0' S=0.0100 '/'	Outflow=2.60 cfs	8,920 cf
<b>Pond M35:</b>	Peak Elev=16.66'	Inflow=0.71 cfs	4,032 cf
	12.0" Round Culvert n=0.013 L=43.0' S=0.0049 '/'	Outflow=0.71 cfs	4,032 cf
<b>Pond M37:</b>	Peak Elev=18.51'	Inflow=1.17 cfs	4,033 cf
	12.0" Round Culvert n=0.013 L=2.0' S=0.0300 '/'	Outflow=1.17 cfs	4,033 cf
<b>Pond M40:</b>	Peak Elev=13.50'	Inflow=7.31 cfs	33,600 cf
	24.0" Round Culvert n=0.013 L=116.5' S=0.0050 '/'	Outflow=7.31 cfs	33,600 cf
<b>Pond M42:</b>	Peak Elev=14.15'	Inflow=6.45 cfs	28,881 cf
	18.0" Round Culvert n=0.013 L=93.5' S=0.0050 '/'	Outflow=6.45 cfs	28,881 cf

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 16

<b>Pond M44:</b>	Peak Elev=14.82'	Inflow=5.75 cfs	25,539 cf
18.0" Round Culvert	n=0.013	L=133.0'	S=0.0050 '/ Outflow=5.75 cfs 25,539 cf
<b>Pond M47:</b>	Peak Elev=15.61'	Inflow=5.22 cfs	22,717 cf
18.0" Round Culvert	n=0.013	L=119.5'	S=0.0050 '/ Outflow=5.22 cfs 22,717 cf
<b>Pond M48:</b>	Peak Elev=16.01'	Inflow=5.22 cfs	22,717 cf
18.0" Round Culvert	n=0.013	L=34.5'	S=0.0049 '/ Outflow=5.22 cfs 22,717 cf
<b>Pond M49:</b>	Peak Elev=16.64'	Inflow=3.11 cfs	15,665 cf
12.0" Round Culvert	n=0.013	L=6.5'	S=0.0154 '/ Outflow=3.11 cfs 15,665 cf
<b>Pond M51:</b>	Peak Elev=21.29'	Inflow=10.66 cfs	34,882 cf
18.0" Round Culvert	n=0.013	L=2.0'	S=0.0000 '/ Outflow=10.66 cfs 34,882 cf
<b>Pond M52:</b>	Peak Elev=22.85'	Inflow=10.66 cfs	34,882 cf
18.0" Round Culvert	n=0.013	L=5.0'	S=0.0100 '/ Outflow=10.66 cfs 34,882 cf
<b>Pond M54:</b>	Peak Elev=23.66'	Inflow=7.25 cfs	23,449 cf
18.0" Round Culvert	n=0.013	L=91.0'	S=0.0049 '/ Outflow=7.25 cfs 23,449 cf
<b>Pond M57:</b>	Peak Elev=16.92'	Inflow=2.36 cfs	7,053 cf
12.0" Round Culvert	n=0.013	L=160.5'	S=0.0050 '/ Outflow=2.36 cfs 7,053 cf
<b>Pond M59:</b>	Peak Elev=34.78'	Inflow=3.59 cfs	12,744 cf
6.0" Round Culvert	n=0.013	L=3.0'	S=0.0200 '/ Outflow=3.59 cfs 12,744 cf
<b>Pond M6:</b>	Peak Elev=19.59'	Inflow=9.47 cfs	38,045 cf
24.0" Round Culvert	n=0.013	L=36.0'	S=0.0050 '/ Outflow=9.47 cfs 38,045 cf
<b>Pond M63:</b>	Peak Elev=213.72'	Inflow=13.02 cfs	43,956 cf
12.0" Round Culvert	n=0.013	L=3.0'	S=0.0100 '/ Outflow=13.02 cfs 43,956 cf
<b>Pond M64:</b>	Peak Elev=234.04'	Inflow=13.02 cfs	43,956 cf
12.0" Round Culvert	n=0.013	L=147.5'	S=0.0050 '/ Outflow=13.02 cfs 43,956 cf
<b>Pond M66:</b>	Peak Elev=242.79'	Inflow=6.99 cfs	23,726 cf
12.0" Round Culvert	n=0.013	L=269.5'	S=0.0050 '/ Outflow=6.99 cfs 23,726 cf
<b>Pond M68:</b>	Peak Elev=243.10'	Inflow=2.58 cfs	8,786 cf
12.0" Round Culvert	n=0.013	L=45.0'	S=0.0049 '/ Outflow=2.58 cfs 8,786 cf
<b>Pond M9:</b>	Peak Elev=19.85'	Inflow=7.78 cfs	30,023 cf
24.0" Round Culvert	n=0.013	L=56.5'	S=0.0050 '/ Outflow=7.78 cfs 30,023 cf
<b>Pond RD 20:</b>	Peak Elev=71.60'	Inflow=4.68 cfs	16,595 cf
6.0" Round Culvert	n=0.013	L=15.5'	S=0.0052 '/ Outflow=4.68 cfs 16,595 cf
<b>Pond RD69:</b>	Peak Elev=168.97'	Inflow=2.79 cfs	9,898 cf
6.0" Round Culvert	n=0.013	L=31.0'	S=0.0052 '/ Outflow=2.79 cfs 9,898 cf

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 17

**Pond WQS1:**

Peak Elev=18.14' Inflow=11.18 cfs 43,974 cf  
24.0" Round Culvert n=0.013 L=25.0' S=0.0048 '/ Outflow=11.19 cfs 43,974 cf

**Link AP1: Hodgson Brook**

Inflow=34.99 cfs 123,435 cf  
Primary=34.99 cfs 123,435 cf

**Link AP2:**

Inflow=14.18 cfs 72,394 cf  
Primary=14.18 cfs 72,394 cf

**Link AP3:**

Inflow=3.99 cfs 16,368 cf  
Primary=3.99 cfs 16,368 cf

**Total Runoff Area = 648,524 sf Runoff Volume = 244,681 cf Average Runoff Depth = 4.53"**  
**31.65% Pervious = 205,286 sf 68.35% Impervious = 443,238 sf**

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 18

**Summary for Subcatchment 1:**


Runoff = 1.66 cfs @ 12.00 hrs, Volume= 4,432 cf, Depth= 4.57"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,618	74	>75% Grass cover, Good, HSG C
8,030	98	Paved parking, HSG C
11,648	91	Weighted Average
3,618		31.06% Pervious Area
8,030		68.94% Impervious Area

**Subcatchment 1:**

**Hydrograph**

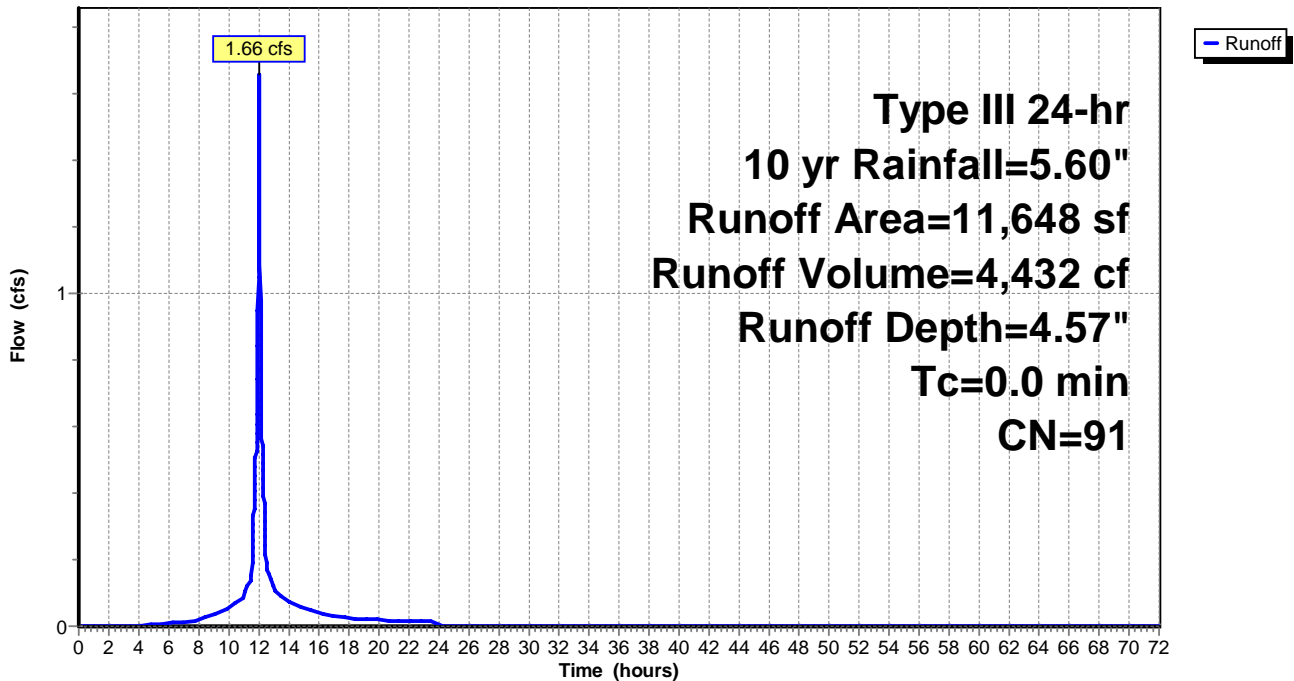

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 19

**Summary for Subcatchment 2:**

Runoff = 0.66 cfs @ 12.09 hrs, Volume= 2,079 cf, Depth= 3.93"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
2,819	98	Paved parking, HSG C
3,536	74	>75% Grass cover, Good, HSG C
6,355	85	Weighted Average
3,536		55.64% Pervious Area
2,819		44.36% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 2:**

**Hydrograph**

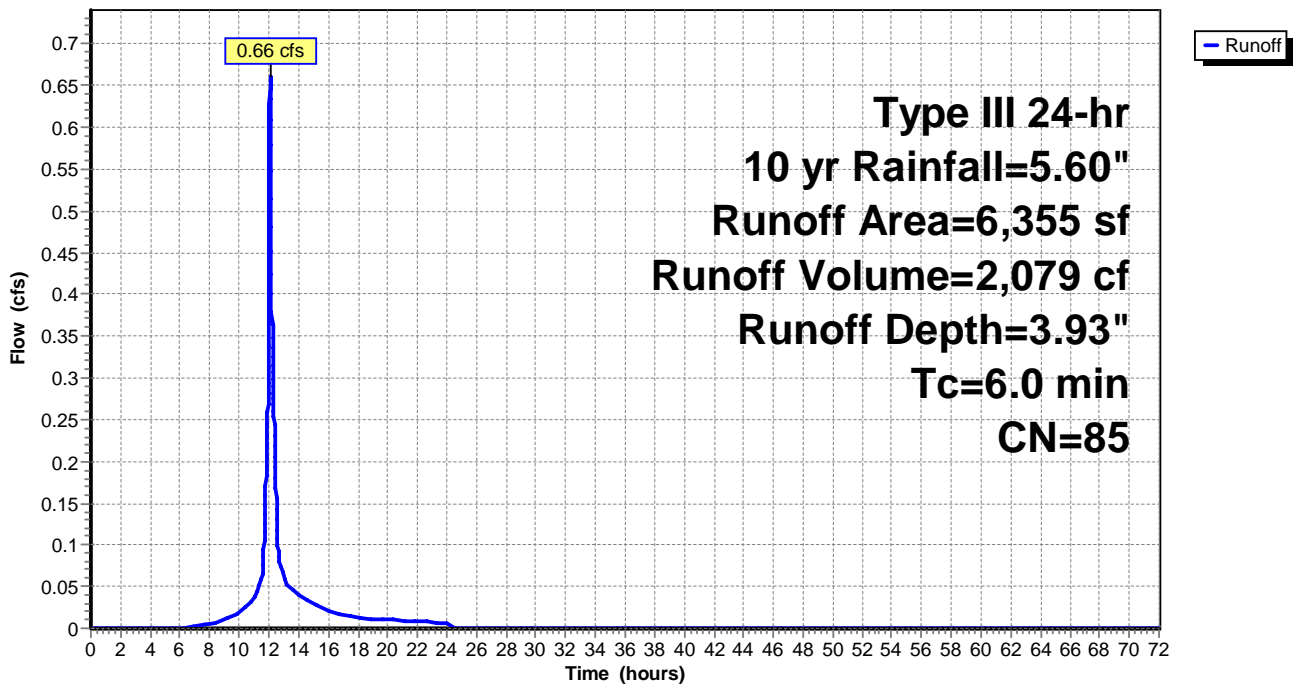

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 20

**Summary for Subcatchment 3:**

Runoff = 2.03 cfs @ 12.09 hrs, Volume= 6,511 cf, Depth= 4.35"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
11,365	98	Paved parking, HSG C
6,601	74	>75% Grass cover, Good, HSG C
17,966	89	Weighted Average
6,601		36.74% Pervious Area
11,365		63.26% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 3:**

**Hydrograph**

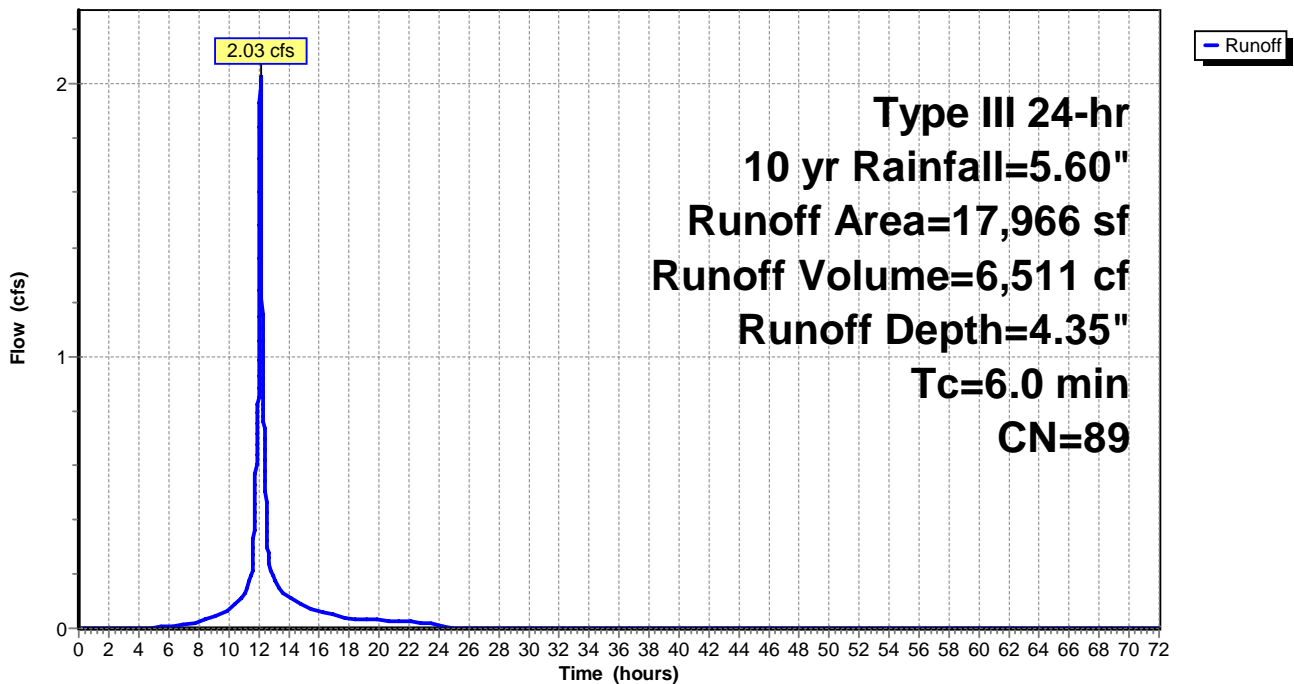

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 21

**Summary for Subcatchment 4:**

Runoff = 1.73 cfs @ 12.08 hrs, Volume= 5,859 cf, Depth= 5.01"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
12,250	98	Paved parking, HSG C
1,772	74	>75% Grass cover, Good, HSG C
14,022	95	Weighted Average
1,772		12.64% Pervious Area
12,250		87.36% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 4:**

**Hydrograph**

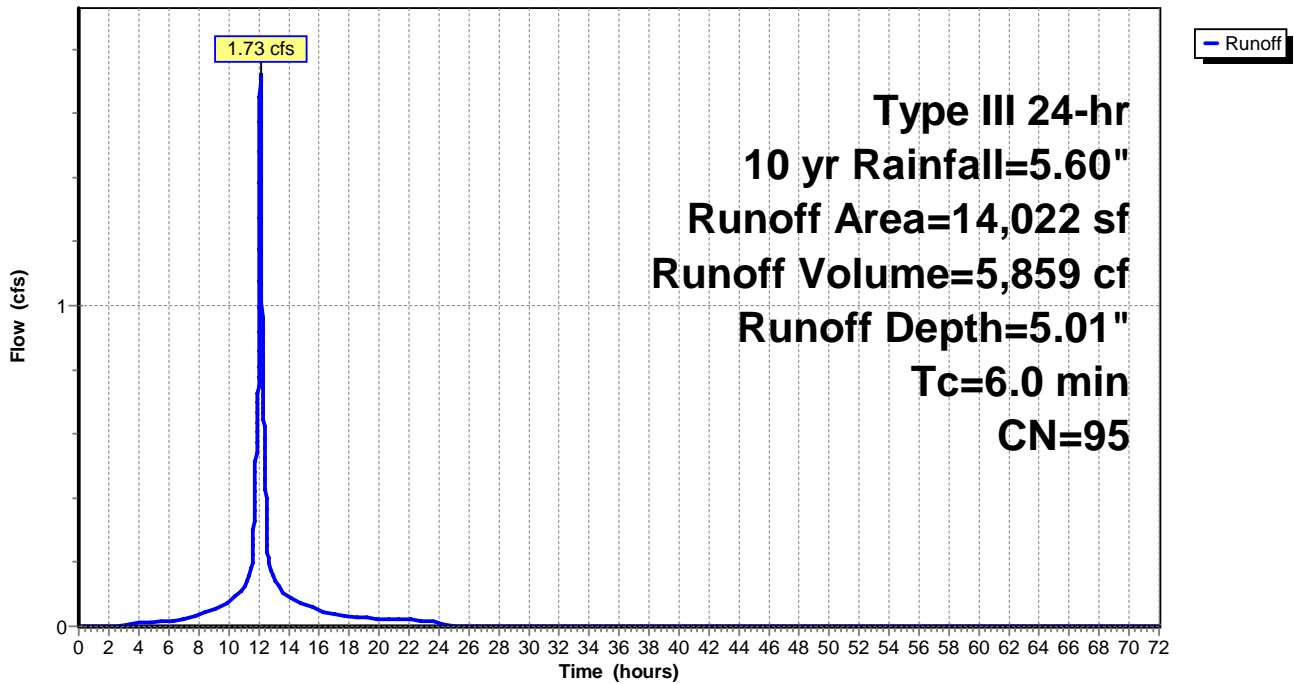



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 22

**Summary for Subcatchment 5:**

Runoff = 0.23 cfs @ 12.08 hrs, Volume= 787 cf, Depth= 5.25"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,744	98	Paved parking, HSG C
57	74	>75% Grass cover, Good, HSG C
1,801	97	Weighted Average
57		3.16% Pervious Area
1,744		96.84% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 5:**

**Hydrograph**

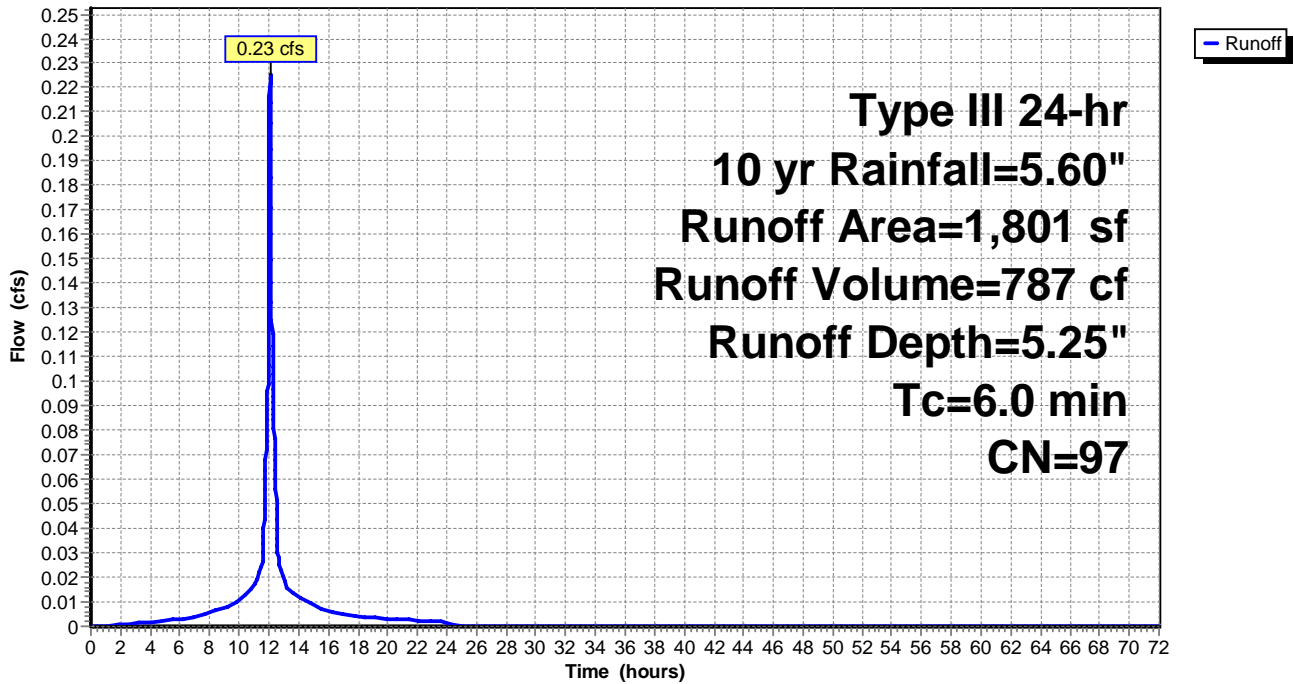

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 23

**Summary for Subcatchment 6:**

Runoff = 0.88 cfs @ 12.08 hrs, Volume= 3,061 cf, Depth= 5.25"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
6,736	98	Paved parking, HSG C
267	74	>75% Grass cover, Good, HSG C
7,003	97	Weighted Average
267		3.81% Pervious Area
6,736		96.19% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 6:**

**Hydrograph**

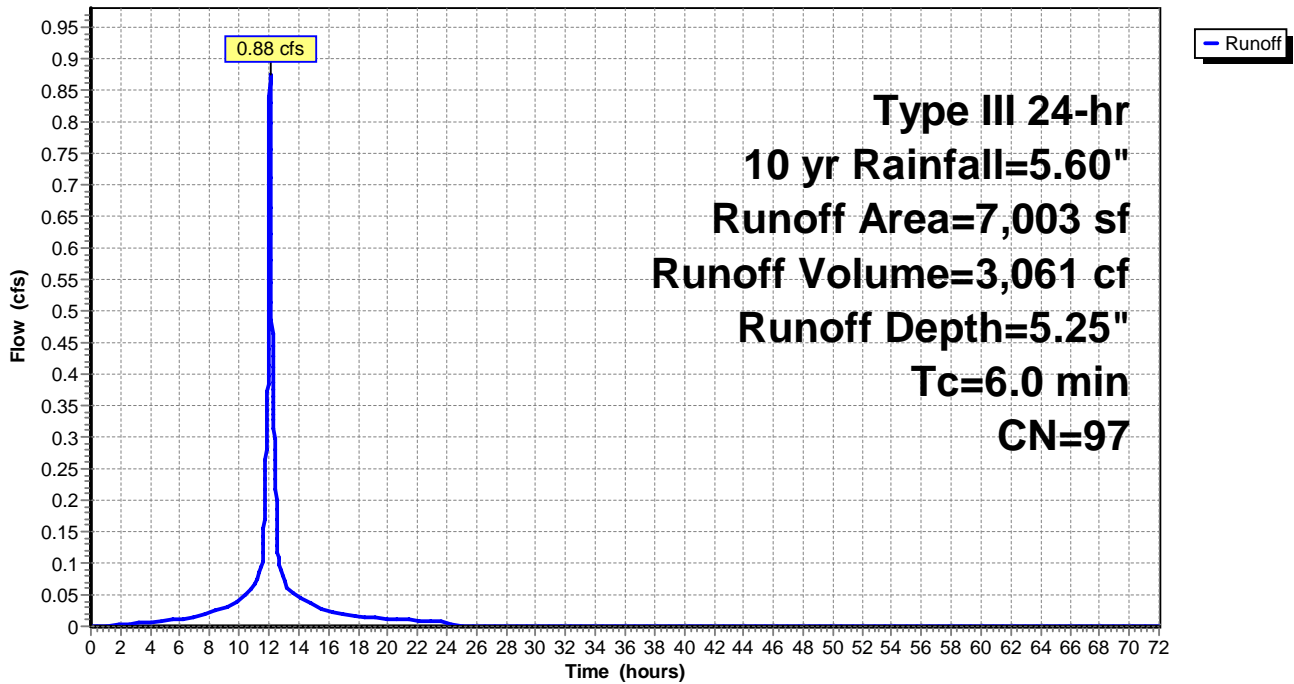

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 24

**Summary for Subcatchment 7:**

Runoff = 0.31 cfs @ 12.08 hrs, Volume= 1,052 cf, Depth= 5.13"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
2,212	98	Paved parking, HSG C
250	74	>75% Grass cover, Good, HSG C
2,462	96	Weighted Average
250		10.15% Pervious Area
2,212		89.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 7:**

**Hydrograph**

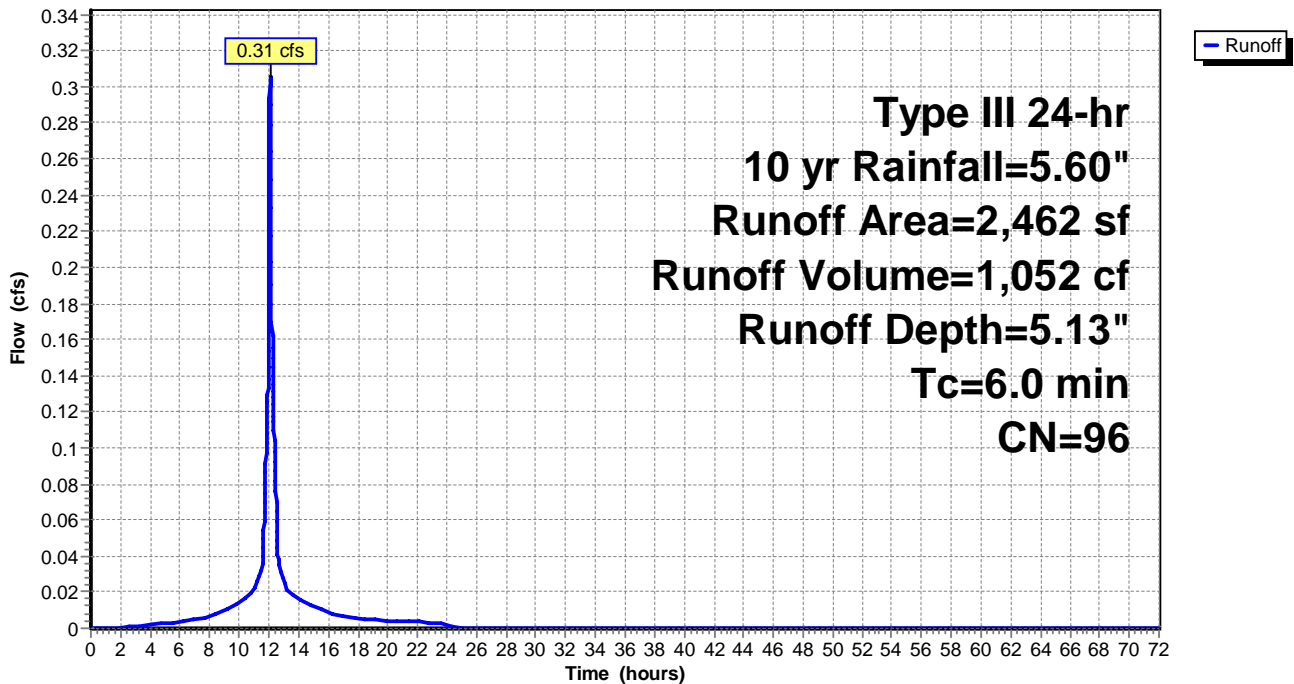

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 25

**Summary for Subcatchment 8:**

Runoff = 0.87 cfs @ 12.08 hrs, Volume= 2,981 cf, Depth= 5.13"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
6,482	98	Paved parking, HSG C
491	74	>75% Grass cover, Good, HSG C
6,973	96	Weighted Average
491		7.04% Pervious Area
6,482		92.96% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 8:**

**Hydrograph**

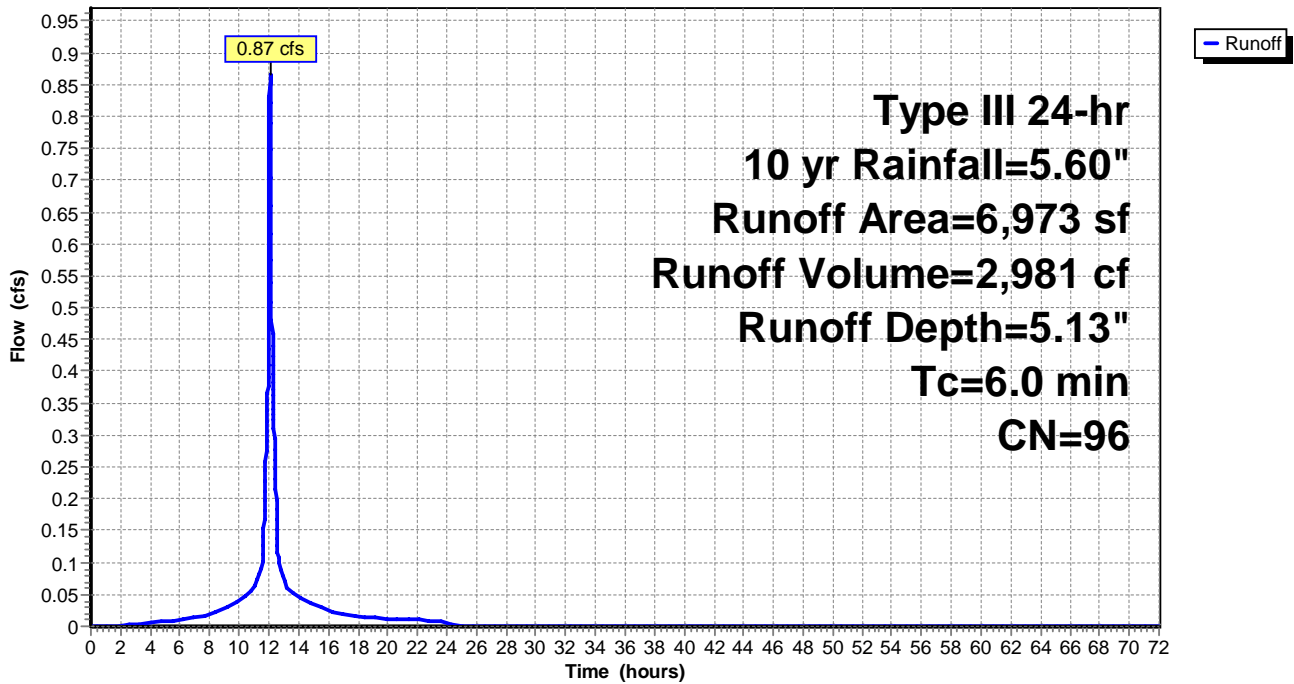

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 26

**Summary for Subcatchment 9:**

Runoff = 0.45 cfs @ 12.08 hrs, Volume= 1,511 cf, Depth= 5.01"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,114	98	Paved parking, HSG C
502	74	>75% Grass cover, Good, HSG C
3,616	95	Weighted Average
502		13.88% Pervious Area
3,114		86.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 9:**

**Hydrograph**

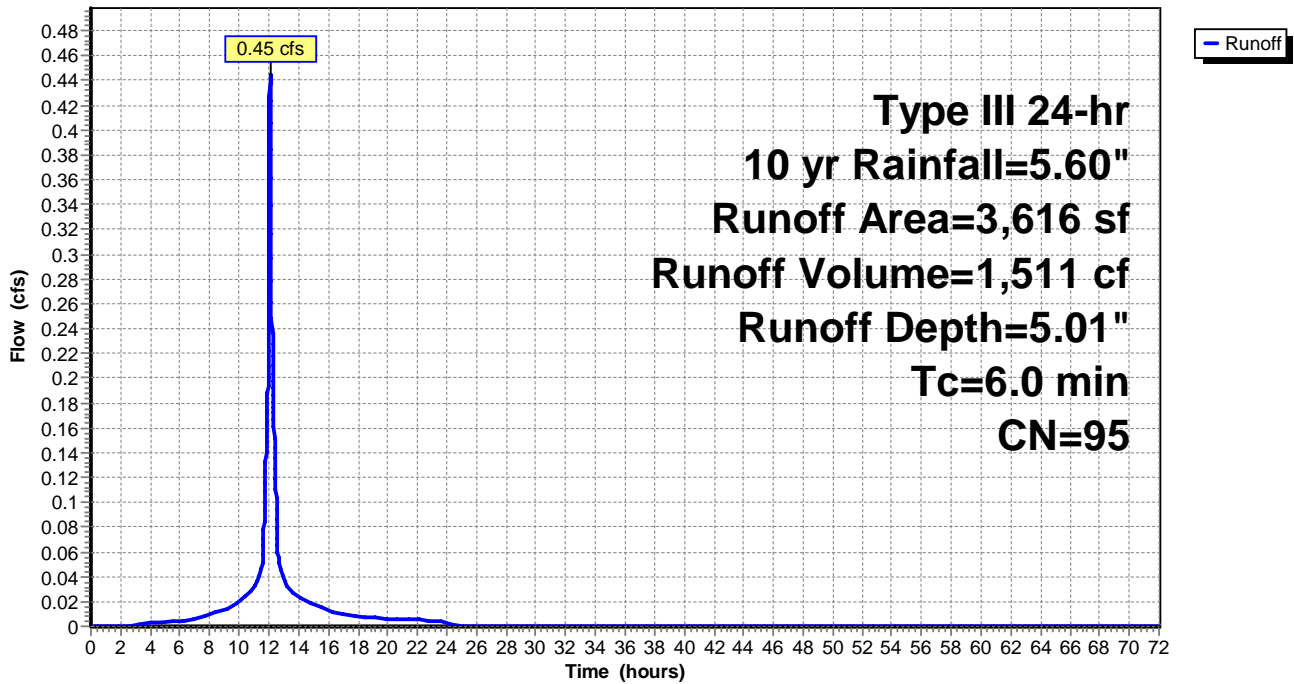

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 27

**Summary for Subcatchment 10:**

Runoff = 1.07 cfs @ 12.08 hrs, Volume= 3,552 cf, Depth= 4.79"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
7,178	98	Paved parking, HSG C
1,723	74	>75% Grass cover, Good, HSG C
8,901	93	Weighted Average
1,723		19.36% Pervious Area
7,178		80.64% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 10:**

**Hydrograph**

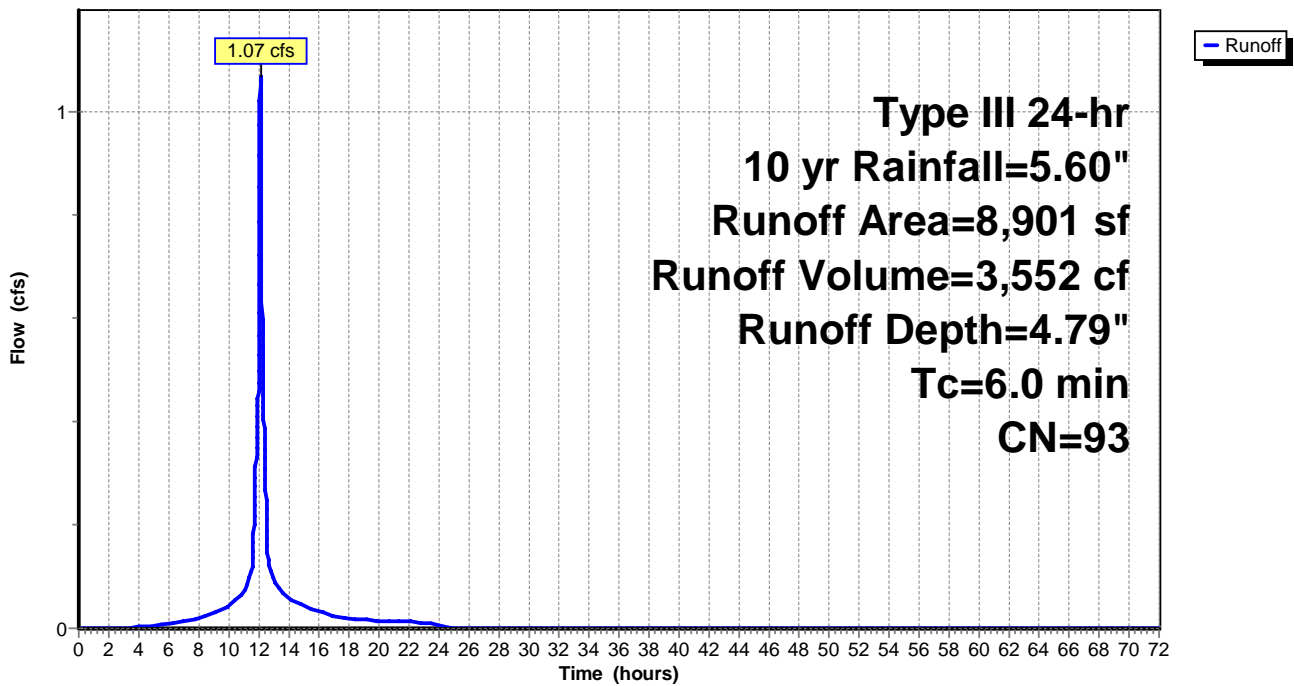

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 28

**Summary for Subcatchment 10B:**

Runoff = 1.01 cfs @ 12.08 hrs, Volume= 3,343 cf, Depth= 4.79"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
6,620	98	Paved parking, HSG C
1,757	74	>75% Grass cover, Good, HSG C
8,377	93	Weighted Average
1,757		20.97% Pervious Area
6,620		79.03% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 10B:**

Hydrograph

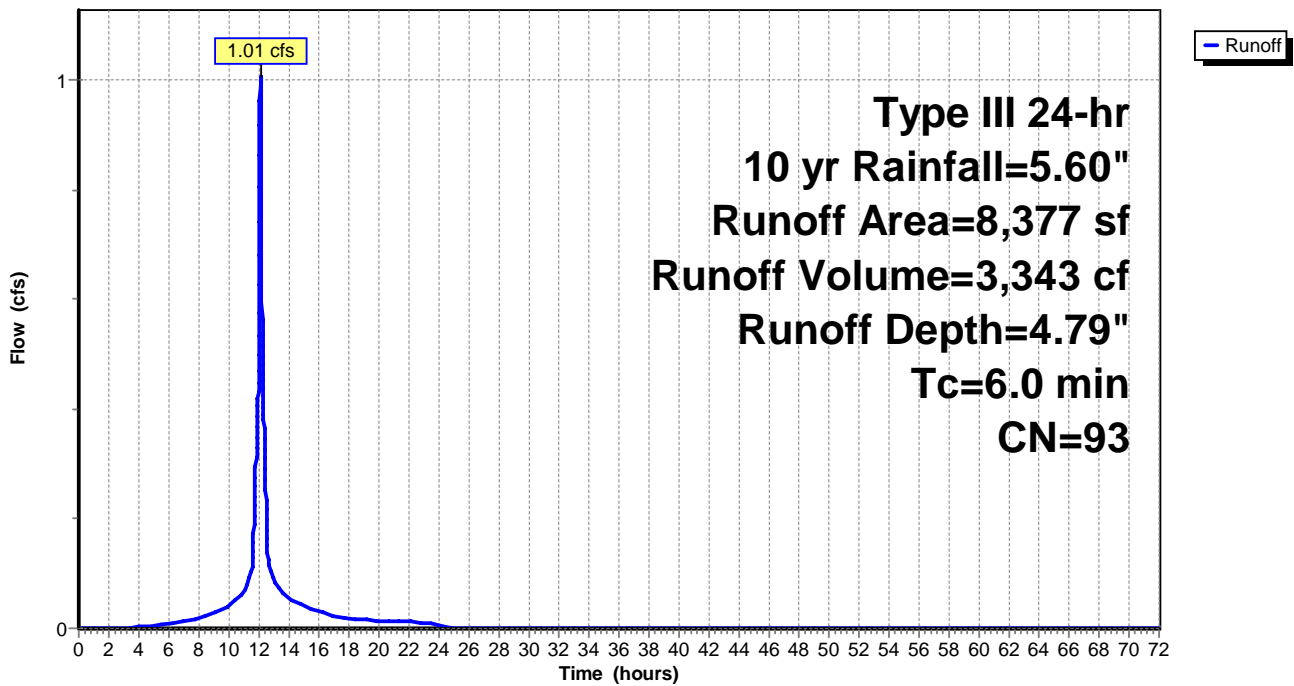

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 29

**Summary for Subcatchment 11:**

Runoff = 0.55 cfs @ 12.09 hrs, Volume= 1,724 cf, Depth= 4.03"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
2,566	98	Paved parking, HSG C
2,566	74	>75% Grass cover, Good, HSG C
5,132	86	Weighted Average
2,566		50.00% Pervious Area
2,566		50.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 11:**

**Hydrograph**

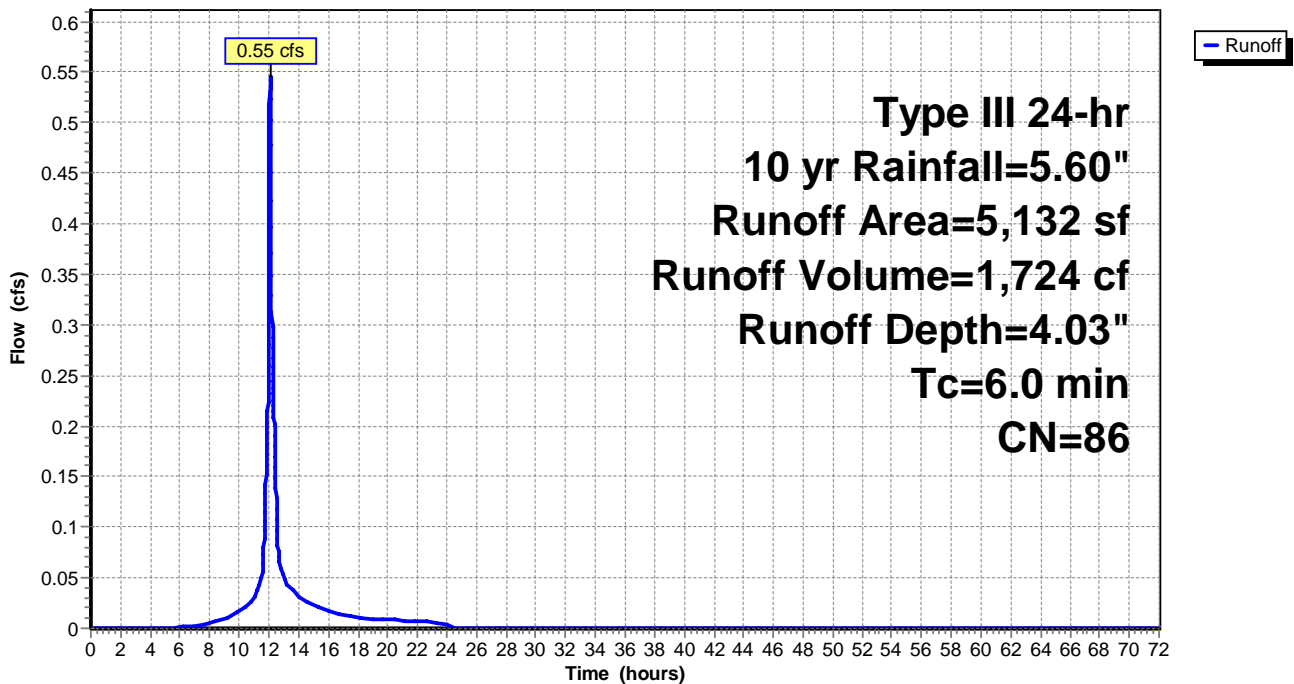



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 30

**Summary for Subcatchment 12:**

Runoff = 1.46 cfs @ 12.08 hrs, Volume= 4,719 cf, Depth= 4.46"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
8,297	98	Paved parking, HSG C
4,408	74	>75% Grass cover, Good, HSG C
12,705	90	Weighted Average
4,408		34.70% Pervious Area
8,297		65.30% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 12:**

**Hydrograph**

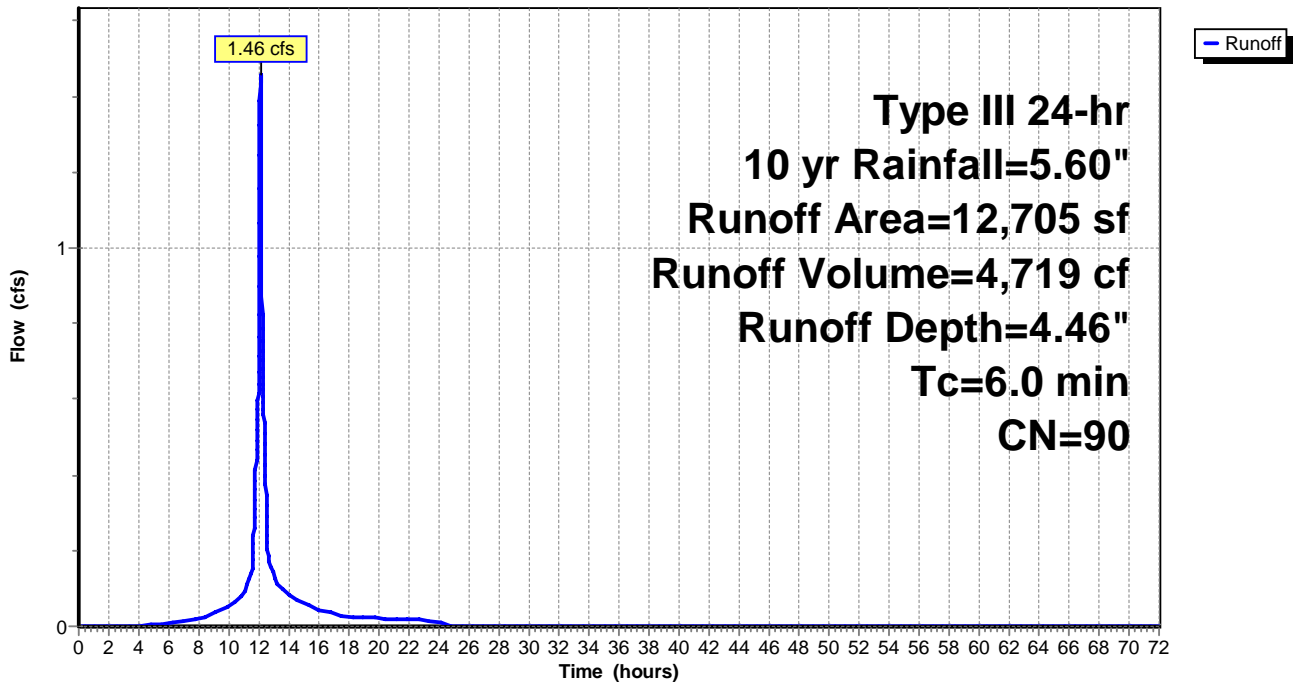

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 31

**Summary for Subcatchment 13:**

Runoff = 0.30 cfs @ 12.08 hrs, Volume= 992 cf, Depth= 4.79"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,947	98	Paved parking, HSG C
539	74	>75% Grass cover, Good, HSG C
2,486	93	Weighted Average
539		21.68% Pervious Area
1,947		78.32% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 13:**

**Hydrograph**

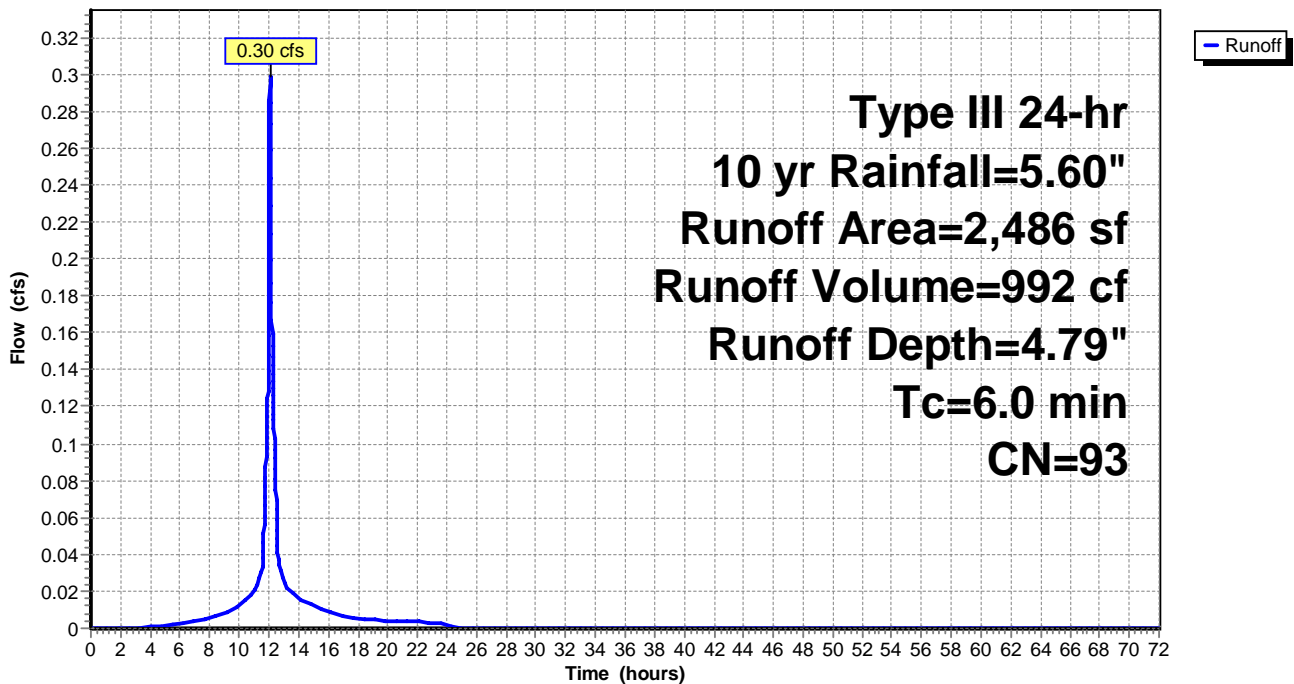

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 32

**Summary for Subcatchment 14:**

Runoff = 0.58 cfs @ 12.09 hrs, Volume= 1,830 cf, Depth= 3.82"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
2,329	98	Paved parking, HSG C
3,413	74	>75% Grass cover, Good, HSG C
5,742	84	Weighted Average
3,413		59.44% Pervious Area
2,329		40.56% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 14:**

**Hydrograph**

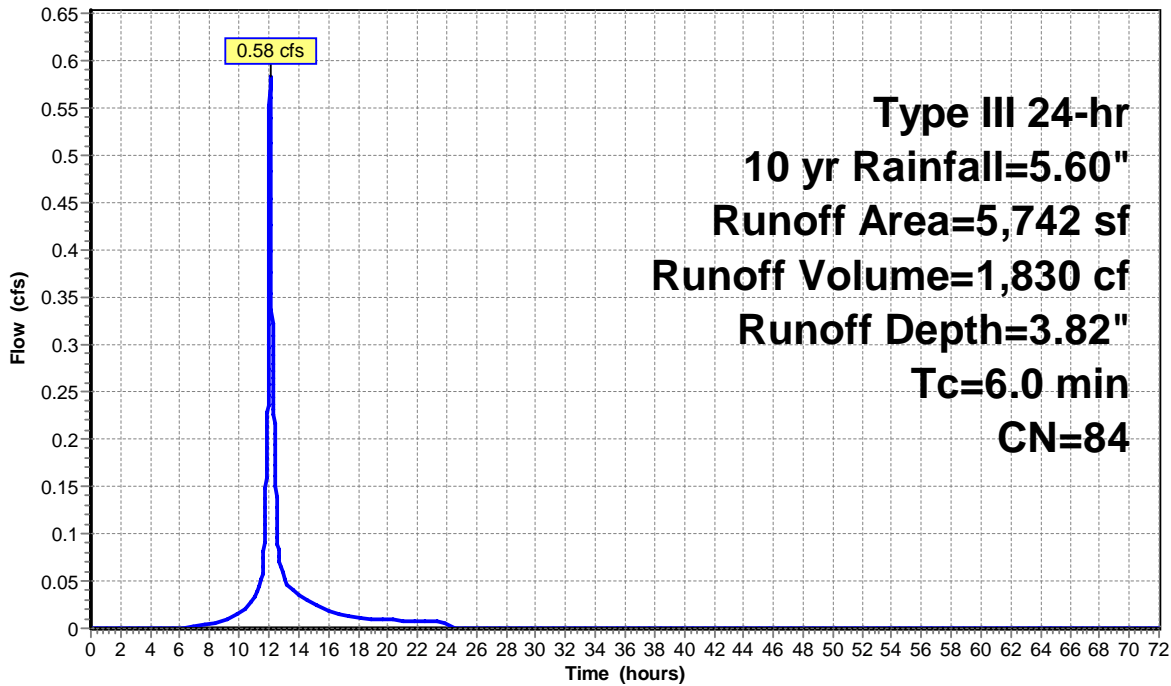

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 33

**Summary for Subcatchment 15:**

Runoff = 3.41 cfs @ 12.08 hrs, Volume= 11,434 cf, Depth= 4.90"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
23,021	98	Paved parking, HSG C
4,976	74	>75% Grass cover, Good, HSG C
27,997	94	Weighted Average
4,976		17.77% Pervious Area
23,021		82.23% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 15:**

**Hydrograph**

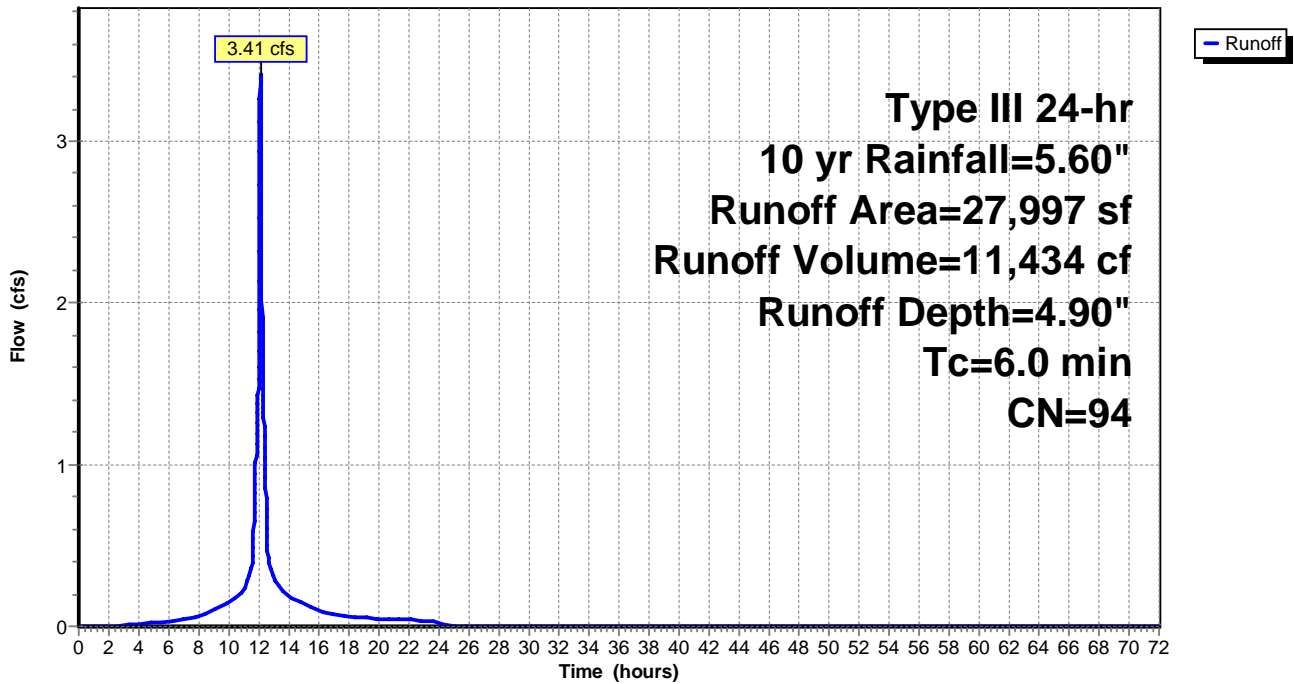

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 34

**Summary for Subcatchment 16:**

Runoff = 5.23 cfs @ 12.08 hrs, Volume= 17,029 cf, Depth= 4.57"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
31,180	98	Paved parking, HSG C
13,571	74	>75% Grass cover, Good, HSG C
44,751	91	Weighted Average
13,571		30.33% Pervious Area
31,180		69.67% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 16:**

**Hydrograph**

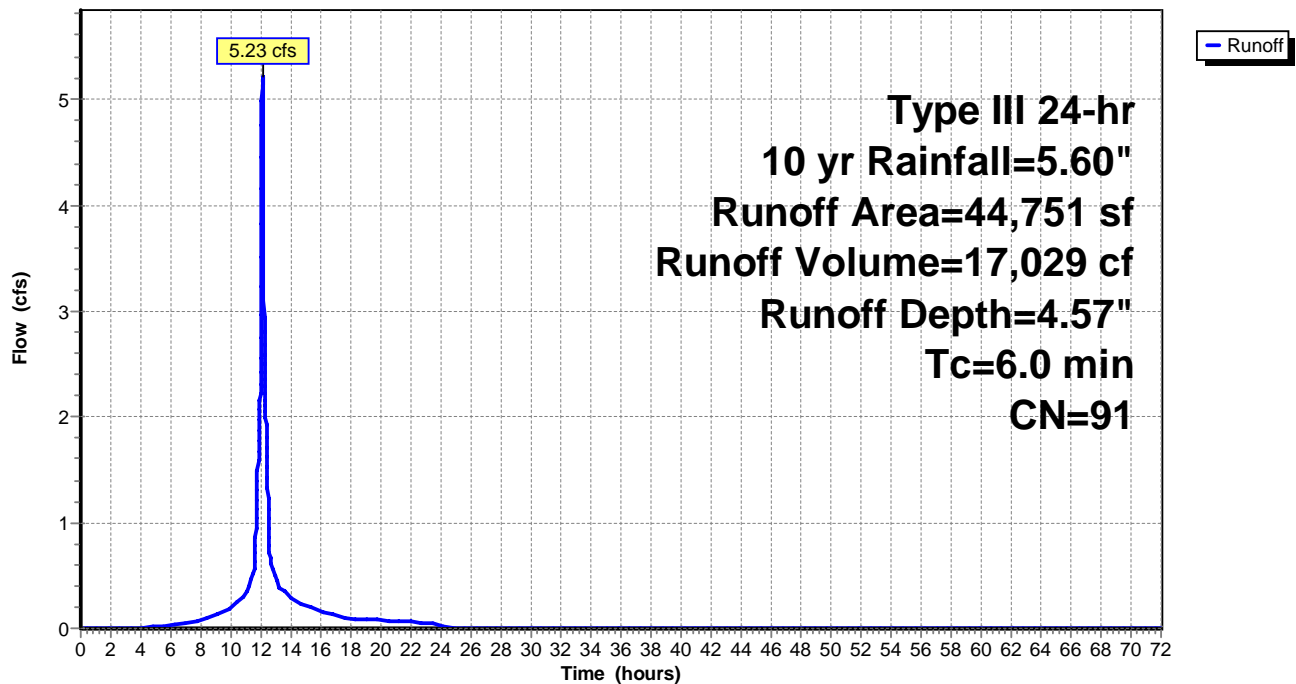

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 35

**Summary for Subcatchment 17:**

Runoff = 2.02 cfs @ 12.09 hrs, Volume= 6,420 cf, Depth= 4.14"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
10,273	98	Paved parking, HSG C
8,356	74	>75% Grass cover, Good, HSG C
18,629	87	Weighted Average
8,356		44.85% Pervious Area
10,273		55.15% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 17:**

**Hydrograph**

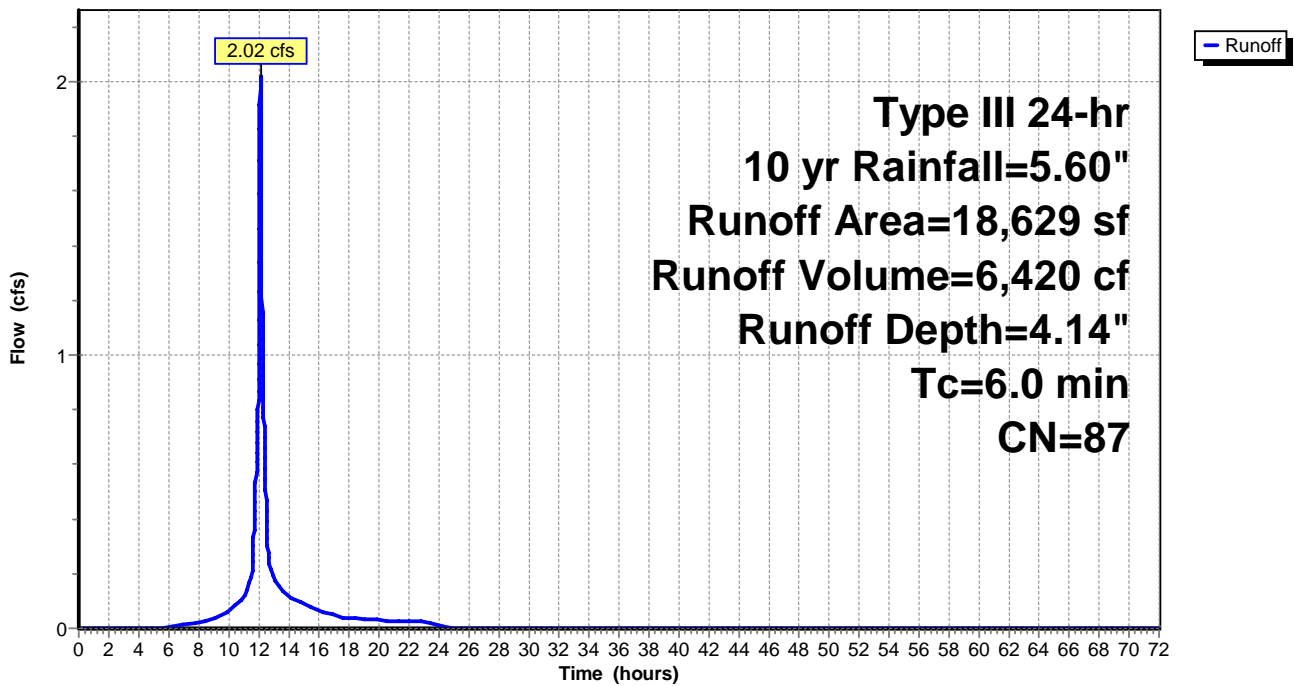

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 36

**Summary for Subcatchment 18:**

Runoff = 3.59 cfs @ 12.08 hrs, Volume= 12,744 cf, Depth= 5.36"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
28,518	98	Roofs, HSG C
28,518		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 18:**

Hydrograph

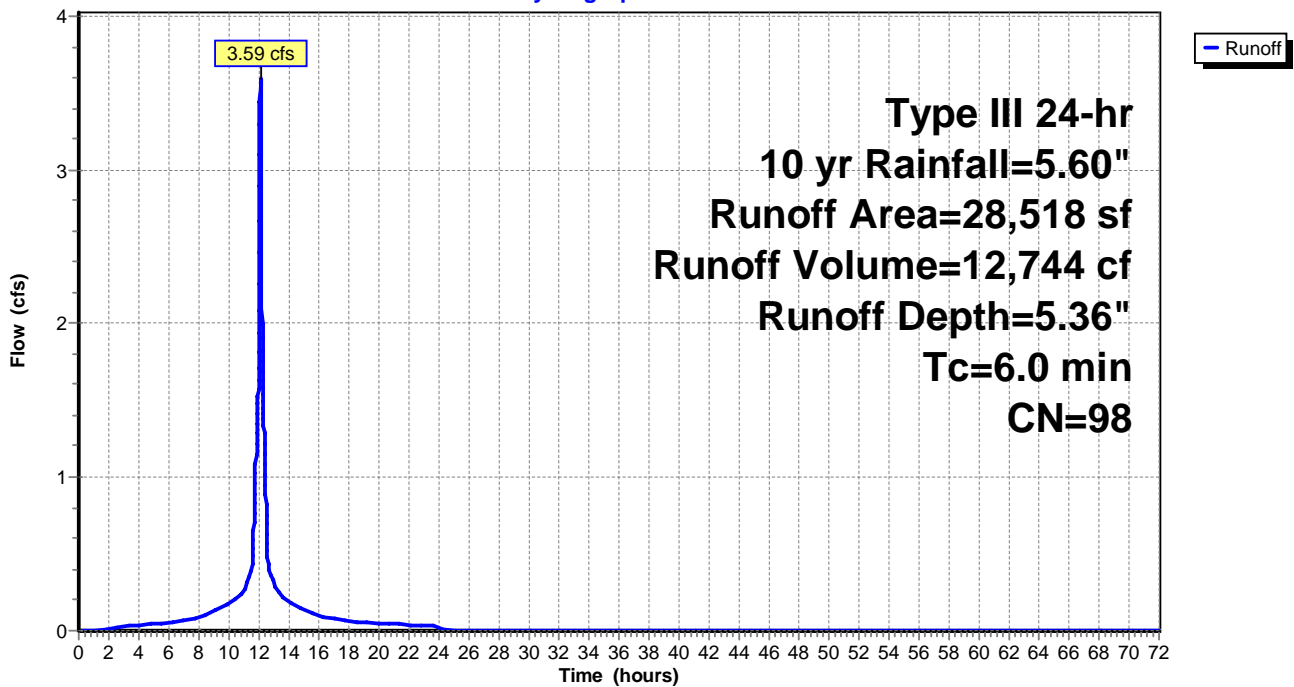

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 37

**Summary for Subcatchment 19:**

Runoff = 0.36 cfs @ 12.09 hrs, Volume= 1,105 cf, Depth= 3.23"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
711	98	Paved parking, HSG C
3,397	74	>75% Grass cover, Good, HSG C
4,108	78	Weighted Average
3,397		82.69% Pervious Area
711		17.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 19:**

**Hydrograph**

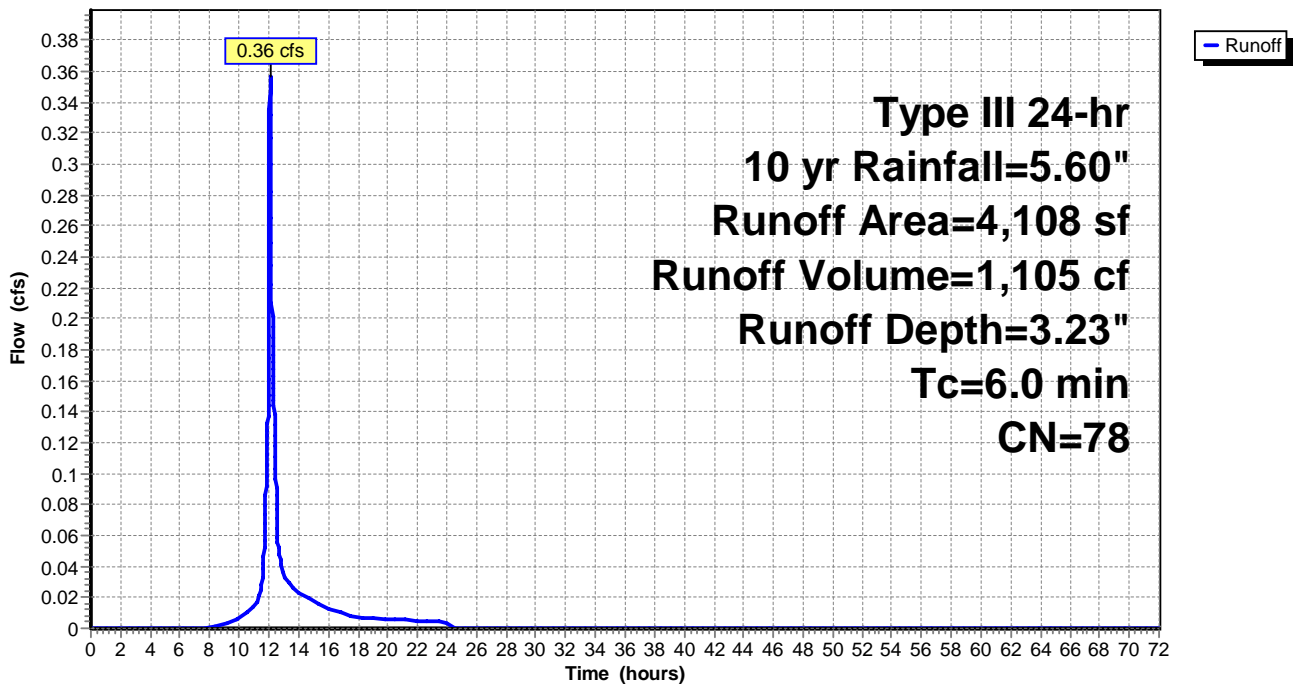



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 38

**Summary for Subcatchment 20:**

Runoff = 0.19 cfs @ 12.08 hrs, Volume= 681 cf, Depth= 5.36"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,524	98	Paved parking, HSG C
1,524		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 20:**

**Hydrograph**

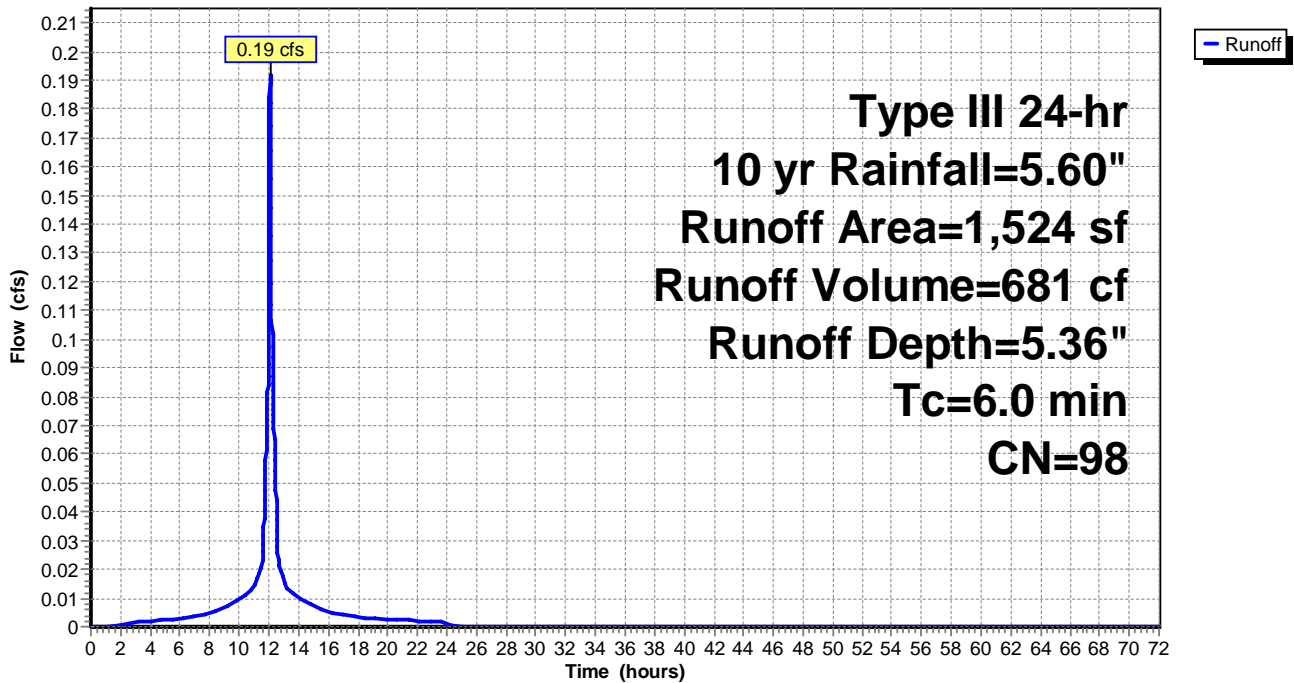

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 39

**Summary for Subcatchment 21:**

Runoff = 0.09 cfs @ 12.08 hrs, Volume= 294 cf, Depth= 4.46"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
523	98	Paved parking, HSG C
269	74	>75% Grass cover, Good, HSG C
792	90	Weighted Average
269		33.96% Pervious Area
523		66.04% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 21:**

**Hydrograph**

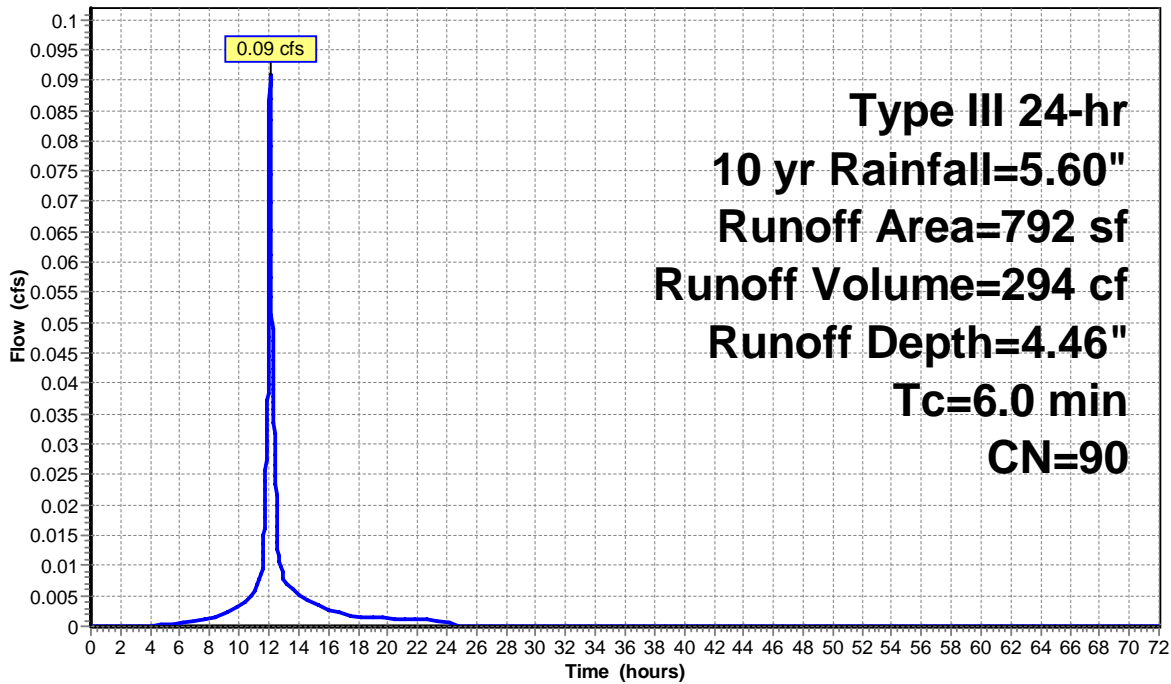

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 40

**Summary for Subcatchment 22:**

Runoff = 3.21 cfs @ 12.09 hrs, Volume= 9,946 cf, Depth= 2.85"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
509	98	Paved parking, HSG C
41,345	74	>75% Grass cover, Good, HSG C
41,854	74	Weighted Average
41,345		98.78% Pervious Area
509		1.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 22:**

**Hydrograph**

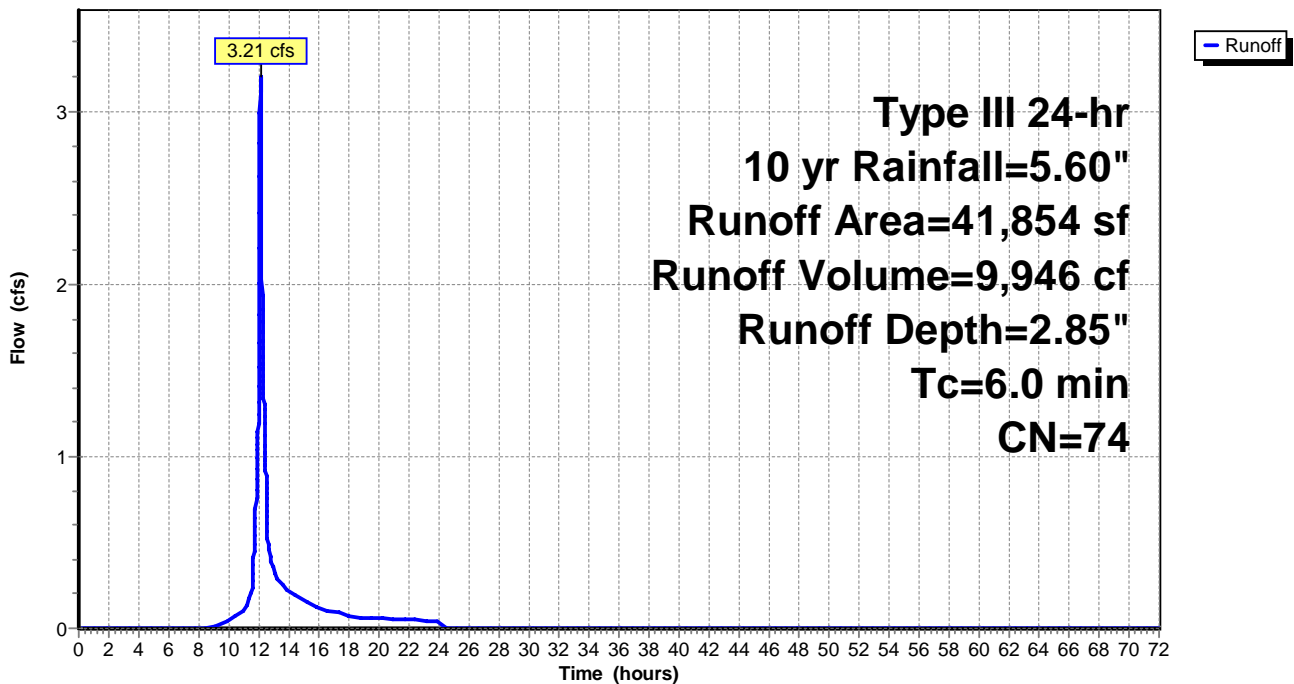

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 41

**Summary for Subcatchment 23:**

Runoff = 1.11 cfs @ 12.09 hrs, Volume= 3,437 cf, Depth= 2.85"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
14,462	74	>75% Grass cover, Good, HSG C
14,462		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.8	115	0.0011	0.67		<b>Shallow Concentrated Flow,</b> Paved Kv= 20.3 fps
3.2					<b>Direct Entry,</b>
6.0	115	Total			

**Subcatchment 23:**

**Hydrograph**

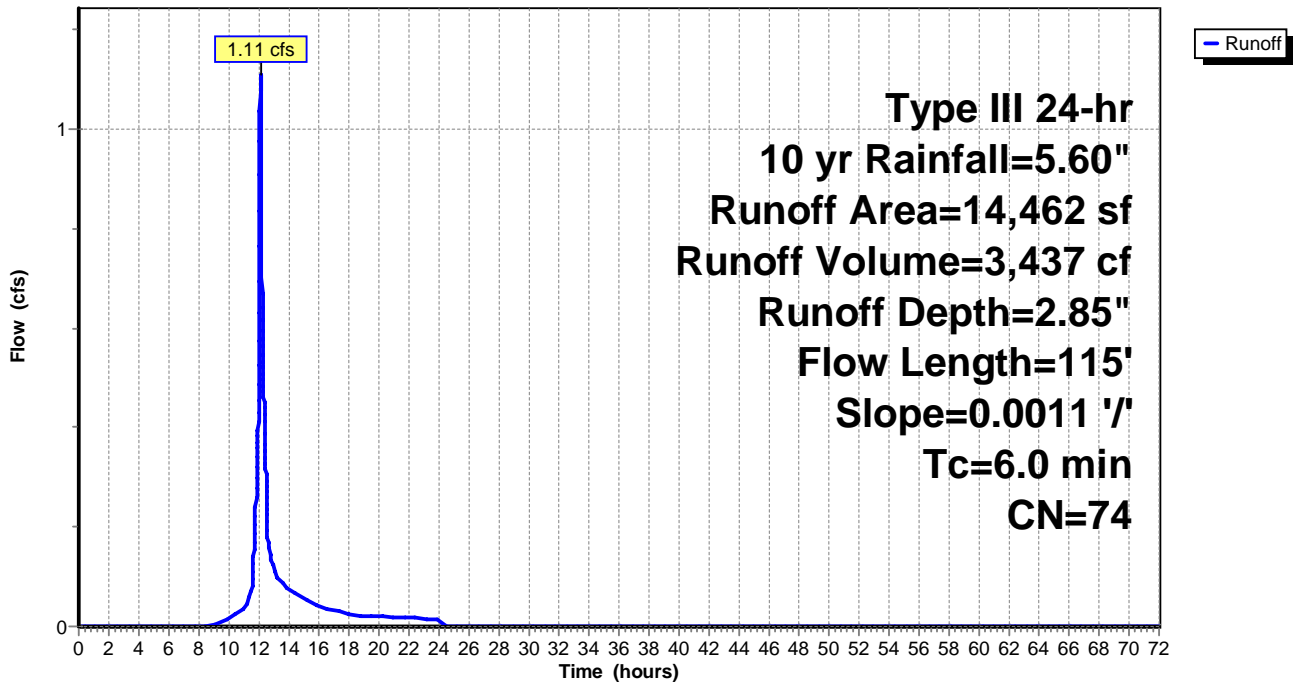

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 42

**Summary for Subcatchment 24:**

Runoff = 0.75 cfs @ 12.09 hrs, Volume= 2,378 cf, Depth= 4.24"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"


Area (sf)	CN	Description
3,786	98	Paved parking, HSG C
2,943	74	>75% Grass cover, Good, HSG C
6,729	88	Weighted Average
2,943		43.74% Pervious Area
3,786		56.26% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.1	50	0.0894	0.27		Sheet Flow, Grass: Short n= 0.150 P2= 3.10"
0.9	126	0.0138	2.38		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.0					Direct Entry,
6.0	176	Total			

**Subcatchment 24:**

Hydrograph

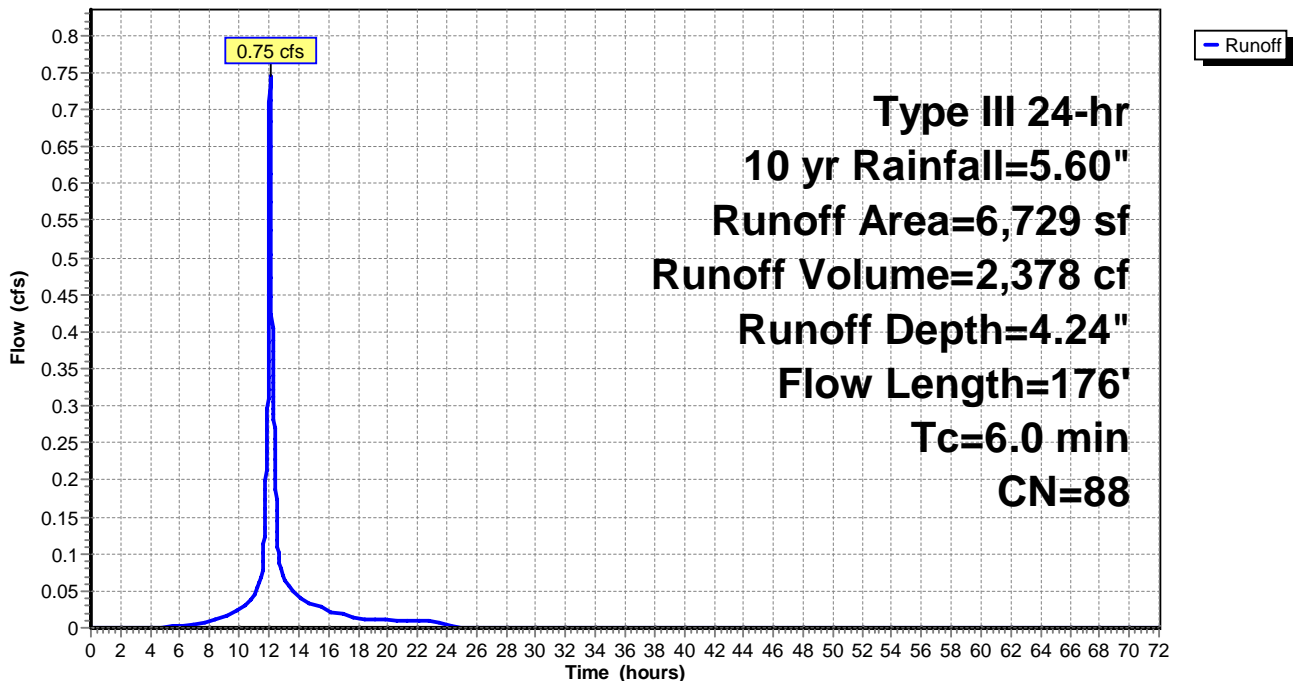

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 43

**Summary for Subcatchment 25:**


Runoff = 0.76 cfs @ 12.00 hrs, Volume= 1,944 cf, Depth= 3.62"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
2,210	98	Paved parking, HSG C
4,232	74	>75% Grass cover, Good, HSG C
6,442	82	Weighted Average
4,232		65.69% Pervious Area
2,210		34.31% Impervious Area

**Subcatchment 25:**

**Hydrograph**

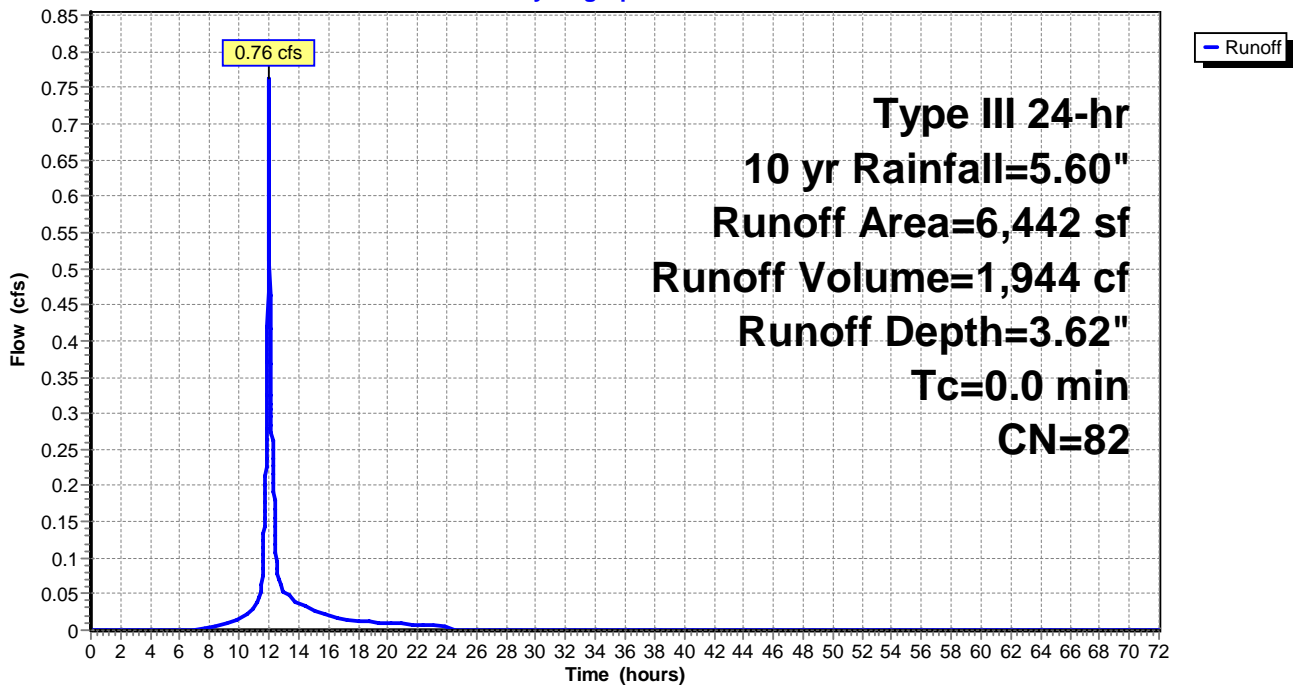

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 44

**Summary for Subcatchment 26:**


Runoff = 2.14 cfs @ 12.00 hrs, Volume= 5,961 cf, Depth= 5.01"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
12,344	98	Paved parking, HSG C
1,921	74	>75% Grass cover, Good, HSG C
14,265	95	Weighted Average
1,921		13.47% Pervious Area
12,344		86.53% Impervious Area

**Subcatchment 26:**

**Hydrograph**

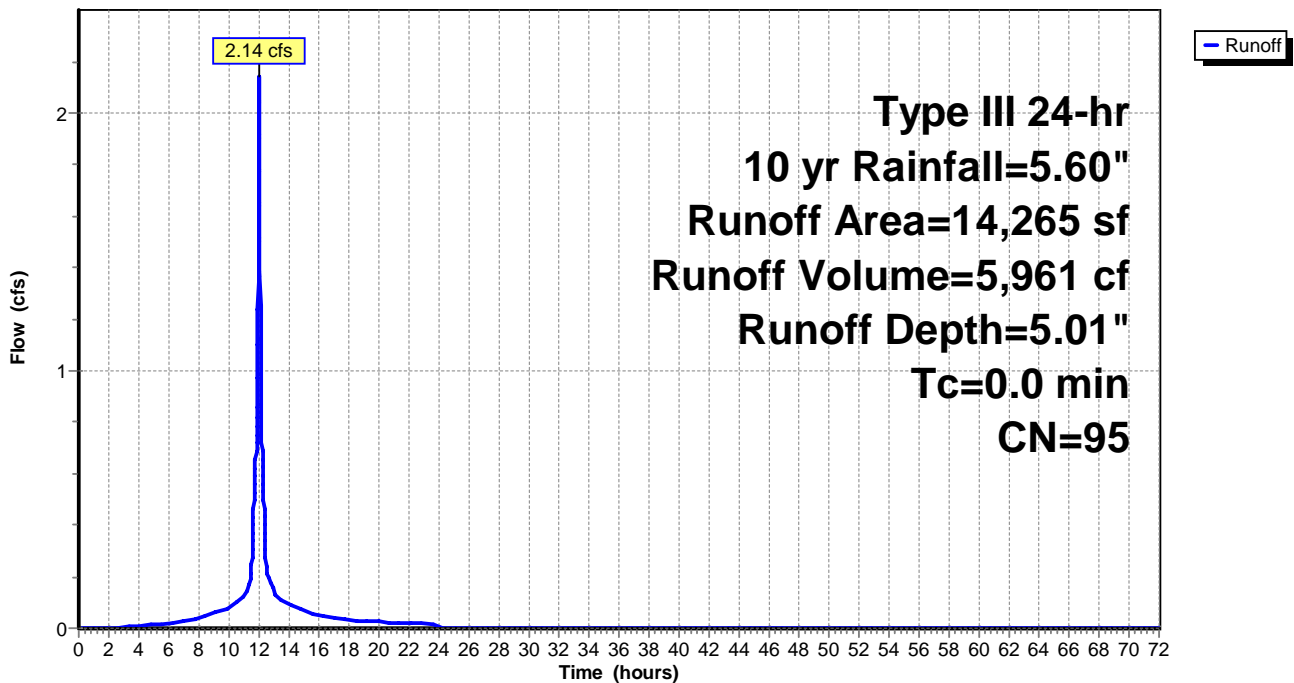

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 45

**Summary for Subcatchment 27:**

Runoff = 0.59 cfs @ 12.11 hrs, Volume= 2,061 cf, Depth= 4.68"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
4,020	98	Paved parking, HSG C
1,269	74	>75% Grass cover, Good, HSG C
5,289	92	Weighted Average
1,269		23.99% Pervious Area
4,020		76.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.7	71	0.1342	0.15		Sheet Flow, sheet into hodgson brook Woods: Light underbrush n= 0.400 P2= 3.10"

**Subcatchment 27:**

Hydrograph

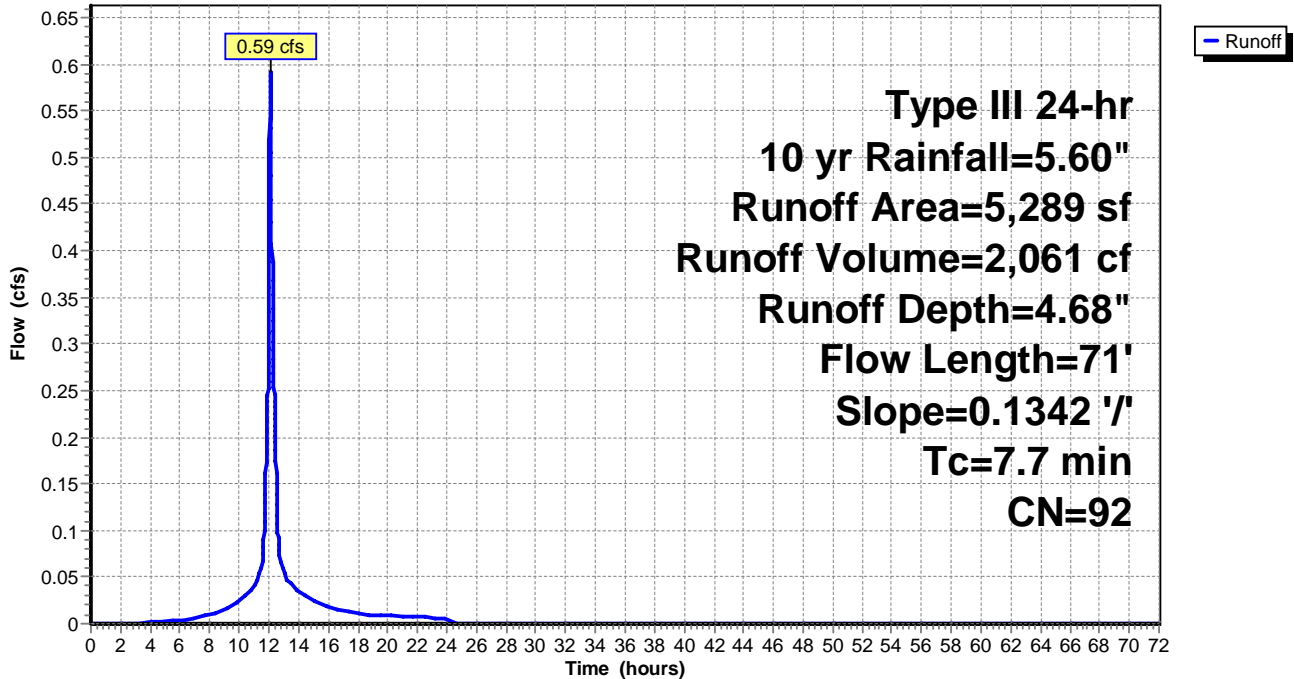



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 46

**Summary for Subcatchment 28:**

Runoff = 2.27 cfs @ 12.08 hrs, Volume= 7,716 cf, Depth= 5.01"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
16,004	98	Paved parking, HSG C
2,460	74	>75% Grass cover, Good, HSG C
18,464	95	Weighted Average
2,460		13.32% Pervious Area
16,004		86.68% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 28:**

**Hydrograph**

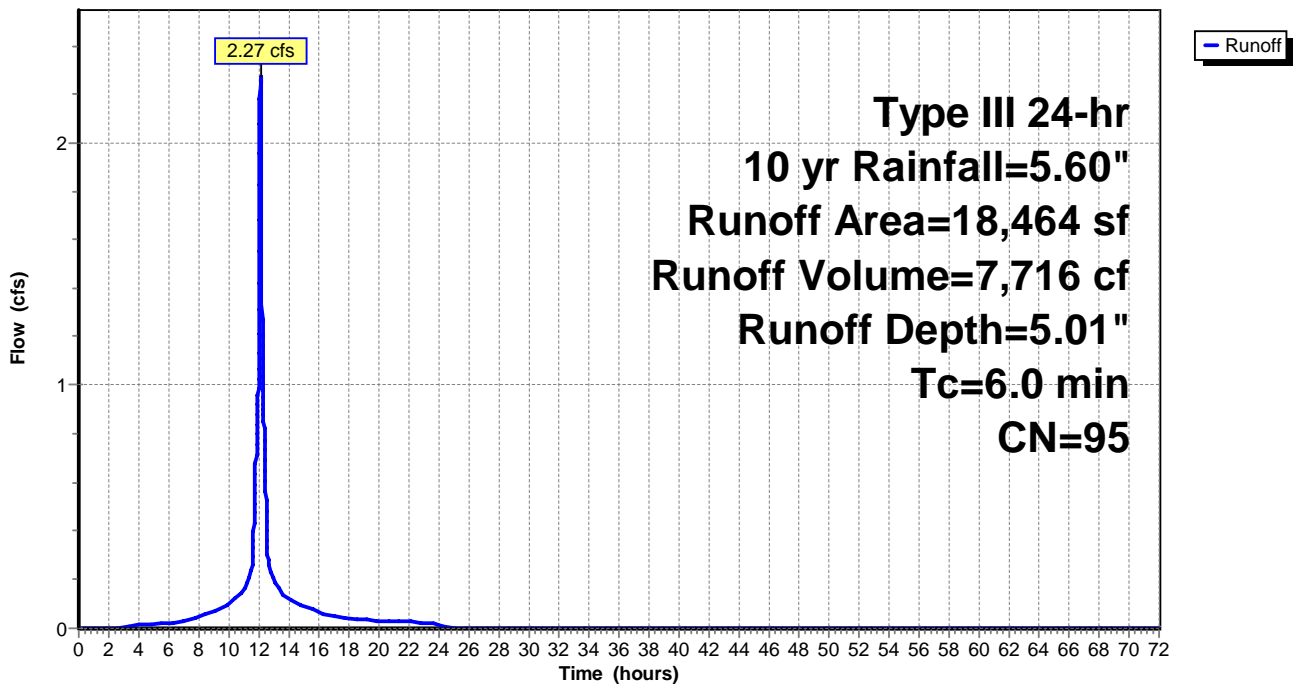

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 47

**Summary for Subcatchment 29:**


Runoff = 1.31 cfs @ 12.00 hrs, Volume= 3,556 cf, Depth= 4.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
7,174	98	Paved parking, HSG C
1,738	74	>75% Grass cover, Good, HSG C
8,912	93	Weighted Average
1,738		19.50% Pervious Area
7,174		80.50% Impervious Area

**Subcatchment 29:**

Hydrograph

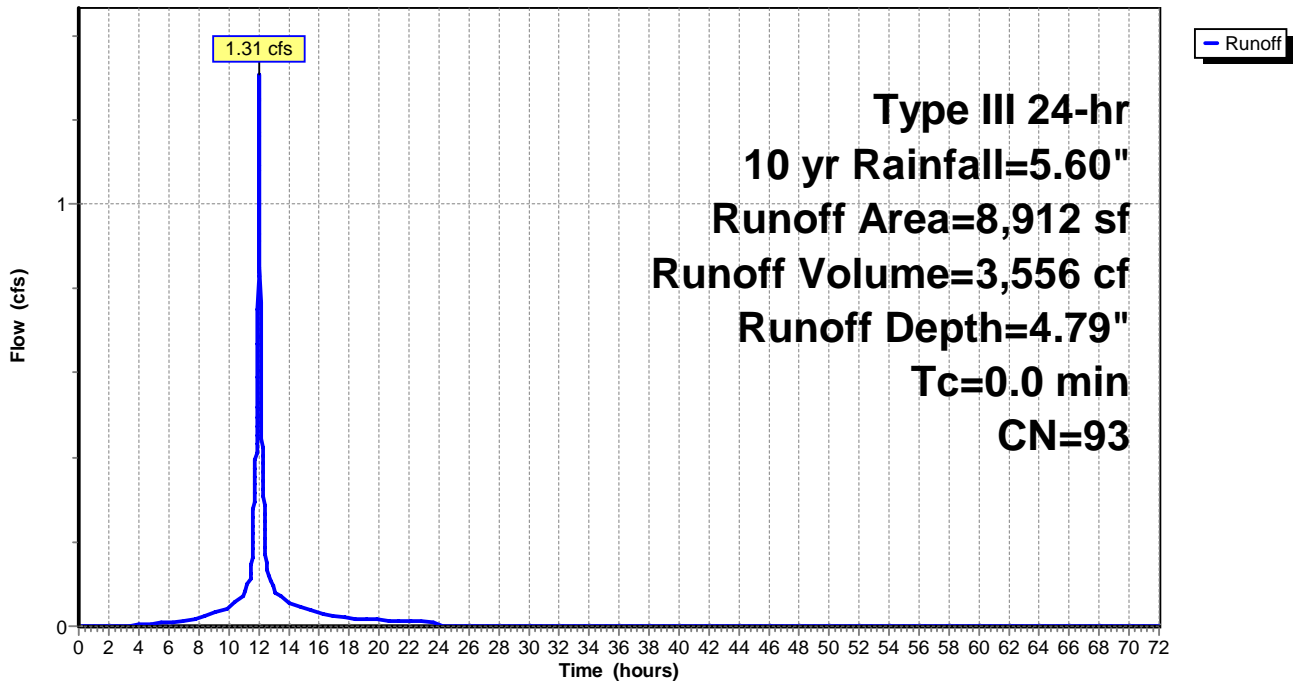

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 48

**Summary for Subcatchment 30:**

Runoff = 1.87 cfs @ 12.09 hrs, Volume= 5,840 cf, Depth= 3.72"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
7,266	98	Paved parking, HSG C
11,564	74	>75% Grass cover, Good, HSG C
18,830	83	Weighted Average
11,564		61.41% Pervious Area
7,266		38.59% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.4	349	0.0138	2.38		<b>Shallow Concentrated Flow,</b> Paved Kv= 20.3 fps
3.6					<b>Direct Entry,</b>
6.0	349	Total			

**Subcatchment 30:**

**Hydrograph**

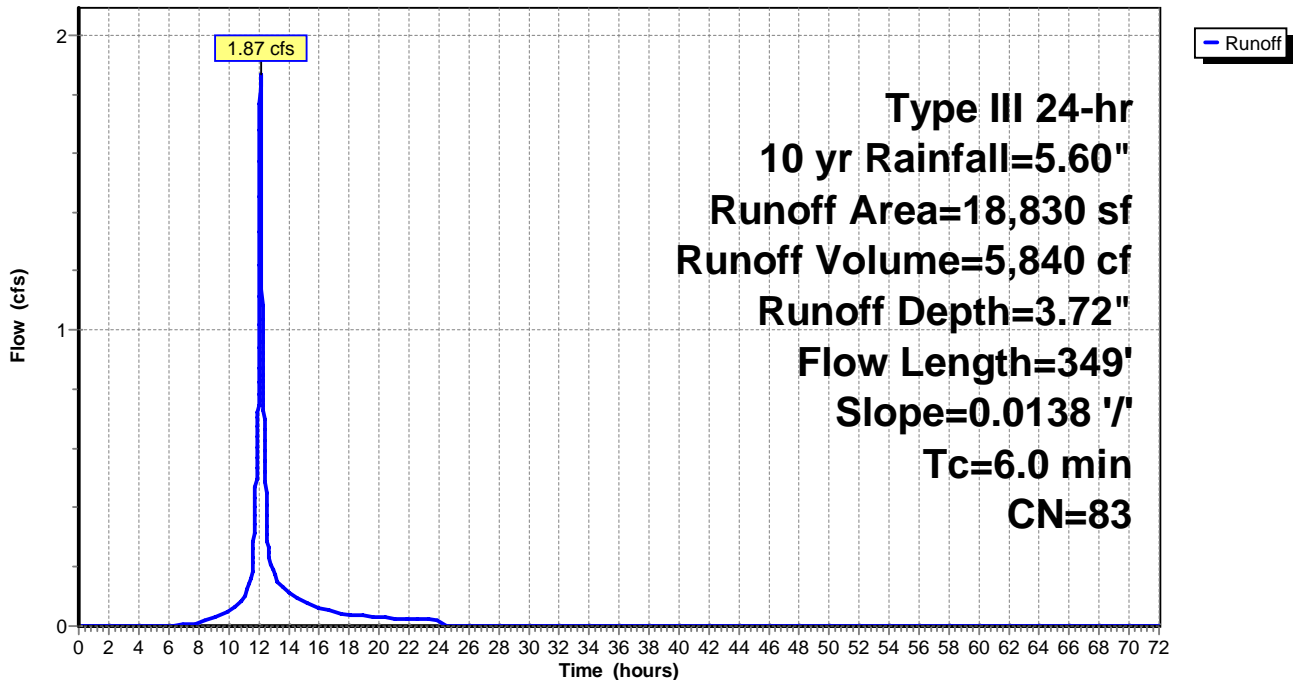

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 49

**Summary for Subcatchment 31:**

Runoff = 1.26 cfs @ 12.09 hrs, Volume= 3,891 cf, Depth= 3.04"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,539	98	Paved parking, HSG C
13,832	74	>75% Grass cover, Good, HSG C
15,371	76	Weighted Average
13,832		89.99% Pervious Area
1,539		10.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 31:**

**Hydrograph**

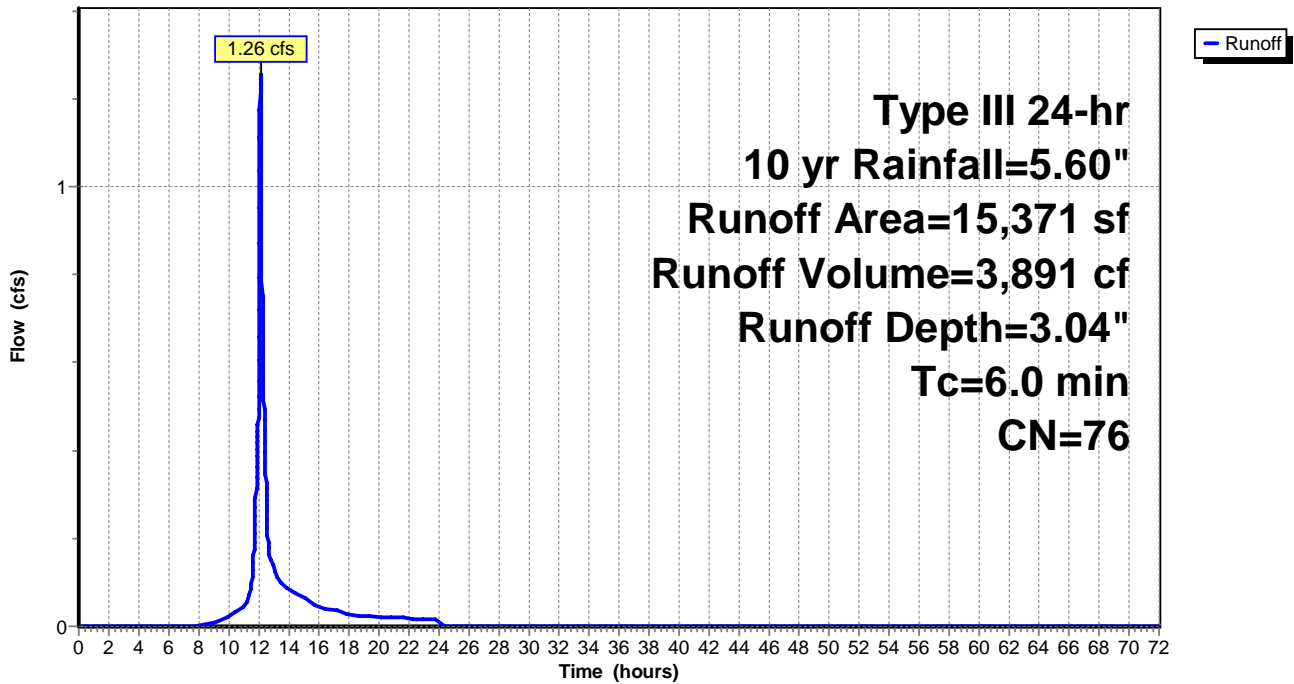

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 50

**Summary for Subcatchment 32:**

Runoff = 4.68 cfs @ 12.08 hrs, Volume= 16,595 cf, Depth= 5.36"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
37,137	98	Unconnected roofs, HSG C
37,137		100.00% Impervious Area
37,137		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 32:**

Hydrograph

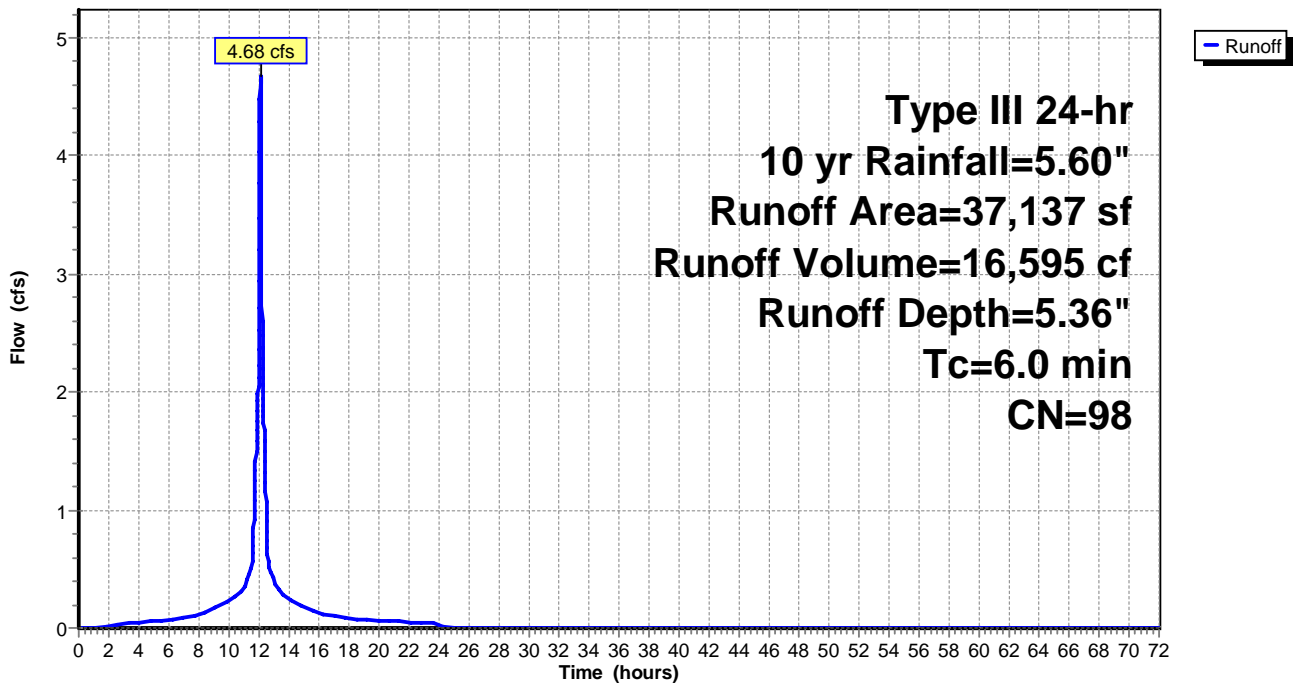

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 51

**Summary for Subcatchment 34:**

Runoff = 1.26 cfs @ 12.08 hrs, Volume= 4,227 cf, Depth= 4.90"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
8,652	98	Paved parking, HSG C
1,698	74	>75% Grass cover, Good, HSG C
10,350	94	Weighted Average
1,698		16.41% Pervious Area
8,652		83.59% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 34:**

**Hydrograph**

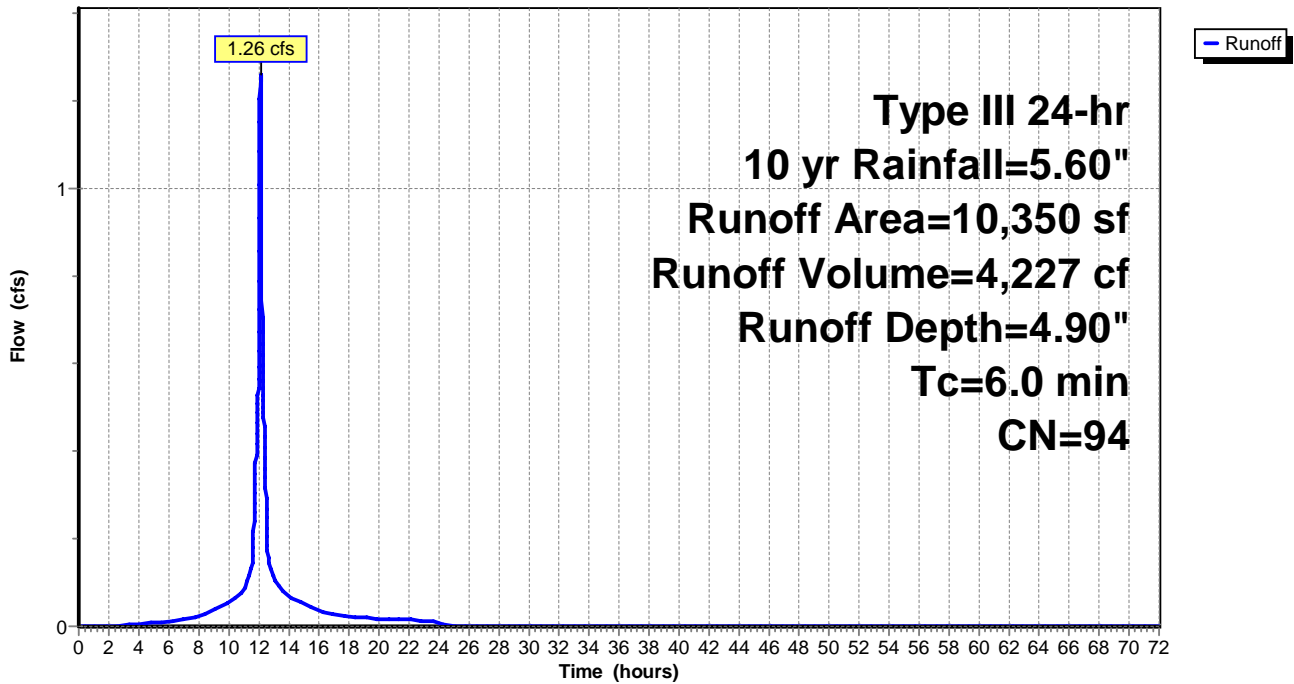

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 52

**Summary for Subcatchment 35:**

Runoff = 1.32 cfs @ 12.08 hrs, Volume= 4,558 cf, Depth= 5.13"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
9,716	98	Paved parking, HSG C
948	74	>75% Grass cover, Good, HSG C
10,664	96	Weighted Average
948		8.89% Pervious Area
9,716		91.11% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 35:**

**Hydrograph**

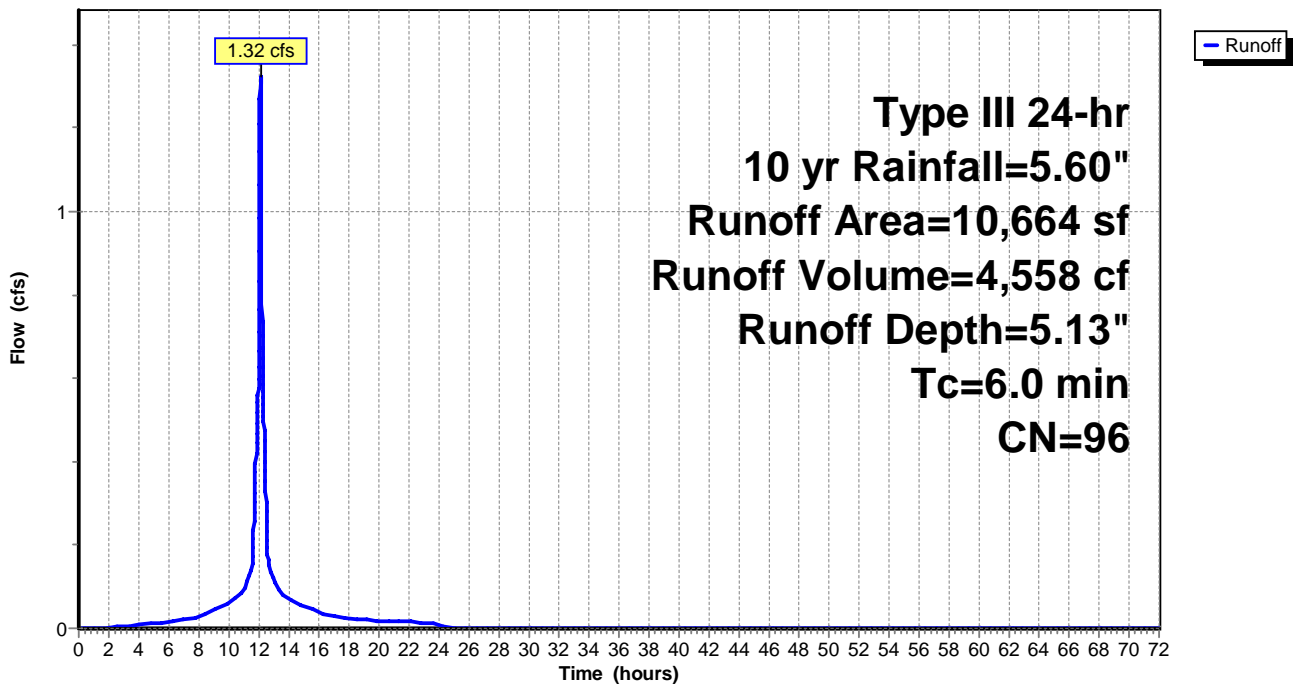

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 53

**Summary for Subcatchment 36:**

Runoff = 4.40 cfs @ 12.08 hrs, Volume= 14,940 cf, Depth= 5.01"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
31,667	98	Paved parking, HSG C
4,086	74	>75% Grass cover, Good, HSG C
35,753	95	Weighted Average
4,086		11.43% Pervious Area
31,667		88.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 36:**

**Hydrograph**

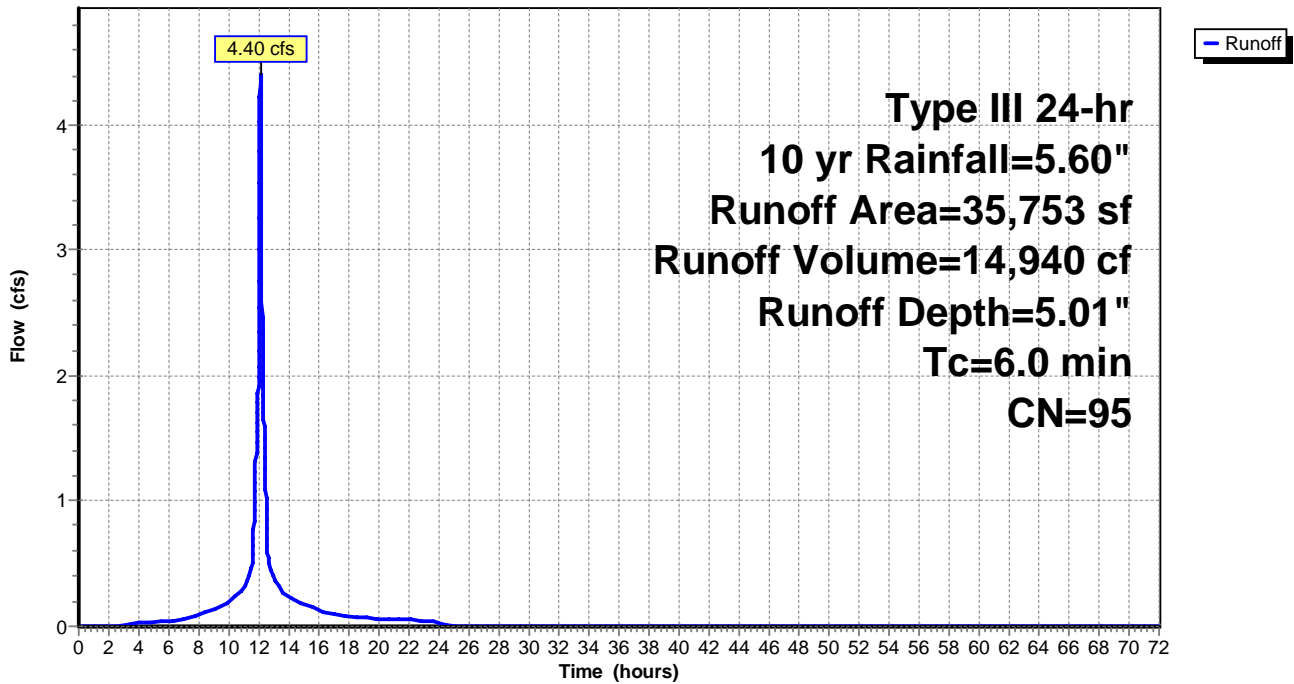



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 54

**Summary for Subcatchment 37:**

Runoff = 6.03 cfs @ 12.08 hrs, Volume= 20,230 cf, Depth= 4.90"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
41,954	98	Paved parking, HSG C
7,582	74	>75% Grass cover, Good, HSG C
49,536	94	Weighted Average
7,582		15.31% Pervious Area
41,954		84.69% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 37:**

**Hydrograph**

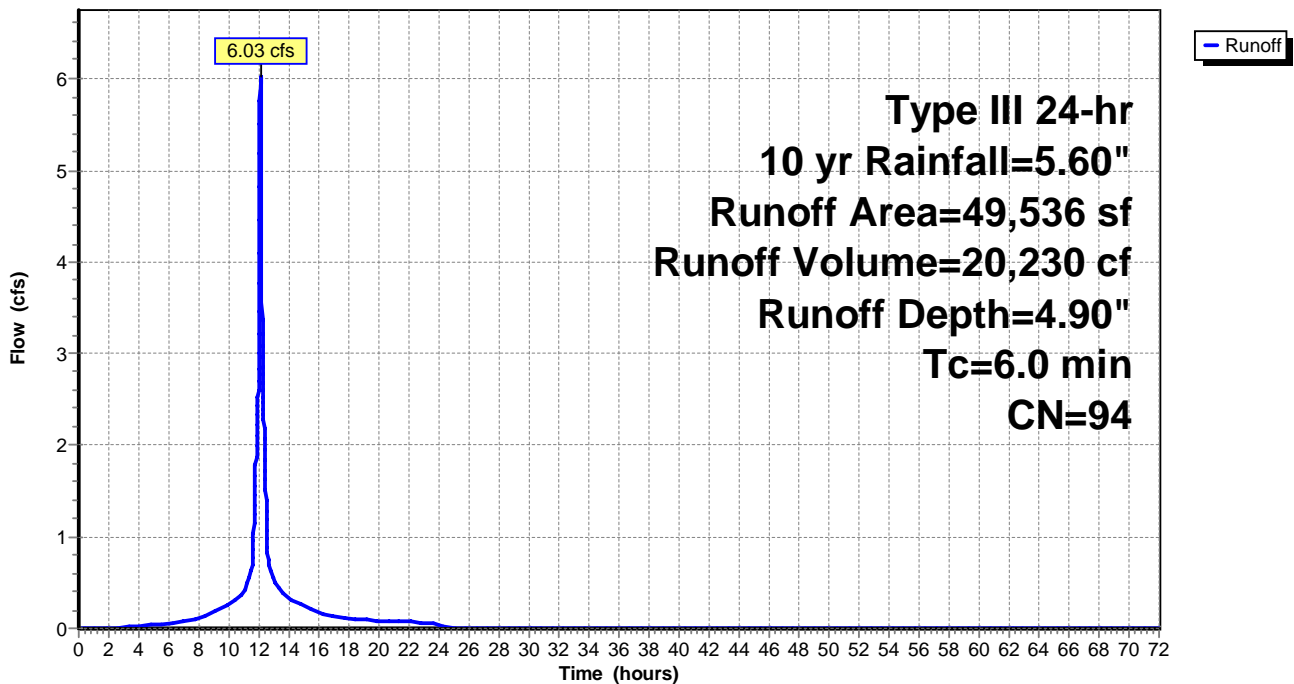

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 55

**Summary for Subcatchment 38:**

Runoff = 2.79 cfs @ 12.08 hrs, Volume= 9,898 cf, Depth= 5.36"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
22,151	98	Unconnected roofs, HSG C
22,151		100.00% Impervious Area
22,151		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 38:**

Hydrograph

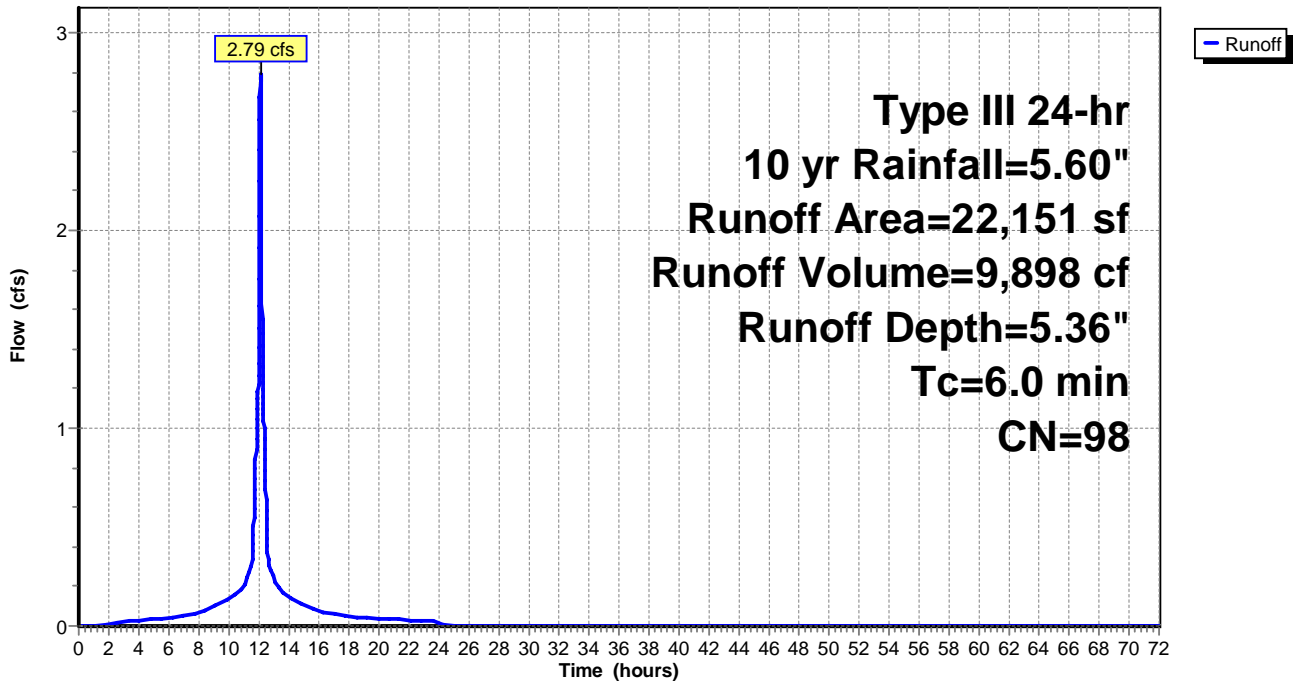

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 56

**Summary for Subcatchment 39:**

Runoff = 1.14 cfs @ 12.09 hrs, Volume= 3,574 cf, Depth= 3.82"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
6,344	74	>75% Grass cover, Good, HSG C
4,874	98	Paved parking, HSG C
11,218	84	Weighted Average
6,344		56.55% Pervious Area
4,874		43.45% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 39:**

**Hydrograph**

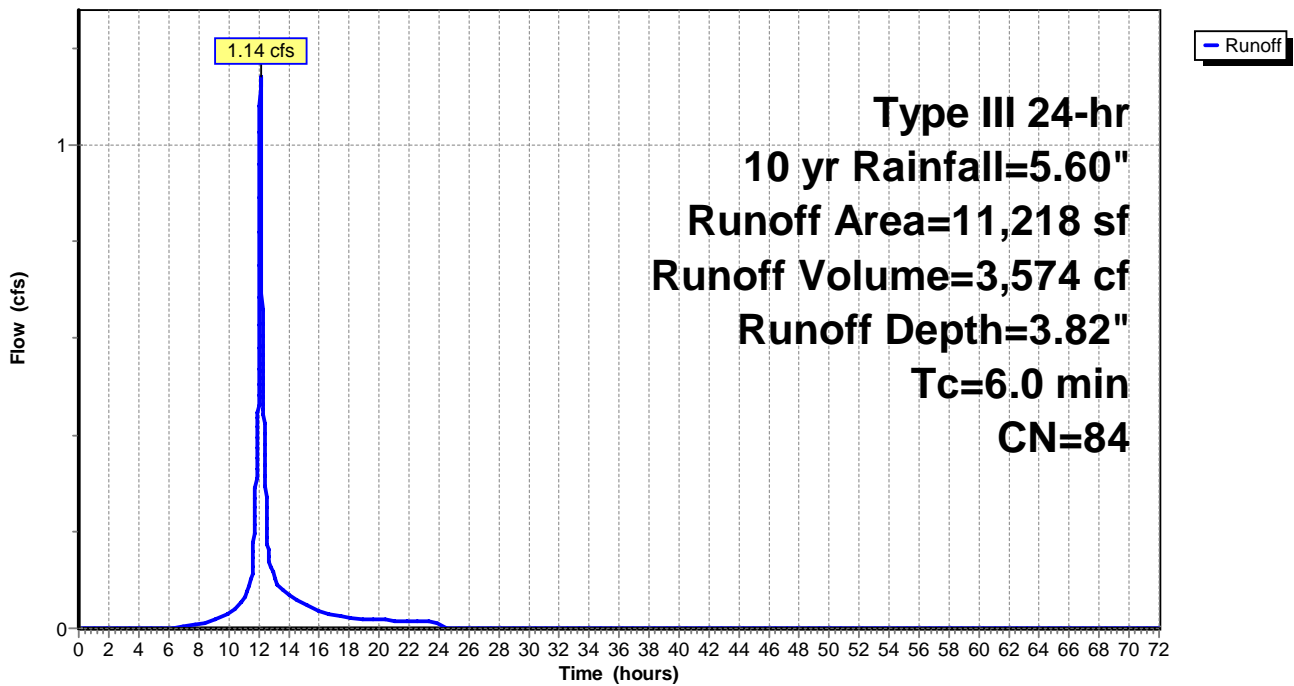

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 57

**Summary for Subcatchment 40:**

Runoff = 1.59 cfs @ 12.08 hrs, Volume= 5,265 cf, Depth= 4.79"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
10,295	98	Paved parking, HSG C
2,900	74	>75% Grass cover, Good, HSG C
13,195	93	Weighted Average
2,900		21.98% Pervious Area
10,295		78.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 40:**

**Hydrograph**

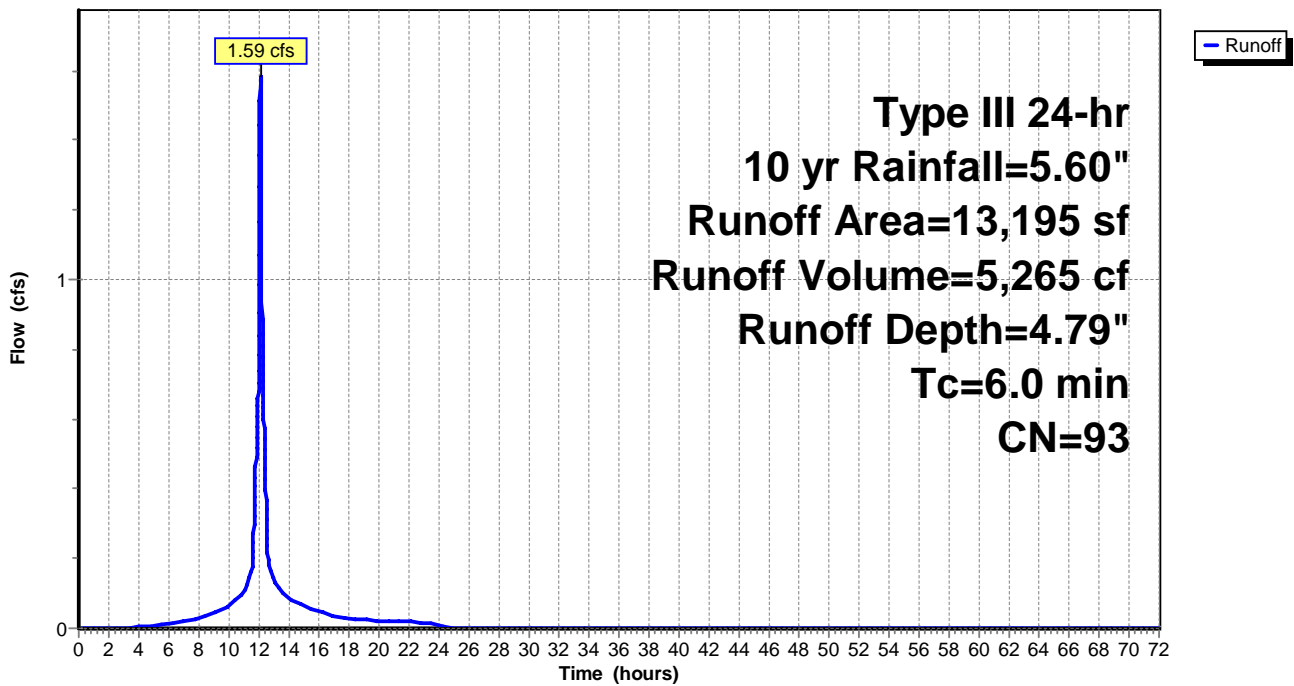

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 58

**Summary for Subcatchment 41:**

Runoff = 0.76 cfs @ 12.09 hrs, Volume= 2,410 cf, Depth= 4.03"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,631	74	>75% Grass cover, Good, HSG C
3,544	98	Paved parking, HSG C
7,175	86	Weighted Average
3,631		50.61% Pervious Area
3,544		49.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 41:**

**Hydrograph**

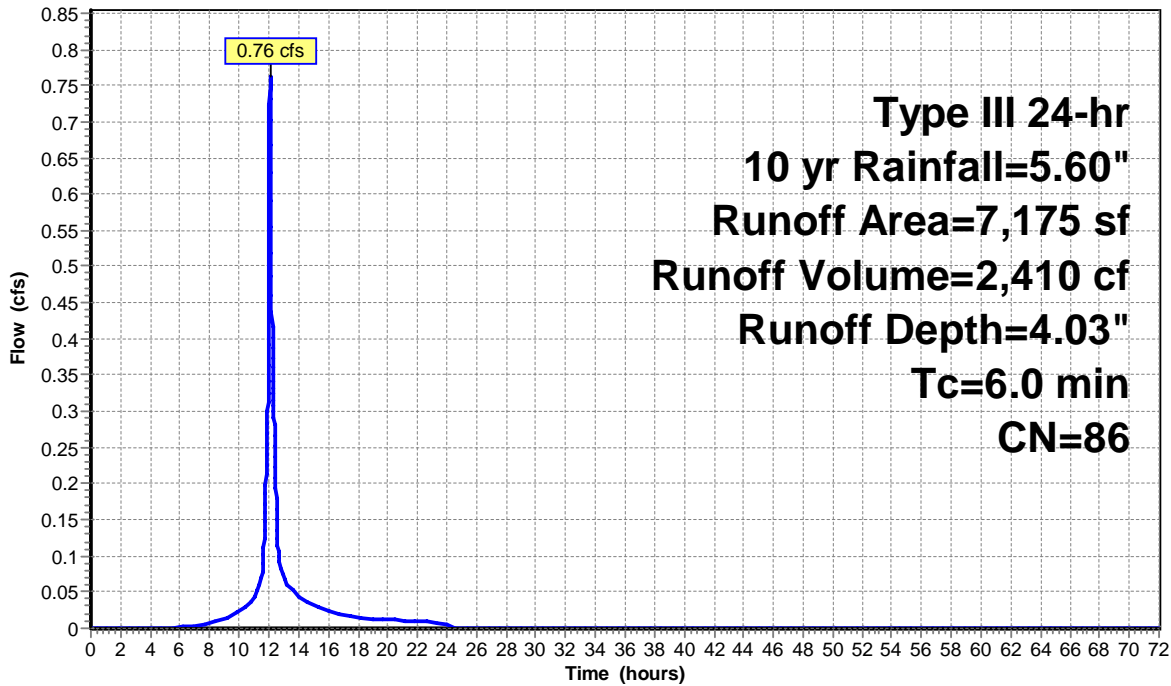

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 59

**Summary for Subcatchment 42:**

Runoff = 0.52 cfs @ 12.09 hrs, Volume= 1,607 cf, Depth= 2.85"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
6,762	74	>75% Grass cover, Good, HSG C
6,762		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Subcatchment 42:**

**Hydrograph**

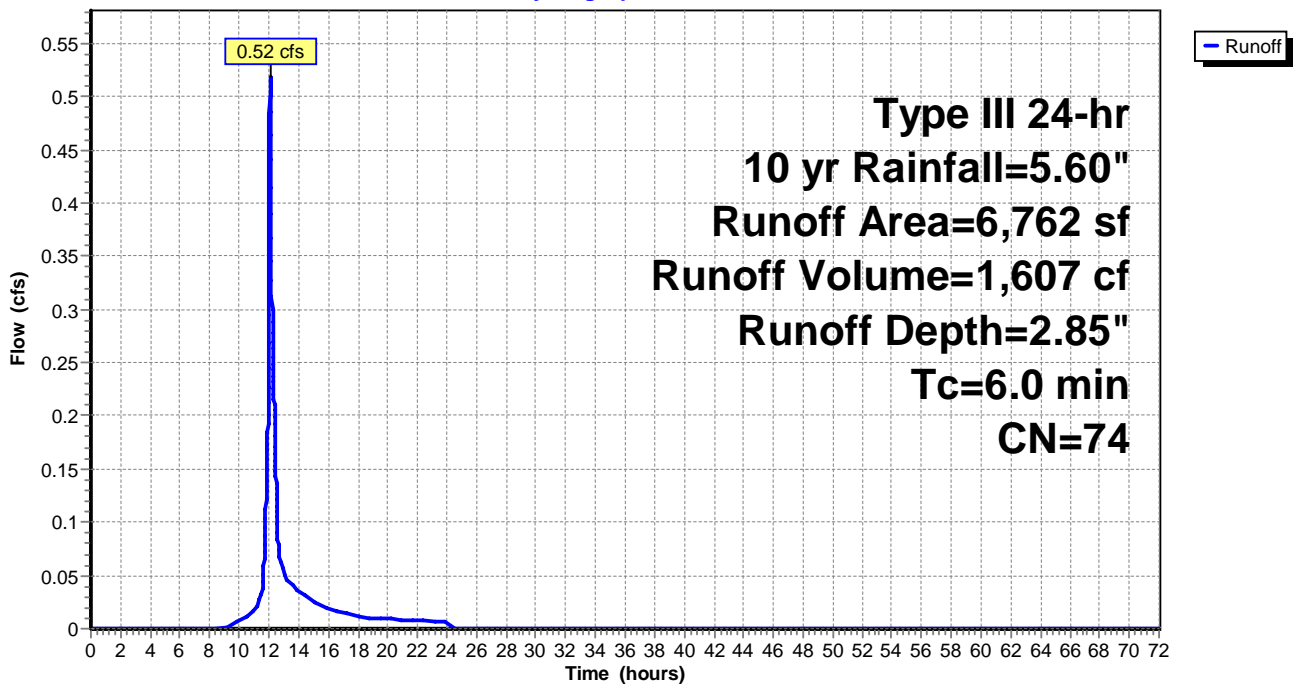

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 60

**Summary for Subcatchment 43:**


Runoff = 0.37 cfs @ 12.00 hrs, Volume= 1,002 cf, Depth= 4.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,984	98	Paved parking, HSG C
526	74	>75% Grass cover, Good, HSG C
2,510	93	Weighted Average
526		20.96% Pervious Area
1,984		79.04% Impervious Area

**Subcatchment 43:**

**Hydrograph**

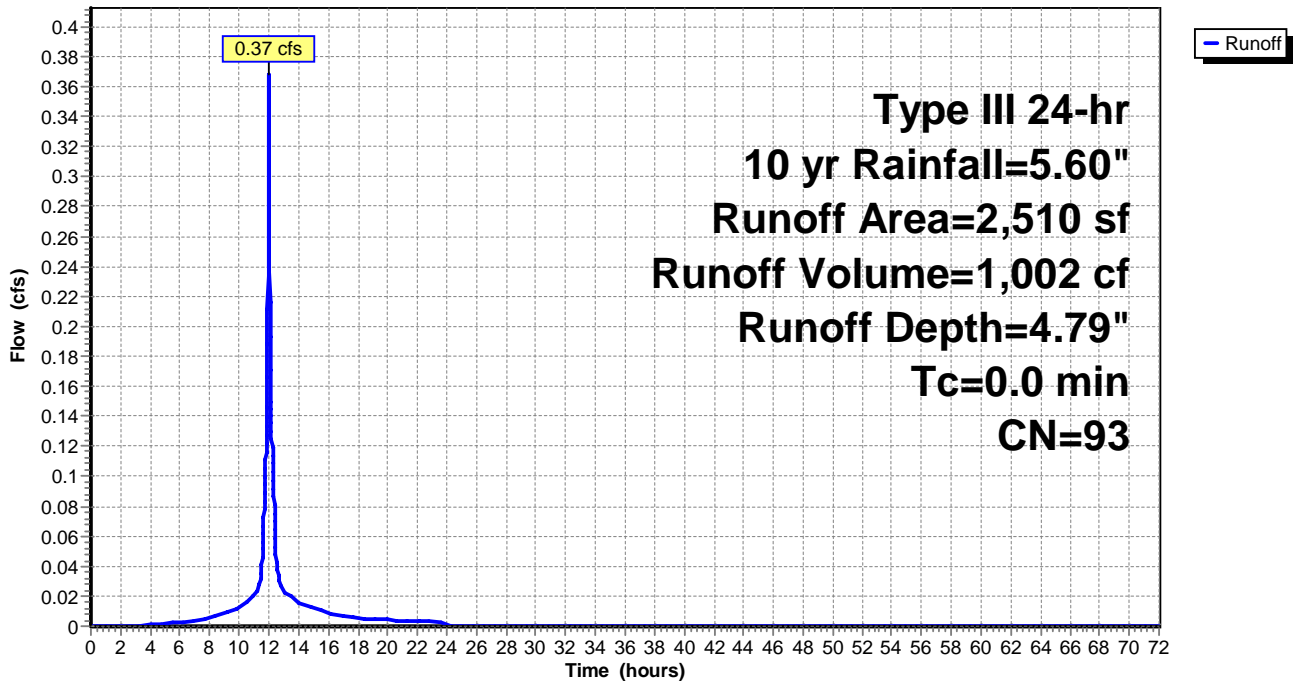

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 61

**Summary for Subcatchment 44:**


Runoff = 0.57 cfs @ 12.00 hrs, Volume= 1,670 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,738	98	Paved parking, HSG C
3,738		100.00% Impervious Area

**Subcatchment 44:**

**Hydrograph**

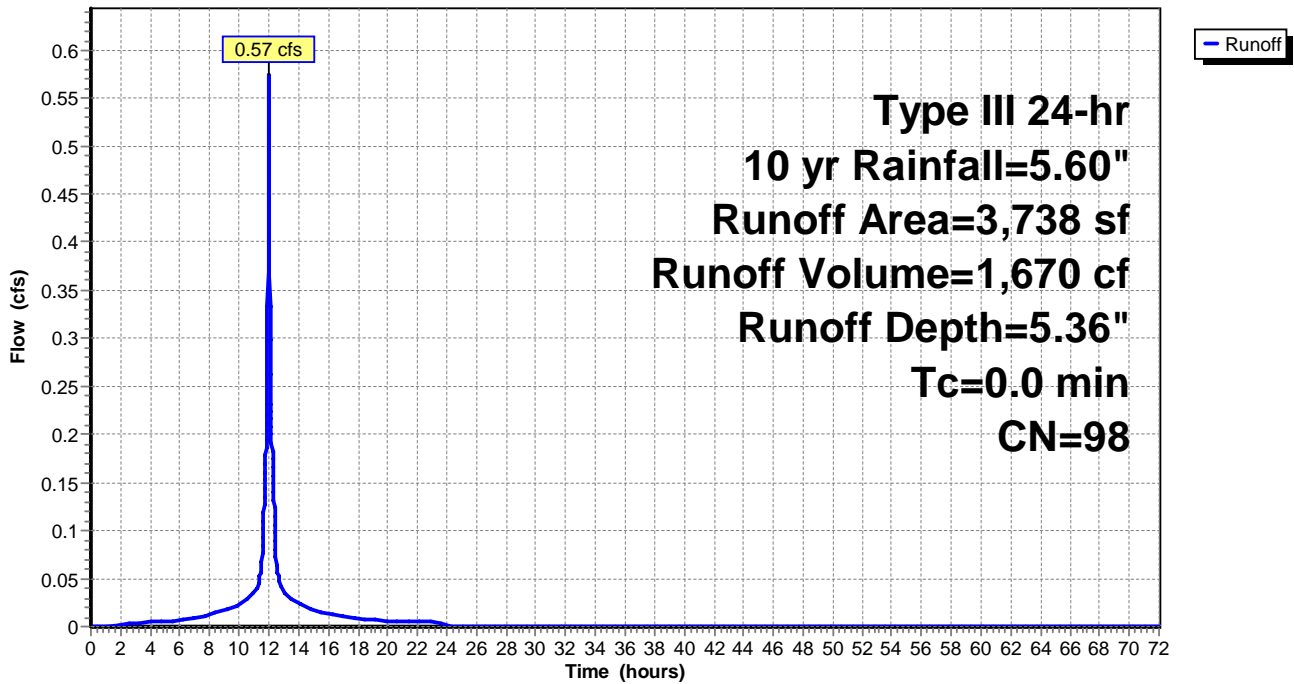



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 62

**Summary for Subcatchment 45:**


Runoff = 1.95 cfs @ 12.00 hrs, Volume= 4,955 cf, Depth= 3.52"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
4,856	98	Paved parking, HSG C
12,032	74	>75% Grass cover, Good, HSG C
16,888	81	Weighted Average
12,032		71.25% Pervious Area
4,856		28.75% Impervious Area

**Subcatchment 45:**

Hydrograph

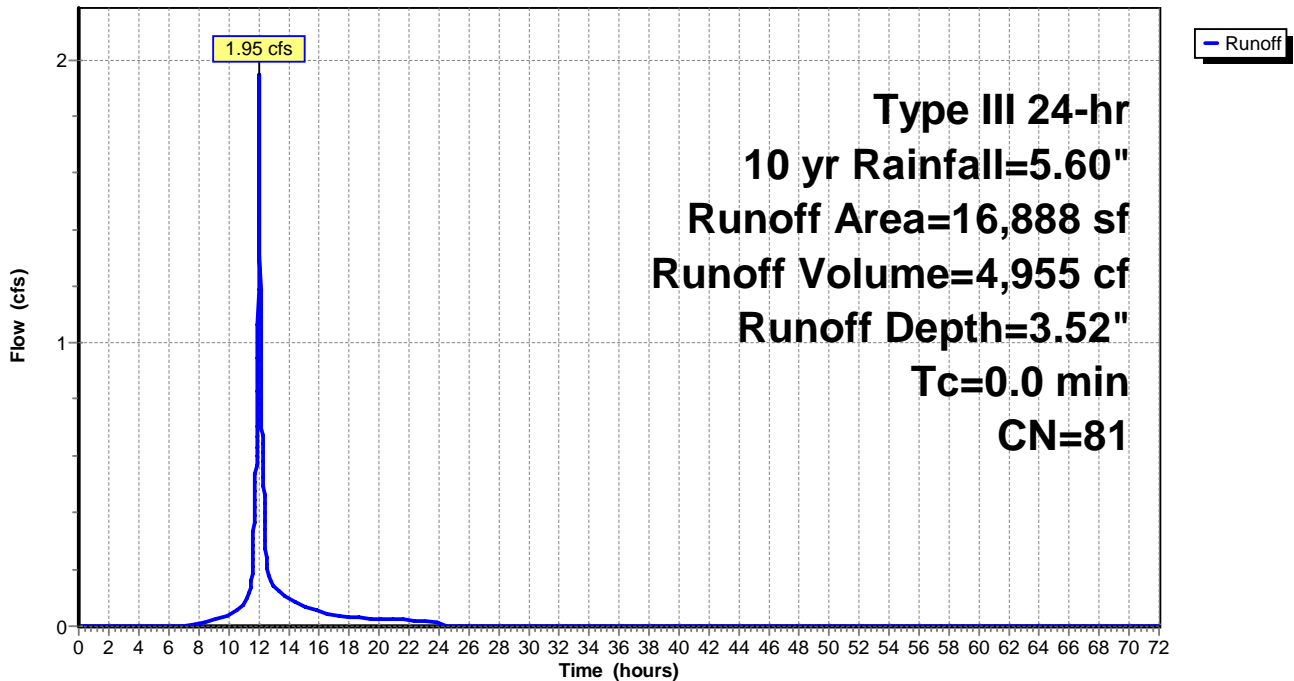

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 63

**Summary for Subcatchment 46:**


Runoff = 0.34 cfs @ 12.00 hrs, Volume= 983 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
2,200	98	Paved parking, HSG C
2,200		100.00% Impervious Area

**Subcatchment 46:**

Hydrograph

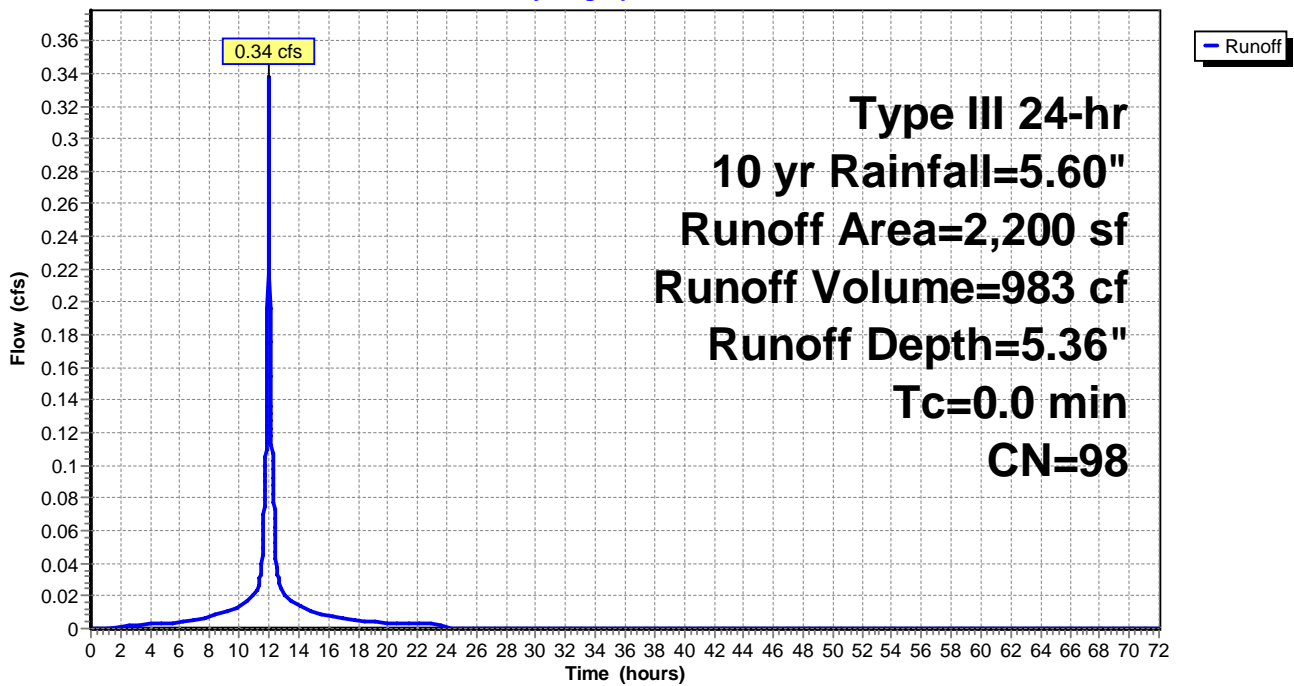

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 64

**Summary for Subcatchment 47:**


Runoff = 0.41 cfs @ 12.00 hrs, Volume= 1,086 cf, Depth= 4.46"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,982	98	Paved parking, HSG C
942	74	>75% Grass cover, Good, HSG C
2,924	90	Weighted Average
942		32.22% Pervious Area
1,982		67.78% Impervious Area

**Subcatchment 47:**

Hydrograph

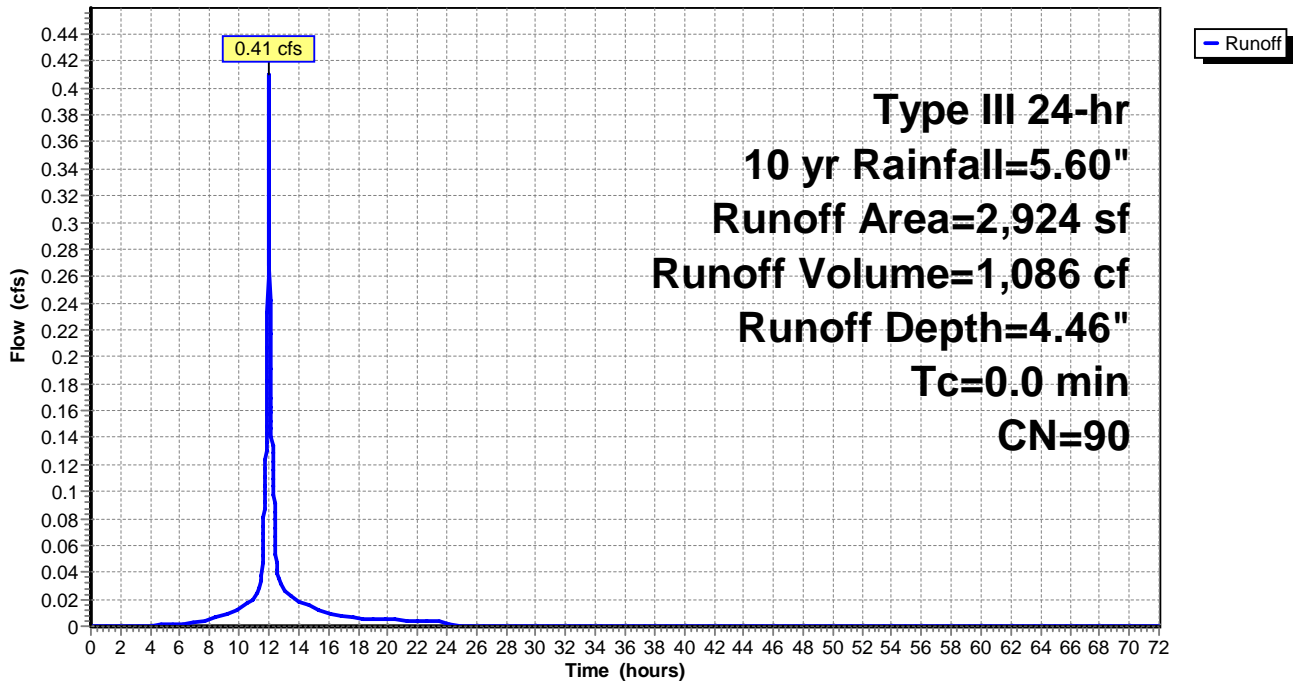

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 65

**Summary for Subcatchment 48:**


Runoff = 2.16 cfs @ 12.00 hrs, Volume= 6,271 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
14,033	98	Paved parking, HSG C
14,033		100.00% Impervious Area

**Subcatchment 48:**

Hydrograph

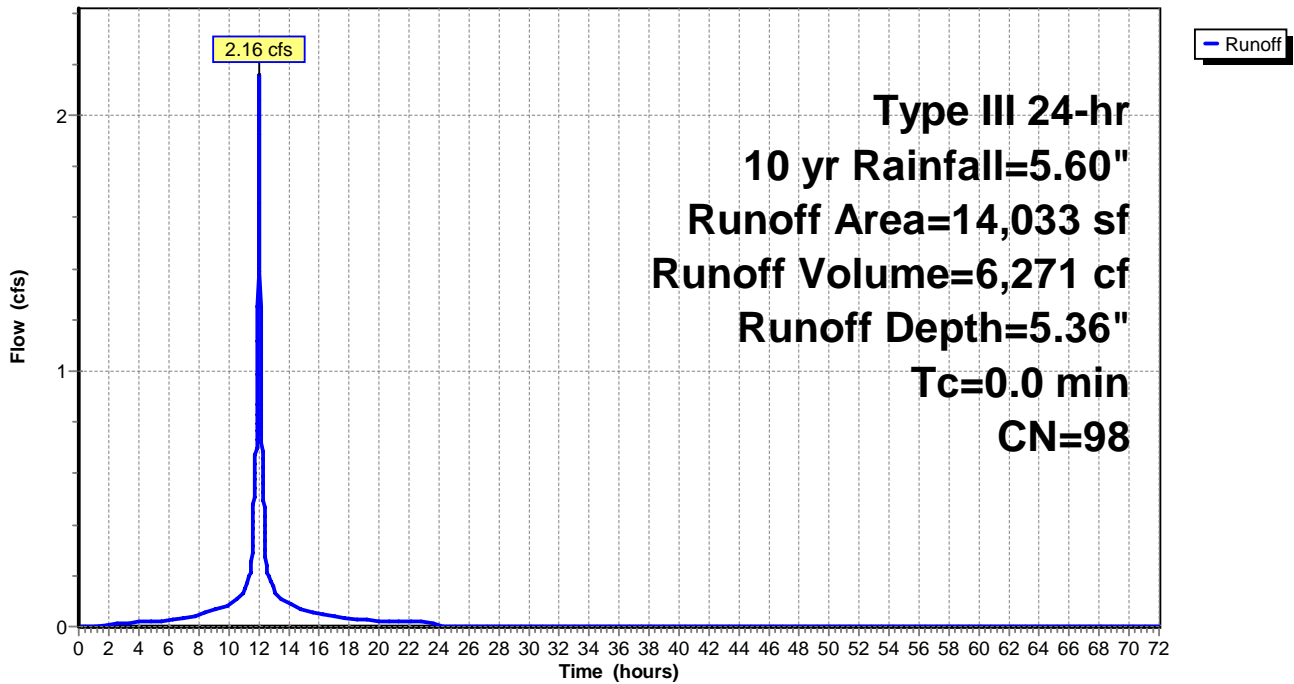

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 66

**Summary for Subcatchment 49:**


Runoff = 0.06 cfs @ 12.00 hrs, Volume= 186 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
417	98	Paved parking, HSG C
417		100.00% Impervious Area

**Subcatchment 49:**

**Hydrograph**

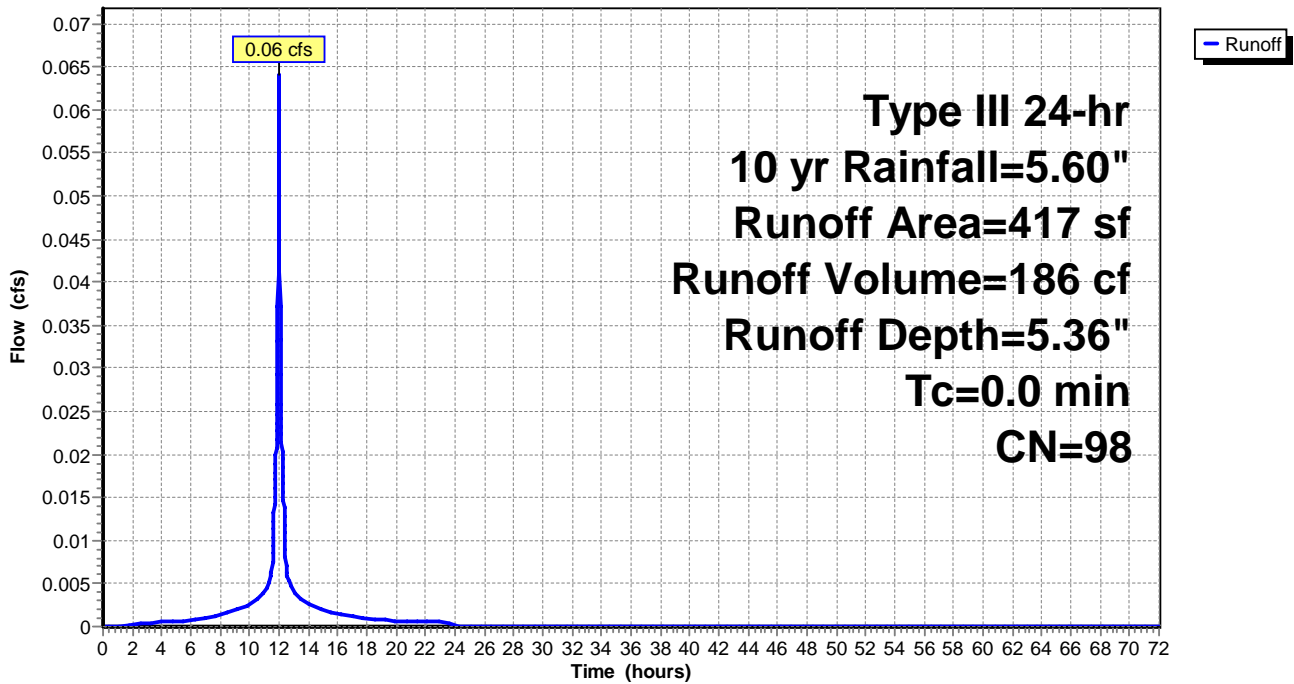

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 67

**Summary for Subcatchment 50:**


Runoff = 0.54 cfs @ 12.00 hrs, Volume= 1,573 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
3,520	98	Paved parking, HSG C
3,520		100.00% Impervious Area

**Subcatchment 50:**

**Hydrograph**

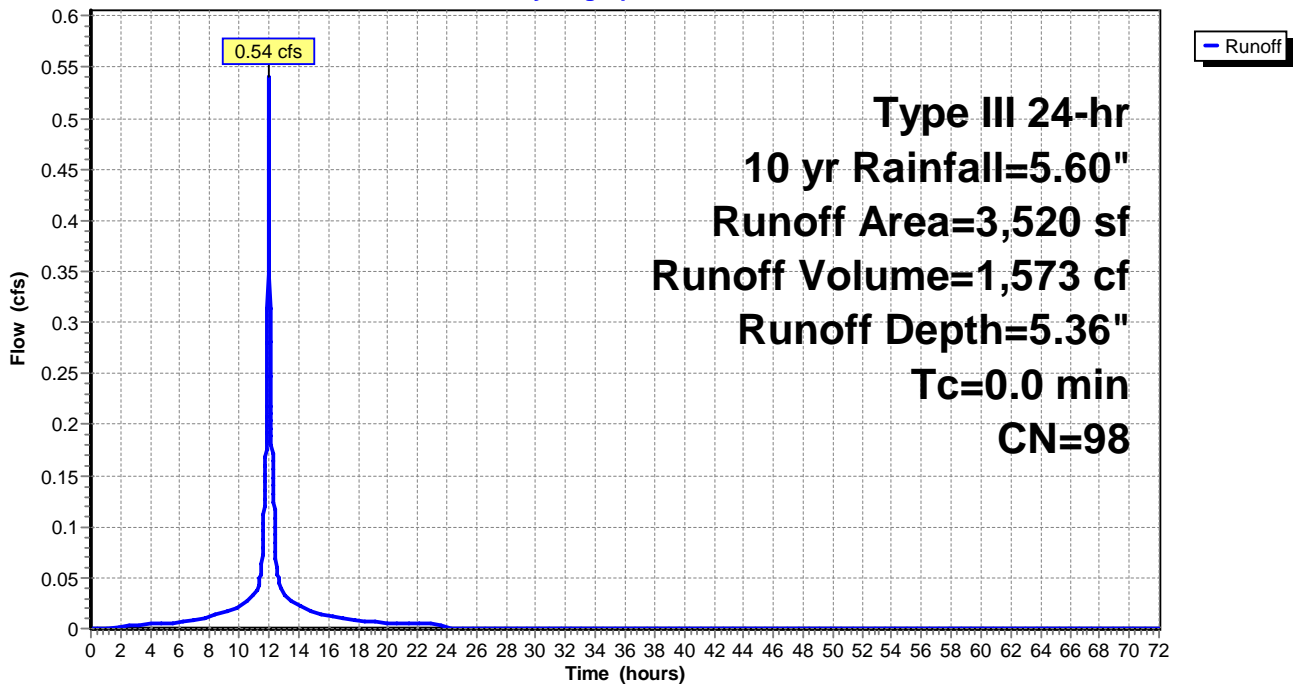

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 68

**Summary for Subcatchment 51:**


Runoff = 0.28 cfs @ 12.00 hrs, Volume= 825 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
1,846	98	Paved parking, HSG C
1,846		100.00% Impervious Area

**Subcatchment 51:**

Hydrograph

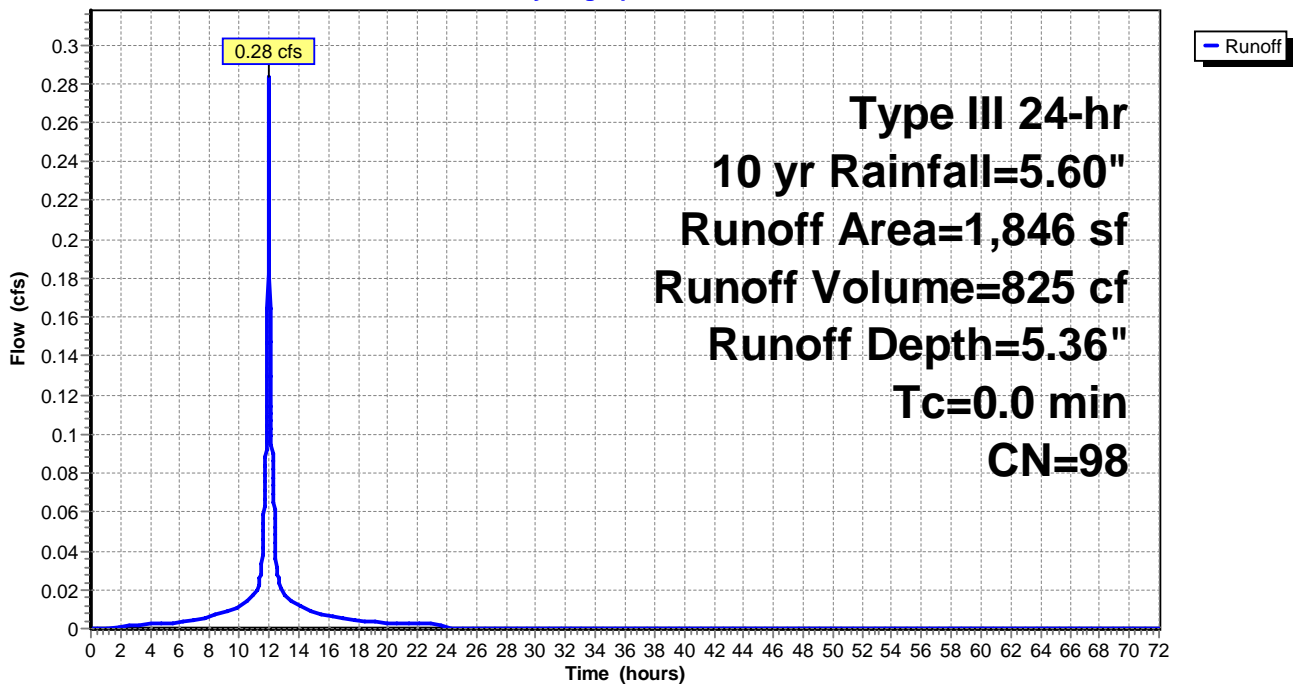

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 69

**Summary for Subcatchment 52:**


Runoff = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Type III 24-hr 10 yr Rainfall=5.60"

Area (sf)	CN	Description
4,381	98	Roofs, HSG C
4,381		100.00% Impervious Area

**Subcatchment 52:**

**Hydrograph**

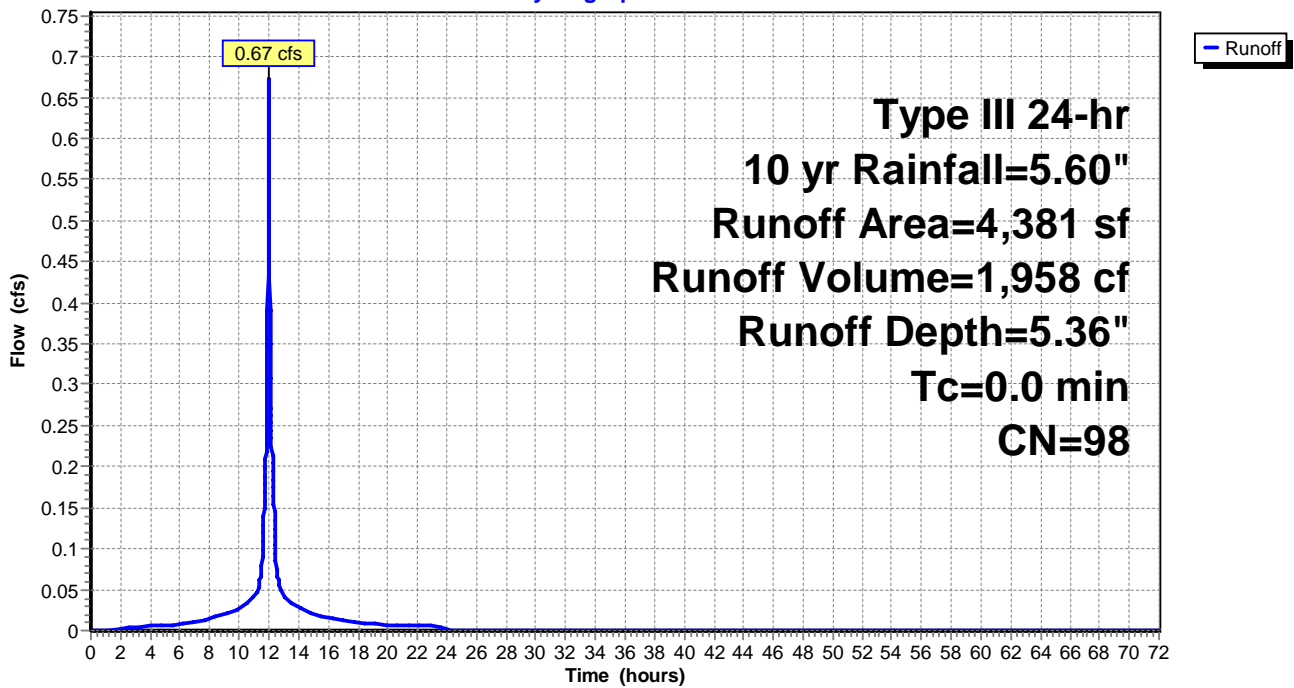



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 70

**Summary for Reach R1: Swale**

Inflow Area = 152,663 sf, 59.92% Impervious, Inflow Depth = 3.73" for 10 yr event  
Inflow = 12.27 cfs @ 12.07 hrs, Volume= 47,410 cf  
Outflow = 12.23 cfs @ 12.08 hrs, Volume= 47,410 cf, Atten= 0%, Lag= 0.5 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Max. Velocity= 3.51 fps, Min. Travel Time= 0.5 min  
Avg. Velocity = 1.01 fps, Avg. Travel Time= 1.7 min


Peak Storage= 348 cf @ 12.08 hrs  
Average Depth at Peak Storage= 0.60'  
Bank-Full Depth= 3.00' Flow Area= 39.0 sf, Capacity= 333.24 cfs

4.00' x 3.00' deep channel, n= 0.035 High grass  
Side Slope Z-value= 3.0 '/' Top Width= 22.00'  
Length= 100.0' Slope= 0.0200 '/'  
Inlet Invert= 17.00', Outlet Invert= 15.00'



**Reach R1: Swale**

**Hydrograph**

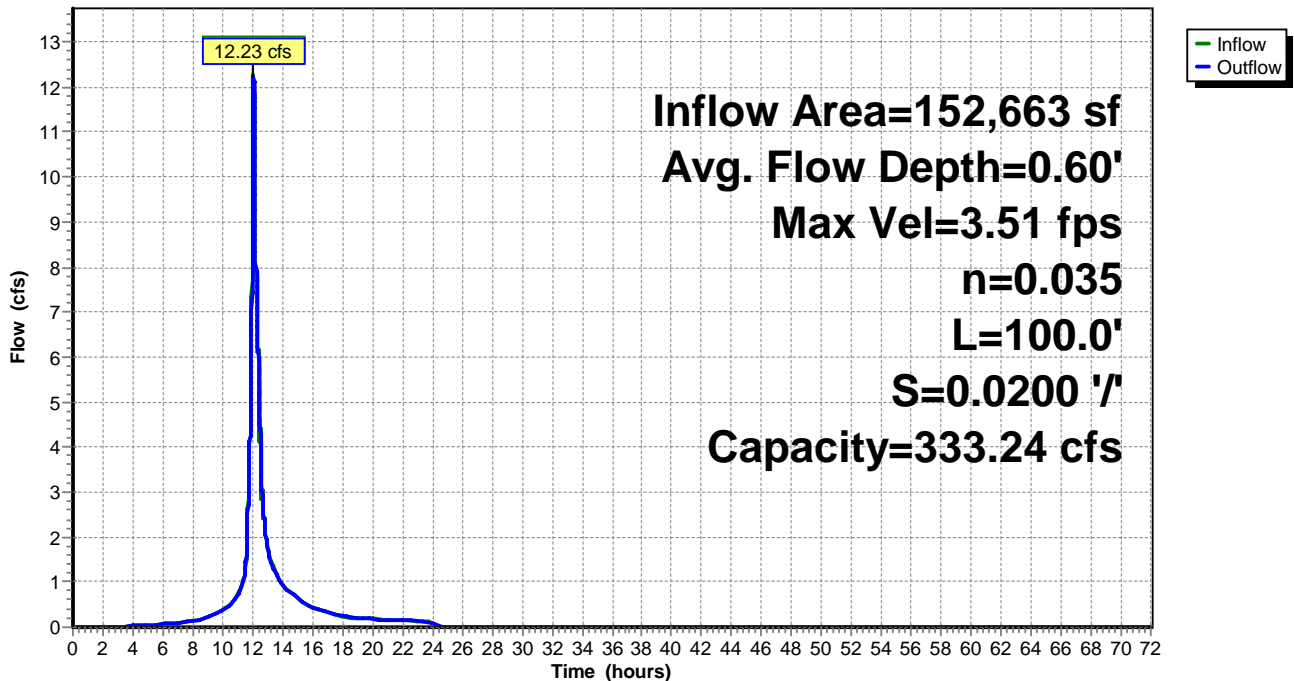

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 71


**Summary for Reach TB:**

Inflow Area = 28,429 sf, 52.39% Impervious, Inflow Depth = 4.09" for 10 yr event  
Inflow = 3.05 cfs @ 12.09 hrs, Volume= 9,695 cf  
Outflow = 3.05 cfs @ 12.09 hrs, Volume= 9,695 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Reach TB:**

Hydrograph

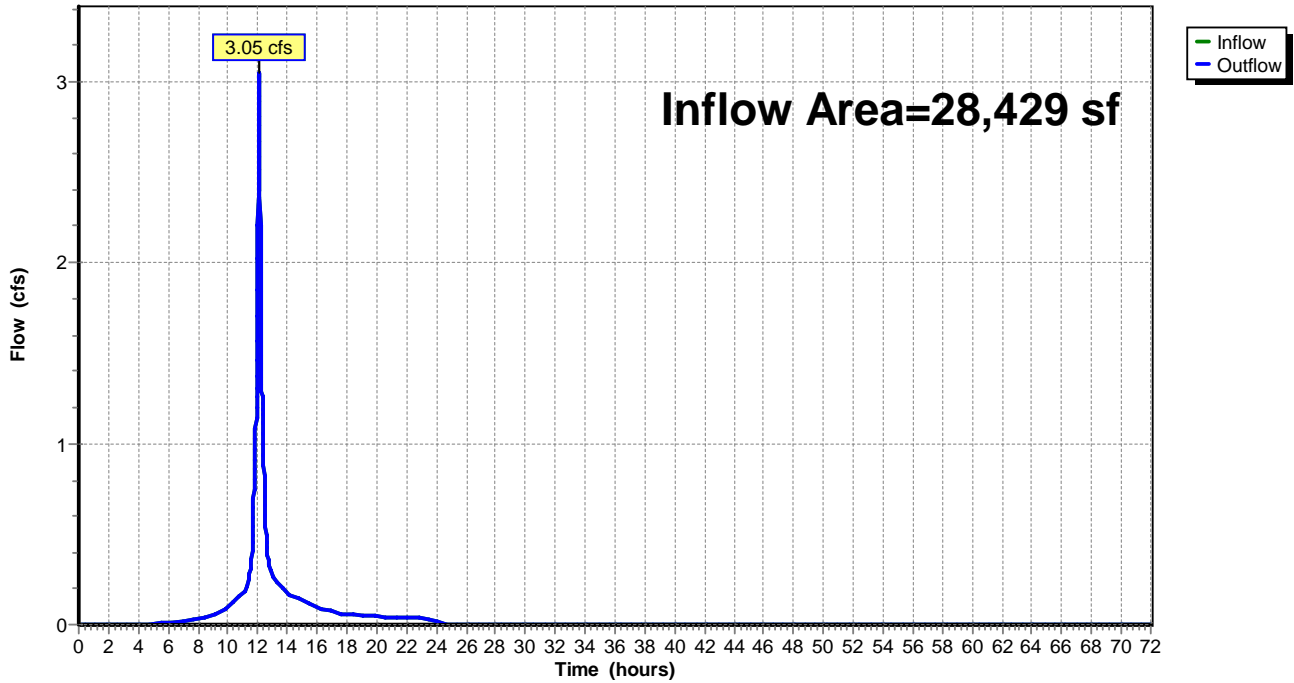

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 72

**Summary for Pond 27 BRB1:**

Inflow Area = 5,132 sf, 50.00% Impervious, Inflow Depth = 4.03" for 10 yr event  
 Inflow = 0.55 cfs @ 12.09 hrs, Volume= 1,724 cf  
 Outflow = 0.09 cfs @ 12.57 hrs, Volume= 1,724 cf, Atten= 84%, Lag= 28.8 min  
 Primary = 0.09 cfs @ 12.57 hrs, Volume= 1,724 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 16.01' @ 12.57 hrs Surf.Area= 1,212 sf Storage= 565 cf  
 Flood Elev= 16.00' Surf.Area= 1,209 sf Storage= 555 cf

Plug-Flow detention time= 54.4 min calculated for 1,723 cf (100% of inflow)  
 Center-of-Mass det. time= 54.4 min ( 854.6 - 800.2 )

Volume	Invert	Avail.Storage	Storage Description			
#1	15.50'	1,966 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
15.50	1,013	192.9	0	0	1,013	
16.00	1,209	199.1	555	555	1,230	
16.50	1,411	205.5	654	1,209	1,459	
17.00	1,620	211.7	757	1,966	1,690	

Device	Routing	Invert	Outlet Devices	
#1	Primary	12.43'	<b>12.0" Round Culvert</b> L= 26.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 12.43' / 12.30' S= 0.0049 ' / ' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf	
#2	Device 1	12.91'	<b>6.0" Vert. Orifice/Grate</b> C= 0.600	
#3	Device 2	15.50'	<b>2.410 in/hr Exfiltration over Surface area</b> Conductivity to Groundwater Elevation = 12.40' Phase-In= 0.01'	
#4	Device 1	16.00'	<b>15.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads	

**Primary OutFlow** Max=0.09 cfs @ 12.57 hrs HW=16.01' TW=12.37' (Dynamic Tailwater)

- ↑ **1=Culvert** (Passes 0.09 cfs of 6.64 cfs potential flow)
- ↑ **2=Orifice/Grate** (Passes 0.08 cfs of 1.60 cfs potential flow)
- ↑ **3=Exfiltration** ( Controls 0.08 cfs)
- ↑ **4=Orifice/Grate** (Weir Controls 0.01 cfs @ 0.30 fps)

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC


Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 73

**Pond 27 BRB1:**

**Hydrograph**

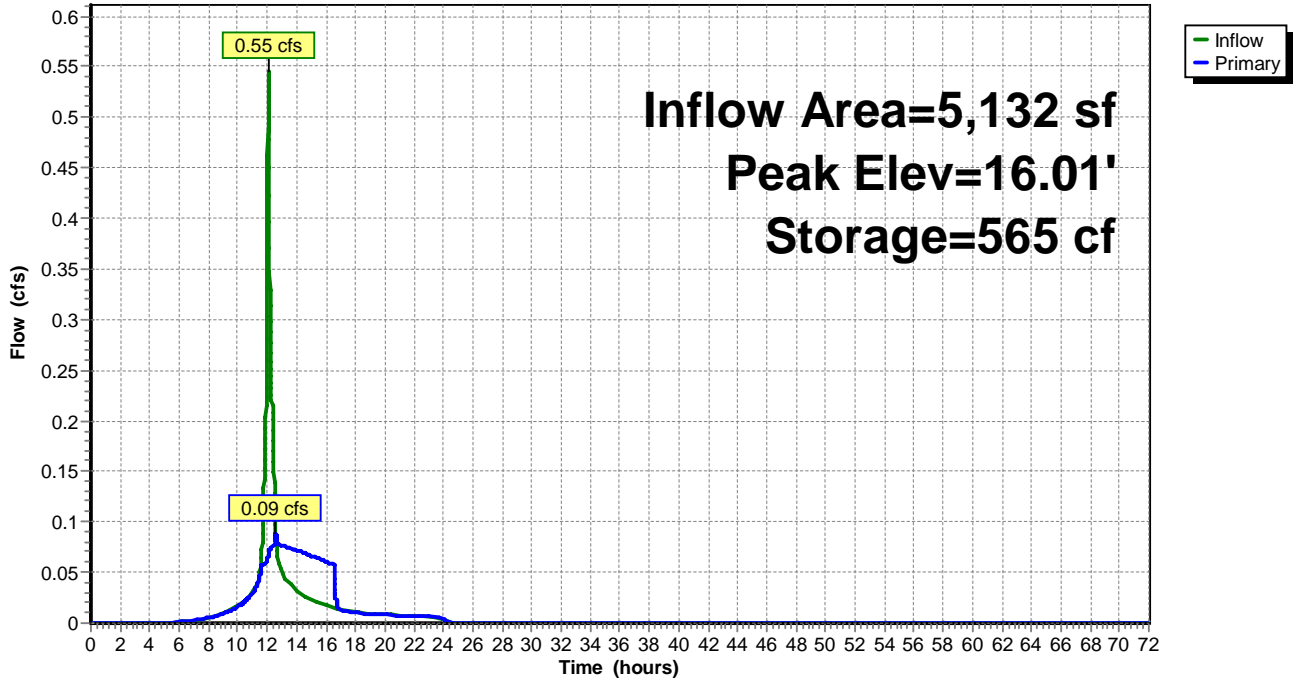

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 74

**Summary for Pond 30 DB1:**

Inflow Area = 21,025 sf, 90.30% Impervious, Inflow Depth = 5.09" for 10 yr event  
 Inflow = 2.60 cfs @ 12.08 hrs, Volume= 8,920 cf  
 Outflow = 1.84 cfs @ 12.16 hrs, Volume= 8,918 cf, Atten= 29%, Lag= 4.3 min  
 Primary = 1.03 cfs @ 12.16 hrs, Volume= 957 cf  
 Secondary = 0.83 cfs @ 12.11 hrs, Volume= 7,961 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 14.42' @ 12.16 hrs Surf.Area= 1,170 sf Storage= 1,250 cf

Plug-Flow detention time= 19.0 min calculated for 8,918 cf (100% of inflow)  
 Center-of-Mass det. time= 18.8 min ( 780.1 - 761.3 )

Volume	Invert	Avail.Storage	Storage Description
#1A	12.80'	1,087 cf	<b>25.25'W x 46.34'L x 3.50'H Field A</b> 4,095 cf Overall - 1,378 cf Embedded = 2,717 cf x 40.0% Voids
#2A	13.30'	1,378 cf	<b>ADS_StormTech SC-740 +Cap</b> x 30 Inside #1 Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap 5 Rows of 6 Chambers
		2,465 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	13.80'	<b>12.0" Round Culvert</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 13.80' / 13.75' S= 0.0250 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Secondary	12.80'	<b>6.0" Round Culvert</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 12.80' / 12.80' S= 0.0000 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.20 sf

**Primary OutFlow** Max=1.02 cfs @ 12.16 hrs HW=14.42' TW=13.69' (Dynamic Tailwater)↑**1=Culvert** (Barrel Controls 1.02 cfs @ 2.89 fps)**Secondary OutFlow** Max=0.81 cfs @ 12.11 hrs HW=14.32' TW=13.58' (Dynamic Tailwater)↑**2=Culvert** (Inlet Controls 0.81 cfs @ 4.15 fps)

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 75

**Pond 30 DB1: - Chamber Wizard Field A**

**Chamber Model = ADS\_StormTech SC-740 +Cap (ADS StormTech® SC-740 with cap length)**

Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf

Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

6 Chambers/Row x 7.12' Long +0.81' Cap Length x 2 = 44.34' Row Length +12.0" End Stone x 2 = 46.34' Base Length

5 Rows x 51.0" Wide + 6.0" Spacing x 4 + 12.0" Side Stone x 2 = 25.25' Base Width

6.0" Base + 30.0" Chamber Height + 6.0" Cover = 3.50' Field Height

30 Chambers x 45.9 cf = 1,378.2 cf Chamber Storage

4,095.0 cf Field - 1,378.2 cf Chambers = 2,716.8 cf Stone x 40.0% Voids = 1,086.7 cf Stone Storage

Chamber Storage + Stone Storage = 2,464.9 cf = 0.057 af



Overall Storage Efficiency = 60.2%

Overall System Size = 46.34' x 25.25' x 3.50'

30 Chambers

151.7 cy Field

100.6 cy Stone

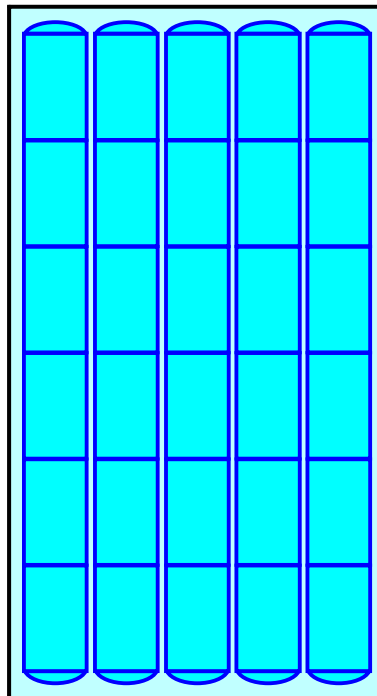

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC


Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 76

**Pond 30 DB1:**

Hydrograph

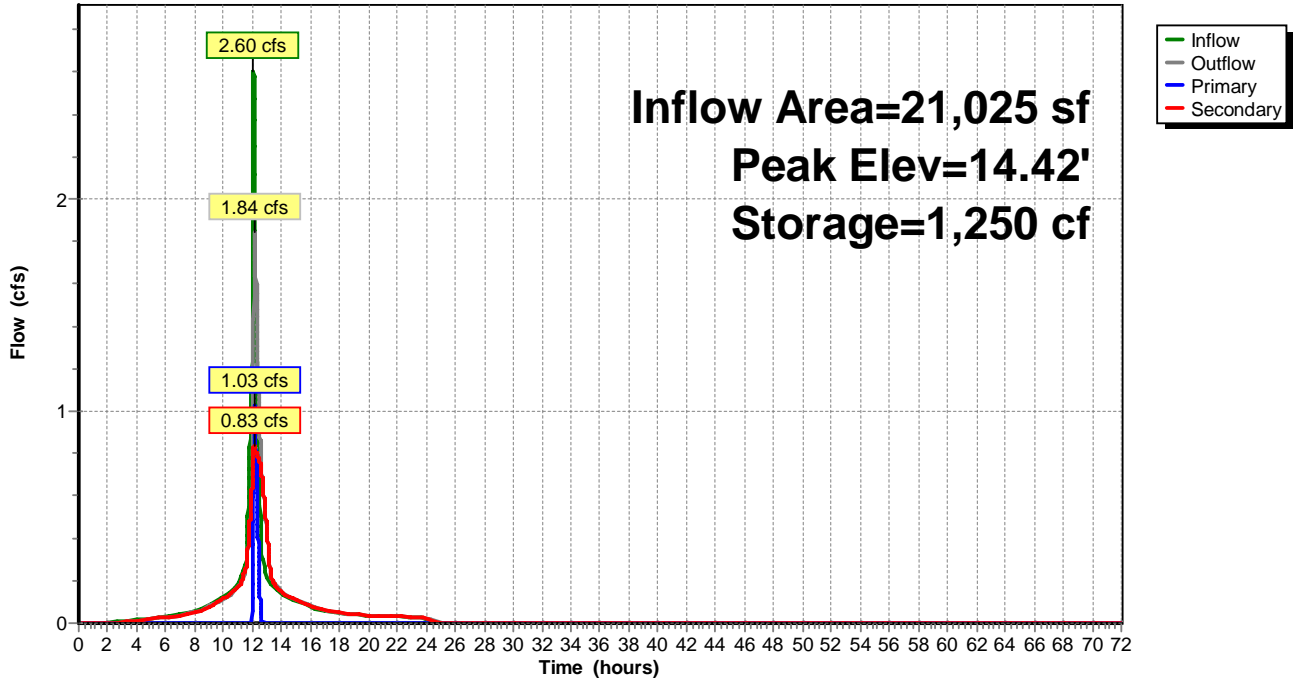

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 77

**Summary for Pond 36 DB2:**

Inflow Area = 9,435 sf, 92.15% Impervious, Inflow Depth = 5.13" for 10 yr event  
 Inflow = 1.17 cfs @ 12.08 hrs, Volume= 4,033 cf  
 Outflow = 0.71 cfs @ 12.18 hrs, Volume= 4,032 cf, Atten= 39%, Lag= 5.9 min  
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf  
 Secondary = 0.71 cfs @ 12.18 hrs, Volume= 4,032 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 17.23' @ 12.18 hrs Surf.Area= 823 sf Storage= 470 cf

Plug-Flow detention time= 17.7 min calculated for 4,032 cf (100% of inflow)  
 Center-of-Mass det. time= 17.5 min ( 777.3 - 759.8 )

Volume	Invert	Avail.Storage	Storage Description
#1A	16.25'	785 cf	<b>11.00'W x 74.82'L x 3.50'H Field A</b> 2,880 cf Overall - 919 cf Embedded = 1,962 cf x 40.0% Voids
#2A	16.75'	919 cf	<b>ADS_StormTech SC-740 +Cap</b> x 20 Inside #1 Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap 2 Rows of 10 Chambers
		1,703 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	17.79'	<b>12.0" Round Culvert</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.79' / 17.75' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Secondary	16.25'	<b>6.0" Round Culvert</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 16.25' / 16.25' S= 0.0000 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.20 sf

**Primary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=16.25' TW=16.15' (Dynamic Tailwater)↑**1=Culvert** ( Controls 0.00 cfs)**Secondary OutFlow** Max=0.71 cfs @ 12.18 hrs HW=17.23' TW=16.66' (Dynamic Tailwater)↑**2=Culvert** (Inlet Controls 0.71 cfs @ 3.63 fps)



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 78

**Pond 36 DB2: - Chamber Wizard Field A**

**Chamber Model = ADS\_StormTech SC-740 +Cap (ADS StormTech® SC-740 with cap length)**

Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf

Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

10 Chambers/Row x 7.12' Long +0.81' Cap Length x 2 = 72.82' Row Length +12.0" End Stone x 2 = 74.82' Base Length

2 Rows x 51.0" Wide + 6.0" Spacing x 1 + 12.0" Side Stone x 2 = 11.00' Base Width

6.0" Base + 30.0" Chamber Height + 6.0" Cover = 3.50' Field Height

20 Chambers x 45.9 cf = 918.8 cf Chamber Storage

2,880.4 cf Field - 918.8 cf Chambers = 1,961.6 cf Stone x 40.0% Voids = 784.7 cf Stone Storage

Chamber Storage + Stone Storage = 1,703.5 cf = 0.039 af


Overall Storage Efficiency = 59.1%

Overall System Size = 74.82' x 11.00' x 3.50'

20 Chambers

106.7 cy Field

72.7 cy Stone



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC


Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 79

**Pond 36 DB2:**

**Hydrograph**

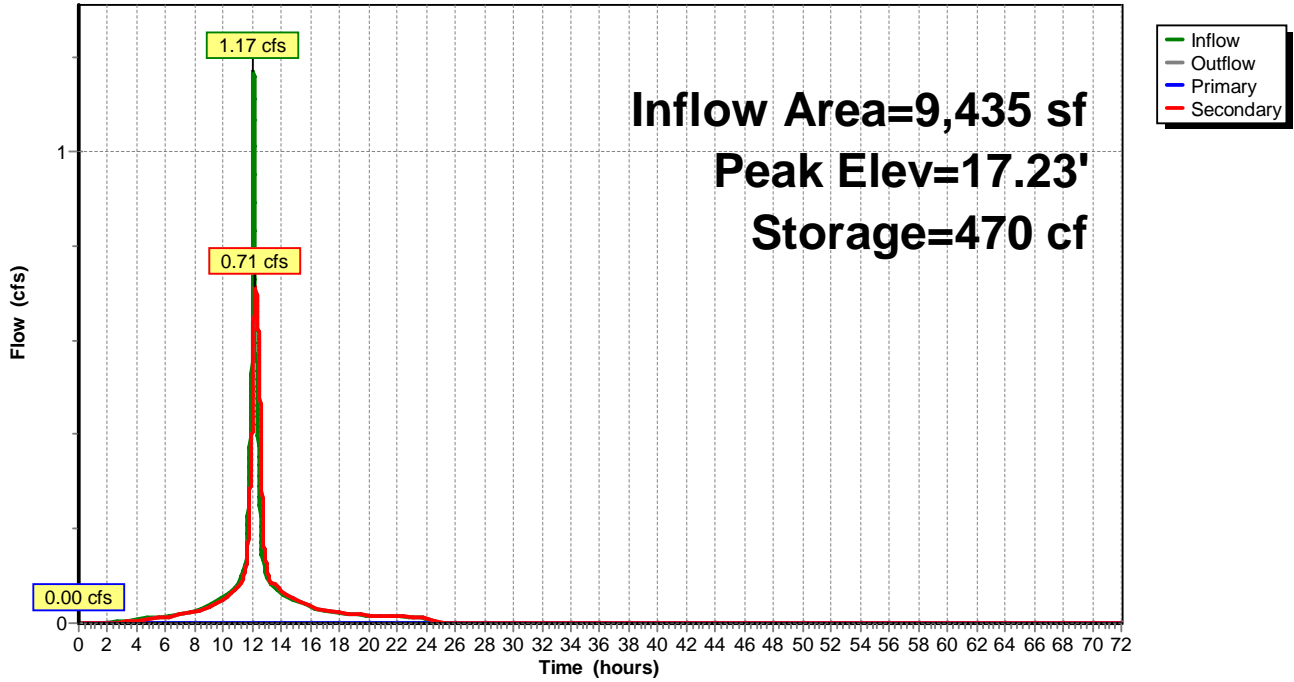

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 80

**Summary for Pond 41 BRB2:**

Inflow Area = 12,705 sf, 65.30% Impervious, Inflow Depth = 4.46" for 10 yr event  
 Inflow = 1.46 cfs @ 12.08 hrs, Volume= 4,719 cf  
 Outflow = 0.89 cfs @ 12.19 hrs, Volume= 4,719 cf, Atten= 39%, Lag= 6.0 min  
 Primary = 0.89 cfs @ 12.19 hrs, Volume= 4,719 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 18.15' @ 12.19 hrs Surf.Area= 1,840 sf Storage= 1,113 cf  
 Flood Elev= 19.50' Surf.Area= 2,215 sf Storage= 2,826 cf

Plug-Flow detention time= 49.6 min calculated for 4,719 cf (100% of inflow)  
 Center-of-Mass det. time= 49.6 min ( 836.5 - 786.9 )

Volume	Invert	Avail.Storage	Storage Description			
#1	17.50'	2,826 cf	<b>Rain Garden 5 (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
17.50	1,563	208.2	0	0	1,563	
18.00	1,774	214.5	834	834	1,800	
18.50	1,992	220.7	941	1,775	2,041	
19.00	2,215	227.0	1,051	2,826	2,291	

Device	Routing	Invert	Outlet Devices	
#1	Primary	14.43'	<b>12.0" Round Culvert</b> L= 20.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 14.43' / 14.33' S= 0.0050 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf	
#2	Device 1	14.93'	<b>6.0" Vert. Orifice/Grate</b> C= 0.600	
#3	Device 2	17.50'	<b>2.410 in/hr Exfiltration over Surface area</b> Conductivity to Groundwater Elevation = 12.40' Phase-In= 0.01'	
#4	Device 1	18.00'	<b>15.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads	

**Primary OutFlow** Max=0.89 cfs @ 12.19 hrs HW=18.15' TW=13.49' (Dynamic Tailwater)

- ↑ **1=Culvert** (Passes 0.89 cfs of 6.79 cfs potential flow)
- ↑ **2=Orifice/Grate** (Passes 0.11 cfs of 1.63 cfs potential flow)
- ↑ **3=Exfiltration** ( Controls 0.11 cfs)
- ↑ **4=Orifice/Grate** (Weir Controls 0.78 cfs @ 1.28 fps)

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC


Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 81

**Pond 41 BRB2:**

Hydrograph

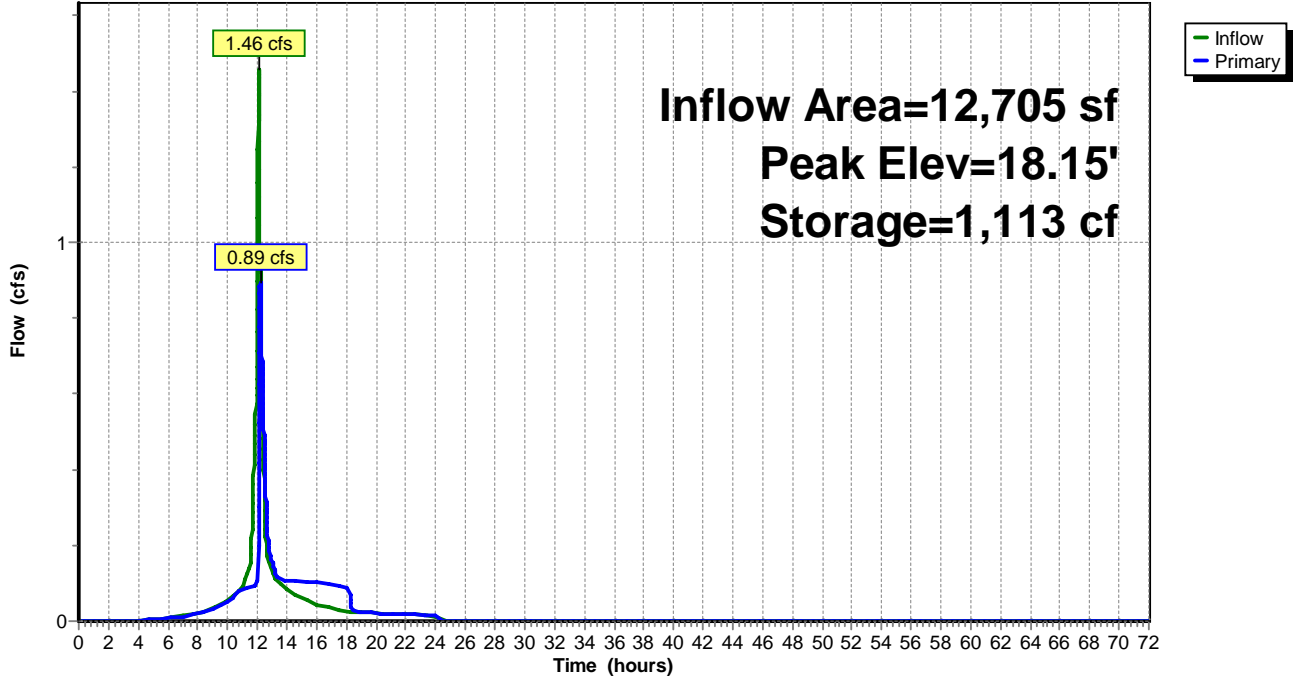

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 82

**Summary for Pond 50 IB3:**

Inflow Area = 91,377 sf, 70.56% Impervious, Inflow Depth = 4.58" for 10 yr event  
 Inflow = 10.66 cfs @ 12.08 hrs, Volume= 34,882 cf  
 Outflow = 3.71 cfs @ 12.35 hrs, Volume= 34,882 cf, Atten= 65%, Lag= 16.2 min  
 Discarded = 0.60 cfs @ 12.35 hrs, Volume= 19,218 cf  
 Primary = 3.11 cfs @ 12.35 hrs, Volume= 15,665 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.92' @ 12.35 hrs Surf.Area= 8,685 sf Storage= 11,574 cf

Plug-Flow detention time= 77.6 min calculated for 34,882 cf (100% of inflow)  
 Center-of-Mass det. time= 77.6 min ( 859.1 - 781.5 )

Volume	Invert	Avail.Storage	Storage Description
#1A	18.00'	7,712 cf	<b>106.00'W x 81.94'L x 3.50'H Field A</b> 30,399 cf Overall - 11,117 cf Embedded = 19,281 cf x 40.0% Voids
#2A	18.50'	11,117 cf	<b>ADS_StormTech SC-740 +Cap</b> x 242 Inside #1 Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap 22 Rows of 11 Chambers
		18,830 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	18.00'	<b>0.970 in/hr Exfiltration over Wetted area</b> Conductivity to Groundwater Elevation = 17.00' Phase-In= 0.01'
#2	Primary	18.60'	<b>12.0" Round Overflow</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.60' / 18.55' S= 0.0250 ' /' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Discarded OutFlow** Max=0.60 cfs @ 12.35 hrs HW=19.92' (Free Discharge)

↑**1=Exfiltration** ( Controls 0.60 cfs)

**Primary OutFlow** Max=3.11 cfs @ 12.35 hrs HW=19.92' TW=16.57' (Dynamic Tailwater)

↑**2=Overflow** (Barrel Controls 3.11 cfs @ 3.97 fps)

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 83

**Pond 50 IB3: - Chamber Wizard Field A**

**Chamber Model = ADS\_StormTech SC-740 +Cap (ADS StormTech® SC-740 with cap length)**

Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf

Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

11 Chambers/Row x 7.12' Long +0.81' Cap Length x 2 = 79.94' Row Length +12.0" End Stone x 2 = 81.94' Base Length

22 Rows x 51.0" Wide + 6.0" Spacing x 21 + 12.0" Side Stone x 2 = 106.00' Base Width

6.0" Base + 30.0" Chamber Height + 6.0" Cover = 3.50' Field Height

242 Chambers x 45.9 cf = 11,117.5 cf Chamber Storage

30,398.5 cf Field - 11,117.5 cf Chambers = 19,281.0 cf Stone x 40.0% Voids = 7,712.4 cf Stone Storage

Chamber Storage + Stone Storage = 18,829.9 cf = 0.432 af


Overall Storage Efficiency = 61.9%

Overall System Size = 81.94' x 106.00' x 3.50'

242 Chambers

1,125.9 cy Field

714.1 cy Stone

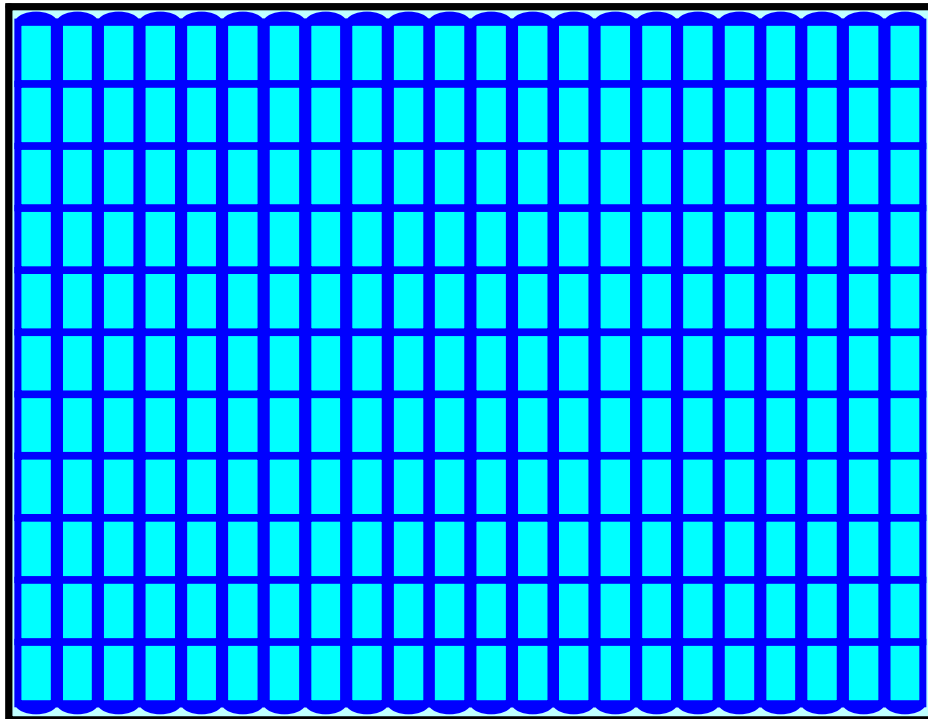

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC


Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 84

**Pond 50 IB3:**

**Hydrograph**

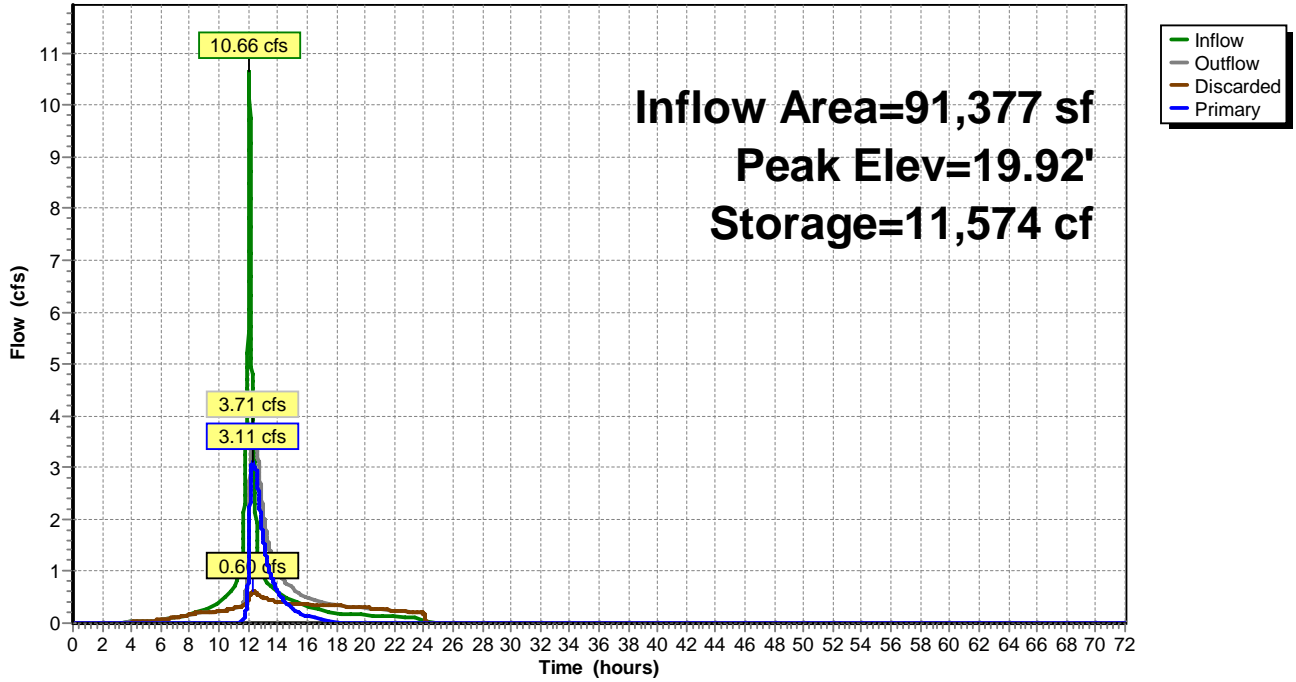

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 85

**Summary for Pond 58 IB2:**

Inflow Area = 28,518 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 3.59 cfs @ 12.08 hrs, Volume= 12,744 cf  
 Outflow = 2.49 cfs @ 12.16 hrs, Volume= 12,744 cf, Atten= 31%, Lag= 4.8 min  
 Discarded = 0.13 cfs @ 12.16 hrs, Volume= 5,691 cf  
 Primary = 2.36 cfs @ 12.16 hrs, Volume= 7,053 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.64' @ 12.16 hrs Surf.Area= 2,264 sf Storage= 2,492 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)  
 Center-of-Mass det. time= 52.5 min ( 798.7 - 746.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	18.00'	2,066 cf	<b>20.50'W x 110.42'L x 3.50'H Field A</b> 7,922 cf Overall - 2,756 cf Embedded = 5,166 cf x 40.0% Voids
#2A	18.50'	2,756 cf	<b>ADS_StormTech SC-740 +Cap</b> x 60 Inside #1 Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap 4 Rows of 15 Chambers
		4,823 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	18.00'	<b>0.970 in/hr Exfiltration over Surface area</b> Conductivity to Groundwater Elevation = 17.00'
#2	Primary	18.60'	<b>12.0" Round Overflow</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.60' / 18.55' S= 0.0250 ' /' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Discarded OutFlow** Max=0.13 cfs @ 12.16 hrs HW=19.64' (Free Discharge)

↑**1=Exfiltration** ( Controls 0.13 cfs)

**Primary OutFlow** Max=2.36 cfs @ 12.16 hrs HW=19.64' TW=16.90' (Dynamic Tailwater)

↑**2=Overflow** (Barrel Controls 2.36 cfs @ 3.59 fps)



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 86

**Pond 58 IB2: - Chamber Wizard Field A**

**Chamber Model = ADS\_StormTech SC-740 +Cap (ADS StormTech® SC-740 with cap length)**

Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf

Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

15 Chambers/Row x 7.12' Long +0.81' Cap Length x 2 = 108.42' Row Length +12.0" End Stone x 2 = 110.42' Base Length

4 Rows x 51.0" Wide + 6.0" Spacing x 3 + 12.0" Side Stone x 2 = 20.50' Base Width

6.0" Base + 30.0" Chamber Height + 6.0" Cover = 3.50' Field Height

60 Chambers x 45.9 cf = 2,756.4 cf Chamber Storage

7,922.4 cf Field - 2,756.4 cf Chambers = 5,166.0 cf Stone x 40.0% Voids = 2,066.4 cf Stone Storage

Chamber Storage + Stone Storage = 4,822.8 cf = 0.111 af


Overall Storage Efficiency = 60.9%

Overall System Size = 110.42' x 20.50' x 3.50'

60 Chambers

293.4 cy Field

191.3 cy Stone

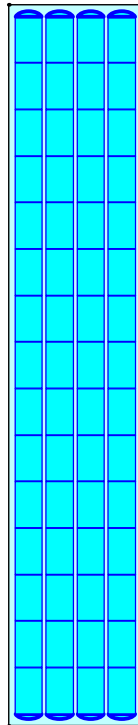

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC


Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 87

**Pond 58 IB2:**

Hydrograph

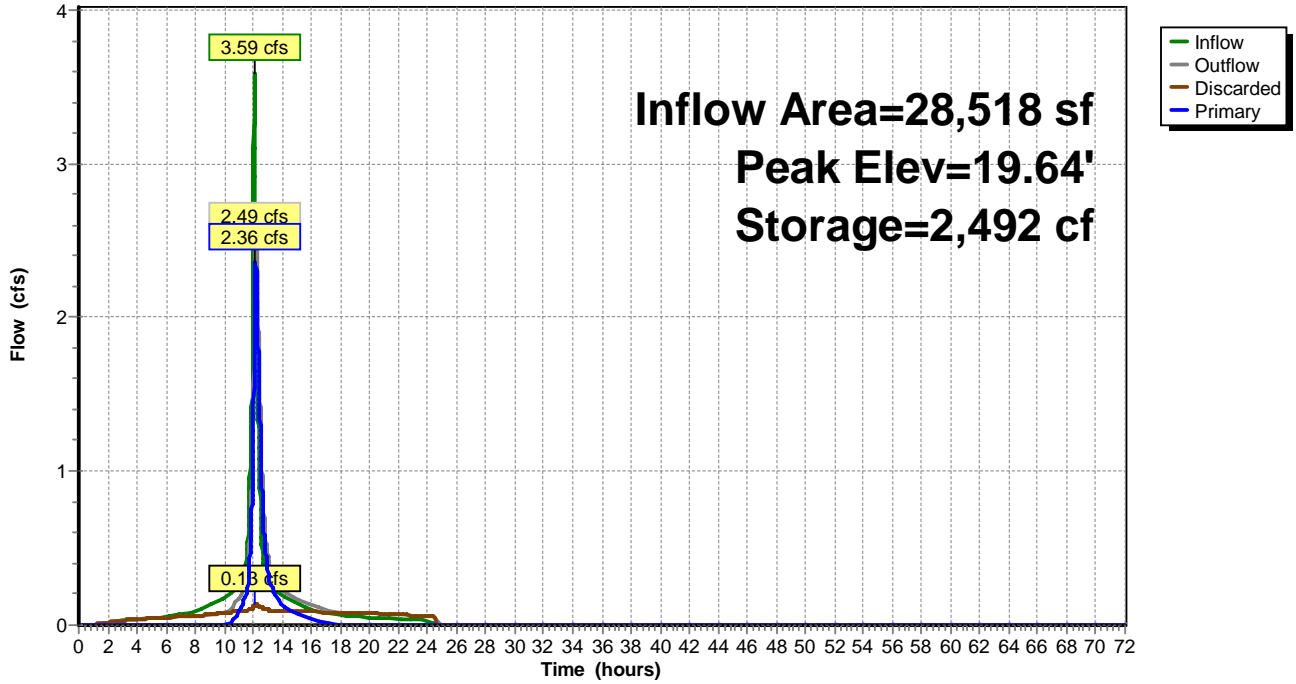

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 88

**Summary for Pond 60 RD B:**

Inflow Area = 28,518 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 3.59 cfs @ 12.08 hrs, Volume= 12,744 cf  
 Outflow = 3.59 cfs @ 12.08 hrs, Volume= 12,744 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 3.59 cfs @ 12.08 hrs, Volume= 12,744 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 90.05' @ 12.09 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	20.78'	<b>6.0" Round Culvert</b> L= 116.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.78' / 20.20' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.20 sf

**Primary OutFlow** Max=3.58 cfs @ 12.08 hrs HW=89.78' TW=34.73' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 3.58 cfs @ 18.22 fps)

**Pond 60 RD B:**

Hydrograph

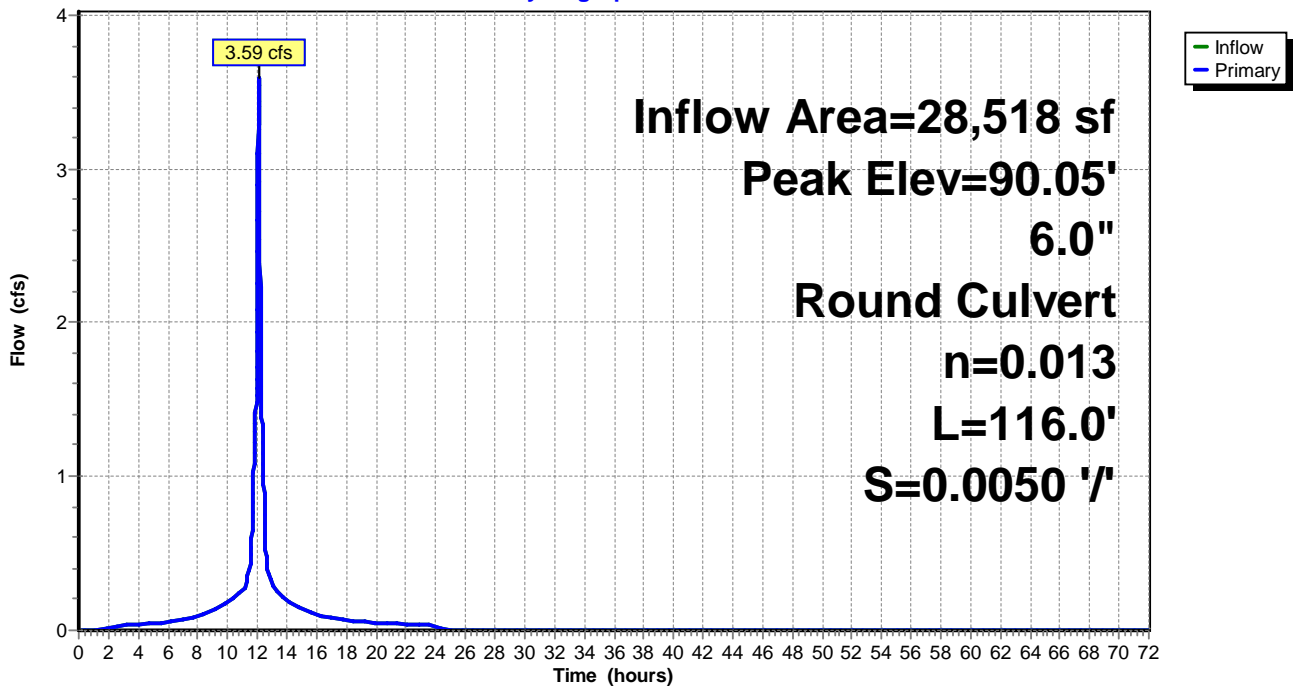

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 89

**Summary for Pond 60 WQU 2:**

Inflow Area = 106,303 sf, 86.53% Impervious, Inflow Depth = 4.96" for 10 yr event  
 Inflow = 13.02 cfs @ 12.08 hrs, Volume= 43,956 cf  
 Outflow = 13.02 cfs @ 12.08 hrs, Volume= 43,956 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 13.02 cfs @ 12.08 hrs, Volume= 43,956 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 203.84' @ 12.11 hrs  
 Flood Elev= 25.16'

Device #1	Routing	Invert	Outlet Devices
	Primary	18.05'	<b>12.0" Round Culvert</b> L= 90.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.05' / 17.60' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=8.07 cfs @ 12.08 hrs HW=184.88' TW=177.79' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 8.07 cfs @ 10.28 hrs)

**Pond 60 WQU 2:**

Hydrograph

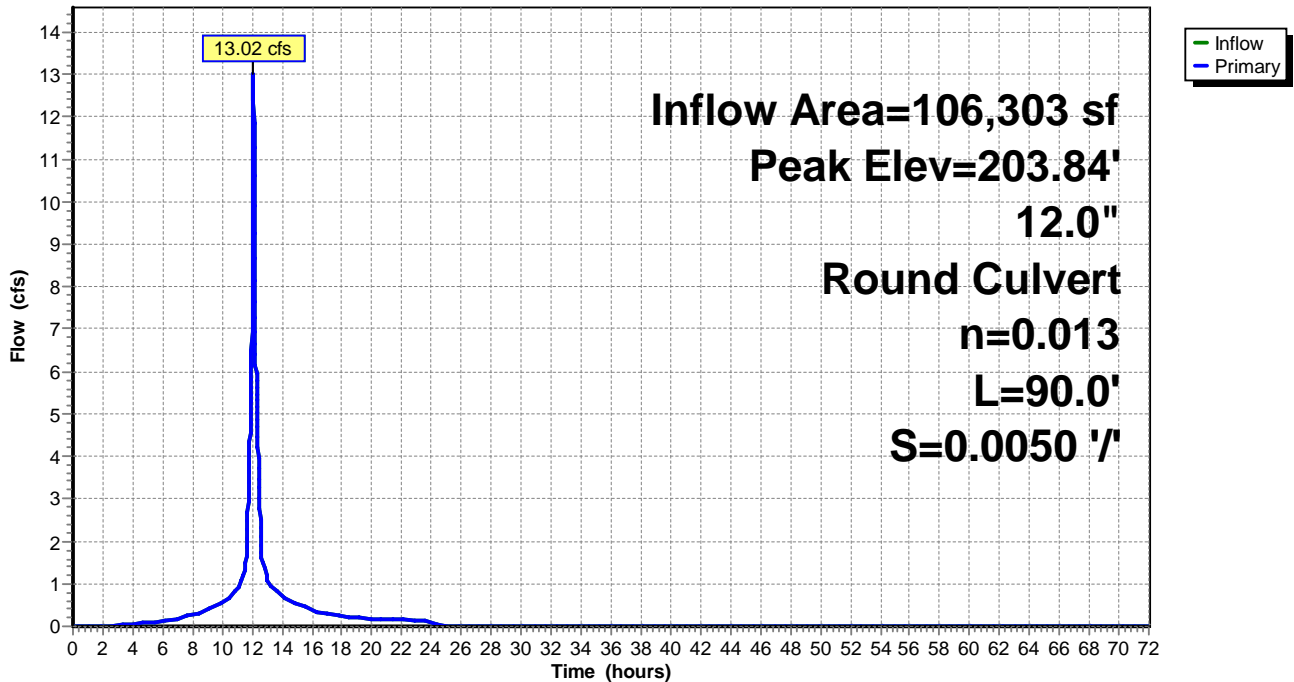

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 90

**Summary for Pond 1071:**

Inflow Area = 130,716 sf, 81.98% Impervious, Inflow Depth = 4.85" for 10 yr event  
Inflow = 15.74 cfs @ 12.08 hrs, Volume= 52,795 cf  
Outflow = 15.74 cfs @ 12.08 hrs, Volume= 52,795 cf, Atten= 0%, Lag= 0.0 min  
Primary = 15.74 cfs @ 12.08 hrs, Volume= 52,795 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Peak Elev= 187.35' @ 12.10 hrs  
Flood Elev= 22.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	17.50'	<b>12.0" Round Culvert</b> L= 31.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.50' / 17.30' S= 0.0065 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 0.79 sf

**Primary OutFlow** Max=13.78 cfs @ 12.08 hrs HW=177.99' TW=153.60' (Dynamic Tailwater)  
↑ **1=Culvert** (Outlet Controls 13.78 cfs @ 17.55 fps)

**Pond 1071:**

Hydrograph

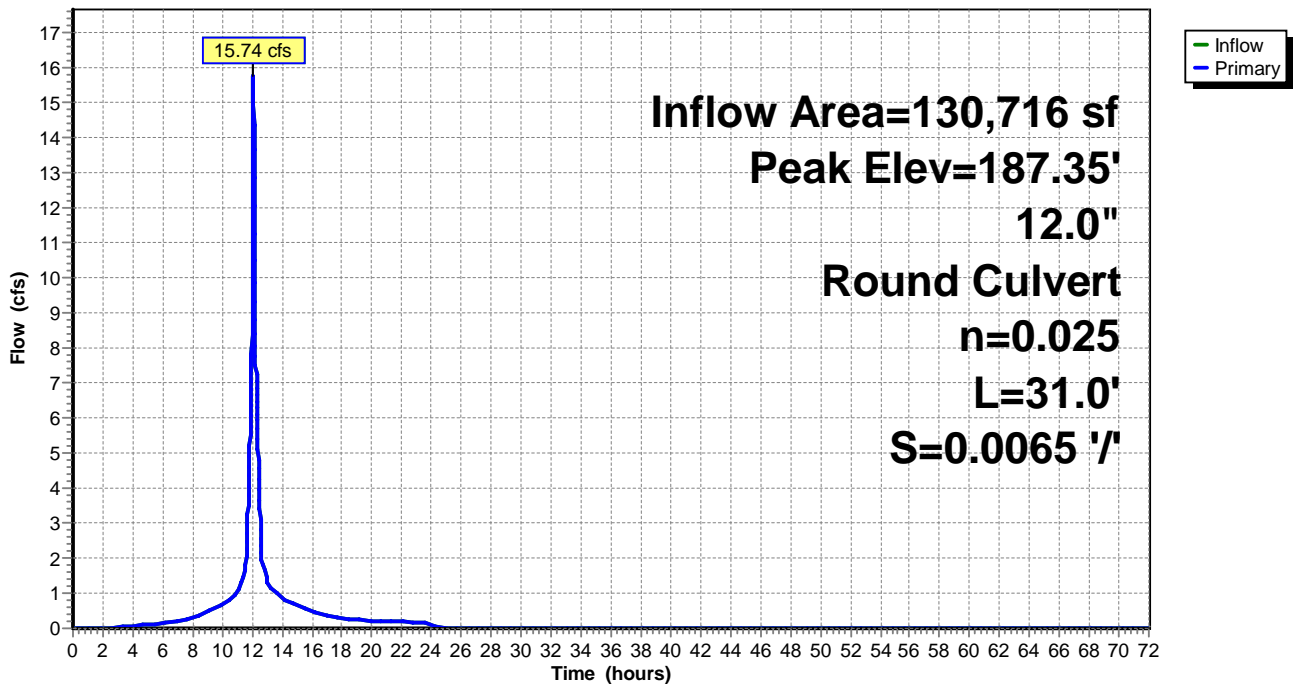

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 91

**Summary for Pond 1072:**

Inflow Area = 160,042 sf, 83.01% Impervious, Inflow Depth = 4.88" for 10 yr event  
 Inflow = 19.29 cfs @ 12.08 hrs, Volume= 65,104 cf  
 Outflow = 19.29 cfs @ 12.08 hrs, Volume= 65,104 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 19.29 cfs @ 12.08 hrs, Volume= 65,104 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 157.45' @ 12.10 hrs  
 Flood Elev= 22.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	17.10'	<b>15.0" Round Culvert</b> L= 31.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.10' / 15.90' S= 0.0387 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 1.23 sf

**Primary OutFlow** Max=17.04 cfs @ 12.08 hrs HW=153.59' TW=141.09' (Dynamic Tailwater)  
 ← **1=Culvert** (Outlet Controls 17.04 cfs @ 13.89 fps)

**Pond 1072:**

Hydrograph

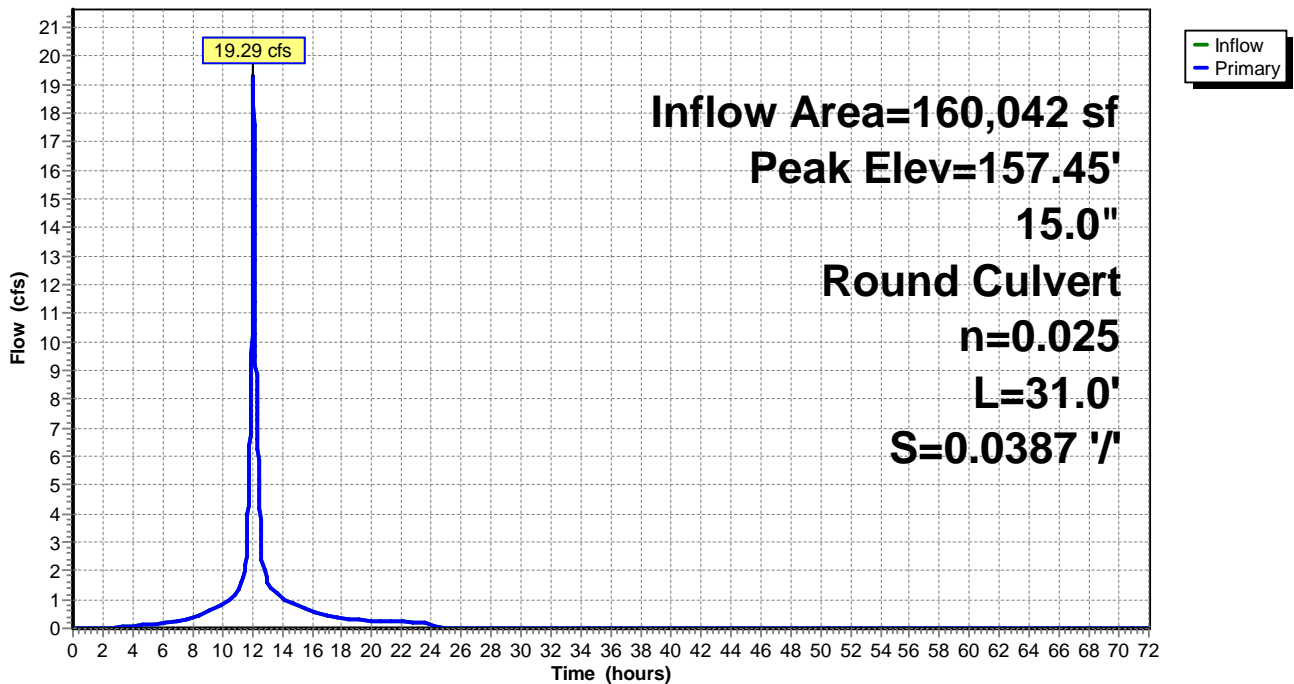

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 92

**Summary for Pond 1346:**

Inflow Area = 160,042 sf, 83.01% Impervious, Inflow Depth = 4.88" for 10 yr event  
 Inflow = 19.29 cfs @ 12.08 hrs, Volume= 65,104 cf  
 Outflow = 19.29 cfs @ 12.08 hrs, Volume= 65,104 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 19.29 cfs @ 12.08 hrs, Volume= 65,104 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 69.04' @ 12.08 hrs  
 Flood Elev= 25.00'

Device #1	Routing	Invert	Outlet Devices
	Primary	15.70'	<b>15.0" Round Culvert</b> L= 143.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 15.70' / 14.70' S= 0.0070 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 1.23 sf

**Primary OutFlow** Max=19.26 cfs @ 12.08 hrs HW=68.85' TW=0.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 19.26 cfs @ 15.69 fps)

**Pond 1346:**

**Hydrograph**

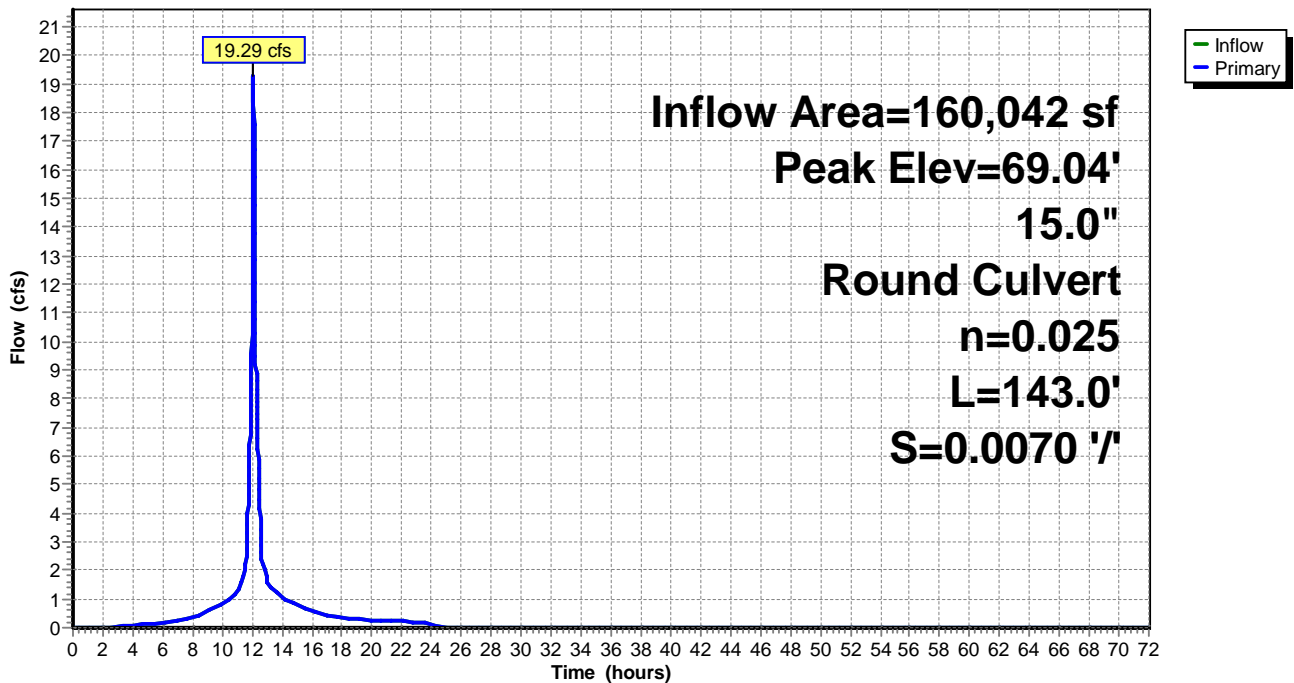

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 93

**Summary for Pond 1347:**

Inflow Area = 160,042 sf, 83.01% Impervious, Inflow Depth = 4.88" for 10 yr event  
 Inflow = 19.29 cfs @ 12.08 hrs, Volume= 65,104 cf  
 Outflow = 19.29 cfs @ 12.08 hrs, Volume= 65,104 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 19.29 cfs @ 12.08 hrs, Volume= 65,104 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 141.87' @ 12.09 hrs  
 Flood Elev= 23.90'

Device #1	Routing	Invert	Outlet Devices
	Primary	15.90'	<b>15.0" Round Culvert</b> L= 204.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 15.90' / 15.80' S= 0.0005 '/ Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 1.23 sf

**Primary OutFlow** Max=19.16 cfs @ 12.08 hrs HW=141.09' TW=68.85' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 19.16 cfs @ 15.61 fps)

**Pond 1347:**

Hydrograph

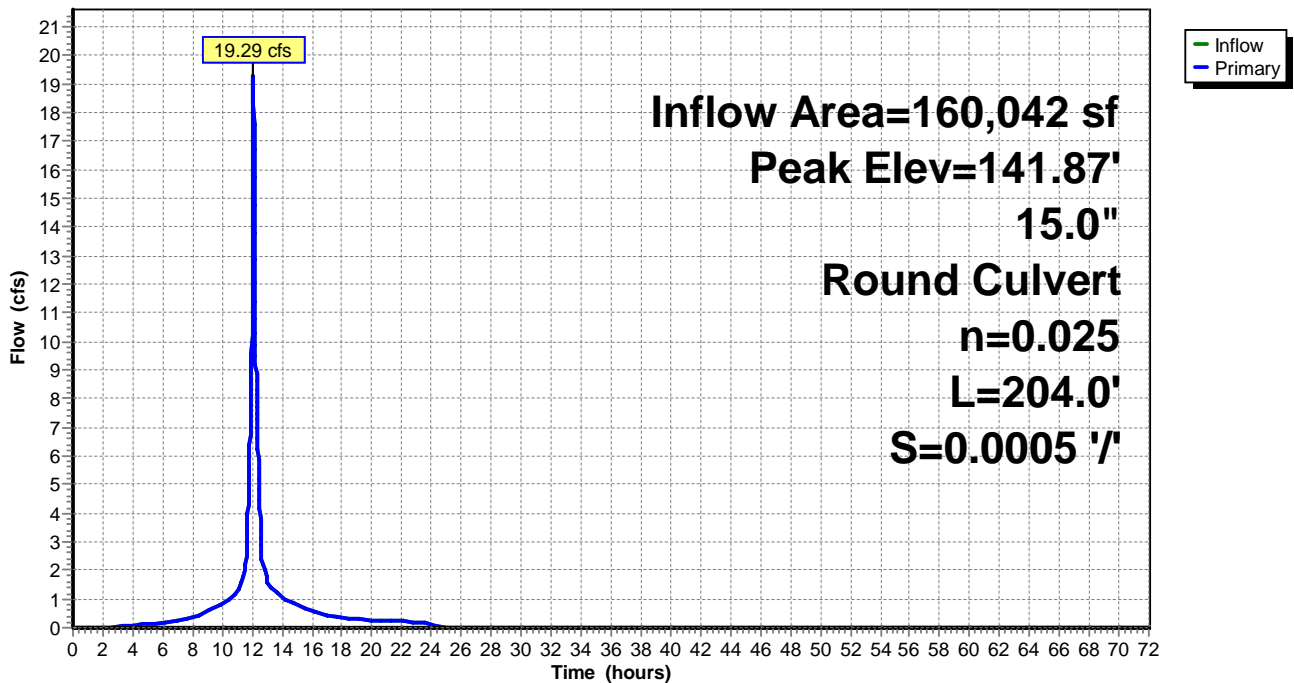



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 94

**Summary for Pond CB10:**

Inflow Area = 18,464 sf, 86.68% Impervious, Inflow Depth = 5.01" for 10 yr event  
 Inflow = 2.27 cfs @ 12.08 hrs, Volume= 7,716 cf  
 Outflow = 2.27 cfs @ 12.08 hrs, Volume= 7,716 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.27 cfs @ 12.08 hrs, Volume= 7,716 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 20.25' @ 12.10 hrs  
 Flood Elev= 24.11'

Device #1	Routing	Invert	Outlet Devices
	Primary	18.87'	<b>12.0" Round Culvert</b> L= 56.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.87' / 18.37' S= 0.0089 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=2.09 cfs @ 12.08 hrs HW=20.14' TW=19.80' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 2.09 cfs @ 2.70 fps)

**Pond CB10:**

Hydrograph

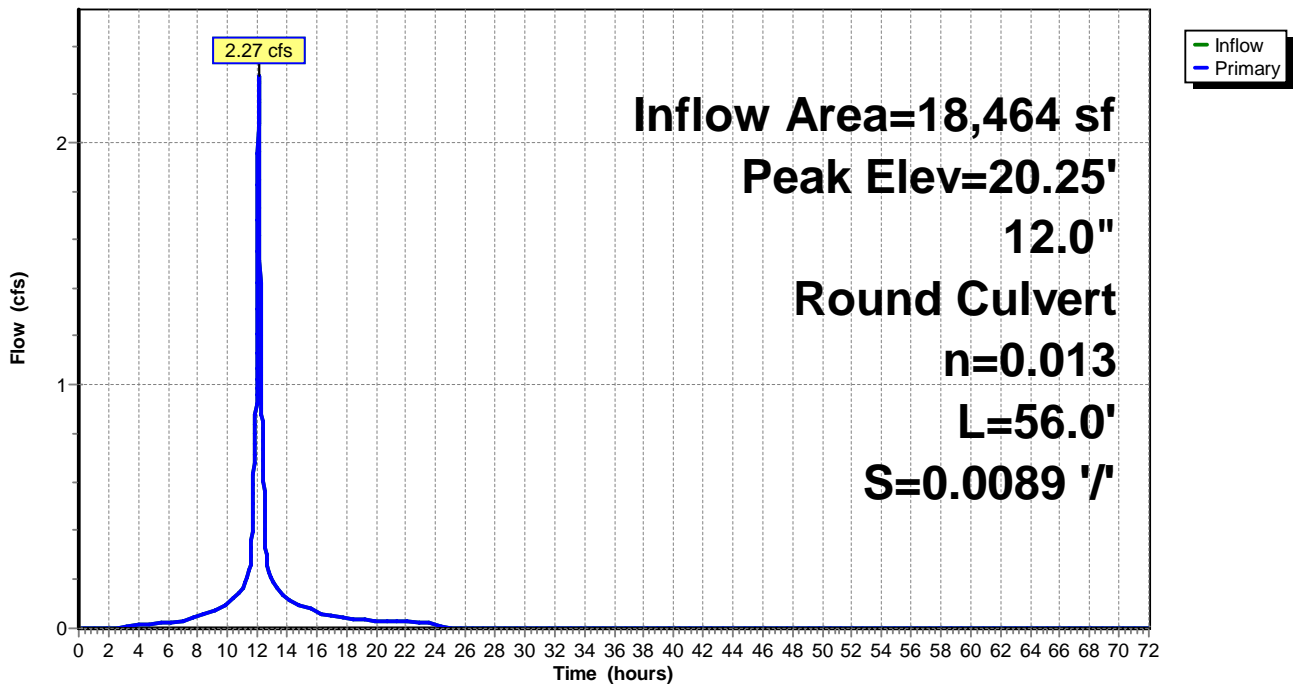

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 95

**Summary for Pond CB12:**

Inflow Area = 8,912 sf, 80.50% Impervious, Inflow Depth = 4.79" for 10 yr event  
 Inflow = 1.31 cfs @ 12.00 hrs, Volume= 3,556 cf  
 Outflow = 1.31 cfs @ 12.00 hrs, Volume= 3,556 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.31 cfs @ 12.00 hrs, Volume= 3,556 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 20.34' @ 12.12 hrs  
 Flood Elev= 24.07'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.30'	<b>12.0" Round Culvert</b> L= 7.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.30' / 18.87' S= 0.0573 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.18 cfs @ 12.00 hrs HW=19.92' TW=19.61' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 1.18 cfs @ 3.33 fps)

**Pond CB12:**

Hydrograph

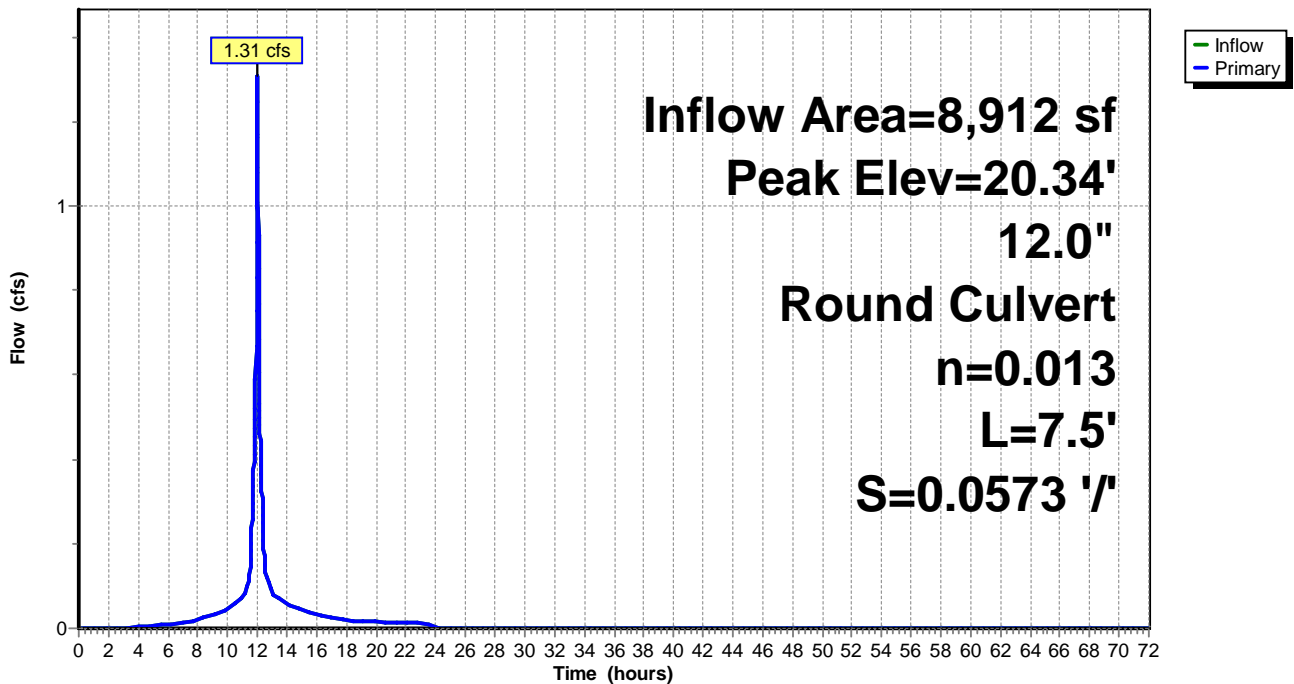

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 96

**Summary for Pond CB13:**

Inflow Area = 18,830 sf, 38.59% Impervious, Inflow Depth = 3.72" for 10 yr event  
 Inflow = 1.87 cfs @ 12.09 hrs, Volume= 5,840 cf  
 Outflow = 1.87 cfs @ 12.09 hrs, Volume= 5,840 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.87 cfs @ 12.09 hrs, Volume= 5,840 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 20.54' @ 12.11 hrs  
 Flood Elev= 24.07'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.30'	<b>12.0" Round Culvert</b> L= 7.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.30' / 18.87' S= 0.0573 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.57 cfs @ 12.09 hrs HW=20.41' TW=20.24' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 1.57 cfs @ 2.00 fps)

**Pond CB13:**

Hydrograph

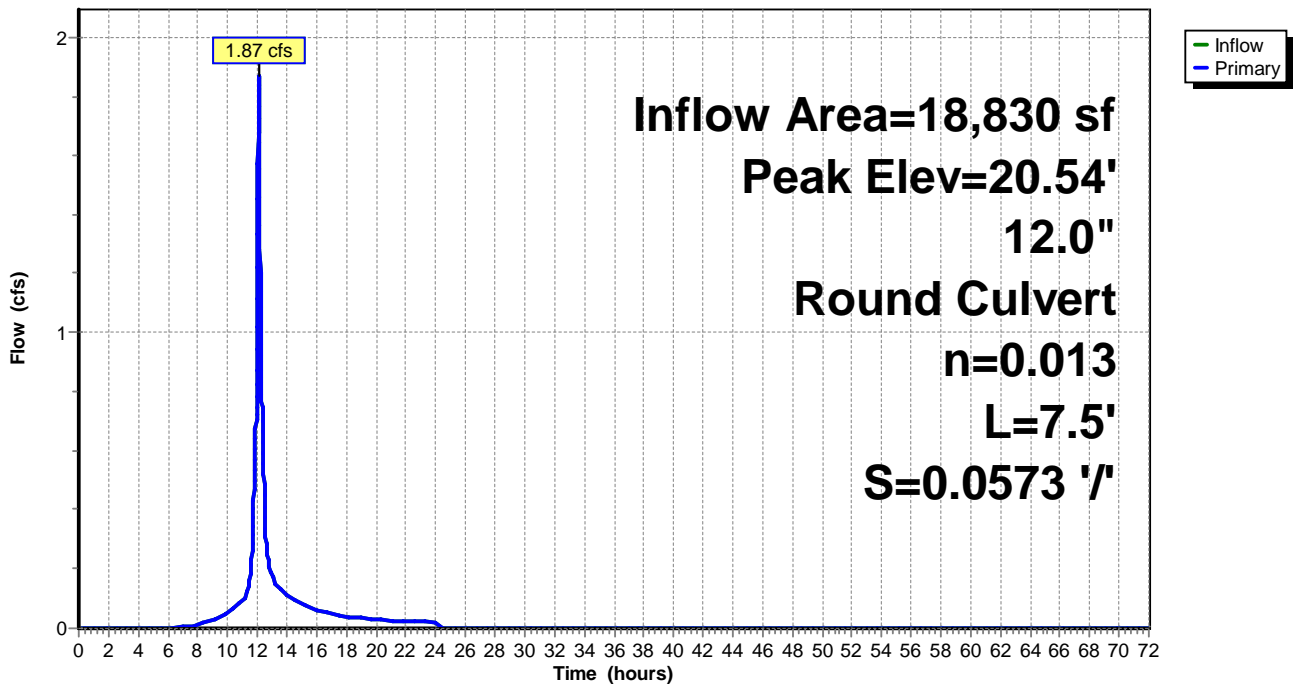

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 97

**Summary for Pond CB16:**

Inflow Area = 15,371 sf, 10.01% Impervious, Inflow Depth = 3.04" for 10 yr event  
 Inflow = 1.26 cfs @ 12.09 hrs, Volume= 3,891 cf  
 Outflow = 1.26 cfs @ 12.09 hrs, Volume= 3,891 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.26 cfs @ 12.09 hrs, Volume= 3,891 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 21.54' @ 12.11 hrs  
 Flood Elev= 27.37'

Device #1	Routing	Invert	Outlet Devices
	Primary	20.82'	<b>12.0" Round Culvert</b> L= 65.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.82' / 20.50' S= 0.0049 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.21 cfs @ 12.09 hrs HW=21.52' TW=21.07' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 1.21 cfs @ 2.90 fps)

**Pond CB16:**

Hydrograph

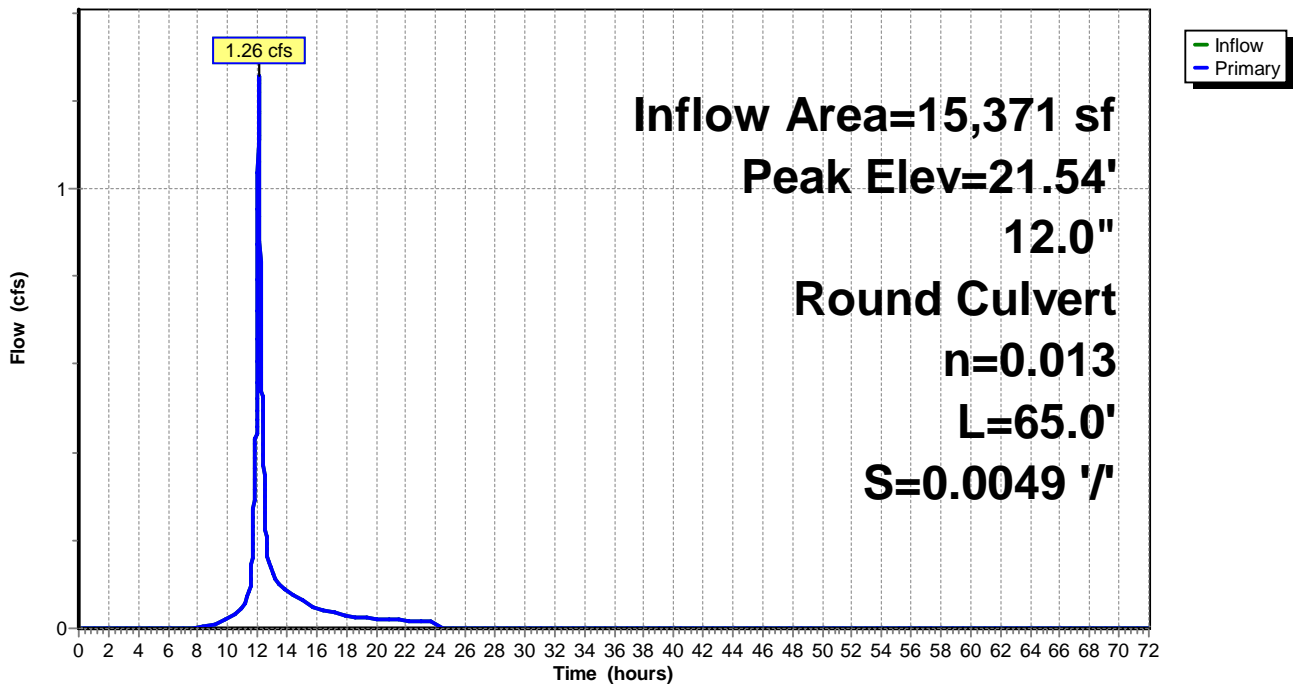

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 98

**Summary for Pond CB23:**

Inflow Area = 3,616 sf, 86.12% Impervious, Inflow Depth = 5.01" for 10 yr event  
 Inflow = 0.45 cfs @ 12.08 hrs, Volume= 1,511 cf  
 Outflow = 0.45 cfs @ 12.08 hrs, Volume= 1,511 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.45 cfs @ 12.08 hrs, Volume= 1,511 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 13.61' @ 12.08 hrs  
 Flood Elev= 16.16'

Device #1	Routing	Invert	Outlet Devices
	Primary	13.20'	<b>12.0" Round Culvert</b> L= 15.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 13.20' / 13.13' S= 0.0045 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.44 cfs @ 12.08 hrs HW=13.61' TW=12.20' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 0.44 cfs @ 2.19 fps)

**Pond CB23:**

Hydrograph

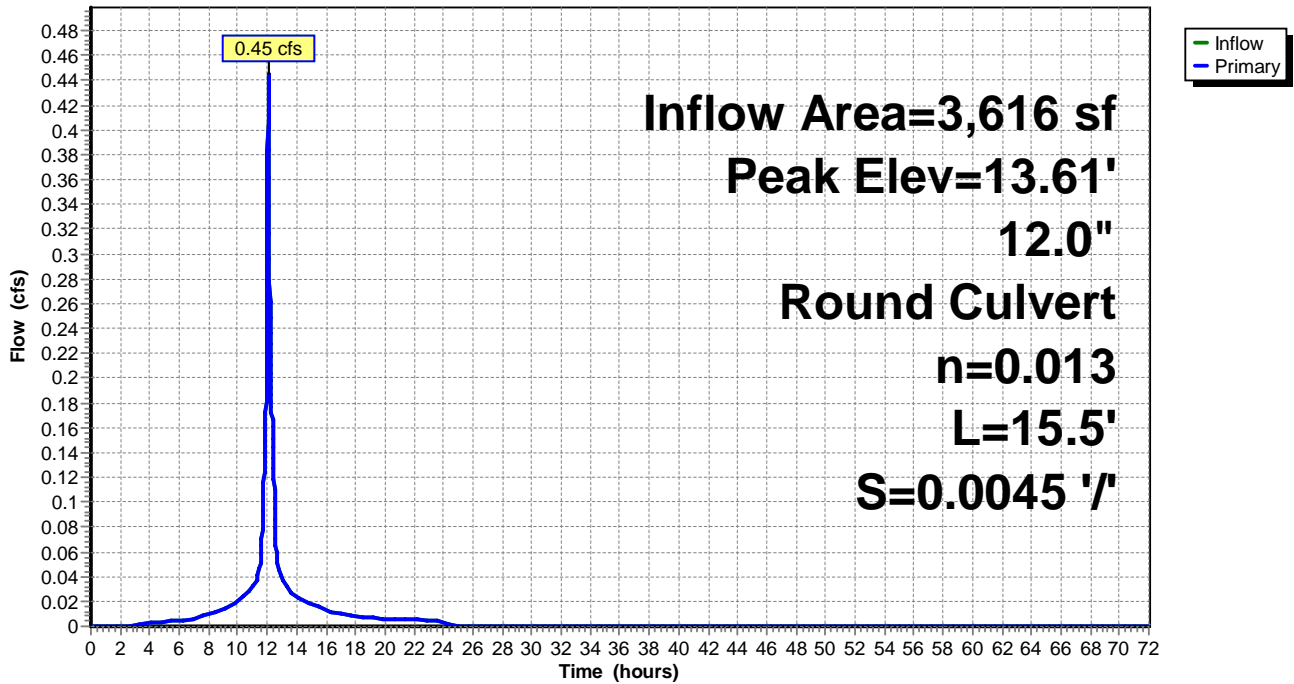

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 99

**Summary for Pond CB24:**

Inflow Area = 1,801 sf, 96.84% Impervious, Inflow Depth = 5.25" for 10 yr event  
 Inflow = 0.23 cfs @ 12.08 hrs, Volume= 787 cf  
 Outflow = 0.23 cfs @ 12.08 hrs, Volume= 787 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.23 cfs @ 12.08 hrs, Volume= 787 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 14.16' @ 12.08 hrs  
 Flood Elev= 18.42'

Device #1	Routing	Invert	Outlet Devices
	Primary	13.92'	<b>12.0" Round Culvert</b> L= 39.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 13.92' / 13.53' S= 0.0099 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.23 cfs @ 12.08 hrs HW=14.16' TW=12.20' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 0.23 cfs @ 2.35 fps)

**Pond CB24:**

Hydrograph

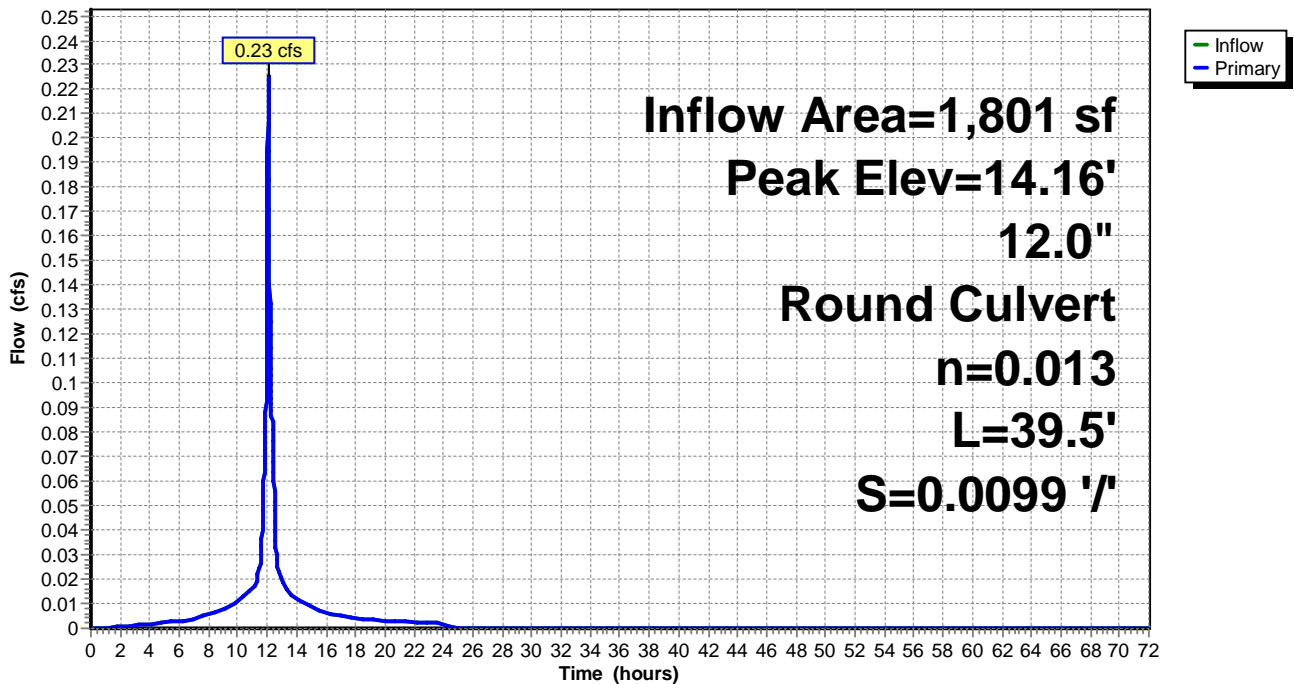

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 100

**Summary for Pond CB26:**

Inflow Area = 8,901 sf, 80.64% Impervious, Inflow Depth = 4.79" for 10 yr event  
 Inflow = 1.07 cfs @ 12.08 hrs, Volume= 3,552 cf  
 Outflow = 1.07 cfs @ 12.08 hrs, Volume= 3,552 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.07 cfs @ 12.08 hrs, Volume= 3,552 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 13.54' @ 12.08 hrs  
 Flood Elev= 18.43'

Device #1	Routing	Invert	Outlet Devices
	Primary	13.00'	<b>12.0" Round Culvert</b> L= 14.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 13.00' / 12.20' S= 0.0571 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.07 cfs @ 12.08 hrs HW=13.54' TW=12.77' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 1.07 cfs @ 2.49 fps)

**Pond CB26:**

Hydrograph

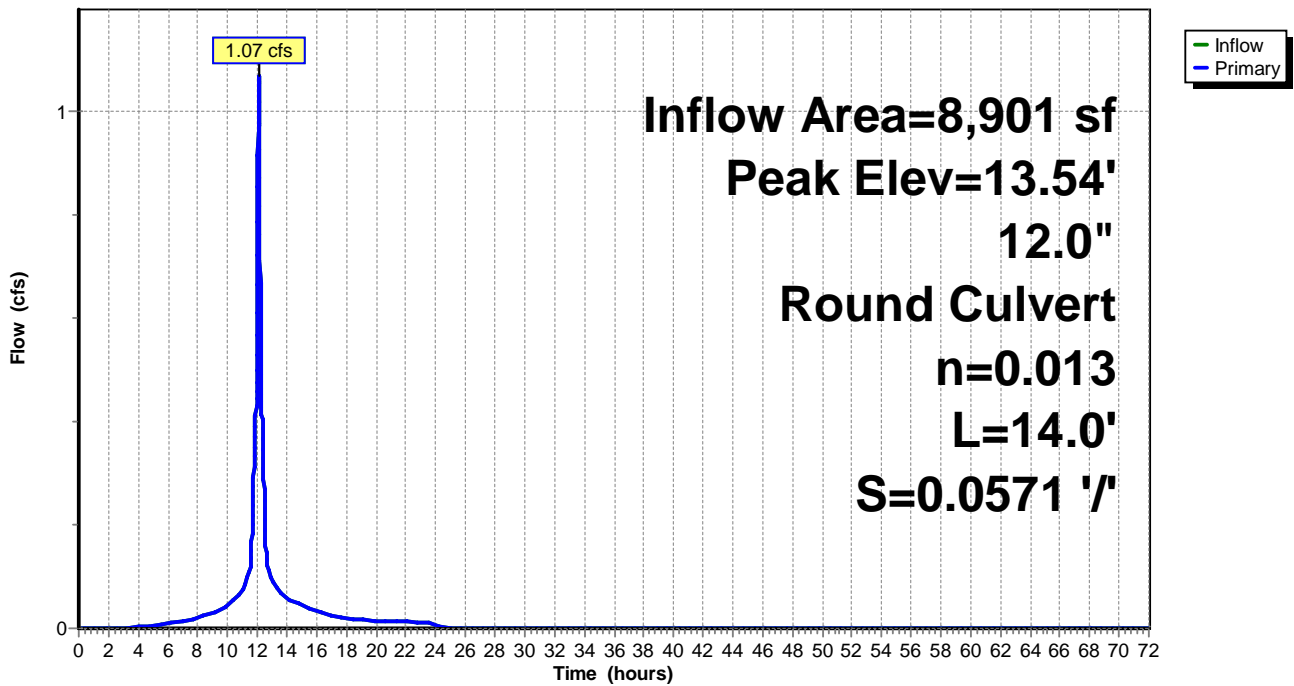

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 101

**Summary for Pond CB33:**

Inflow Area = 14,022 sf, 87.36% Impervious, Inflow Depth = 5.01" for 10 yr event  
 Inflow = 1.73 cfs @ 12.08 hrs, Volume= 5,859 cf  
 Outflow = 1.73 cfs @ 12.08 hrs, Volume= 5,859 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.73 cfs @ 12.08 hrs, Volume= 5,859 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 16.22' @ 12.10 hrs  
 Flood Elev= 19.26'

Device	Routing	Invert	Outlet Devices
#1	Primary	15.00'	<b>12.0" Round Culvert</b> L= 63.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 15.00' / 14.65' S= 0.0055 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.63 cfs @ 12.08 hrs HW=16.20' TW=15.97' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 1.63 cfs @ 2.20 fps)

**Pond CB33:**

Hydrograph

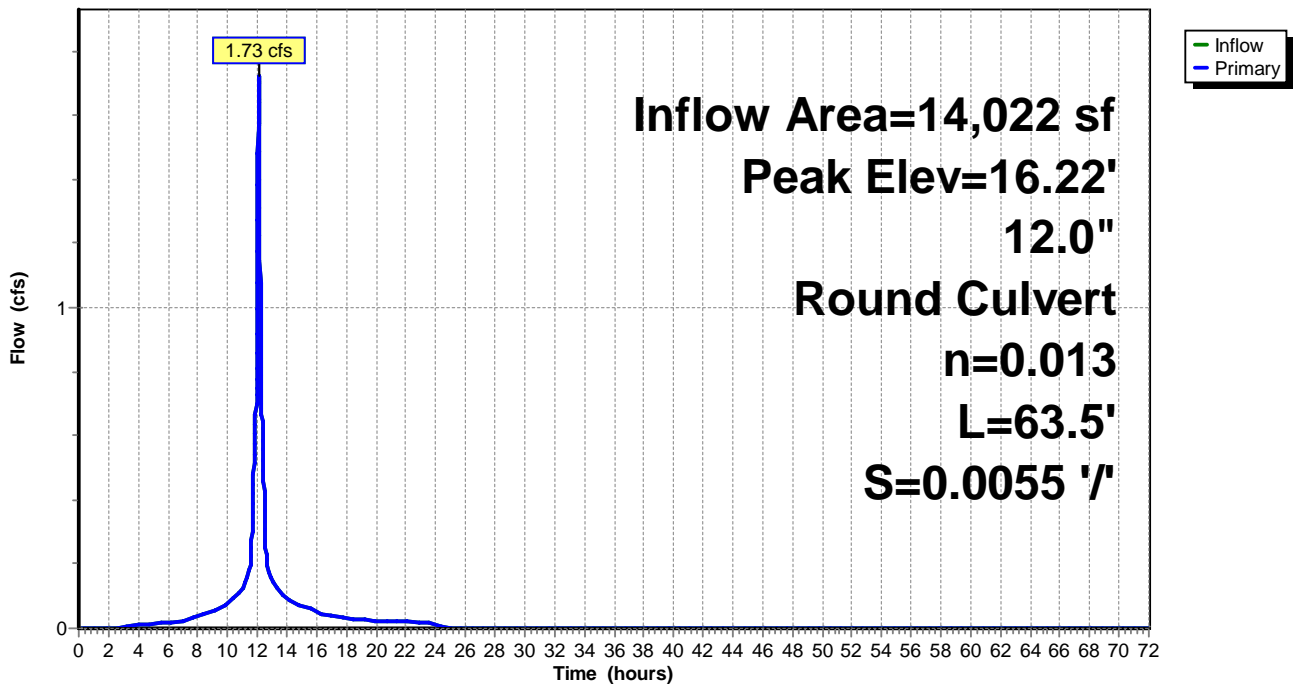



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 102

**Summary for Pond CB34:**

Inflow Area = 7,003 sf, 96.19% Impervious, Inflow Depth = 5.25" for 10 yr event  
 Inflow = 0.88 cfs @ 12.08 hrs, Volume= 3,061 cf  
 Outflow = 0.88 cfs @ 12.08 hrs, Volume= 3,061 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.88 cfs @ 12.08 hrs, Volume= 3,061 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 16.15' @ 12.10 hrs  
 Flood Elev= 19.74'

Device #1	Routing	Invert	Outlet Devices
	Primary	15.50'	<b>12.0" Round Culvert</b> L= 24.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 15.50' / 15.15' S= 0.0146 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.81 cfs @ 12.08 hrs HW=16.14' TW=15.97' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 0.81 cfs @ 2.19 fps)

**Pond CB34:**

Hydrograph

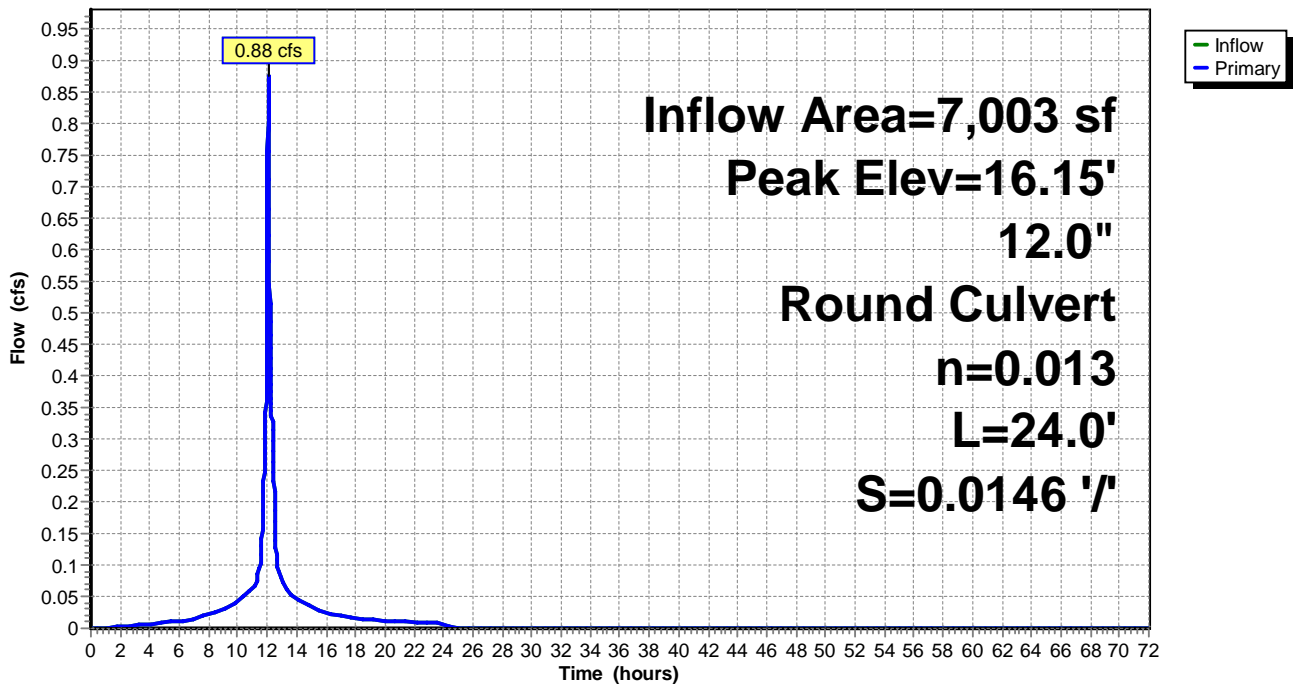

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 103

**Summary for Pond CB38:**

Inflow Area = 2,462 sf, 89.85% Impervious, Inflow Depth = 5.13" for 10 yr event  
 Inflow = 0.31 cfs @ 12.08 hrs, Volume= 1,052 cf  
 Outflow = 0.31 cfs @ 12.08 hrs, Volume= 1,052 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.31 cfs @ 12.08 hrs, Volume= 1,052 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 18.54' @ 12.09 hrs  
 Flood Elev= 22.07'

Device #1	Routing	Invert	Outlet Devices
	Primary	18.00'	<b>12.0" Round Culvert</b> L= 5.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.00' / 17.95' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.29 cfs @ 12.08 hrs HW=18.53' TW=18.51' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 0.29 cfs @ 0.99 fps)

**Pond CB38:**

Hydrograph

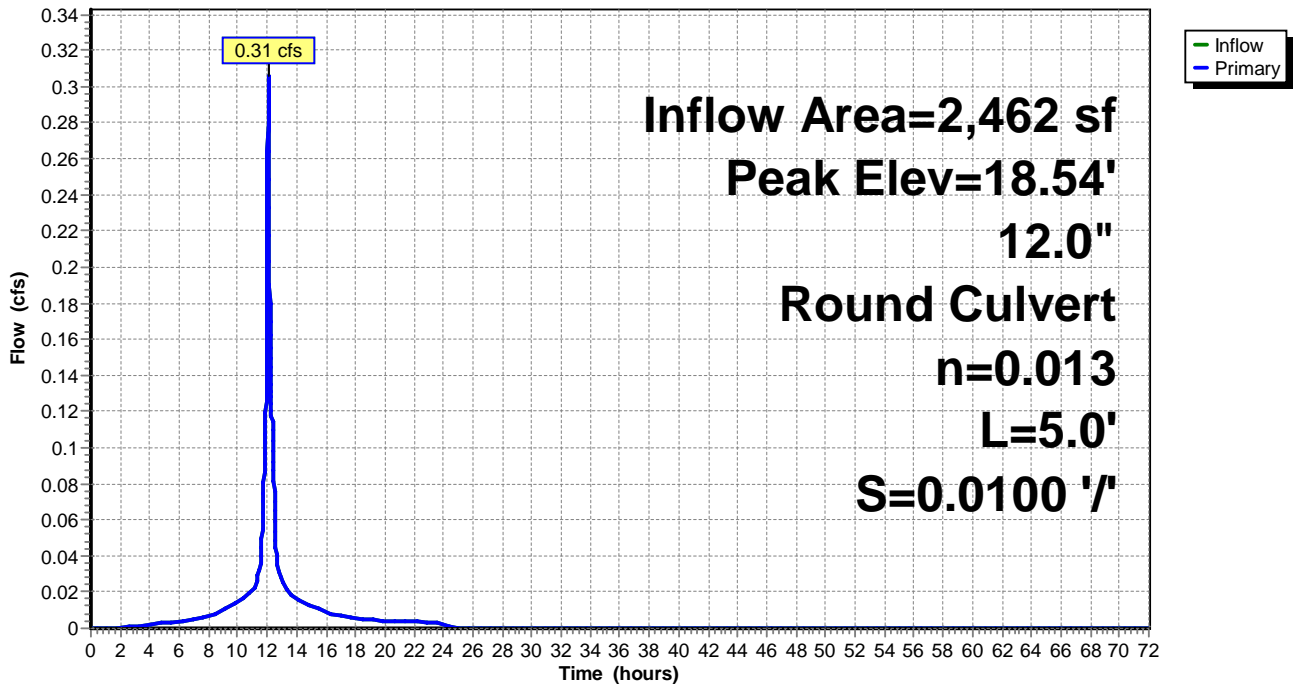

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 104

**Summary for Pond CB39:**

Inflow Area = 6,973 sf, 92.96% Impervious, Inflow Depth = 5.13" for 10 yr event  
 Inflow = 0.87 cfs @ 12.08 hrs, Volume= 2,981 cf  
 Outflow = 0.87 cfs @ 12.08 hrs, Volume= 2,981 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.87 cfs @ 12.08 hrs, Volume= 2,981 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.56' @ 12.08 hrs  
 Flood Elev= 23.28'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.00'	<b>12.0" Round Culvert</b> L= 53.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.00' / 18.74' S= 0.0049 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.86 cfs @ 12.08 hrs HW=19.56' TW=18.51' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 0.86 cfs @ 2.74 fps)

**Pond CB39:**

Hydrograph

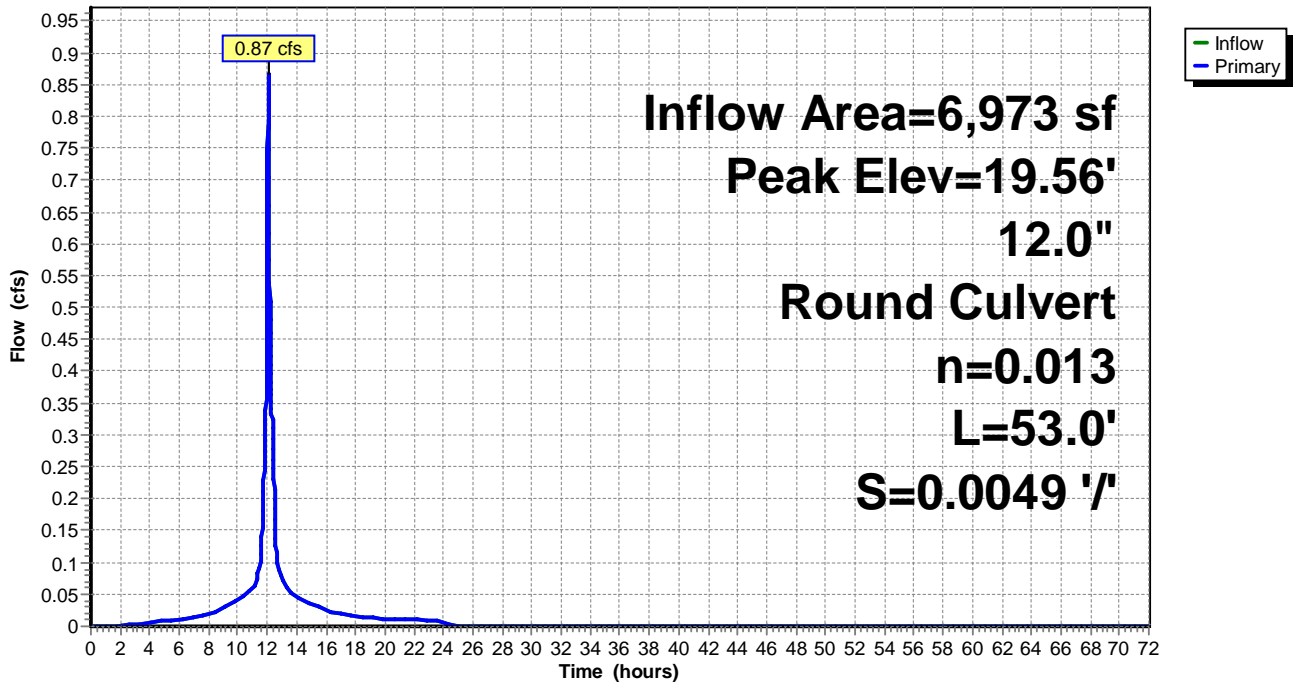

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 105

**Summary for Pond CB4:**

Inflow Area = 6,729 sf, 56.26% Impervious, Inflow Depth = 4.24" for 10 yr event  
 Inflow = 0.75 cfs @ 12.09 hrs, Volume= 2,378 cf  
 Outflow = 0.75 cfs @ 12.09 hrs, Volume= 2,378 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.75 cfs @ 12.09 hrs, Volume= 2,378 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.30' @ 12.09 hrs  
 Flood Elev= 23.31'

Device #1	Routing	Invert	Outlet Devices
	Primary	18.56'	<b>12.0" Round Culvert</b> L= 24.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.56' / 17.71' S= 0.0347 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.70 cfs @ 12.09 hrs HW=19.29' TW=19.21' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 0.70 cfs @ 1.57 fps)

**Pond CB4:**

Hydrograph

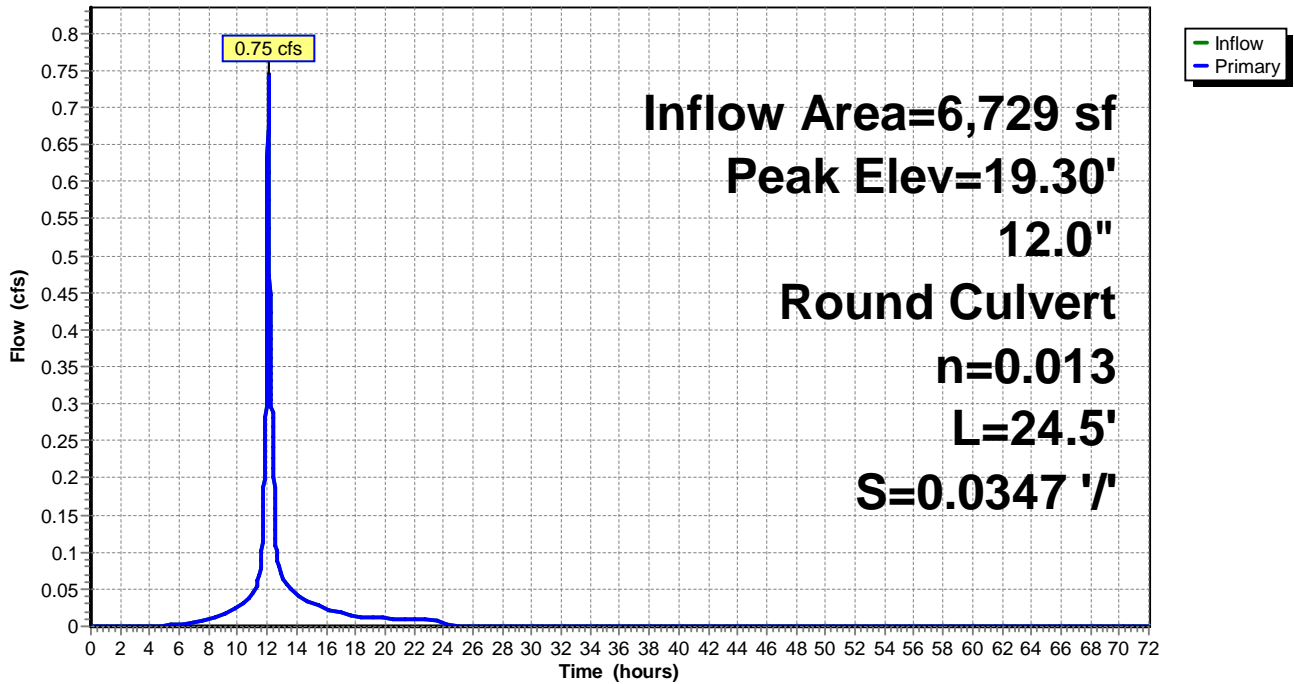

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 106

**Summary for Pond CB43:**

Inflow Area = 8,377 sf, 79.03% Impervious, Inflow Depth = 4.79" for 10 yr event  
 Inflow = 1.01 cfs @ 12.08 hrs, Volume= 3,343 cf  
 Outflow = 1.01 cfs @ 12.08 hrs, Volume= 3,343 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.01 cfs @ 12.08 hrs, Volume= 3,343 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 14.36' @ 12.08 hrs  
 Flood Elev= 22.42'

Device	Routing	Invert	Outlet Devices
#1	Primary	13.84'	<b>12.0" Round Culvert</b> L= 9.9' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 13.84' / 13.35' S= 0.0495 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.01 cfs @ 12.08 hrs HW=14.36' TW=13.85' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 1.01 cfs @ 2.45 fps)

**Pond CB43:**

Hydrograph

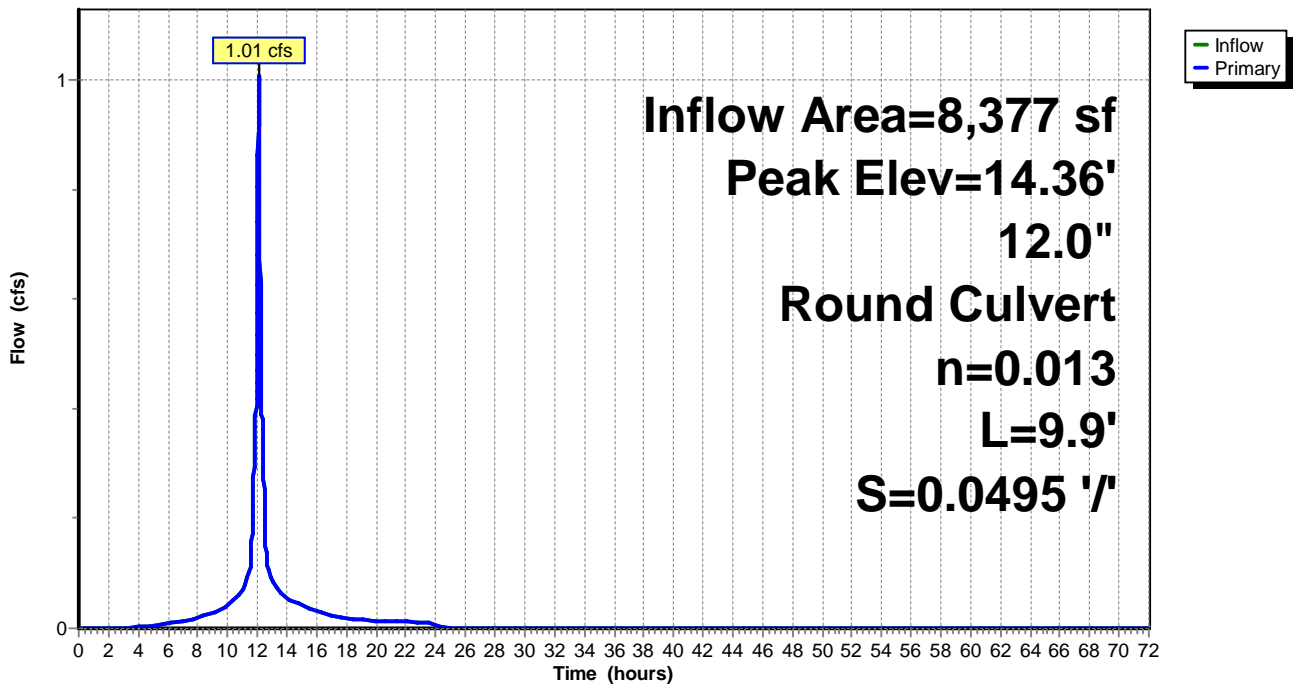

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 107

**Summary for Pond CB45:**

Inflow Area = 5,742 sf, 40.56% Impervious, Inflow Depth = 3.82" for 10 yr event  
 Inflow = 0.58 cfs @ 12.09 hrs, Volume= 1,830 cf  
 Outflow = 0.58 cfs @ 12.09 hrs, Volume= 1,830 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.58 cfs @ 12.09 hrs, Volume= 1,830 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.88' @ 12.09 hrs  
 Flood Elev= 24.90'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.50'	<b>12.0" Round Culvert</b> L= 15.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.50' / 18.50' S= 0.0667 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.58 cfs @ 12.09 hrs HW=19.88' TW=14.50' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 0.58 cfs @ 2.11 fps)

**Pond CB45:**

Hydrograph

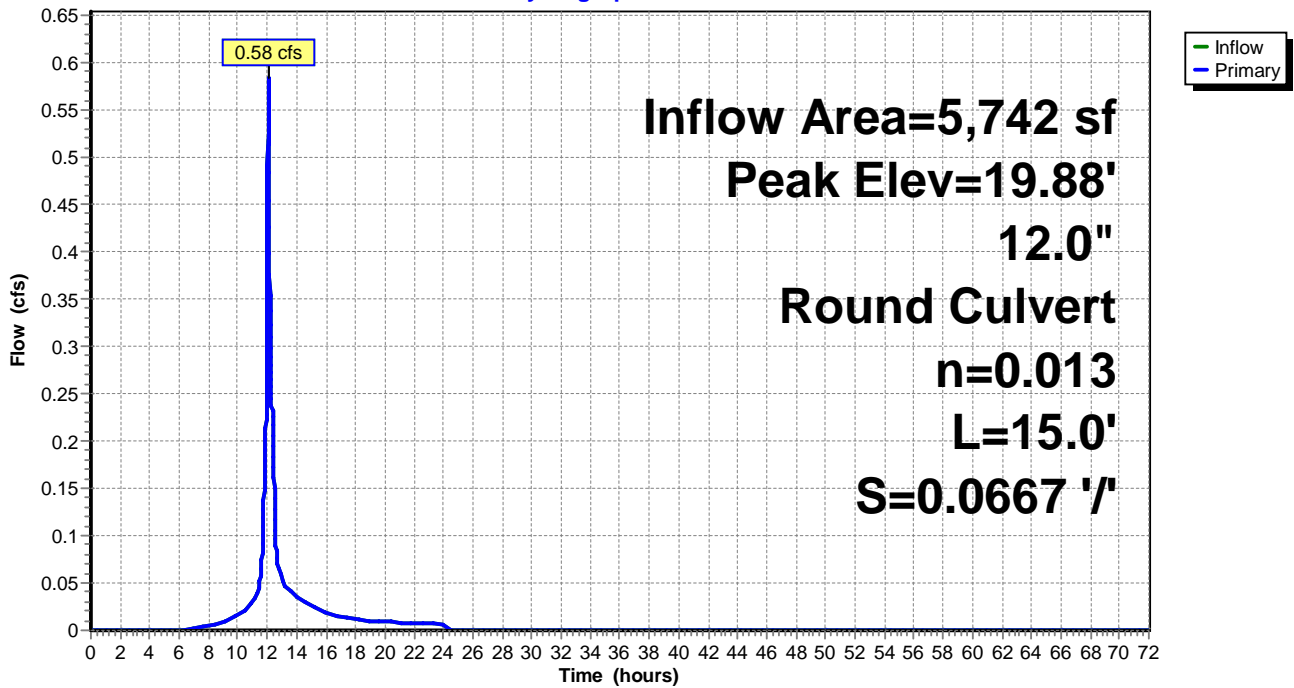

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 108

**Summary for Pond CB46:**

Inflow Area = 2,486 sf, 78.32% Impervious, Inflow Depth = 4.79" for 10 yr event  
 Inflow = 0.30 cfs @ 12.08 hrs, Volume= 992 cf  
 Outflow = 0.30 cfs @ 12.08 hrs, Volume= 992 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.30 cfs @ 12.08 hrs, Volume= 992 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.77' @ 12.08 hrs  
 Flood Elev= 24.90'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.50'	<b>12.0" Round Culvert</b> L= 15.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.50' / 18.50' S= 0.0667 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.30 cfs @ 12.08 hrs HW=19.77' TW=14.49' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 0.30 cfs @ 1.76 fps)

**Pond CB46:**

Hydrograph

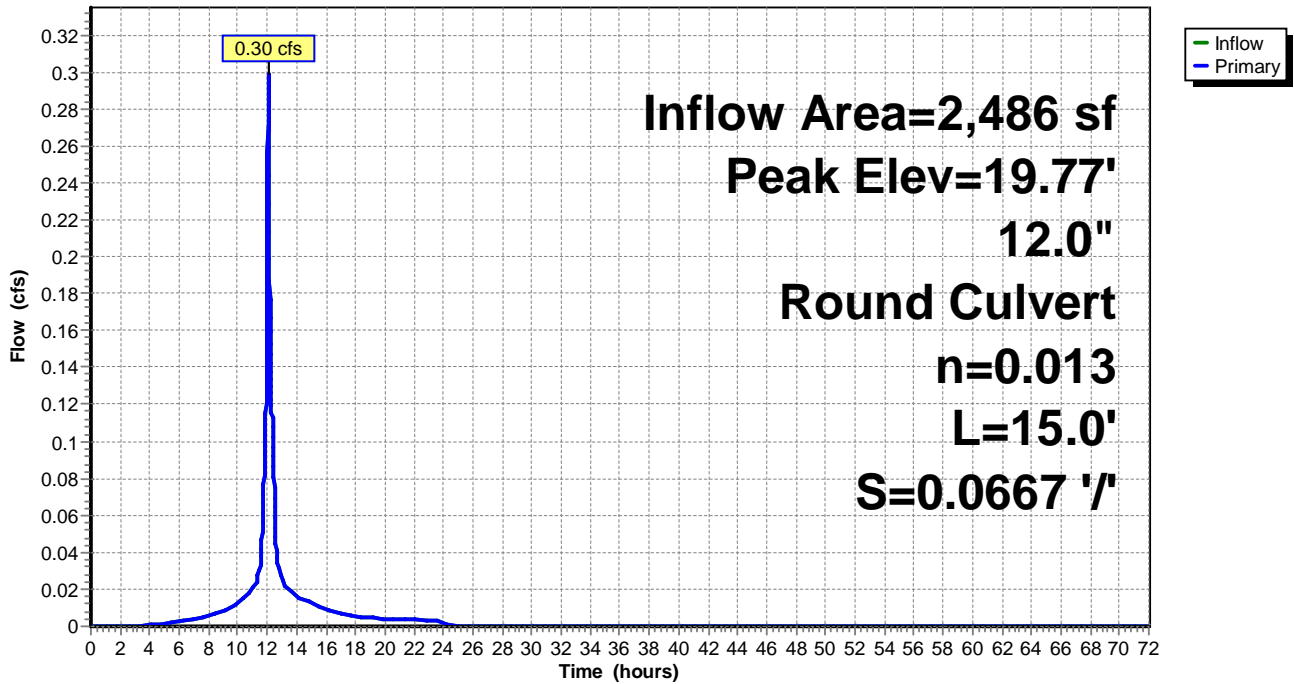

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 109

**Summary for Pond CB5:**

Inflow Area = 13,204 sf, 16.74% Impervious, Inflow Depth = 3.23" for 10 yr event  
 Inflow = 1.06 cfs @ 12.01 hrs, Volume= 3,551 cf  
 Outflow = 1.06 cfs @ 12.01 hrs, Volume= 3,551 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.06 cfs @ 12.01 hrs, Volume= 3,551 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.26' @ 12.09 hrs  
 Flood Elev= 20.32'

Device	Routing	Invert	Outlet Devices
#1	Primary	17.60'	<b>12.0" Round Culvert</b> L= 33.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.60' / 17.43' S= 0.0051 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.01 hrs HW=18.75' TW=18.76' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond CB5:**

Hydrograph

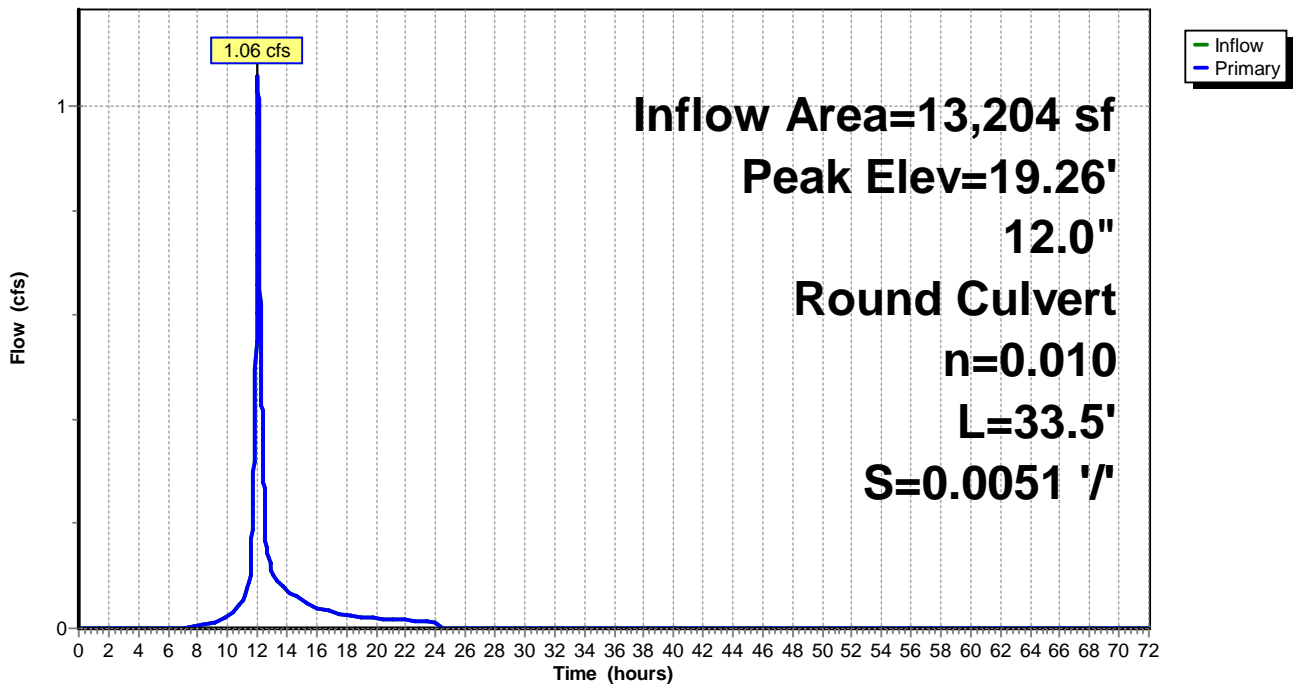



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 110

**Summary for Pond CB53:**

Inflow Area = 27,997 sf, 82.23% Impervious, Inflow Depth = 4.90" for 10 yr event  
 Inflow = 3.41 cfs @ 12.08 hrs, Volume= 11,434 cf  
 Outflow = 3.41 cfs @ 12.08 hrs, Volume= 11,434 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 3.41 cfs @ 12.08 hrs, Volume= 11,434 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 24.05' @ 12.09 hrs  
 Flood Elev= 25.14'

Device	Routing	Invert	Outlet Devices
#1	Primary	20.38'	<b>12.0" Round Culvert</b> L= 86.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.38' / 19.95' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=3.31 cfs @ 12.08 hrs HW=23.99' TW=22.83' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 3.31 cfs @ 4.21 fps)

**Pond CB53:**

Hydrograph

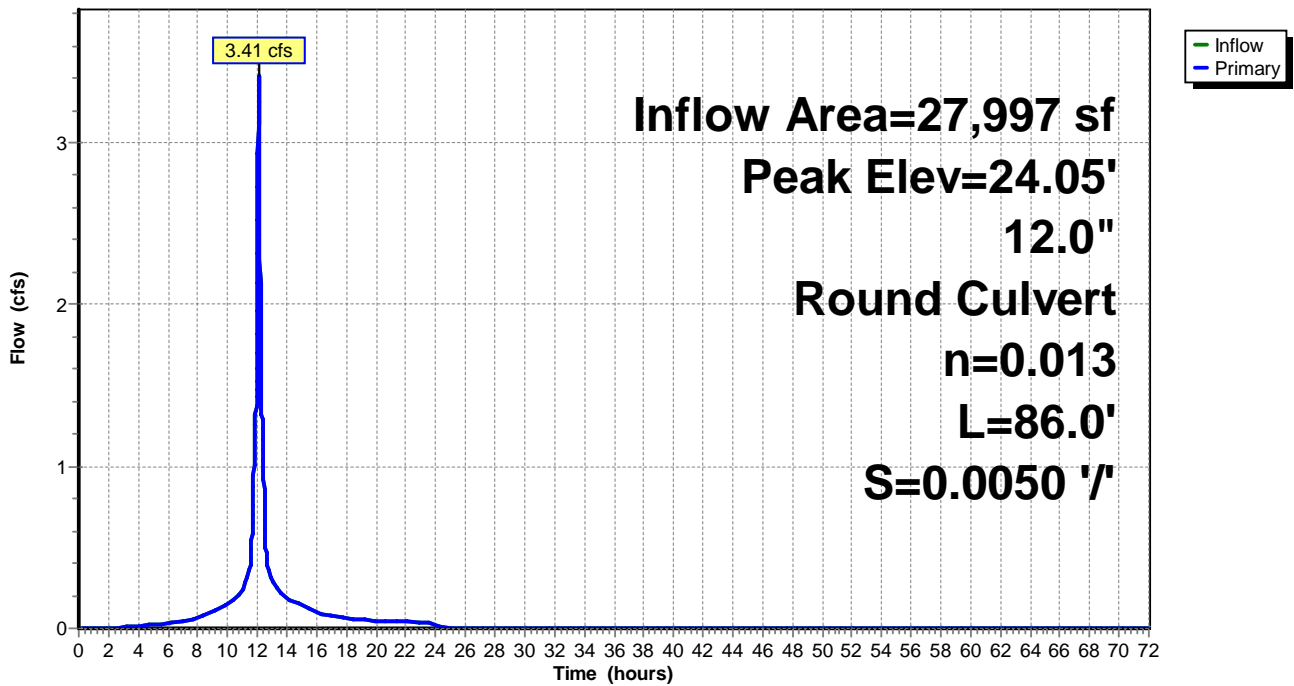

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 111

**Summary for Pond CB55:**

Inflow Area = 44,751 sf, 69.67% Impervious, Inflow Depth = 4.57" for 10 yr event  
 Inflow = 5.23 cfs @ 12.08 hrs, Volume= 17,029 cf  
 Outflow = 5.23 cfs @ 12.08 hrs, Volume= 17,029 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 5.23 cfs @ 12.08 hrs, Volume= 17,029 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 25.56' @ 12.10 hrs  
 Flood Elev= 23.71'

Device #1	Routing	Invert	Outlet Devices
	Primary	20.24'	<b>12.0" Round Culvert</b> L= 44.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.24' / 20.02' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=5.02 cfs @ 12.08 hrs HW=25.42' TW=23.60' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 5.02 cfs @ 6.39 fps)

**Pond CB55:**

Hydrograph

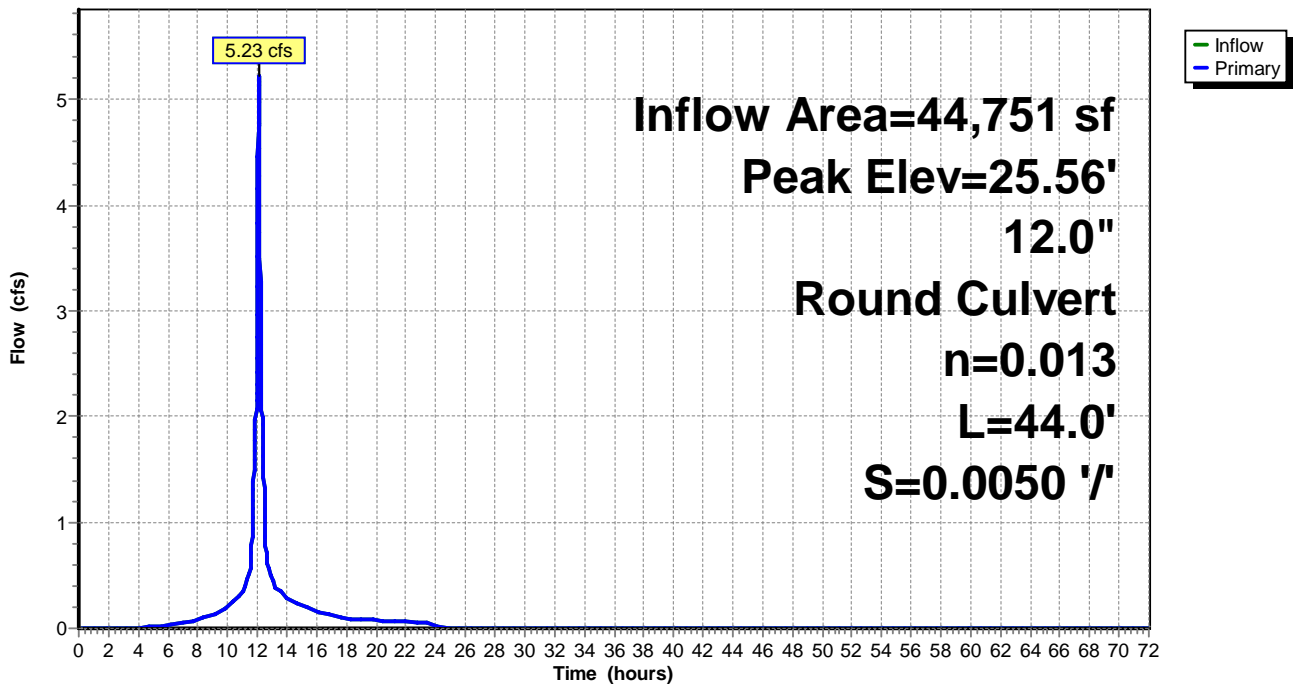

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 112

**Summary for Pond CB56:**

Inflow Area = 18,629 sf, 55.15% Impervious, Inflow Depth = 4.14" for 10 yr event  
 Inflow = 2.02 cfs @ 12.09 hrs, Volume= 6,420 cf  
 Outflow = 2.02 cfs @ 12.09 hrs, Volume= 6,420 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.02 cfs @ 12.09 hrs, Volume= 6,420 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 24.02' @ 12.10 hrs  
 Flood Elev= 24.43'

Device	Routing	Invert	Outlet Devices
#1	Primary	20.86'	<b>12.0" Round Culvert</b> L= 69.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.86' / 20.02' S= 0.0122 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.62 cfs @ 12.09 hrs HW=23.85' TW=23.61' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 1.62 cfs @ 2.06 fps)

**Pond CB56:**

Hydrograph

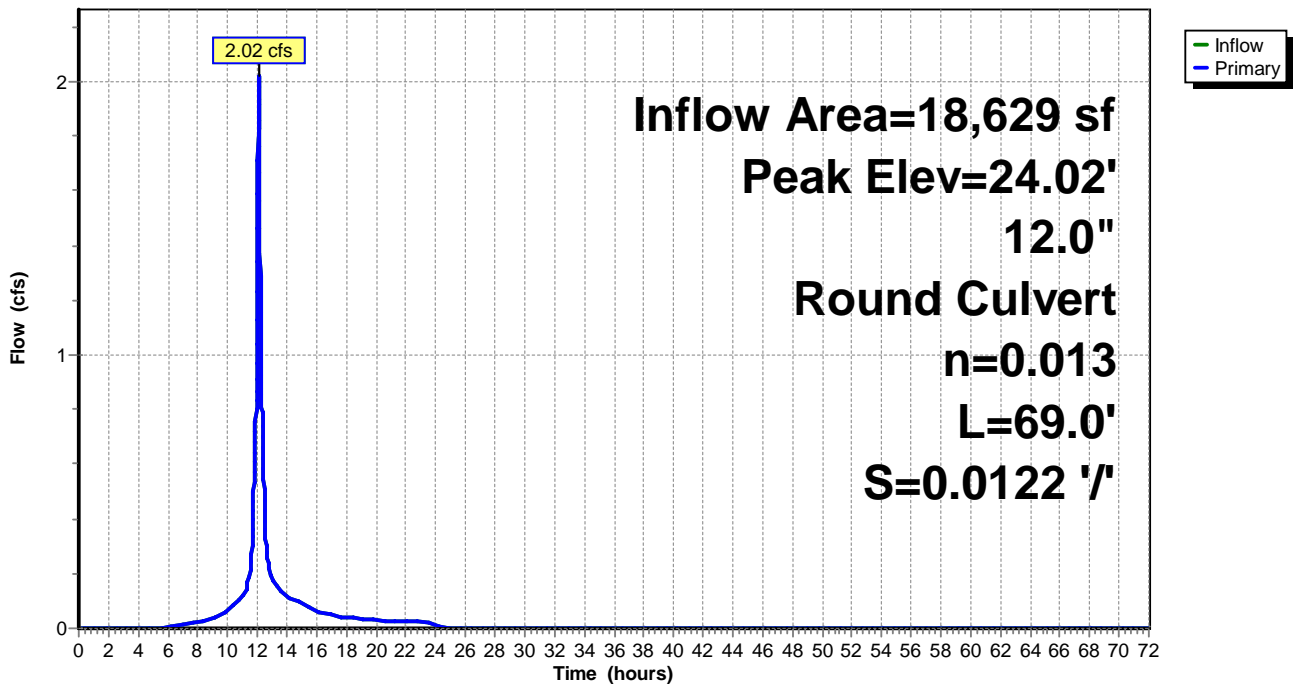

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 113

**Summary for Pond CB6:**

Inflow Area = 5,289 sf, 76.01% Impervious, Inflow Depth = 4.68" for 10 yr event  
 Inflow = 0.59 cfs @ 12.11 hrs, Volume= 2,061 cf  
 Outflow = 0.59 cfs @ 12.11 hrs, Volume= 2,061 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.59 cfs @ 12.11 hrs, Volume= 2,061 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.61' @ 12.10 hrs  
 Flood Elev= 22.65'

Device #1	Routing	Invert	Outlet Devices
	Primary	17.83'	<b>12.0" Round Culvert</b> L= 13.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.83' / 17.49' S= 0.0262 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.92 cfs @ 12.11 hrs HW=19.60' TW=19.55' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 0.92 cfs @ 1.17 fps)

**Pond CB6:**

Hydrograph

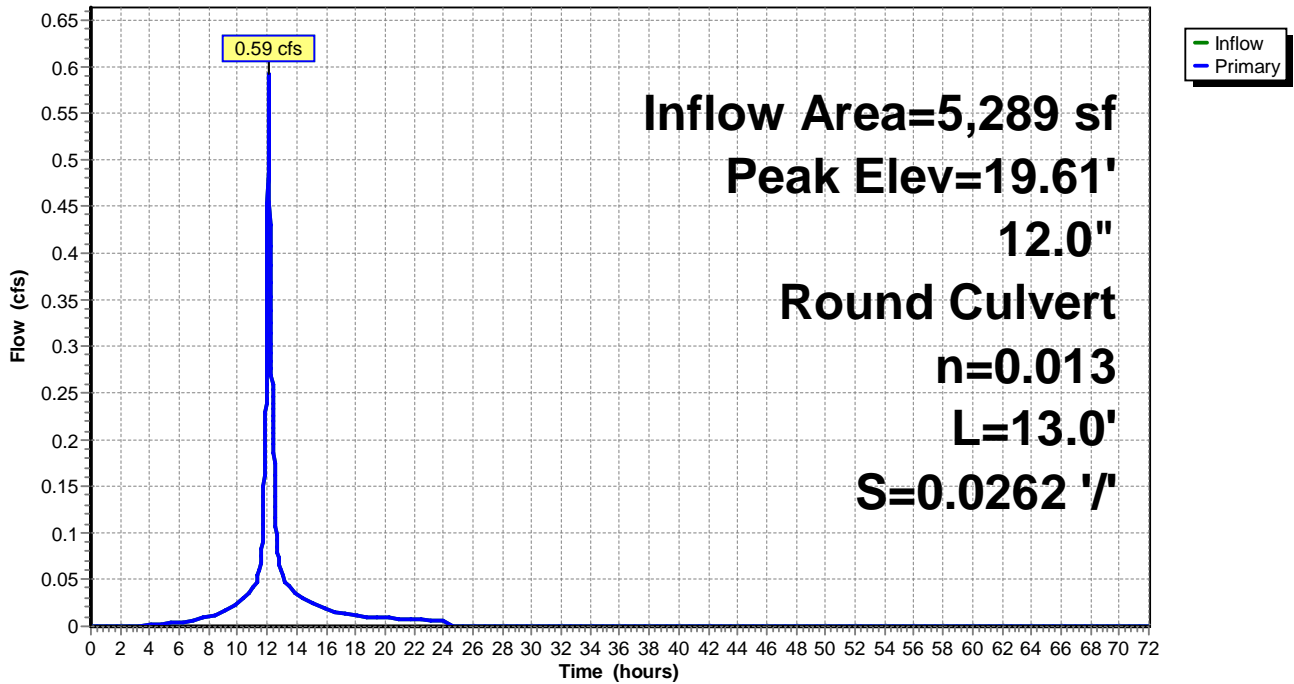

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 114

**Summary for Pond CB61:**

Inflow Area = 16,888 sf, 28.75% Impervious, Inflow Depth = 3.52" for 10 yr event  
 Inflow = 1.95 cfs @ 12.00 hrs, Volume= 4,955 cf  
 Outflow = 1.95 cfs @ 12.00 hrs, Volume= 4,955 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.95 cfs @ 12.00 hrs, Volume= 4,955 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 7.79' @ 12.00 hrs  
 Flood Elev= 10.85'

Device	Routing	Invert	Outlet Devices
#1	Primary	7.00'	<b>12.0" Round Culvert</b> L= 65.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.00' / 6.38' S= 0.0095 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.94 cfs @ 12.00 hrs HW=7.79' TW=4.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 1.94 cfs @ 4.00 fps)

**Pond CB61:**

Hydrograph

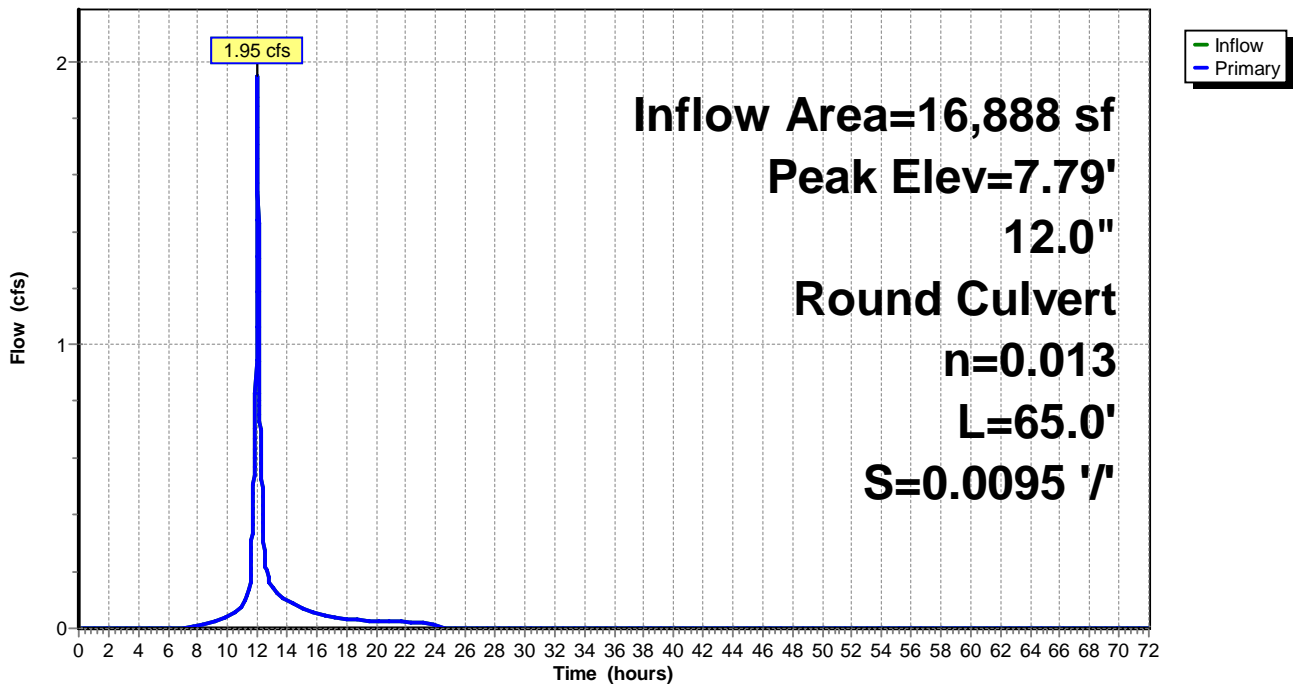

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 115

**Summary for Pond CB62:**

Inflow Area = 2,200 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.34 cfs @ 12.00 hrs, Volume= 983 cf  
 Outflow = 0.34 cfs @ 12.00 hrs, Volume= 983 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.34 cfs @ 12.00 hrs, Volume= 983 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 5.36' @ 12.15 hrs  
 Flood Elev= 12.22'

Device #1	Routing	Invert	Outlet Devices
	Primary	4.48'	<b>12.0" Round Culvert</b> L= 6.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 4.48' / 4.41' S= 0.0104 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.07 cfs @ 12.00 hrs HW=4.94' TW=4.93' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 0.07 cfs @ 0.30 fps)

**Pond CB62:**

Hydrograph

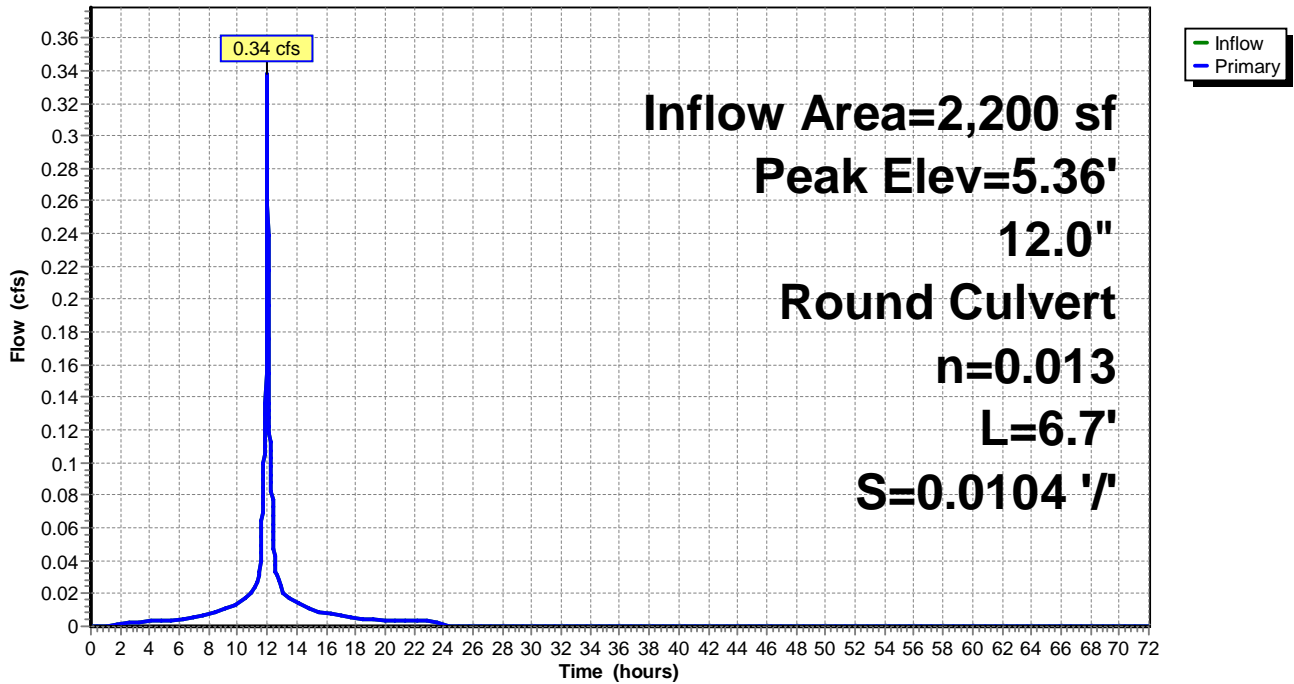

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 116

**Summary for Pond CB63:**

Inflow Area = 2,510 sf, 79.04% Impervious, Inflow Depth = 4.79" for 10 yr event  
 Inflow = 0.37 cfs @ 12.00 hrs, Volume= 1,002 cf  
 Outflow = 0.37 cfs @ 12.00 hrs, Volume= 1,002 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.37 cfs @ 12.00 hrs, Volume= 1,002 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 6.07' @ 12.16 hrs  
 Flood Elev= 13.64'

Device #1	Routing	Invert	Outlet Devices
	Primary	5.05'	<b>12.0" Round Culvert</b> L= 13.4' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.05' / 4.92' S= 0.0097 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.11 cfs @ 12.00 hrs HW=5.53' TW=5.52' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 0.11 cfs @ 0.44 fps)

**Pond CB63:**

Hydrograph

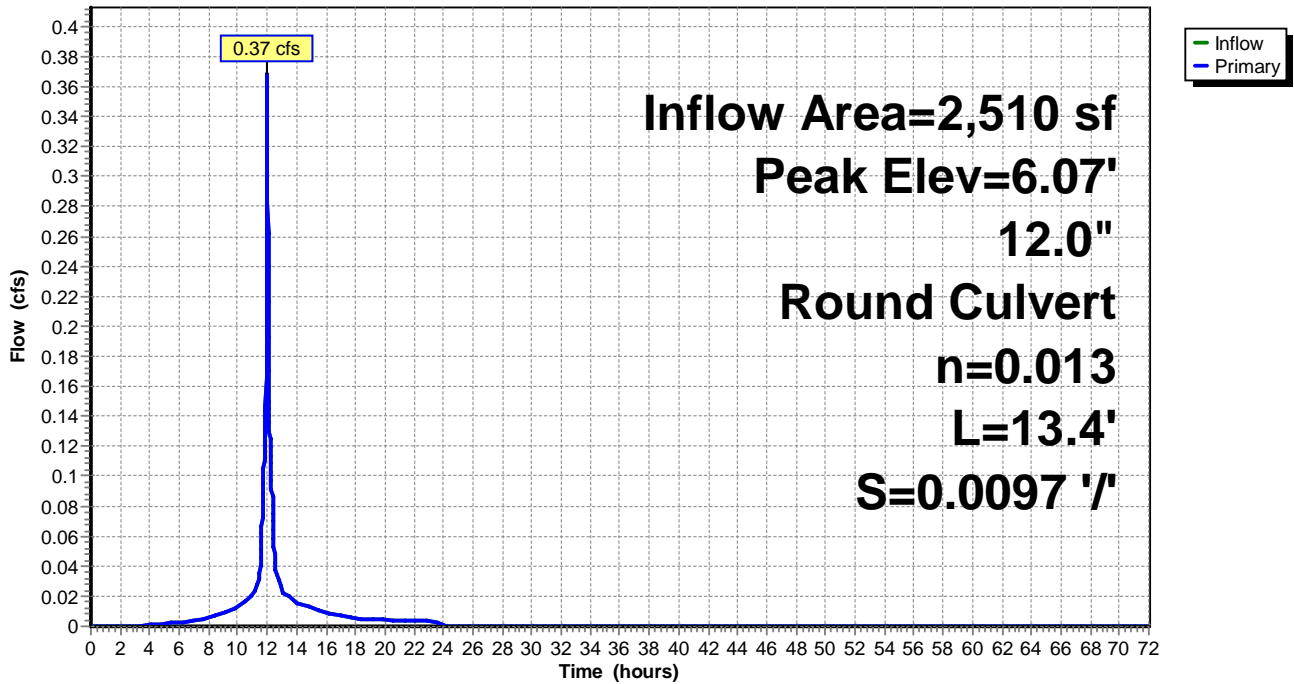

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 117

**Summary for Pond CB65:**

Inflow Area = 49,536 sf, 84.69% Impervious, Inflow Depth = 4.90" for 10 yr event  
 Inflow = 6.03 cfs @ 12.08 hrs, Volume= 20,230 cf  
 Outflow = 6.03 cfs @ 12.08 hrs, Volume= 20,230 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 6.03 cfs @ 12.08 hrs, Volume= 20,230 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 236.04' @ 12.13 hrs  
 Flood Elev= 23.22'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.37'	<b>12.0" Round Culvert</b> L= 50.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.37' / 19.12' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.08 hrs HW=175.72' TW=191.28' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond CB65:**

Hydrograph

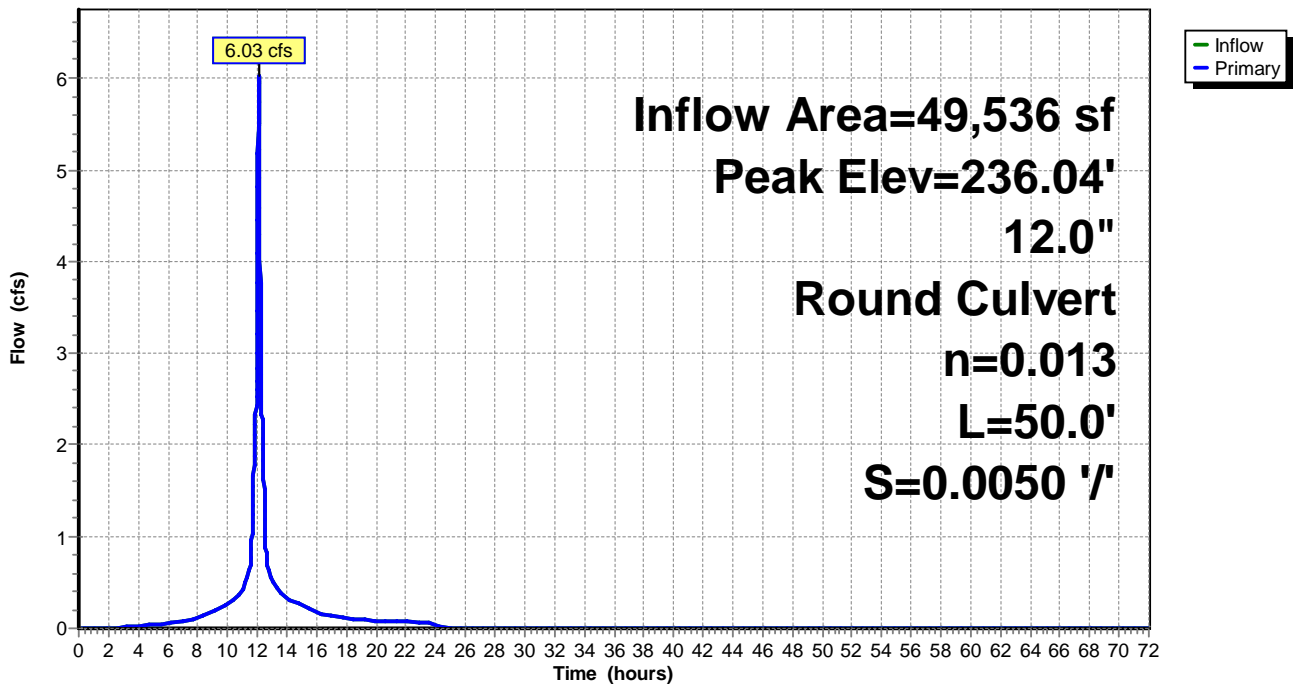



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 118

**Summary for Pond CB67:**

Inflow Area = 35,753 sf, 88.57% Impervious, Inflow Depth = 5.01" for 10 yr event  
 Inflow = 4.40 cfs @ 12.08 hrs, Volume= 14,940 cf  
 Outflow = 4.40 cfs @ 12.08 hrs, Volume= 14,940 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 4.40 cfs @ 12.08 hrs, Volume= 14,940 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 243.66' @ 12.14 hrs  
 Flood Elev= 24.24'

Device #1	Routing	Invert	Outlet Devices
	Primary	20.60'	<b>12.0" Round Culvert</b> L= 3.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.60' / 20.57' S= 0.0086 1/ n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.08 hrs HW=167.08' TW=184.76' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond CB67:**

Hydrograph

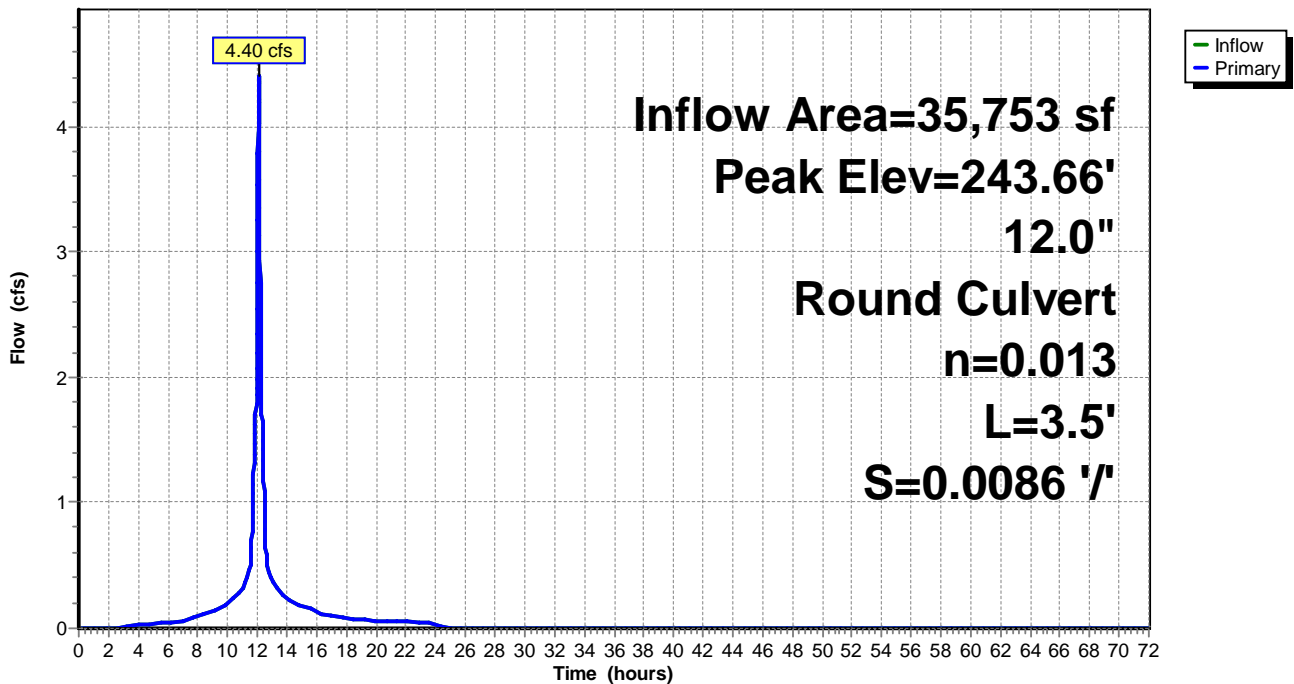

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 119

**Summary for Pond CB69:**

Inflow Area = 10,664 sf, 91.11% Impervious, Inflow Depth = 5.13" for 10 yr event  
 Inflow = 1.32 cfs @ 12.08 hrs, Volume= 4,558 cf  
 Outflow = 1.32 cfs @ 12.08 hrs, Volume= 4,558 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.32 cfs @ 12.08 hrs, Volume= 4,558 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 243.17' @ 12.15 hrs  
 Flood Elev= 25.12'

Device #1	Routing	Invert	Outlet Devices
	Primary	20.93'	<b>12.0" Round Culvert</b> L= 7.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.93' / 20.89' S= 0.0053 ' / ' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.08 hrs HW=147.29' TW=165.90' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond CB69:**

Hydrograph

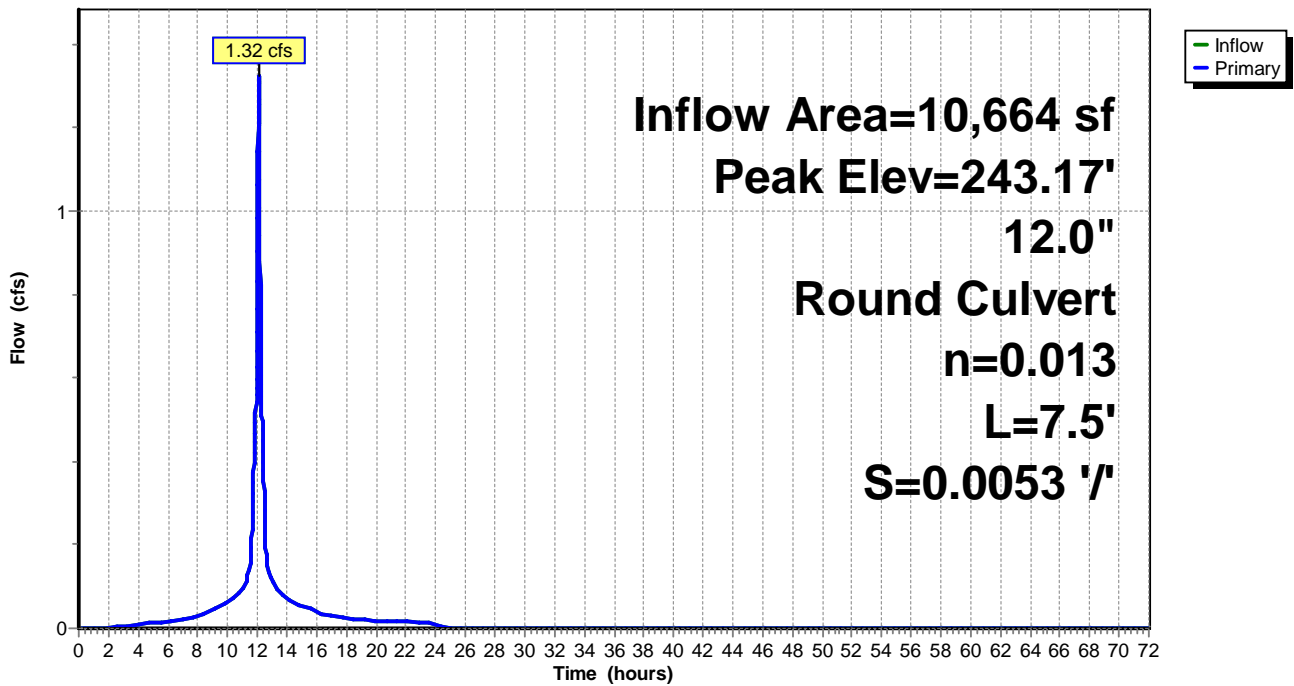

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 120

**Summary for Pond CB7:**

Inflow Area = 14,265 sf, 86.53% Impervious, Inflow Depth = 5.01" for 10 yr event  
 Inflow = 2.14 cfs @ 12.00 hrs, Volume= 5,961 cf  
 Outflow = 2.14 cfs @ 12.00 hrs, Volume= 5,961 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.14 cfs @ 12.00 hrs, Volume= 5,961 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.64' @ 12.10 hrs  
 Flood Elev= 22.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	18.28'	<b>12.0" Round Culvert</b> L= 16.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.28' / 17.49' S= 0.0479 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.86 cfs @ 12.00 hrs HW=19.23' TW=18.94' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 1.86 cfs @ 3.13 fps)

**Pond CB7:**

Hydrograph

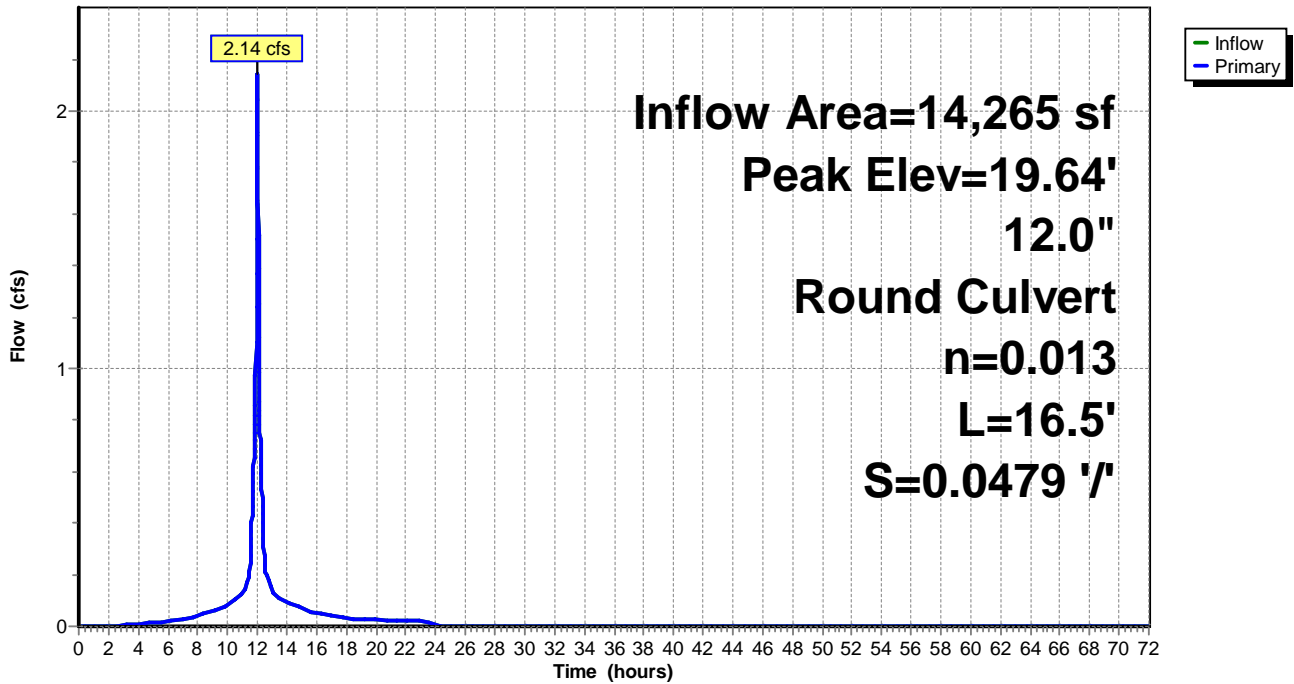

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 121

**Summary for Pond CB70:**

Inflow Area = 10,350 sf, 83.59% Impervious, Inflow Depth = 4.90" for 10 yr event  
 Inflow = 1.26 cfs @ 12.08 hrs, Volume= 4,227 cf  
 Outflow = 1.26 cfs @ 12.08 hrs, Volume= 4,227 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.26 cfs @ 12.08 hrs, Volume= 4,227 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 243.17' @ 12.15 hrs  
 Flood Elev= 25.17'

Device #1	Routing	Invert	Outlet Devices
	Primary	21.15'	<b>12.0" Round Culvert</b> L= 52.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 21.15' / 20.89' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.08 hrs HW=147.95' TW=166.59' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond CB70:**

Hydrograph

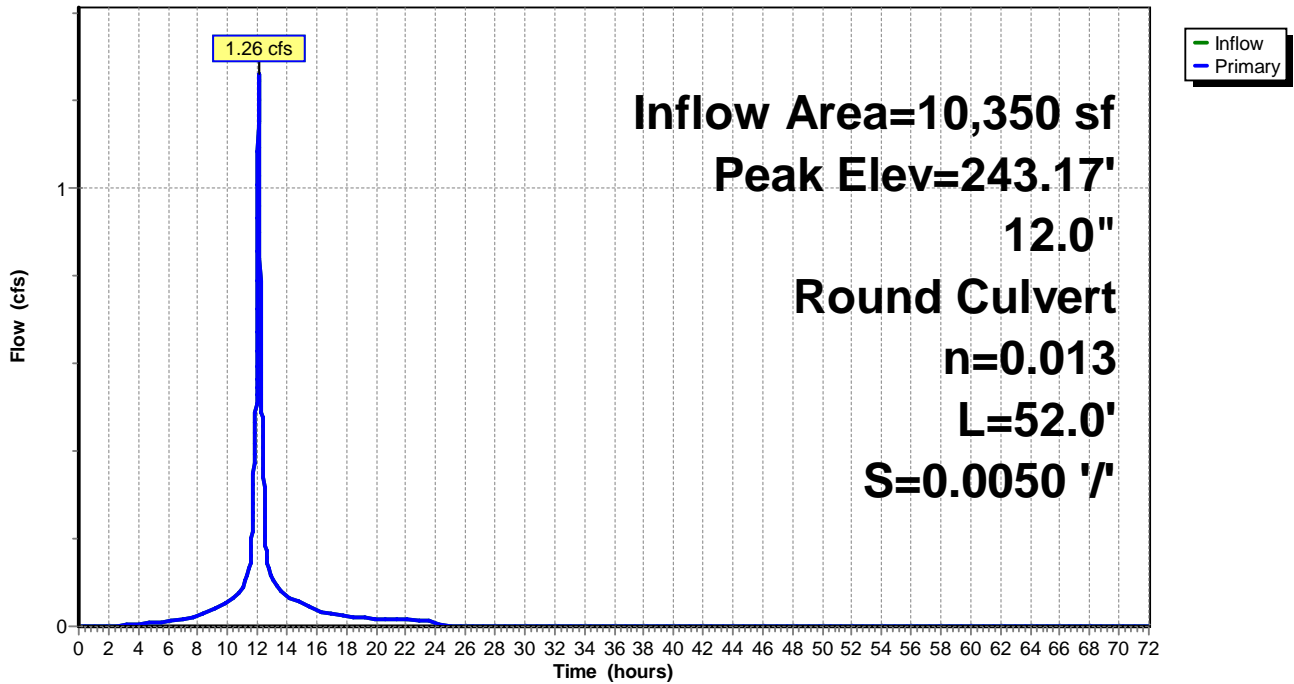

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 122

**Summary for Pond E2347:**

Inflow Area = 11,648 sf, 68.94% Impervious, Inflow Depth = 4.57" for 10 yr event  
 Inflow = 1.66 cfs @ 12.00 hrs, Volume= 4,432 cf  
 Outflow = 1.66 cfs @ 12.00 hrs, Volume= 4,432 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.66 cfs @ 12.00 hrs, Volume= 4,432 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 10.73' @ 12.01 hrs  
 Flood Elev= 13.80'

Device	Routing	Invert	Outlet Devices
#1	Primary	9.80'	<b>15.0" Round Culvert</b> L= 72.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.70' / 9.80' S= -0.0014 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=1.57 cfs @ 12.00 hrs HW=10.72' TW=10.54' (Dynamic Tailwater)  
 ↳ **1=Culvert** (Outlet Controls 1.57 cfs @ 1.99 fps)

**Pond E2347:**

Hydrograph

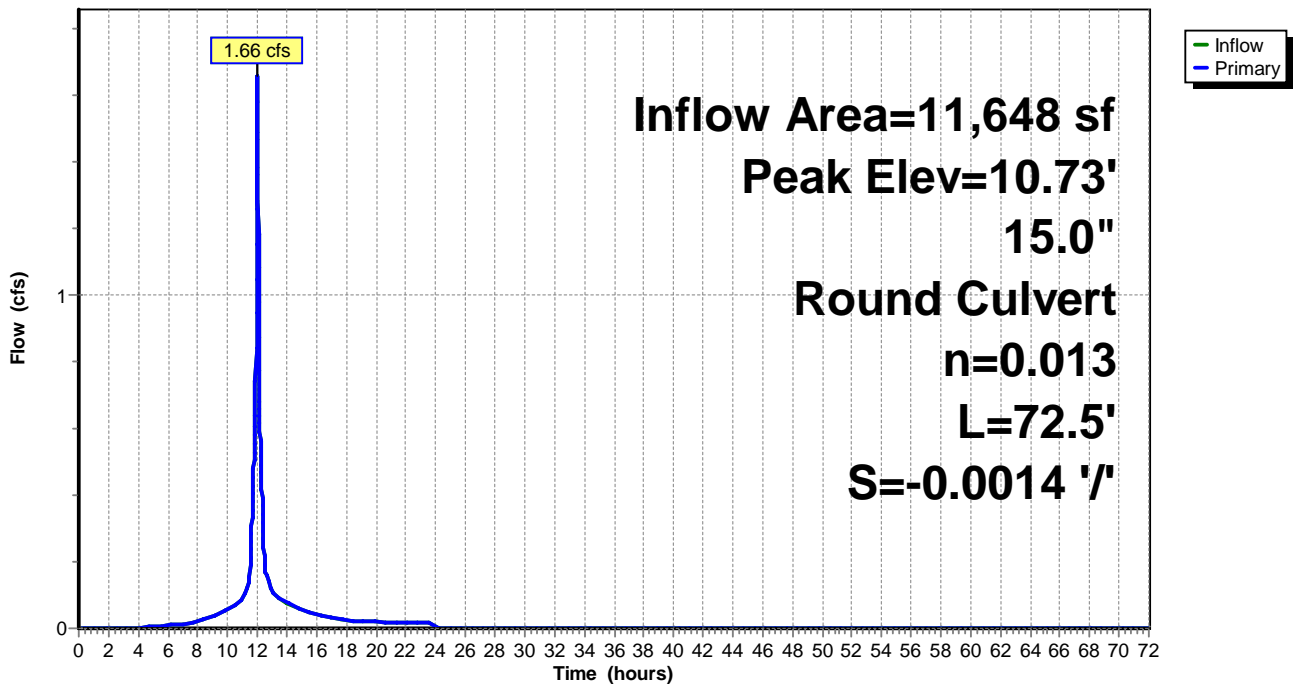

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 123

**Summary for Pond E2348:**

Inflow Area = 15,386 sf, 76.49% Impervious, Inflow Depth = 4.76" for 10 yr event  
 Inflow = 2.24 cfs @ 12.00 hrs, Volume= 6,103 cf  
 Outflow = 2.24 cfs @ 12.00 hrs, Volume= 6,103 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.24 cfs @ 12.00 hrs, Volume= 6,103 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 10.54' @ 12.00 hrs  
 Flood Elev= 13.60'

Device	Routing	Invert	Outlet Devices
#1	Primary	9.80'	<b>15.0" Round Culvert</b> L= 15.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.80' / 9.10' S= 0.0464 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=2.23 cfs @ 12.00 hrs HW=10.54' TW=5.52' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 2.23 cfs @ 2.94 fps)

**Pond E2348:**

Hydrograph

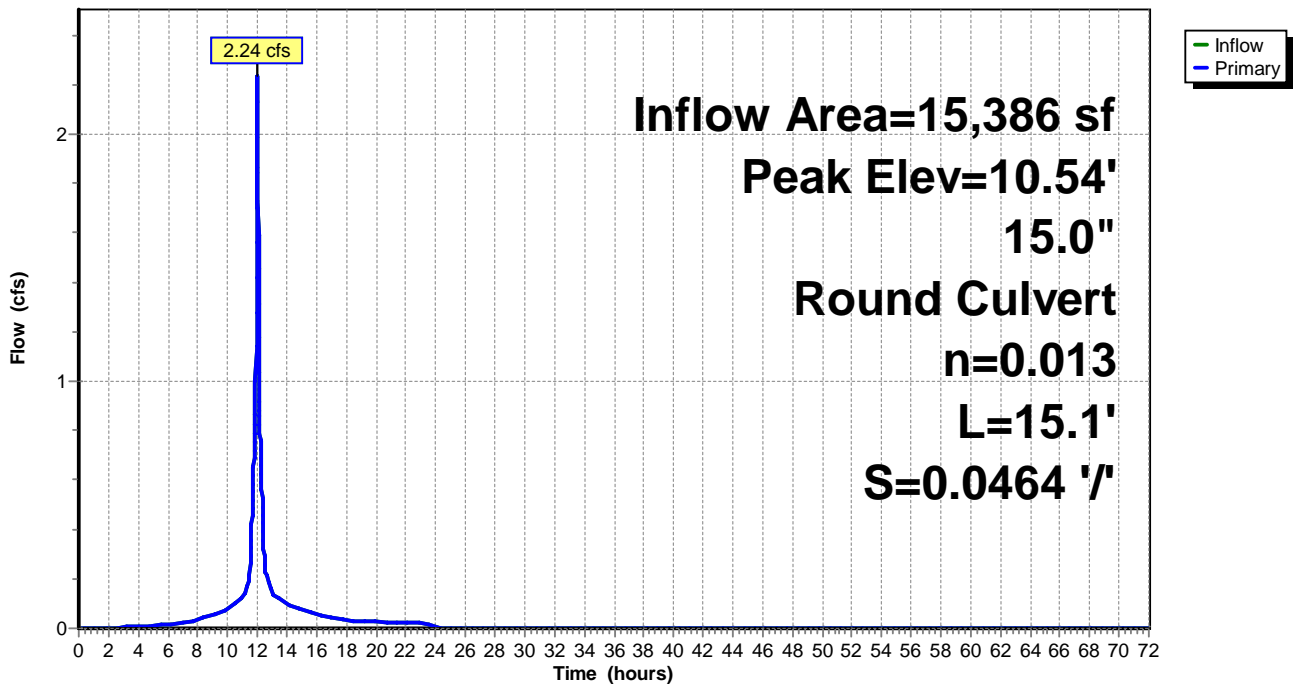

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 124

**Summary for Pond E2349:**

Inflow Area = 217,011 sf, 77.52% Impervious, Inflow Depth = 3.39" for 10 yr event  
 Inflow = 12.19 cfs @ 12.14 hrs, Volume= 61,228 cf  
 Outflow = 12.19 cfs @ 12.14 hrs, Volume= 61,228 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 12.19 cfs @ 12.14 hrs, Volume= 61,228 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 6.07' @ 12.15 hrs  
 Flood Elev= 13.94'

Device #1	Routing	Invert	Outlet Devices
	Primary	3.92'	<b>24.0" Round Culvert</b> L= 82.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 3.92' / 3.51' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=12.14 cfs @ 12.14 hrs HW=6.07' TW=5.36' (Dynamic Tailwater)  
 1=Culvert (Outlet Controls 12.14 cfs @ 4.48 fps)

**Pond E2349:**

Hydrograph

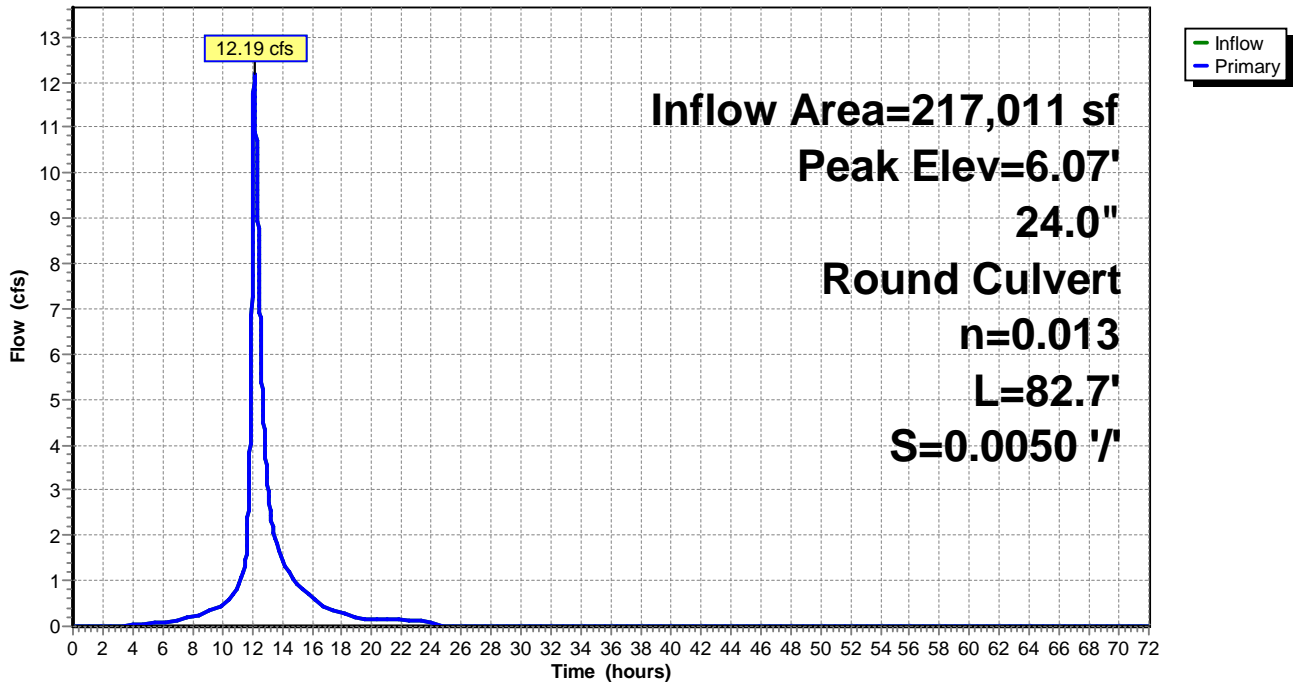

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 125

**Summary for Pond E3578A:**

Inflow Area = 4,381 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf  
 Outflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 9.50' @ 12.00 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	9.00'	<b>8.0" Round Culvert</b> L= 11.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.00' / 7.90' S= 0.0982 '/ Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.35 sf

**Primary OutFlow** Max=0.67 cfs @ 12.00 hrs HW=9.50' TW=8.59' (Dynamic Tailwater)  
 ↳ **1=Culvert** (Inlet Controls 0.67 cfs @ 2.40 fps)

**Pond E3578A:**

Hydrograph

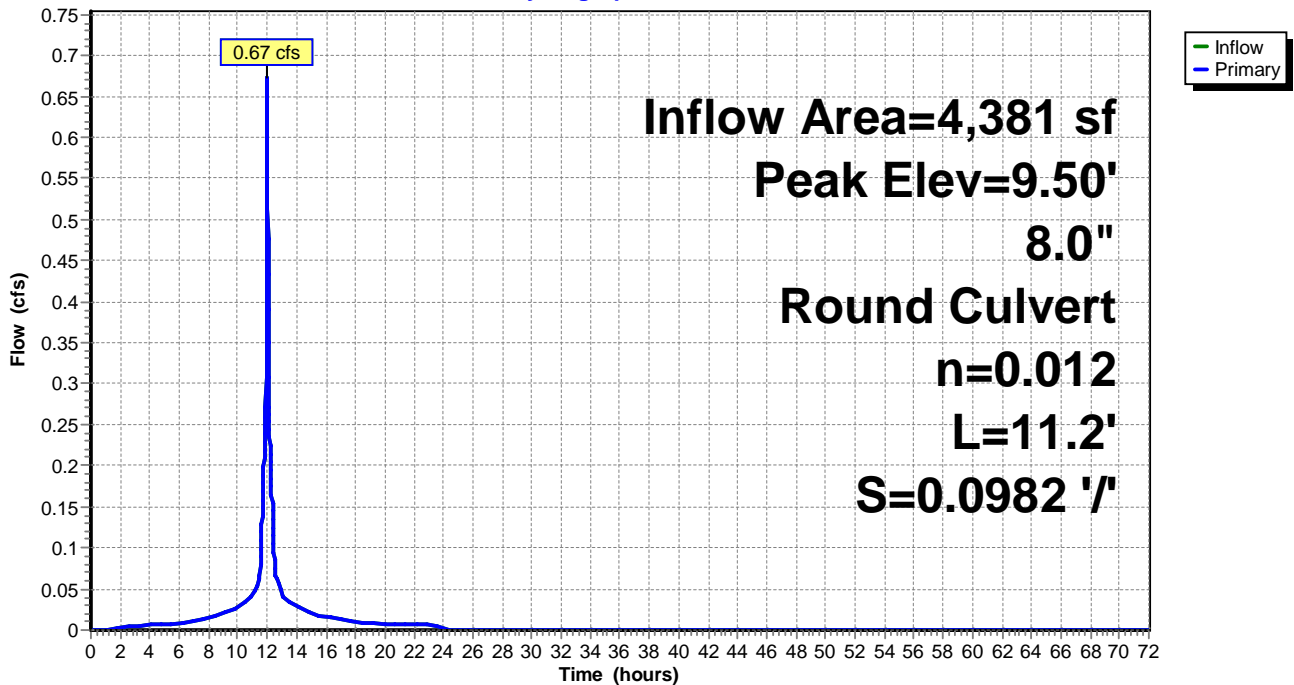



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 126

**Summary for Pond E3579:**

Inflow Area = 274,692 sf, 72.93% Impervious, Inflow Depth = 3.16" for 10 yr event  
 Inflow = 14.18 cfs @ 12.13 hrs, Volume= 72,393 cf  
 Outflow = 14.18 cfs @ 12.13 hrs, Volume= 72,393 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 14.18 cfs @ 12.13 hrs, Volume= 72,393 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 4.19' @ 12.14 hrs  
 Flood Elev= 10.77'

Device #1	Routing	Invert	Outlet Devices
	Primary	2.00'	<b>36.0" Round Culvert</b> L= 205.5' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 2.00' / 1.80' S= 0.0010 1/' Cc= 0.900 n= 0.015 Brickwork, Flow Area= 7.07 sf

**Primary OutFlow** Max=14.11 cfs @ 12.13 hrs HW=4.19' TW=3.52' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 14.11 cfs @ 3.57 fps)

**Pond E3579:**

Hydrograph

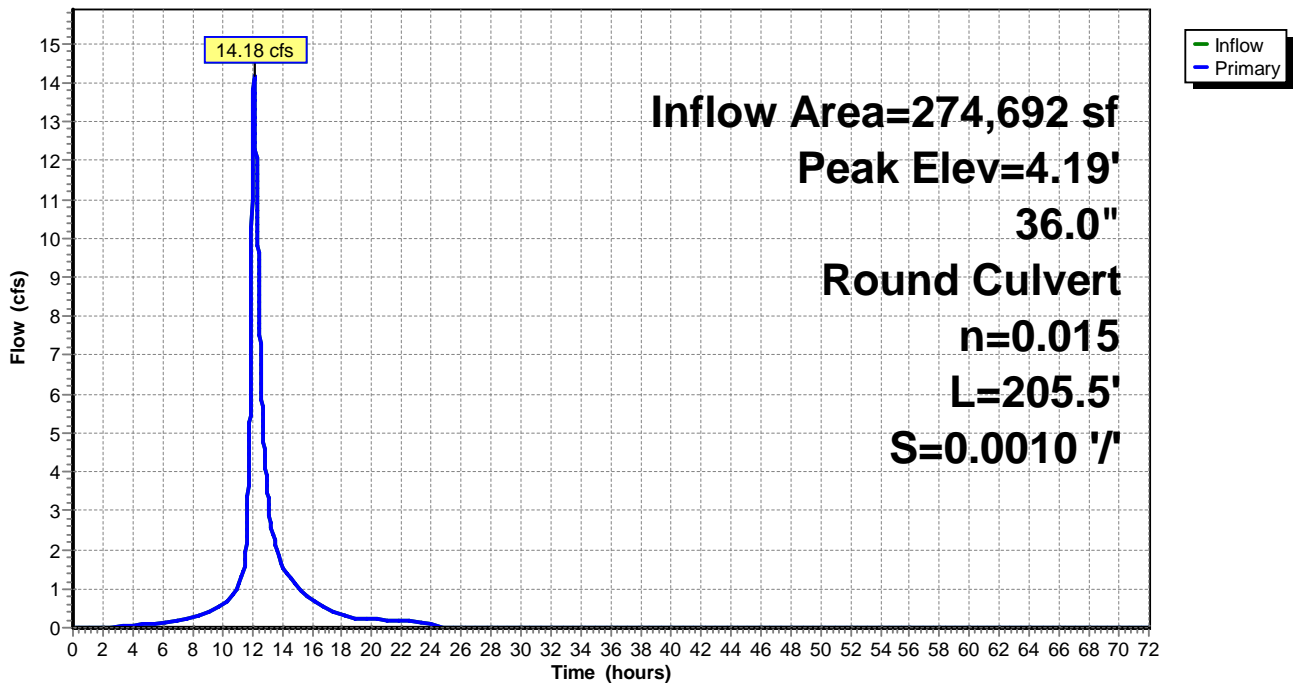

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 127

**Summary for Pond E3600:**

Inflow Area = 417 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.06 cfs @ 12.00 hrs, Volume= 186 cf  
 Outflow = 0.06 cfs @ 12.00 hrs, Volume= 186 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.06 cfs @ 12.00 hrs, Volume= 186 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 7.62' @ 12.00 hrs  
 Flood Elev= 11.10'

Device #1	Routing	Invert	Outlet Devices
	Primary	7.50'	<b>12.0" Round Culvert</b> L= 21.4' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.50' / 2.00' S= 0.2570 '/ Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.06 cfs @ 12.00 hrs HW=7.62' TW=4.00' (Dynamic Tailwater)  
 ← **1=Culvert** (Inlet Controls 0.06 cfs @ 1.18 fps)

**Pond E3600:**

Hydrograph

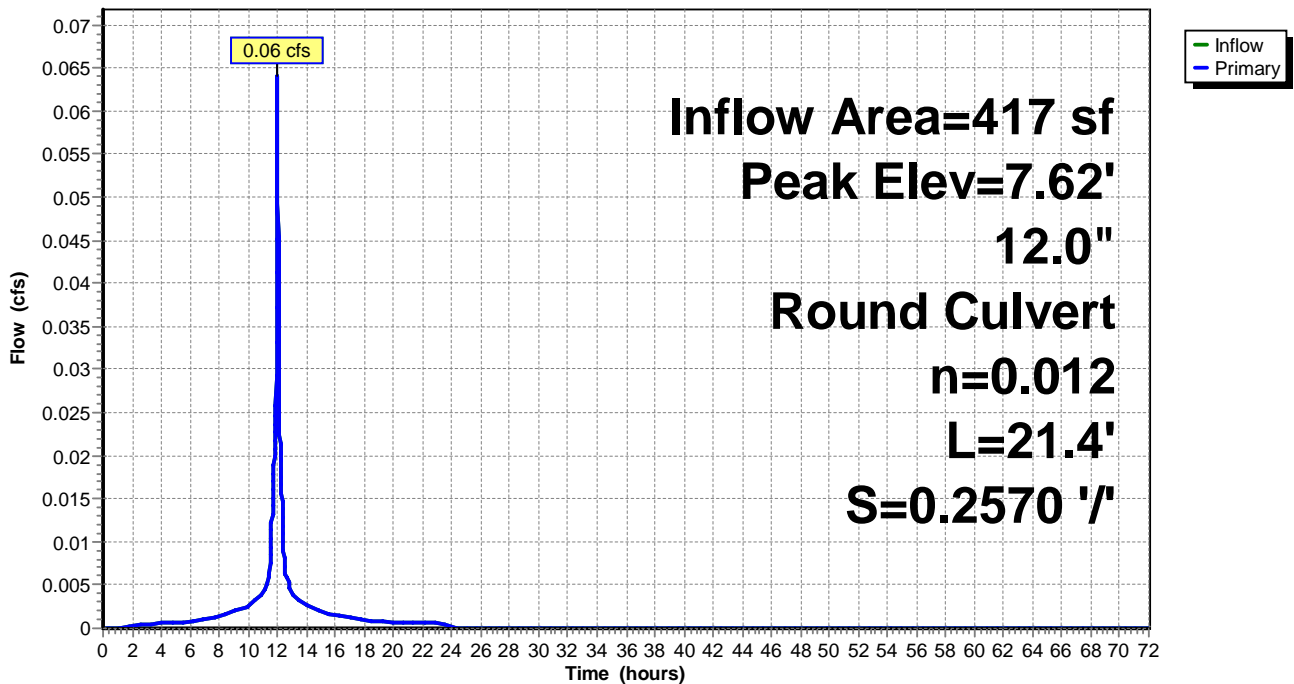

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 128

**Summary for Pond E3672:**

Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0 cf  
 Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 8.24' @ 11.99 hrs  
 Flood Elev= 11.90'

Device	Routing	Invert	Outlet Devices
#1	Primary	8.20'	<b>4.0" Round Culvert</b> L= 13.9' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 8.20' / 8.20' S= 0.0000 1' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

**Primary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=8.20' TW=7.90' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond E3672:**

Hydrograph

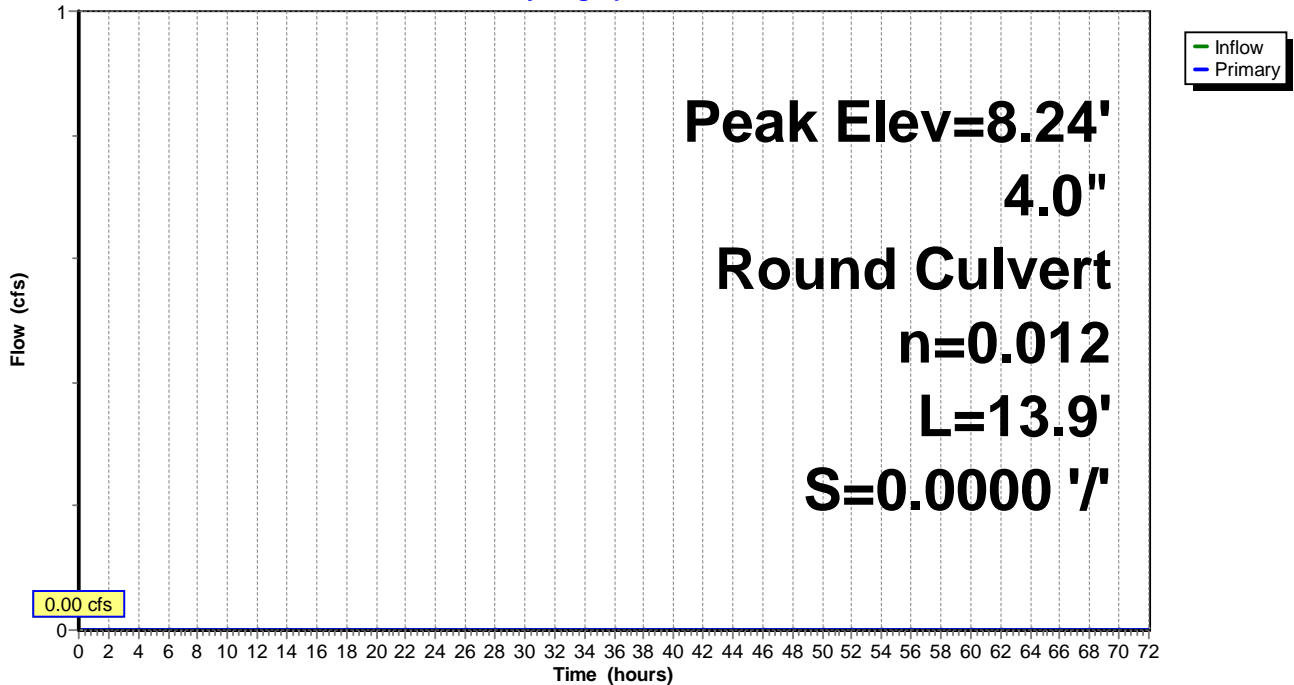

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 129

**Summary for Pond E3693:**

Inflow Area = 3,520 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.54 cfs @ 12.00 hrs, Volume= 1,573 cf  
 Outflow = 0.54 cfs @ 12.00 hrs, Volume= 1,573 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.54 cfs @ 12.00 hrs, Volume= 1,573 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 8.27' @ 12.00 hrs  
 Flood Elev= 11.00'

Device #1	Routing	Invert	Outlet Devices
	Primary	7.90'	<b>12.0" Round Culvert</b> L= 27.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.90' / 2.00' S= 0.2177 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.54 cfs @ 12.00 hrs HW=8.27' TW=4.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 0.54 cfs @ 2.06 fps)

**Pond E3693:**

Hydrograph

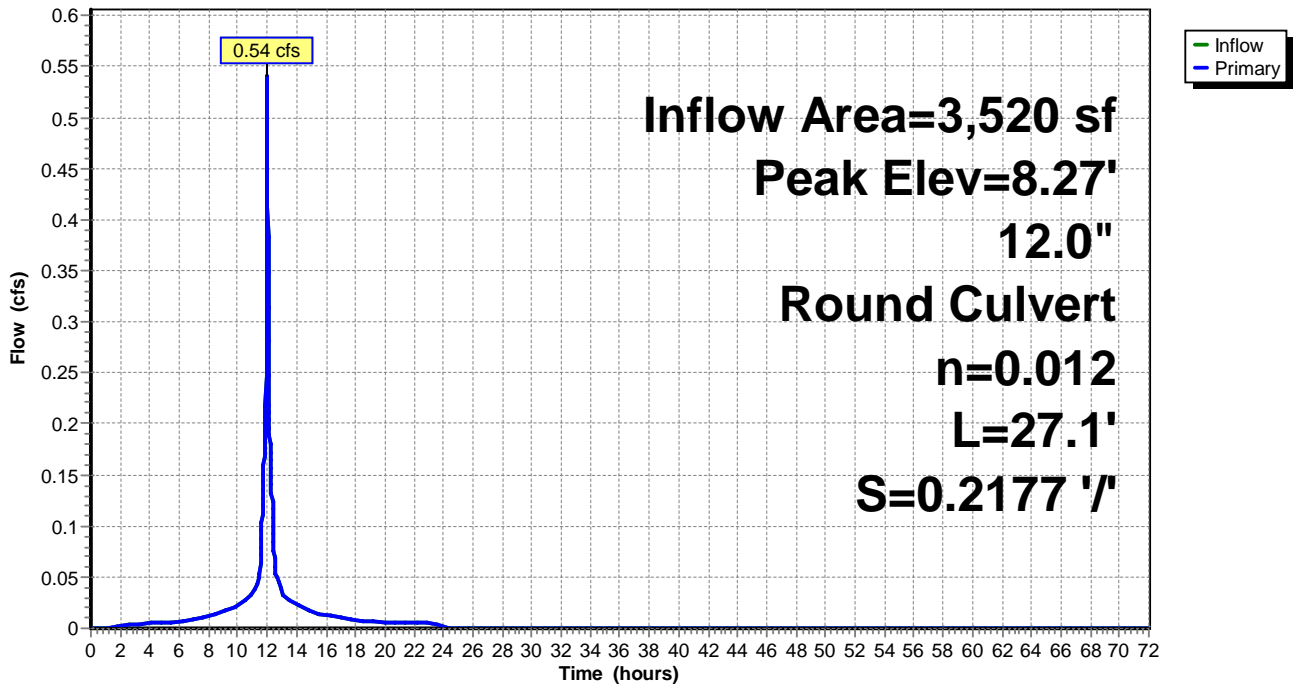

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 130

**Summary for Pond E3756:**

Inflow Area = 4,381 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf  
 Outflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 8.21' @ 12.00 hrs  
 Flood Elev= 11.60'

Device #1	Routing	Invert	Outlet Devices
	Primary	7.80'	<b>12.0" Round Culvert</b> L= 23.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.80' / 2.00' S= 0.2500 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.67 cfs @ 12.00 hrs HW=8.21' TW=4.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 0.67 cfs @ 2.19 fps)

**Pond E3756:**

Hydrograph

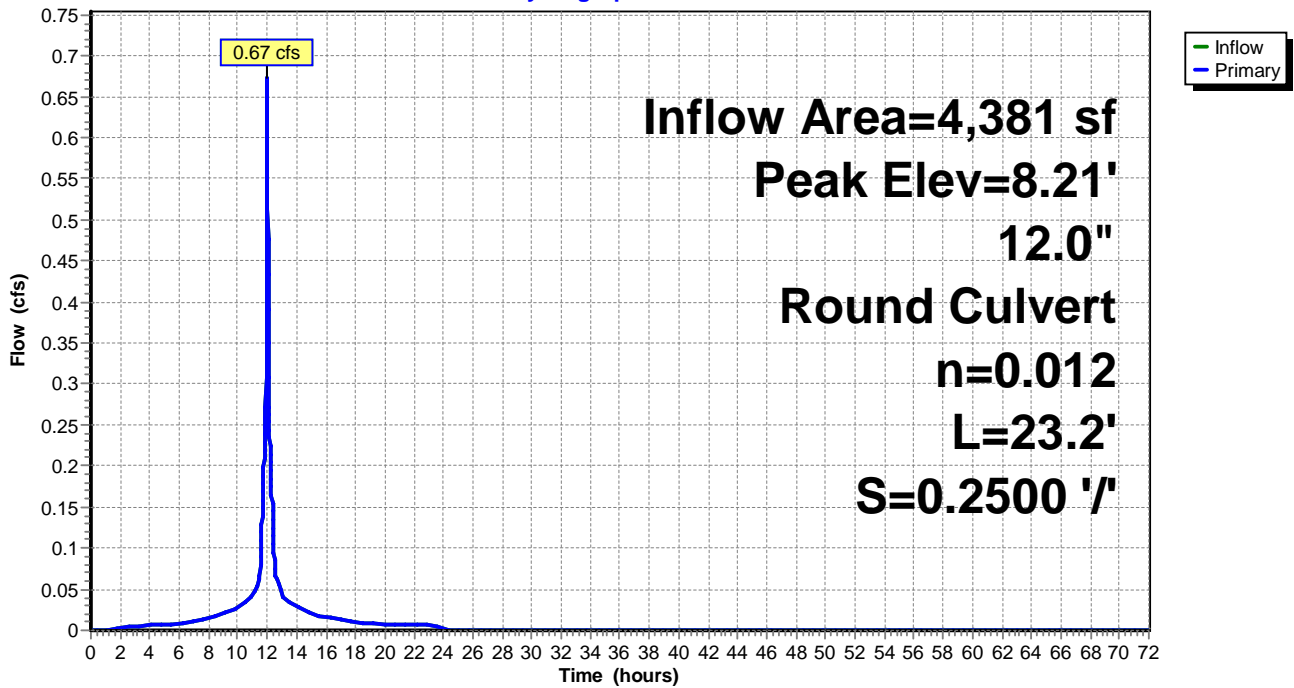

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 131

**Summary for Pond E3758:**

Inflow Area = 4,381 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf  
 Outflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 8.59' @ 12.01 hrs  
 Flood Elev= 10.90'

Device #1	Routing	Invert	Outlet Devices
	Primary	8.00'	<b>12.0" Round Culvert</b> L= 10.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 8.00' / 8.00' S= 0.0000 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.63 cfs @ 12.00 hrs HW=8.59' TW=8.49' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 0.63 cfs @ 1.89 fps)

**Pond E3758:**

Hydrograph

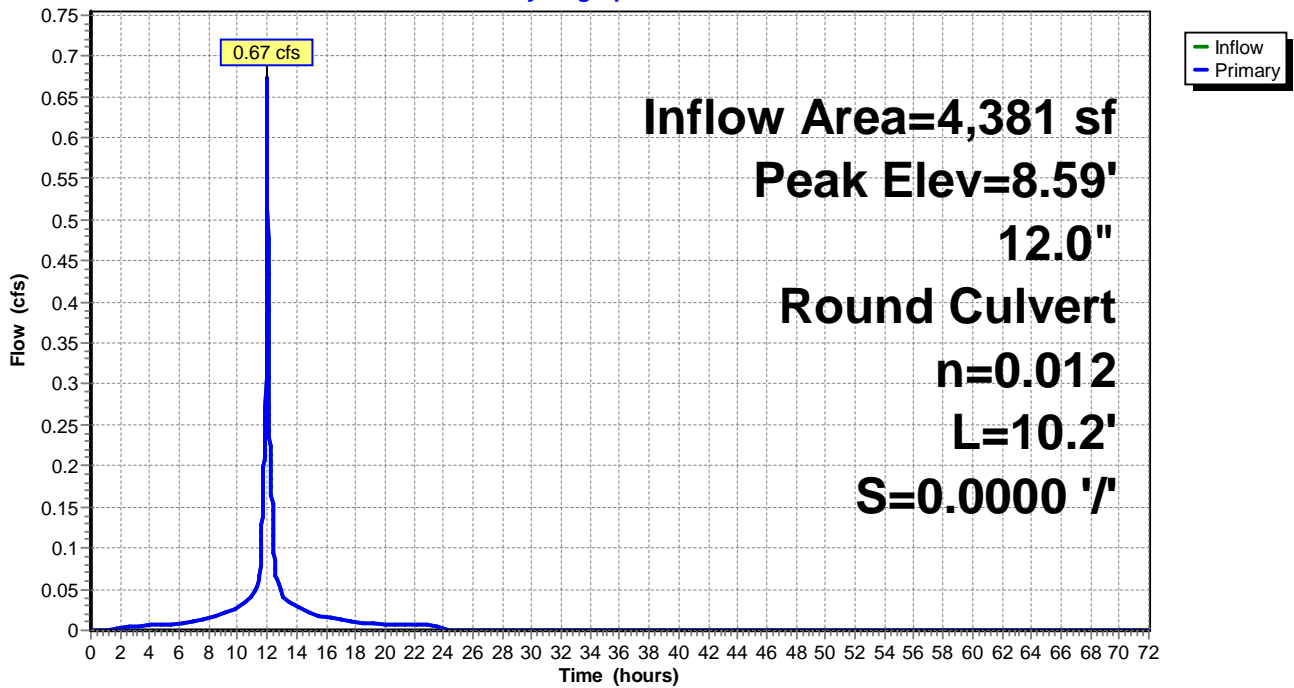

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 132

**Summary for Pond E3760:**

Inflow Area = 4,381 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf  
 Outflow = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.67 cfs @ 12.00 hrs, Volume= 1,958 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 8.49' @ 12.00 hrs  
 Flood Elev= 10.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	8.00'	<b>12.0" Round Culvert</b> L= 32.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 8.00' / 7.80' S= 0.0061 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.66 cfs @ 12.00 hrs HW=8.49' TW=8.21' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 0.66 cfs @ 2.55 fps)

**Pond E3760:**

Hydrograph

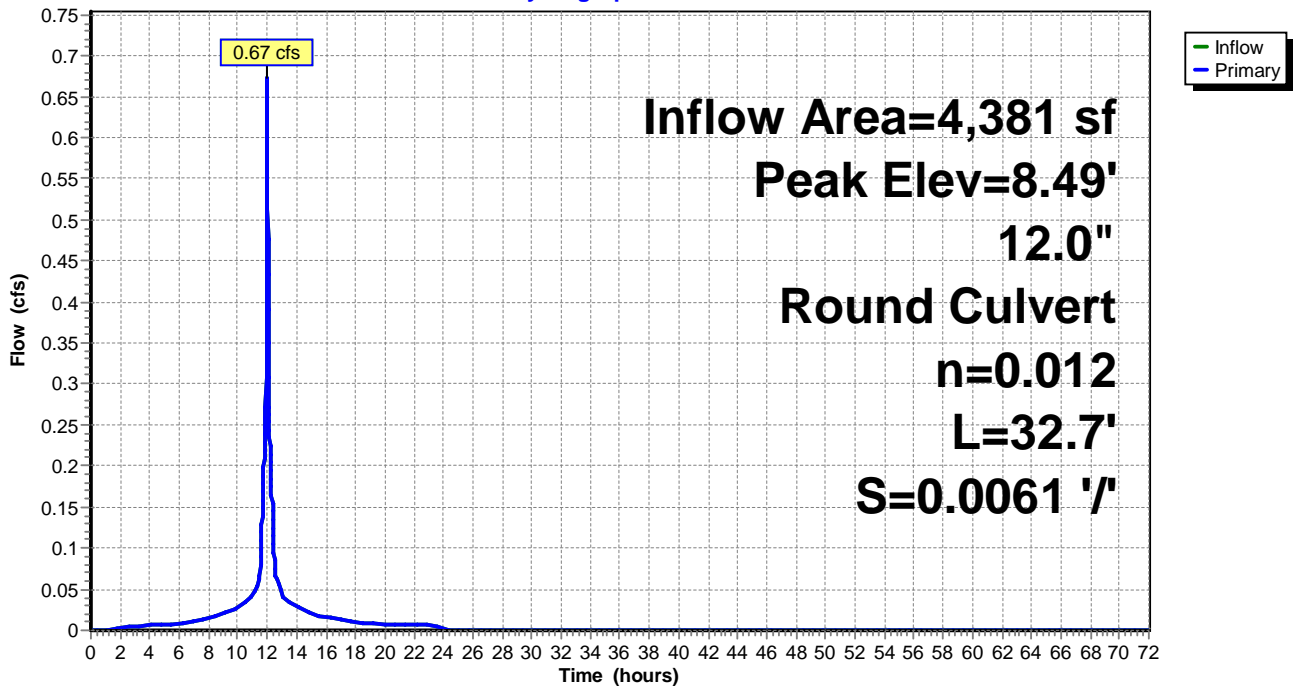

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 133

**Summary for Pond E3772:**

Inflow Area = 219,211 sf, 77.74% Impervious, Inflow Depth = 3.41" for 10 yr event  
 Inflow = 12.31 cfs @ 12.14 hrs, Volume= 62,212 cf  
 Outflow = 12.31 cfs @ 12.14 hrs, Volume= 62,212 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 12.31 cfs @ 12.14 hrs, Volume= 62,212 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 5.36' @ 12.14 hrs  
 Flood Elev= 12.38'

Device #1	Routing	Invert	Outlet Devices
	Primary	3.41'	<b>24.0" Round Culvert</b> L= 81.8' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 3.41' / 3.00' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=12.30 cfs @ 12.14 hrs HW=5.36' TW=4.19' (Dynamic Tailwater)  
 ↳ **1=Culvert** (Barrel Controls 12.30 cfs @ 5.01 fps)

**Pond E3772:**

Hydrograph

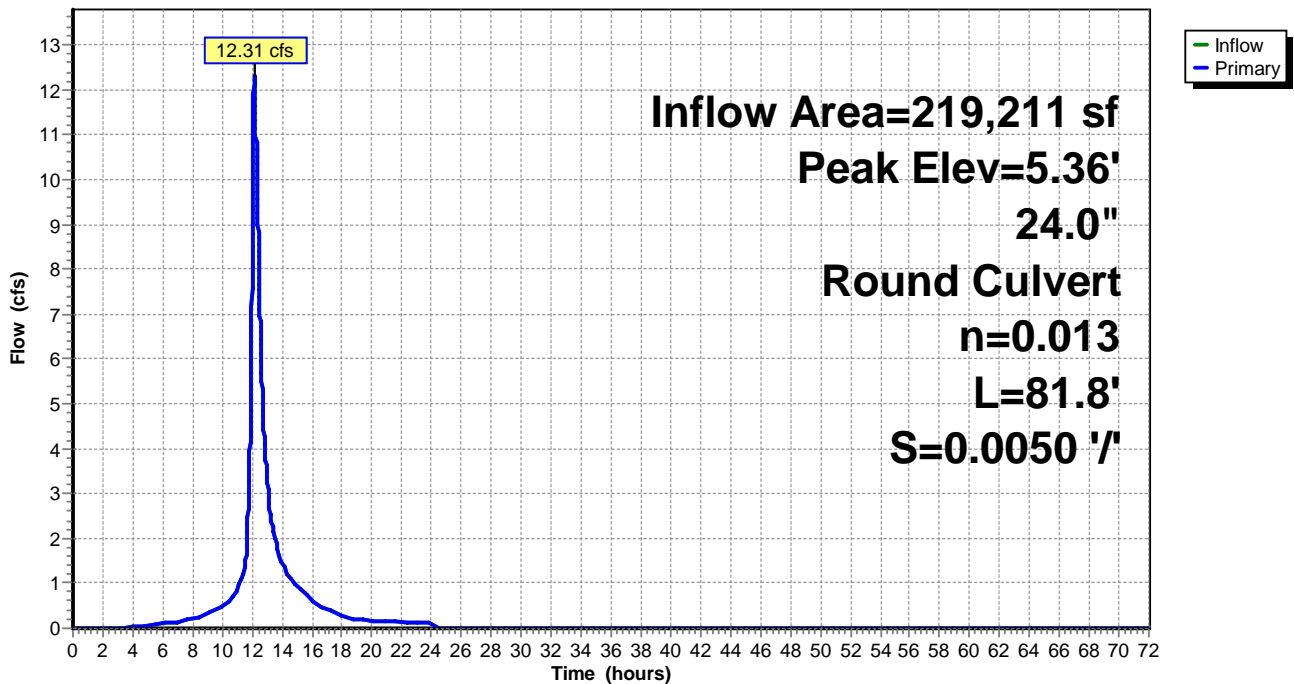



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 134

**Summary for Pond E3866:**

Inflow Area = 28,429 sf, 52.39% Impervious, Inflow Depth = 4.09" for 10 yr event  
 Inflow = 3.05 cfs @ 12.09 hrs, Volume= 9,695 cf  
 Outflow = 3.05 cfs @ 12.09 hrs, Volume= 9,695 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.73 cfs @ 12.08 hrs, Volume= 684 cf  
 Secondary = 2.33 cfs @ 12.09 hrs, Volume= 9,011 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 5.75' @ 12.08 hrs

Flood Elev= 10.04'

Device	Routing	Invert	Outlet Devices
#1	Primary	5.40'	<b>24.0" Round Culvert</b> L= 49.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.40' / 3.00' S= 0.0490 1/1' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Secondary	5.30'	<b>42.0" W x 24.0" H Box Culvert</b> L= 83.8' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.30' / 5.00' S= 0.0036 1/1' Cc= 0.900 n= 0.012 Concrete pipe, finished, Flow Area= 7.00 sf

**Primary OutFlow** Max=0.73 cfs @ 12.08 hrs HW=5.75' TW=4.13' (Dynamic Tailwater)


↑**1=Culvert** (Inlet Controls 0.73 cfs @ 2.00 fps)

**Secondary OutFlow** Max=2.40 cfs @ 12.09 hrs HW=5.74' TW=5.52' (Dynamic Tailwater)

↑**2=Culvert** (Outlet Controls 2.40 cfs @ 2.06 fps)

**Pond E3866:**

Hydrograph

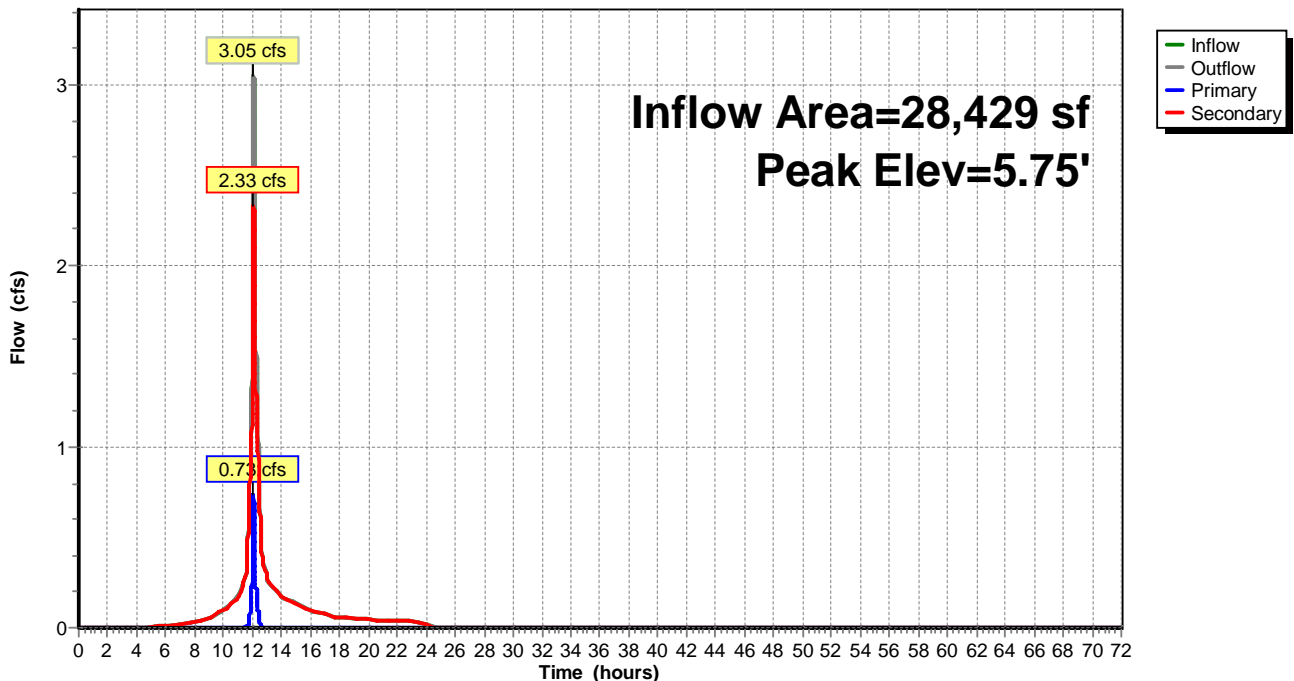

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 135

**Summary for Pond E3895:**


Device #1	Routing	Invert	Outlet Devices
	Primary	9.70'	<b>4.0" Round Culvert</b> L= 37.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.70' / 8.70' S= 0.0270 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.09 sf

**Primary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=0.00' TW=8.20' (Dynamic Tailwater)

↑**1=Culvert** ( Controls 0.00 cfs)

**Pond E3895:**

Hydrograph

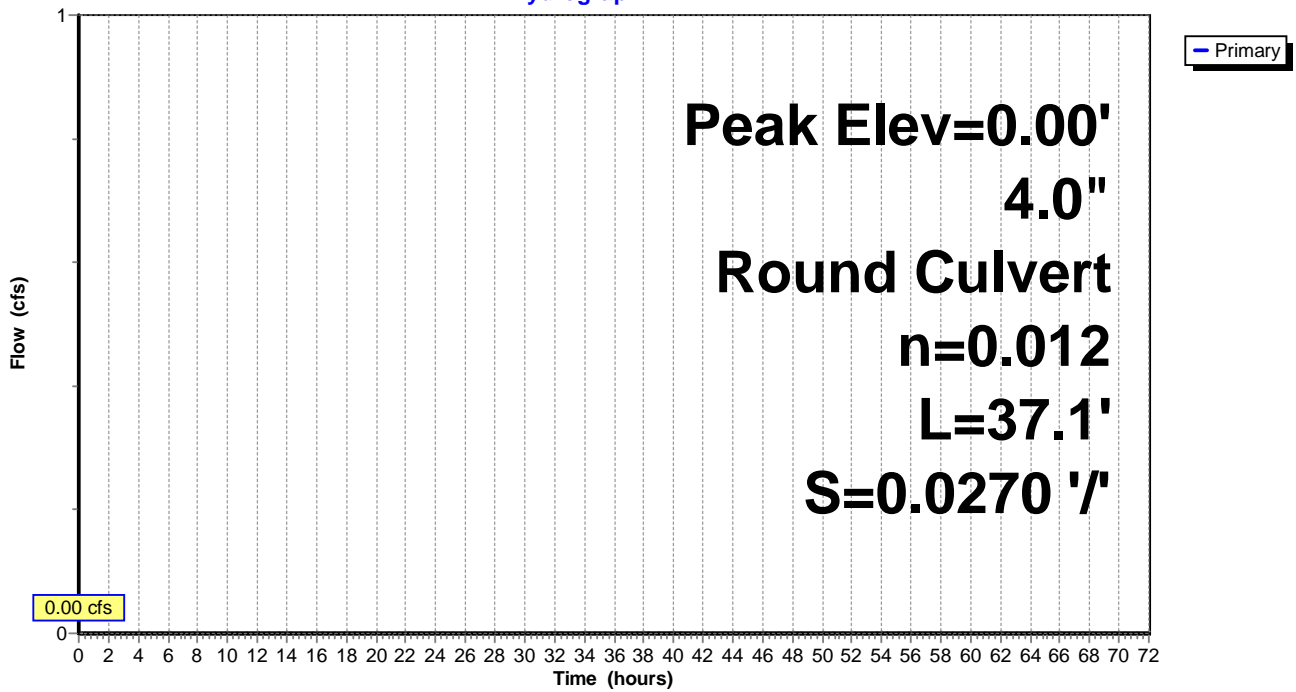

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 136

**Summary for Pond E4034:**

Inflow Area = 1,846 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 0.28 cfs @ 12.00 hrs, Volume= 825 cf  
 Outflow = 0.28 cfs @ 12.00 hrs, Volume= 825 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.28 cfs @ 12.00 hrs, Volume= 825 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 7.76' @ 12.00 hrs  
 Flood Elev= 10.80'

Device	Routing	Invert	Outlet Devices
#1	Primary	7.50'	<b>12.0" Round Culvert</b> L= 14.8' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 7.50' / 2.00' S= 0.3716 '/ Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.28 cfs @ 12.00 hrs HW=7.76' TW=4.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 0.28 cfs @ 1.74 fps)

**Pond E4034:**

Hydrograph

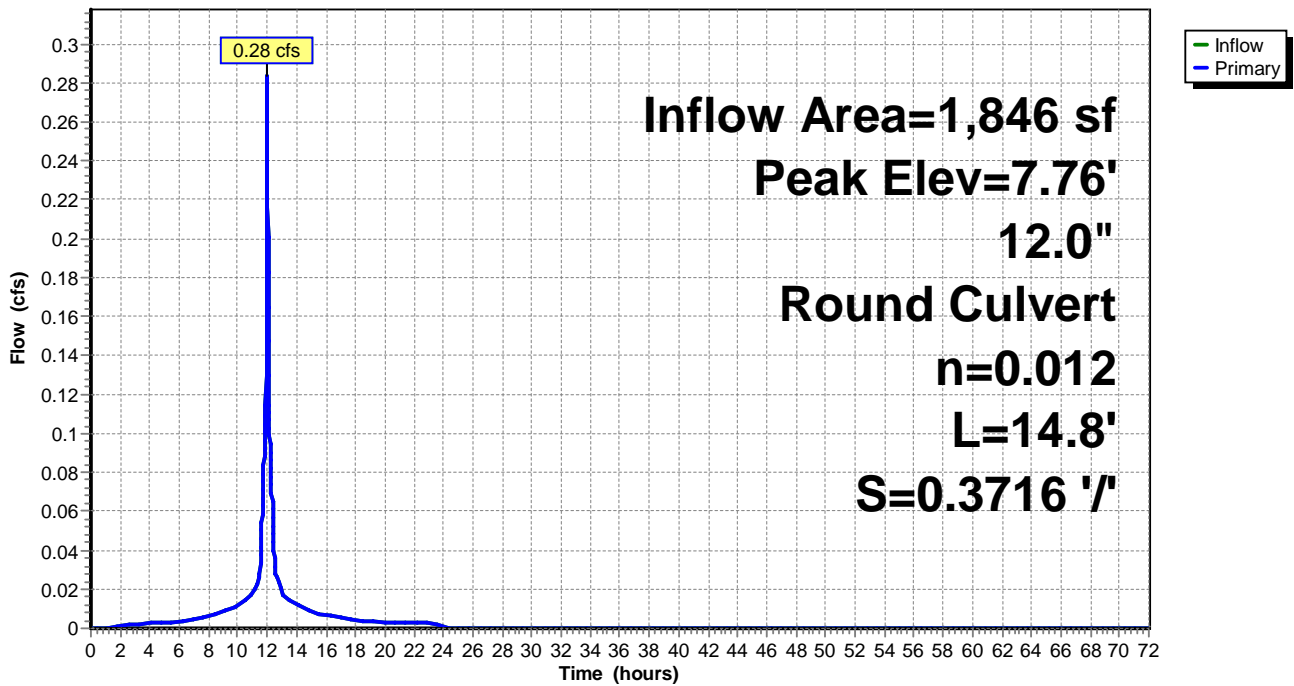

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 137

**Summary for Pond E4035:**

Inflow Area = 274,692 sf, 72.93% Impervious, Inflow Depth = 3.16" for 10 yr event  
 Inflow = 14.18 cfs @ 12.13 hrs, Volume= 72,393 cf  
 Outflow = 14.18 cfs @ 12.13 hrs, Volume= 72,393 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 14.18 cfs @ 12.13 hrs, Volume= 72,393 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 3.53' @ 12.14 hrs  
 Flood Elev= 11.70'

Device #1	Routing	Invert	Outlet Devices
	Primary	1.80'	<b>42.0" Round Culvert</b> L= 139.6' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1.80' / 1.00' S= 0.0057 '/' Cc= 0.900 n= 0.012 Concrete pipe, finished, Flow Area= 9.62 sf

**Primary OutFlow** Max=14.15 cfs @ 12.13 hrs HW=3.52' TW=2.80' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 14.15 cfs @ 4.38 fps)

**Pond E4035:**

Hydrograph

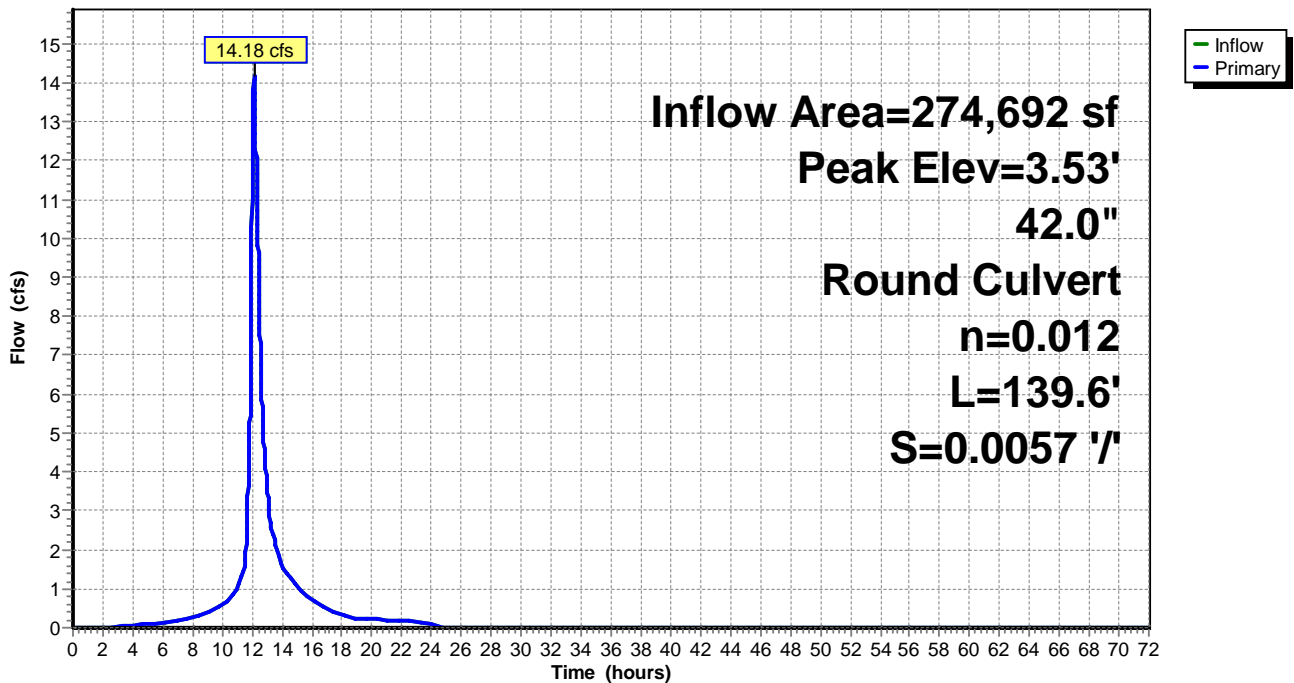

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 138

**Summary for Pond E4081:**

Inflow Area = 14,033 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 2.16 cfs @ 12.00 hrs, Volume= 6,271 cf  
 Outflow = 2.15 cfs @ 12.00 hrs, Volume= 6,271 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.15 cfs @ 12.00 hrs, Volume= 6,271 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 7.09' @ 12.00 hrs

Flood Elev= 8.70'


Device	Routing	Invert	Outlet Devices
#1	Primary	5.80'	<b>12.0" Round Culvert</b> L= 13.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.80' / 5.70' S= 0.0077 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=2.06 cfs @ 12.00 hrs HW=7.08' TW=6.78' (Dynamic Tailwater)

↑ **1=Culvert** (Inlet Controls 2.06 cfs @ 2.62 fps)

**Pond E4081:**

Hydrograph

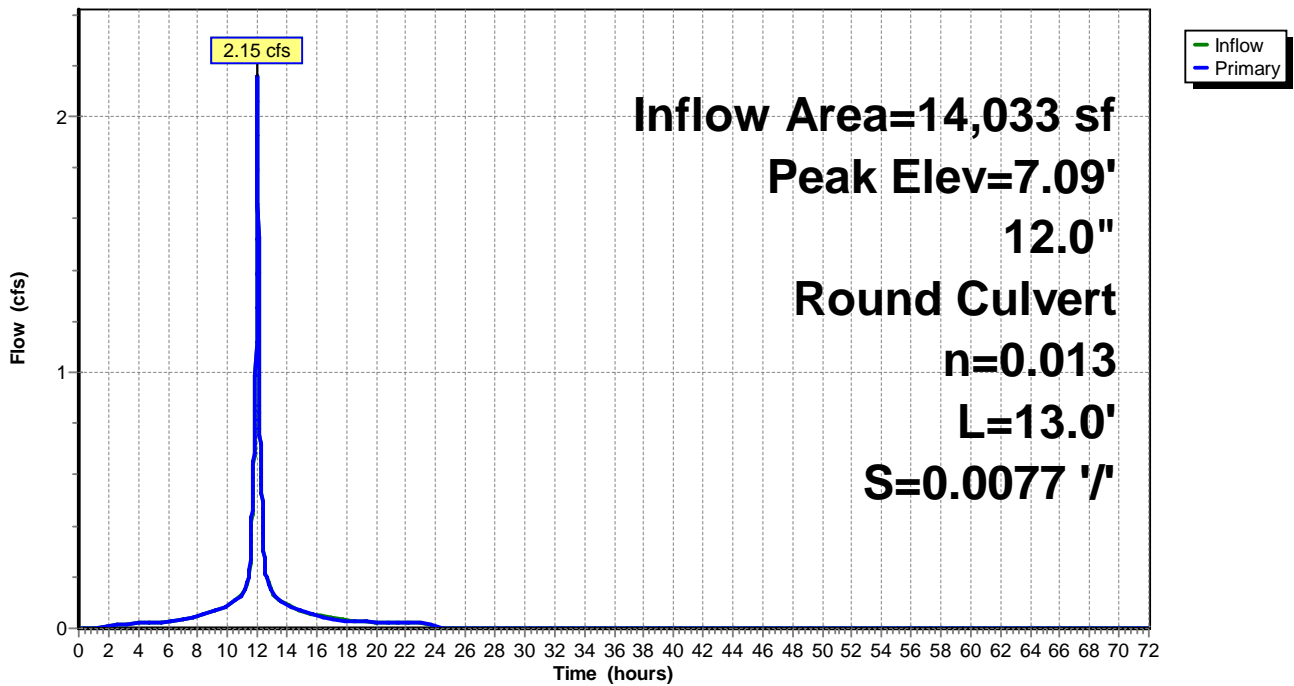

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 139

**Summary for Pond E4082:**

Inflow Area = 14,033 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 2.15 cfs @ 12.00 hrs, Volume= 6,271 cf  
 Outflow = 2.15 cfs @ 12.00 hrs, Volume= 6,271 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.15 cfs @ 12.00 hrs, Volume= 6,271 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 6.78' @ 12.00 hrs  
 Flood Elev= 8.70'

Device	Routing	Invert	Outlet Devices
#1	Primary	5.90'	<b>12.0" Round Culvert</b> L= 11.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.90' / 5.70' S= 0.0180 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=2.15 cfs @ 12.00 hrs HW=6.78' TW=5.56' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 2.15 cfs @ 3.90 fps)

**Pond E4082:**

Hydrograph

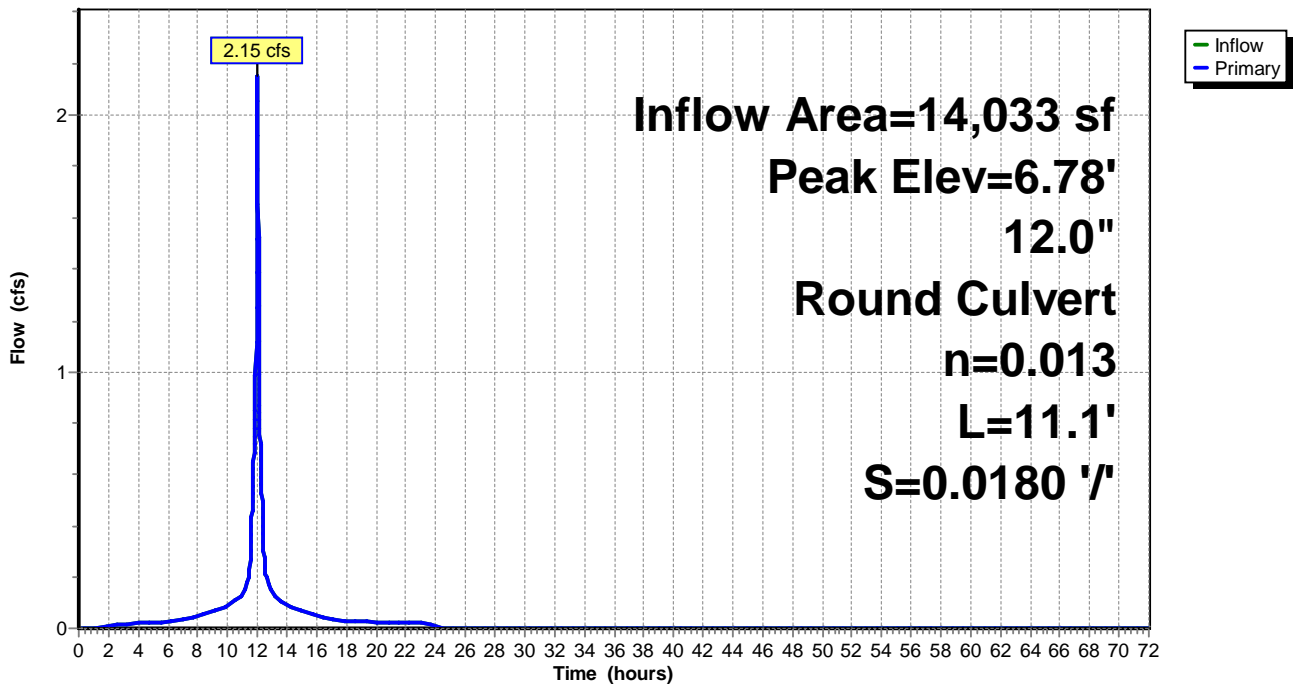

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 140

**Summary for Pond E4083:**

Inflow Area = 16,957 sf, 94.44% Impervious, Inflow Depth = 11.58" for 10 yr event  
 Inflow = 3.99 cfs @ 12.00 hrs, Volume= 16,368 cf  
 Outflow = 3.99 cfs @ 12.00 hrs, Volume= 16,368 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 3.99 cfs @ 12.00 hrs, Volume= 16,368 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 5.56' @ 12.00 hrs  
 Flood Elev= 8.90'

Device #1	Routing	Invert	Outlet Devices
	Primary	5.00'	<b>42.0" W x 24.0" H Box Culvert</b> L= 25.4' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.00' / 4.75' S= 0.0098 '/' Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 7.00 sf

**Primary OutFlow** Max=3.96 cfs @ 12.00 hrs HW=5.56' TW=0.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 3.96 cfs @ 2.69 fps)

**Pond E4083:**

Hydrograph

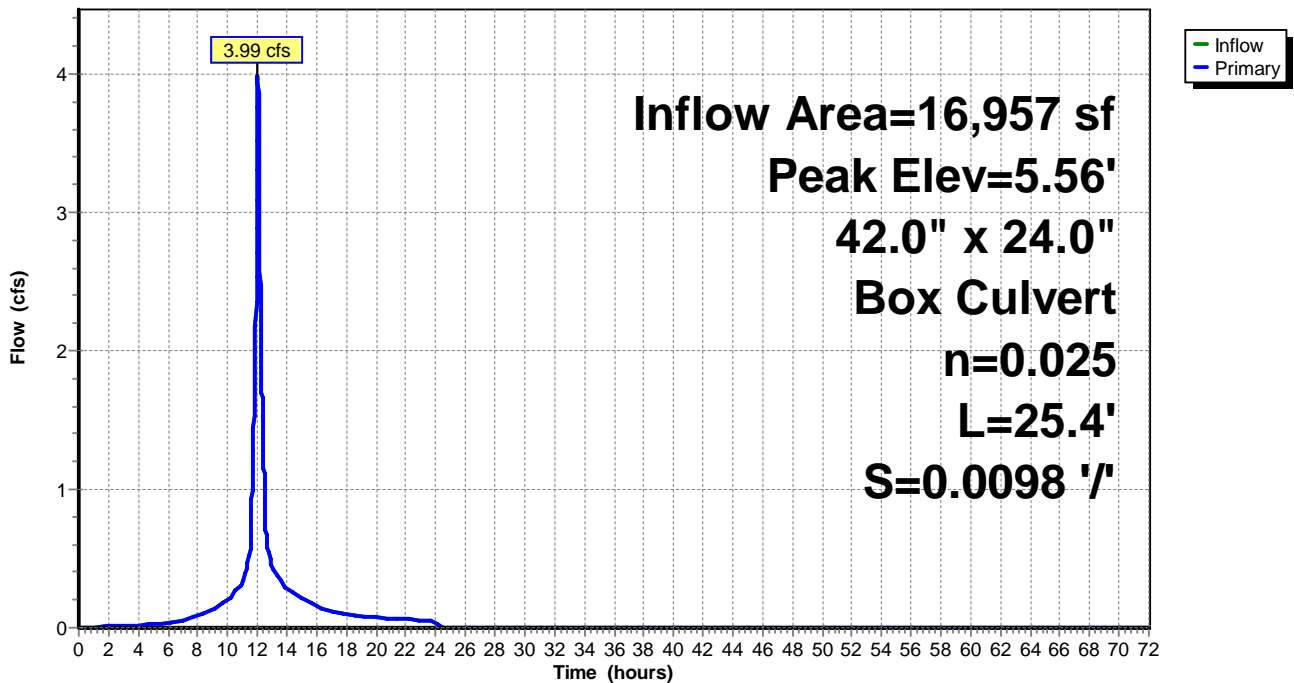

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 141

**Summary for Pond E4093:**

Inflow Area = 2,924 sf, 67.78% Impervious, Inflow Depth = 4.46" for 10 yr event  
 Inflow = 0.41 cfs @ 12.00 hrs, Volume= 1,086 cf  
 Outflow = 0.41 cfs @ 12.00 hrs, Volume= 1,086 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.41 cfs @ 12.00 hrs, Volume= 1,086 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Peak Elev= 6.22' @ 12.00 hrs


Flood Elev= 9.00'

Device #1	Routing	Invert	Outlet Devices
	Primary	5.90'	<b>12.0" Round Culvert</b> L= 13.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 5.90' / 5.60' S= 0.0219 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.41 cfs @ 12.00 hrs HW=6.22' TW=5.56' (Dynamic Tailwater)  
 ← **1=Culvert** (Inlet Controls 0.41 cfs @ 1.92 fps)

**Pond E4093:**

Hydrograph

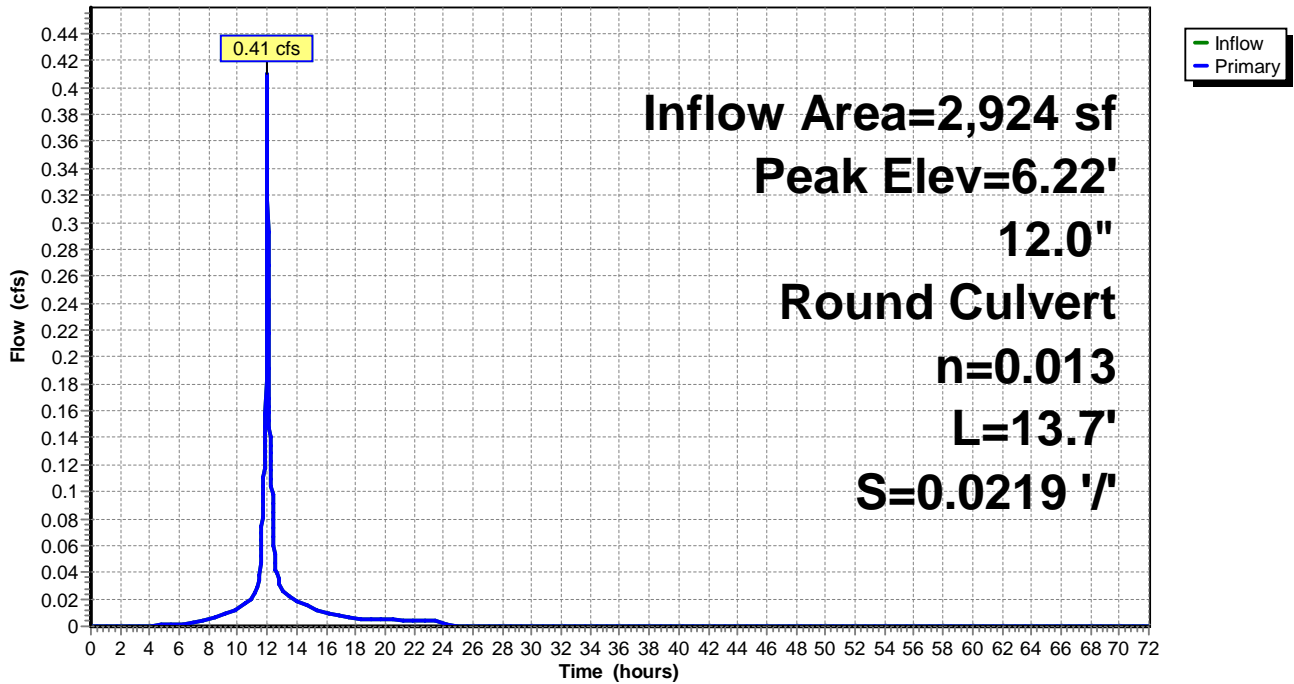



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 142

**Summary for Pond E4604:**

Inflow Area = 274,692 sf, 72.93% Impervious, Inflow Depth = 3.16" for 10 yr event  
 Inflow = 14.18 cfs @ 12.13 hrs, Volume= 72,393 cf  
 Outflow = 14.18 cfs @ 12.13 hrs, Volume= 72,394 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 14.18 cfs @ 12.13 hrs, Volume= 72,394 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 2.80' @ 12.13 hrs  
 Flood Elev= 10.30'

Device #1	Routing	Invert	Outlet Devices
	Primary	1.20'	<b>42.0" Round Culvert</b> L= 18.1' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 1.20' / 1.00' S= 0.0110 '/' Cc= 0.900 n= 0.012 Concrete pipe, finished, Flow Area= 9.62 sf

**Primary OutFlow** Max=14.17 cfs @ 12.13 hrs HW=2.80' TW=0.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 14.17 cfs @ 4.87 fps)

**Pond E4604:**

Hydrograph

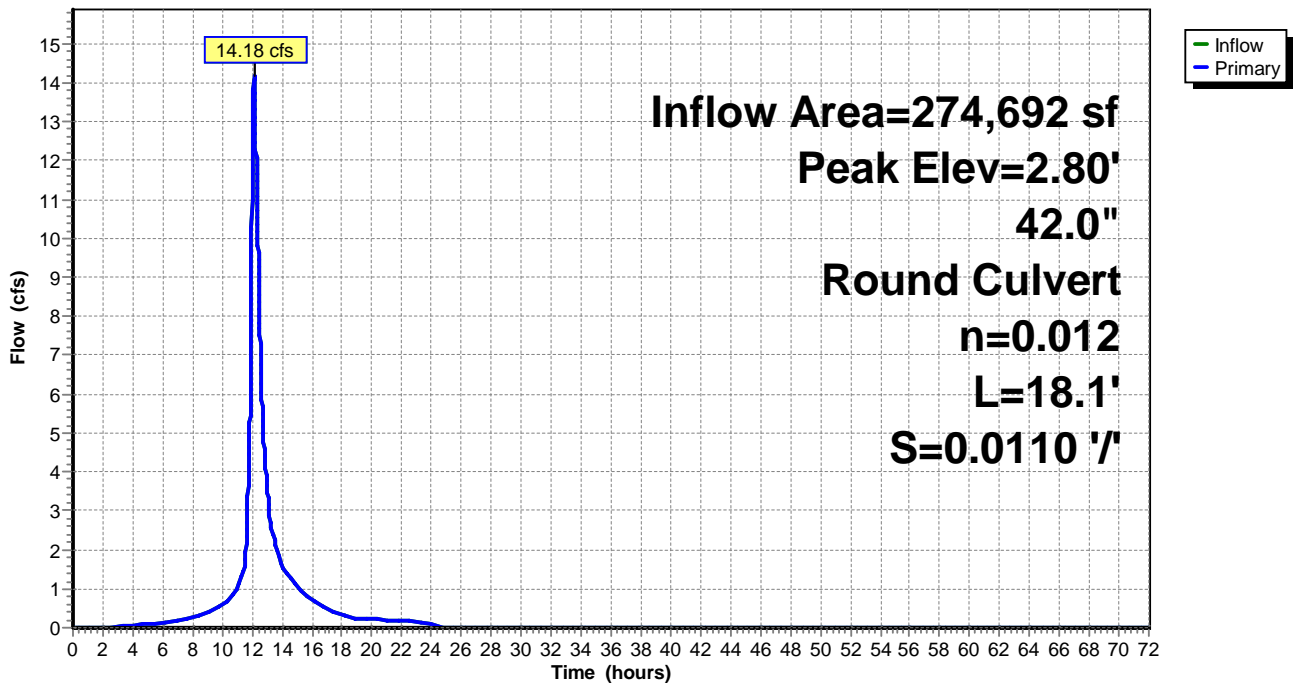

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 143

**Summary for Pond HW5A: HEADWALL INLET**

Inflow Area = 6,762 sf, 0.00% Impervious, Inflow Depth = 2.85" for 10 yr event  
 Inflow = 0.52 cfs @ 12.09 hrs, Volume= 1,607 cf  
 Outflow = 0.52 cfs @ 12.09 hrs, Volume= 1,607 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.52 cfs @ 12.09 hrs, Volume= 1,607 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.47' @ 12.10 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	19.00'	<b>12.0" Round Culvert</b> L= 39.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.00' / 17.70' S= 0.0333 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.49 cfs @ 12.09 hrs HW=19.47' TW=19.26' (Dynamic Tailwater)  
 ↳ **1=Culvert** (Outlet Controls 0.49 cfs @ 2.02 fps)

**Pond HW5A: HEADWALL INLET**

Hydrograph

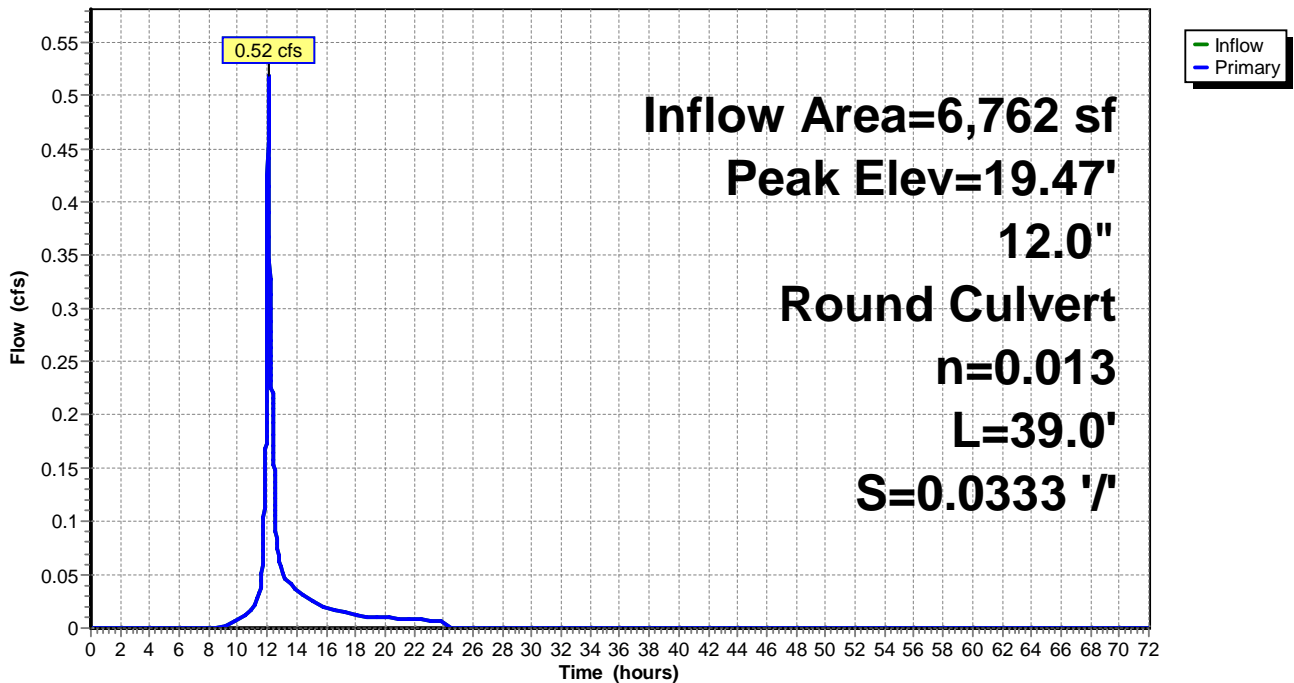

**Proposed**

Prepared by Fuss &amp; O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 144

**Summary for Pond IB1:**

Inflow Area = 37,137 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 4.68 cfs @ 12.08 hrs, Volume= 16,595 cf  
 Outflow = 2.52 cfs @ 12.40 hrs, Volume= 16,596 cf, Atten= 46%, Lag= 19.0 min  
 Discarded = 0.13 cfs @ 12.23 hrs, Volume= 7,576 cf  
 Primary = 2.39 cfs @ 12.40 hrs, Volume= 9,020 cf

Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 22.20' @ 12.23 hrs Surf.Area= 3,889 sf Storage= 4,500 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)  
 Center-of-Mass det. time= 74.3 min ( 820.5 - 746.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	20.50'	3,515 cf	<b>72.75'W x 53.46'L x 3.50'H Field A</b> 13,611 cf Overall - 4,824 cf Embedded = 8,788 cf x 40.0% Voids
#2A	21.00'	4,824 cf	<b>ADS_StormTech SC-740 +Cap</b> x 105 Inside #1 Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap 15 Rows of 7 Chambers
		8,339 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	21.10'	<b>12.0" Round Overflow</b> L= 6.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 21.10' / 21.00' S= 0.0167 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Discarded	20.50'	<b>0.970 in/hr Exfiltration over Surface area</b> Conductivity to Groundwater Elevation = 17.00'

**Discarded OutFlow** Max=0.13 cfs @ 12.23 hrs HW=22.20' (Free Discharge)↑**2=Exfiltration** ( Controls 0.13 cfs)**Primary OutFlow** Max=1.51 cfs @ 12.40 hrs HW=22.12' TW=21.96' (Dynamic Tailwater)↑**1=Overflow** (Inlet Controls 1.51 cfs @ 1.92 fps)

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 145

**Pond IB1: - Chamber Wizard Field A**

**Chamber Model = ADS\_StormTech SC-740 +Cap (ADS StormTech® SC-740 with cap length)**

Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf

Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

7 Chambers/Row x 7.12' Long +0.81' Cap Length x 2 = 51.46' Row Length +12.0" End Stone x 2 = 53.46' Base Length

15 Rows x 51.0" Wide + 6.0" Spacing x 14 + 12.0" Side Stone x 2 = 72.75' Base Width

6.0" Base + 30.0" Chamber Height + 6.0" Cover = 3.50' Field Height

105 Chambers x 45.9 cf = 4,823.7 cf Chamber Storage

13,611.4 cf Field - 4,823.7 cf Chambers = 8,787.7 cf Stone x 40.0% Voids = 3,515.1 cf Stone Storage

Chamber Storage + Stone Storage = 8,338.8 cf = 0.191 af


Overall Storage Efficiency = 61.3%

Overall System Size = 53.46' x 72.75' x 3.50'

105 Chambers

504.1 cy Field

325.5 cy Stone

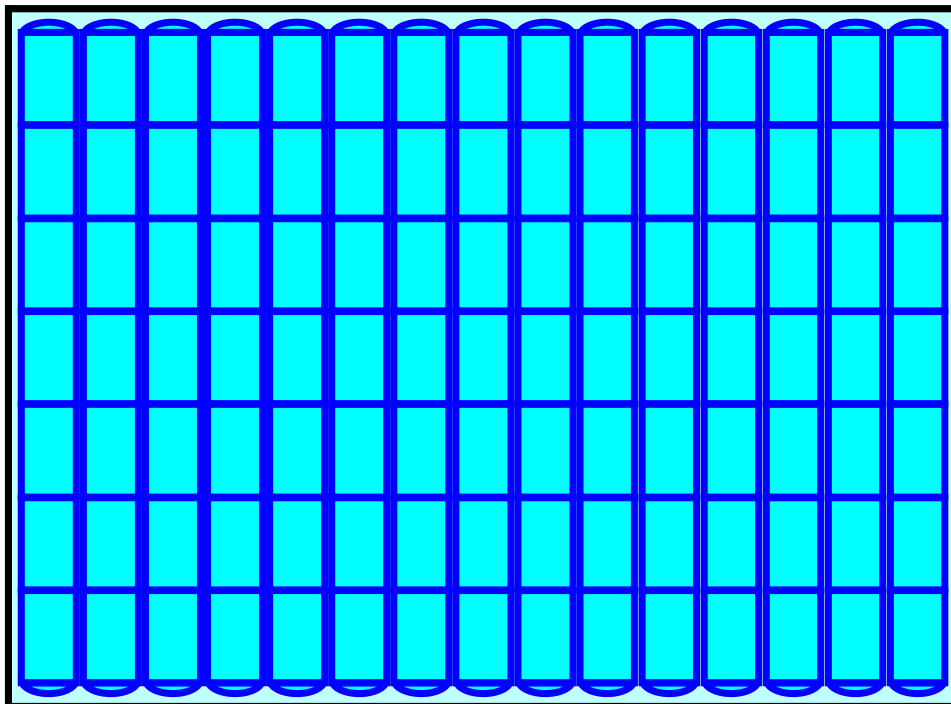

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC


Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 146

**Pond IB1:**

**Hydrograph**

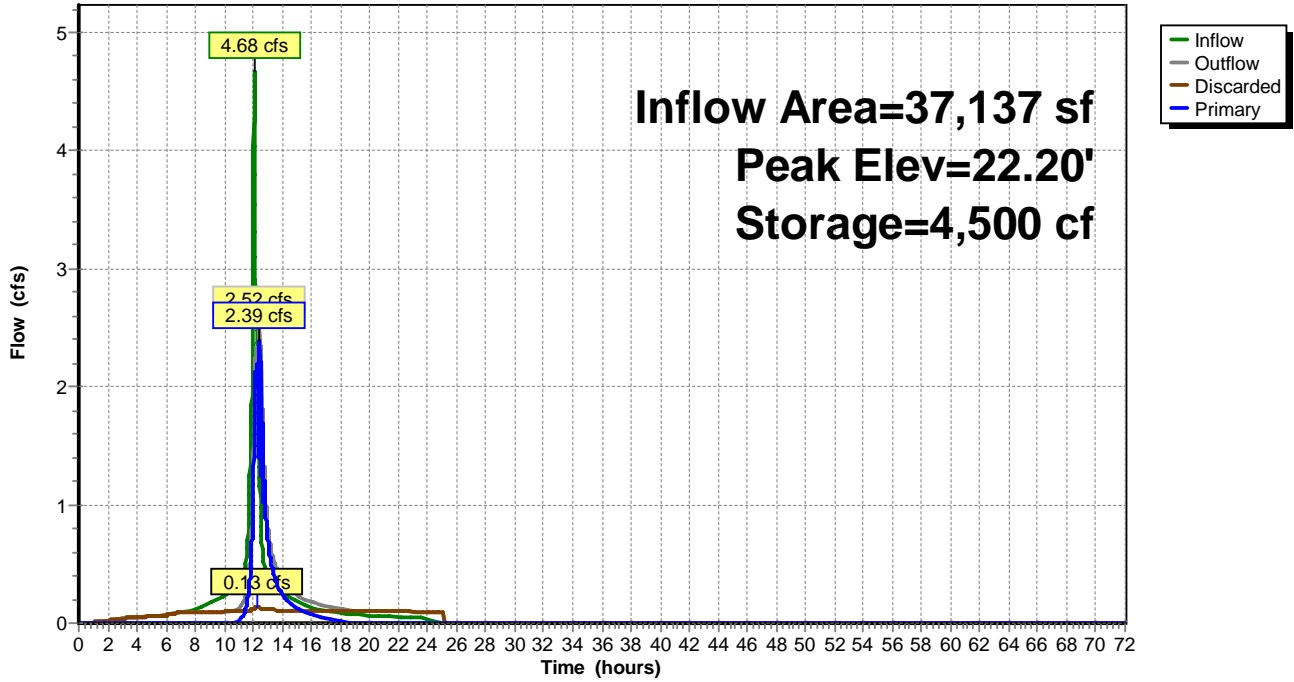

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 147

**Summary for Pond M11:**

Inflow Area = 80,250 sf, 66.19% Impervious, Inflow Depth = 3.34" for 10 yr event  
 Inflow = 5.52 cfs @ 12.09 hrs, Volume= 22,307 cf  
 Outflow = 5.52 cfs @ 12.09 hrs, Volume= 22,307 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 5.52 cfs @ 12.09 hrs, Volume= 22,307 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 20.32' @ 12.11 hrs  
 Flood Elev= 24.29'

Device #1	Routing	Invert	Outlet Devices
	Primary	18.37'	<b>18.0" Round Culvert</b> L= 101.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.37' / 17.87' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=5.21 cfs @ 12.09 hrs HW=20.26' TW=19.84' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 5.21 cfs @ 3.01 fps)

**Pond M11:**

Hydrograph

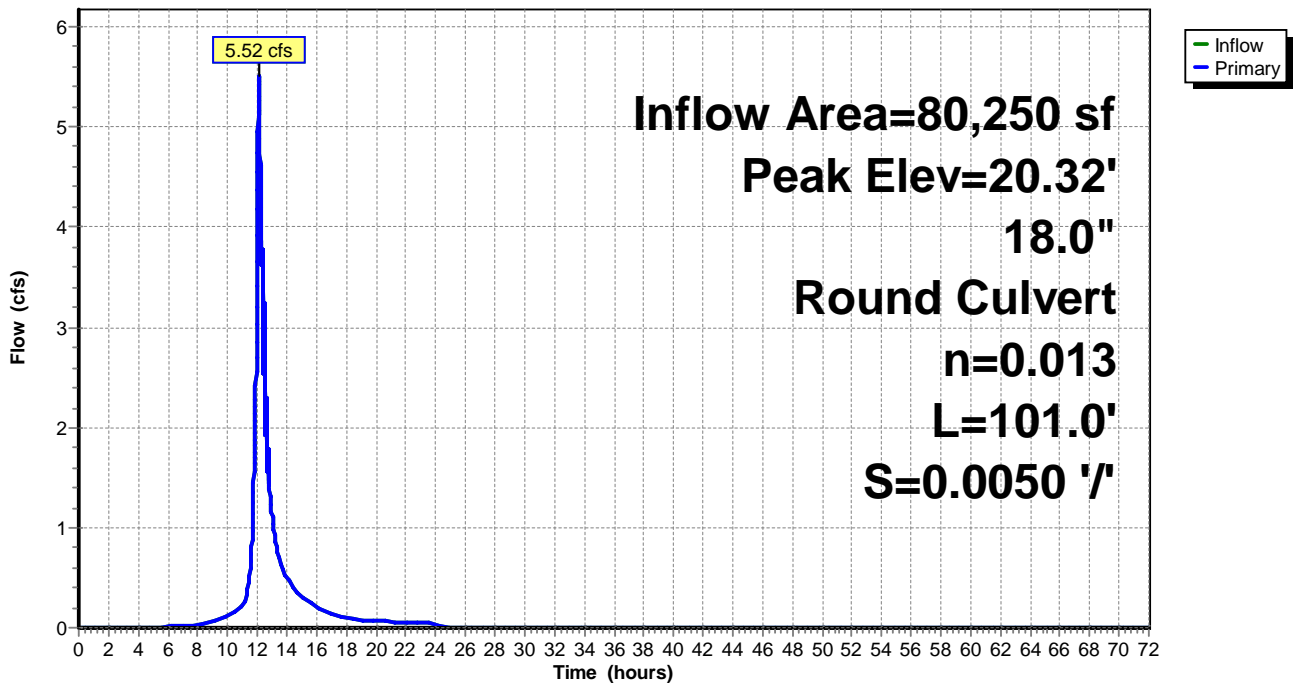

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 148

**Summary for Pond M14:**

Inflow Area = 52,508 sf, 73.66% Impervious, Inflow Depth = 2.95" for 10 yr event  
 Inflow = 3.16 cfs @ 12.12 hrs, Volume= 12,911 cf  
 Outflow = 3.16 cfs @ 12.12 hrs, Volume= 12,911 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 3.16 cfs @ 12.12 hrs, Volume= 12,911 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 20.66' @ 12.12 hrs  
 Flood Elev= 28.45'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.27'	<b>18.0" Round Culvert</b> L= 160.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.27' / 18.47' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=3.27 cfs @ 12.12 hrs HW=20.66' TW=20.29' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 3.27 cfs @ 2.50 fps)

**Pond M14:**

Hydrograph

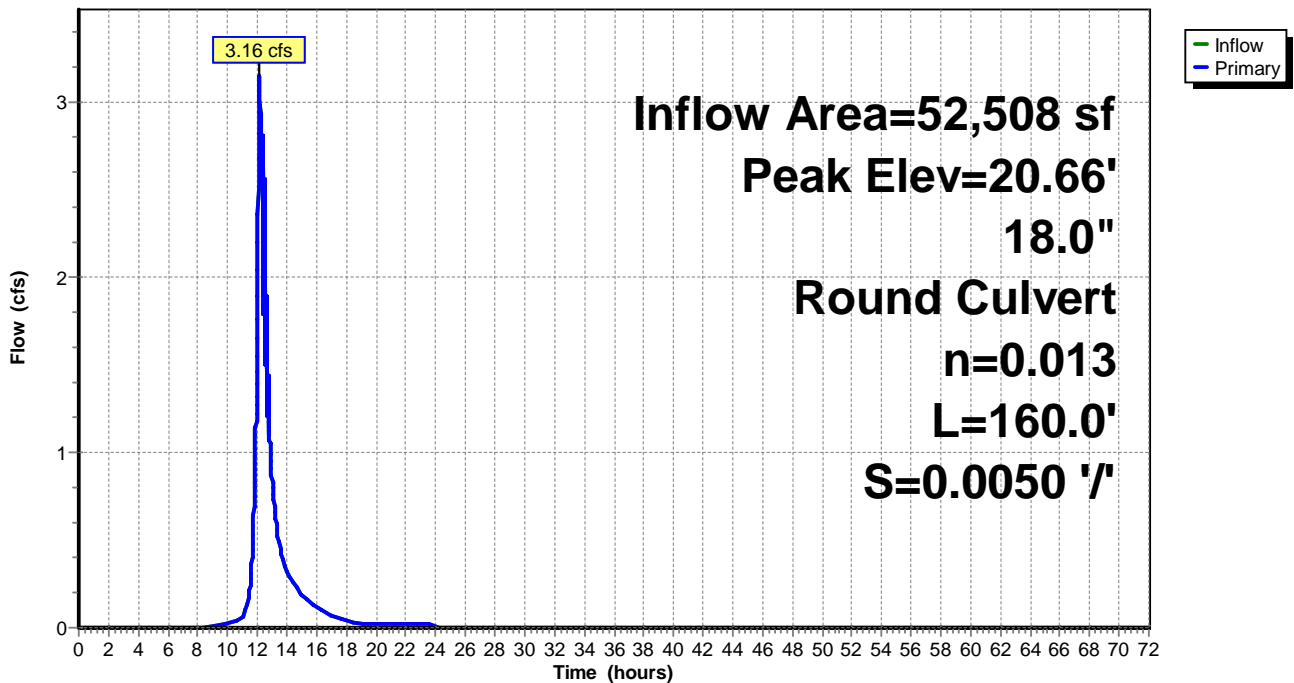

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 149

**Summary for Pond M15:**

Inflow Area = 52,508 sf, 73.66% Impervious, Inflow Depth = 2.95" for 10 yr event  
 Inflow = 3.16 cfs @ 12.12 hrs, Volume= 12,911 cf  
 Outflow = 3.16 cfs @ 12.12 hrs, Volume= 12,911 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 3.16 cfs @ 12.12 hrs, Volume= 12,911 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 21.15' @ 12.12 hrs  
 Flood Elev= 27.37'

Device #1	Routing	Invert	Outlet Devices
	Primary	20.00'	<b>18.0" Round Culvert</b> L= 122.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.00' / 19.37' S= 0.0052 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=3.12 cfs @ 12.12 hrs HW=21.14' TW=20.66' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 3.12 cfs @ 2.99 fps)

**Pond M15:**

Hydrograph

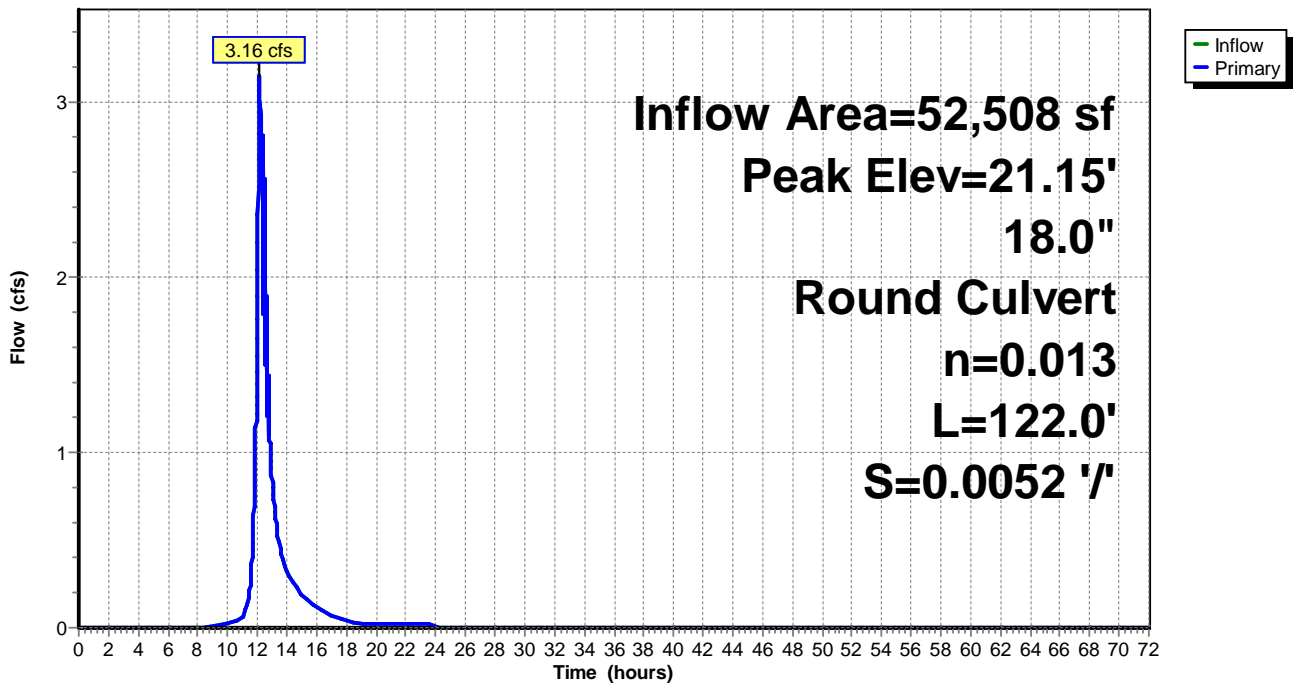



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 150

**Summary for Pond M17:**

Inflow Area = 37,137 sf, 100.00% Impervious, Inflow Depth = 2.91" for 10 yr event  
 Inflow = 2.39 cfs @ 12.40 hrs, Volume= 9,020 cf  
 Outflow = 2.39 cfs @ 12.40 hrs, Volume= 9,020 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.39 cfs @ 12.40 hrs, Volume= 9,020 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 21.97' @ 12.40 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	20.90'	<b>12.0" Round Culvert</b> L= 81.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.90' / 20.50' S= 0.0049 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=2.35 cfs @ 12.40 hrs HW=21.96' TW=20.90' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 2.35 cfs @ 3.52 fps)

**Pond M17:**

Hydrograph

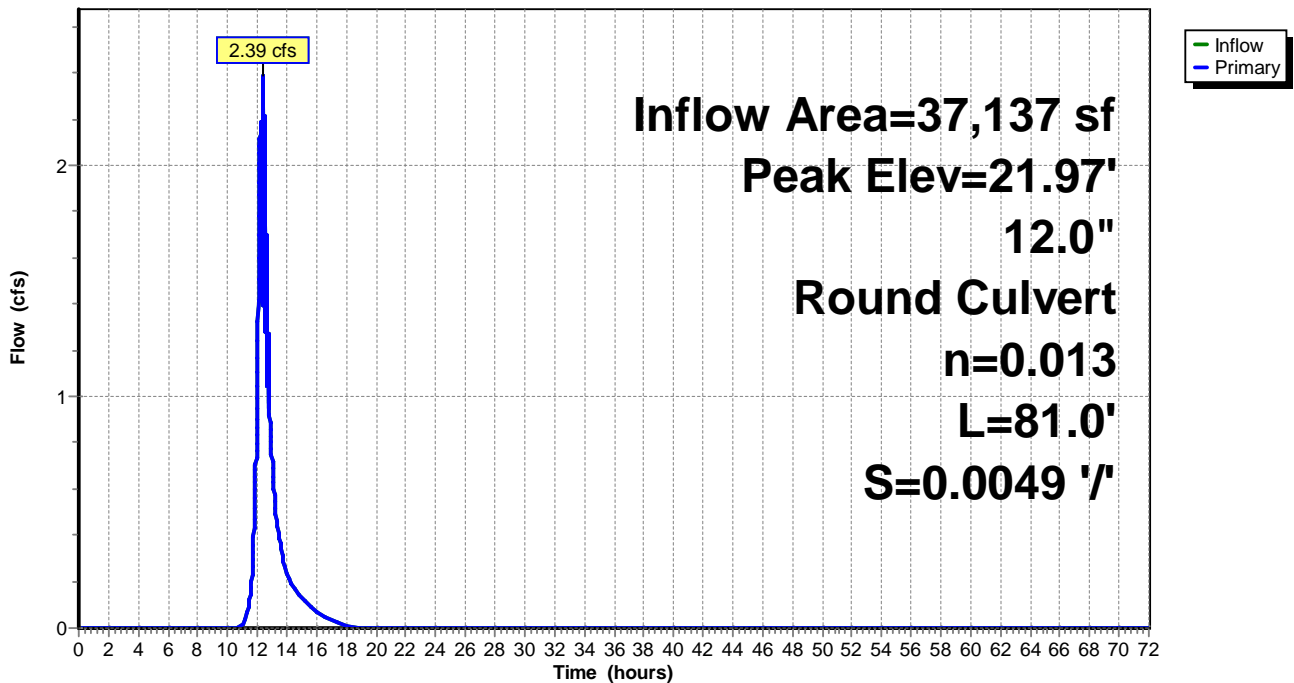

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 151

**Summary for Pond M19:**

Inflow Area = 37,137 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 4.68 cfs @ 12.08 hrs, Volume= 16,595 cf  
 Outflow = 4.68 cfs @ 12.08 hrs, Volume= 16,595 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 4.68 cfs @ 12.08 hrs, Volume= 16,595 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 47.31' @ 12.08 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	22.60'	<b>6.0" Round Roof Drain</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 22.60' / 22.54' S= 0.0300 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.20 sf

**Primary OutFlow** Max=4.67 cfs @ 12.08 hrs HW=47.23' TW=21.97' (Dynamic Tailwater)  
 ↳ **1=Roof Drain** (Inlet Controls 4.67 cfs @ 23.78 fps)

**Pond M19:**

Hydrograph

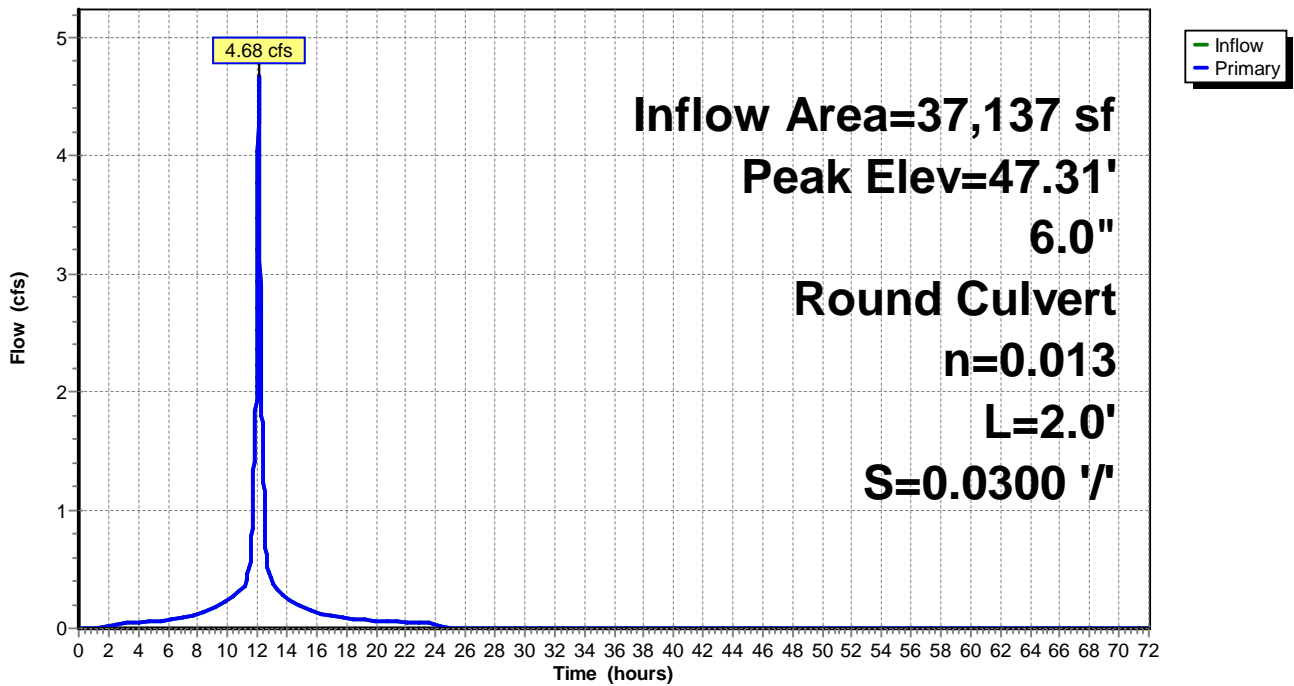

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 152

**Summary for Pond M2:**

Inflow Area = 138,201 sf, 66.19% Impervious, Inflow Depth = 3.82" for 10 yr event  
 Inflow = 11.16 cfs @ 12.07 hrs, Volume= 43,974 cf  
 Outflow = 11.18 cfs @ 12.07 hrs, Volume= 43,974 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 11.18 cfs @ 12.07 hrs, Volume= 43,974 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 18.68' @ 12.08 hrs  
 Flood Elev= 23.00'

Device #1	Routing	Invert	Outlet Devices
	Primary	16.26'	<b>24.0" Round Culvert</b> L= 10.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 16.26' / 16.22' S= 0.0040 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=10.98 cfs @ 12.07 hrs HW=18.67' TW=18.14' (Dynamic Tailwater)  
 ↳ **1=Culvert** (Inlet Controls 10.98 cfs @ 3.50 fps)

**Pond M2:**

Hydrograph

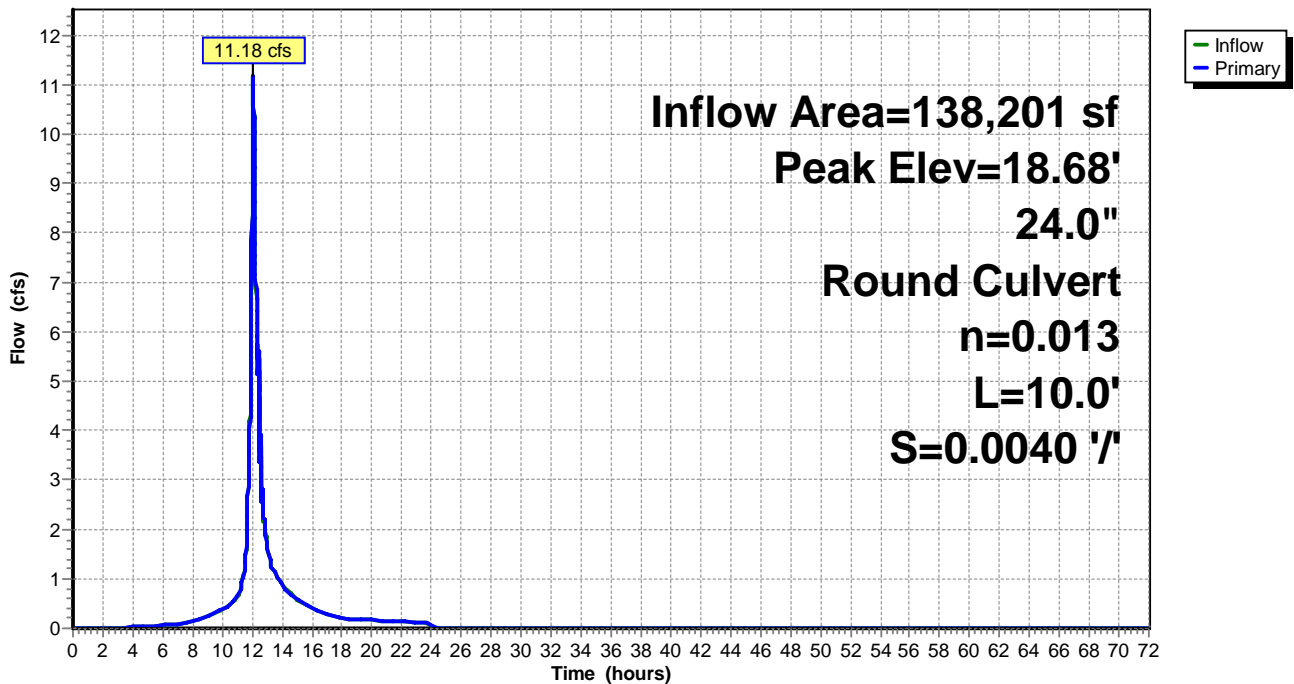

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 153

**Summary for Pond M21:**

Inflow Area = 199,115 sf, 77.58% Impervious, Inflow Depth = 3.26" for 10 yr event  
 Inflow = 11.22 cfs @ 12.15 hrs, Volume= 54,124 cf  
 Outflow = 11.22 cfs @ 12.15 hrs, Volume= 54,124 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 11.22 cfs @ 12.15 hrs, Volume= 54,124 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 11.35' @ 12.15 hrs  
 Flood Elev= 15.22'

Device #1	Routing	Invert	Outlet Devices
	Primary	9.79'	<b>24.0" Round Culvert</b> L= 116.8' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 9.79' / 4.02' S= 0.0494 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=11.22 cfs @ 12.15 hrs HW=11.35' TW=6.07' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 11.22 cfs @ 4.26 fps)

**Pond M21:**

Hydrograph

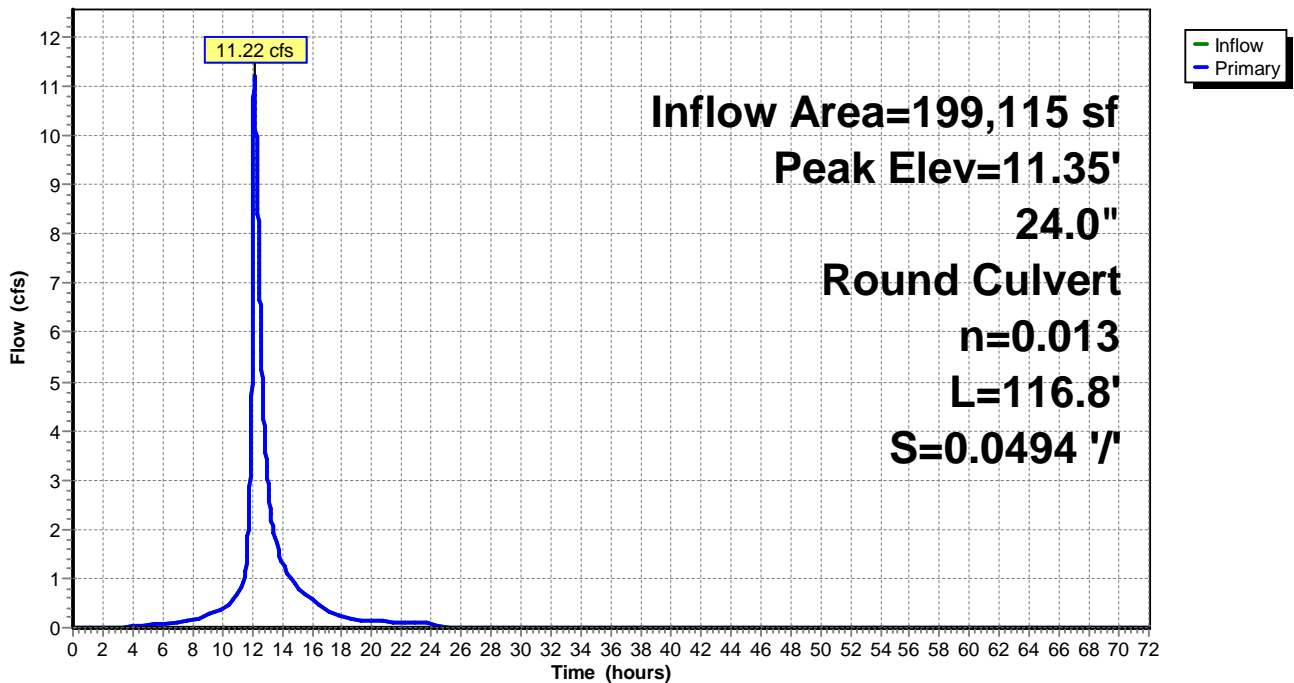

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 154

**Summary for Pond M22:**

Inflow Area = 199,115 sf, 77.58% Impervious, Inflow Depth = 3.26" for 10 yr event  
Inflow = 11.22 cfs @ 12.15 hrs, Volume= 54,124 cf  
Outflow = 11.22 cfs @ 12.15 hrs, Volume= 54,124 cf, Atten= 0%, Lag= 0.0 min  
Primary = 11.22 cfs @ 12.15 hrs, Volume= 54,124 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Peak Elev= 12.38' @ 12.15 hrs  
Flood Elev= 16.85'

Device #1	Routing	Invert	Outlet Devices
	Primary	10.73'	<b>24.0" Round Culvert</b> L= 67.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 10.73' / 9.89' S= 0.0125 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=11.20 cfs @ 12.15 hrs HW=12.38' TW=11.35' (Dynamic Tailwater)  
↑ **1=Culvert** (Outlet Controls 11.20 cfs @ 5.47 fps)

**Pond M22:**

Hydrograph

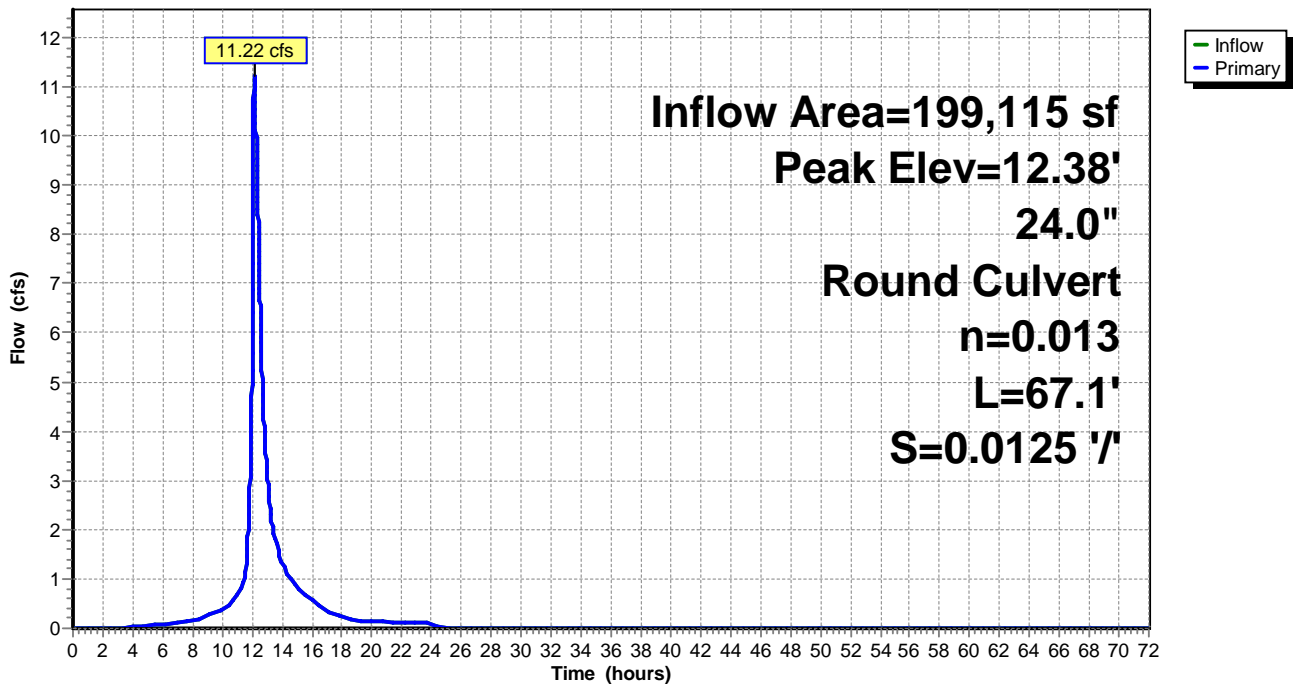

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 155

**Summary for Pond M25:**

Inflow Area = 193,698 sf, 77.24% Impervious, Inflow Depth = 3.21" for 10 yr event  
 Inflow = 10.71 cfs @ 12.15 hrs, Volume= 51,826 cf  
 Outflow = 10.71 cfs @ 12.15 hrs, Volume= 51,826 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 10.71 cfs @ 12.15 hrs, Volume= 51,826 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 13.01' @ 12.16 hrs  
 Flood Elev= 18.56'

Device #1	Routing	Invert	Outlet Devices
	Primary	11.10'	<b>24.0" Round Culvert</b> L= 54.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 11.10' / 10.83' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=10.69 cfs @ 12.15 hrs HW=13.01' TW=12.38' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 10.69 cfs @ 4.45 fps)

**Pond M25:**

Hydrograph

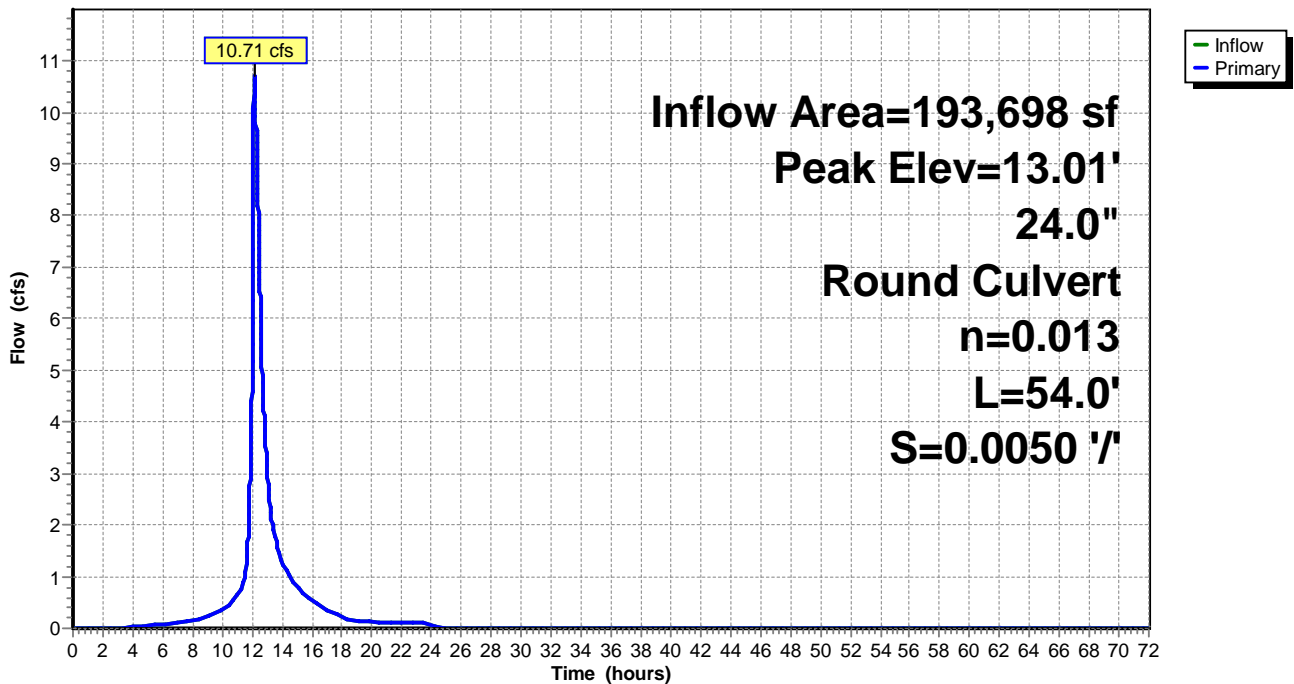

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 156

**Summary for Pond M28:**

Inflow Area = 30,460 sf, 90.87% Impervious, Inflow Depth = 5.10" for 10 yr event  
 Inflow = 2.55 cfs @ 12.16 hrs, Volume= 12,950 cf  
 Outflow = 2.55 cfs @ 12.16 hrs, Volume= 12,950 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.55 cfs @ 12.16 hrs, Volume= 12,950 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 13.46' @ 12.16 hrs  
 Flood Elev= 18.58'

Device	Routing	Invert	Outlet Devices
#1	Primary	12.57'	<b>18.0" Round Culvert</b> L= 51.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 12.57' / 12.31' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=2.54 cfs @ 12.16 hrs HW=13.46' TW=13.01' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 2.54 cfs @ 3.36 fps)

**Pond M28:**

Hydrograph

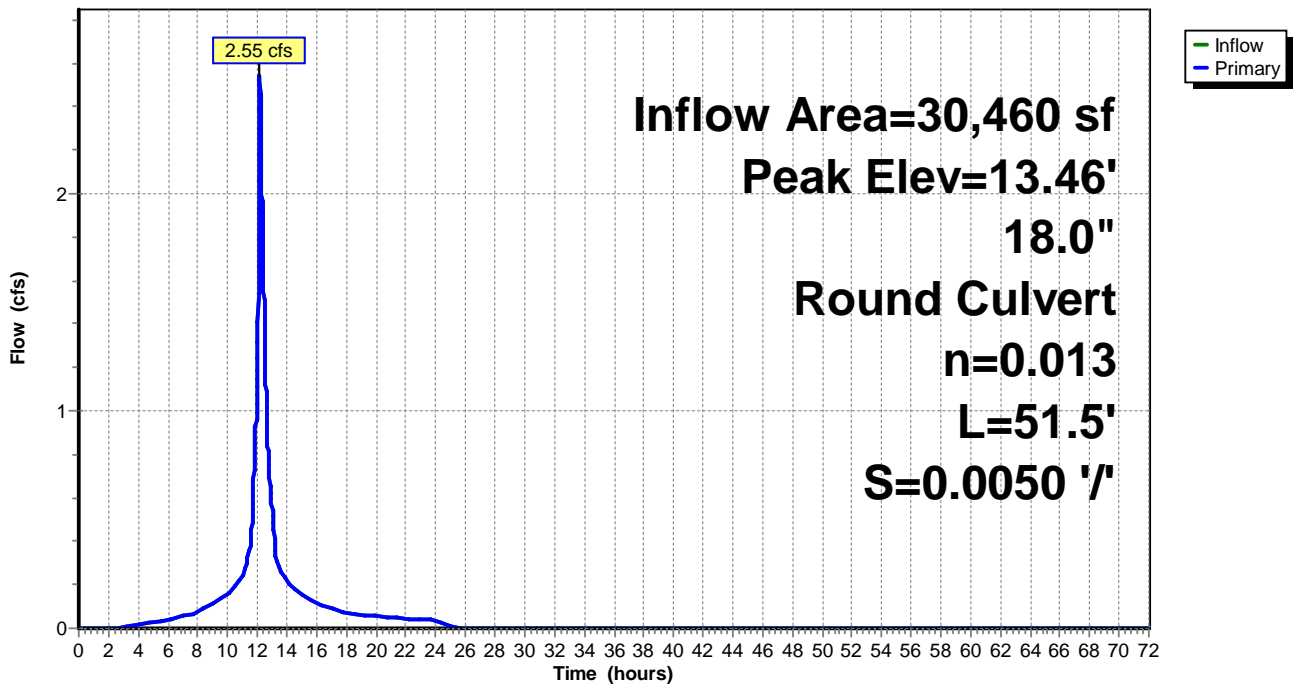

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 157

**Summary for Pond M29:**

Inflow Area = 21,025 sf, 90.30% Impervious, Inflow Depth = 5.09" for 10 yr event  
 Inflow = 1.84 cfs @ 12.16 hrs, Volume= 8,918 cf  
 Outflow = 1.84 cfs @ 12.16 hrs, Volume= 8,918 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.84 cfs @ 12.16 hrs, Volume= 8,918 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 13.69' @ 12.17 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	12.70'	<b>12.0" Round Culvert</b> L= 6.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 12.70' / 12.67' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.81 cfs @ 12.16 hrs HW=13.68' TW=13.45' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 1.81 cfs @ 2.31 fps)

**Pond M29:**

Hydrograph

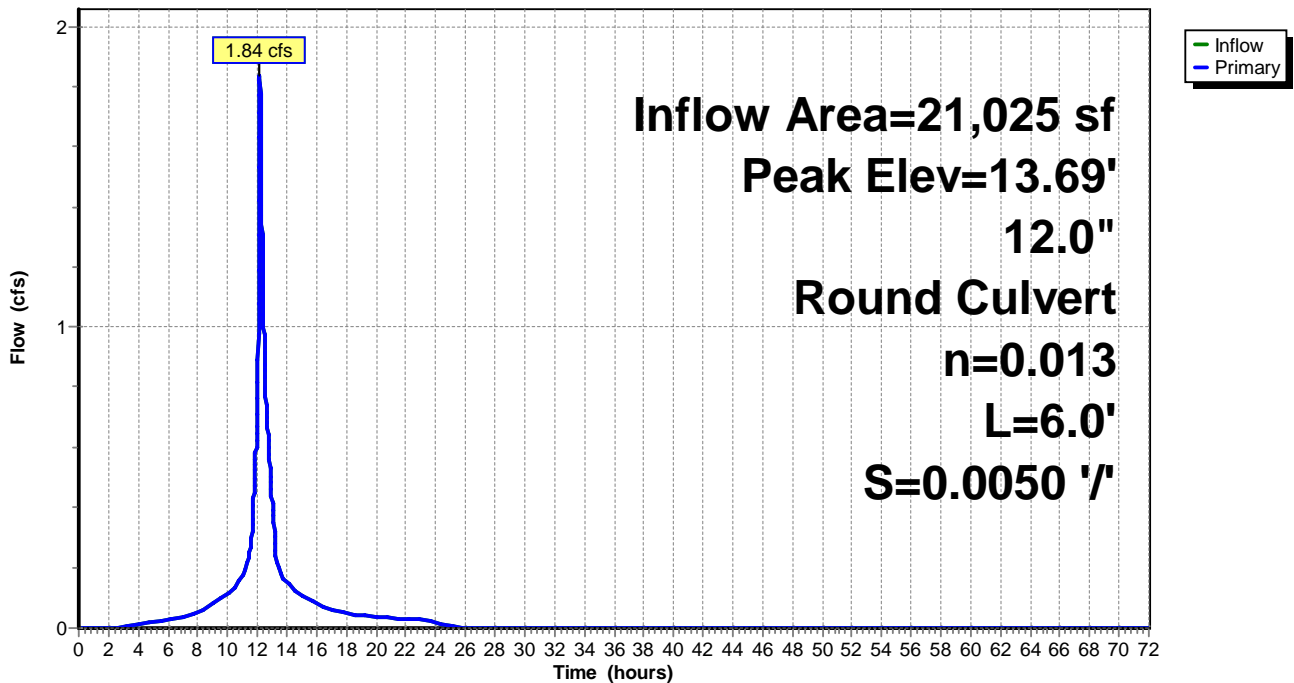



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 158

**Summary for Pond M3:**

Inflow Area = 138,201 sf, 66.19% Impervious, Inflow Depth = 3.82" for 10 yr event  
 Inflow = 11.16 cfs @ 12.07 hrs, Volume= 43,974 cf  
 Outflow = 11.16 cfs @ 12.07 hrs, Volume= 43,974 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 11.16 cfs @ 12.07 hrs, Volume= 43,974 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.21' @ 12.09 hrs  
 Flood Elev= 23.27'

Device #1	Routing	Invert	Outlet Devices
	Primary	16.71'	<b>24.0" Round Culvert</b> L= 70.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 16.71' / 16.36' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=10.88 cfs @ 12.07 hrs HW=19.19' TW=18.67' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 10.88 cfs @ 3.46 fps)

**Pond M3:**

Hydrograph

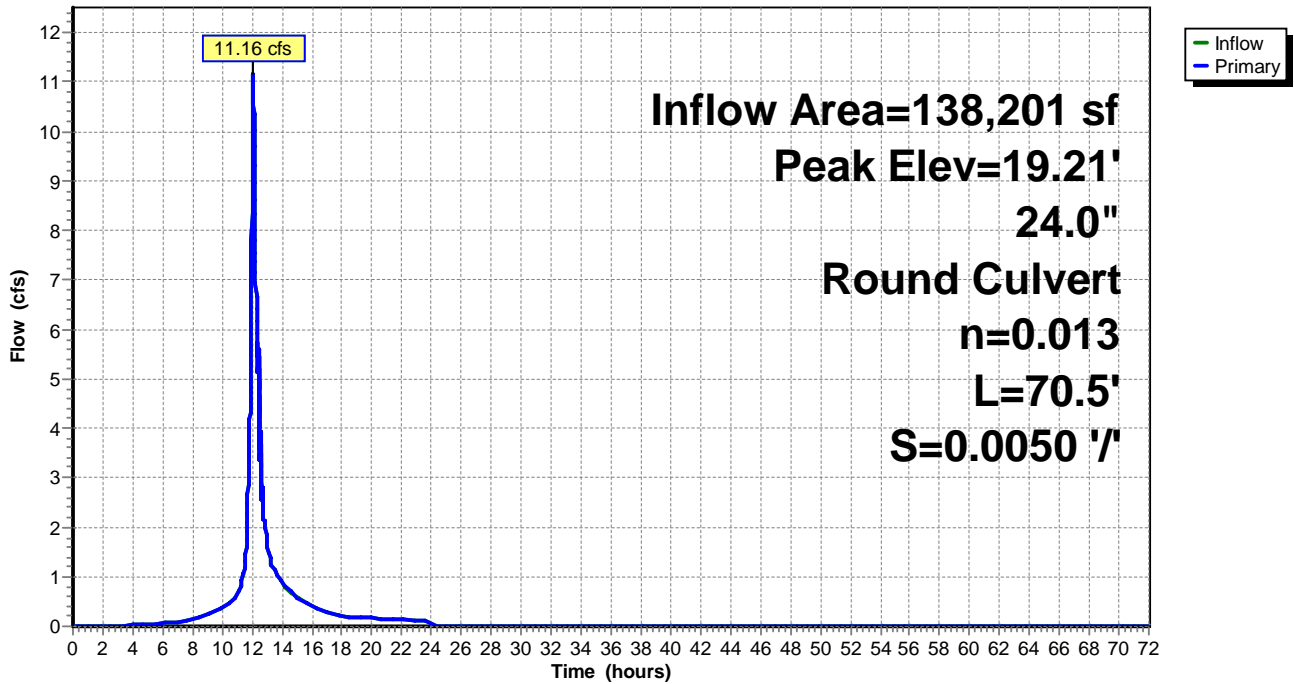

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 159

**Summary for Pond M31:**

Inflow Area = 21,025 sf, 90.30% Impervious, Inflow Depth = 5.09" for 10 yr event  
 Inflow = 2.60 cfs @ 12.08 hrs, Volume= 8,920 cf  
 Outflow = 2.60 cfs @ 12.08 hrs, Volume= 8,920 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.60 cfs @ 12.08 hrs, Volume= 8,920 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 15.50' @ 12.08 hrs  
 Flood Elev= 19.45'

Device #1	Routing	Invert	Outlet Devices
	Primary	14.40'	<b>12.0" Round Culvert</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 14.40' / 14.34' S= 0.0300 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=2.60 cfs @ 12.08 hrs HW=15.50' TW=14.22' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 2.60 cfs @ 3.74 fps)

**Pond M31:**

Hydrograph

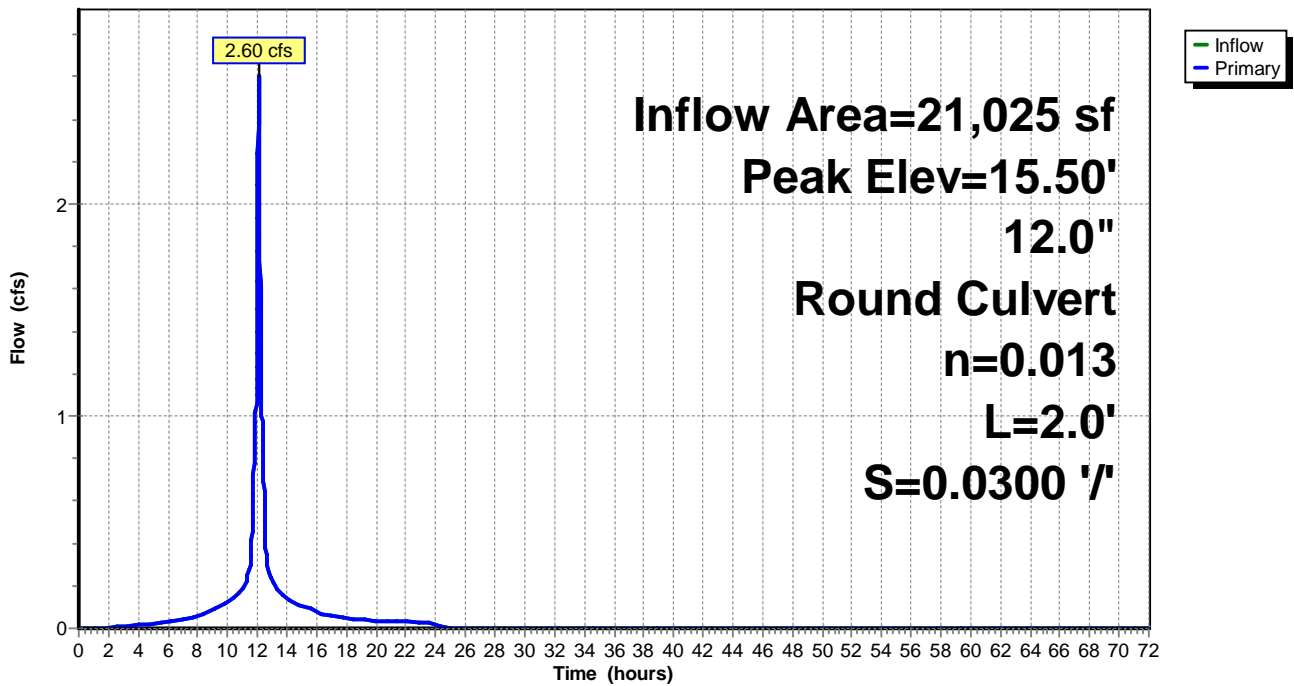

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 160

**Summary for Pond M32:**

Inflow Area = 21,025 sf, 90.30% Impervious, Inflow Depth = 5.09" for 10 yr event  
 Inflow = 2.60 cfs @ 12.08 hrs, Volume= 8,920 cf  
 Outflow = 2.60 cfs @ 12.08 hrs, Volume= 8,920 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.60 cfs @ 12.08 hrs, Volume= 8,920 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 15.98' @ 12.09 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	14.55'	<b>12.0" Round Culvert</b> L= 5.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 14.55' / 14.50' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=2.58 cfs @ 12.08 hrs HW=15.97' TW=15.50' (Dynamic Tailwater)  
 ↳ **1=Culvert** (Inlet Controls 2.58 cfs @ 3.29 fps)

**Pond M32:**

Hydrograph

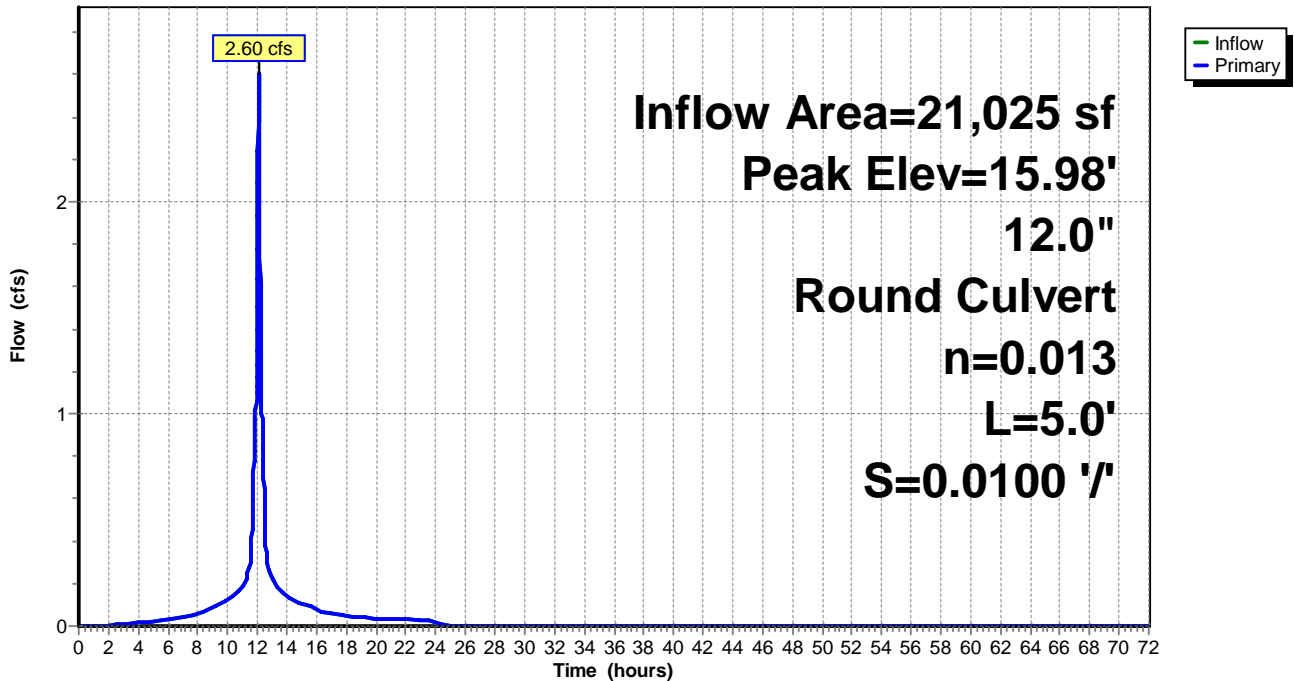

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 161

**Summary for Pond M35:**

Inflow Area = 9,435 sf, 92.15% Impervious, Inflow Depth = 5.13" for 10 yr event  
 Inflow = 0.71 cfs @ 12.18 hrs, Volume= 4,032 cf  
 Outflow = 0.71 cfs @ 12.18 hrs, Volume= 4,032 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 0.71 cfs @ 12.18 hrs, Volume= 4,032 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 16.66' @ 12.18 hrs  
 Flood Elev= 19.93'

Device #1	Routing	Invert	Outlet Devices
	Primary	16.15'	<b>12.0" Round Culvert</b> L= 43.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 16.15' / 15.94' S= 0.0049 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.71 cfs @ 12.18 hrs HW=16.66' TW=13.45' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 0.71 cfs @ 2.59 fps)

**Pond M35:**

Hydrograph

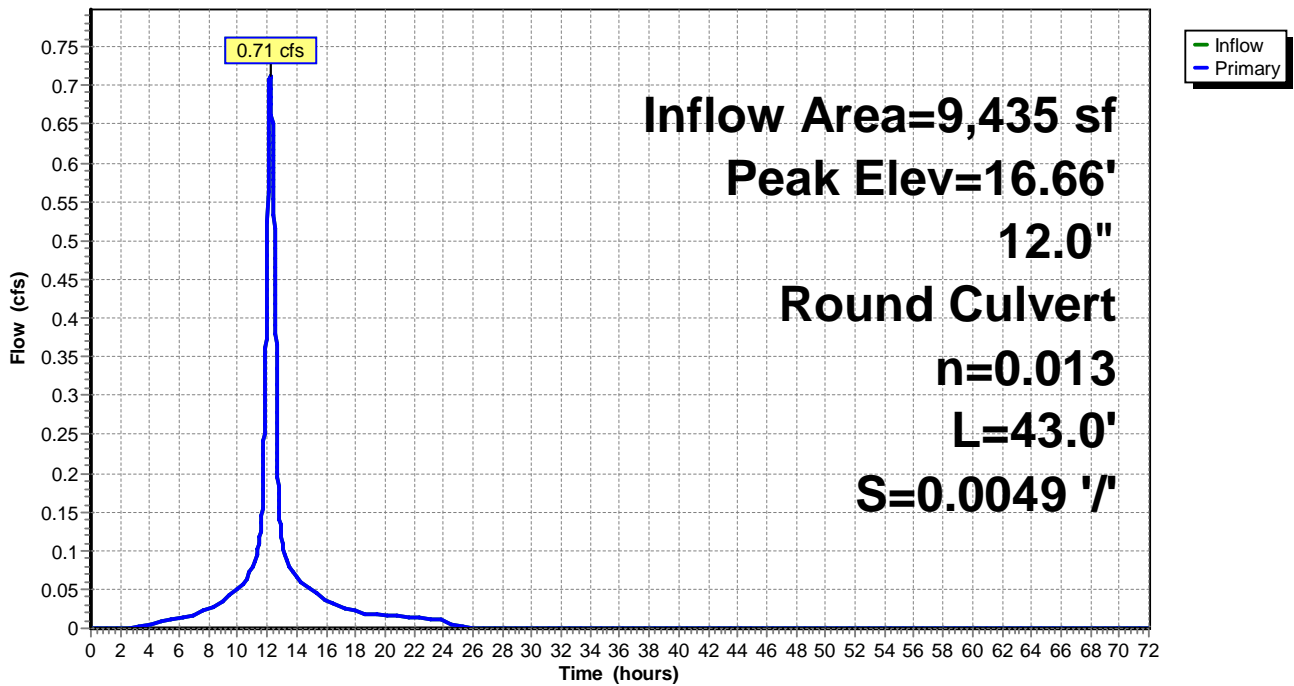

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 162

**Summary for Pond M37:**

Inflow Area = 9,435 sf, 92.15% Impervious, Inflow Depth = 5.13" for 10 yr event  
 Inflow = 1.17 cfs @ 12.08 hrs, Volume= 4,033 cf  
 Outflow = 1.17 cfs @ 12.08 hrs, Volume= 4,033 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 1.17 cfs @ 12.08 hrs, Volume= 4,033 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 18.51' @ 12.08 hrs  
 Flood Elev= 23.36'

Device	Routing	Invert	Outlet Devices
#1	Primary	17.85'	<b>12.0" Round Culvert</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.85' / 17.79' S= 0.0300 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.17 cfs @ 12.08 hrs HW=18.51' TW=17.06' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Barrel Controls 1.17 cfs @ 3.04 fps)

**Pond M37:**

Hydrograph

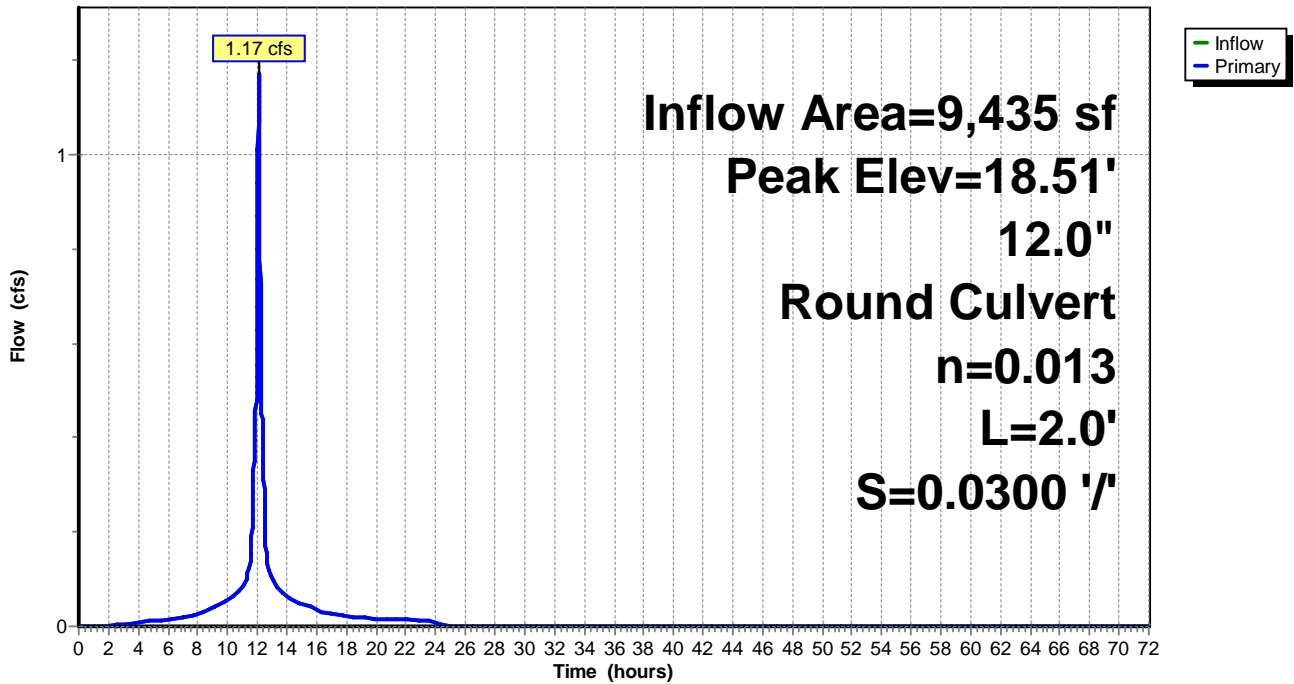

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 163

**Summary for Pond M40:**

Inflow Area = 149,205 sf, 75.19% Impervious, Inflow Depth = 2.70" for 10 yr event  
 Inflow = 7.31 cfs @ 12.16 hrs, Volume= 33,600 cf  
 Outflow = 7.31 cfs @ 12.16 hrs, Volume= 33,600 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 7.31 cfs @ 12.16 hrs, Volume= 33,600 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 13.50' @ 12.16 hrs  
 Flood Elev= 21.69'

Device #1	Routing	Invert	Outlet Devices
	Primary	11.78'	<b>24.0" Round Culvert</b> L= 116.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 11.78' / 11.20' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=7.32 cfs @ 12.16 hrs HW=13.50' TW=13.00' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 7.32 cfs @ 3.42 fps)

**Pond M40:**

Hydrograph

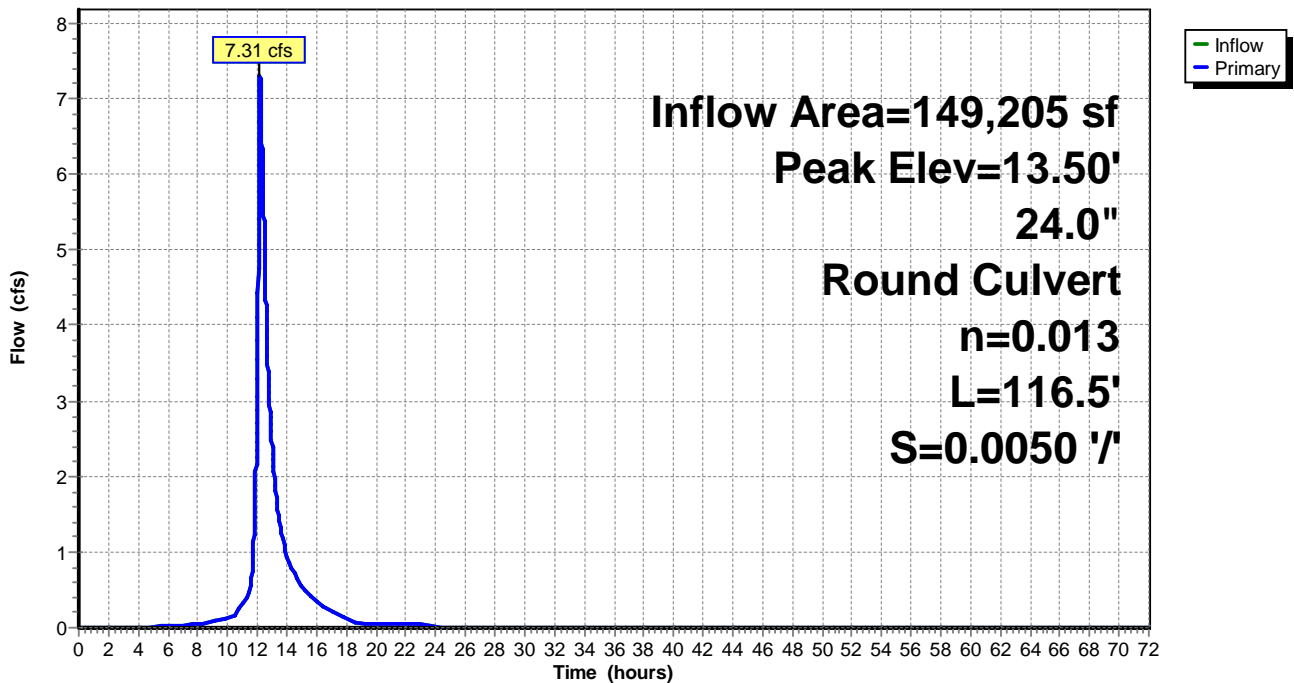

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 164

**Summary for Pond M42:**

Inflow Area = 136,500 sf, 76.11% Impervious, Inflow Depth = 2.54" for 10 yr event  
 Inflow = 6.45 cfs @ 12.15 hrs, Volume= 28,881 cf  
 Outflow = 6.45 cfs @ 12.15 hrs, Volume= 28,881 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 6.45 cfs @ 12.15 hrs, Volume= 28,881 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 14.15' @ 12.17 hrs  
 Flood Elev= 22.86'

Device #1	Routing	Invert	Outlet Devices
	Primary	12.35'	<b>18.0" Round Culvert</b> L= 93.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 12.35' / 11.88' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=6.38 cfs @ 12.15 hrs HW=14.14' TW=13.49' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 6.38 cfs @ 3.82 fps)

**Pond M42:**

Hydrograph

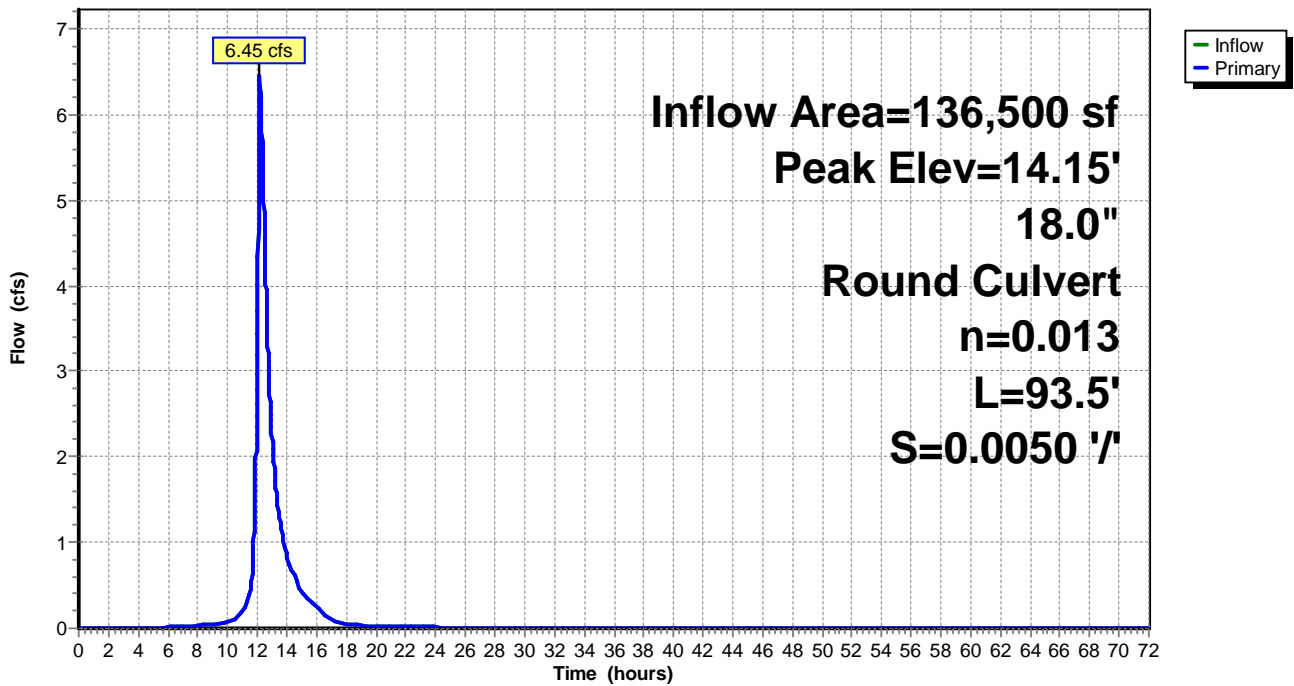

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 165

**Summary for Pond M44:**

Inflow Area = 128,123 sf, 75.92% Impervious, Inflow Depth = 2.39" for 10 yr event  
 Inflow = 5.75 cfs @ 12.18 hrs, Volume= 25,539 cf  
 Outflow = 5.75 cfs @ 12.18 hrs, Volume= 25,539 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 5.75 cfs @ 12.18 hrs, Volume= 25,539 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 14.82' @ 12.18 hrs  
 Flood Elev= 24.89'

Device #1	Routing	Invert	Outlet Devices
	Primary	13.11'	<b>18.0" Round Culvert</b> L= 133.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 13.11' / 12.45' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=5.77 cfs @ 12.18 hrs HW=14.82' TW=14.14' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 5.77 cfs @ 3.59 fps)

**Pond M44:**

Hydrograph

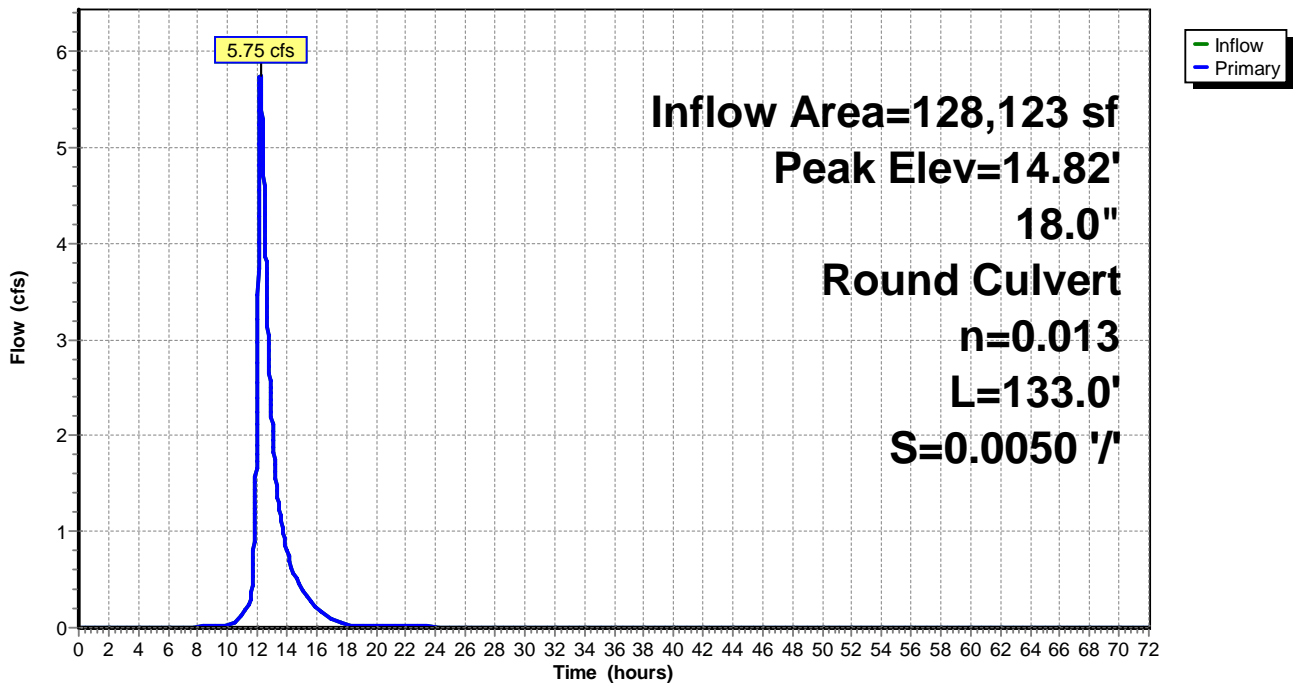



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 166

**Summary for Pond M47:**

Inflow Area = 119,895 sf, 77.56% Impervious, Inflow Depth = 2.27" for 10 yr event  
 Inflow = 5.22 cfs @ 12.21 hrs, Volume= 22,717 cf  
 Outflow = 5.22 cfs @ 12.21 hrs, Volume= 22,717 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 5.22 cfs @ 12.21 hrs, Volume= 22,717 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 15.61' @ 12.19 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	14.21'	<b>18.0" Round Culvert</b> L= 119.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 14.21' / 13.61' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=5.26 cfs @ 12.21 hrs HW=15.60' TW=14.80' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 5.26 cfs @ 3.99 fps)

**Pond M47:**

Hydrograph

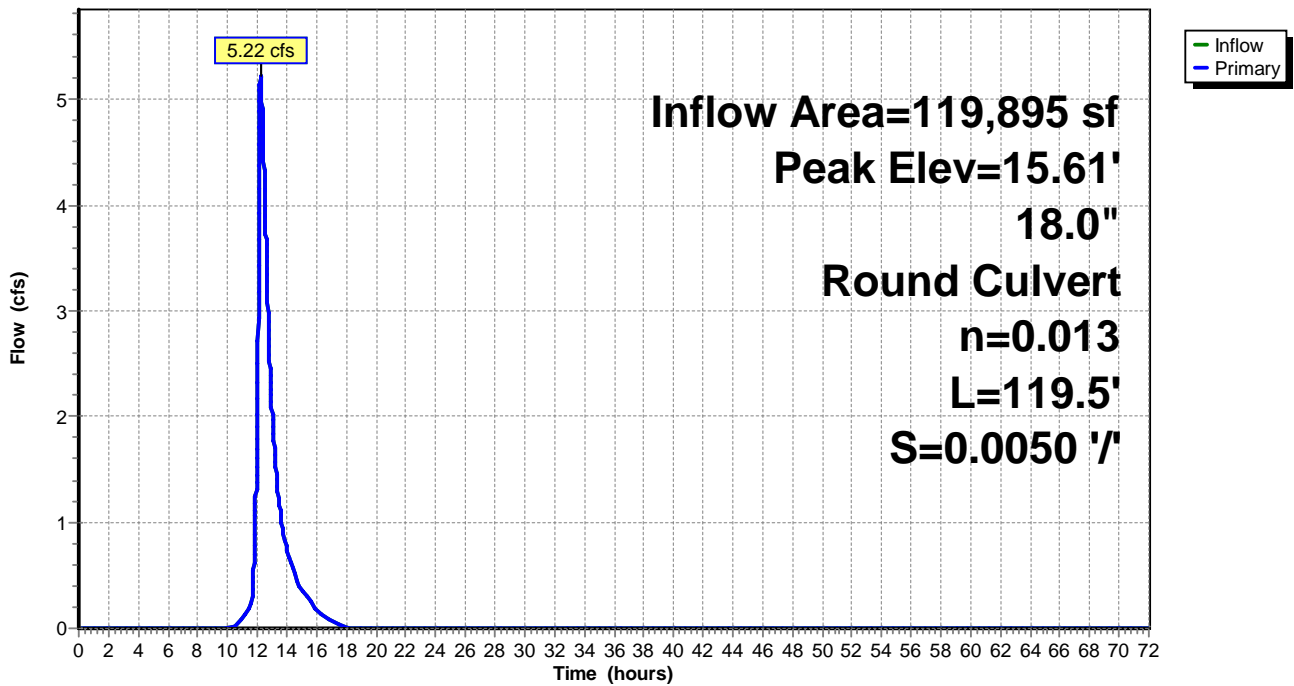

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 167

**Summary for Pond M48:**

Inflow Area = 119,895 sf, 77.56% Impervious, Inflow Depth = 2.27" for 10 yr event  
 Inflow = 5.22 cfs @ 12.21 hrs, Volume= 22,717 cf  
 Outflow = 5.22 cfs @ 12.21 hrs, Volume= 22,717 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 5.22 cfs @ 12.21 hrs, Volume= 22,717 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 16.01' @ 12.20 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	14.48'	<b>18.0" Round Culvert</b> L= 34.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 14.48' / 14.31' S= 0.0049 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=5.24 cfs @ 12.21 hrs HW=16.01' TW=15.60' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 5.24 cfs @ 3.61 fps)

**Pond M48:**

Hydrograph

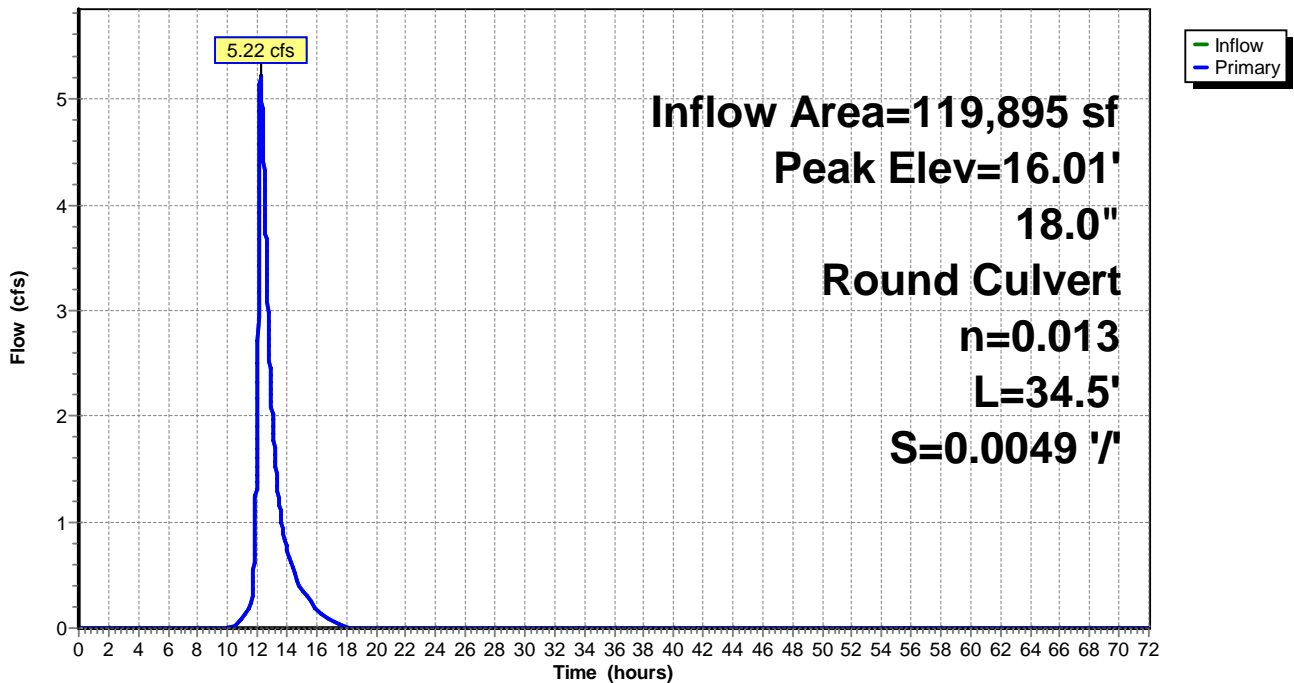

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 168

**Summary for Pond M49:**

Inflow Area = 91,377 sf, 70.56% Impervious, Inflow Depth = 2.06" for 10 yr event  
 Inflow = 3.11 cfs @ 12.35 hrs, Volume= 15,665 cf  
 Outflow = 3.11 cfs @ 12.35 hrs, Volume= 15,665 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 3.11 cfs @ 12.35 hrs, Volume= 15,665 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 16.64' @ 12.25 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	15.10'	<b>12.0" Round Culvert</b> L= 6.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 15.10' / 15.00' S= 0.0154 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=3.13 cfs @ 12.35 hrs HW=16.57' TW=15.88' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 3.13 cfs @ 3.99 fps)

**Pond M49:**

Hydrograph

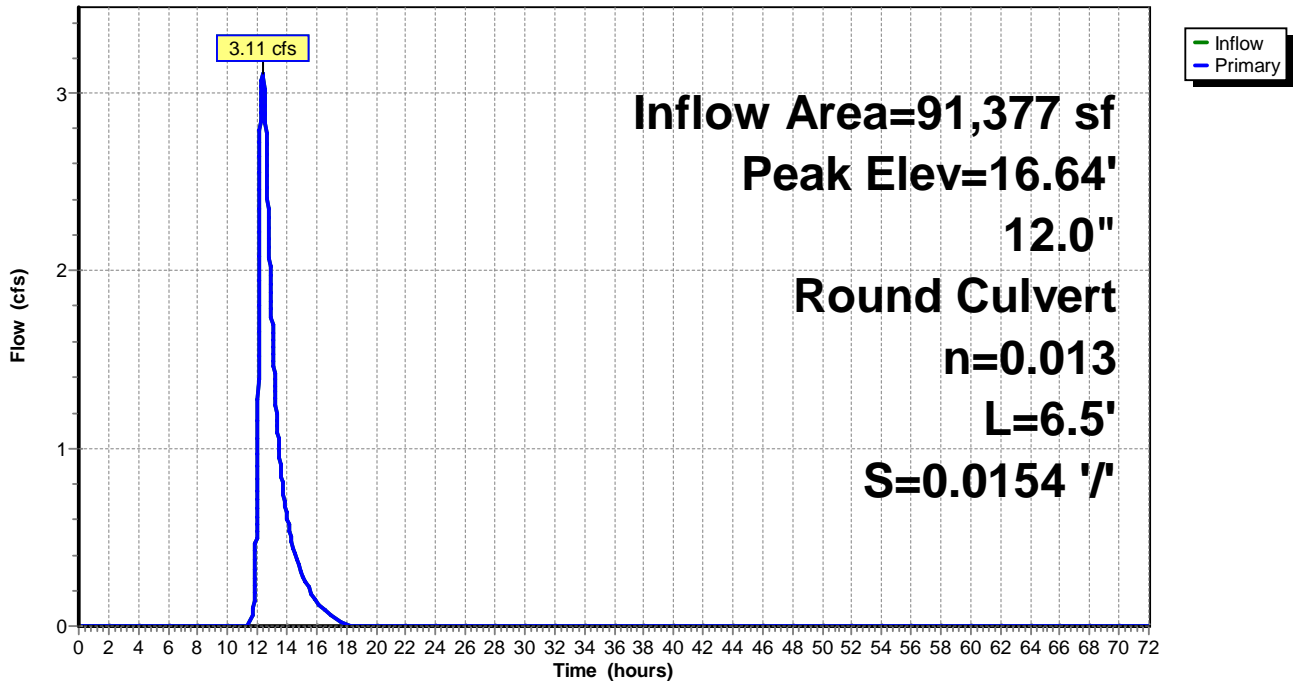

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 169

**Summary for Pond M51:**

Inflow Area = 91,377 sf, 70.56% Impervious, Inflow Depth = 4.58" for 10 yr event  
Inflow = 10.66 cfs @ 12.08 hrs, Volume= 34,882 cf  
Outflow = 10.66 cfs @ 12.08 hrs, Volume= 34,882 cf, Atten= 0%, Lag= 0.0 min  
Primary = 10.66 cfs @ 12.08 hrs, Volume= 34,882 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
Peak Elev= 21.29' @ 12.08 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	18.92'	<b>18.0" Round Culvert</b> L= 2.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.92' / 18.92' S= 0.0000 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=10.64 cfs @ 12.08 hrs HW=21.28' TW=19.49' (Dynamic Tailwater)  
↑ **1=Culvert** (Barrel Controls 10.64 cfs @ 6.02 fps)

**Pond M51:**

Hydrograph

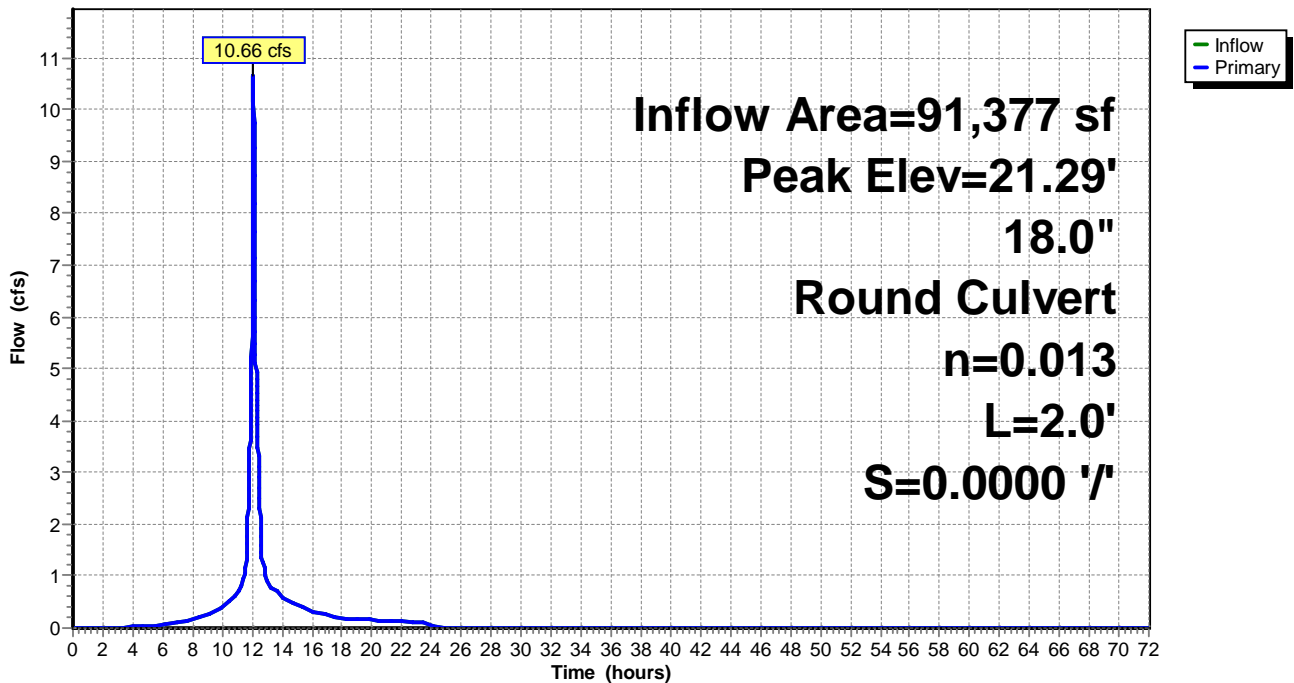

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 170

**Summary for Pond M52:**

Inflow Area = 91,377 sf, 70.56% Impervious, Inflow Depth = 4.58" for 10 yr event  
 Inflow = 10.66 cfs @ 12.08 hrs, Volume= 34,882 cf  
 Outflow = 10.66 cfs @ 12.08 hrs, Volume= 34,882 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 10.66 cfs @ 12.08 hrs, Volume= 34,882 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 22.85' @ 12.09 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	18.97'	<b>18.0" Round Culvert</b> L= 5.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.97' / 18.92' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=10.59 cfs @ 12.08 hrs HW=22.83' TW=21.28' (Dynamic Tailwater)  
 ← **1=Culvert** (Inlet Controls 10.59 cfs @ 5.99 fps)

**Pond M52:**

Hydrograph

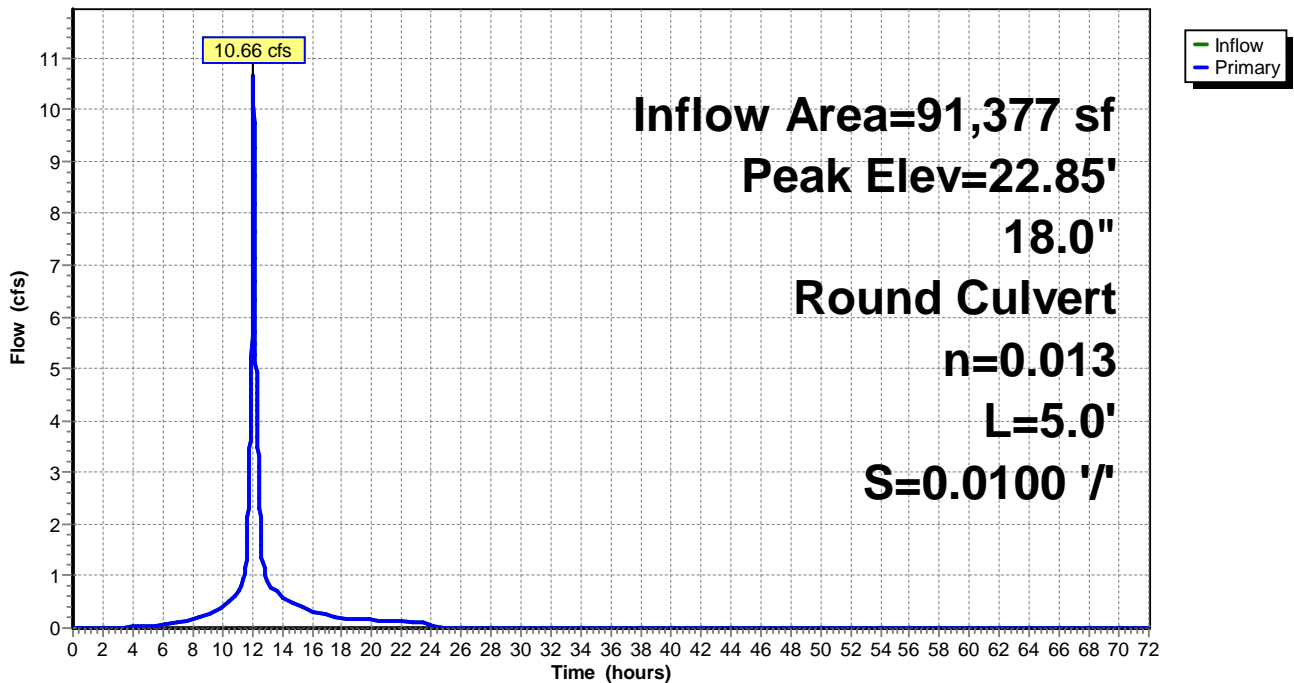

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 171

**Summary for Pond M54:**

Inflow Area = 63,380 sf, 65.40% Impervious, Inflow Depth = 4.44" for 10 yr event  
 Inflow = 7.25 cfs @ 12.08 hrs, Volume= 23,449 cf  
 Outflow = 7.25 cfs @ 12.08 hrs, Volume= 23,449 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 7.25 cfs @ 12.08 hrs, Volume= 23,449 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 23.66' @ 12.09 hrs  
 Flood Elev= 24.99'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.52'	<b>18.0" Round Culvert</b> L= 91.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.52' / 19.07' S= 0.0049 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=6.97 cfs @ 12.08 hrs HW=23.60' TW=22.83' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 6.97 cfs @ 3.94 fps)

**Pond M54:**

Hydrograph

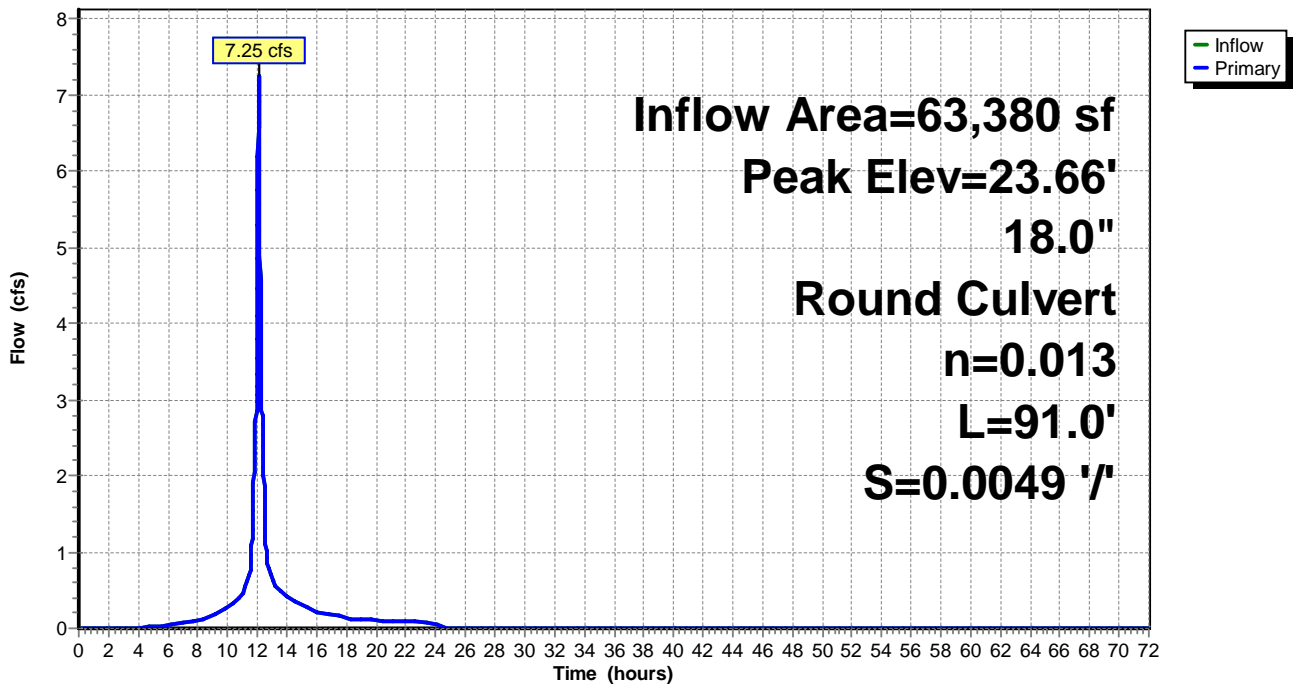

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 172

**Summary for Pond M57:**

Inflow Area = 28,518 sf, 100.00% Impervious, Inflow Depth = 2.97" for 10 yr event  
 Inflow = 2.36 cfs @ 12.16 hrs, Volume= 7,053 cf  
 Outflow = 2.36 cfs @ 12.16 hrs, Volume= 7,053 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.36 cfs @ 12.16 hrs, Volume= 7,053 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 16.92' @ 12.18 hrs

Device #1	Routing	Invert	Outlet Devices
	Primary	15.80'	<b>12.0" Round Culvert</b> L= 160.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 15.80' / 15.00' S= 0.0050 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=2.33 cfs @ 12.16 hrs HW=16.90' TW=15.97' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 2.33 cfs @ 3.35 fps)

**Pond M57:**

Hydrograph

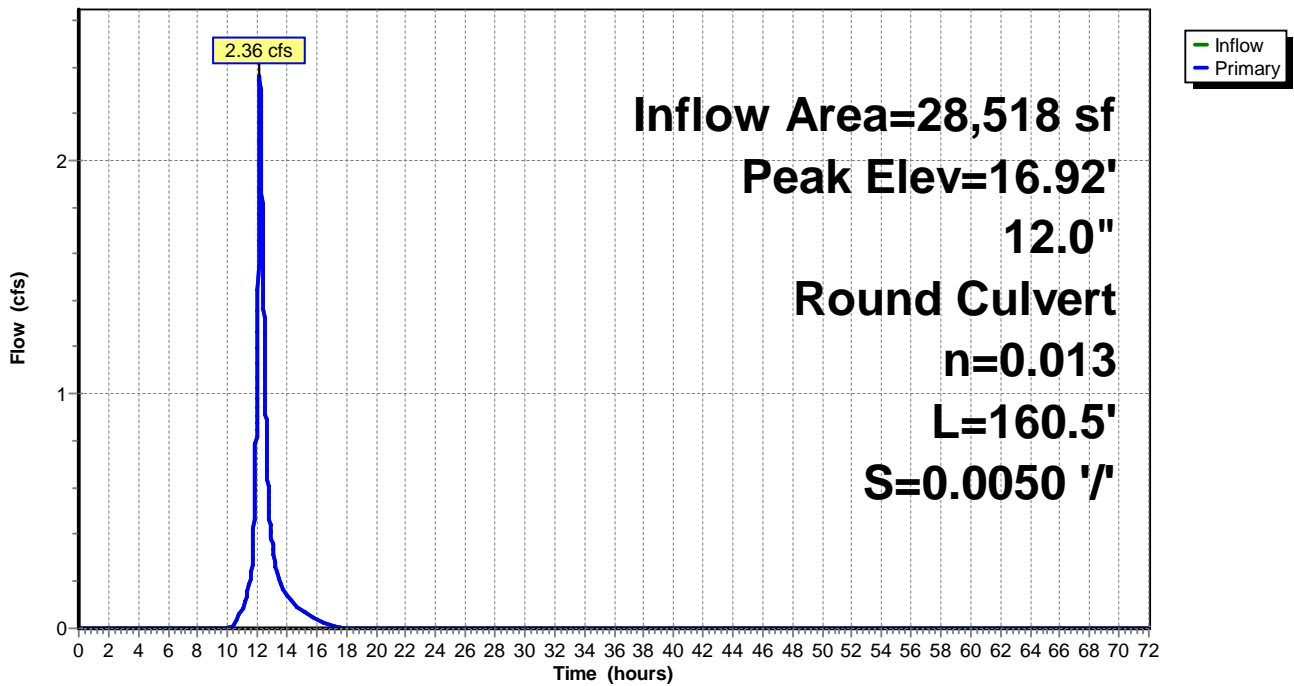

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 173

**Summary for Pond M59:**

Inflow Area = 28,518 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 3.59 cfs @ 12.08 hrs, Volume= 12,744 cf  
 Outflow = 3.59 cfs @ 12.08 hrs, Volume= 12,744 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 3.59 cfs @ 12.08 hrs, Volume= 12,744 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 34.78' @ 12.08 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	20.10'	<b>6.0" Round Culvert</b> L= 3.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.10' / 20.04' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.20 sf

**Primary OutFlow** Max=3.58 cfs @ 12.08 hrs HW=34.73' TW=19.50' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 3.58 cfs @ 18.26 fps)

**Pond M59:**

Hydrograph

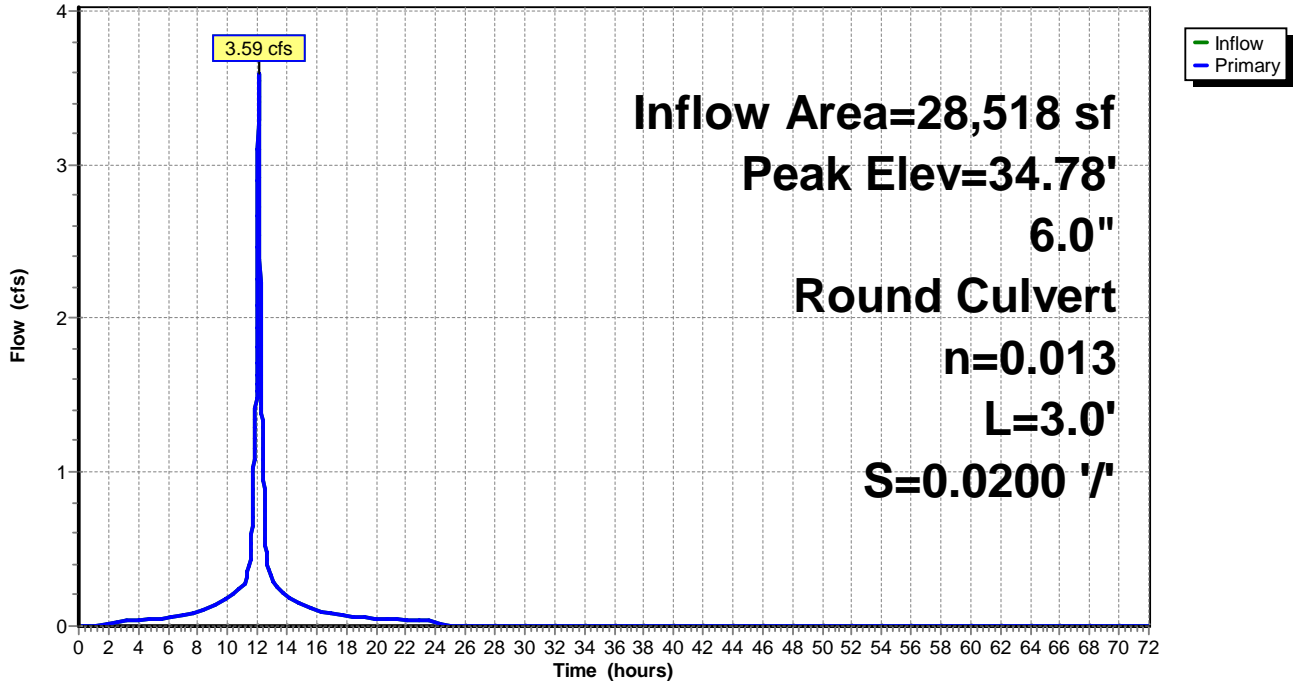



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 174

**Summary for Pond M6:**

Inflow Area = 118,268 sf, 72.28% Impervious, Inflow Depth = 3.86" for 10 yr event  
 Inflow = 9.47 cfs @ 12.07 hrs, Volume= 38,045 cf  
 Outflow = 9.47 cfs @ 12.07 hrs, Volume= 38,045 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 9.47 cfs @ 12.07 hrs, Volume= 38,045 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.59' @ 12.09 hrs  
 Flood Elev= 22.90'

Device #1	Routing	Invert	Outlet Devices
	Primary	16.99'	<b>24.0" Round Culvert</b> L= 36.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 16.99' / 16.81' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=8.95 cfs @ 12.07 hrs HW=19.54' TW=19.19' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 8.95 cfs @ 2.85 fps)

**Pond M6:**

Hydrograph

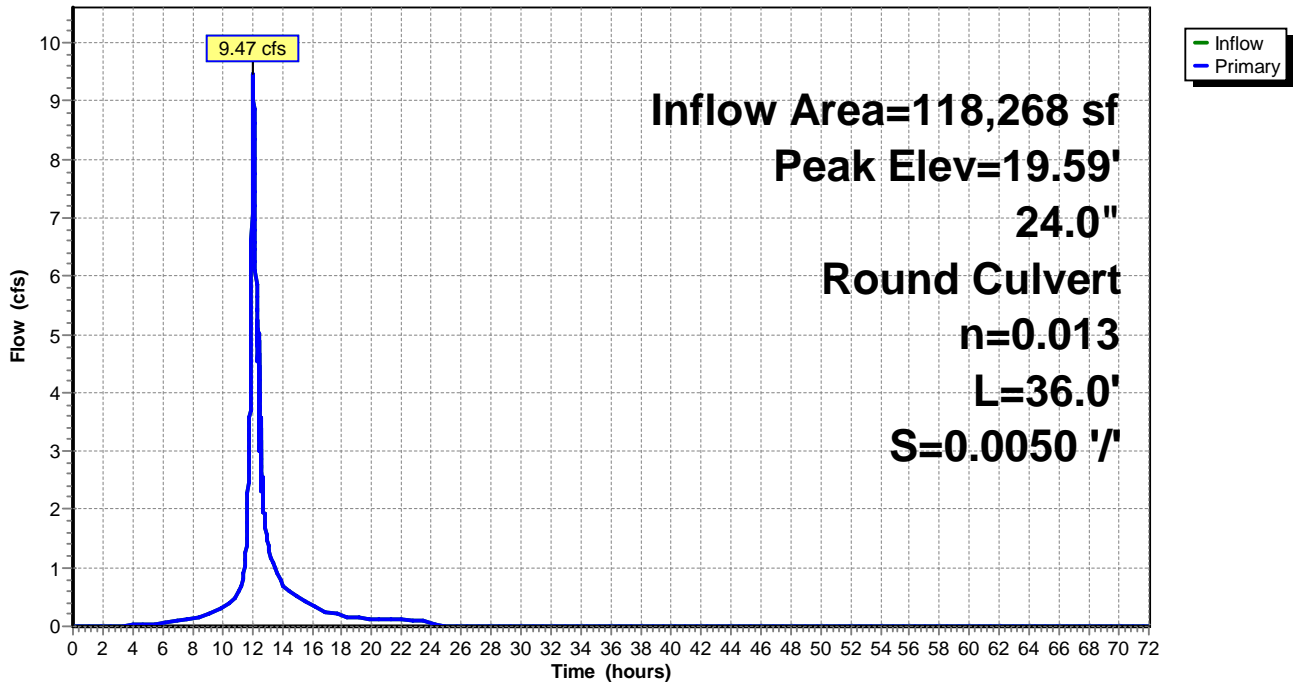

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 175

**Summary for Pond M63:**

Inflow Area = 106,303 sf, 86.53% Impervious, Inflow Depth = 4.96" for 10 yr event  
 Inflow = 13.02 cfs @ 12.08 hrs, Volume= 43,956 cf  
 Outflow = 13.02 cfs @ 12.08 hrs, Volume= 43,956 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 13.02 cfs @ 12.08 hrs, Volume= 43,956 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 213.72' @ 12.12 hrs  
 Flood Elev= 25.16'

Device #1	Routing	Invert	Outlet Devices
	Primary	18.18'	<b>12.0" Round Culvert</b> L= 3.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.18' / 18.15' S= 0.0100 1/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.08 hrs HW=182.02' TW=184.88' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond M63:**

Hydrograph

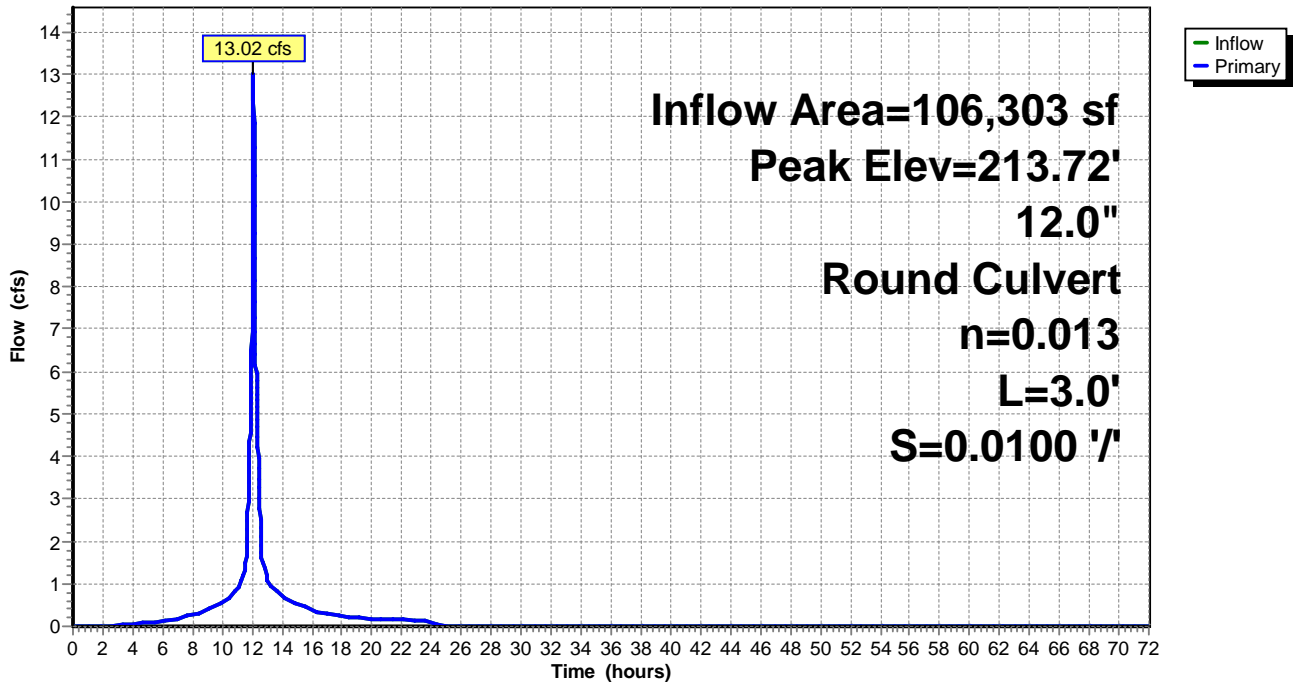

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 176

**Summary for Pond M64:**

Inflow Area = 106,303 sf, 86.53% Impervious, Inflow Depth = 4.96" for 10 yr event  
 Inflow = 13.02 cfs @ 12.08 hrs, Volume= 43,956 cf  
 Outflow = 13.02 cfs @ 12.08 hrs, Volume= 43,956 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 13.02 cfs @ 12.08 hrs, Volume= 43,956 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 234.04' @ 12.12 hrs  
 Flood Elev= 24.53'

Device #1	Routing	Invert	Outlet Devices
	Primary	19.02'	<b>12.0" Round Culvert</b> L= 147.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 19.02' / 18.28' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=7.67 cfs @ 12.08 hrs HW=191.10' TW=182.02' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 7.67 cfs @ 9.76 fps)

**Pond M64:**

Hydrograph

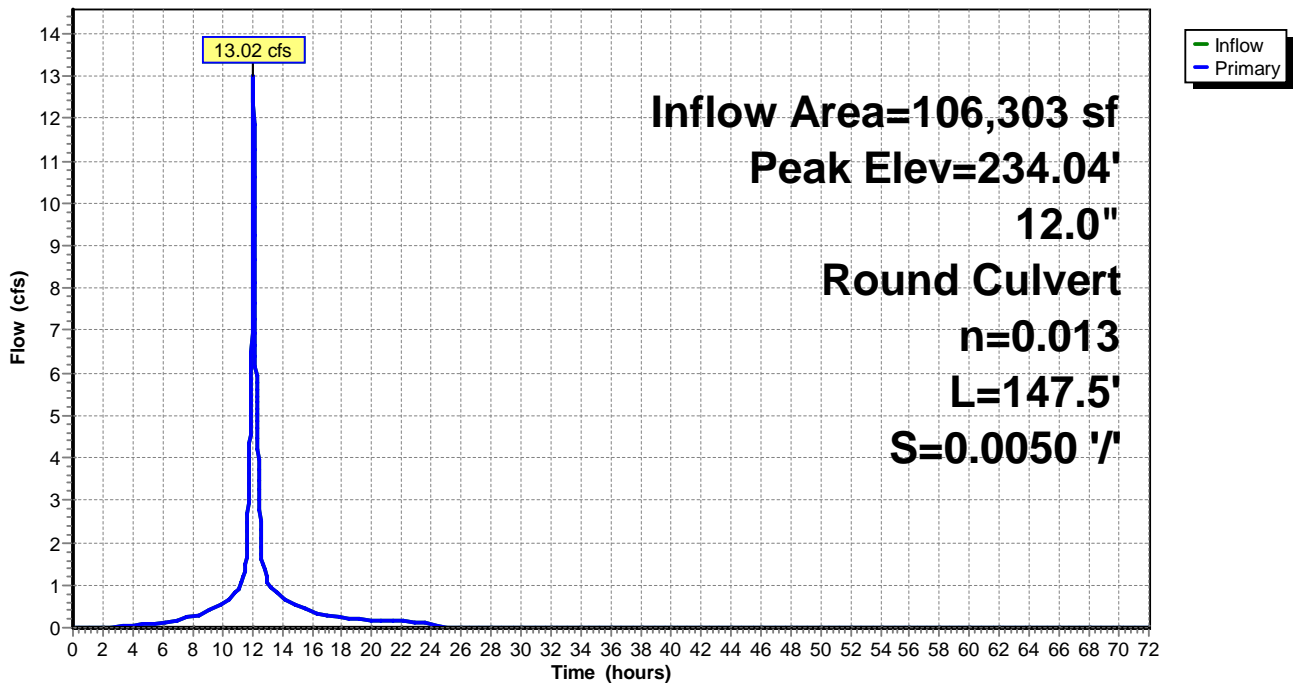

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 177

**Summary for Pond M66:**

Inflow Area = 56,767 sf, 88.14% Impervious, Inflow Depth = 5.02" for 10 yr event  
 Inflow = 6.99 cfs @ 12.08 hrs, Volume= 23,726 cf  
 Outflow = 6.99 cfs @ 12.08 hrs, Volume= 23,726 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 6.99 cfs @ 12.08 hrs, Volume= 23,726 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 242.79' @ 12.13 hrs  
 Flood Elev= 24.32'

Device #1	Routing	Invert	Outlet Devices
	Primary	20.47'	<b>12.0" Round Culvert</b> L= 269.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.47' / 19.12' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.08 hrs HW=184.76' TW=190.95' (Dynamic Tailwater)  
 ↑ **1=Culvert** ( Controls 0.00 cfs)

**Pond M66:**

Hydrograph

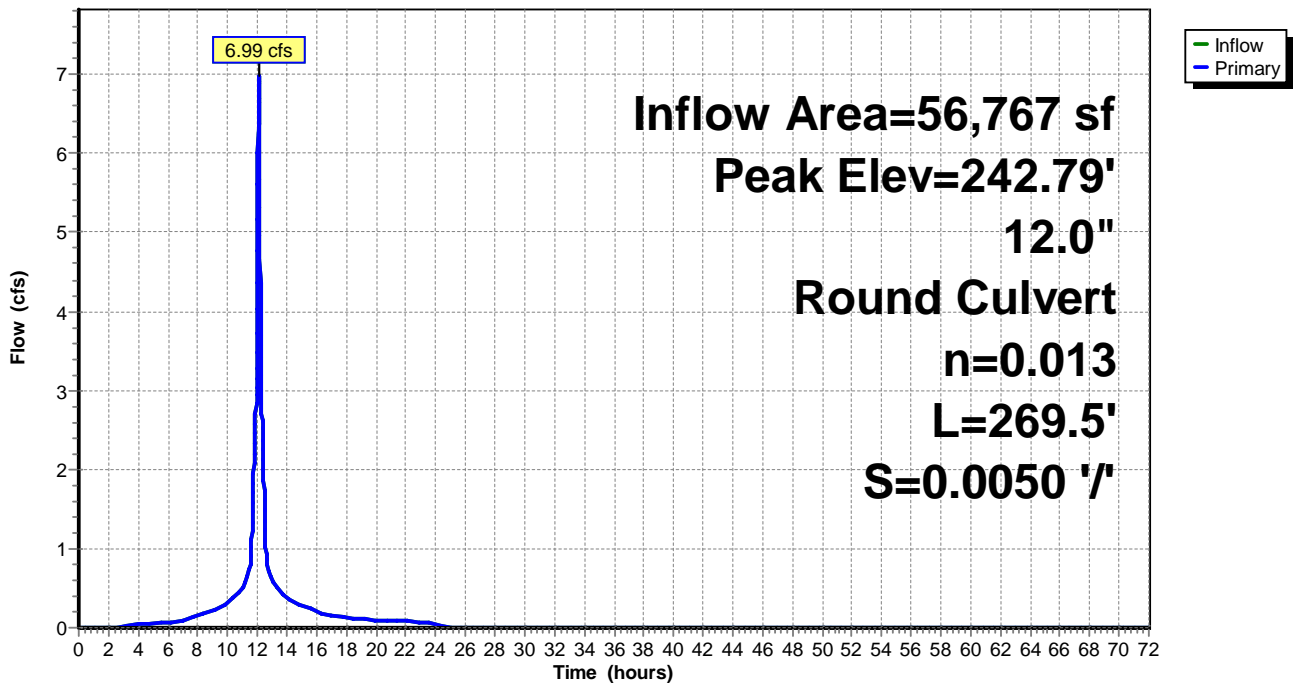

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 178

**Summary for Pond M68:**

Inflow Area = 21,014 sf, 87.41% Impervious, Inflow Depth = 5.02" for 10 yr event  
 Inflow = 2.58 cfs @ 12.08 hrs, Volume= 8,786 cf  
 Outflow = 2.58 cfs @ 12.08 hrs, Volume= 8,786 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.58 cfs @ 12.08 hrs, Volume= 8,786 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 243.10' @ 12.14 hrs  
 Flood Elev= 25.13'

Device #1	Routing	Invert	Outlet Devices
	Primary	20.79'	<b>12.0" Round Culvert</b> L= 45.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 20.79' / 20.57' S= 0.0049 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.08 hrs HW=166.23' TW=184.77' (Dynamic Tailwater)  
 ↑1=Culvert ( Controls 0.00 cfs)

**Pond M68:**

Hydrograph

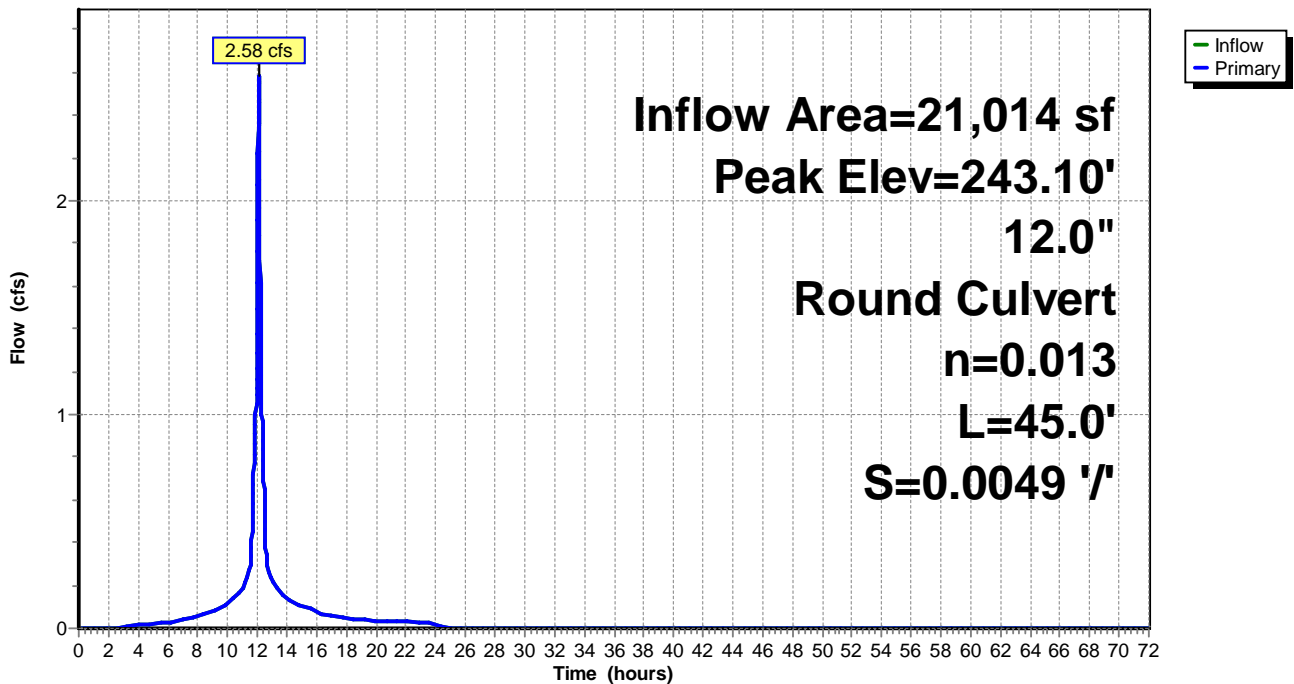

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 179

**Summary for Pond M9:**

Inflow Area = 98,714 sf, 70.02% Impervious, Inflow Depth = 3.65" for 10 yr event  
 Inflow = 7.78 cfs @ 12.09 hrs, Volume= 30,023 cf  
 Outflow = 7.78 cfs @ 12.09 hrs, Volume= 30,023 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 7.78 cfs @ 12.09 hrs, Volume= 30,023 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 19.85' @ 12.10 hrs  
 Flood Elev= 23.71'

Device #1	Routing	Invert	Outlet Devices
	Primary	17.37'	<b>24.0" Round Culvert</b> L= 56.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 17.37' / 17.09' S= 0.0050 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=7.38 cfs @ 12.09 hrs HW=19.82' TW=19.58' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 7.38 cfs @ 2.35 fps)

**Pond M9:**

Hydrograph

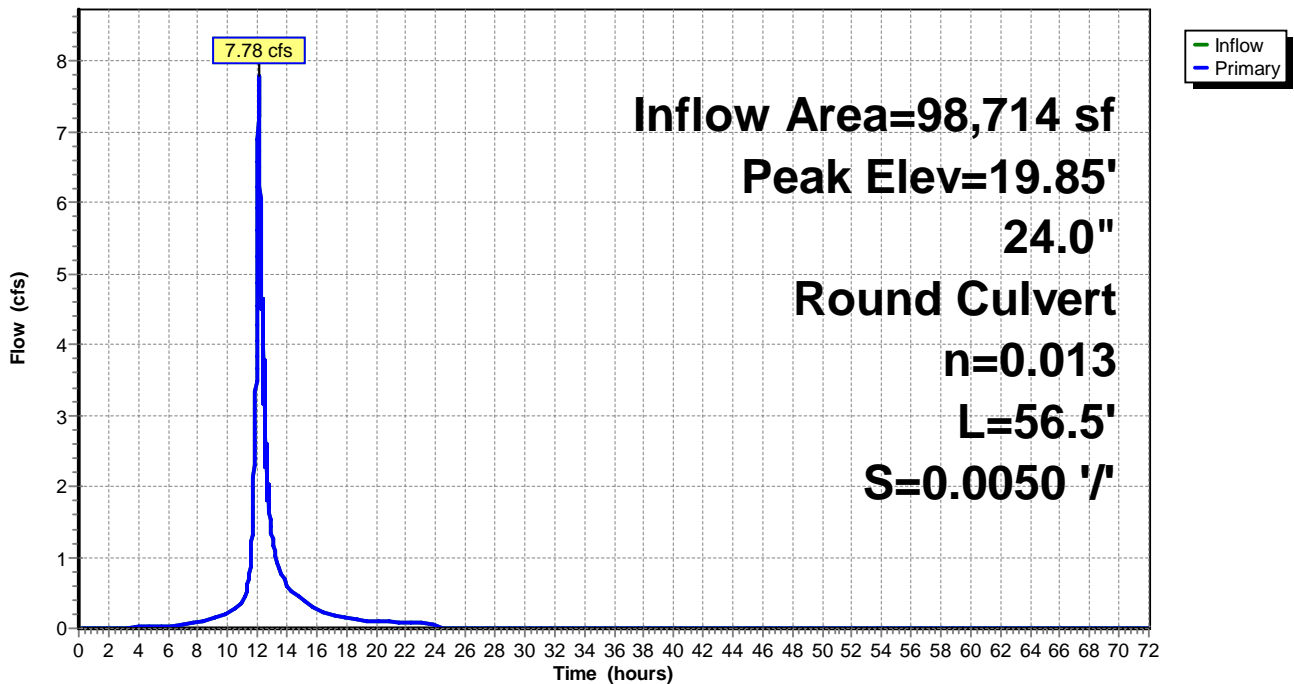

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 180

**Summary for Pond RD 20:**

Inflow Area = 37,137 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 4.68 cfs @ 12.08 hrs, Volume= 16,595 cf  
 Outflow = 4.68 cfs @ 12.08 hrs, Volume= 16,595 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 4.68 cfs @ 12.08 hrs, Volume= 16,595 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 71.60' @ 12.09 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	22.78'	<b>6.0" Round Culvert</b> L= 15.5' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 22.78' / 22.70' S= 0.0052 1/ S= 0.0052 1/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.20 sf

**Primary OutFlow** Max=4.63 cfs @ 12.08 hrs HW=71.26' TW=47.23' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 4.63 cfs @ 23.60 fps)

**Pond RD 20:**

Hydrograph

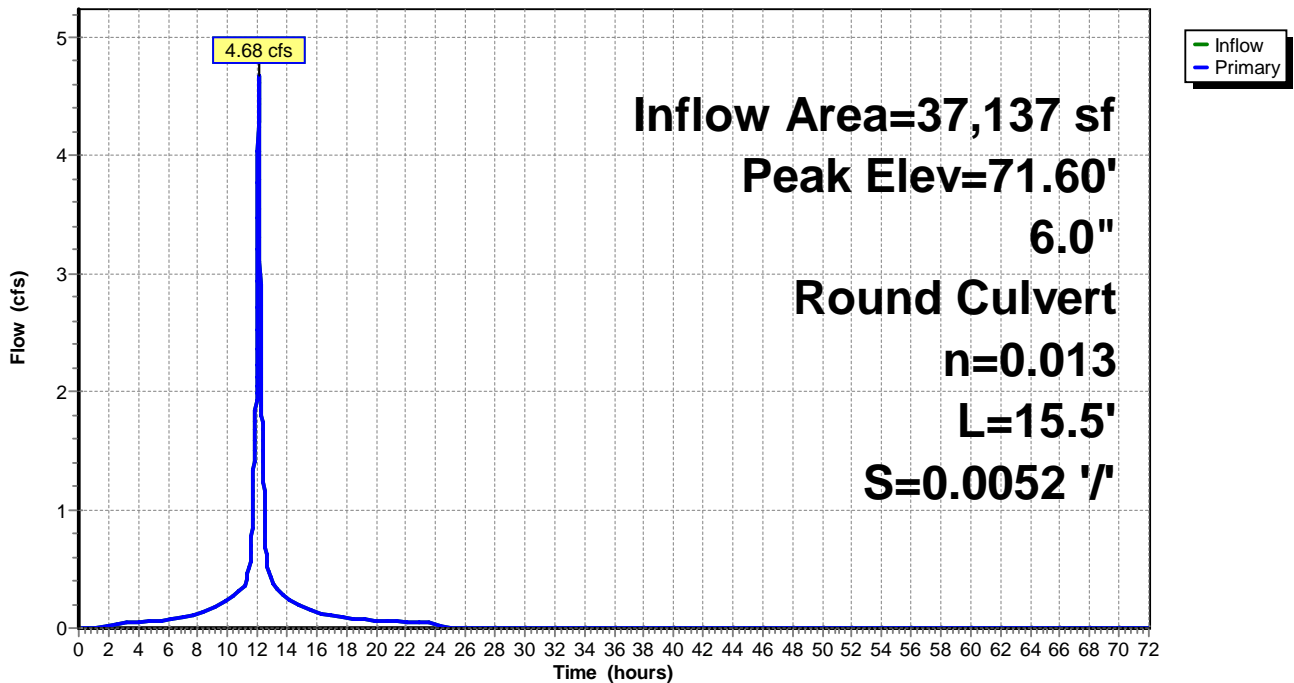

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 181

**Summary for Pond RD69:**

Inflow Area = 22,151 sf, 100.00% Impervious, Inflow Depth = 5.36" for 10 yr event  
 Inflow = 2.79 cfs @ 12.08 hrs, Volume= 9,898 cf  
 Outflow = 2.79 cfs @ 12.08 hrs, Volume= 9,898 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 2.79 cfs @ 12.08 hrs, Volume= 9,898 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 168.97' @ 12.10 hrs  
 Flood Elev= 22.70'

Device	Routing	Invert	Outlet Devices
#1	Primary	18.16'	<b>6.0" Round Culvert</b> L= 31.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 18.16' / 18.00' S= 0.0052 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.20 sf

**Primary OutFlow** Max=1.72 cfs @ 12.08 hrs HW=157.98' TW=153.24' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Outlet Controls 1.72 cfs @ 8.78 fps)

**Pond RD69:**

Hydrograph

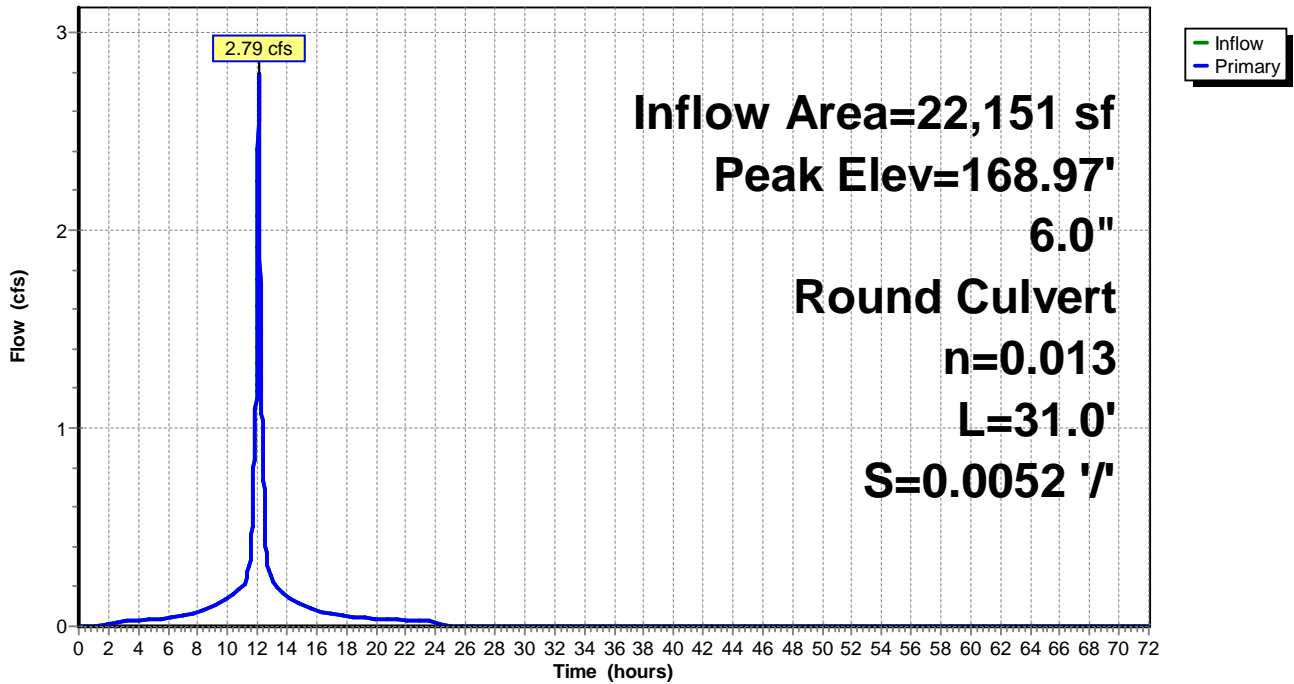



**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 182

**Summary for Pond WQS1:**

Inflow Area = 138,201 sf, 66.19% Impervious, Inflow Depth = 3.82" for 10 yr event  
 Inflow = 11.18 cfs @ 12.07 hrs, Volume= 43,974 cf  
 Outflow = 11.19 cfs @ 12.07 hrs, Volume= 43,974 cf, Atten= 0%, Lag= 0.0 min  
 Primary = 11.19 cfs @ 12.07 hrs, Volume= 43,974 cf


Routing by Dyn-Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs  
 Peak Elev= 18.14' @ 12.07 hrs  
 Flood Elev= 23.00'

Device #1	Routing	Invert	Outlet Devices
	Primary	16.12'	<b>24.0" Round Culvert</b> L= 25.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 16.12' / 16.00' S= 0.0048 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=11.13 cfs @ 12.07 hrs HW=18.14' TW=17.60' (Dynamic Tailwater)  
 ↑ **1=Culvert** (Inlet Controls 11.13 cfs @ 3.54 fps)

**Pond WQS1:**

Hydrograph

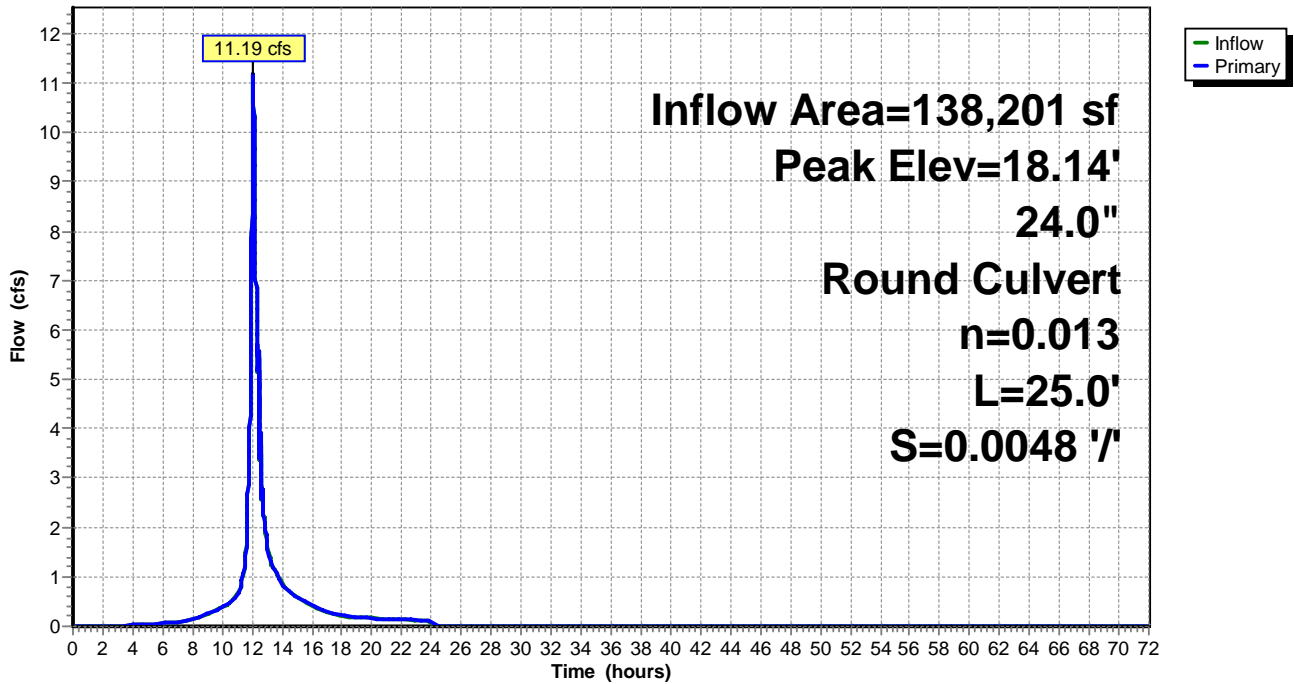

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 183


**Summary for Link AP1: Hodgson Brook**

Inflow Area = 356,875 sf, 63.58% Impervious, Inflow Depth = 4.15" for 10 yr event  
Inflow = 34.99 cfs @ 12.08 hrs, Volume= 123,435 cf  
Primary = 34.99 cfs @ 12.08 hrs, Volume= 123,435 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Link AP1: Hodgson Brook**

Hydrograph

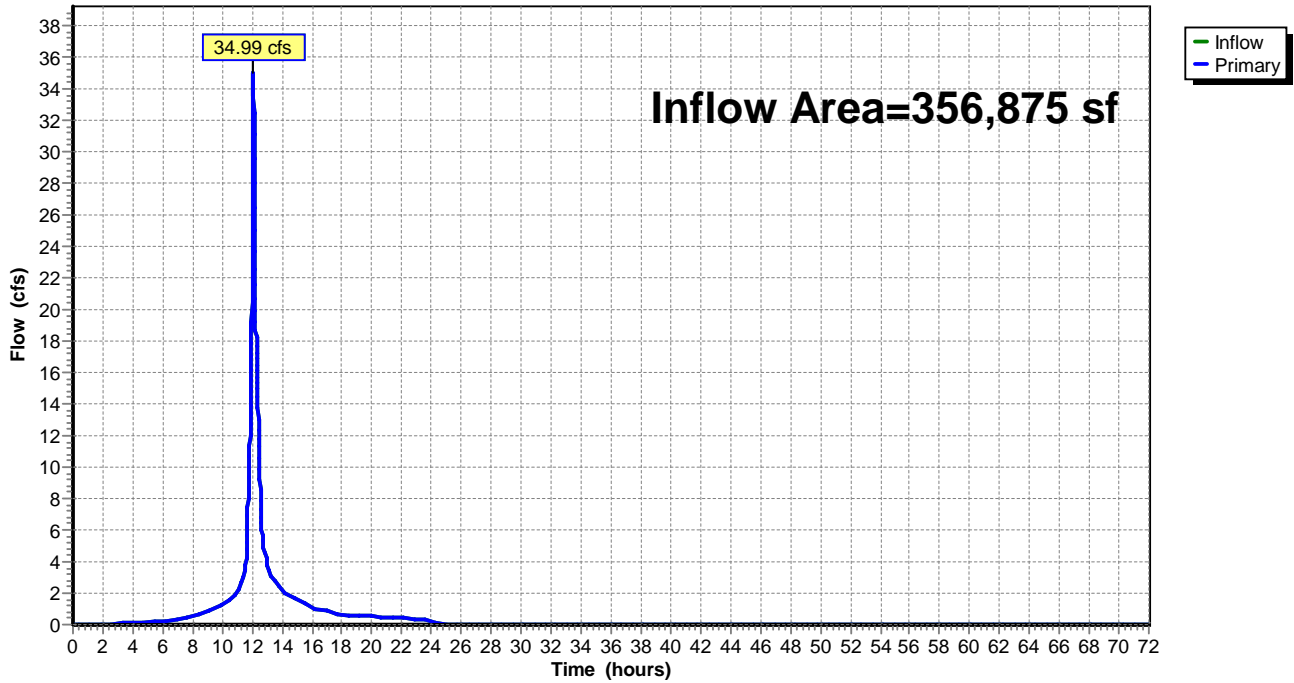

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 184


**Summary for Link AP2:**

Inflow Area = 274,692 sf, 72.93% Impervious, Inflow Depth = 3.16" for 10 yr event  
Inflow = 14.18 cfs @ 12.13 hrs, Volume= 72,394 cf  
Primary = 14.18 cfs @ 12.13 hrs, Volume= 72,394 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Link AP2:**

Hydrograph

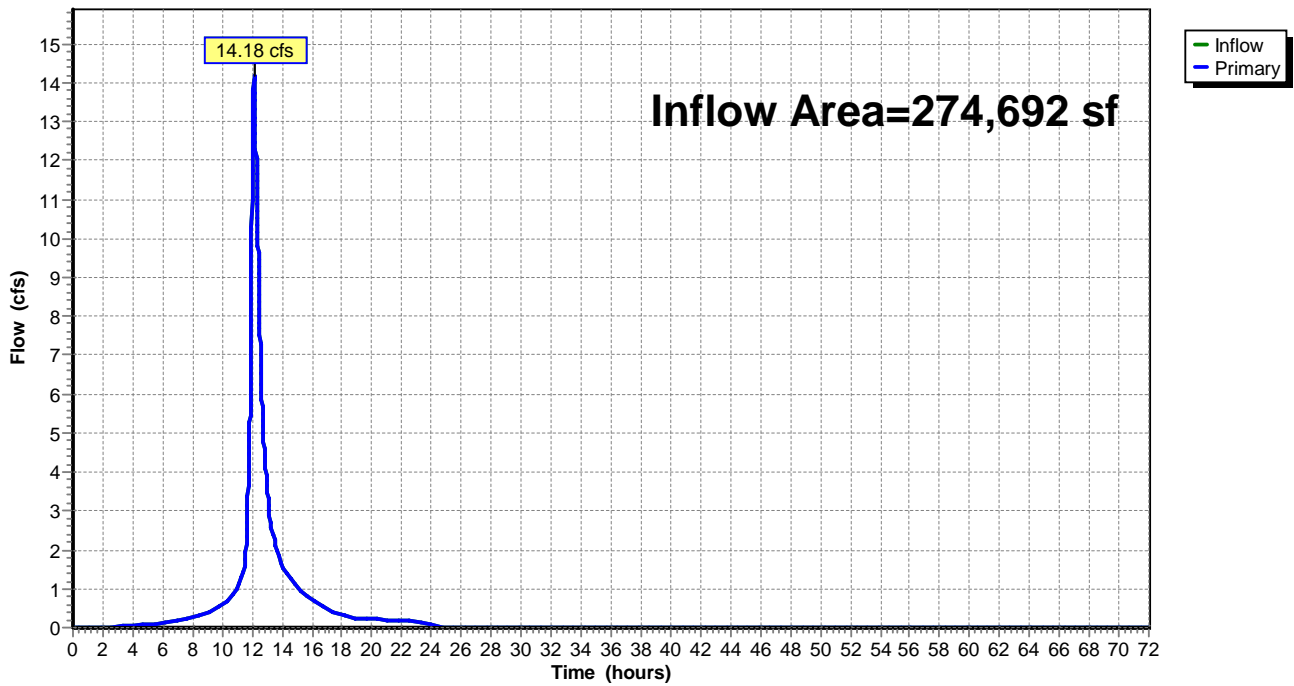

**Proposed**

Prepared by Fuss & O'Neill Inc.

HydroCAD® 10.00-21 s/n 01745 © 2018 HydroCAD Software Solutions LLC

Type III 24-hr 10 yr Rainfall=5.60"

Printed 7/23/2019

Page 185


**Summary for Link AP3:**

Inflow Area = 16,957 sf, 94.44% Impervious, Inflow Depth = 11.58" for 10 yr event  
Inflow = 3.99 cfs @ 12.00 hrs, Volume= 16,368 cf  
Primary = 3.99 cfs @ 12.00 hrs, Volume= 16,368 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

**Link AP3:**

Hydrograph

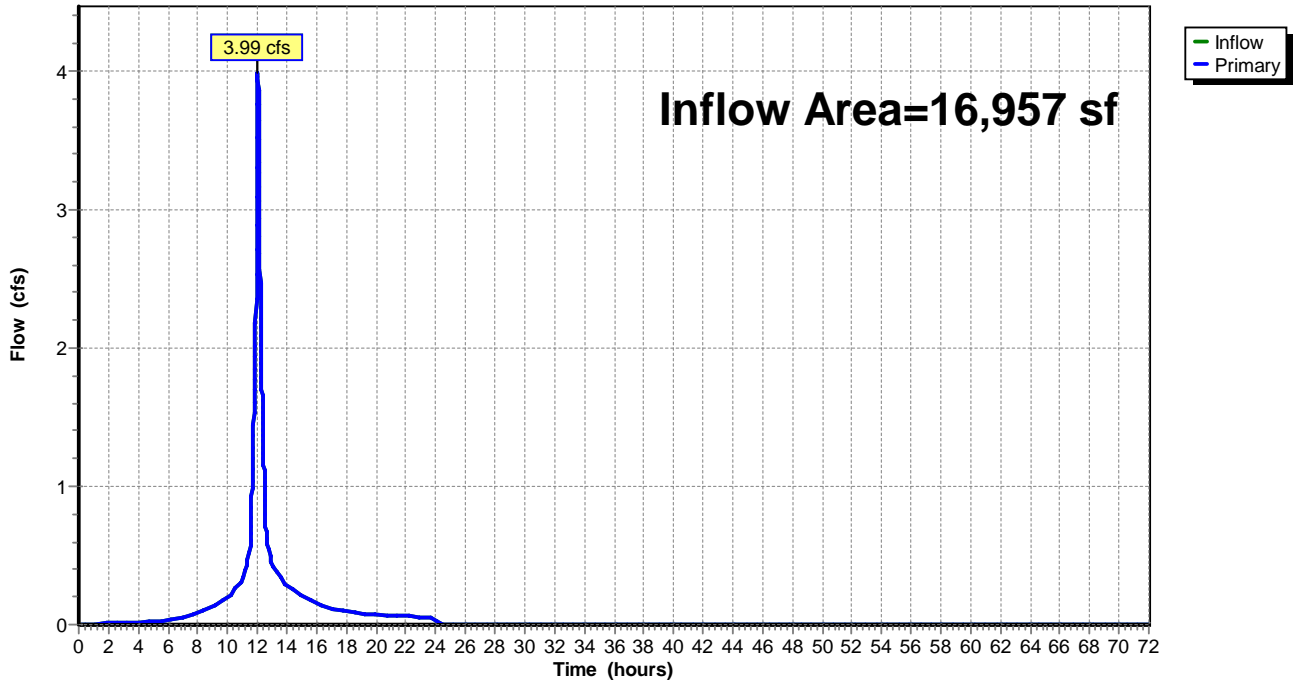

## Appendix G

---

### Rip-Rap Apron / Energy Dissipation Calculations



Project Name: WEST END YARDS

Project Location.: Portsmouth, NH

Project No.: 20180317

Date: 24-Jul

By: JVA

Chk'd By: RRL

Design Storm: **25** Year

Apron Location: Outlet to Hodgson Brook from WQU 1

**DOWNSTREAM CHANNEL (OR SPREADER) HYDRAULICS:**

Q (required) =	<b>14.65</b>	cfs	←	<b>From HydroCAD</b>
Channel Bottom Width =	<b>4</b>	ft.		(3 x Do)
Slope (along channel) =	<b>0.02</b>	ft/ft		
Left Side Slope =	<b>3</b>	h:v ang. =	18.43	deg.
Right Side Slope =	<b>3</b>	h:v ang. =	18.43	deg.
Depth of Flow =	<b>0.7076</b>	ft.	←	<b>Iterative Input</b>
Manning's 'n' =	<b>0.0397</b>			
Area =	4.33	sq.ft.		
Wetted Perimeter =	8.48	ft.		
Hydraulic Radius =	0.51	ft.		
Top Width =	8.25	ft.		
Velocity =	3.38	ft/sec		
Q (determined) =	<b>14.65</b>	cfs		<b>FLOW DEPTH ACHIEVED</b>

**ROCK RIP-RAP SIZE:** (Equ. Taken from Figure 7-43, 7-44, NH Erosion control Handbook)

**Trapazoidal Channel:**

$d50 = 12((118QS^{13/6})(R/P))^{2/5}$  **d50 = 3.0 inches\***

$n(\text{based on } d50 \text{ and } DF) = (DF^{1/6}) / (21.6 \times \log(DF/d50) + 14)$  **n = 0.0397 \*\***

**Triangular Channel:**

(likely not used; if it is change cell E14 to refernce cell H32)

$d50 = 12((64.4QS^{13/6})(Z/((Z^2)+1))^{2/5}$  **d50 = 4.0 inches\***

$n(\text{based on } d50 \text{ and } DF) = (DF^{1/6}) / (21.6 \times \log(DF/d50) + 14)$  **n = 0.0448 \*\***

\*Please note d50 has been rounded to the nearest whole number in inches for easier gradation

\*\*'n' is base on the rounded d50 in order to give the proper coefficient for rip-rap as specified

## La AND W CALCULATIONS:

Culvert Diameter (Do) =	24	Inches	← From HydroCAD
Tail Water Depth (TW) =	0.71	ft.	(greater of depth of flow above or TW below)
Length of Apron (La) =	23.32	ft.	
Width of Apron @ Do (Wo) =	6	ft.	
Width of Apron @ D.S. End (W) =	29.32	ft.	
Width of Apron if Channel (W) =	4	ft.	

\*If outleting to flat area use Tailwater (TW) =  $0.2 \times Do$  0.40

Tailwater TW to be hand calc'd if not outleting to flat area w/ invert out at grade

## ROCK RIP-RAP SIZE:

$$d50 = (0.02 \times Q^{(4/3)}) / (TW \times Do)$$

\*Use a minimum of 3 Inch d50 if Rip Rap to be installed

**Class B**  
d50 = 6.08 inches

USE: 7 Inches\*

## ROCK RIP-RAP GRADATION:

(Taken from Table 7-24 of NHDES Erosion Control Handbook)

% of Weight Smaller Than the Given Size	Size of Stone (inches)		
100	11	to	14
85	9	to	13
50	7	to	11
15	2	to	4

Minimum Rock RipRap Blanket Thickness = 16 in. use 16 in.

Minimum 6 inch sand/gravel bedding or geotextile fabric required under all rock riprap

## FORMULAE USED:

References:

NHDES Erosion Control Handbook, Pages 7-114, 7-115

NH Stormwater Manual: Volume 2, section 4-6.6, pages 172-174

Note: This spreadsheet was generated using the print-out "Pipe Outlet Protection Apron Design and d50 Riprap Sizing" prepared by Ed Minick of the Rockingham County Conservation District as a guide.

$$\text{Manning's Uniform Channel Flow: } Q = 1.486 \cdot (A \times r^{(2/3)} \times s^{(1/2)}) / n$$

$$\text{Length of Apron (La) TW < Do/2: } La = (1.8 \times Q / (Do^{(1.5)})) + 7Do$$

$$\text{Length of Apron (La) TW > Do/2: } La = (3.0 \times Q / (Do^{(1.5)})) + 7Do$$

$$\text{Width of Apron @ D.S. End TW < Do/2: } W = 3Do + La$$

$$\text{Width of Apron @ D.S. End TW } \geq \text{Do/2: } W = 3Do + 0.4La$$

$$\text{Width of D.S. End if Channel: } W = \text{Channel Bottom Width}$$

$$\text{Width of Apron at Culvert: } Wo = 3 \times Do$$



Project Name: WEST END YARDS

Project Location.: Portsmouth, NH

Project No.: 20180317

Date: 24-Jul

By: JVA

Chk'd By: RRL

Design Storm: **25** Year

Apron Location: **Outlet into Bioretention Basin 1**

**DOWNSTREAM CHANNEL (OR SPREADER) HYDRAULICS:**

Q (required) =	<b>0.73</b>	cfs	←	<b>From HydroCAD</b>
Channel Bottom Width =	<b>4</b>	ft.		(3 x Do)
Slope (along channel) =	<b>0.01</b>	ft/ft		
Left Side Slope =	<b>2</b>	h:v ang. =	26.57	deg.
Right Side Slope =	<b>2</b>	h:v ang. =	26.57	deg.
Depth of Flow =	<b>0.155</b>	ft.	←	<b>Iterative Input</b>
Manning's 'n' =	<b>0.0370</b>			
Area =	0.67	sq.ft.		
Wetted Perimeter =	4.69	ft.		
Hydraulic Radius =	0.14	ft.		
Top Width =	4.62	ft.		
Velocity =	1.10	ft/sec		
Q (determined) =	<b>0.73</b>	cfs		<b>FLOW DEPTH ACHIEVED</b>

**ROCK RIP-RAP SIZE:** (Equ. Taken from Figure 7-43, 7-44, NH Erosion control Handbook)

**Trapazoidal Channel:**

$d50 = 12((118QS^{13/6})(R/P))^{2/5}$  **d50 = 1.0 inches\***

$n(\text{based on } d50 \text{ and } DF) = (DF^{1/6}) / (21.6 \times \log(DF/d50) + 14)$  **n = 0.0370 \*\***

**Triangular Channel:**

(likely not used; if it is change cell E14 to refernce cell H32)

$d50 = 12((64.4QS^{13/6})(Z/((Z^2)+1))^{2/5}$  **d50 = 1.0 inches\***

$n(\text{based on } d50 \text{ and } DF) = (DF^{1/6}) / (21.6 \times \log(DF/d50) + 14)$  **n = 0.0370 \*\***

\*Please note d50 has been rounded to the nearest whole number in inches for easier gradation

\*\*'n' is base on the rounded d50 in order to give the proper coefficient for rip-rap as specified

## La AND W CALCULATIONS:

Culvert Diameter (Do) =	12	Inches	← From HydroCAD
Tail Water Depth (TW) =	0.20	ft.	(greater of depth of flow above or TW below)
Length of Apron (La) =	8.31	ft.	
Width of Apron @ Do (Wo) =	3	ft.	
Width of Apron @ D.S. End (W) =	11.31	ft.	
Width of Apron if Channel (W) =	4	ft.	

\*If outleting to flat area use Tailwater (TW) =  $0.2 \times Do$  0.20

Tailwater TW to be hand calc'd if not outleting to flat area w/ invert out at grade

## ROCK RIP-RAP SIZE:

$$d50 = (0.02 \times Q^{4/3}) / (TW \times Do)$$

\*Use a minimum of 3 Inch d50 if Rip Rap to be installed

**Class B**  
d50 = 1.00 inches

USE: 3 Inches\*

## ROCK RIP-RAP GRADATION:

(Taken from Table 7-24 of NHDES Erosion Control Handbook)

% of Weight Smaller Than the Given Size	Size of Stone (inches)		
100	5	to	6
85	4	to	5
50	3	to	5
15	1	to	2

Minimum Rock RipRap Blanket Thickness = 7 in. use 16 in.

Minimum 6 inch sand/gravel bedding or geotextile fabric required under all rock riprap

## FORMULAE USED:

References:

NHDES Erosion Control Handbook, Pages 7-114, 7-115

NH Stormwater Manual: Volume 2, section 4-6.6, pages 172-174

Note: This spreadsheet was generated using the print-out "Pipe Outlet Protection Apron Design and d50 Riprap Sizing" prepared by Ed Minick of the Rockingham County Conservation District as a guide.

$$\text{Manning's Uniform Channel Flow: } Q = 1.486 \cdot (A \times r^{2/3} \times s^{1/2}) / n$$

$$\text{Length of Apron (La) TW < Do/2: } La = (1.8 \times Q / (Do^{1.5})) + 7Do$$

$$\text{Length of Apron (La) TW > Do/2: } La = (3.0 \times Q / (Do^{1.5})) + 7Do$$

$$\text{Width of Apron @ D.S. End TW < Do/2: } W = 3Do + La$$

$$\text{Width of Apron @ D.S. End TW } \geq \text{Do/2: } W = 3Do + 0.4La$$

$$\text{Width of D.S. End if Channel: } W = \text{Channel Bottom Width}$$

$$\text{Width of Apron at Culvert: } Wo = 3 \times Do$$

Project Name: WEST END YARDS

Project Location.: Portsmouth, NH

Project No.: 20180317

Date: 24-Jul

By: JVA

Chk'd By: RRL

Design Storm: **25** Year

Apron Location: **Outlet into Bioretention Basin 2**

**DOWNSTREAM CHANNEL (OR SPREADER) HYDRAULICS:**

Q (required) =	<b>1.91</b>	cfs	←	<b>From HydroCAD</b>
Channel Bottom Width =	<b>4</b>	ft.		(3 x Do)
Slope (along channel) =	<b>0.01</b>	ft/ft		
Left Side Slope =	<b>2</b>	h:v ang. =	26.57	deg.
Right Side Slope =	<b>2</b>	h:v ang. =	26.57	deg.
Depth of Flow =	<b>0.2532</b>	ft.	←	<b>Iterative Input</b>
Manning's 'n' =	<b>0.0326</b>			
Area =	1.14	sq.ft.		
Wetted Perimeter =	5.13	ft.		
Hydraulic Radius =	0.22	ft.		
Top Width =	5.01	ft.		
Velocity =	1.67	ft/sec		
Q (determined) =	<b>1.91</b>	cfs		<b>FLOW DEPTH ACHIEVED</b>

**ROCK RIP-RAP SIZE:** (Equ. Taken from Figure 7-43, 7-44, NH Erosion control Handbook)

**Trapazoidal Channel:**

$d50 = 12((118QS^{13/6})(R/P))^{2/5}$  **d50 = 1.0 inches\***

$n(\text{based on } d50 \text{ and } DF) = (DF^{1/6}) / (21.6 \times \log(DF/d50) + 14)$  **n = 0.0326 \*\***

**Triangular Channel:** (likely not used; if it is change cell E14 to refernce cell H32)

$d50 = 12((64.4QS^{13/6})(Z/((Z^2)+1))^{2/5}$  **d50 = 2.0 inches\***

$n(\text{based on } d50 \text{ and } DF) = (DF^{1/6}) / (21.6 \times \log(DF/d50) + 14)$  **n = 0.0444 \*\***

\*Please note d50 has been rounded to the nearest whole number in inches for easier gradation

\*\*'n' is base on the rounded d50 in order to give the proper coefficient for rip-rap as specified

## La AND W CALCULATIONS:

Culvert Diameter (Do) =	12	Inches	← From HydroCAD
Tail Water Depth (TW) =	0.25	ft.	(greater of depth of flow above or TW below)
Length of Apron (La) =	10.44	ft.	
Width of Apron @ Do (Wo) =	3	ft.	
Width of Apron @ D.S. End (W) =	13.44	ft.	
Width of Apron if Channel (W) =	4	ft.	

\*If outleting to flat area use Tailwater (TW) =  $0.2 \times Do$     0.20

Tailwater TW to be hand calc'd if not outleting to flat area w/ invert out at grade

## ROCK RIP-RAP SIZE:

$$d50 = (0.02 \times Q^{4/3}) / (TW \times Do)$$

\*Use a minimum of 3 Inch d50 if Rip Rap to be installed

**Class B**  
d50 = 2.25 inches

USE: 3 Inches\*

## ROCK RIP-RAP GRADATION:

(Taken from Table 7-24 of NHDES Erosion Control Handbook)

% of Weight Smaller Than the Given Size	Size of Stone (inches)		
100	5	to	6
85	4	to	5
50	3	to	5
15	1	to	2

Minimum Rock RipRap Blanket Thickness = 7 in. use 16 in.

Minimum 6 inch sand/gravel bedding or geotextile fabric required under all rock riprap

## FORMULAE USED:

References:

NHDES Erosion Control Handbook, Pages 7-114, 7-115

NH Stormwater Manual: Volume 2, section 4-6.6, pages 172-174

Note: This spreadsheet was generated using the print-out "Pipe Outlet Protection Apron Design and d50 Riprap Sizing" prepared by Ed Minick of the Rockingham County Conservation District as a guide.

$$\text{Manning's Uniform Channel Flow: } Q = 1.486 \cdot (A \times r^{2/3} \times s^{1/2}) / n$$

$$\text{Length of Apron (La) TW < Do/2: } La = (1.8 \times Q / (Do^{1.5})) + 7Do$$

$$\text{Length of Apron (La) TW > Do/2: } La = (3.0 \times Q / (Do^{1.5})) + 7Do$$

$$\text{Width of Apron @ D.S. End TW < Do/2: } W = 3Do + La$$

$$\text{Width of Apron @ D.S. End TW } \geq \text{Do/2: } W = 3Do + 0.4La$$

$$\text{Width of D.S. End if Channel: } W = \text{Channel Bottom Width}$$

$$\text{Width of Apron at Culvert: } Wo = 3 \times Do$$

## Appendix H

---

### Site Specific Soils Survey



Richard Lundborn

---

From: Luke Hurley <lhurley@gesinc.biz>  
Sent: Wednesday, September 12, 2018 9:32 AM  
To: Richard Lundborn  
Subject: Cate street soil Map

Hi Rick,

Here is the soil map. Pretty straight forward:

**400A Udorthents, sandy or gravelly**

This map unit typically includes the following concepts: 1) very gravelly (> 35%) sand or very gravelly loamy sand; Or 2) sand or loamy sand textures that may have lenses of loamy very fine sand or finer somewhere in the particle-size class control section (25 - 100 cm or 10 - 40"). Saturated hydraulic conductivity ( $K_{sat}$ ) is high or very high. Drainage class ranges from excessively drained to somewhat poorly drained. Typical gravel pit.

This would equate to an Eldridge NRCS, 89 HSG C.

I see no need to mark up the plan.

Luke





# Appendix I

---

## Infiltration Feasibility Report





March 18, 2019

Torrington Properties, Inc.  
60 K Street  
Boston, MA 02127

Attention: Mr. Jay Bisognano

Reference: West End Yards Development Site; Portsmouth, New Hampshire  
Subsurface Exploration Program

Ladies and Gentlemen:

This letter documents the results of our subsurface exploration program, including the results of soil permeability analyses associated the proposed subsurface infiltration systems to be constructed for the West End Yards Development project to be located in Portsmouth, New Hampshire.

On March 1 and 5, 2019, nineteen (19) test pits TP-101 through TP-119 were performed at the site by P. K. Brown Construction of Portsmouth, New Hampshire under contract to McPhail Associates, LLC (McPhail). Approximate test pit locations are as indicated on the enclosed Subsurface Exploration Plan, **Figure 1**. A detailed description of the subsurface conditions encountered within the explorations is documented on the attached test pit logs.

The test pits were performed within the footprint of the proposed subsurface infiltration systems. A fill deposit encountered within the test pits was observed to extend to depths ranging from 1 to 5.5 feet below the existing ground surface. In general, the fill deposit consists of loose to compact, light brown to gray black silty sand and gravel to sandy silt with trace to some gravel containing cobbles, brick and wood. Below the fill material, an organic deposit was encountered within three (3) test pits TP-101, TP-112, and TP-117 at depths ranging from 3.5 to 5.5 feet below ground surface. The organic deposit was observed to consist of a soft, black, organic silt with trace sand. A natural marine clay deposit was present below the fill and/or organic deposits within seven (7) test pits TP-101, TP-103, TP-112, TP-116, TP-117, TP-118, and TP-119 at depths ranging from 3 to 5.5 feet below ground surface corresponding to Elevation +15.4 to Elevation +17.6. The marine clay deposit was observed to consist of a soft to stiff, blue to gray, silty clay. A natural glacial outwash deposit was present below the fill deposit within twelve (12) test pits at depths ranging from 0.3 to 5.5 feet below ground surface corresponding to Elevation +26.2 to Elevation +20.8. The glacial outwash deposit was observed to consist of a compact to very dense, light gray/brown, silty fine sand with trace to some gravel. Grain-size distributions of typical samples of glacial outwash are presented on the enclosed **Figures 2** and **3**. Within the exception of test pits TP-108 and TP-113 that were terminated on refusal on possible bedrock, the remaining test pits were terminated within glacial outwash or marine clay deposits.

Groundwater was observed during excavation in test pits TP-102, TP-105, TP-106, TP-108, TP-112, TP-116, TP-117, TP-118 and TP-119 at respective depths of 6, 6.5, 7, 7, 5, 6, 5.5, 5, and 5.5 feet below ground surface. Groundwater was not observed in other completed



test pits. Due to the relatively impervious nature of the marine clay deposit and underlying bedrock, groundwater at the site is considered to be “perched” on the surface of the marine clay deposit and/or bedrock during and after precipitation events. It is anticipated that future groundwater levels across the project site may vary from those reported herein based on such factors such as normal seasonal changes, runoff during or following periods of heavy precipitation, and alterations to existing drainage patterns.

### **Soil Permeability**

McPhail estimated the coefficient of permeability of the glacial outwash deposit based on laboratory grain-size distribution using the Kozeny-Carmen formula. This method involves the use of additional parameters such as void ratio and particle shape, which are estimated from the exploration data and the representative soil samples. The results of the Kozeny-Carmen formula indicate values of the coefficient of permeability within published ranges for similar soils.

Specifically, below are the tabulated results of the coefficient of permeability based on laboratory grain-size distribution using the Kozeny-Carmen formula within ten (10) test pits.

Exploration	Depth [feet]	Strata	k at 20°C [cm/s]	k at 10°C [cm/s]
TP-102	3.5 to 7.5	Glacial Outwash	3.41E-04	2.62E-04
TP-105	0 to 7.5	Glacial Outwash	8.17E-04	6.28E-04
TP-107	4 to 6.5	Glacial Outwash	6.07E-04	4.67E-04
TP-108	0 to 7.5	Glacial Outwash	2.45E-03	1.88E-03
TP-109	3 to 6	Glacial Outwash	3.67E-04	2.82E-04
TP-110	4.5 to 6	Glacial Outwash	1.29E-03	9.93E-04
TP-111	3.5 to 6	Glacial Outwash	6.90E-04	5.31E-04
TP-113	1.25 to 3.75	Glacial Outwash	4.57E-04	3.51E-04
TP-115	1 to 5	Glacial Outwash	3.01E-04	2.31E-04

In consideration of the above, a coefficient of permeability in the range of  $1.9 \times 10^{-3}$  to  $3 \times 10^{-4}$  cm/s and is recommended for the glacial outwash deposit.

It should be noted that the existing glacial outwash deposit is heterogeneous in composition and variable in density, thus, it is anticipated that the coefficient of permeability in the glacial outwash deposit will be highly variable and the results of our permeability testing may not be representative of the entire glacial outwash deposit at the site. The analyses and recommendations presented in this letter are based upon the data obtained from the subsurface explorations performed at the approximate locations indicated on the enclosed plan. If variations in the nature and extent of subsurface conditions between the widely spaced explorations become evident during the course of construction, it will be necessary for a re-evaluation of the recommendations of this letter to be made after performing on-site observations during the construction period and noting the characteristics of any variations.



Torrington Properties, Inc.  
March 18, 2019  
Page 3

Additionally, given that the marine clay deposit is consider impermeable, sieve and permeability analyses of this deposit were not performed. Generally, the marine clay deposit was encountered within the test pits performed at the northern and southern areas of the site. The approximate locations of these areas are indicated on the attached plan.

Furthermore, the approximate areas of the test pits that were terminated on refusal on possible bedrock are indicated on the attached plan.

**Final Comments**

We trust that the above is sufficient for your present requirements. Should you have any questions concerning the recommendations presented herein, please do not hesitate to call us.

Very truly yours,

McPHAIL ASSOCIATES, LLC

A handwritten signature in blue ink, appearing to read "Fatima Babic-Konjic".

Fatima Babic-Konjic, P.E.



A handwritten signature in blue ink, appearing to read "Ambrose J. Donovan".

Ambrose J. Donovan, P.E., L.S.P.

N:\Working Documents\Reports\6524\_SEP\_031819.docx

FBK/ajd




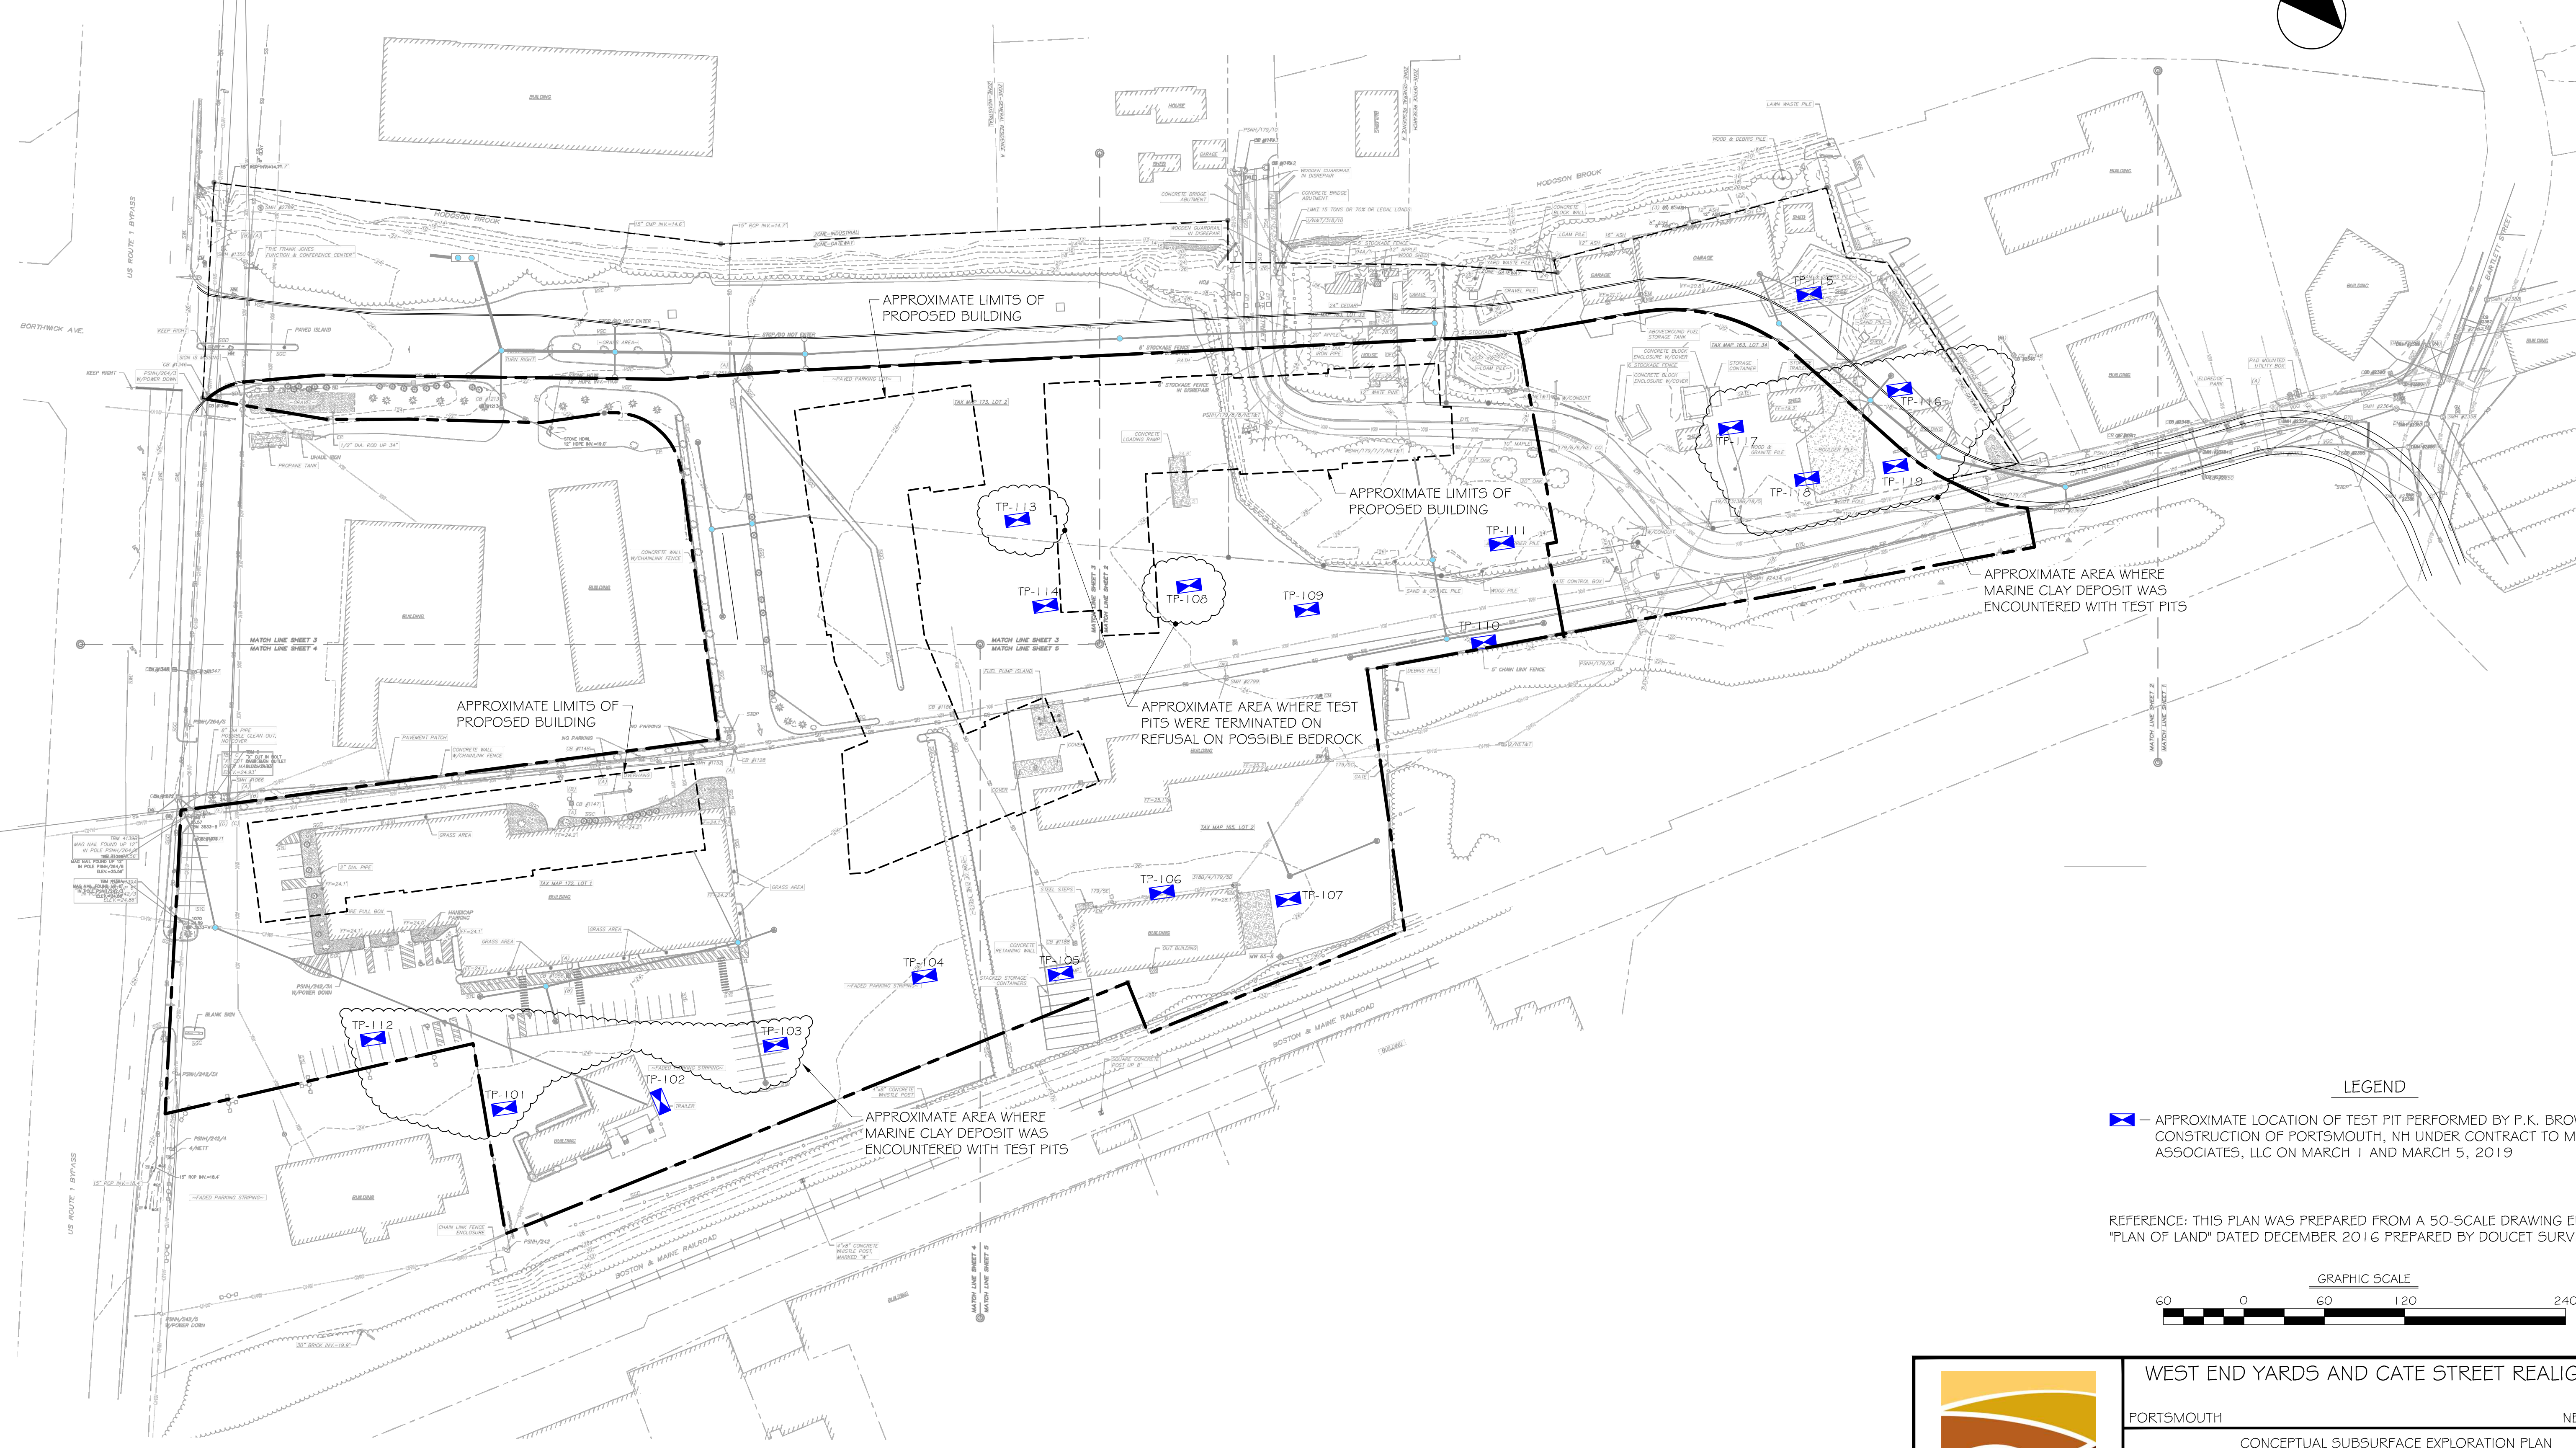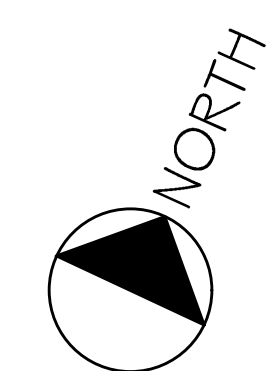

**LEGEND**

☒ — APPROXIMATE LOCATION OF TEST PIT PERFORMED BY P.K. BROWN CONSTRUCTION OF PORTSMOUTH, NH UNDER CONTRACT TO McPHAIL ASSOCIATES, LLC ON MARCH 1 AND MARCH 5, 2019

REFERENCE: THIS PLAN WAS PREPARED FROM A 50-SCALE DRAWING ENTITLED, "PLAN OF LAND" DATED DECEMBER 2016 PREPARED BY DOUCET SURVEY INC.

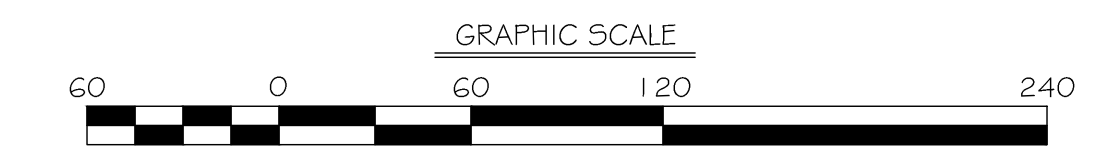

FILE NAME: N:\Vocad\LOB5624\Storm Infiltration\6524-F01.dwg



Geotechnical and  
Geoenvironmental Engineers  
2269 Massachusetts Avenue  
Cambridge, MA 02140  
617/868-1420  
617/868-1423 (Fax)  
www.mcphailgeo.com

WEST END YARDS AND CATE STREET REALIGNMENT			
PORTSMOUTH		NEW HAMPSHIRE	
CONCEPTUAL SUBSURFACE EXPLORATION PLAN			
FOR TORRINGTON PROPERTIES, INC. BY McPHAIL ASSOCIATES, LLC			
Date: MARCH 2019	Dwn: M.B.S.	Chkd: F.B.K.	Scale: 1" = 60'
Project No: 6524			FIGURE 1




McPHAIL ASSOCIATES, LLC

M.I.T. GRAIN SIZE SCALE


GRAIN SIZE DISTRIBUTION  
GLACIAL OUTWASH

FIGURE 2

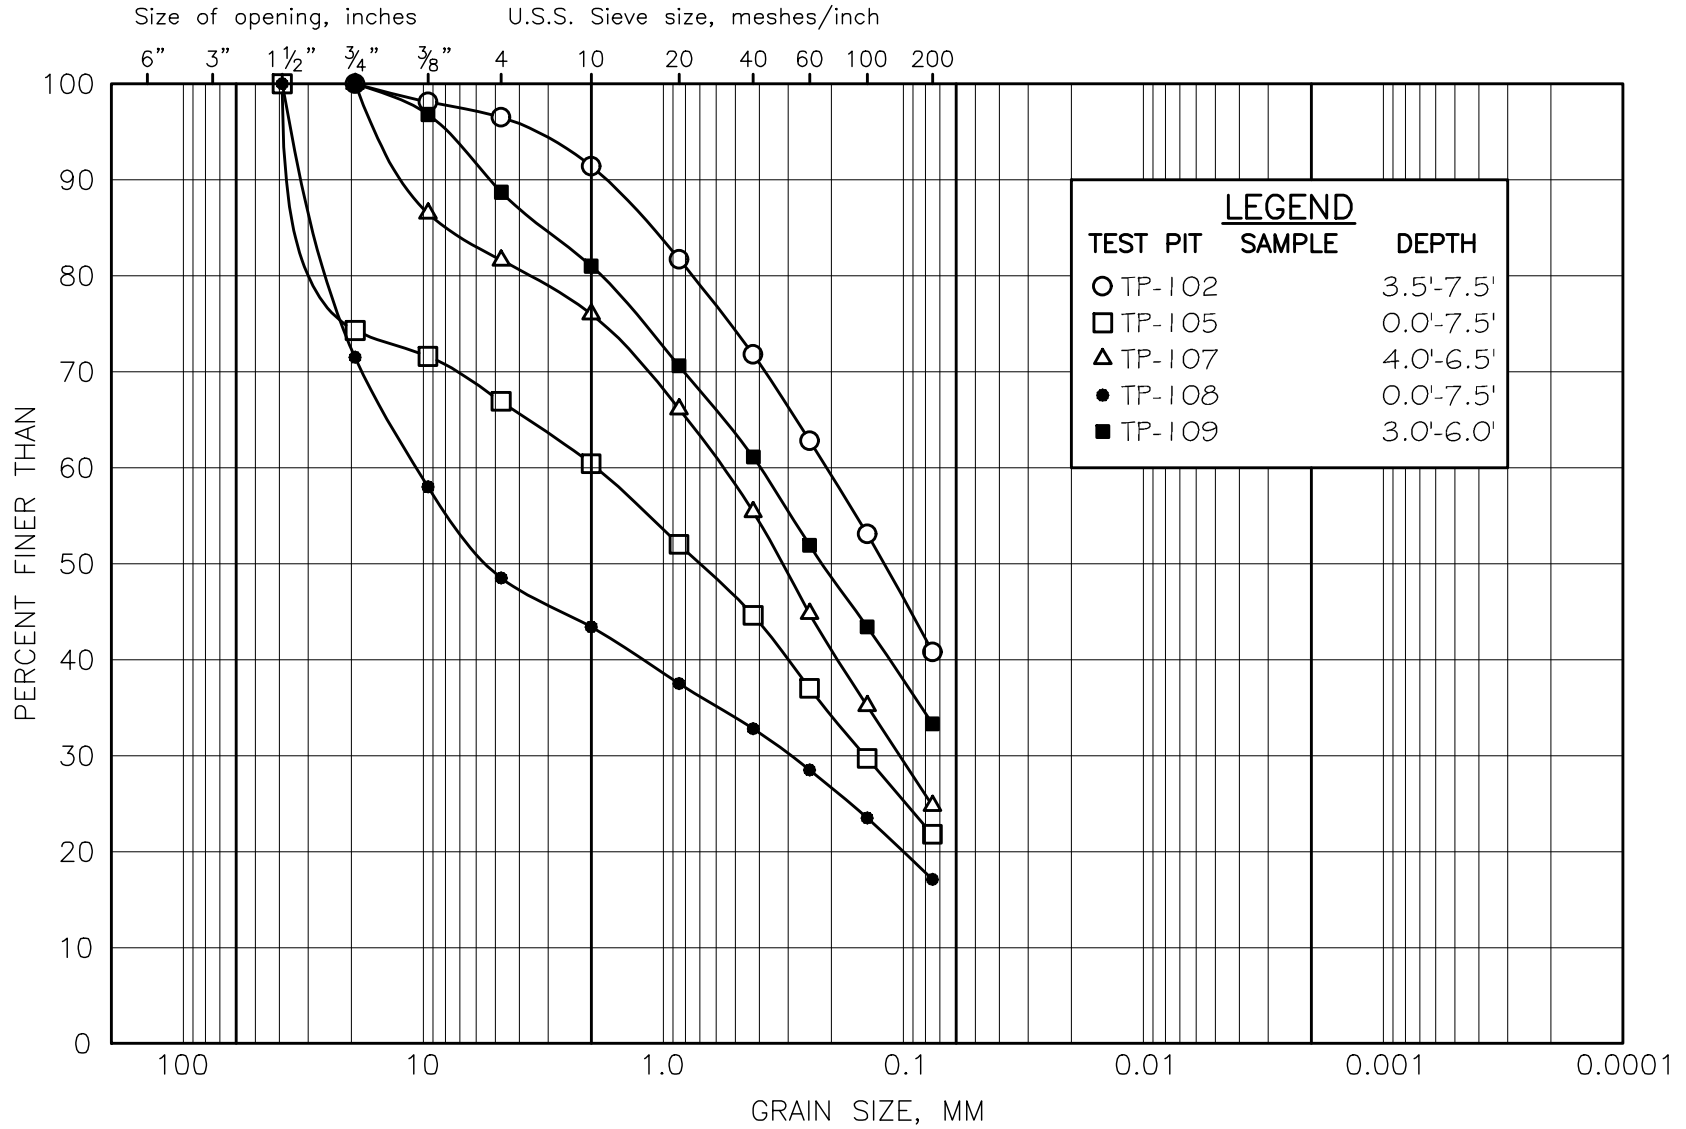

COBBLE SIZE	COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE	SILT SIZE	CLAY SIZE
	GRAVEL SIZE			SAND SIZE				

M.I.T. GRAIN SIZE SCALE

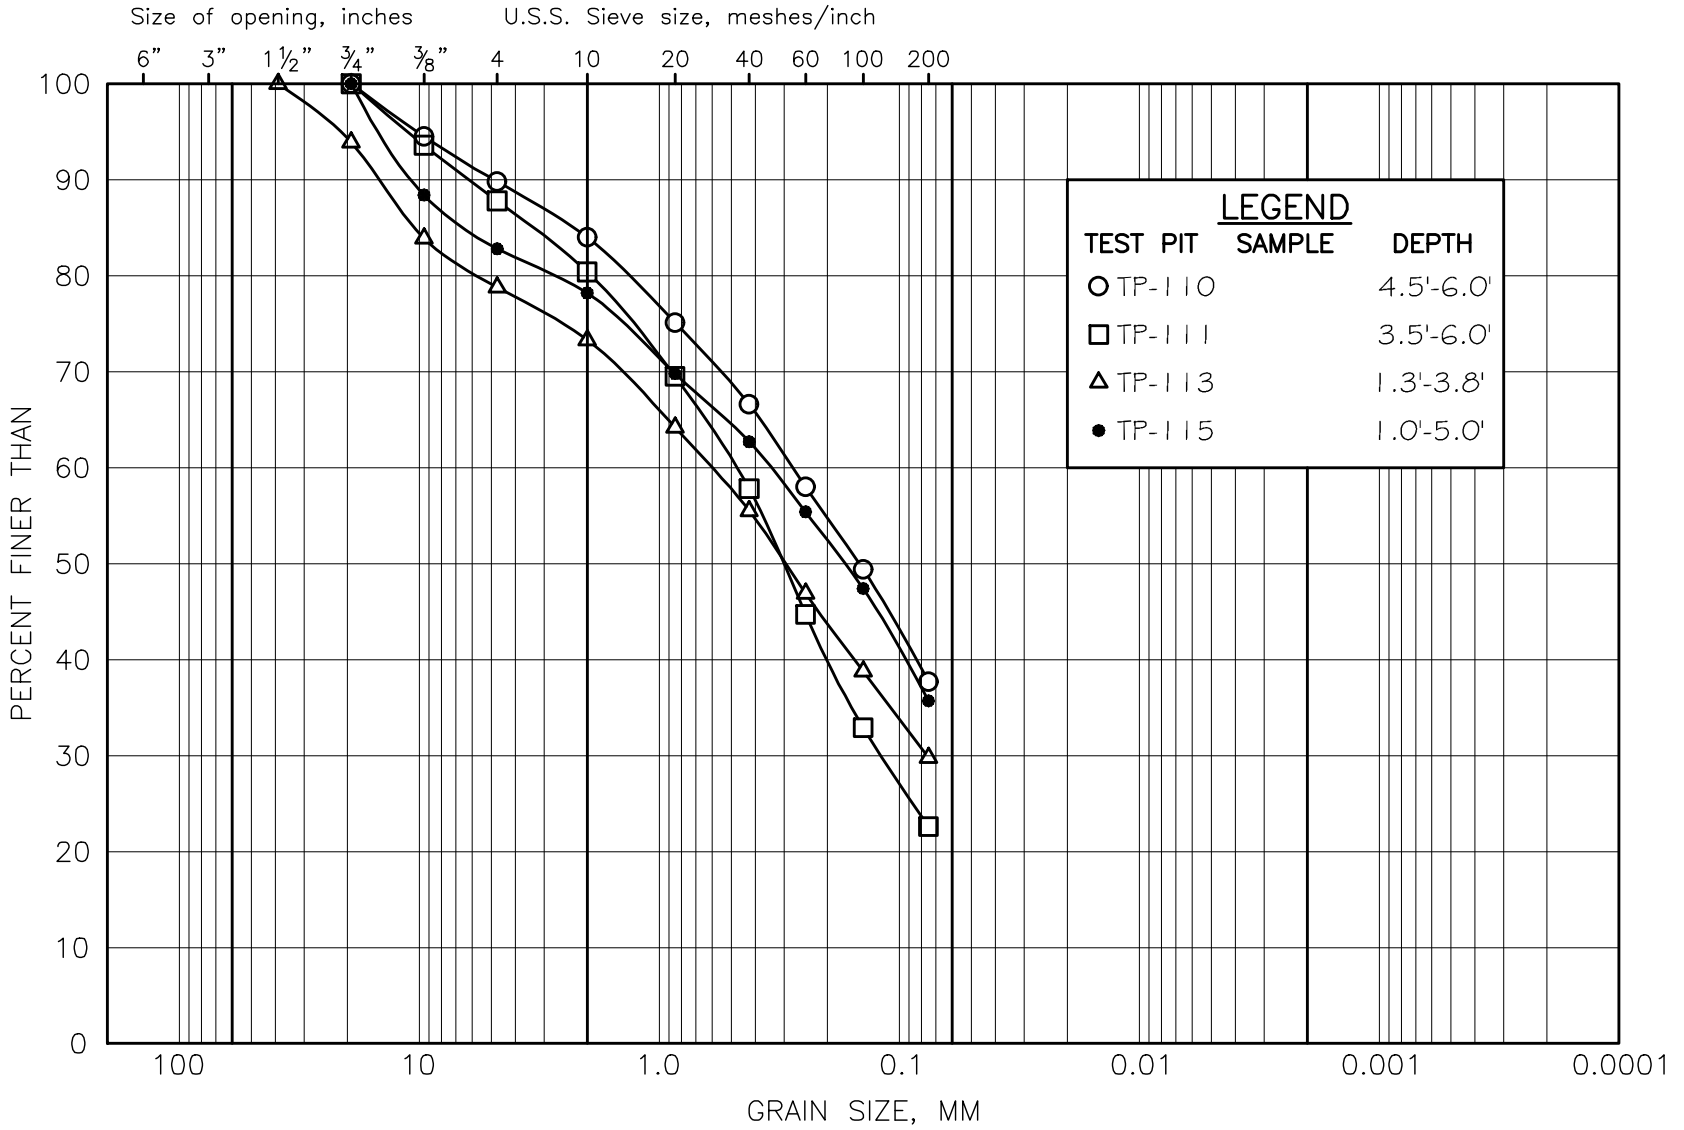

COBBLE SIZE	COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE	SILT SIZE	CLAY SIZE
	GRAVEL SIZE			SAND SIZE				

McPHAIL ASSOCIATES, LLC

GRAIN SIZE DISTRIBUTION  
GLACIAL OUTWASH

FIGURE 3



JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 101

0 3 6 9 FT.

NORTH ←

→ SOUTH

GROUND SURFACE EL. +24.3

ASPHALT

0.3

LOOSE LIGHT BROWN SILTY SAND WITH GRAVEL (FILL)

1.0

COMPACT GRAY-BLACK SANDY SILT WITH  
GRAVEL AND TRACE COBBLES (FILL)

3

4.0

SOFT BLACK ORGANIC SILT,  
TRACE CLAY (ORGANIC DEPOSIT)

5.0

FIRM BLUE-GRAY CLAY  
(MARINE CLAY)

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION


JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 102



**McPHAIL ASSOCIATES, LLC**

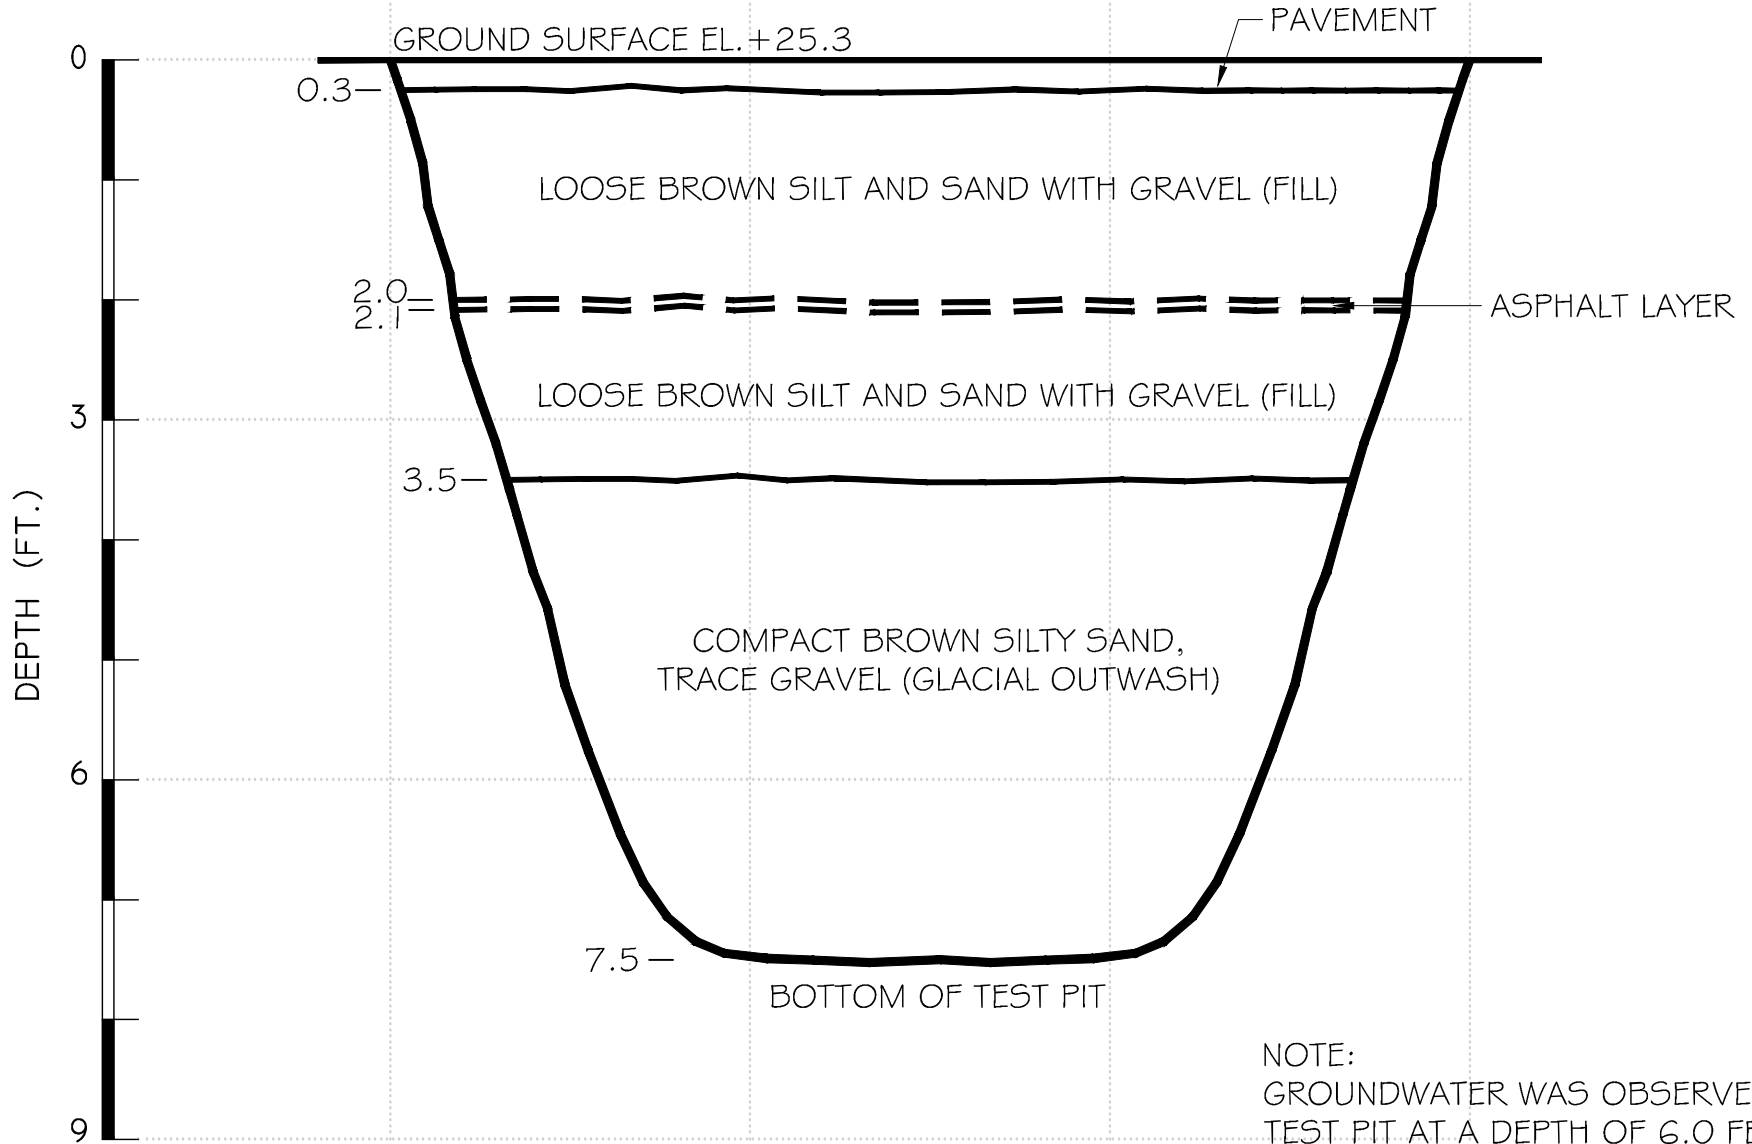

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 6.0 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 103

NORTH ←

→ SOUTH

0 3 6 9 FT.

GROUND SURFACE EL. +25.6

ASPHALT

0.3

LOOSE TO COMPACT BROWN SILTY SAND WITH  
GRAVEL, SOME BRICK AND COBBLES (FILL)

2.5

CONCRETE PAD

3.5

FIRM LIGHT BROWN SILTY  
CLAY WITH SAND, TRACE  
GRAVEL (MARINE CLAY)

6.0

BOTTOM OF TEST PIT

DEPTH (FT.)

0

3

6

9

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 104

NORTH ←

→ SOUTH

0 3 6 9 FT.

GROUND SURFACE EL. +26.3

PAVEMENT

0.3

LOOSE LIGHT BROWN SILTY SAND, TRACE GRAVEL (FILL)

1.5

LOOSE TO COMPACT GRAY SANDY SILT, TRACE GRAVEL, TRACE BRICK AND WOOD (FILL)

3

5.5

COMPACT LIGHT BROWN SILTY SAND, TRACE TO SOME GRAVEL (GLACIAL OUTWASH)

6

6.5

BOTTOM OF TEST PIT

9

DEPTH (FT.)


McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 105

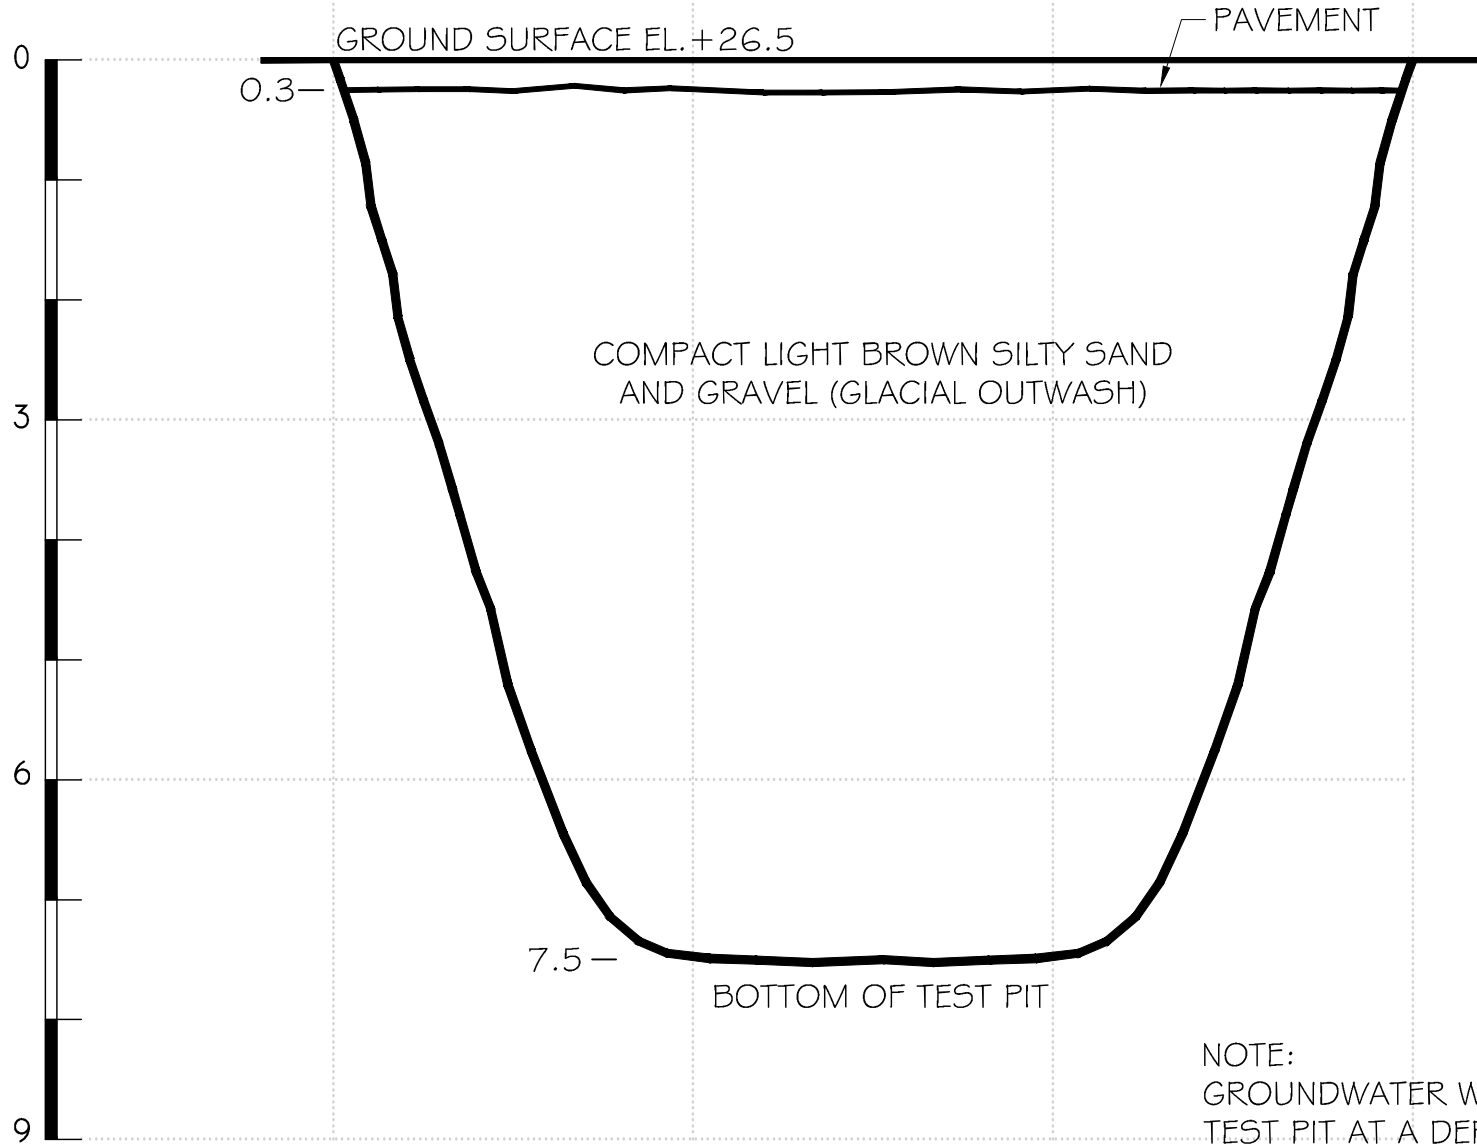

**McPHAIL ASSOCIATES, LLC**

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 6.5 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 106

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +26.0

LOOSE BROWN SILTY SAND WITH SOME GRAVEL (FILL)

1.5

COMPACT TO DENSE BROWN-GRAY,  
SILTY SAND, TRACE TO SOME  
GRAVEL (GLACIAL OUTWASH)

3

6

7.5

BOTTOM OF TEST PIT

9

DEPTH (FT.)


McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 7.0 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 107

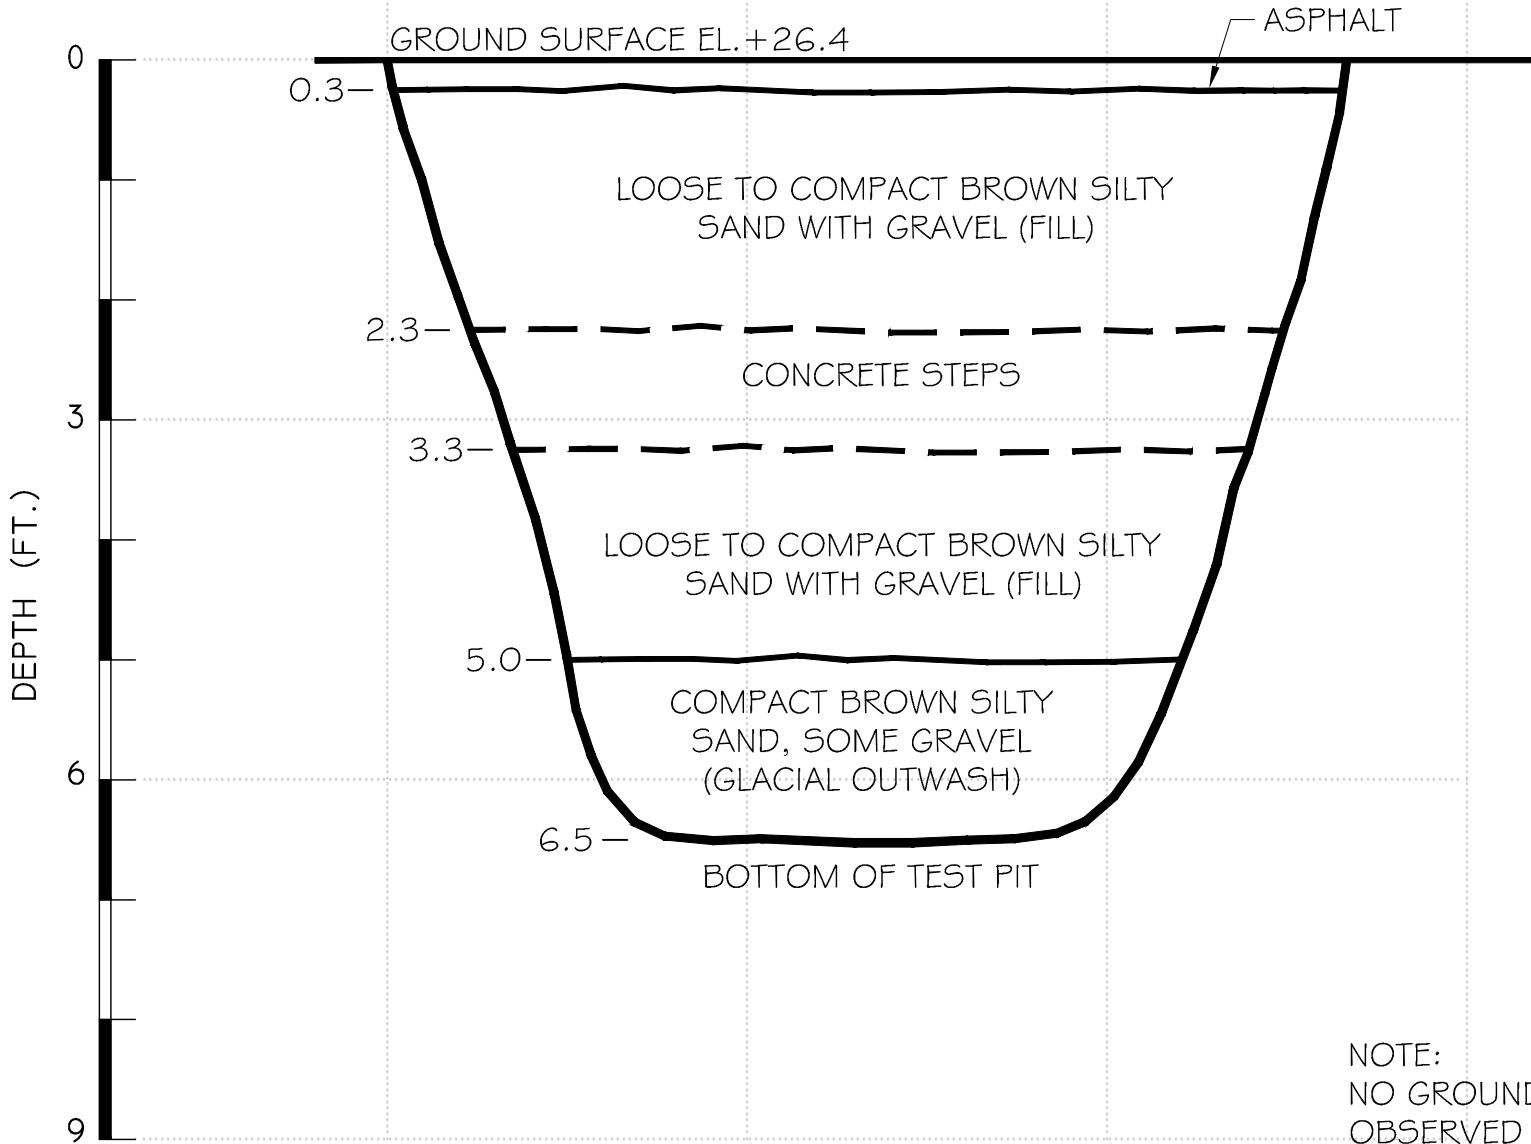

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 108

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +23.7

PAVEMENT

0.3

COMPACT TO DENSE LIGHT BROWN  
SANDY GRAVEL WITH SOME SILT  
(GLACIAL OUTWASH)

0

3

6

7.5

REFUSAL ON POSSIBLE BEDROCK

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 7.0 FEET  
UPON COMPLETION OF EXCAVATION





JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 109

0 3 6 9 FT.



GROUND SURFACE EL. +23.0

ASPHALT

0

0.3

LOOSE TO COMPACT BROWN SILT  
AND SAND WITH GRAVEL (FILL)

1.5

COMPACT GRAY TO BROWN REWORKED  
CLAYEY SILT, SOME FINE SAND (FILL)

3

3.0

COMPACT LIGHT BROWN  
SILTY SAND, SOME GRAVEL  
(GLACIAL OUTWASH)

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 110

NORTH ←

→ SOUTH

0 3 6 9 FT.

GROUND SURFACE EL. +22.2

ASPHALT

0.3

BROWN SILTY SAND WITH SOME GRAVEL (FILL)

1.0

COMPACT SLIGHT BROWN  
REWORKED CLAYEY SILT AND FINE  
SAND, TRACE GRAVEL (FILL)

3

4.5

COMPACT LIGHT BROWN SILT  
AND SAND, TRACE TO SOME  
GRAVEL (GLACIAL OUTWASH)

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION


JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 111



**McPHAIL ASSOCIATES, LLC**

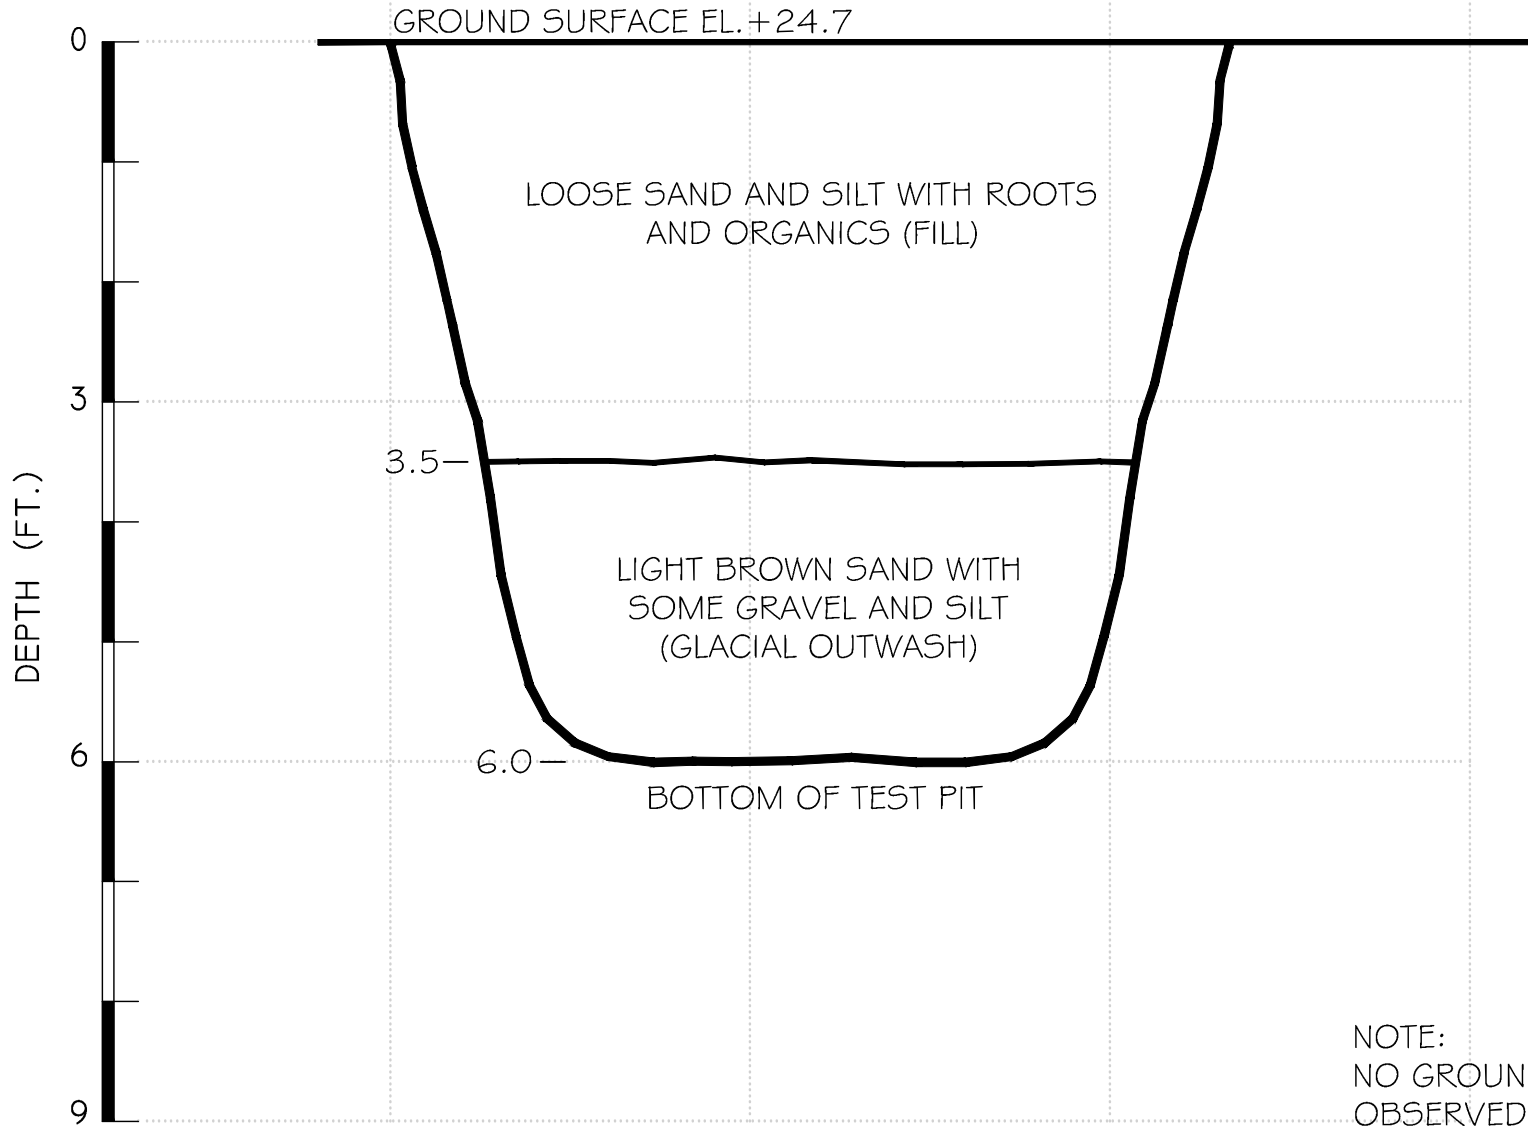

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 112

NORTH ←

→ SOUTH

0 3 6 9 FT.

GROUND SURFACE EL. +23.1

PAVEMENT

0

0.3

COMPACT BROWN SILT AND SAND WITH GRAVEL (FILL)

1.5

COMPACT GRAY SILTY SAND AND GRAVEL, TRACE CLAY (FILL)

3

ACTIVE 3/4" COPPER WATER LINE

4.5

SOFT BLACK ORGANIC SILT, TRACE CLAY (ORGANIC DEPOSIT)

5.5

FIRM BLUE CLAY (MARINE CLAY)

6

6.5

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC


NOTE:  
GROUNDWATER WAS OBSERVED IN TEST PIT AT A DEPTH OF 5.0 FEET UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019


# TEST PIT LOG

TEST PIT NO. 113

NORTH ←



0 3 6 9 FT.



→ SOUTH

GROUND SURFACE EL. +24.4

0

COMPACT DARK BROWN SILTY  
SAND AND GRAVEL (FILL)

2.5

COMPACT TO DENSE LIGHT BROWN SILT,  
SAND, AND A WELL-GRADED MIXTURE OF  
GRAVEL (GLACIAL OUTWASH)

3

3.8

BOTTOM OF TEST PIT

6

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC


NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 114

NORTH ←




0

3

6

9

FT.



SOUTH →

GROUND SURFACE EL. +24.3

PAVEMENT

0.3

COMPACT TO DENSE LIGHT  
BROWN SILT AND SAND, TRACE  
GRAVEL (GLACIAL OUTWASH)

0

3

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC


NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019


# TEST PIT LOG

TEST PIT NO. 115

NORTH ←



0 3 6 9 FT.



→ SOUTH

GROUND SURFACE EL. +22.9

0  
1.0  
LOOSE TO COMPACT BROWN SILTY, GRAVELLY SAND WITH WOOD AND BRICK (FILL)

3  
DENSE TO VERY DENSE LIGHT BROWN SILT AND SAND, TRACE TO SOME GRAVEL, TRACE CLAY (GLACIAL OUTWASH)

5.0  
BOTTOM OF TEST PIT

DEPTH (FT.)

0

1.0

3

6

9

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS OBSERVED IN TEST PIT UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG


TEST PIT NO. 116

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +18.4

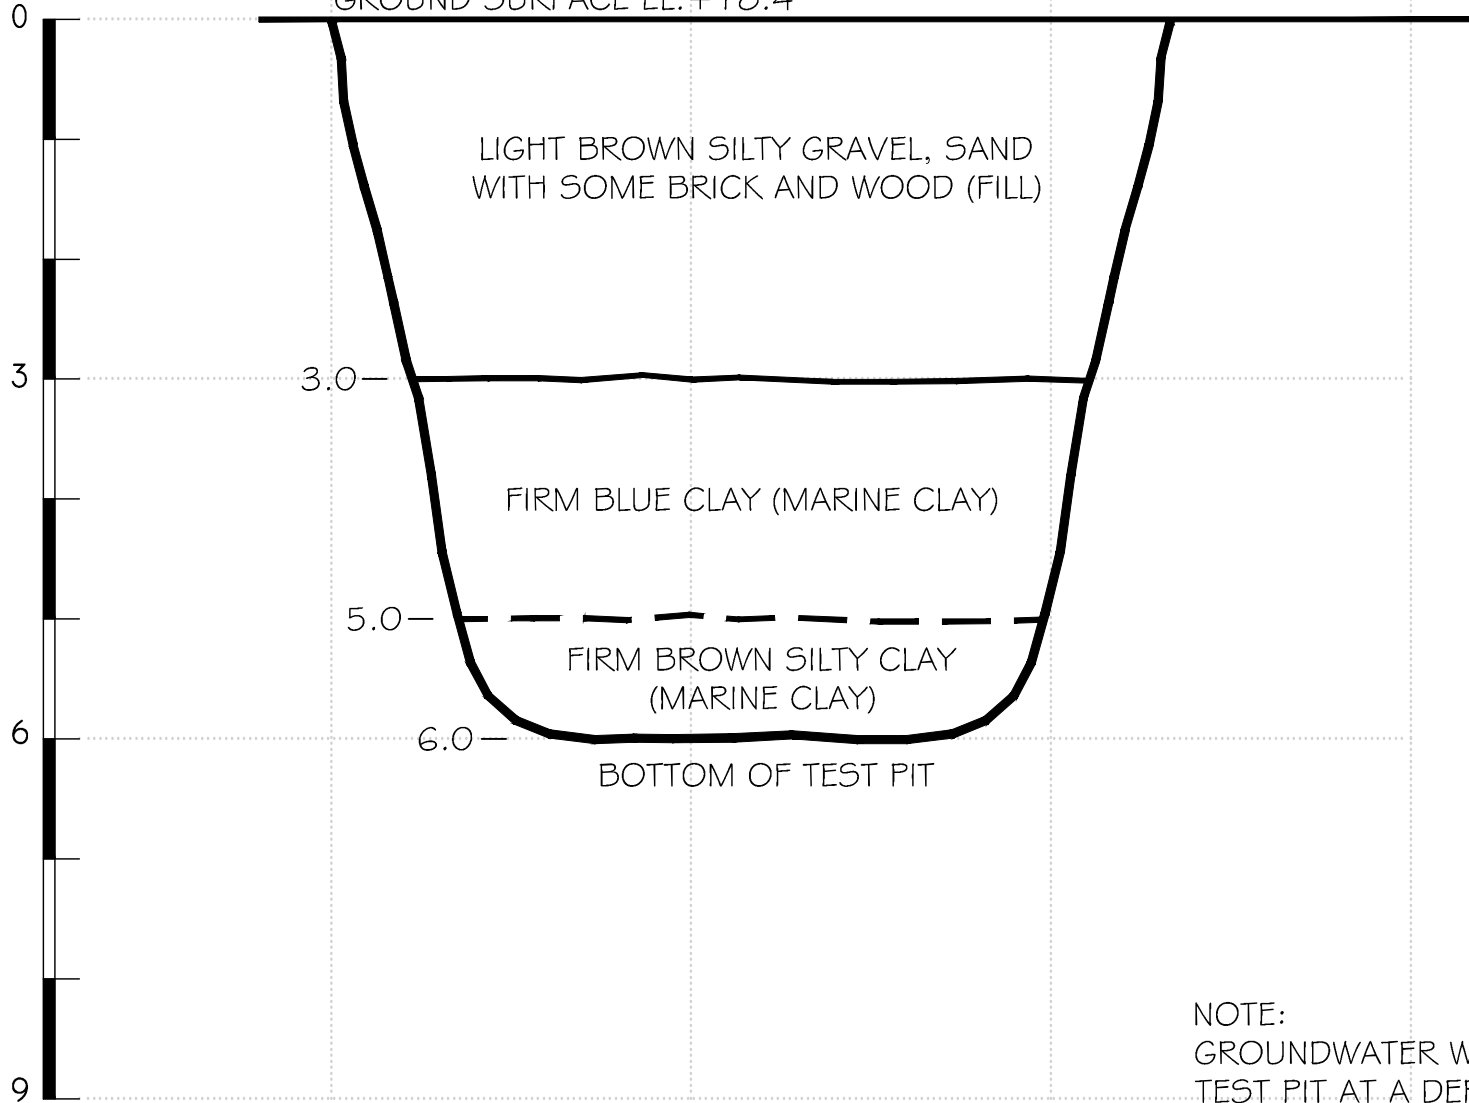

McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 6.0 FEET  
UPON COMPLETION OF EXCAVATION



JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 117

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +18.8

0

LIGHT BROWN SILTY SAND WITH GRAVEL,  
CONTAINING WOOD AND ASPHALT (FILL)

3

3.2

3.5

4.0

CONTINUOUS WOOD

SOFT BLACK ORGANIC SILT,  
TRACE GRAVEL AND SAND  
(ORGANIC DEPOSIT)

FIRM GRAY TO BLUE SILTY CLAY  
OBSERVED TO BE MORE SILTY  
WITH DEPTH (MARINE CLAY)

6

6.5

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 5.5 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 118

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +18.4

CONCRETE PAD

0.5

COMPACT BROWN-RED SILTY GRAVEL,  
SAND, TRACE WOOD AND BRICK (FILL)

3

3.0

DENSE GRAY TO BROWN  
SILTY CLAY (MARINE CLAY)

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 5.0 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG


TEST PIT NO. 119

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +17.2

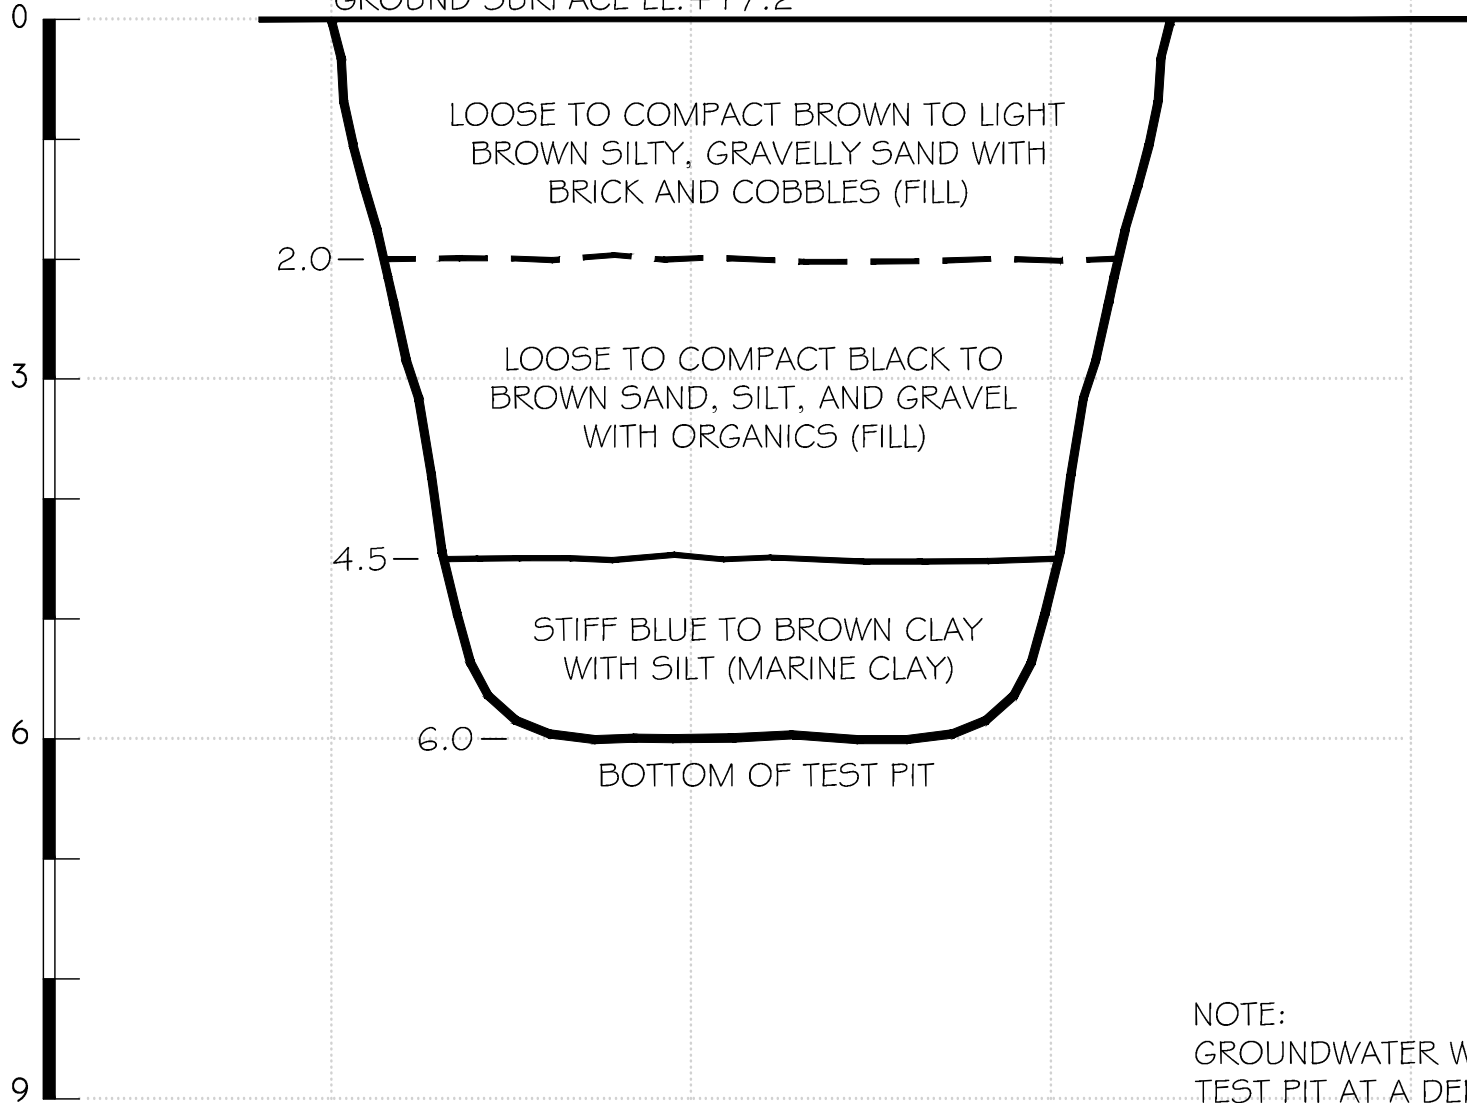

McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 5.5 FEET  
UPON COMPLETION OF EXCAVATION

Exploration	Depth (feet)	Strata	K at 20° C [cm/s]	K at 20° C [in/hr]	K at 10° C [cm/s]	K at 10° C [in/hr]
TP-102	3.5 to 7.5	Glacial Outwash	0.00034	0.48331	0.00026	0.37134
TP-105	0 to 7.5	Glacial Outwash	0.00082	1.15795	0.00063	0.89008
TP-107	4 to 6.5	Glacial Outwash	0.00061	0.86031	0.00047	0.66189
TP-108	0 to 7.5	Glacial Outwash	0.00245	3.47243	0.00188	2.66456
TP-109	3 to 6	Glacial Outwash	0.00037	0.52016	0.00028	0.39968
TP-110	4.5 to 6	Glacial Outwash	0.00129	1.82834	0.00099	1.40740
TP-111	3.5 to 6	Glacial Outwash	0.00069	0.97795	0.00053	0.75260
TP-113	1.25 to 3.75	Glacial Outwash	0.00046	0.64772	0.00035	0.49748
TP-115	1 to 5	Glacial Outwash	0.00030	0.42661	0.00023	0.32740



GOVE ENVIRONMENTAL SERVICES, INC.

TEST PIT DATA

Project : Cate Street  
 Client: Torrington Properties  
 GES Project No. 2018141  
 03/01/2019– Luke Hurley

<b>Test Pit No.</b>	<b>101</b>	Lot No.:				
ESHWT:	36"	WSPCD Group:				
Termination @	68"	Roots to:				
Refusal:	None	SCS Soil:			NA	
Obs. Water:	62"	HIS Type:			NA	
<b>Depth</b>	<b>Color</b>	<b>Texture</b>	<b>Structure</b>	<b>Consistence</b>	<b>Redox %</b>	<b>Horizon</b>
0-24"	FILL					NONE
24-36"	10YR 2/1	S	SG	FR		NONE
36-68"	2.5Y 3/1	FS	BLK	FI	15% 10YR	5/6

<b>Test Pit No.</b>	<b>102</b>	Lot No.:				
ESHWT:	32"	WSPCD Group:				
Termination @	90"	Roots to:				
Refusal:	None	SCS Soil:			NA	
Obs. Water:	70"	HIS Type:			NA	
<b>Depth</b>	<b>Color</b>	<b>Texture</b>	<b>Structure</b>	<b>Consistence</b>	<b>Redox %</b>	<b>Horizon</b>
0-20"	FILL					NONE
20-32"	2.5Y 4/4	FSL	GR	FR		NONE
32-90"	2.5Y 4/3	FS	BLK	FI	15% 10YR	5/6

<b>Test Pit No.</b>	<b>103</b>	Lot No.:				
ESHWT:	30"	WSPCD Group:				
Termination @	70"	Roots to:				
Refusal:	None	SCS Soil:			NA	
Obs. Water:	60"	HIS Type:			NA	
<b>Depth</b>	<b>Color</b>	<b>Texture</b>	<b>Structure</b>	<b>Consistence</b>	<b>Redox %</b>	<b>Horizon</b>
0-30"	FILL					NONE
30-48"	G2.5/10Y	SLCL	BLK	FR	10% 10YR	5/6
48-70"	2.5Y 4/4	FS	GR	FR	10% 10YR	5/6

<b>Test Pit No.</b>	<b>104</b>	Lot No.:				
ESHWT:	36"	WSPCD Group:				
Termination @	72"	Roots to:				
Refusal:	None	SCS Soil:			NA	
Obs. Water:	67"	HIS Type:			NA	
<b>Depth</b>	<b>Color</b>	<b>Texture</b>	<b>Structure</b>	<b>Consistence</b>	<b>Redox %</b>	<b>Horizon</b>
0-36"	FILL					NONE
36-60"	10YR 3/2	FSL	GR	FR	10% 10YR	5/6
60-72"	2.5Y 4/4	FS	GR	FR	15% 10YR	5/6

<b>Test Pit No.</b>	<b>105</b>	Lot No.:				
ESHWT:	24"	WSPCD Group:				
Termination @	80"	Roots to:				
Refusal:	None	SCS Soil:	NA			
Obs. Water:	74"	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-24"	FILL					NONE
24-80"	2.5Y 4/4	FS	BLK	FI	20% CON. & DEPL.	10YR 5/6

<b>Test Pit No.</b>	<b>106</b>	Lot No.:				
ESHWT:	18"	WSPCD Group:				
Termination @	86"	Roots to:				
Refusal:	None	SCS Soil:	NA			
Obs. Water:	86"	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-18"	FILL					NONE
18-48"	2.5Y 4/3	FSL	BLK	FI	25% 10YR	5/6
48-86"	2.5Y 4/4	FS	BLK	FI	20% 10YR	5/6

<b>Test Pit No.</b>	<b>107</b>	Lot No.:				
ESHWT:	36"	WSPCD Group:				
Termination @	80"	Roots to:				
Refusal:	None	SCS Soil:	NA			
Obs. Water:	NA	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-36"	FILL					NONE
36-46"	2.5Y 5/2	SL	BLK	FI	30% 10YR	5/6
46-80"	2.5Y 4/4	FS	BLK	FI	10% 10YR	5/6

<b>Test Pit No.</b>	<b>108</b>	Lot No.:				
ESHWT:	80"	WSPCD Group:				
Termination @	90"	Roots to:				
Refusal:	None	SCS Soil:	NA			
Obs. Water:	90"	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-24"	FILL					NONE
24-55"	10YR 4/6	FSL	GR	FR		
55-80"	10YR 3/4	FS	GR	FR		
80-90"	2.5Y 4/4	FS	BLK	FI	15% 10YR	5/6

<b>Test Pit No.</b>	<b>109</b>	Lot No.:				
ESHWT:	12"	WSPCD Group:				
Termination @	75"	Roots to:				
Refusal:	None	SCS Soil:	NA			
Obs. Water:	NA	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon

0-12"	FILL				NONE
12-42"	G2.5/10Y	SLCL	OM	FI	15% 10YR 5/6
42-75"	10YR 4/4	FS	GR	FR	15% 10YR 5/6

<b>Test Pit No.</b>	<b>110</b>	Lot No.:	
ESHWT:	10"	WSPCD Group:	
Termination @	70"	Roots to:	
Refusal:	None	SCS Soil:	NA
Obs. Water:	NA	HIS Type:	NA

Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-10"	FILL					NONE
10-48"	2.5Y 4/2	SLCL	OM	FI	35% 10YR 5/6	
48-70"	2.5Y 4/4	SLCL	OM	FR	25% 10YR 5/6	

<b>Test Pit No.</b>	<b>111</b>	Lot No.:	
ESHWT:	40"	WSPCD Group:	
Termination @	74"	Roots to:	
Refusal:	None	SCS Soil:	NA
Obs. Water:	NA	HIS Type:	NA

Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-12"	10YR 3/2	FSL	GR	FR		NONE
12-24"	2.5Y 4/2	SIL	BLK	FI		NONE
24-40"	2.5Y 4/3	FSL	GR	FR		NONE
40-74"	2.5Y 4/3	FS	SG	FR	25% 10YR 5/6	

<b>Test Pit No.</b>	<b>112</b>	Lot No.:	
ESHWT:	17"	WSPCD Group:	
Termination @	68"	Roots to:	
Refusal:	None	SCS Soil:	NA
Obs. Water:	62"	HIS Type:	NA

Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-17"	FILL					NONE
17-22"	G2.5/10Y	SLCL	BLK	FI	15% 10YR 5/6	
22-55"	2.5Y 2.5/1	SLCL	BLK	FI	15% 10YR 5/6	
55-63"	10YR 2/1	M	GR	FR	15% 10YR 5/6	
63-68"	G4/N	CL	BLK	FI	15% 10YR 5/6	

SEEP @ 42"

<b>Test Pit No.</b>	<b>113</b>	Lot No.:	
ESHWT:	NA	WSPCD Group:	
Termination @	42"	Roots to:	
Refusal: Ledge	42"	SCS Soil:	NA
Obs. Water:	NA	HIS Type:	NA

Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-14"	FILL					NONE
14-42"	2.5Y 4/4	FSL	GR	FR		NONE

<b>Test Pit No.</b>	<b>114</b>	Lot No.:	
ESHWT:	NA	WSPCD Group:	

Termination @	76"	Roots to:	NA			
Refusal:	None	SCS Soil:	NA			
Obs. Water:	NA	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-16"	FILL				NONE	
16-42"	2.5Y 4/4	FS	GR	FR	NONE	
42-76"	2.5Y 3/3	FS	GR	FR	NONE	

<b>Test Pit No.</b>	<b>115</b>	Lot No.:				
ESHWT:	30"	WSPCD Group:				
Termination @	62"	Roots to:	NA			
Refusal:	None	SCS Soil:	NA			
Obs. Water:	NA	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-30"	FILL				NONE	
30-62"	2.5Y 4/4	FSL	GR	FR	10% 10YR	5/6

<b>Test Pit No.</b>	<b>116</b>	Lot No.:				
ESHWT:	23"	WSPCD Group:				
Termination @	75"	Roots to:	NA			
Refusal:	None	SCS Soil:	NA			
Obs. Water:	75"	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-23"	FILL				NONE	
23-75"	2.5Y 4/2	SLCL	OM	FI	25% 10YR	5/6

<b>Test Pit No.</b>	<b>117</b>	Lot No.:				
ESHWT:	24"	WSPCD Group:				
Termination @	75"	Roots to:	NA			
Refusal:	None	SCS Soil:	NA			
Obs. Water:	65"	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-24"	FILL				NONE	
24-40"	FILL				15% 10YR	5/6
40-75"	2.5Y 4/2	SLCL	OM	FI	15% 10YR	5/6

<b>Test Pit No.</b>	<b>118</b>	Lot No.:				
ESHWT:	20"	WSPCD Group:				
Termination @	76"	Roots to:	NA			
Refusal:	None	SCS Soil:	NA			
Obs. Water:	68"	HIS Type:	NA			
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-20"	FILL				NONE	
20-76"	2.5Y 4/2	SLCL	OM	FI	20% 10YR	5/6

<b>Test Pit No.</b>	<b>119</b>	Lot No.:	
ESHWT:	30"	WSPCD Group:	
Termination @	70"	Roots to:	NA



Refusal:		None		SCS Soil:	NA	
Obs. Water:		60"		HIS Type:	NA	
Depth	Color	Texture	Structure	Consistence	Redox %	Horizon
0-30"	FILL				NONE	
30-70"	2.5Y 4/2	SLCL	OM	FI	20% 10YR	5/6





**FOUNDATION ENGINEERING REPORT**  
**WEST END YARDS**  
**PORTSMOUTH, NEW HAMPSHIRE**

**APRIL 16, 2019**

Prepared For:

Torrington Properties, Inc.  
60 K Street  
Boston, MA 02127

2269 Massachusetts Avenue  
Cambridge, MA 02140  
www.mcphailgeo.com  
(617) 868-1420

**PROJECT NO. 6524.2.00**



April 16, 2019

Torrington Properties, Inc.  
60 K Street  
Boston, MA 02127

Attention: Mr. Jay Bisognano

Reference: West End Yards; Portsmouth, New Hampshire  
Foundation Engineering Report

Ladies and Gentlemen:

This report documents the results of our subsurface exploration programs and foundation design study for the proposed West End Yards development project to be located in Portsmouth, New Hampshire. Refer to the Project Location Plan (**Figure 1**) for the general site location.

This report was prepared in accordance with our proposal dated November 26, 2018 and the subsequent authorization of Torrington Properties, Inc (TPI). These services are subject to the limitations contained in **Appendix A**.

### **Purpose and Scope**

The purposes of the subsurface exploration programs and foundation design study are to define the subsurface soil, rock, and groundwater conditions as they relate to foundation design and, based on these conditions, to provide engineering recommendations for safe and economical foundation design of the proposed development.

Foundation design includes foundation support of the proposed structures and their lowest level slabs, treatment of the lowest level slabs in consideration of groundwater, lateral earth pressures on foundation walls, and seismic design considerations in accordance with the provisions of the New Hampshire State Building Code, which is understood to be the 2009 International Building Code (IBC) with the City of Portsmouth amendments. Foundation construction considerations relating to geotechnical aspects of the proposed construction and pavement design criteria are also presented herein.

### **Available Information**

McPhail Associates, LLC (McPhail) prior involvement with this site included the preparation of the following documents:

- A report entitled "Phase II Environmental Site Assessment Report – Portsmouth Parcels" dated February 5, 2018;



- A memorandum entitled "Results of Test Pits Exploration – Cate Street Development" dated July 18, 2018;
- A report entitled "Phase I/II Environmental Site Assessment Report – West End Yards" dated February 18, 2019;
- A letter entitled "West End Yards Development Site – Subsurface Exploration Program" dated March 18, 2019;
- A report entitled "Initial Site Characterization Report – 55 Cate Street" dated March 20, 2019; and
- A memorandum entitled "Foundation Design Considerations" dated April 8, 2019.

Available information provided to McPhail included the following:

- A civil drawing set entitled "West End Yards – Cate Street" dated March 2019 and prepared by Fuss & O'Neill; and
- A 50-scale drawing entitled "Plan of Land" dated December 2016 prepared by Doucet Survey, Inc. (DSI).

Elevations cited herein are in feet and are referenced to the National Geodetic Vertical Datum of 1929 (NGVD 29).

### **Existing Conditions**

The subject site occupies an approximate 12-acre plan area fronting onto US Route 1 Bypass to the west and generally bounded by railroad tracks and an active construction site to the south-southeast and Hodgson Brook to the north-northeast. In addition, the site consists of five (5) contiguous parcels identified as 428 US Route 1 Bypass, 55 Cate Street, 161 Cate Street and Cate Street, and is divided by Cate Street.

In general, the site is occupied by several existing buildings consisting of a convention center, a storage/warehouse building and industrial/commercial buildings, a vacant residential house, an unattached garage, sheds, elevated loading ramp within central portion of the site, asphalt paved parking lots and landscape areas. Furthermore, it is understood that an existing sewer line with an invert at about Elevation +11 is crossing the central portion of the subject site.

Ground surface across the site generally slopes downward from southeast to northwest from approximately Elevation +26.6 to Elevation +21.6. In addition, within the Cate Street roadway located at the northern corner of the western portion of the site, ground surface varies from about Elevation +28 to Elevation +24.



## **Proposed Development**

It is understood that the proposed development includes the demolition of the existing buildings, relocation of Cate Street and the construction of three (3) multi-story buildings identified as the Commercial Building, Building A, and Building B. The approximate footprints of the proposed buildings are indicated on the enclosed **Figure 2**. Also, it is understood that several stormwater infiltration systems will be constructed as part of the site development. The remainder of the site is planned to consist of landscaped regions and paved parking areas and roadways.

The proposed new structures are understood to include the following:

Building B is planned to consist of a 4-story wood-framed building with an approximate 28,600 square-foot plan area. The building will be constructed at the northern portion of the site, in the area of the existing Cate Street that will be relocated during the construction. The lowest-level slab is proposed to be located at Elevation +27.8. The existing grade within the western portion of the proposed building ranges between Elevation +23.4 to Elevation +24.5, and within the eastern portion of the proposed building the existing grade is at Elevation +27.9. Therefore, up to about 4.4 feet of fill will need to be placed within the western portion of the building to raise the grade for construction of the proposed lowest level slab.

Building A is planned to consist of a 4-story wood-framed building with an approximate 36,600 square-foot plan area and it will be located within the central portion of the site. The lowest-level slab is proposed to be located at Elevation +26.8. Approximately 1.5 to 5.5 feet of fill will typically need to be placed to raise the grade for construction of the lowest level slab. Based on the available information provided to us, it is understood that the existing sewer line traversing the southern portion of the building will not be utilized for the new development and will be removed.

Commercial Building is planned to consist of a 2-story steel-framed structure occupying an approximate 22,630 square-foot plan area and it will be constructed within the western area of the site, partially within the footprint of an existing building that will be demolished. The lowest level slab is proposed to be constructed at about Elevation +26 which is about 1 to 3 feet above the existing grade. Based on our conversation with the project structural engineer, the maximum column load is estimated to be about 200 kips. In addition, it is understood that the existing sewer line located north of the proposed building will remain in service. It is understood that the location of the Commercial Building has not been finalized and it may be located south of the location described herein.

## **Recent Subsurface Exploration Program**

During the period of March 1 through 5 and 11 through 18, 2019, a subsurface exploration program consisting of twenty-six (26) borings (B-101 to B-104, B-106 to B-119, B-122 and B-123) and nineteen (19) test pits (TP-101 to TP-119) was completed at the project site by



McPhail. Approximate plan locations of the explorations are indicated on the enclosed Subsurface Exploration Plan, **Figure 2**. Generalized subsurface sections are present on **Figure 3**.

The borings were performed by Carr-Dee Corp. (Carr-Dee) of Medford, Massachusetts under contract to McPhail. The borings were drilled to depths ranging from 3 to 18.5 feet below existing grade and were typically terminated within the natural glacial deposits or possible bedrock. The borings were performed using a truck-mounted drill-rig and advanced utilizing 2-1/4-inch hollow stem augers. Standard 2-inch O.D. split-spoon samples and standard penetration tests were obtained at minimum 5-foot intervals of depth in accordance with the standard procedures described in ASTM D1586. Recent boring logs prepared by Carr-Dee are contained in **Appendix B** following the text of this report.

The test pits were performed by P.K. Brown Construction of Portsmouth, New Hampshire under contract to McPhail. The test pits extended to depths ranging from 3.8 to 7.5 feet below ground surface. The test pits were performed with a 314 CAT excavator. Test pit logs prepared by McPhail are contained in **Appendix C** following the text of this report.

The explorations were monitored by a McPhail field representative who performed field layout, prepared field logs, obtained and visually classified soil samples, monitored groundwater conditions in the open explorations, and determined the required exploration depths based upon the actual subsurface conditions encountered.

Field locations of the borings and test pits were determined by taping from existing site features included on the above-referenced existing conditions plan prepared by DSI. The existing ground surface elevation at each exploration location was determined by a level survey performed by our field staff utilizing vertical control information on the above-referenced existing conditions plan by DSI.

### **Previous Subsurface Exploration Programs**

In addition to the subsurface exploration program described above, the following previous subsurface exploration programs as indicated on the enclosed Subsurface Exploration Plan, **Figure 2**, were performed at the site:

- Three (3) borings (B-1 through B-3) performed at the site on December 10, 2018 by Carr-Dee under contract to McPhail. The boring logs prepared by McPhail are enclosed in **Appendix D**.
- Four (4) test pits (TP-1 through TP-4) were conducted at the site on June 21, 2018 by Severino Trucking, Co. Inc. (STC) under contract to others. The test pit logs prepared by McPhail are enclosed in **Appendix E**.



- Fifteen (15) geoprobes (GP-1 through GP-15) were conducted at the site on January 19 and 22 2018 by Technical Drilling Services, Inc. (TDS) under contract to McPhail. The geoprobe logs prepared by McPhail are contained in **Appendix F**.

### **Laboratory Testing**

At the completion of the subsurface exploration programs, soil samples were returned to our laboratory for more detailed classification, analysis, and testing. The laboratory testing consisted of sieve analyses to determine the grain size distribution and confirm the visual classifications of the fill and glacial outwash deposits. Laboratory test procedures were in general accordance with applicable ASTM Standards. Results of the sieve analyses for the fill material appear on **Figure 4, Figure 5** and **Figure 6**. Results of the sieve analyses for the glacial outwash deposit appear on **Figure 7, Figure 8, Figure 9** and **Figure 10**.

### **Subsurface Conditions**

A detailed description of the subsurface conditions encountered in the borings, geoprobes and test pits is documented on the logs contained in **Appendix B** through **Appendix F**. It should be noted that not all strata, as described below, were encountered at all exploration locations. Note that the descriptions of the soil strata are primarily based on the visual observations of soil samples obtained from the test pits, geoprobes and borings.

- Fill: Loose to very dense, brown to dark brown, sand and gravel, with trace to some silt, varying to a well-graded mixture of silt, sand and gravel, also containing varying amounts of brick. Grain size distributions of samples of the fill deposit are presented on the enclosed **Figure 4, Figure 5** and **Figure 6**.
- Organic Deposit: Soft to stiff, brown to black, organic silt with some sand and clay and trace peat fibers.
- Marine Clay Deposit: Yellow to blue, silty clay transitioning with depth from very stiff to very soft. Based on our experience on nearby projects and from our review of published information about the Portsmouth clay deposit, the undrained shear strength of the marine clay is anticipated to vary from about 250 to 400 pounds per square-foot (psf). Furthermore, the marine clay deposit is anticipated to be slightly over-consolidated.
- Glacial Deposits:
  - Glaciomarine Deposit: Compact, gray, silty sand, some gravel varying to silty sand and gravel with pieces of weathered bedrock.
  - Glacial Outwash: Compact to very dense, gray, sand and gravel, with trace to some silt, varying to a well-graded mixture of sand, gravel and silt. Grain size distributions of samples of the glacial outwash deposit are contained on the enclosed **Figure 7, Figure 8** and **Figure 9**.





- Possible Bedrock: Based on the published United States Geological Survey (USGS) bedrock maps for the general area of the site, bedrock is anticipated to be associated with the Kittery Formation and consist of metasandstone and phyllite.
- Groundwater: Where groundwater was encountered within the recent explorations, it was observed to range from 4 to 11 feet below ground surface corresponding to Elevation +19.9 to Elevation +14.1 with a general downward gradient from south to north. Groundwater was observed within five (5) accessible installed wells (GP-5, GP-6, GP-10, GP-13, and GP-15) to range from 2.8 to 8.3 feet below the existing ground surface corresponding to Elevation +21.8 to Elevation +15. Other installed wells at the site were not accessible due to snow or ice or they were demolished. Groundwater Monitoring Reports are enclosed in **Appendix G**. It is anticipated that future groundwater levels across the project site may vary from those reported herein based on such factors such as normal seasonal changes, runoff during or following periods of heavy precipitation and alterations to existing drainage patterns.

The following is a description of the subsurface conditions encountered from ground surface downward within the vicinity of each proposed new structure. Elevations corresponding to the surface of the natural marine or glacial outwash deposit noted below are also presented on **Figure 2**. In addition, a generalized subsurface section through each structure is indicated on the enclosed Generalized Subsurface Sections A-A, B-B and C-C, **Figure 3**.

**Building B:** Underneath the surface treatments, generally the explorations encountered a layer of fill material which ranged from 0.7 to 3.5 feet in thickness. The explorations performed within the western portion of the building encountered a glacial outwash deposit below the subsurface improvements or fill material at depths ranging from about 0.5 to 4 feet below ground surface corresponding to Elevation +23.4 to Elevation +21.6. Boring B-108 performed within the east end of the proposed building encountered a 3-foot thickness of firm marine clay at a depth of 4 feet below ground surface which corresponds to Elevation +23.9. Each boring conducted within the footprint of this building encountered refusal on possible boulders or bedrock at depths ranging between 3 to 10.7 feet below ground surface corresponding to Elevation +20.4 and Elevation +13.8. Groundwater was observed to vary from 7 to 9.5 feet below ground surface corresponding to Elevation +20.9 to Elevation +15.

**Building A:** Underlying the asphalt surface treatment, the explorations encountered a layer of fill material which ranged from 3.7 to 14.2 feet in thickness. The fill was typically thinner within the eastern portion of the proposed building footprint. Below the fill material, the explorations encountered a compact to very dense glacial outwash deposit below an uncontrolled fill material at depths ranging from about 4 to 14.5 feet below ground surface. In general, the surface of the natural glacial deposit in the explorations was observed to vary from about Elevation +15.1 to Elevation +23.2 with the exception of at boring B-110 where it was observed to be at Elevation +9. Groundwater was observed to range from 7 to 9.5 feet below ground surface corresponding to Elevation +18.3 to Elevation +14.2.



**Commercial Building:** Borings B-101 through B-104 were performed in the direct vicinity of the proposed Commercial Building. Within these borings, an uncontrolled fill material extends to depths from 5 to 7 feet below ground surface corresponding to Elevation +19.7 to Elevation +17.8. Below the fill material, a 0.5 to 1-foot thickness of an organic deposit was encountered within the northwest corner of the proposed building footprint in borings B-101 and B-102. A natural inorganic marine clay deposit was encountered below the fill and/or organics within the western portion of the building in borings B-101, B-102 and B-104 at elevations ranging from +17.9 to +19.2. The upper portion of the marine clay deposit was generally observed to consist of a very stiff silty clay. Within borings B-101 and B-104, which were performed on the north side of the building, the consistency of the clay transitioned with depth to very soft. The total thickness of the marine clay deposit, where penetrated, ranges from 4 to 13 feet. Directly below the fill within the eastern portion of the building and below the marine clay in the western portion of the building, the explorations encountered a compact to very dense glacial deposit at depths ranging between 5 to 18.5 feet below ground surface corresponding to Elevation +17.8 and Elevation +6.2. Groundwater was observed to vary from 4 to 11 below ground surface corresponding to Elevation +19.9 to Elevation +14.1.

### **Foundation Design Recommendations**

Based on our current understanding of the proposed development and the anticipated subsurface conditions, foundation support for the proposed development is recommended to consist of conventional spread footing foundations in conjunction with soil-supported slabs-on-grade. In consideration of the various footing support conditions as described below, it is recommended for continuity that the footings be proportioned utilizing a maximum design bearing pressure of two (2) tons per square-foot (tsf). The use of higher allowable bearing pressures may be feasible subject to further understanding of the proposed structural loads and the selection of the footing support method. Detailed recommendations for each building are presented below as well as recommendations in consideration for the lowest-level slabs and general foundation recommendations.

#### **Building B**

The surface of the natural glacial or marine clay deposit within Building B varies from Elevation +23.4 to Elevation +23.9. In consideration that the proposed lowest level slab will be at Elevation +27.8, it is anticipated that the surface of the natural inorganic deposits will either be slightly above or below the design bottom of footing elevation. As such, for Building B it is recommended the spread footings bear directly on the natural marine clay, glacial deposit or bedrock, or on compacted structural fill placed over the natural marine clay, glacial deposit or bedrock.

The lowest level slab should be designed as a conventional slab-on-grade bearing on the existing fill subject to proof-compaction as described below.



The lateral limits of the excavation for footings supported on structural fill should extend beyond the outside edges of the footing a horizontal distance equal to the distance between the bottom of the proposed footing and the surface of the underlying natural glacial or marine clay deposit, plus two feet in every plan direction. Depending on the final configuration of the proposed footings, it may be more efficient for the earthwork contractor to remove all the existing fill material from the proposed building footprint and the lateral limits for structural fill discussed above and replace it with compacted structural fill.

Structural fill placed for support of the spread footings and slab-on-grade should consist of suitable on-site fill or glacial outwash or an off-site gravel borrow consisting of well-graded, natural sand and gravel containing less than 8 percent passing the No. 200 sieve. All structural fill placed within the footprint of the proposed buildings should be placed in lifts having a compacted thickness of 6 inches and be compacted to a minimum of 95 percent of its maximum modified Proctor dry density. The placement and compaction of structural fill should be monitored by a registered design professional or his designated representative in accordance with the provisions of the Code. Reuse of the on-site soil is discussed in more detail in the "Foundation Construction Considerations" section of this report.

### **Building A**

As indicated above, the surface of the natural glacial deposit in Building A was observed to vary from about Elevation +15.1 to Elevation +23.2 with the exception of at boring B-110 where it was observed to be at Elevation +9. Therefore, in consideration that the proposed lowest level slab will be at Elevation +26.8, it is anticipated that the surface of the natural glacial deposits will be slightly above or up to about 14 feet below the design bottom of footing elevation.

As such for Building A it is recommended that the spread footings bear directly on the glacial outwash, on compacted structural fill or lean concrete placed over the glacial deposit, or on fill that is improved by aggregate piers (APs) ground improvement method. We recommend that the specific building pad preparation method be based on economic conditions at the time the project is bid for construction.

The use of APs would allow for the utilization of conventional spread footing construction without requiring overexcavation of the existing uncontrolled fill or significant dewatering. The structural design of footings support on soil improved by ground improvement methods would be the same if structural fill or lean concrete were used to replace unsuitable soils. If utilized, the APs for Building A can be ungrouted and would extend to the top of the glacial outwash deposit and would likely range up to about 18 feet in length. Recommendations for APs are contained below and recommendations for Structural Fill are contained above.

The lowest level slab of the proposed building should be designed as a conventional slab-on-grade bearing on the existing fill subject to proof-compaction described below and/or on AP improved site soils.



As an alternative to placement of structural fill or ground improvement in areas where the fill deposit is thicker, proposed footings may be supported on lean concrete placed on the surface of the natural glacial deposit. Lean concrete placed for support of the spread footings should have a minimum design compressive strength of 1,000 pounds per square-inch. The limits of the excavation for lean concrete placement should extend beyond the outside edge of the footing for a minimum horizontal distance of 6 inches. The excavation required for the placement of lean concrete is anticipated to be performed within a trench box which should minimize the size of the over-excavation and, hence, will generate less excess soil in comparison with the excavation required for the placement of structural fill.

### **Commercial Building**

As described above, a natural inorganic marine clay deposit building was encountered below the fill and/or organics within the western portion of the building. Directly below the fill within the eastern portion of the building and below the marine clay in the western portion of the building, the explorations encountered a compact to very dense glacial deposit at depths ranging between 5 to 18.5 feet below ground surface corresponding to Elevation +17.8 and Elevation +6.2.

In consideration of the anticipated low shear strength of the marine clay deposit, utilization of footings bearing on the marine clay deposit without ground improvement would require the use of a low bearing pressure and may lead to unacceptable differential settlement. Therefore, ground improvement is recommended to be installed in order to construct conventional footings. Also, due to the close proximity of the existing sewer line along the north side of the proposed building, ground improvement consisting of rigid inclusions (RIs) would need to be installed in the vicinity of the sewer pipe to avoid transfer of the proposed footing load to the existing sewer. Elsewhere, grouted aggregate piers should be installed below the proposed footings.

It is noted that moving the proposed building footprint to the south may result in the elimination of the RIs. Furthermore, if the organic and soft clay deposit are not present below the building, then utilization of ungrouted APs or the elimination of ground improvement may be feasible.

Typically, APs installed through organic and soft clay soils for footing support are grouted from the bottom of the pier to the top of the compressible deposit in order to minimize the anticipated amount of settlement of the footing to an acceptable amount. This would also allow the construction of footings supported on grouted APs shortly after installation of the APs (before consolidation settlement of the organic and marine clay deposit is complete).

In order to raise the grade to slab subgrade, approximately 1 to 3 feet of fill will need to be placed across the building footprint which will induce settlement of the underlying compressible organic and marine clay soils that are typically present in the western portion of the building. It is recommended that ungrouted APs be utilized in a grid layout beneath the proposed slab to facilitate conventional, slab-on-grade construction. The installation of



the ungrouted APs beneath the slab-on-grade is anticipated to provide drainage paths shortening the time required for consolidation settlement of the building pad to occur.

APs and RIs should be installed through the existing fill, organic and marine clay deposit into the underlying glacial deposit to provide continuity of bearing across the building footprint. Based on the results of the explorations, the APs and RIs would likely range up to about 8 to 20 feet in length. Recommendations for ground improvement are contained below.

Also, with the use of APs, ordinary fill can be used in lieu of structural fill to raise the grade within the building footprint. Ordinary fill generally costs less than structural fill to import and since the compaction requirements for ordinary fill are less, it can generally be placed more quickly. Ordinary fill should be placed in maximum 12-inch thick loose lifts and compacted to a minimum of 92 percent of its maximum modified Proctor dry density.

### **Rigid Inclusions (RIs) and Aggregate Piers (APs)**

RIs and APs are two (2) common ground improvement methods installed to improve the density and stiffness of existing soils. Ground improvement methods would densify the existing fill and increase the lateral stress in the soil matrix beneath the proposed building foundations. Thus, the uncontrolled existing fill soils, organics, and/or marine clay would be improved to a stiffer composite soil matrix allowing the use of footing foundations by minimizing settlement to within acceptable limits.

RIs are constructed by advancing a hollow mandrel to the design depth, densifying the surrounding soils by displacement. Once reaching the design depth, concrete is pumped through the mandrel, which opens as it is raised. If required, the mandrel can be raised and lowered several times, vertically ramming lifts of concrete to create an expanded base. The RI elements are typically installed in a grid pattern and are used in conjunction with an engineered granular pad to produce an intermediate foundation system for support of foundation loads. The type and thickness of the engineered pad is dependent on the design bearing pressure and is designed by the RI design-build consultant.

In general, for APs an aggregate pier cavity is created by driving a specially designed 12- to 16-inch diameter mandrel and tamper foot using a large static force augmented by dynamic vertical impact energy. A sacrificial plate is placed at the bottom of the tamper foot to prevent soil from entering the mandrel during installation. This method of advancement minimizes drill spoils as penetrated soils are displaced laterally. After installation to the design depth, coarse aggregate is placed inside the mandrel and the mandrel is lifted, leaving the sacrificial plate at the bottom of the cavity. Typically, the tamper foot is lifted approximately four feet and then driven and vibrated back down three feet, forming a one-foot thick compacted lift of approximately 20 inches in diameter. This process is repeated to the top of the cavity, forming the completed aggregate pier.

Since ground improvement techniques are provided by a design-build consultant, detailed design calculations should be submitted to the Architect and design team for review prior to the beginning of construction. A detailed explanation of the design parameters for capacity



and settlement calculations should be included in the design submittal. The design submittal should also include a testing program to demonstrate the capacity of the elements. In addition, the submittal should illustrate that loads from the proposed Commercial Building are not shed onto the existing sewer. All calculations and drawings should be prepared and sealed by a Professional Engineer who is licensed in the State of New Hampshire, and is retained by the Contractor who is to perform the work.

The following general criteria should be utilized in the design of the rigid inclusions and aggregate piers:

1. Rigid inclusions and aggregate piers should extend at least to the surface of the natural glacial deposit;
2. Estimated long-term settlement for footings and slabs should be less than 1-inch;
3. Estimated long-term differential settlement of adjacent footings should be less than 1/2-inch; and
4. Modulus load tests should be performed on a selective RI and AP to a minimum of 150 percent of the maximum design stress.

### **Slab Recommendations**

The lowest level slab of the proposed buildings should be designed as a conventional slab-on-grade bearing on the existing fill subject to proof compaction or on AP improved site soils. As indicated above, APs are recommended, at a minimum, to support the slab-on-grade of the Commercial Building, and are also recommended to be considered for slab support of Building A due to the presence of a loose fill layer.

Frequent control joints should be employed in the lowest level slabs to reduce the potential for cracking. Some future cosmetic settlement of the slab should be anticipated due to the heterogenous fill deposit. The future settlements may cause some minor dishing and cracking of the slabs possibly requiring future repair. Slabs-on-grade bearing on AP-improved soils would minimize potential future settlement of the slab.

The lowest level slab of the occupied building area should be underlain by a polyethylene vapor barrier spread across the surface of a 9-inch minimum thickness of off-site gravel borrow. See below **Radon Ventilation System** section of the report for additional recommendations.

It is understood that the lowest level slabs will be constructed roughly coincident with, or slightly above, proposed finished grades. Therefore, the lowest level slabs and foundation walls are not considered to require underslab and perimeter foundation drainage, respectively.





All localized depressions in the lowest level slabs extending below grade (such as elevator pits, etc.) should be provided with properly tied continuous waterstops in all construction joints and cementitious waterproofing to protect against groundwater intrusion. Depressions in the lowest level slabs should be designed to resist a hydrostatic uplift pressure resulting from the groundwater being present at the 100-year design flood elevation.

In the event that APs are not installed below the proposed slabs, the existing uncontrolled fill exposed at the slab subgrades should be proof compacted with a minimum of six passes of a 10-ton vibratory drum roller prior to the placement of structural fill. After the proof compaction, all soft and/or weaving subgrade areas should be removed and replaced with compacted structural fill. Additionally, structural fill should be used to raise the proposed grade below the proposed slabs unless APs are used.

Where construction of the proposed lowest level slab for the Commercial Building requires the placement of fill above existing site grades, the fill will induce settlement of the underlying compressible organic and marine clay soils. The magnitude of settlement and time required for settlement to occur is dependent upon the soil conditions and soil properties, including such factors as the thickness of the organics and marine clay, the stress history of the deposits, the in-situ vertical effective stress, and the compressibility parameters of the deposits. Our preliminary analysis indicates that the placement of 1 to 3 feet of fill could result in approximately 1 to 3 inches of settlement.

As the APs installed for support of the slab-on-grade are anticipated to be ungrouted, these APs would provide drainage paths shortening the time required for consolidation settlement of the building pads to occur. Alternatively, wick drains could be used to expedite the consolidation process. In addition, the magnitude of post-construction settlement could be reduced by preloading. Preloading generally involves placing a height of fill above the proposed finished grade for a period of time prior to construction. The height of the preload should, at a minimum, be about 1-foot above the proposed finished grade. The preload stresses in the soil would be greater than those which would exist after construction is completed, thereby reducing post-construction settlements.

Prior to construction of the slab-on-grade for the Commercial Building, the observed rate of settlement with time will need to have decreased sufficiently to minimize the future settlement of the slab. Settlement of the building pad should be monitored and slab-on-grade should not be constructed until an acceptable magnitude of settlement has occurred. Specifically, this occurs when settlement has either stopped or when the time rate of settlement is very small.

A detailed settlement analysis should be performed once the proposed building details are finalized (i.e. footing layout, structural loads, floor finishes, etc.). This information in conjunction with additional site-specific subsurface information (i.e. further delineation of where the organics and soft clay are present, consolidation testing to determine soil parameters for settlement analysis) would allow the total amount of settlement and time for



the settlement to occur to be further estimated. Further, the settlement analysis could be used to evaluate the effectiveness of various preloading scenarios.

### **General Foundation Recommendations**

All foundations should be designed in accordance with the requirements of the Code.

Recommended minimum footing widths for continuous and isolated spread footings are 24 and 36 inches, respectively. All perimeter foundations and interior foundations located adjacent to unheated areas should be provided with a minimum 4-foot thickness of soil cover as frost protection. Interior footings below heated areas should be located such that the top of the foundation concrete is at least 6 inches below the underside of the lowest level slab. Additionally, all foundations should be located such that they are below a theoretical line drawn upward and outward at 2 to 1 (horizontal to vertical) from the bottom exterior edge of all adjacent footings, structures and utilities.

Below-grade foundation walls receiving lateral support at the top and bottom (i.e. restrained walls) should be designed for a lateral earth pressure corresponding to an equivalent fluid density of 60 pounds per cubic foot (pcf). Similarly, drained cantilevered retaining walls, (i.e. receiving no lateral support at the top) should be designed for a lateral earth pressure corresponding to an equivalent fluid density of 40 pcf. To these values must be added the pressures attributable to earthquake forces per the Code.

Lateral forces can be considered to be transmitted from the structure to the soil by passive Pressure against the perimeter foundation walls utilizing an equivalent fluid density of 120 pounds per cubic-foot providing that the foundation walls are designed to resist these pressures. Lateral force can also be considered to be transmitted from the structure to the soil by friction on the base of footings using a coefficient of 0.4, to which a safety factor of 1.5 should be applied.

### **Radon Ventilation System**

We recommend the installation of a sub slab radon ventilation system within each of the proposed structures. The radon ventilation system should consist of 4-inch diameter perforated PVC pipe laid flat with its invert located 12 inches below the bottom of the lowest level slabs surrounded by 6 inches of  $\frac{3}{4}$ -inch crushed stone and filter fabric. The radon systems should include vertical riser pipe, consisting of solid PVC pipe within the interior of the building. It is anticipated that this system could be designed as a passive radon mitigation system which could be converted to an active mitigation system in the future, if required.





### **Seismic Design Considerations**

For the purposes of determining parameters for structural seismic design, the following are the recommended Site Classes for the various buildings as defined in Section 1613.0 of the Code:

- Building B: Site Class C
- Building A: Site Class D
- Commercial Building: Site Class E

Further, the bearing strata on the site is not considered to be subject to liquefaction during an earthquake based on the criterion of Section 1806.4 of the Code.

### **Pavement Design Criteria**

Preparation of the subgrade for all paved areas should first consist of stripping all existing asphalt and surficial topsoil, if encountered. The existing granular fill, where encountered, may remain in place below the base course materials provided it is proof-compacted with a minimum of six passes of a 10-ton vibratory drum roller prior to placement of gravel borrow to raise grades. All soft, spongy or "weaving" areas observed during the proof compaction should be cut-out and replaced with compacted gravel borrow.

Portions of the site contain compressible organic and/or marine clay soils which could consolidate causing surface settlement depending on the height of fill to be placed. The proposed grading plan will need to be reviewed in conjunction with the available subsurface information to determine what the potential settlement-related impacts area and what, if any, remediation measures should be taken. If remediation is required, preloading could be considered to reduce the amount of post-construction settlement and/or a woven geotextile fabric, such as Mirafi 270HP or equal, could be placed to potentially lessen the impacts of settlement on the paved surfaces.

The base and subbase layers should be placed in lifts having a compacted thickness of 6 inches and be compacted to a minimum of 95 percent of its maximum modified Proctor dry density.



The following are the recommended minimum flexible pavement sections:

<b>Flexible Pavement Sections</b>			
<i>Layer</i>	<i>NHDOT Material Specification</i>	<i>Standard-Duty [Passenger Car Parking] Thickness (Inches)</i>	<i>City Right-of-Way and High Traffic or Truck Areas Thickness (Inches)</i>
Bituminous Concrete Wearing Course	Section 401 Wearing Course	1.5 [Type E]	1.5 [3/8" Superpave]
Bituminous Concrete Binder Course	Section 401 Binder Course	1.5 [Type B]	2.5 [3/4" Superpave]
Base Course	Item No. 304.3 "Crushed Gravel"	6	12
Subbase	Item No. 304.2 "Gravel"	12	12

The heavy-duty pavement section is recommended to be used in the main drive/access lanes and the standard-duty pavement should be used in vehicle parking areas. Furthermore, a rigid concrete pavement section could alternatively be used to provide suitable support at areas of high traffic or severe turns, such as at trash enclosures.

The pavement design recommendations contained herein are contingent upon proper drainage and surface water control being provided.

**Foundation Construction Considerations**

The primary foundation construction considerations include the removal of existing site structures and utilities, removal of obstructions to AP/RI installations, vibration monitoring during AP/RI installation, foundation bearing surface preparation, reuse of on-site soils, construction dewatering, and off-site removal of excess excavated soil.

Prior to construction of the proposed buildings, it is recommended that all existing structures, foundation remains and utilities within the footprint of the proposed buildings be removed in their entirety. A minimum of ten (10) feet outside the footprint of the proposed buildings, abandoned structures and utilities may be cut off and removed to a depth of at least 2 feet below finished grades or proposed utilities and backfilled with compacted ordinary fill.



Obstructions to AP/RI installation encountered in the fill material should be removed by the earthwork contractor. Obstructions that prevent continued installation at a particular AP or RI location should be evaluated on a case-by-case basis to determine the necessity to remove the obstruction or to design the footing to span over the obstruction.

Ground vibrations are produced as a result of the ground improvement installation procedures. Based on our experience, impacts from these vibrations are not anticipated to result in structural damage to existing, adjacent structures, however, the magnitude of vibrations may be of sufficient magnitude to cause cosmetic cracking of adjacent structures and annoyance of occupants. It is not anticipated that ground vibrations caused by construction will cause damage to nearby structures. However, due to the proximity of the adjacent buildings to the site, it is recommended that preconstruction surveys of adjacent buildings and below-grade utilities be completed before the start of construction and that vibration monitoring be performed during the ground improvement installation activities.

The final excavation of the footing subgrades should be accomplished using an excavator that is equipped with smooth-edged bucket to avoid disturbance of the bearing surface. Further, it is recommended that foundation bearing surfaces be immediately covered with a minimum 3-inch thickness of compacted 3/4-inch crushed stone to prevent disturbance of the subgrade during subsequent forming operations and construction traffic.

It is anticipated that portions of the excavated soils may be re-used on-site as ordinary fill and structural fill, provided they are maintained in a dry condition and can be properly compacted. Excavated fill and glacial outwash soil to be reused on-site as structural fill should typically contain less than 30% by weight passing the No. 200 sieve. Excavated soil with greater than 30% by weight passing the No. 200 sieve should be segregated and can be reused on-site as ordinary fill subject to the provisions contained herein.

Grain size distributions of representative samples of the fill material indicate that the fines content ranges from about 1.5 to 32 percent. In addition, grain size distributions of representative samples of the glacial outwash deposit indicate that the fines content ranges from about 18 to 36 percent. It is emphasized that excavated material will become unsuitable for re-use if it becomes too wet. Therefore, it is recommended that stockpiles of excavated material intended for reuse be protected against increases in moisture content by securely covering the stockpiles at all times with 6-mil polyethylene for protection from precipitation and also as a dust mitigation measure. The placement and compaction of on-site material should be completed during relatively dry and non-freezing conditions. If, due to any of the above conditions, the excavated material is unsuitable for reuse, an off-site gravel borrow should be used.

Proper control of groundwater and surface water will be necessary to maintain a firm subgrade to support construction traffic and to complete the construction in-the-dry. Even with proper control of both surface water and groundwater, it is probable that during periods of wet weather off-site gravel fill and/or crushed stone may be required to maintain trafficability for construction equipment.



Based on the soil and groundwater conditions encountered in the subsurface explorations, it is anticipated that groundwater and surface water can generally be controlled using conventional sumping in combination with strategic use of trenches and berms. However, if excavation below the groundwater level occurs within the building areas, it will be necessary to temporarily depress the groundwater level across the site to complete the proposed below-grade construction in-the-dry. The construction dewatering design should be prepared by a professional engineer registered in the State of New Hampshire who is employed by the Contractor. The design should also be submitted for review by McPhail.

In consideration of the observed depth of the groundwater below the existing ground surface and the anticipated scope of the proposed development, on-site recharge of groundwater may not be considered practical. Therefore, off-site discharge of groundwater during foundation excavation and construction may be required. All dewatering operations should be performed in accordance with the rules and regulations of the City of Portsmouth.

Should off-site removal of excess excavated soil from the site be necessary, it is anticipated that chemical analysis of the excess soil will be required in order to conform to applicable regulations and policies. Chemical analysis of existing soil is not anticipated to be required if it is reused on-site.

### **Final Comments**

The subsurface information obtained from the explorations performed to date is considered sufficient for foundation design purposes. However, an additional subsurface exploration program consisting of borings and/or test pits is recommended to be performed to obtain further subsurface information in the following areas:

- Eastern portion of Building B
- Central portion of Building A
- Within the portion of the Commercial Building occupied by the existing building

It is recommended that McPhail be retained to provide design assistance to the design team during the final design phase of this project. The purpose of this involvement is to review the structural foundation drawings and foundation notes for conformance with the recommendations presented herein and to prepare the earthwork and ground improvement specification sections for inclusion into the Contract Documents for construction.

It is recommended that a representative of McPhail be present during the earthwork phase of the project to monitor the installation of ground improvement, to monitor overexcavation of unsuitable soil at footing locations, preparation of foundation bearing surfaces, preparation of slab and pavement subgrades, placement and compaction of fill materials, and segregation of on-site soils in accordance with the provisions of the Code and the provisions of the Contract Documents. Our involvement during the construction phase of the work should minimize costly delays due to unanticipated field problems since our field engineer would be under the direct supervision of our project manager who was responsible



Torrington Properties, Inc.  
April 16, 2019  
Page 18

for the subsurface exploration program and foundation design recommendations documented herein.

We trust that the above is sufficient for your present requirements. Should you have any questions concerning the recommendations presented herein, please do not hesitate to contact us.

Sincerely,

McPHAIL ASSOCIATES, LLC

A handwritten signature in blue ink that reads "Fatima Babic-Konjic".

Fatima Babic-Konjic, P.E.


A handwritten signature in blue ink that reads "Jonathan W. Patch".

Jonathan W. Patch, P.E.


N:\Working Documents\Reports\6524\_FER\_041619.docx  
FBK/JWP



FIGURE I

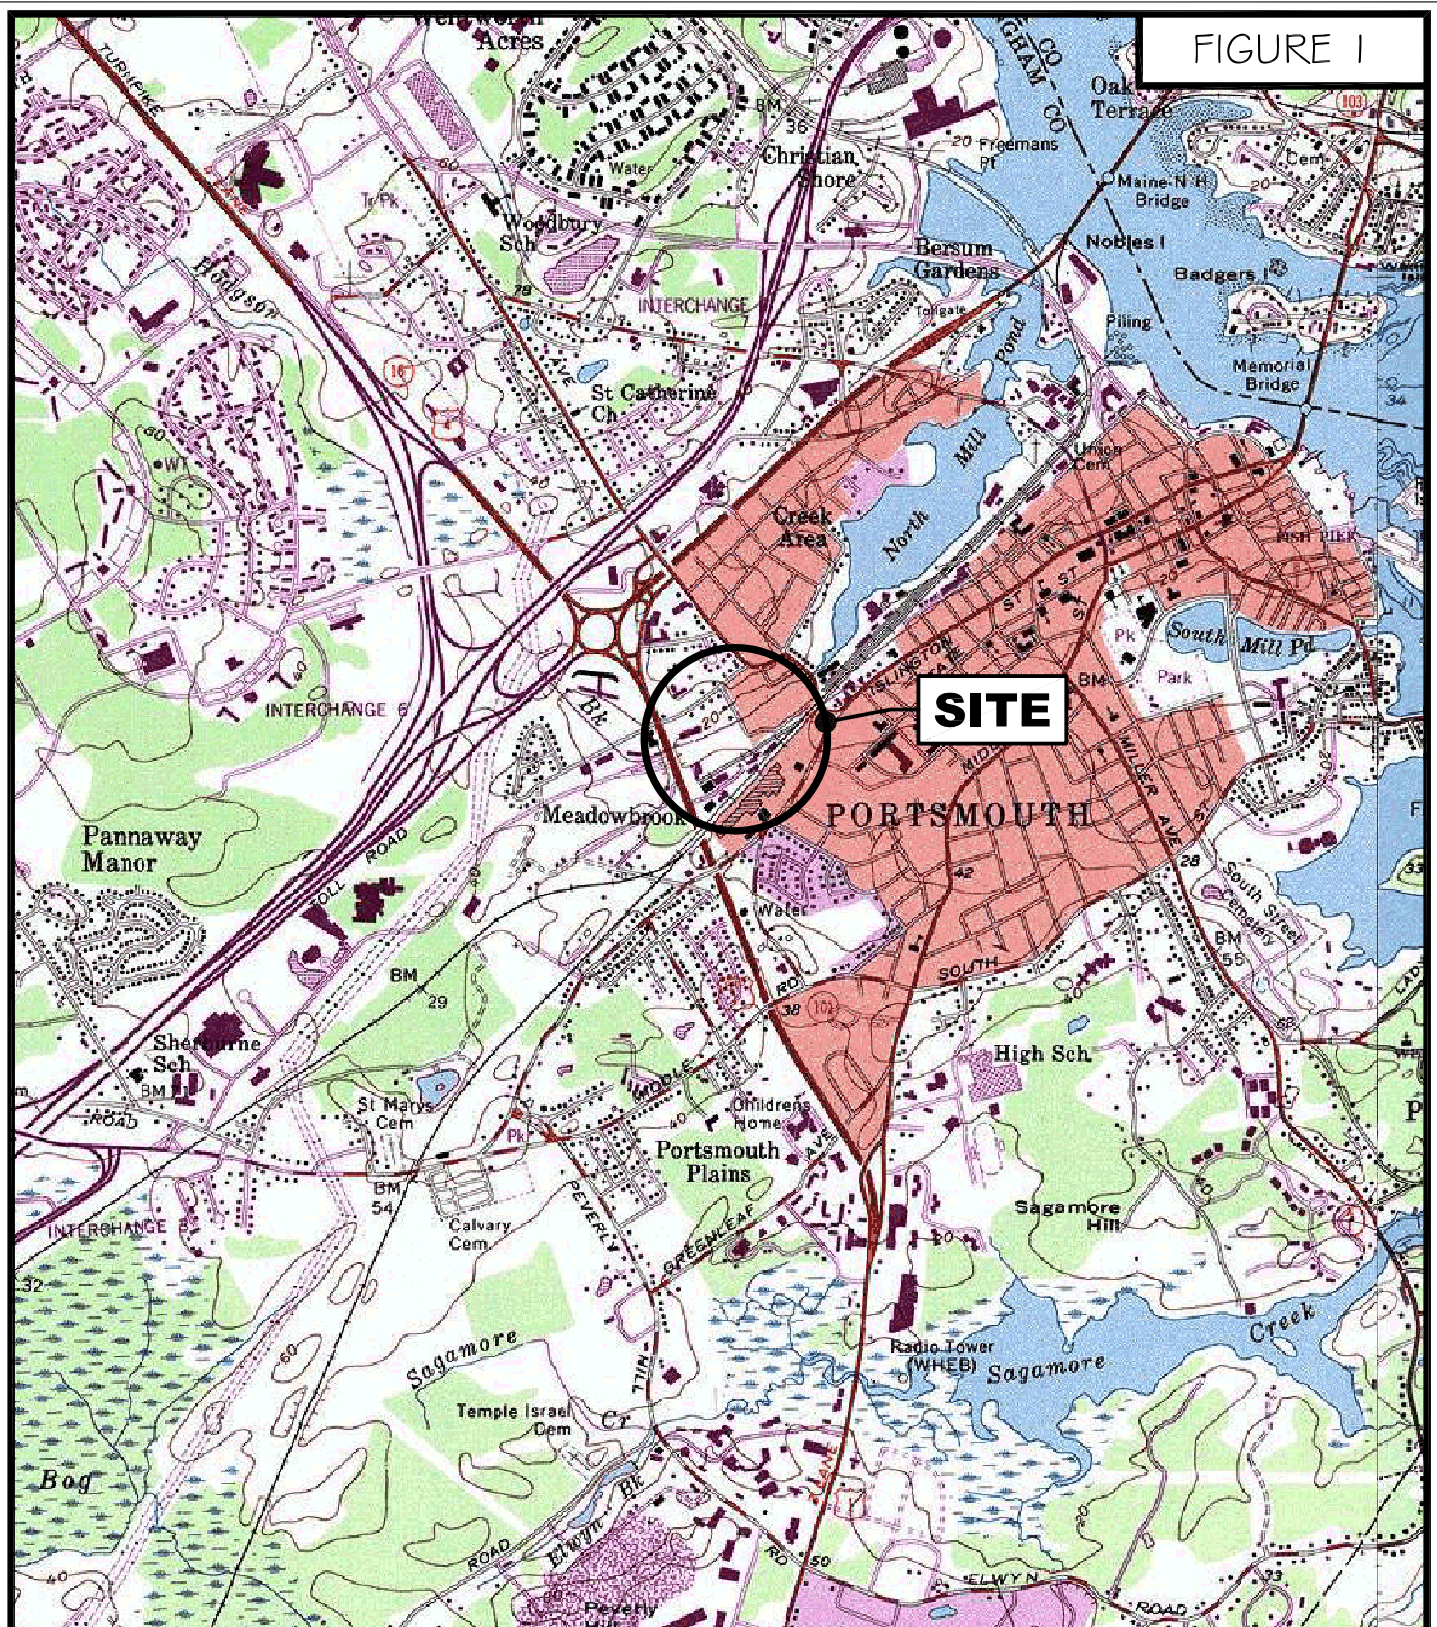

Geotechnical and  
Geoenvironmental Engineers  
2269 Massachusetts Avenue  
Cambridge, MA 02140  
617/868-1420  
617/868-1423 (Fax)  
www.mcphailgeo.com



SCALE 1:25,000



# PROJECT LOCATION PLAN

## WEST END YARDS

PORTSMOUTH

NEW HAMPSHIRE



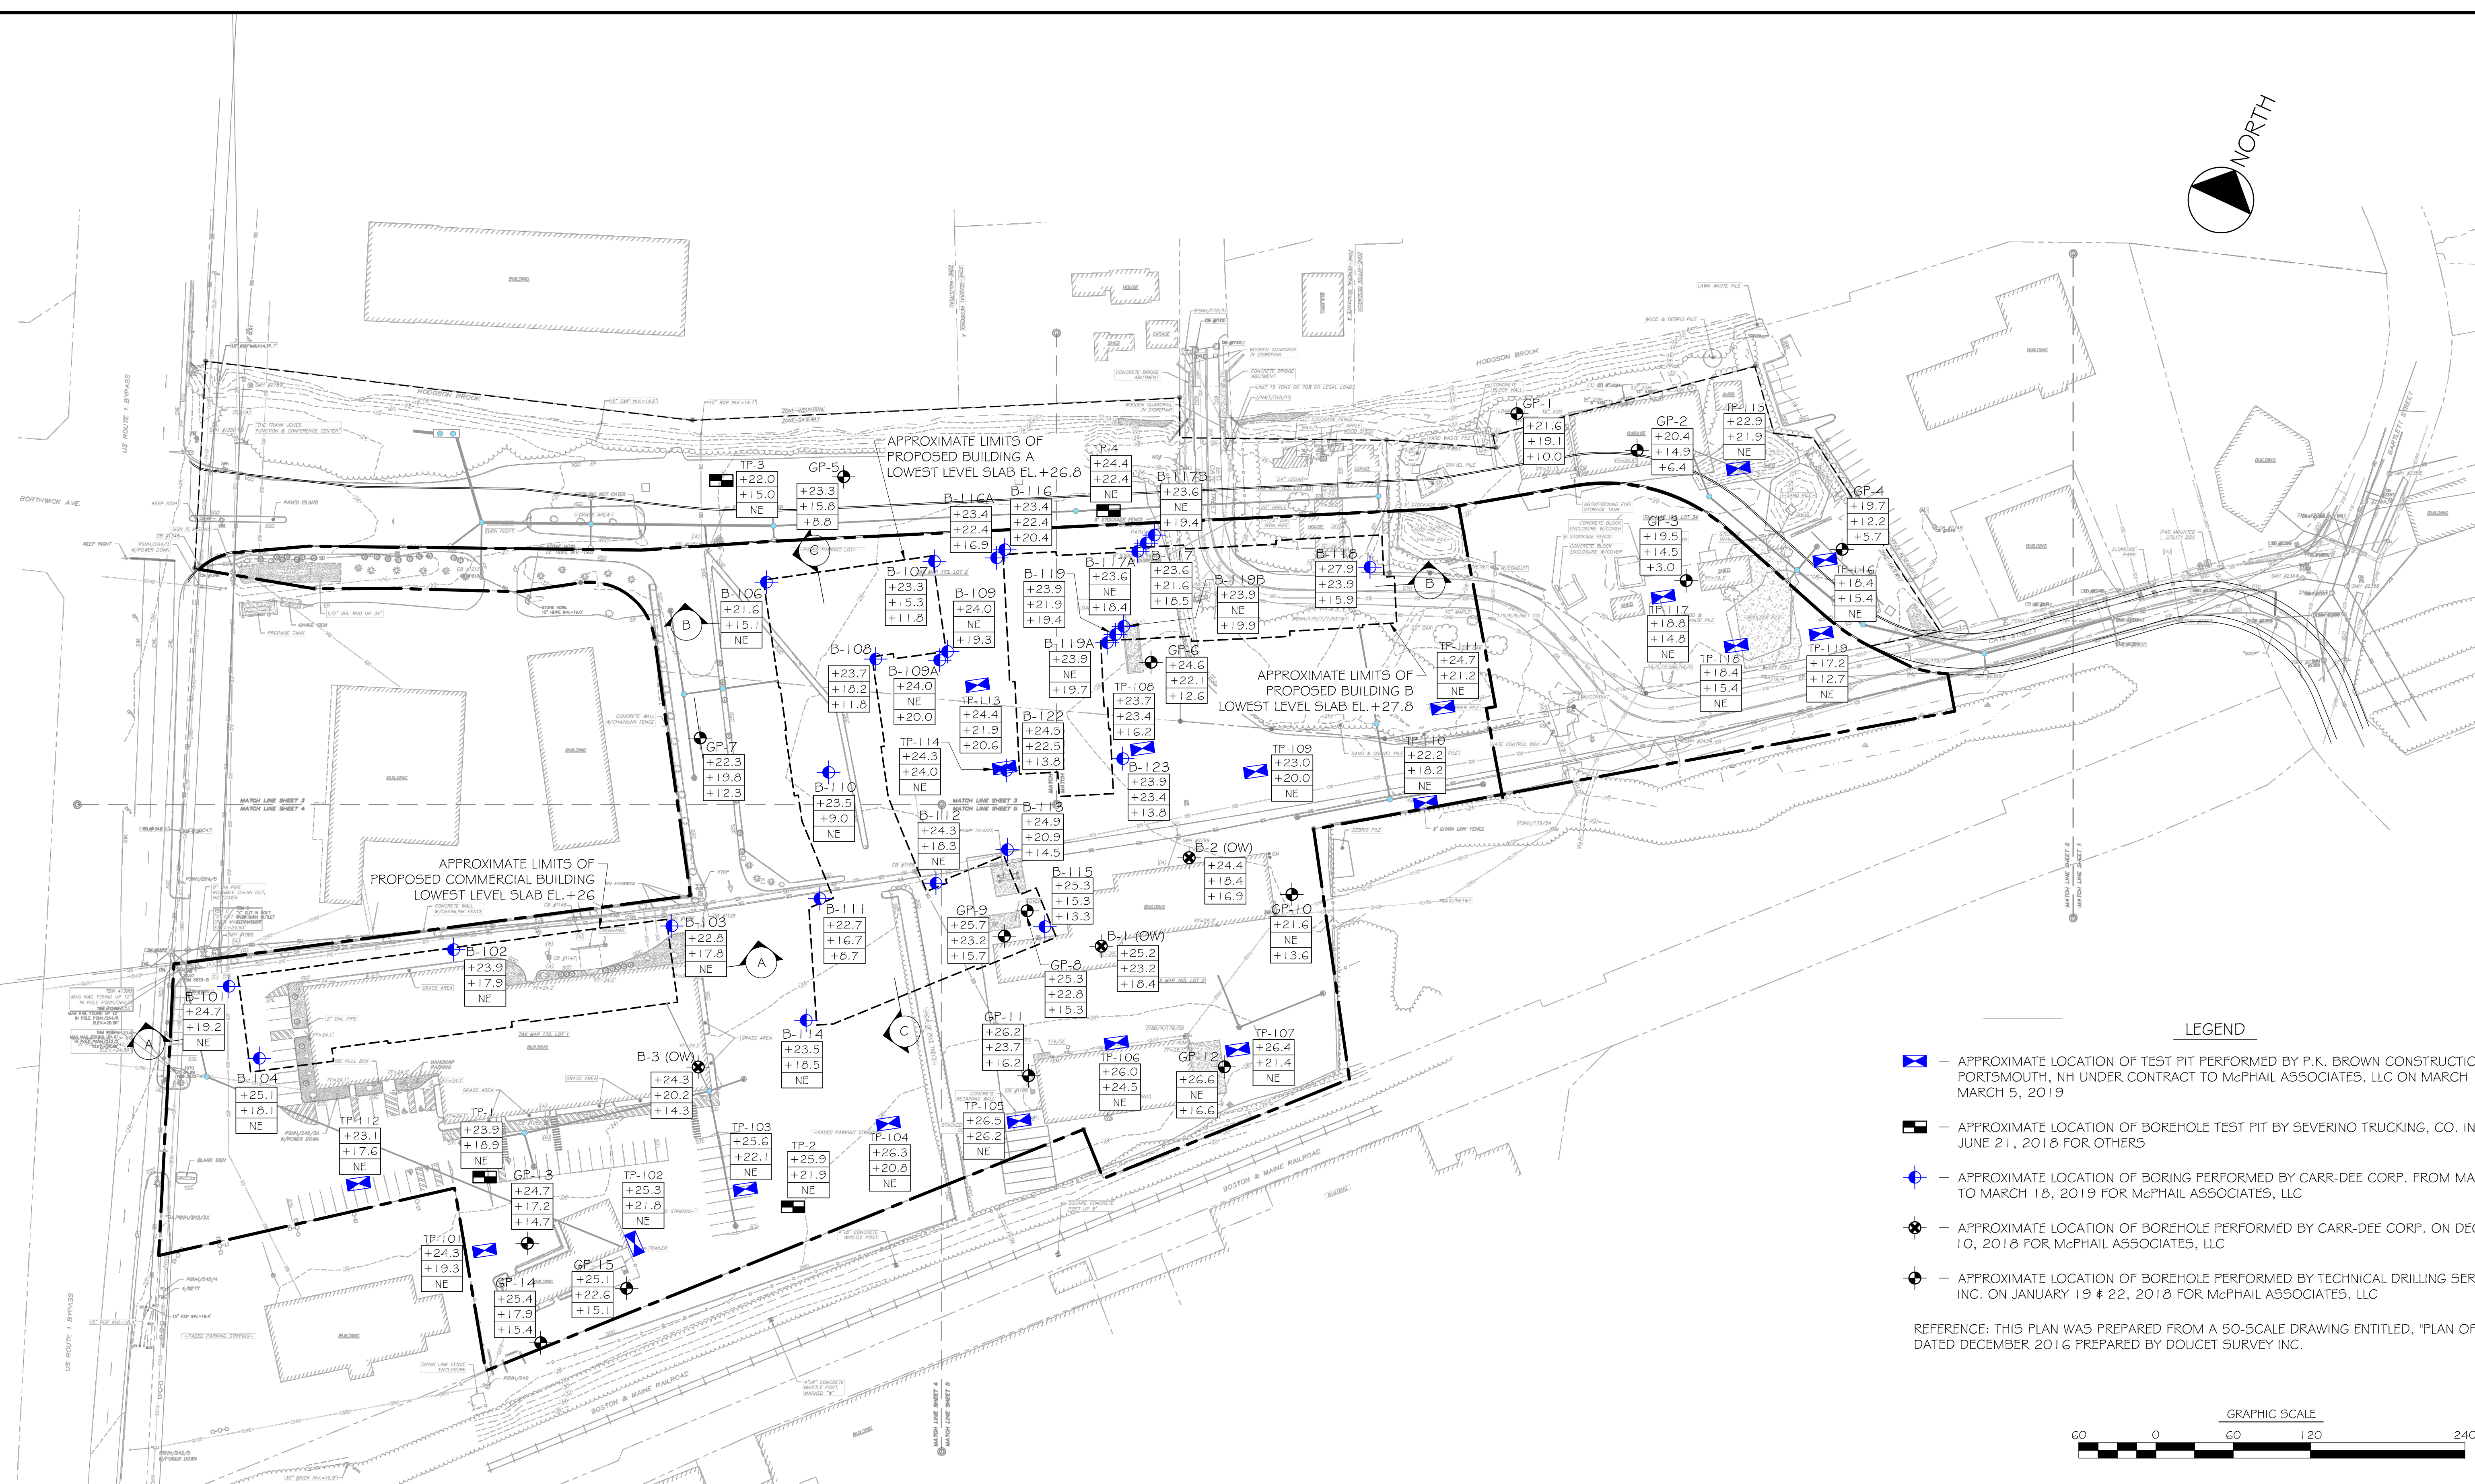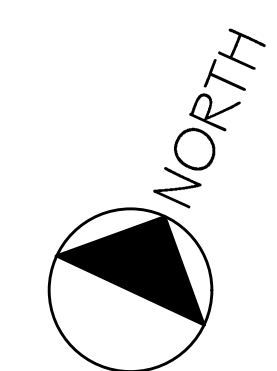

**LEGEND**

- APPROXIMATE LOCATION OF TEST PIT PERFORMED BY P.K. BROWN CONSTRUCTION OF PORTSMOUTH, NH UNDER CONTRACT TO McPHAIL ASSOCIATES, LLC ON MARCH 1 AND MARCH 5, 2019
- APPROXIMATE LOCATION OF BOREHOLE TEST PIT BY SEVERINO TRUCKING, CO. INC. ON JUNE 21, 2018 FOR OTHERS
- APPROXIMATE LOCATION OF BORING PERFORMED BY CARR-DEE CORP. FROM MARCH 11 TO MARCH 18, 2019 FOR McPHAIL ASSOCIATES, LLC
- APPROXIMATE LOCATION OF BOREHOLE PERFORMED BY CARR-DEE CORP. ON DECEMBER 10, 2018 FOR McPHAIL ASSOCIATES, LLC
- APPROXIMATE LOCATION OF BOREHOLE PERFORMED BY TECHNICAL DRILLING SERVICES, INC. ON JANUARY 19 & 22, 2018 FOR McPHAIL ASSOCIATES, LLC

REFERENCE: THIS PLAN WAS PREPARED FROM A 50-SCALE DRAWING ENTITLED, "PLAN OF LAND" DATED DECEMBER 2016 PREPARED BY DOUCET SURVEY INC.



- ELEVATION OF EXISTING GROUND SURFACE
- ELEVATION OF TOP OF NATURAL MARINE CLAY OR GLACIAL OUTWASH DEPOSIT
- ELEVATION OF TOP OF PRACTICAL REFUSAL\* AT EXPLORATION LOCATION
- NOT ENCOUNTERED

\* PRACTICAL REFUSAL IS CONSIDERED INDICATIVE OF EITHER BOULDERS IN THE GLACIAL DEPOSIT OR THE UNDERLYING BEDROCK SURFACE

Geotechnical and Geoenvironmental Engineers  
 2269 Massachusetts Avenue  
 Cambridge, MA 02140  
 617/868-1420  
 617/868-1423 (Fax)  
 www.mcphailgeo.com

**WEST END YARDS**

PORTSMOUTH NEW HAMPSHIRE




SUBSURFACE EXPLORATION PLAN

FOR  
 TORRINGTON PROPERTIES, INC.  
 BY  
 McPHAIL ASSOCIATES, LLC

Date: APRIL 2019	Dwn: M.B.S.	Chkd: F.B.K.	Scale: 1" = 60'
Project No:	6524	<b>FIGURE 2</b>	

FILE NAME: N:\Mcphail\0856\24\FER\0524\_F02.dwg



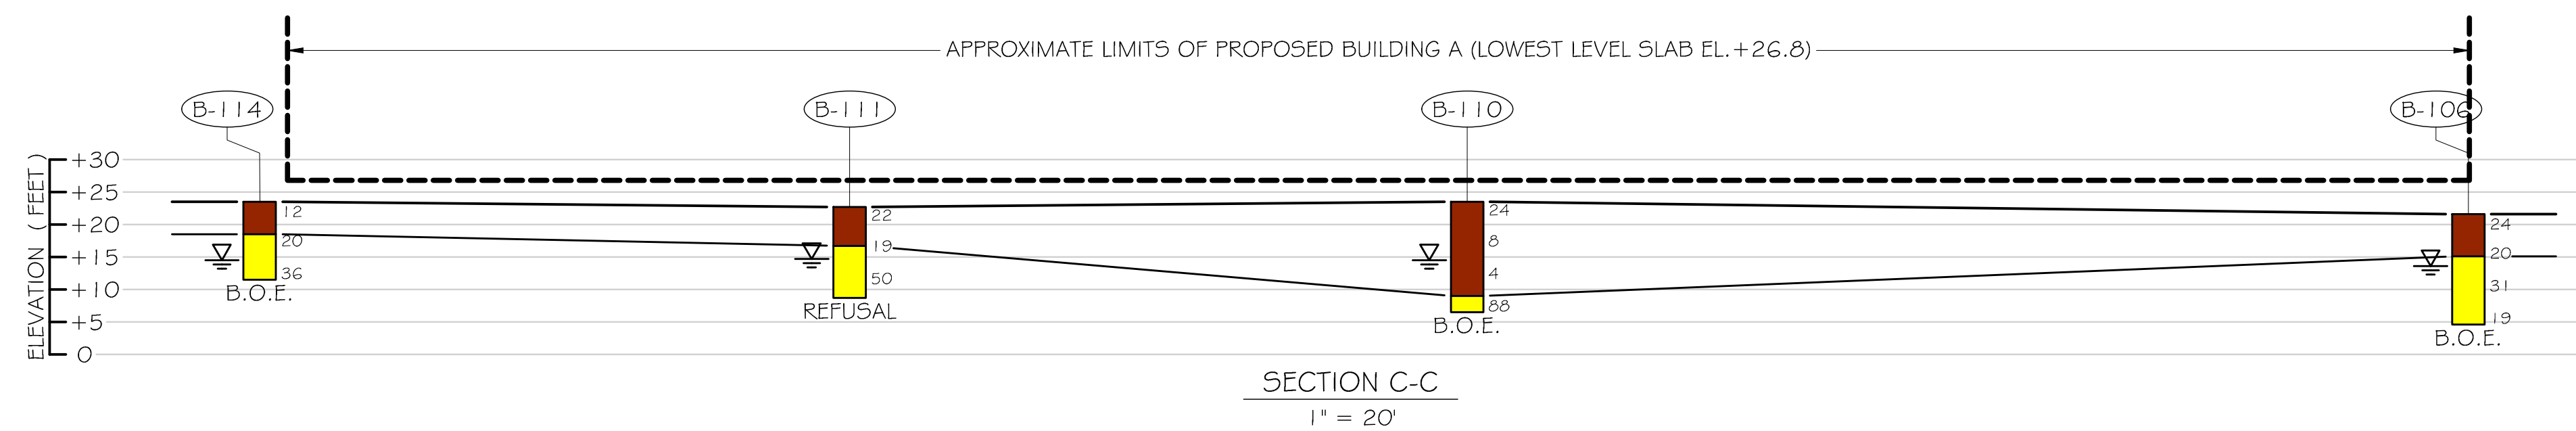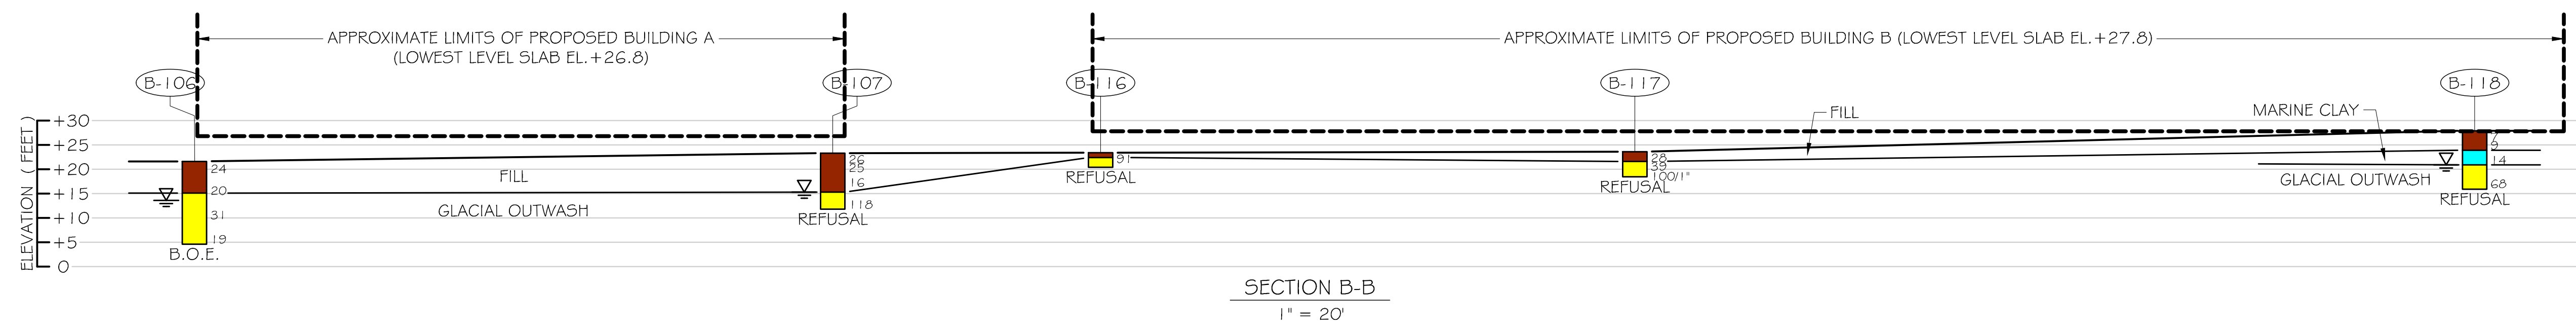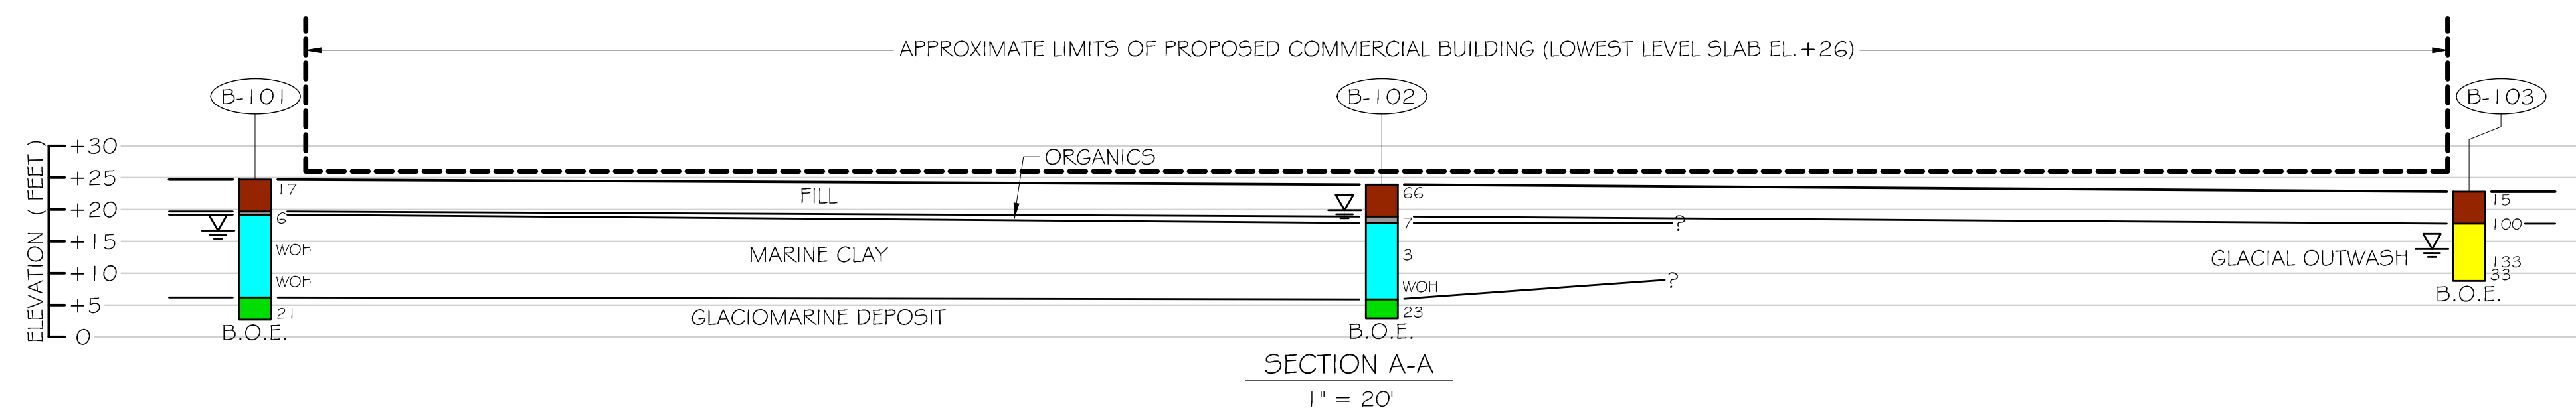

**LEGEND**

(B-101) — BOREHOLE NUMBER

▽ — INDICATES GROUNDWATER LEVEL OBSERVED IN COMPLETED BOREHOLE

17 — STANDARD PENETRATION RESISTANCE OR N-VALUE, BLOWS PER FOOT. (1-3/8" I.D. SPLIT SPOON, 140LB. HAMMER, 30" DROP)

B.O.E. — BOTTOM OF EXPLORATION

REFUSAL — INDICATES SPLIT SPOON AND ROLLER BIT REFUSAL ENCOUNTERED WITHIN COMPLETED BOREHOLE

**NOTES:**

- REFER TO FIGURE 2 FOR LOCATION AND ORIENTATION OF SUBSURFACE SECTIONS.
- STRATIFICATION LINES BETWEEN EXPLORATIONS ARE BASED ON LINEAR INTERPOLATION OF DATA FROM THE EXPLORATIONS AND MAY NOT NECESSARILY REPRESENT ACTUAL SUBSURFACE CONDITIONS.

SUBSURFACE UNIT	GRAPHIC SYMBOL	GENERAL DESCRIPTION
FILL		LOOSE TO VERY DENSE, BROWN TO DARK BROWN, SAND AND GRAVEL WITH TRACE TO SOME SILT, VARYING TO A WELL GRADED MIXTURE OF SAND, GRAVEL, AND SILT WITH BRICK
ORGANICS		SOFT TO STIFF, BROWN TO BLACK, ORGANIC SILT, SOME SAND AND CLAY
MARINE CLAY		VERY SOFT TO STIFF, YELLOW TO BLUE, SILTY CLAY
GLACIOMARINE DEPOSIT		COMPACT, GRAY, SILTY SAND, SOME GRAVEL, VARYING TO SILTY SAND AND GRAVEL WITH WEATHERED BEDROCK
GLACIAL OUTWASH		COMPACT TO VERY DENSE, GRAY, SAND AND GRAVEL WITH TRACE TO SOME SILT, VARYING TO A WELL-GRADED MIXTURE OF SAND, GRAVEL, AND SILT




Geotechnical and Geoenvironmental Engineers  
 2269 Massachusetts Avenue  
 Cambridge, MA 02140  
 617/868-1420  
 617/868-1423 (Fax)  
 www.mcphailgeo.com

<b>WEST END YARDS</b>			
PORTSMOUTH		NEW HAMPSHIRE	
GENERALIZED SUBSURFACE SECTIONS A-A, B-B, AND C-C			
FOR <b>TORRINGTON PROPERTIES, INC.</b> BY <b>McPHAIL ASSOCIATES, LLC</b>			
Date: APRIL 2019	Dwn: M.B.S.	Chkd: F.B.K.	Scale: 1" = 20'
Project No: 6524			FIGURE 3

FILE NAME: N:\wca\AUBS\6524\FE\FE6524-F03 Sections.dwg



M.I.T. GRAIN SIZE SCALE

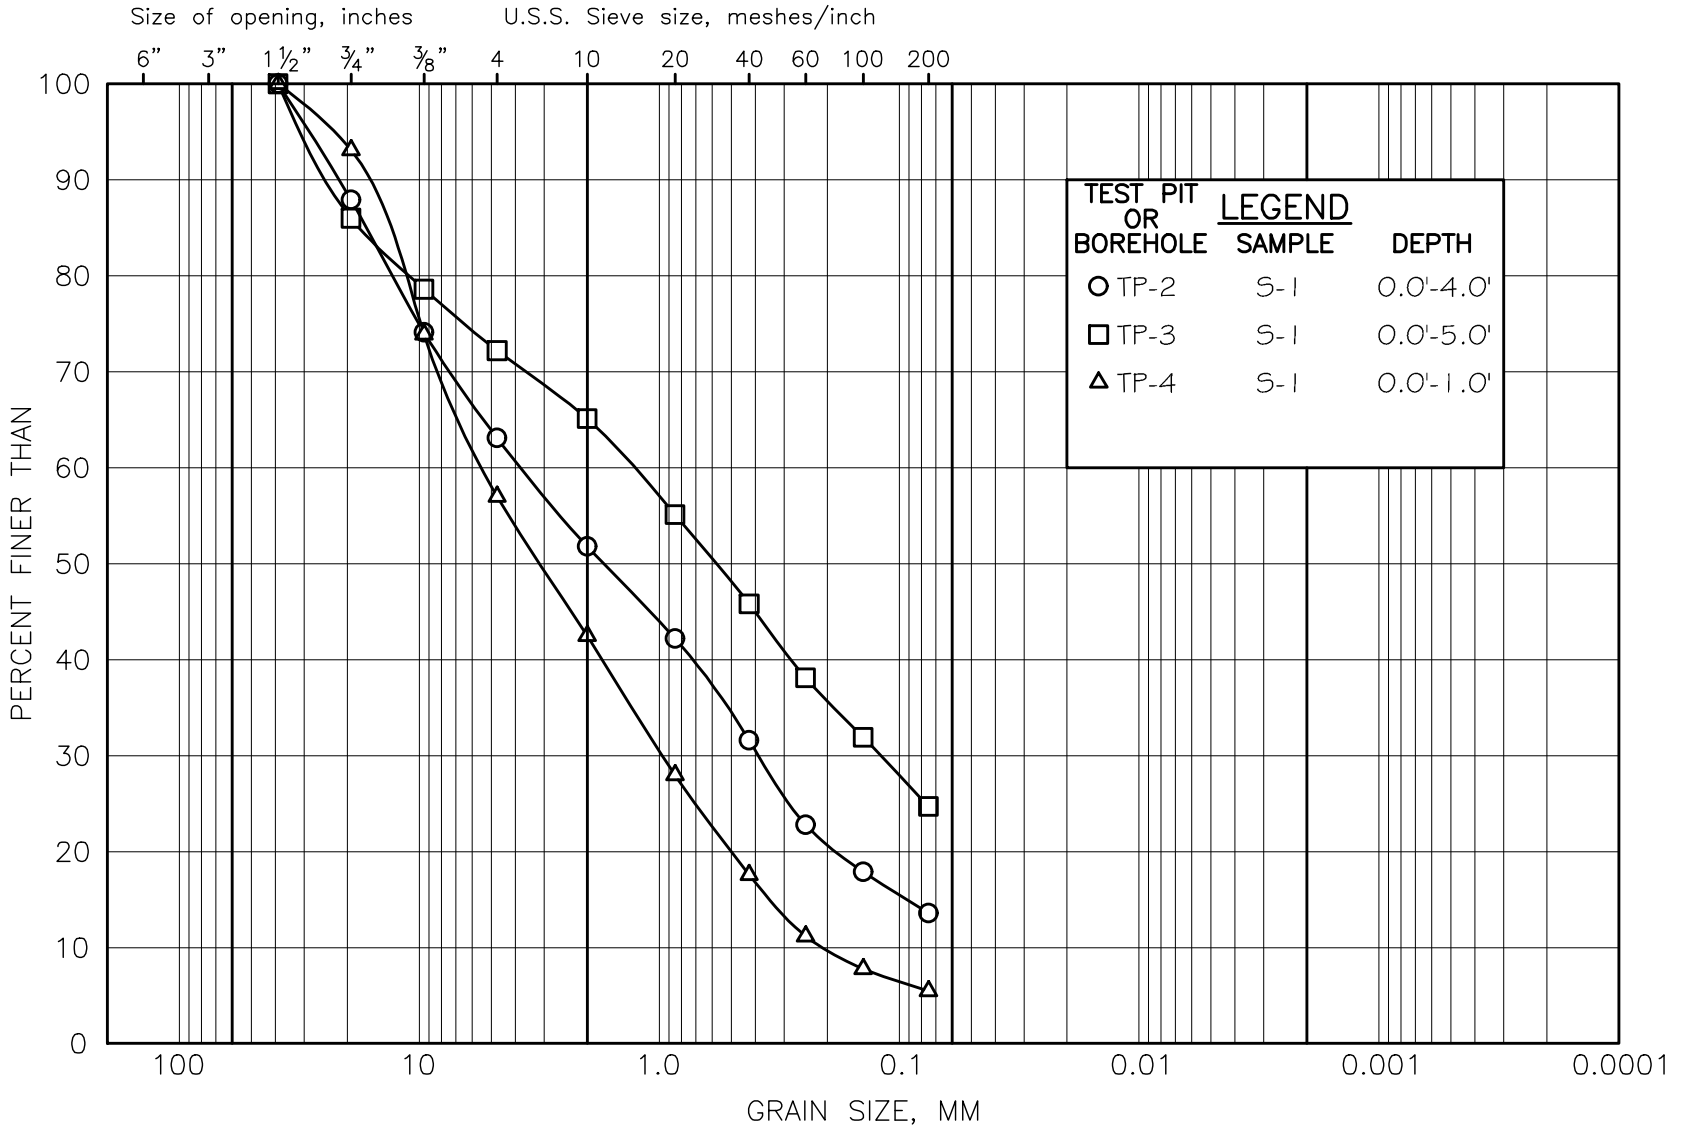

TEST PIT OR BOREHOLE	SAMPLE	DEPTH
○ TP-2	S-1	0.0'-4.0'
□ TP-3	S-1	0.0'-5.0'
△ TP-4	S-1	0.0'-1.0'


COBBLE SIZE	COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE	SILT SIZE	CLAY SIZE
	GRAVEL SIZE			SAND SIZE				

McPHAIL ASSOCIATES, LLC

GRAIN SIZE DISTRIBUTION  
FILL

FIGURE 4

M.I.T. GRAIN SIZE SCALE

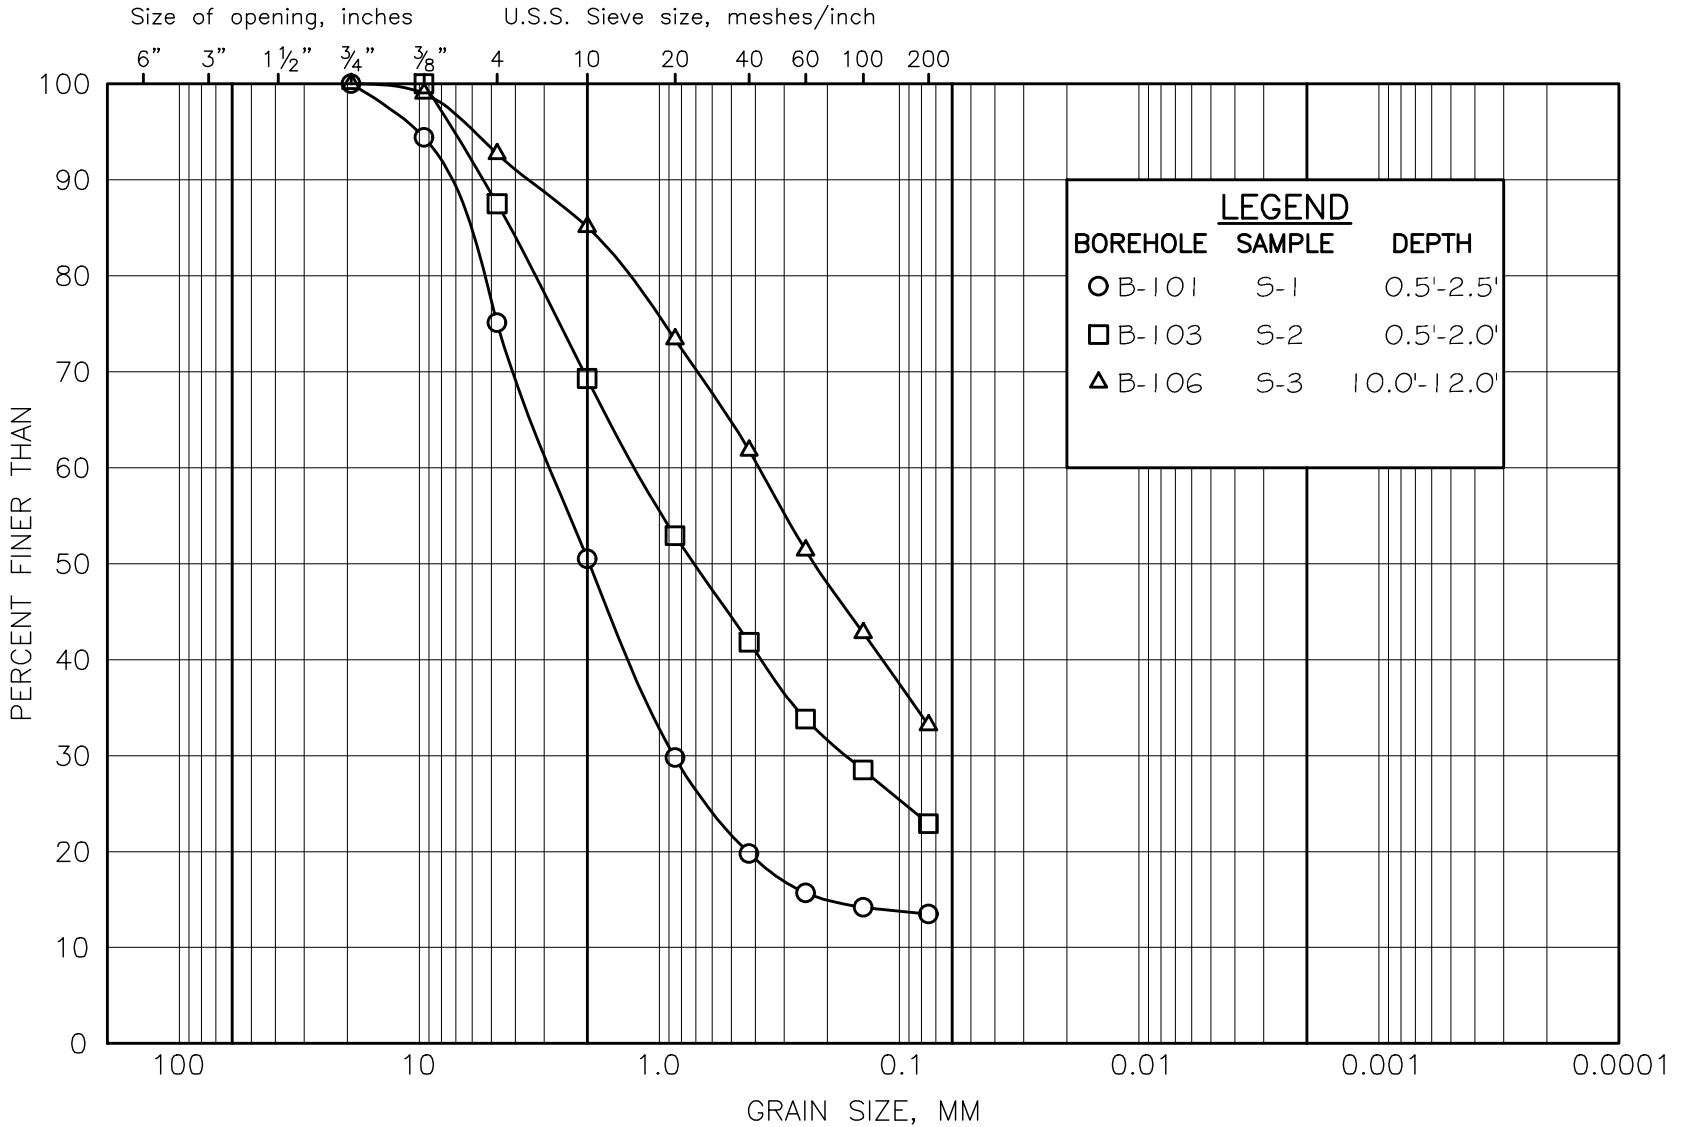


COBBLE SIZE	COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE	SILT SIZE	CLAY SIZE
	GRAVEL SIZE			SAND SIZE				

McPHAIL ASSOCIATES, LLC

GRAIN SIZE DISTRIBUTION  
FILL

FIGURE 5

M.I.T. GRAIN SIZE SCALE

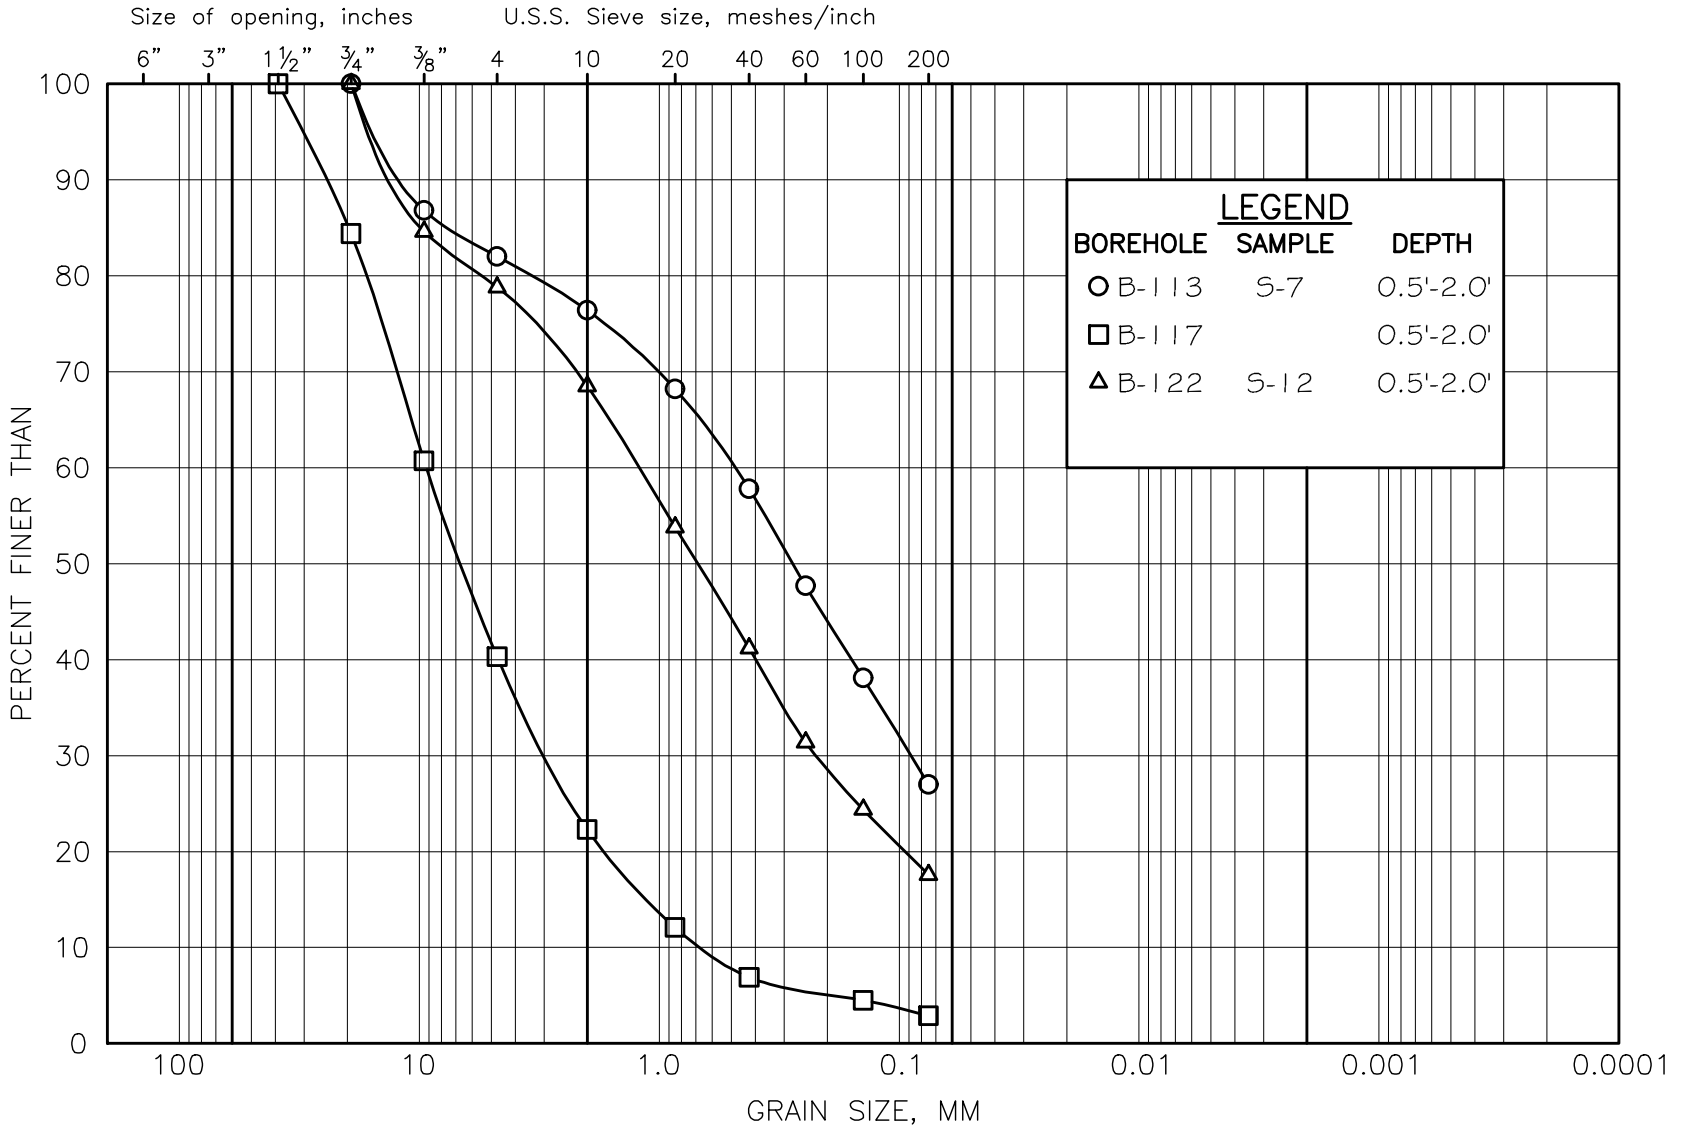

LEGEND		
BOREHOLE	SAMPLE	DEPTH
○	B-113	S-7
□	B-117	S-7
△	B-122	S-12


COBBLE SIZE	COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE	SILT SIZE	CLAY SIZE
	GRAVEL SIZE			SAND SIZE				

McPHAIL ASSOCIATES, LLC

GRAIN SIZE DISTRIBUTION  
FILL

FIGURE 6

M.I.T. GRAIN SIZE SCALE

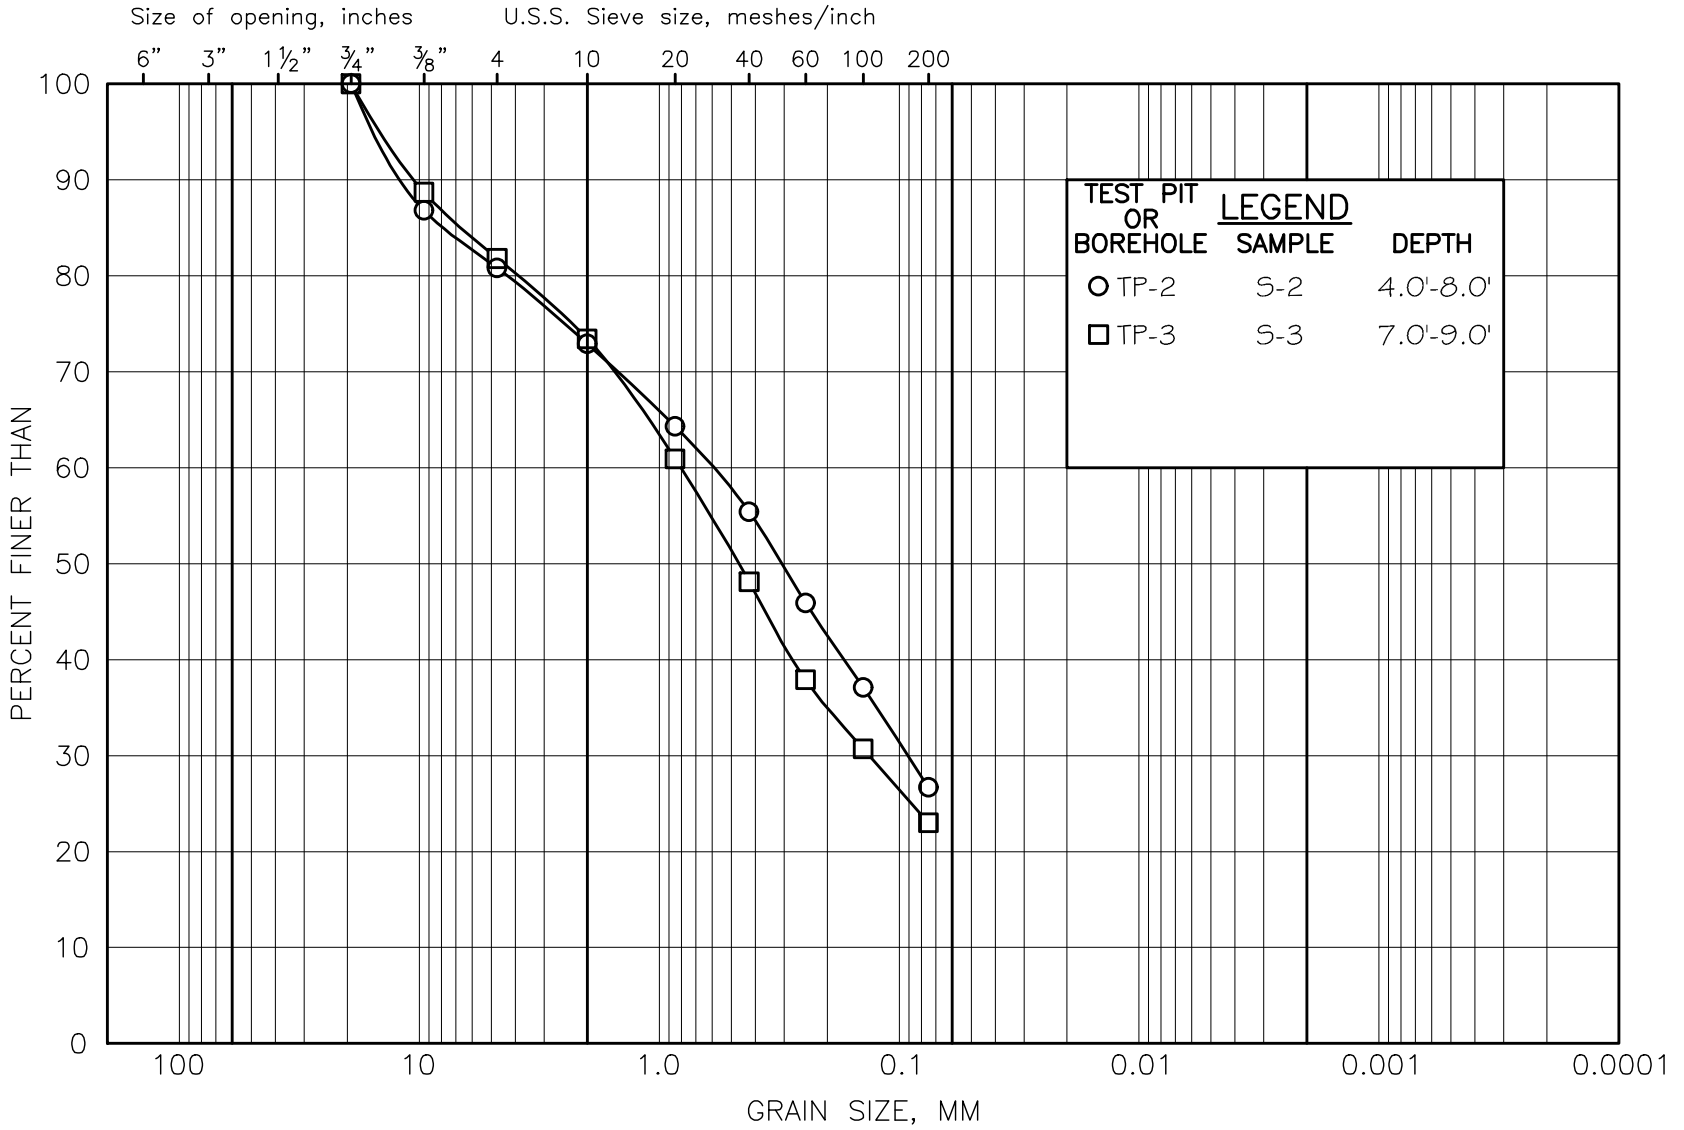


COBBLE SIZE	COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE	SILT SIZE	CLAY SIZE
	GRAVEL SIZE			SAND SIZE			FINE GRAINED	

McPHAIL ASSOCIATES, LLC

GRAIN SIZE DISTRIBUTION  
GLACIAL OUTWASH

FIGURE 7

M.I.T. GRAIN SIZE SCALE

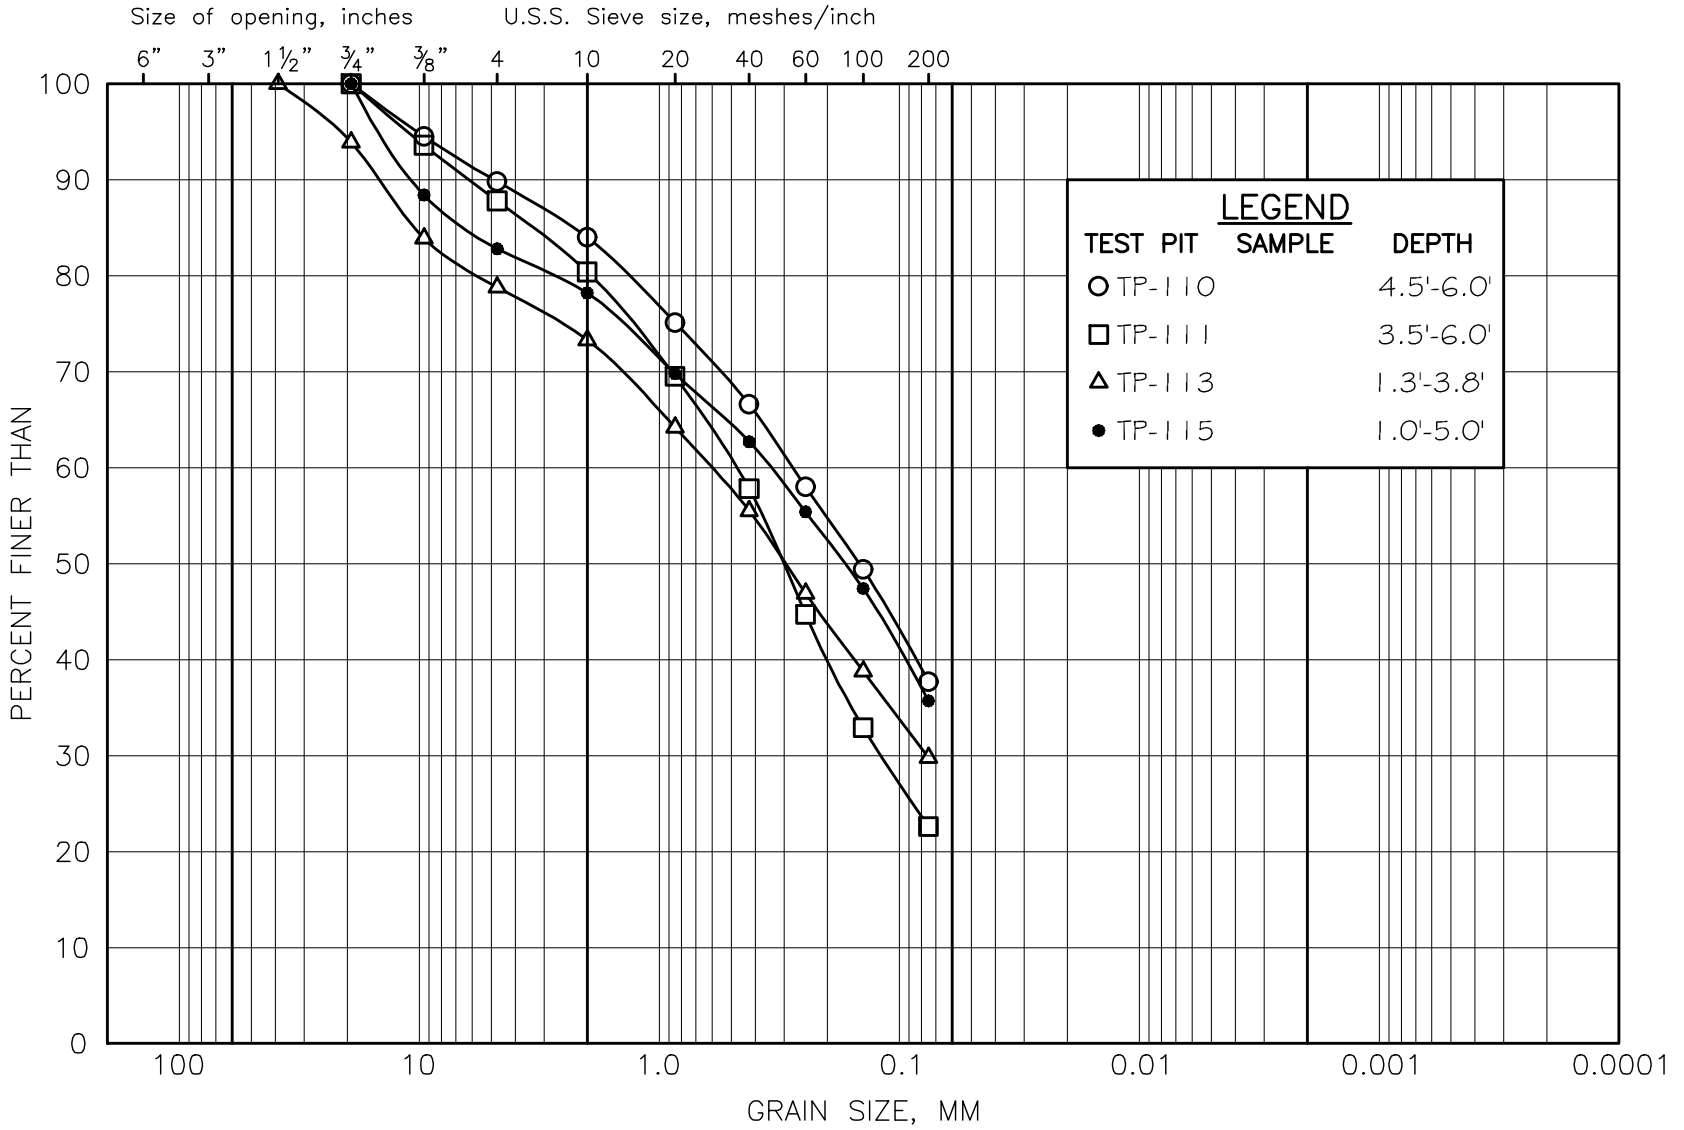

McPHAIL ASSOCIATES, LLC


GRAIN SIZE DISTRIBUTION  
GLACIAL OUTWASH

COBBLE SIZE	COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE	SILT SIZE		CLAY SIZE
	GRAVEL SIZE			SAND SIZE			FINE GRAINED		

FIGURE 8



M.I.T. GRAIN SIZE SCALE

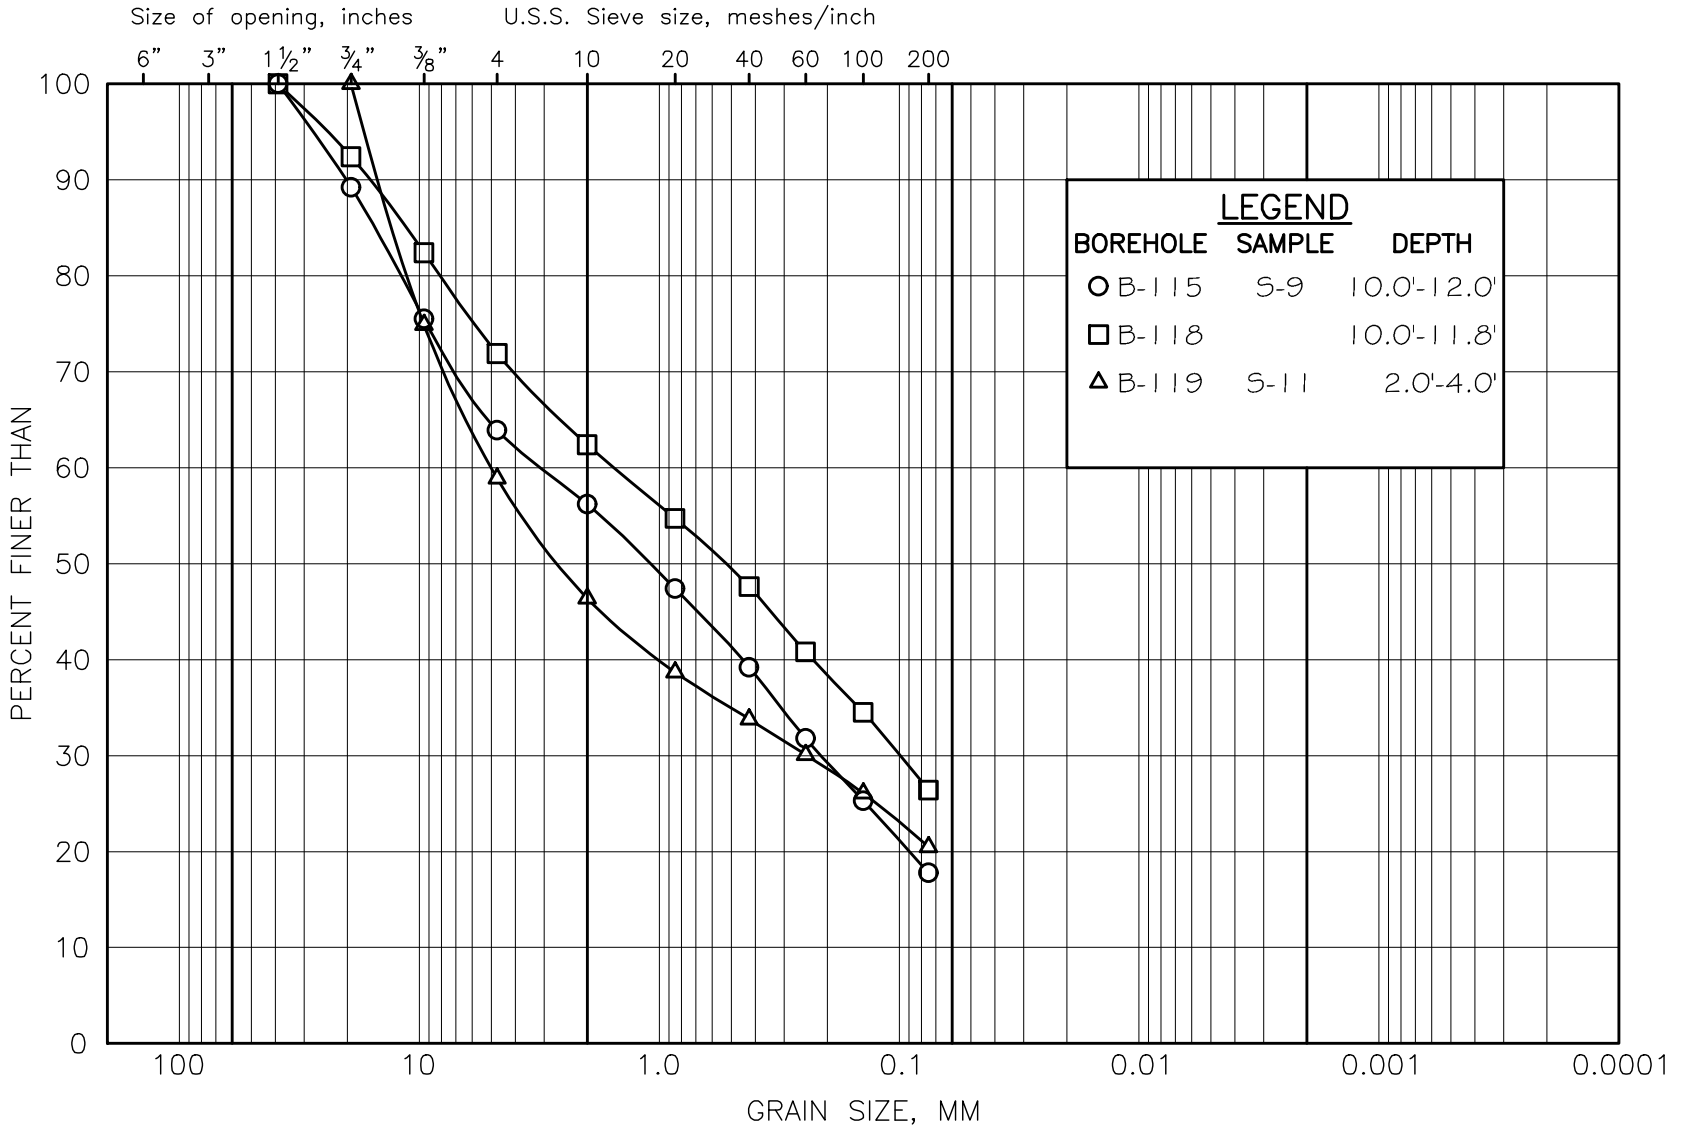

COBBLE SIZE	COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE	SILT SIZE	CLAY SIZE
	GRAVEL SIZE			SAND SIZE				

McPHAIL ASSOCIATES, LLC

GRAIN SIZE DISTRIBUTION  
GLACIAL OUTWASH

FIGURE 10



**APPENDIX A:**  
**LIMITATIONS**





## **LIMITATIONS**

This report has been prepared on behalf of and for the exclusive use of Torrington Properties, Inc. for specific application to the proposed West End Yards development to be located in Portsmouth, New Hampshire in accordance with generally accepted soil and geotechnical engineering practices. No other warranty, expressed or implied, is made.

In the event that any changes in nature or design of the proposed construction are planned, the conclusions and recommendations contained in this report should not be considered valid unless the changes are reviewed and conclusions of this report modified or verified in writing by McPhail Associates, LLC.

The analyses and recommendations presented in this report are based upon the data obtained from the subsurface explorations performed at the approximate locations indicated on the enclosed plan. If variations in the nature and extent of subsurface conditions between the explorations become evident during the course of construction, it will be necessary for a re-evaluation of the recommendations of this report to be made after performing on-site observations during the construction period and noting the characteristics of any variations.



**APPENDIX B:**

**BORING LOGS PREPARED BY CARR-DEE CORP.  
B-101 TO B-104, B-106 TO B-119, B-122 AND B-123**

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

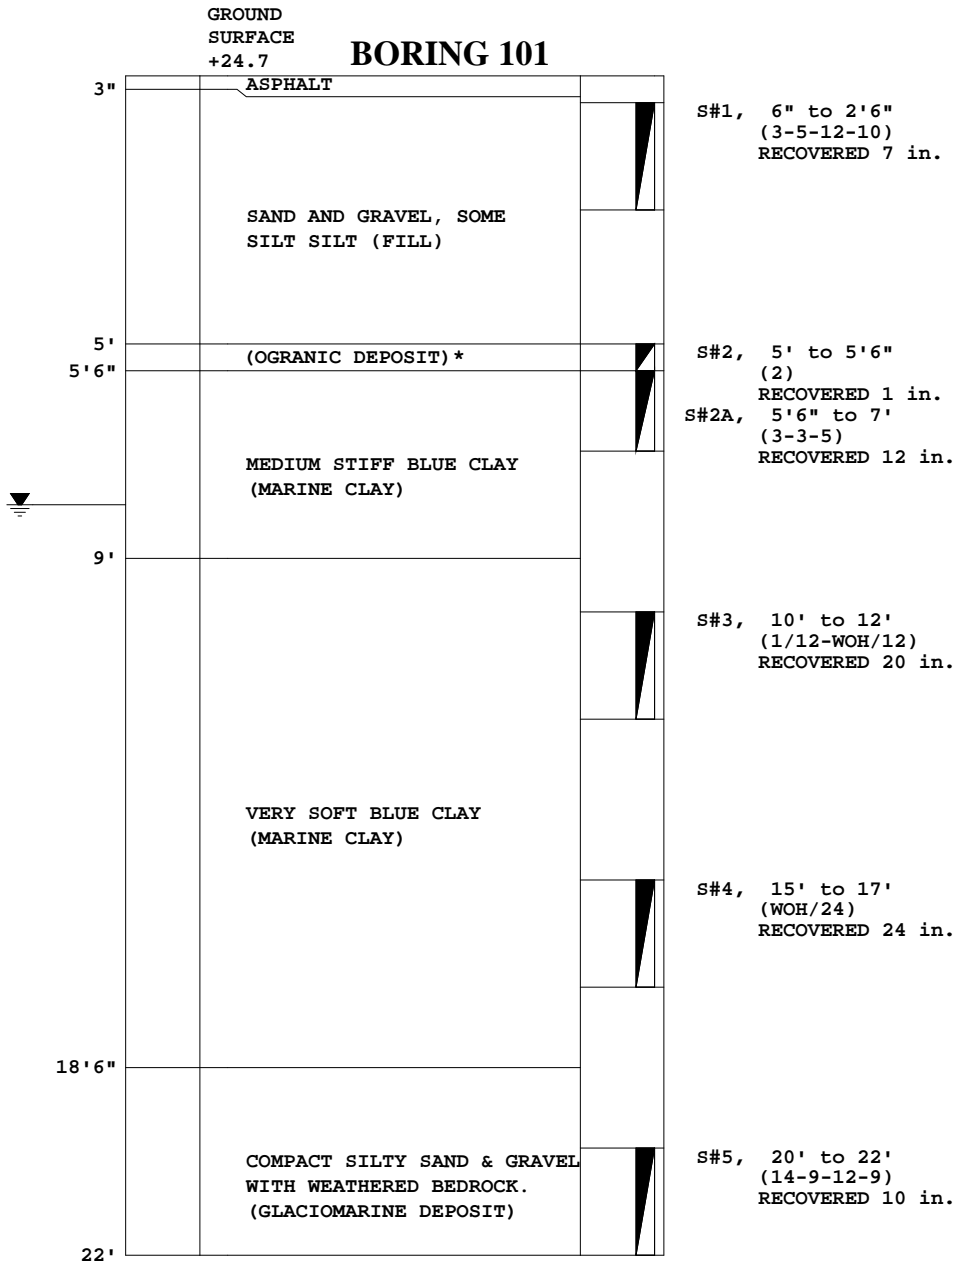

SIZE OF AUGER: 2 1/4" LENGTH: 20'0"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-12-2019  
 RIG TYPE: D-50 AUTO HAMMER

\*SOFT, BROWN TO BLACK, ORGANIC SILT WITH SOME SAND AND CLAY.

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

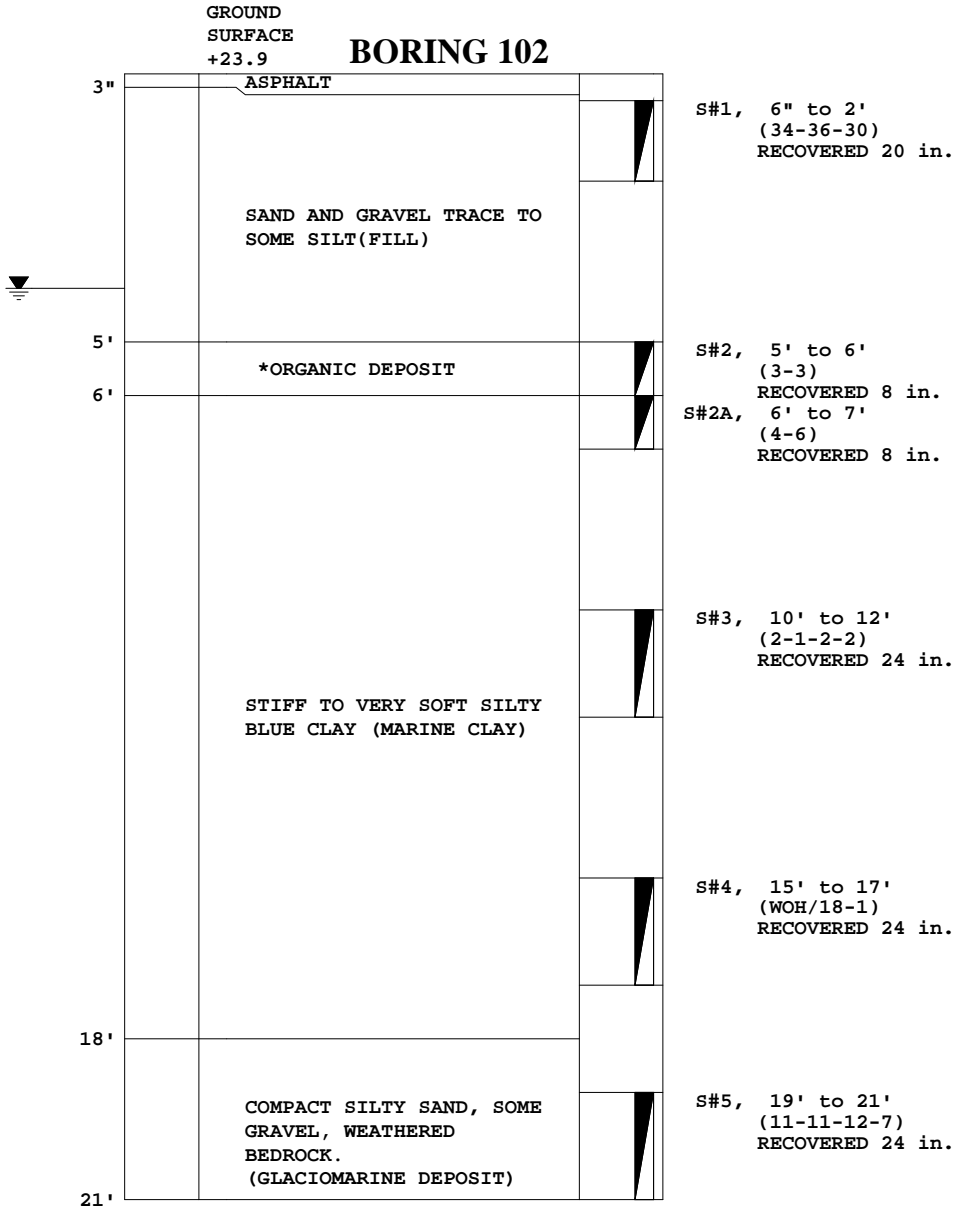

WATER LEVEL 4'  
 SIZE OF AUGER: 2 1/4" LENGTH: 19'0"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-12-2019  
 RIG TYPE: D-50 AUTO HAMMER

\*FIRM, BROWN TO BLACK, ORGANIC SILT WITH SOME SAND AND CLAY.

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

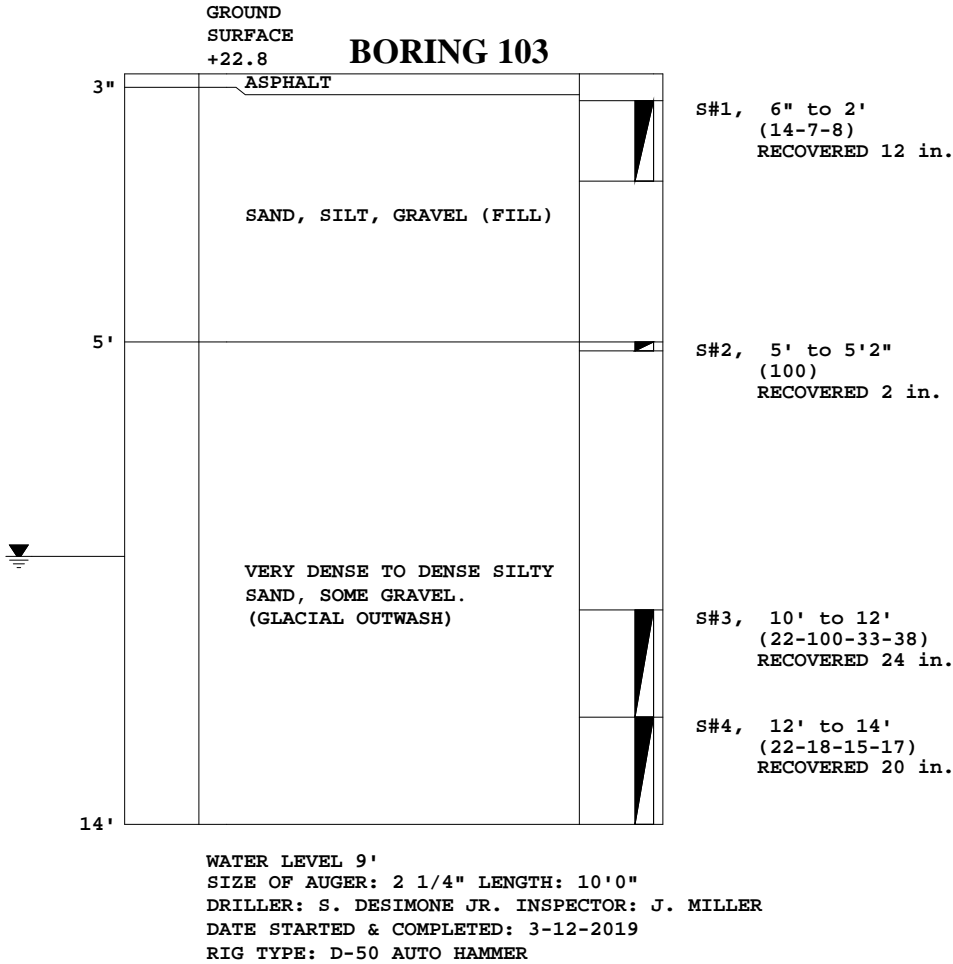

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

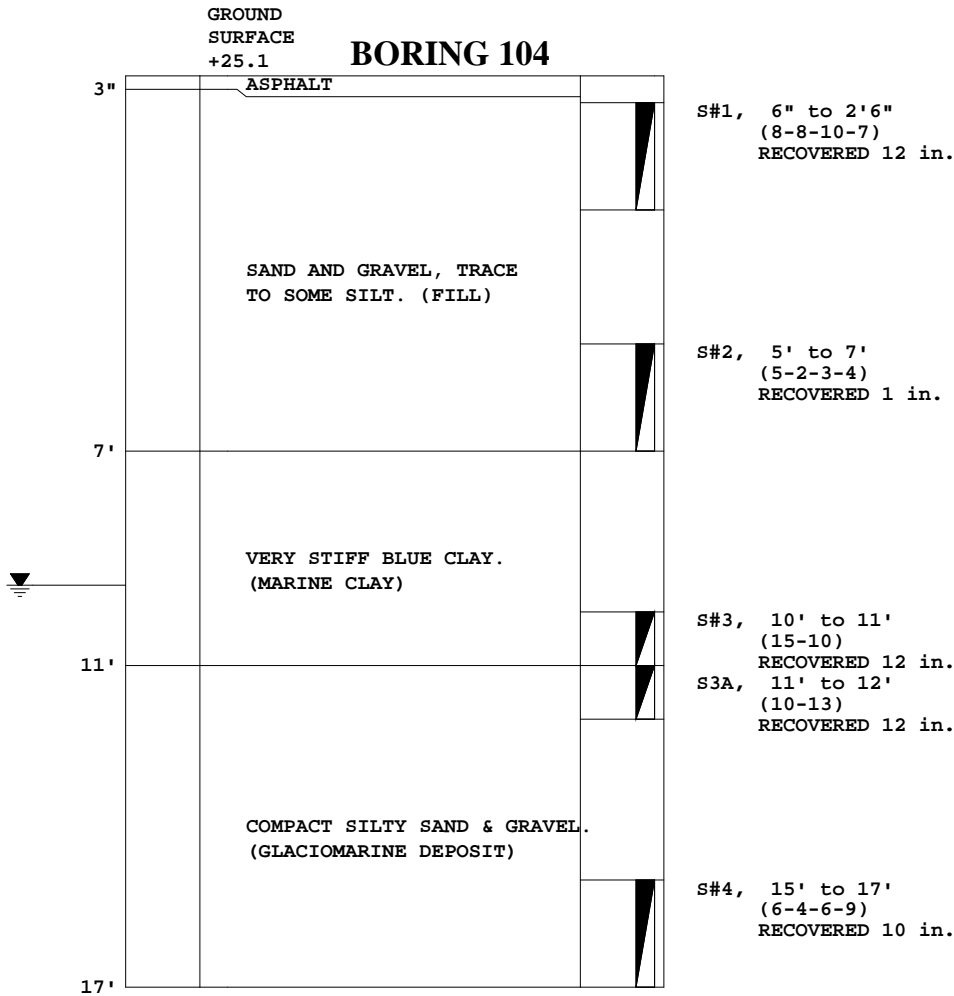

WATER LEVEL 9'6"  
 SIZE OF AUGER: 2 1/4" LENGTH: 15'0"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-12-2019  
 RIG TYPE: D-50 AUTO HAMMER

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

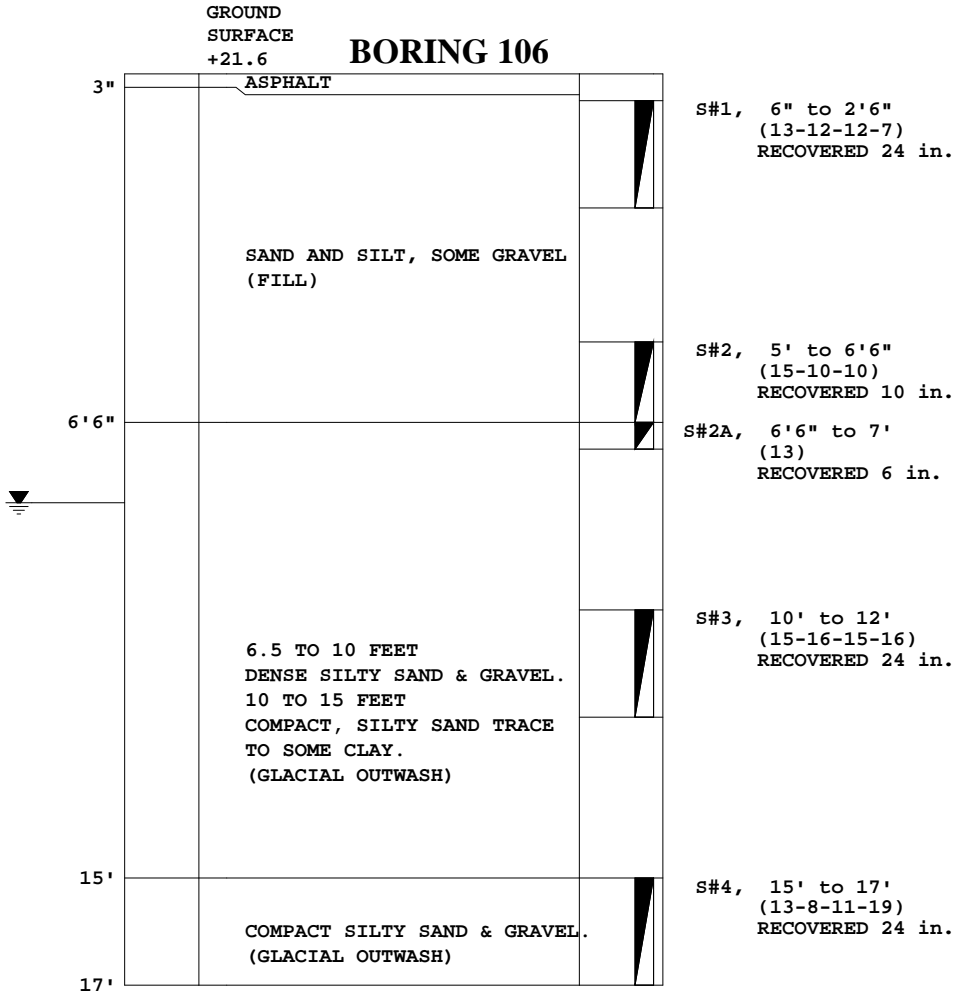

SIZE OF AUGER: 2 1/4" LENGTH: 15'0"  
DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
DATE STARTED & COMPLETED: 3-8-2019  
RIG TYPE: D-50 AUTO HAMMER

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

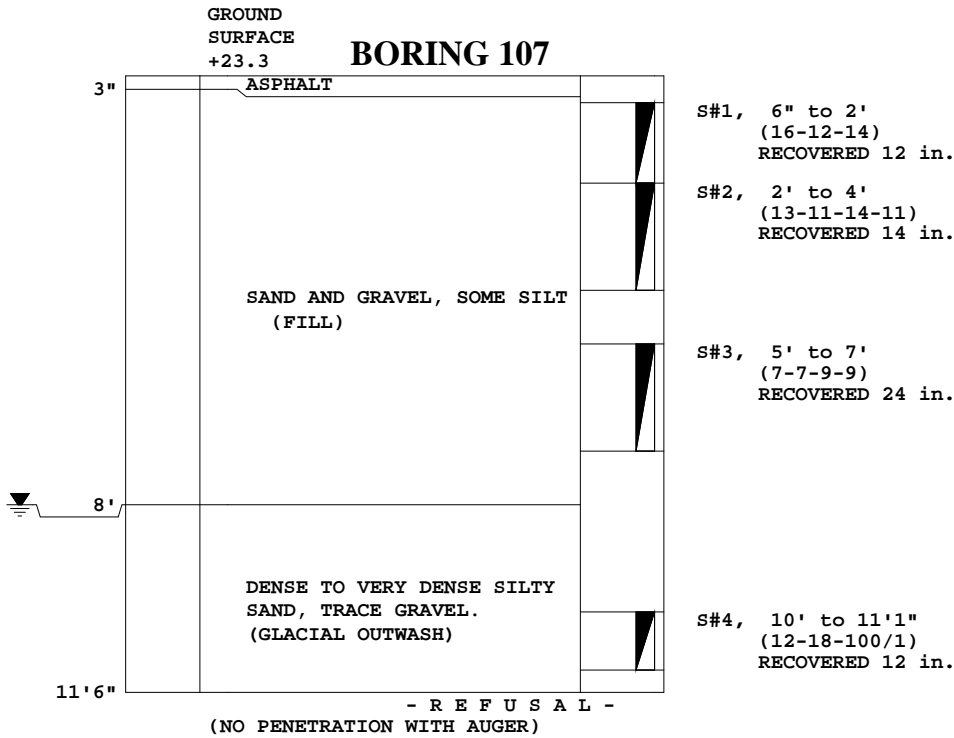

WATER LEVEL 8'  
 SIZE OF AUGER: 2 1/4" LENGTH: 11'6"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-8-2019  
 RIG TYPE: D-50 AUTO HAMMER

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).



# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

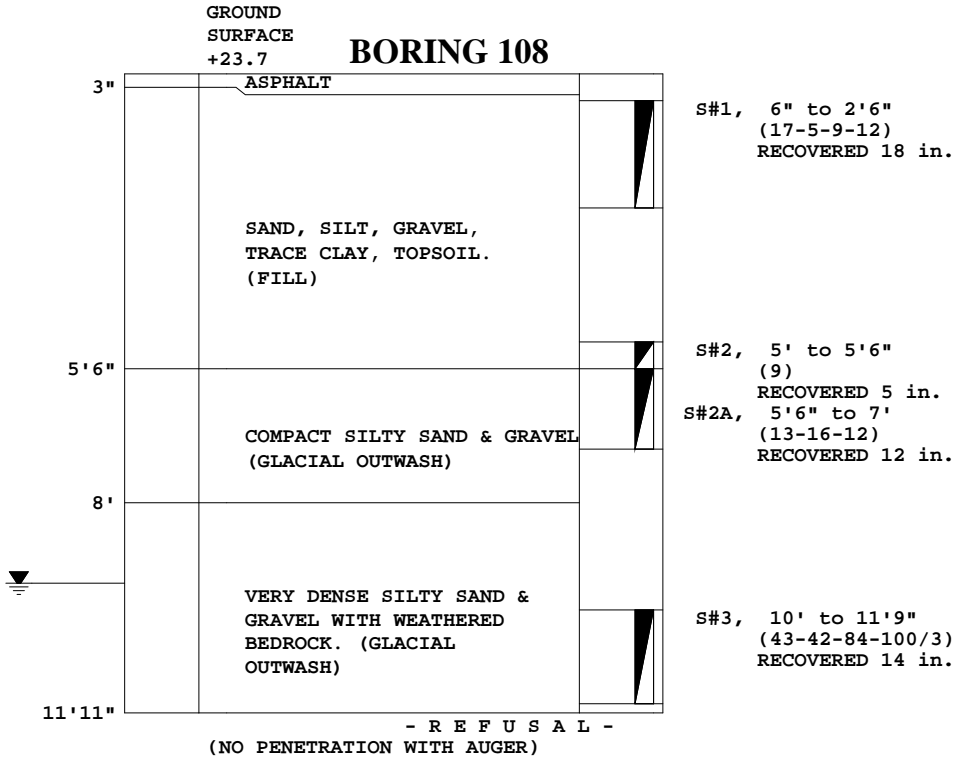

WATER LEVEL 9'6"  
 SIZE OF AUGER: 2 1/4" LENGTH: 11'11"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-8-2019  
 RIG TYPE: D-50 AUTO HAMMER

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

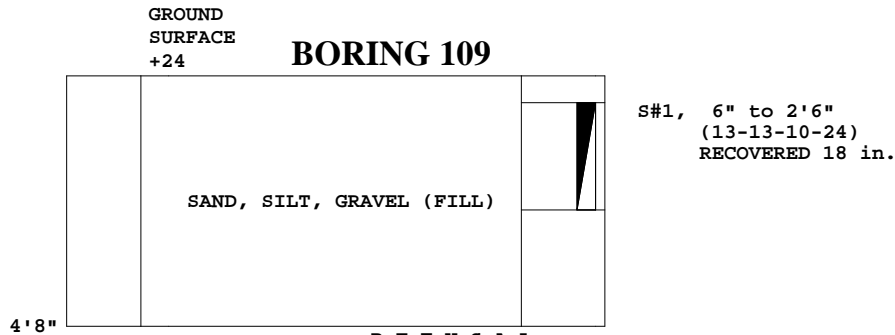

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500

To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019


Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

GROUND  
SURFACE  
+24

## BORING 109A

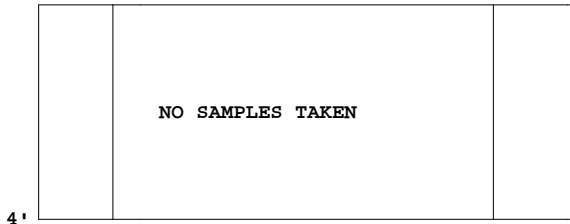

- R E F U S A L -  
(NO PENETRATION WITH AUGER)  
NO WATER ENCOUNTERED  
SIZE OF AUGER: 2 1/4" LENGTH: 4'0"  
DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
DATE STARTED & COMPLETED: 3-8-2019  
RIG TYPE: D-50 AUTO HAMMER  
NOTE: BORING MOVED 4'0" N.E. FROM B-109

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

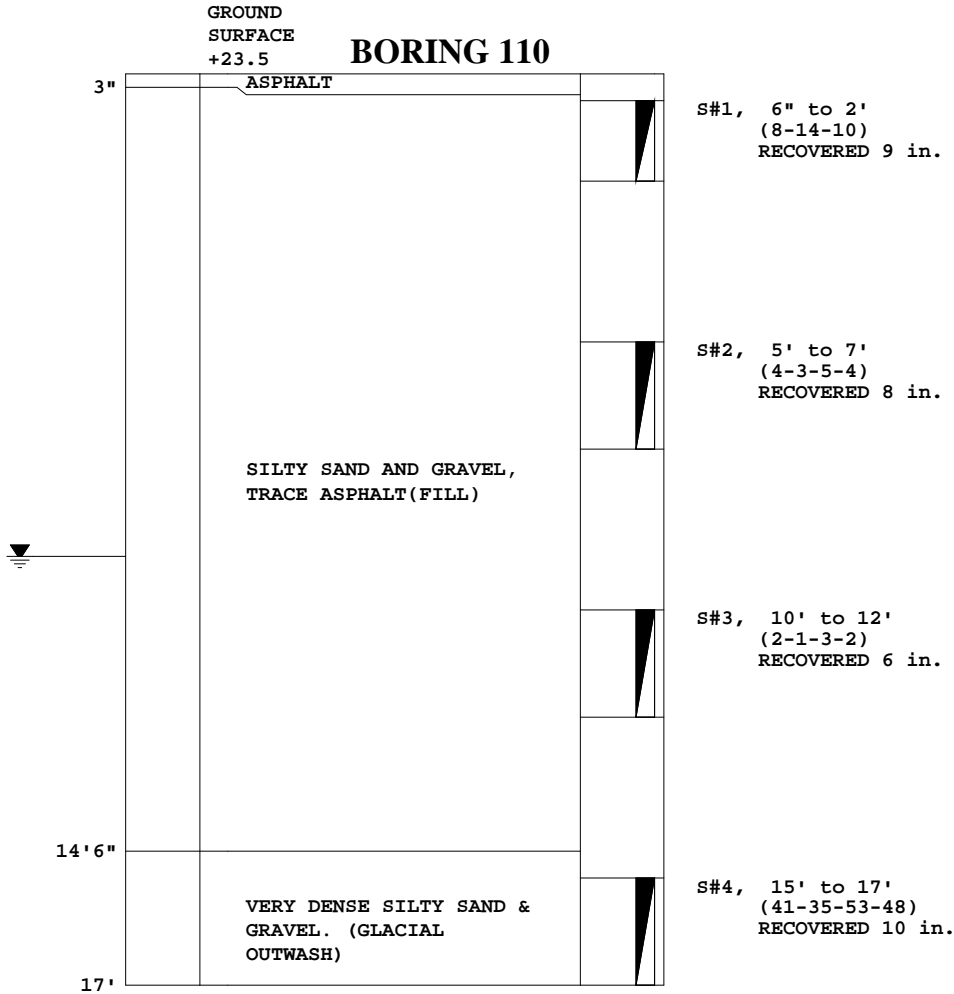

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

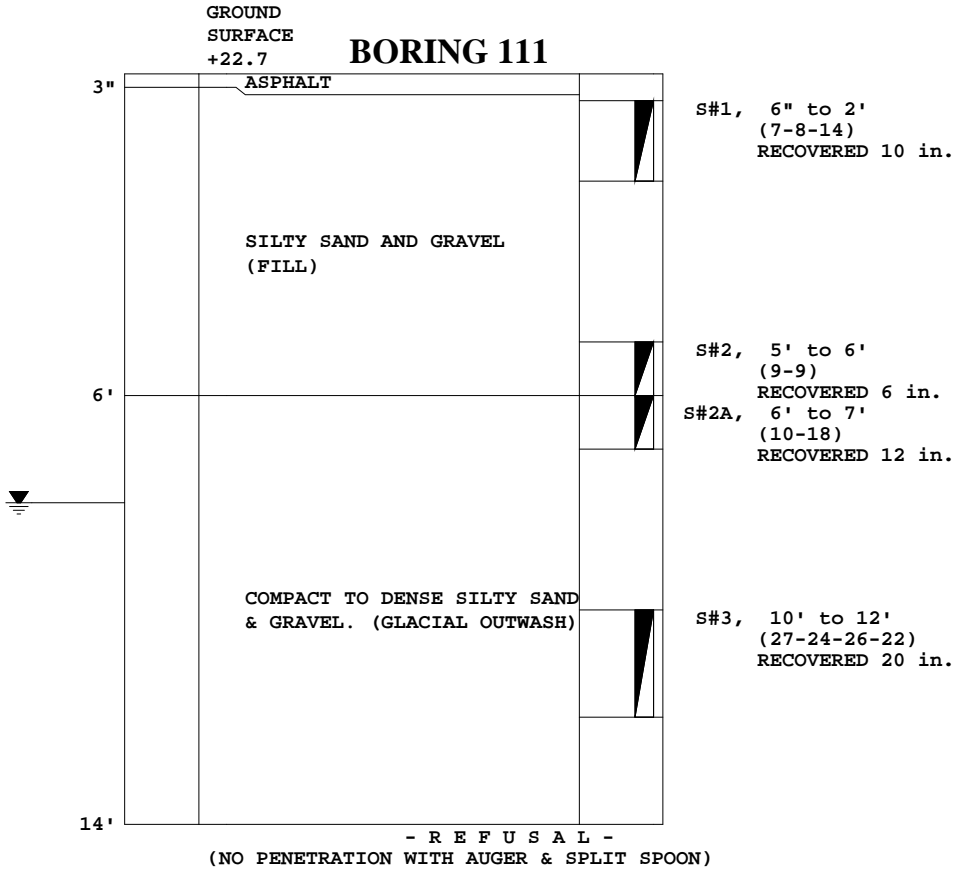

WATER LEVEL 8'  
 SIZE OF AUGER: 2 1/4" LENGTH: 14'0"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-11-2019  
 RIG TYPE: D-50 AUTO HAMMER

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

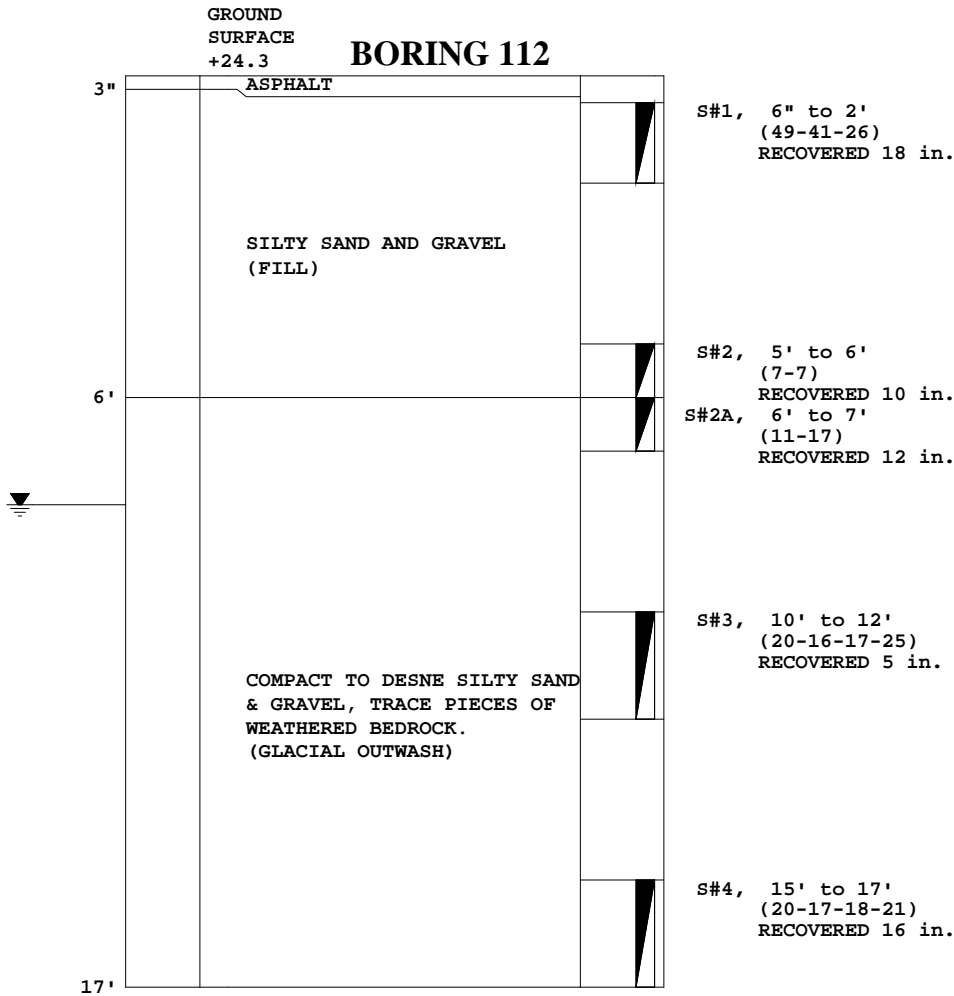

WATER LEVEL 8'  
 SIZE OF AUGER: 2 1/4" LENGTH: 15'0"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-11-2019  
 RIG TYPE: D-50 AUTO HAMMER

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

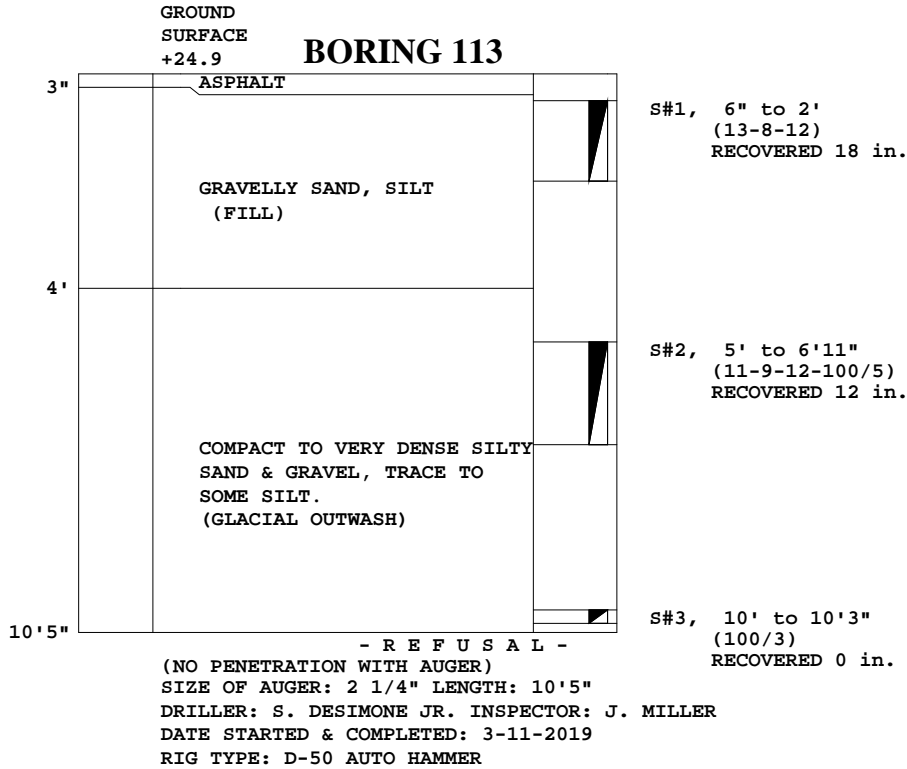

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

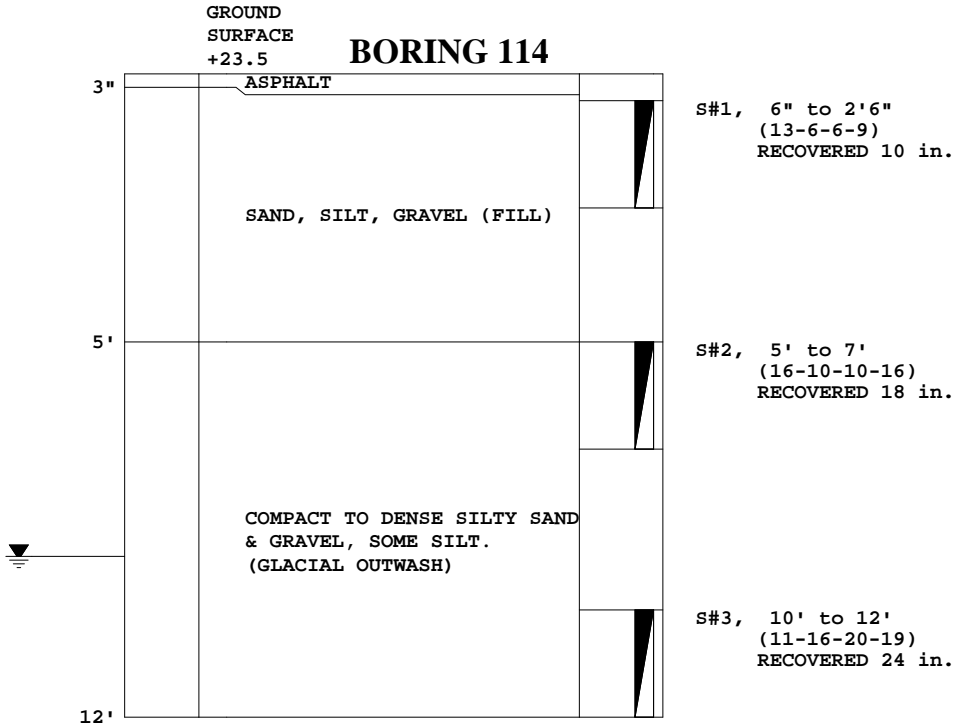

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).



# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

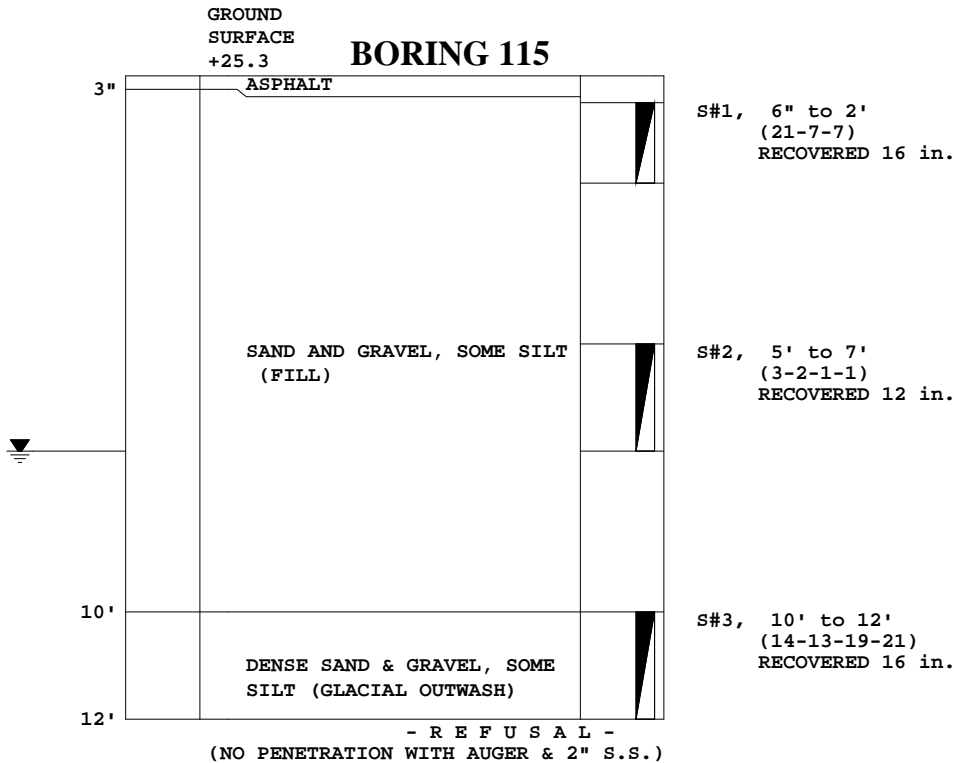

WATER LEVEL 7'  
 SIZE OF AUGER: 2 1/4" LENGTH: 14'1"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-11-2019  
 RIG TYPE: D-50, AUTO HAMMER

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

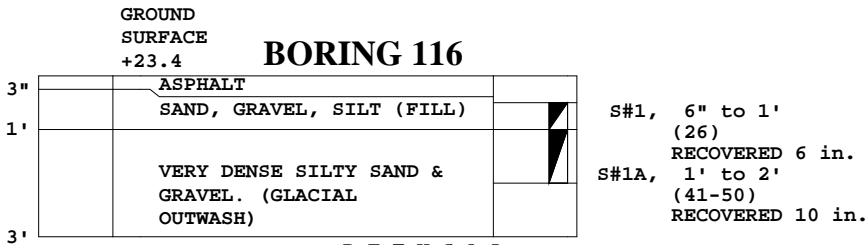

- R E F U S A L -  
(NO PENETRATION WITH AUGERS)  
SIZE OF AUGER: 2 1/4" LENGTH: 3'0"  
DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
DATE STARTED & COMPLETED: 3-7-2019  
RIG TYPE: D-50, AUTO HAMMER.

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

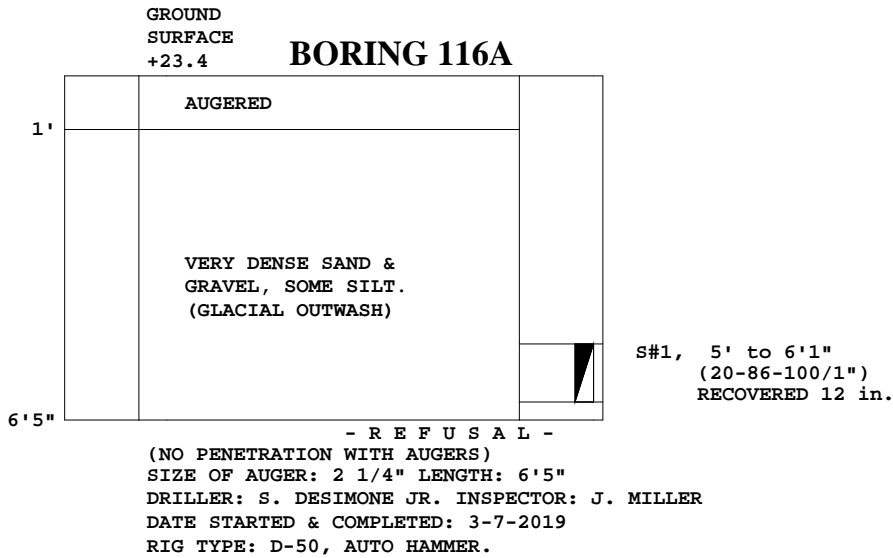

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

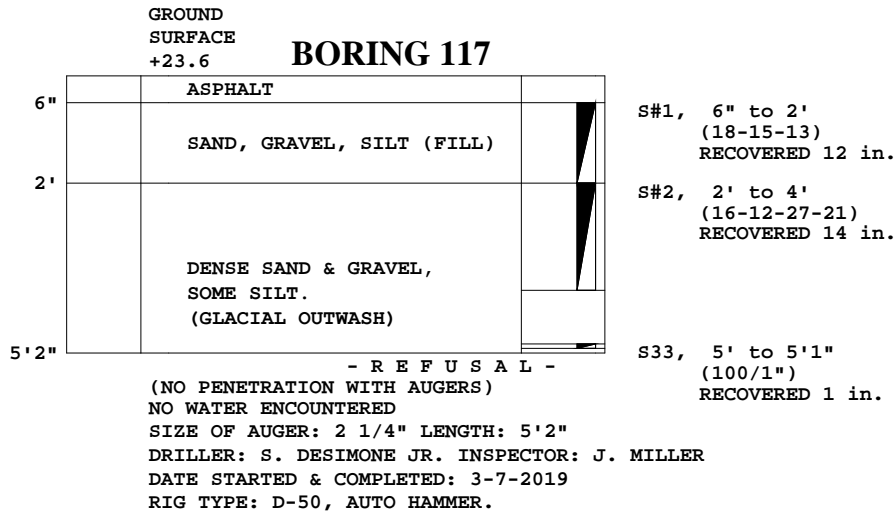

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in.= 3.5 ft.

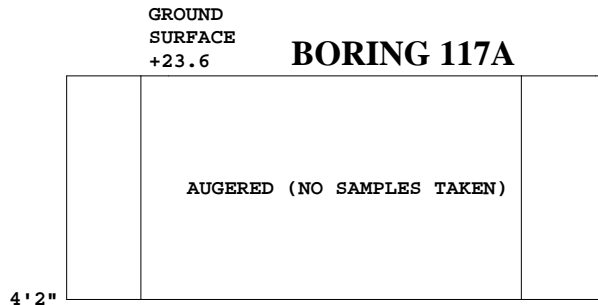

- R E F U S A L -

(NO PENETRATION WITH AUGERS)

NO WATER ENCOUNTERED

SIZE OF AUGER: 2 1/4" LENGTH: 4'2"

DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER

DATE STARTED & COMPLETED: 3-7-2019

RIG TYPE: D-50, AUTO HAMMER.

NOTE: THIS BORING MOVED 5'0" SW OF ORIGINAL LOCATION.

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500

To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019


Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

GROUND  
SURFACE

## BORING 117B

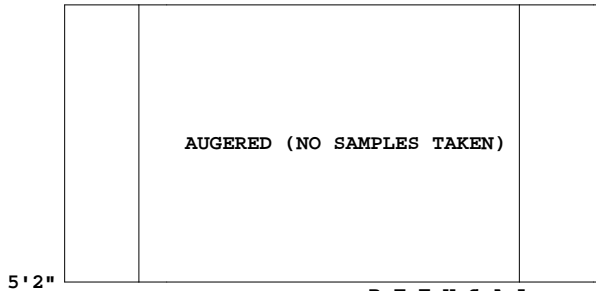

AUGERED (NO SAMPLES TAKEN)

- R E F U S A L -

(NO PENETRATION WITH AUGERS)

NO WATER ENCOUNTERED

SIZE OF AUGER: 2 1/4" LENGTH: 5'2"

DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER

DATE STARTED & COMPLETED: 3-7-2019

RIG TYPE: D-50, AUTO HAMMER.

NOTE: THIS BORING MOVED 6'0" NW OF ORIGINAL LOCATION.

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500

To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019


Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

GROUND  
SURFACE  
+27.9

## BORING 118

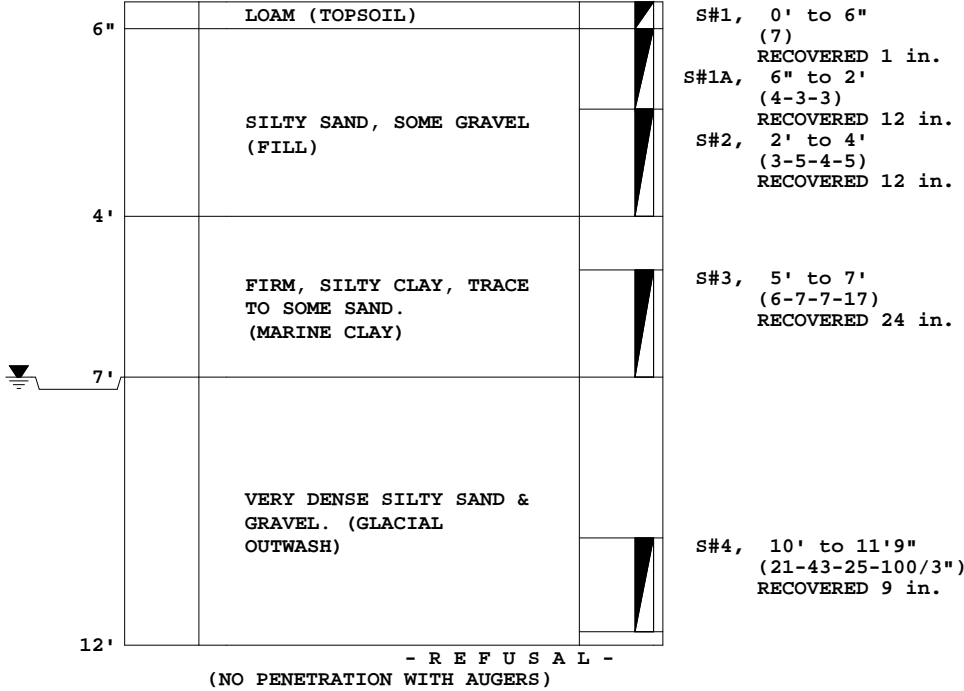

WATER LEVEL 7'  
 SIZE OF AUGER: 2 1/4" LENGTH: 12'0"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-7-2019  
 RIG TYPE: D-50, AUTO HAMMER.

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

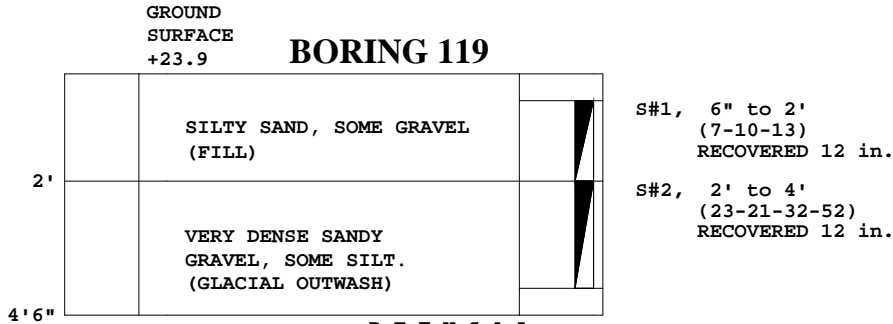

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).



# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in.= 3.5 ft.

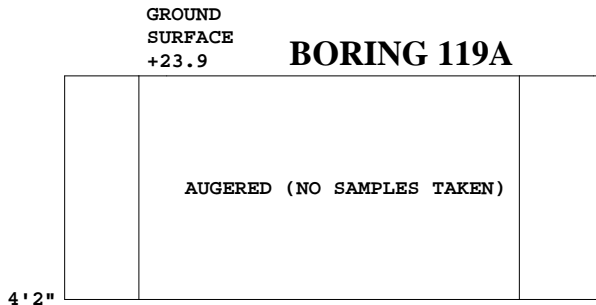

- R E F U S A L -

(NO PENETRATION WITH AUGERS)

NO WATER ENCOUNTERED

SIZE OF AUGER: 2 1/4" LENGTH: 4'2"

DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER

DATE STARTED & COMPLETED: 3-7-2019

RIG TYPE: D-50, AUTO HAMMER.

NOTE: THIS BORING MOVED 6'0" WEST OF ORIGINAL LOCATION.

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001


Telephone (781) 391-4500

To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA Date: 3-13-2019 Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH Scale: 1 in. = 3.5 ft.

GROUND  
SURFACE  
+23.9

## BORING 119B

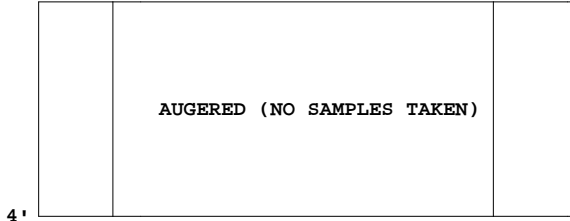

- R E F U S A L -  
(NO PENETRATION WITH AUGERS)  
NO WATER ENCOUNTERED  
SIZE OF AUGER: 2 1/4" LENGTH: 4'0"  
DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
DATE STARTED & COMPLETED: 3-7-2019  
RIG TYPE: D-50, AUTO HAMMER.  
NOTE: THIS BORING MOVED 6'0" NW OF ORIGINAL LOCATION.

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500

To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019


Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

GROUND  
SURFACE  
+24.5

## BORING 122

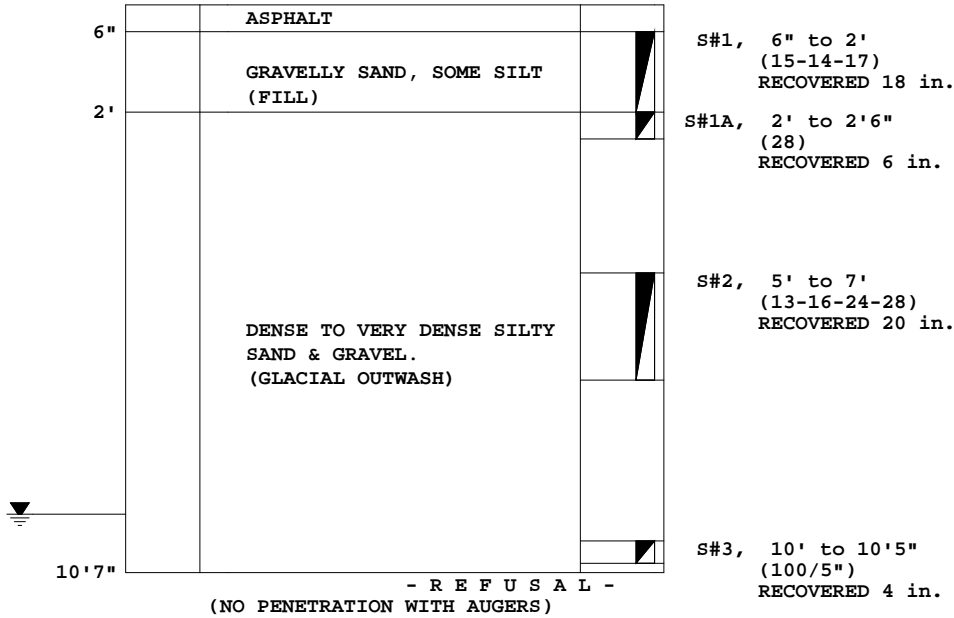

WATER LEVEL 9'6"  
 SIZE OF AUGER: 2 1/4" LENGTH: 10'7"  
 DRILLER: S. DESIMONE JR. INSPECTOR: J. MILLER  
 DATE STARTED & COMPLETED: 3-8-2019  
 RIG TYPE: D-50, AUTO HAMMER.

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).

# CARR-DEE CORP.

37 LINDEN STREET

MEDFORD, MA 02155-0001

Telephone (781) 391-4500


To: MCPHAIL ASSOC., LLC, 2269 MASS. AVE., CAMBRIDGE, MA

Date: 3-13-2019

Job No.: 2019-49

Location: WEST END YARDS, ROUTE 1 BY-PASS, PORTSMOUTH, NH

Scale: 1 in. = 3.5 ft.

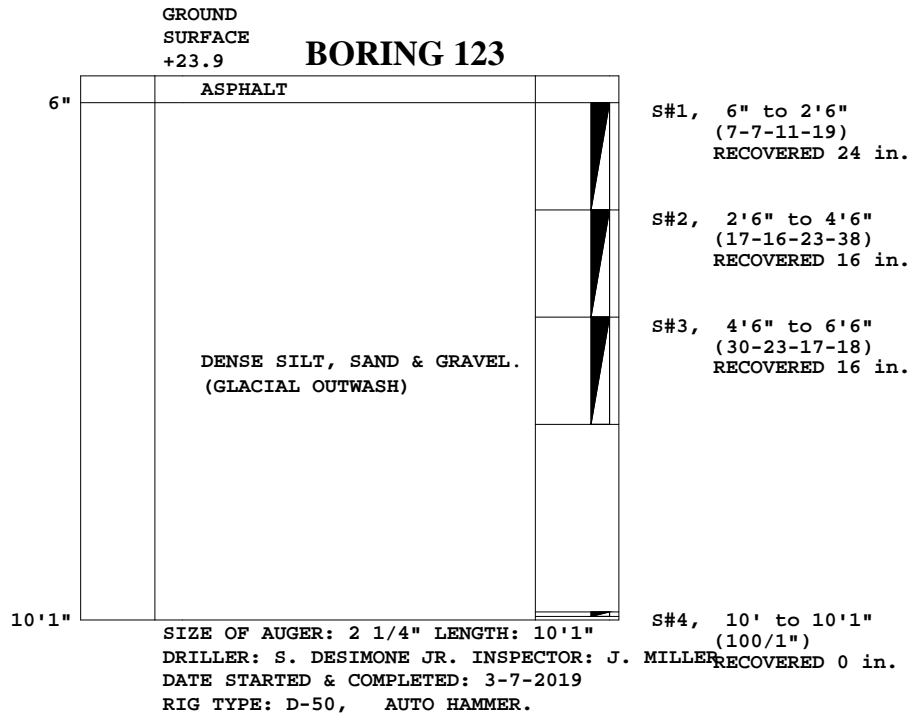

All samples have been visually classified by . Unless otherwise specified, water levels noted were observed at completion of borings, and do not necessarily represent permanent ground water levels. Figures in parenthesis indicate the number of blows required to drive Two-inch Split Sampler 6 inches using 140 lb. weight falling 30 inches(±). Figures in column to left (if noted) indicate number of blows to drive casing one foot, using 300 lb. weight falling 24 inches (±).



**APPENDIX C:**

**TEST PIT LOGS**  
**TP-101 THROUGH TP-119**

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 101

0 3 6 9 FT.

NORTH ←

→ SOUTH

GROUND SURFACE EL. +24.3

ASPHALT

0

0.3

LOOSE LIGHT BROWN SILTY SAND WITH GRAVEL (FILL)

1.0

COMPACT GRAY-BLACK SANDY SILT WITH  
GRAVEL AND TRACE COBBLES (FILL)

3

4.0

SOFT BLACK ORGANIC SILT,  
TRACE CLAY (ORGANIC DEPOSIT)

5.0

FIRM BLUE-GRAY CLAY  
(MARINE CLAY)

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION



JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 102

0 3 6 9 FT.

NORTH ←



→ SOUTH

GROUND SURFACE EL. +25.3

PAVEMENT

0.3

LOOSE BROWN SILT AND SAND WITH GRAVEL (FILL)

2.0  
2.1

ASPHALT LAYER

LOOSE BROWN SILT AND SAND WITH GRAVEL (FILL)

3.5

COMPACT BROWN SILTY SAND,  
TRACE GRAVEL (GLACIAL OUTWASH)

7.5

BOTTOM OF TEST PIT

DEPTH (FT.)

0

3

6

9

McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 6.0 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 103

NORTH ←

→ SOUTH

0 3 6 9 FT.

GROUND SURFACE EL. +25.6

ASPHALT

0.3

LOOSE TO COMPACT BROWN SILTY SAND WITH  
GRAVEL, SOME BRICK AND COBBLES (FILL)

2.5

CONCRETE PAD

3.5

FIRM LIGHT BROWN SILTY  
CLAY WITH SAND, TRACE  
GRAVEL (MARINE CLAY)

6.0

BOTTOM OF TEST PIT

DEPTH (FT.)

0

3

6

9

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION



JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 104

NORTH ←

→ SOUTH

0 3 6 9 FT.

GROUND SURFACE EL. +26.3

PAVEMENT

0.3

LOOSE LIGHT BROWN SILTY SAND, TRACE GRAVEL (FILL)

1.5

LOOSE TO COMPACT GRAY SANDY SILT, TRACE GRAVEL, TRACE BRICK AND WOOD (FILL)

3

5.5

COMPACT LIGHT BROWN SILTY SAND, TRACE TO SOME GRAVEL (GLACIAL OUTWASH)

6

6.5

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION


JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 105



**McPHAIL ASSOCIATES, LLC**

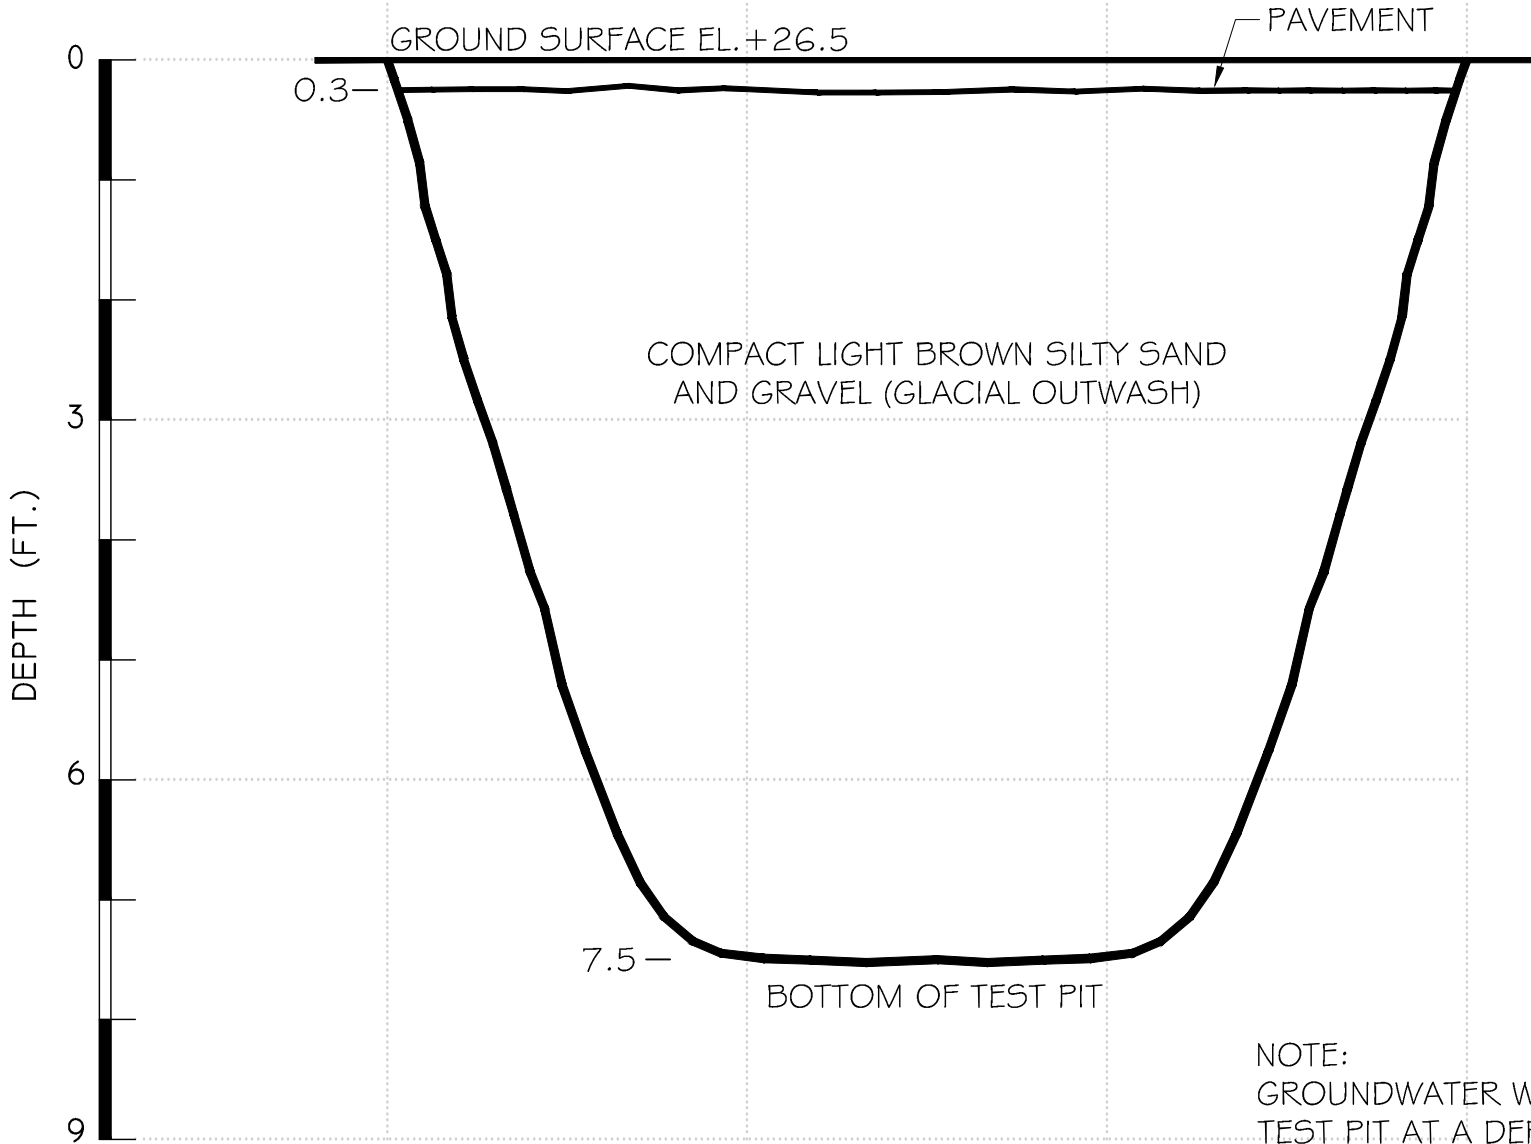

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 6.5 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 106

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +26.0

LOOSE BROWN SILTY SAND WITH SOME GRAVEL (FILL)

1.5

COMPACT TO DENSE BROWN-GRAY,  
SILTY SAND, TRACE TO SOME  
GRAVEL (GLACIAL OUTWASH)

3

6

7.5

BOTTOM OF TEST PIT

9

DEPTH (FT.)


McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 7.0 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 107

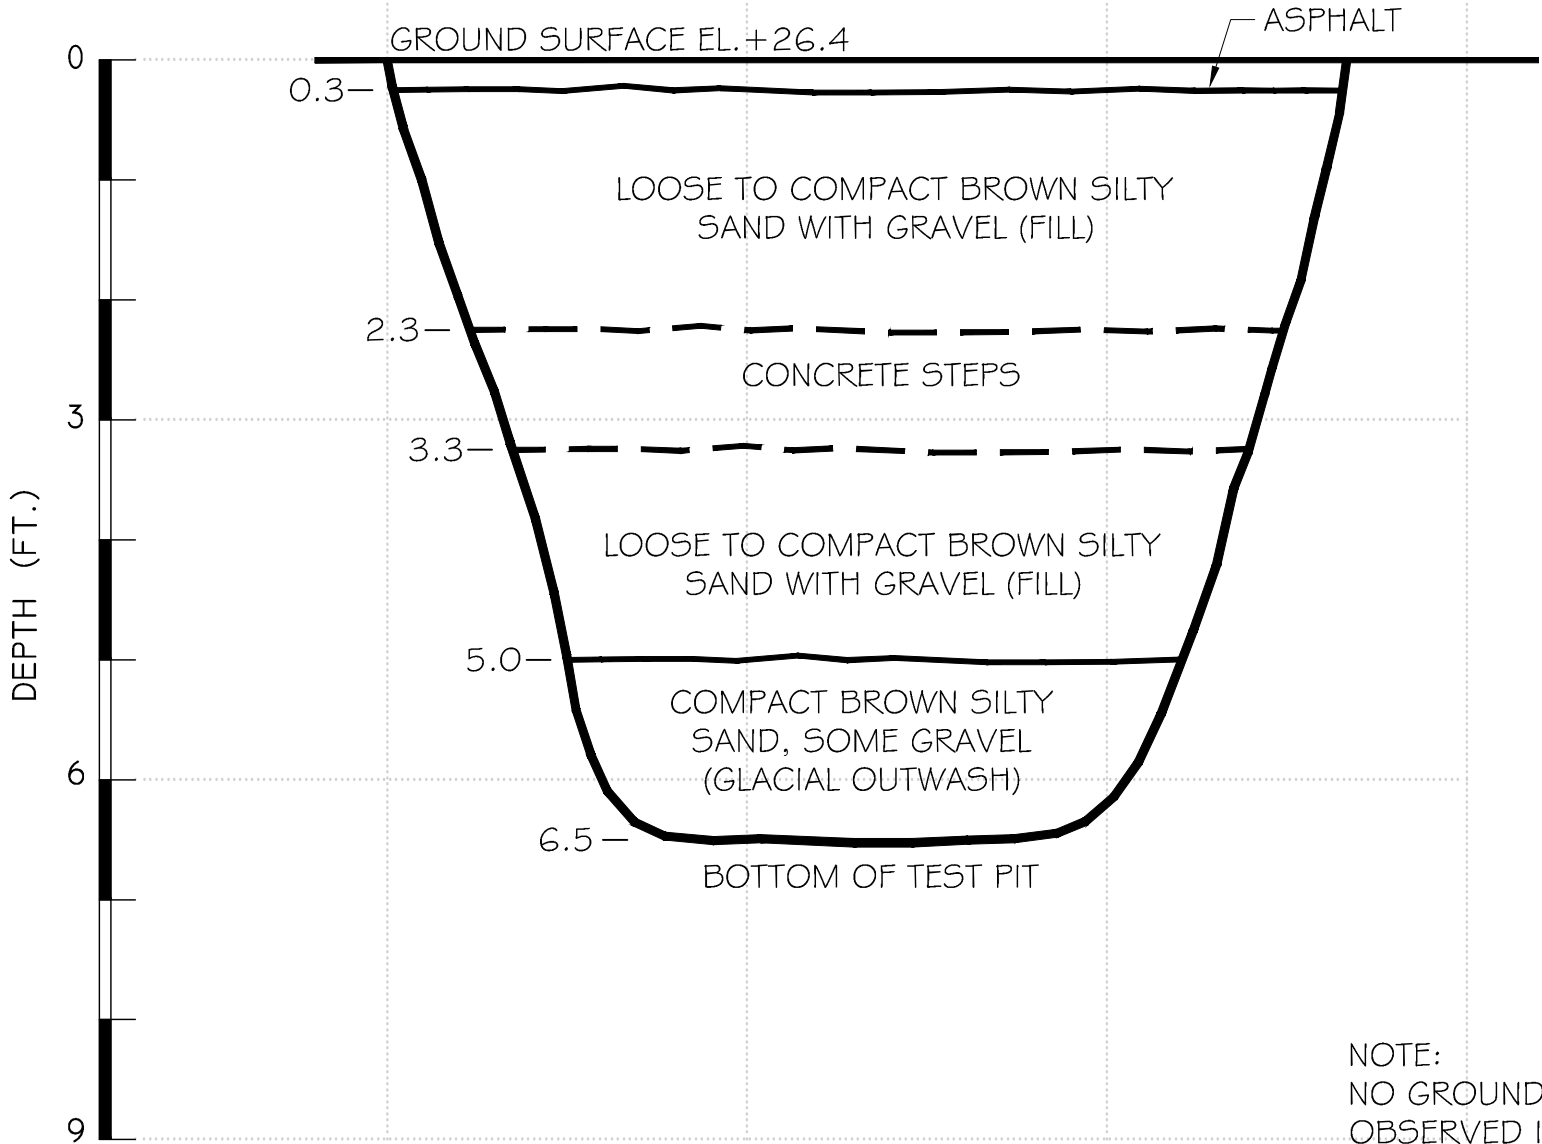

**McPHAIL ASSOCIATES, LLC**

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 108

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +23.7

PAVEMENT

0.3

COMPACT TO DENSE LIGHT BROWN  
SANDY GRAVEL WITH SOME SILT  
(GLACIAL OUTWASH)

0

3

6

7.5

REFUSAL ON POSSIBLE BEDROCK

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC



NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 7.0 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 109

0 3 6 9 FT.



GROUND SURFACE EL. +23.0

ASPHALT

0

0.3

LOOSE TO COMPACT BROWN SILT  
AND SAND WITH GRAVEL (FILL)

1.5

COMPACT GRAY TO BROWN REWORKED  
CLAYEY SILT, SOME FINE SAND (FILL)

3

3.0

COMPACT LIGHT BROWN  
SILTY SAND, SOME GRAVEL  
(GLACIAL OUTWASH)

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 110

NORTH ←

→ SOUTH

0 3 6 9 FT.

GROUND SURFACE EL. +22.2

ASPHALT

0.3

BROWN SILTY SAND WITH SOME GRAVEL (FILL)

1.0

COMPACT SLIGHT BROWN  
REWORKED CLAYEY SILT AND FINE  
SAND, TRACE GRAVEL (FILL)

3

4.5

COMPACT LIGHT BROWN SILT  
AND SAND, TRACE TO SOME  
GRAVEL (GLACIAL OUTWASH)

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION


JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 111



**McPHAIL ASSOCIATES, LLC**

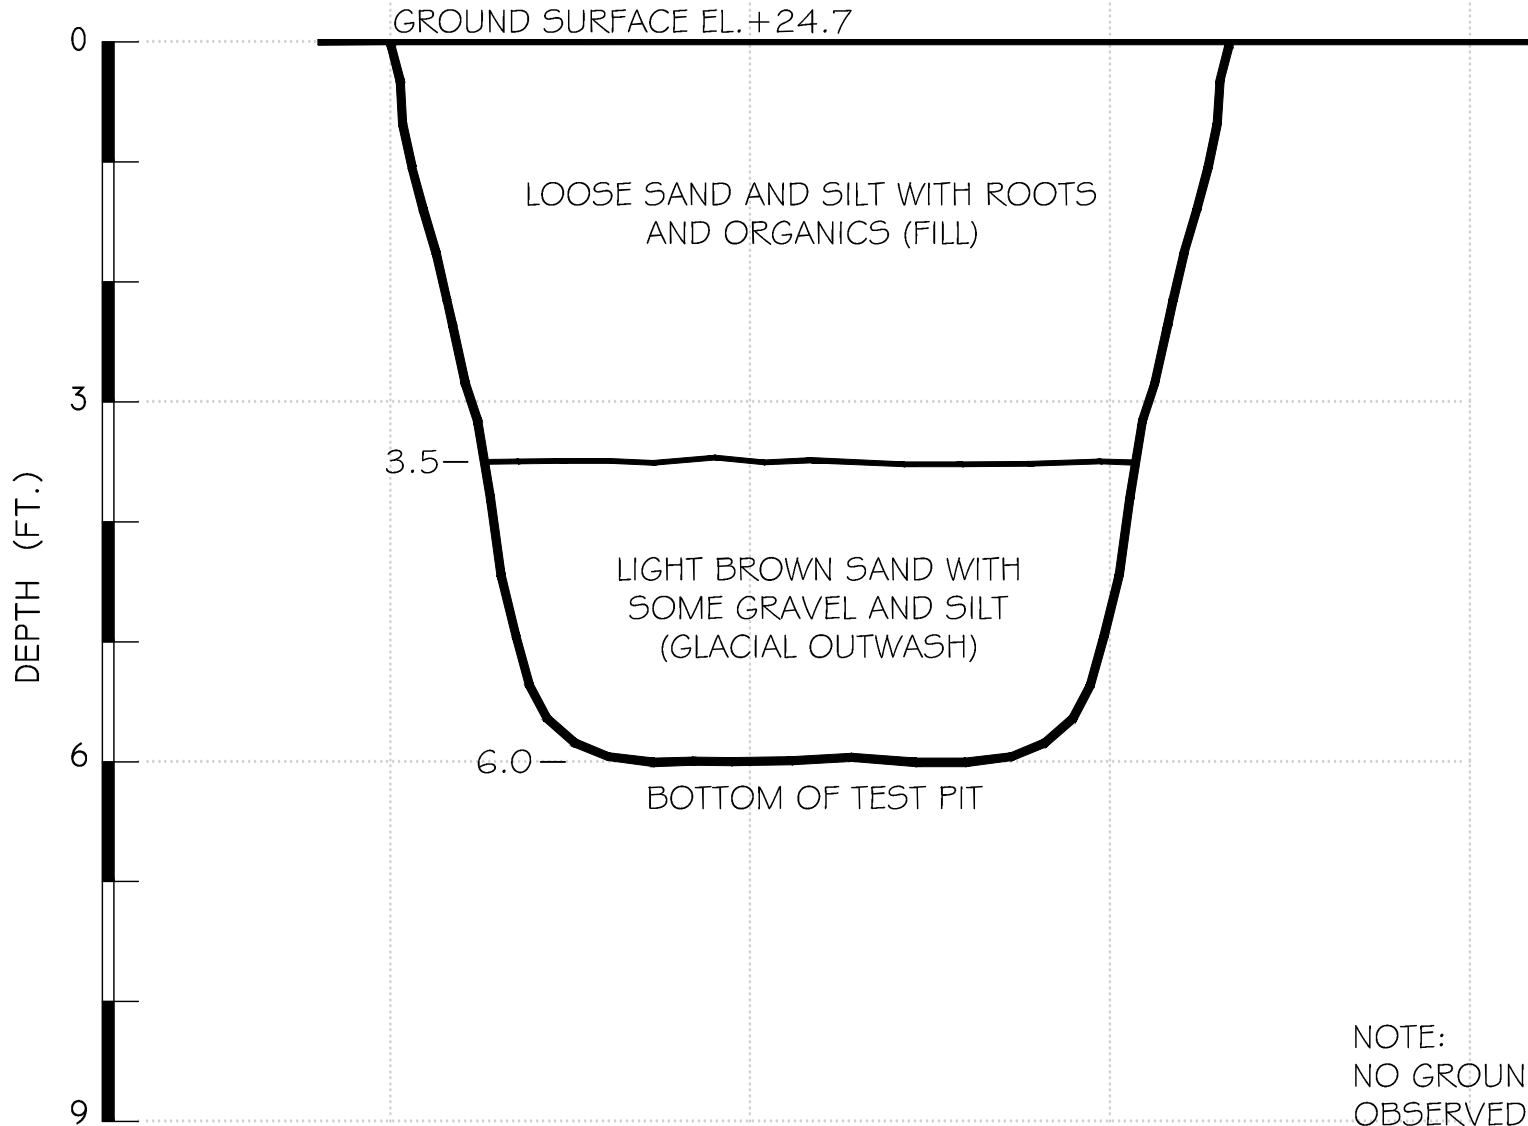

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION



JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 112

NORTH ←

→ SOUTH

0 3 6 9 FT.

GROUND SURFACE EL. +23.1

PAVEMENT

0

0.3

COMPACT BROWN SILT AND SAND WITH GRAVEL (FILL)

1.5

COMPACT GRAY SILTY SAND AND GRAVEL, TRACE CLAY (FILL)

3



ACTIVE 3/4" COPPER WATER LINE

4.5

SOFT BLACK ORGANIC SILT, TRACE CLAY (ORGANIC DEPOSIT)

5.5

FIRM BLUE CLAY (MARINE CLAY)

6

6.5

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC


NOTE:  
GROUNDWATER WAS OBSERVED IN TEST PIT AT A DEPTH OF 5.0 FEET UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG


TEST PIT NO. 113

NORTH ←



→ SOUTH

GROUND SURFACE EL. +24.4

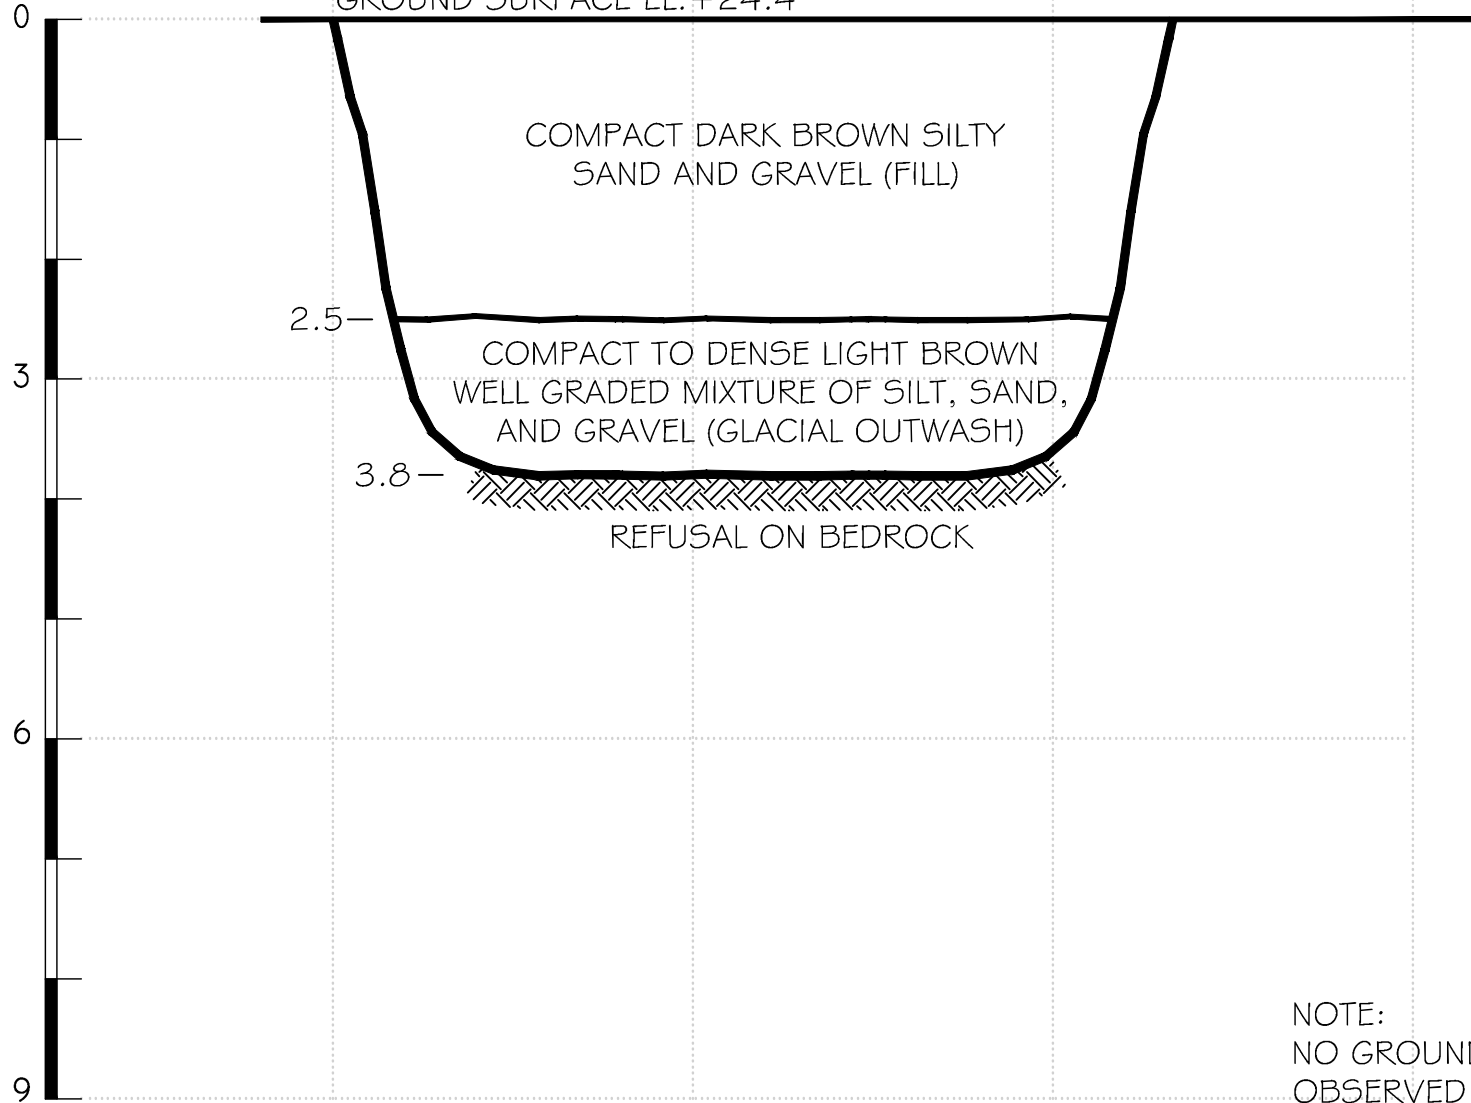

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 1, 2019

# TEST PIT LOG

TEST PIT NO. 114

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +24.3

PAVEMENT

0.3

COMPACT TO DENSE LIGHT  
BROWN SILT AND SAND, TRACE  
GRAVEL (GLACIAL OUTWASH)

3

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS  
OBSERVED IN TEST PIT UPON  
COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 115

NORTH ←

→ SOUTH

0 3 6 9 FT.

GROUND SURFACE EL. +22.9

0  
1.0  
LOOSE TO COMPACT BROWN SILTY, GRAVELLY SAND WITH WOOD AND BRICK (FILL)

3  
DENSE TO VERY DENSE LIGHT BROWN SILT AND SAND, TRACE TO SOME GRAVEL, TRACE CLAY (GLACIAL OUTWASH)

5.0  
BOTTOM OF TEST PIT

DEPTH (FT.)

0  
3  
6  
9

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS OBSERVED IN TEST PIT UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG


TEST PIT NO. 116

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +18.4

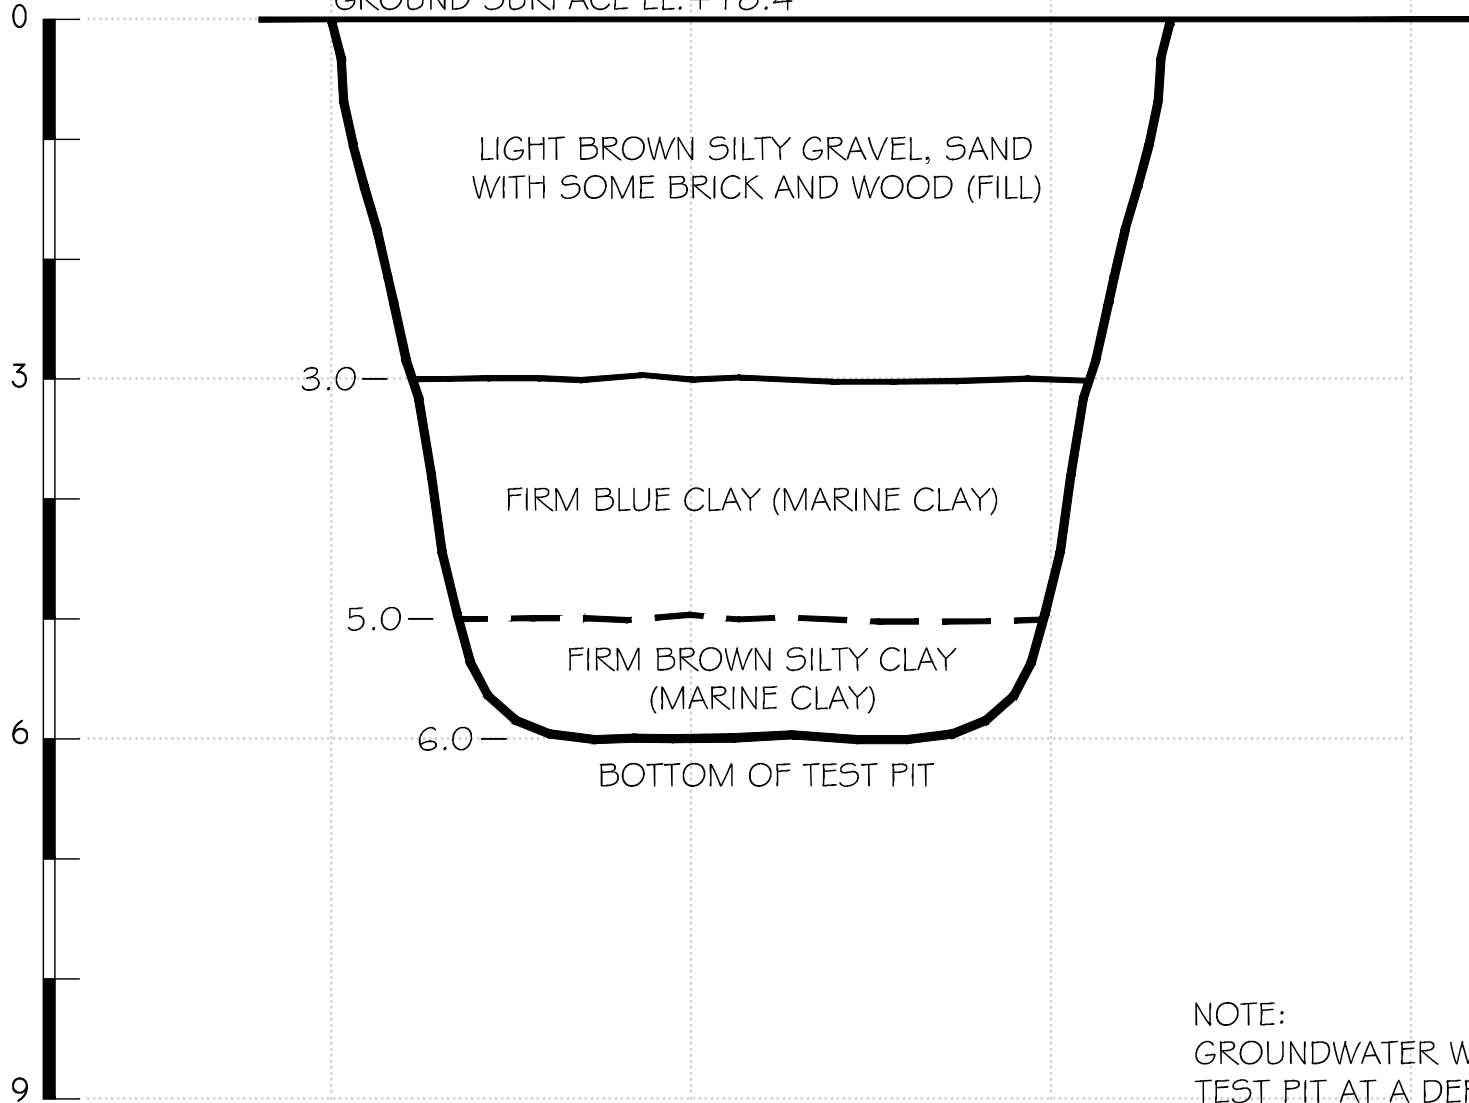

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 6.0 FEET  
UPON COMPLETION OF EXCAVATION

McPHAIL ASSOCIATES, LLC

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 117

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +18.8

0

LIGHT BROWN SILTY SAND WITH GRAVEL,  
CONTAINING WOOD AND ASPHALT (FILL)

3

3.2

3.5

4.0

CONTINUOUS WOOD

SOFT BLACK ORGANIC SILT,  
TRACE GRAVEL AND SAND  
(ORGANIC DEPOSIT)

FIRM GRAY TO BLUE SILTY CLAY  
OBSERVED TO BE MORE SILTY  
WITH DEPTH (MARINE CLAY)

6

6.5

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 5.5 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG

TEST PIT NO. 118

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +18.4

CONCRETE PAD

0.5

COMPACT BROWN-RED SILTY GRAVEL,  
SAND, TRACE WOOD AND BRICK (FILL)

3

3.0

DENSE GRAY TO BROWN  
SILTY CLAY (MARINE CLAY)

6

6.0

BOTTOM OF TEST PIT

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 5.0 FEET  
UPON COMPLETION OF EXCAVATION

JOB NO. 6524  
DATE MAR. 5, 2019

# TEST PIT LOG


TEST PIT NO. 119

NORTH ←

0 3 6 9 FT.

→ SOUTH

GROUND SURFACE EL. +17.2

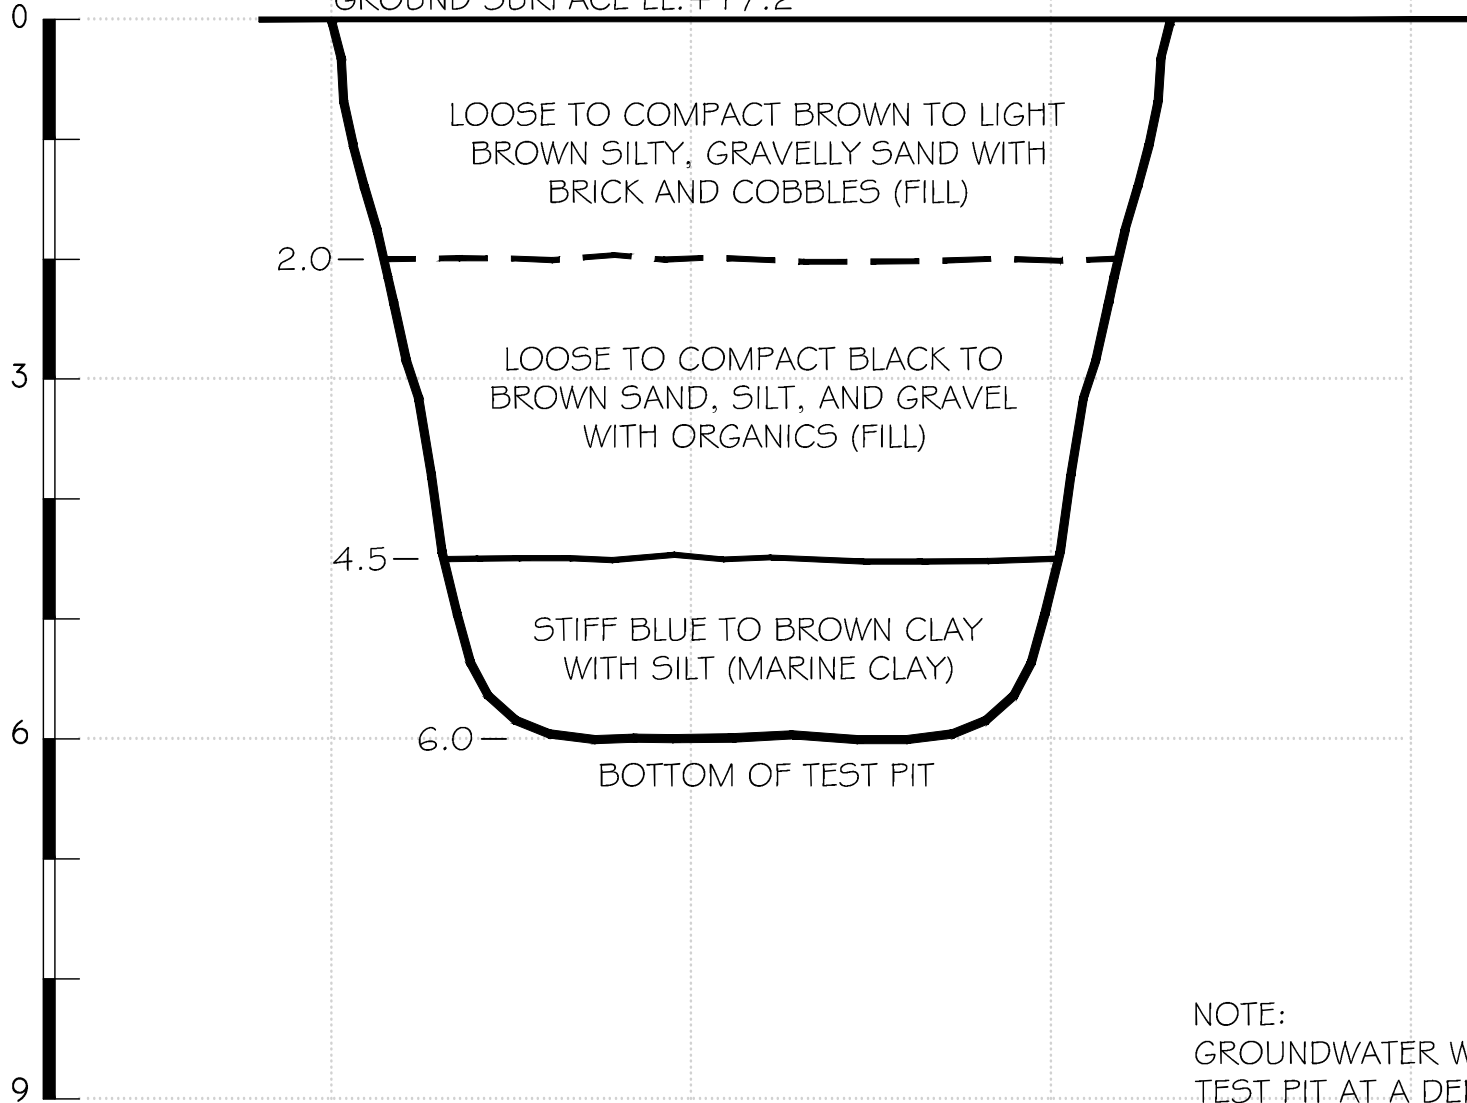

McPHAIL ASSOCIATES, LLC

NOTE:  
GROUNDWATER WAS OBSERVED IN  
TEST PIT AT A DEPTH OF 5.5 FEET  
UPON COMPLETION OF EXCAVATION





**APPENDIX D:**

**BORING LOGS**  
**B-1 THROUGH B-3**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.01	<b>Boring No.</b>
<b>Location:</b> 55 Cate Stree	<b>Date Started:</b> 12-10-19	<b>B-1 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 12-10-19	

<b>Contractor:</b> Carr-Dee Corp.	<b>Casing Type/Depth (ft):</b> 3"	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Steve/Frank	<b>Casing Hammer (lbs)/Drop (in):</b> 300/24"	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> J. Miller	<b>Sampler Size/Type:</b> 24" split spoon	12-10-19	4
<b>Surface Elevation (ft):</b> 25.2	<b>Sampler Hammer (lbs)/Drop (in):</b> 140/30"	<b>Elev.</b>	<b>Notes</b>
		21.2	

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample						Sample Description and Boring Notes
					TVOC (ppm)	N-Value RQD	No.	Pen./Rec. (in)	Depth (ft)	Blows/6" Min/ft	
	25	[Symbol]	0.4 / 24.8	ASPHALT							
1	24	[Symbol]		FILL	0.0	22	S1	18/16	0.5-2.0	40 22 18	Compact, light brown to black, SAND and GRAVEL, some silt, with asphalt and glass (FILL).
2	23	[Symbol]	2.0 / 23.2	GLACIAL OUTWASH	0.0	89	S2	24/16	2.0-4.0	30 29 60 65	Very dense, light brown, SILTY SAND, some gravel (GLACIAL OUTWASH).
3	22										
4	21										
5	20										
6	19	[Symbol]			0.0	62	S3	24/2	4.0-6.0	30 32 42	Very dense, light brown, SILTY SAND, some gravel (GLACIAL OUTWASH).
7	18	[Symbol]	6.8 / 18.4		0.0	130/10"	S4	10/4	6.0-6.8	30 100/4"	Very dense, brown, SAND and SILT and GRAVEL (GLACIAL OUTWASH).  Split spoon refusal 6'10" below ground surface. Roller bit refusal 6'11" below ground surface.
8	17			Bottom of borehole 6.83' below ground surface.							
9	16										
10	15										
11	14										
12	13										
13	12										
14	11										

GRANULAR SOILS	
BLOWS/FT.	DENSITY
0-4	V.LOOSE
4-10	LOOSE
10-30	COMPACT
30-50	DENSE
>50	V.DENSE

SOIL COMPONENT		
DESCRIPTIVE TERM	PROPORTION OF TOTAL	SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"
"TRACE"	0-10%	
"SOME"	10-20%	
"ADJECTIVE" (eg SANDY, SILTY)	20-35%	
"AND"	35-50%	

COHESIVE SOILS	
BLOWS/FT.	CONSISTENCY
<2	V.SOFT
2-4	SOFT
4-8	FIRM
8-15	STIFF
15-30	V.STIFF
>30	HARD

**Notes:**  
OW installed 6.83' below ground surface.  
Total Volatile Organic Compounds (TVOC) measured w/ PID Model:  
TVOC Background: ppm  
Weather:  
Temperature:



**McPHAIL ASSOCIATES, LLC**  
2269 MASSACHUSETTS AVENUE  
CAMBRIDGE, MA 02140  
TEL: 617-868-1420  
FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.01	<b>Boring No.</b>
<b>Location:</b> 55 Cate Street	<b>Date Started:</b> 12-10-19	<b>B-2 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 12-10-19	

<b>Contractor:</b> Carr-Dee Corp.	<b>Casing Type/Depth (ft):</b> N/A	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Steve/Frank	<b>Casing Hammer (lbs)/Drop (in):</b> N/A	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> J. Miller	<b>Sampler Size/Type:</b> 24" split spoon	12-10-19	6
<b>Surface Elevation (ft):</b> 24.4	<b>Sampler Hammer (lbs)/Drop (in):</b> 140/30"	<b>Elev.</b>	<b>Notes</b>
		18.4	

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev to Strata Change (ft)	Stratum	Sample						Sample Description and Boring Notes
					TVOC (ppm)	N-Value RQD	No.	Pen./Rec. (in)	Depth (ft)	Blows/6" Min/ft	
	24		0.3 / 24.1	ASPHALT							
1	23			FILL	0.0	29	S1	18/14	0.5-2.0	36 29 54	Compact, brown, SILTY SAND, some gravel, with brick and asphalt (FILL).
2	22				0.0	34	S2	24/12	2.0-4.0	40 24 10 13	Dense, black to brown, SILTY SAND, some gravel, some cobbles (FILL).
3	21				1.7	41	S3	24/10	4.0-6.0	17 16 25 33	Dense, black, SAND and GRAVEL, some silt, with wood and ash and cinders (FILL). Odor of mothballs.
4	20										
5	19		6.0 / 18.4	GLACIAL OUTWASH	0.0	36	S4	17/14	6.0-7.4	54 36 11/5"	Dense, brown to light brown, SAND and SILT and GRAVEL (GLACIAL OUTWASH). Split spoon refusal 75" below ground surface. Auger refusal 76" below ground surface.
6	18										
7	17		7.5 / 16.9								
8	16			Bottom of borehole 7.5' below ground surface.							
9	15										
10	14										
11	13										
12	12										
13	11										
14	10										

GRANULAR SOILS	
BLOWS/FT.	DENSITY
0-4	V.LOOSE
4-10	LOOSE
10-30	COMPACT
30-50	DENSE
>50	V.DENSE

SOIL COMPONENT		
DESCRIPTIVE TERM	PROPORTION OF TOTAL	SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"
"TRACE"	0-10%	
"SOME"	10-20%	
"ADJECTIVE" (eg SANDY, SILTY)	20-35%	
"AND"	35-50%	

COHESIVE SOILS	
BLOWS/FT.	CONSISTENCY
<2	V.SOFT
2-4	SOFT
4-8	FIRM
8-15	STIFF
15-30	V.STIFF
>30	HARD

**Notes:**  
OW installed 7.5' below ground surface.  
Total Volatile Organic Compounds (TVOC) measured w/ PID Model:  
TVOC Background: ppm  
Weather:  
Temperature:



**McPHAIL ASSOCIATES, LLC**  
2269 MASSACHUSETTS AVENUE  
CAMBRIDGE, MA 02140  
TEL: 617-868-1420  
FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.01	<b>Boring No.</b>
<b>Location:</b> 55 Cate Street	<b>Date Started:</b> 12-10-18	<b>B-3 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 12-10-18	

<b>Contractor:</b> Carr-Dee Corp.	<b>Casing Type/Depth (ft):</b> 3"	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Steve/Frank	<b>Casing Hammer (lbs)/Drop (in):</b> 300/24"	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> J. Miller	<b>Sampler Size/Type:</b> 24" split spoon	12-10-19	6
<b>Surface Elevation (ft):</b> 24.2	<b>Sampler Hammer (lbs)/Drop (in):</b> 140/30"	<b>Elev.</b>	<b>Notes</b>
		18.2	

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample						Sample Description and Boring Notes
					TVOC (ppm)	N-Value RQD	No.	Pen./Rec. (in)	Depth (ft)	Blows/6" Min/ft	
	24	[Symbol]	0.4 / 23.8	ASPHALT							
1	23	[Symbol]		FILL	0.0	28	S1	18/10	0.5-2.0	18 28 18	Dense, light brown, SAND and GRAVEL, trace silt (FILL).
2	22	[Symbol]			0.0	46	S2	24/16	2.0-4.0	21 23 23	Dense, light brown, SAND and GRAVEL, trace silt (FILL).
3	21	[Symbol]		GLACIAL OUTWASH							
4	20	[Symbol]	4.0 / 20.2		0.0	50	S3	24/20	4.0-6.0	27 24 26 30	Dense to very dense, SILTY SAND and GRAVEL (GLACIAL OUTWASH).
5	19	[Symbol]			0.0	54	S4	24/14	6.0-8.0	25 26 28 35	Very dense, light brown, SILTY SAND and GRAVEL (GLACIAL OUTWASH).
6	18	[Symbol]			0.0	53	S5	23/12	8.0-9.9	25 22 31 100/5"	Very dense, light brown, SILT and SAND, some gravel (GLACIAL OUTWASH). Split spoon refusal 9'11" below ground surface.
7	17	[Symbol]									
8	16	[Symbol]									
9	15	[Symbol]									
10	14	[Symbol]	9.9 / 14.3	Bottom of borehole 10.42' below ground surface.							
11	13										
12	12										
13	11										
14	10										

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		
COHESIVE SOILS		Notes:	
BLOWS/FT.	CONSISTENCY	OW installed 10' below ground surface. 10' of screen.	
<2	V.SOFT	Total Volatile Organic Compounds (TVOC) measured w/ PID Model:	
2-4	SOFT	TVOC Background: ppm	
4-8	FIRM	Weather:	
8-15	STIFF	Temperature:	
15-30	V.STIFF		
>30	HARD		



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**



**APPENDIX E:**

**TEST PIT LOGS**  
**TP-1 THROUGH TP-4**

JOB NO. 6524

DATE JUNE 21, 2018

# TEST PIT LOG

TEST PIT NO. 1

0 3 6 9 FT.

NORTH ←

→ SOUTH

GROUND SURFACE EL. +23.9

0.3

ASPHALT

LOOSE TO COMPACT, BROWN TO GRAY,  
SAND AND GRAVEL WITH BOULDERS, SOME  
COBBLES AND BRICK (FILL)

4.0

FIRM TO STIFF, BROWN DARK BLACK, ORGANIC  
SILT, SOME SAND (ORGANIC DEPOSIT)

5.0

FIRM TO STIFF, BLUE TO YELLOW,  
MOTTLED, SILTY CLAY (MARINE CLAY)

9

9.0

BOTTOM OF TEST PIT

NOTE:  
GROUNDWATER WAS OBSERVED IN  
OPEN TEST PIT AT A DEPTH OF 2 FEET  
UPON COMPLETION OF EXCAVATION

McPHAIL ASSOCIATES, LLC

DEPTH (FT.)

0

3

6

JOB NO. 6524

DATE JUNE 21, 2018

# TEST PIT LOG

TEST PIT NO. 2

0 3 6 9 FT.

N. WEST ←

→ S. EAST

GROUND SURFACE EL. +25.9

0

LOOSE TO COMPACT, BROWN, SAND AND GRAVEL, SOME SILT TRACE COBBLES, ROOTS, METAL TO GRAY SAND, TRACE CLAY (FILL)

3

4.0

COMPACT, BROWN TO LIGHT BROWN, SILTY AND GRAVELLY SAND (GLACIAL OUTWASH)

6

8.0

BOTTOM OF TEST PIT

9

NOTE:  
GROUNDWATER WAS OBSERVED IN OPEN TEST PIT AT A DEPTH OF 6 FEET UPON COMPLETION OF EXCAVATION

McPHAIL ASSOCIATES, LLC

DEPTH (FT.)

JOB NO. 6524



DATE JUNE 21, 2018

# TEST PIT LOG

TEST PIT NO. 3

0 3 6 9 FT.

WEST ←



→ EAST

GROUND SURFACE EL. +22.0

0

3

6

9

DEPTH (FT.)

LOOSE TO COMPACT, DARK BROWN TO GRAY,  
SILTY SAND AND GRAVEL, TRACE CLAY, ROOTS TO  
DARK BROWN, SAND, SOME ORGANIC SILT, SOME  
COBBLES AND BOULDERS (FILL)

7.0

COMPACT, GRAY, SILTY AND  
GRAVELLY SAND, TRACE CLAY, TRACE  
COBBLES (GLACIAL OUTWASH)

9.0

BOTTOM OF TEST PIT

NOTE:  
GROUNDWATER WAS OBSERVED IN  
OPEN TEST PIT AT A DEPTH OF 6.5 FEET  
UPON COMPLETION OF EXCAVATION

McPHAIL ASSOCIATES, LLC



JOB NO. 6524

DATE JUNE 21, 2018

# TEST PIT LOG

TEST PIT NO. 4

0 3 6 9 FT.

WEST ←

→ EAST

GROUND SURFACE EL. +24.4

0

LOOSE TO COMPACT, DARK BROWN, SANDY  
GRAVEL, TRACE SILT, TRACE METAL (FILL)

1.0

COMPACT, LIGHT BROWN, SAND AND  
GRAVEL, TRACE SILT (GLACIAL OUTWASH)

2.0

BOTTOM OF TEST PIT

3

6

9

DEPTH (FT.)

McPHAIL ASSOCIATES, LLC

NOTE:  
NO GROUNDWATER WAS OBSERVED IN OPEN  
TEST PIT UPON COMPLETION OF EXCAVATION



**APPENDIX F:**

**GEOPROBE LOGS**  
**GP-1 THROUGH GP-15**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 55 Cate Street	<b>Date Started:</b> 1-19-18	<b>GP-1 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-19-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Darwin	<b>Casing Hammer (lbs)/Drop (in):</b> NA	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-19-18	DRY
<b>Surface Elevation (ft):</b> 21.6	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	1-22-18	7.21
			14.4

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"	
1	21		2.5 / 19.1	FILL	n/a	S1	30/16	0.0-2.5		Brown/gray/black, SILTY SAND, trace gravel, with brick. (Fill)
2	20									
3	19		10.0 / 11.6	OUTWASH	n/a	S2	30/16	2.5-5.0		Brown/gray, SILTY SAND, some gravel, trace cobbles. (Outwash)
4	18									
5	17									
6	16									
7	15									
8	14									
9	13									
10	12									
11	11		Geoprobe refusal at 10 feet below ground surface.							
12	10									
13	9									
14	8									
15	7									
16	6									
17	5									
18	4									
19	3									
20	2									
21	1									
22	0									
	-1									

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 10 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Overcast



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 55 Cate Street	<b>Date Started:</b> 1-19-18	<b>GP-2 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-19-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Darwin	<b>Casing Hammer (lbs)/Drop (in):</b> NA	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-19-18	5.5
<b>Surface Elevation (ft):</b> 20.4	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	1-22-18	8.76
			11.6

Depth (ft)	Elev. (ft)	Symbol	Depth/EL to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes		
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"			
1	20	[Cross-hatch symbol]	0.5 / 19.9	CONCRETE						Brown/black, SILT, SAND, trace gravel. (Fill)		
2	19		n/a	S1	30/15	0.0-2.5						
3	18	[Cross-hatch symbol]		FILL						Brown/gray/black, SILTY SAND, trace gravel with ash & cinders. (Fill)		
4	17				n/a	S2	30/15	2.5-5.0				
5	16	[Dotted symbol]	4.5 / 15.9	ORGANIC DEPOSIT						Gray, SILTY SAND, trace clay, with organic fibers. (Organic Deposit)		
6	15		5.5 / 14.9		n/a	S3	30/30	5.0-7.5				
7	14	[Dotted symbol]		OUTWASH						Brown/gray, mottled, SILTY SAND, some clay. (Outwash)		
8	13				n/a	S4	30/30	7.5-10.0				
9	12				n/a	S4	30/30	7.5-10.0				
10	11				n/a	S5	24/10	10.0-12.0				Brown/gray, mottled, SILTY SAND, some clay. (Outwash)
11	10				n/a	S5	24/10	10.0-12.0				
12	9				n/a	S6	24/10	12.0-14.0				Brown/gray, mottled, SILTY SAND, some clay. (Outwash)
13	8											
14	7		14.0 / 6.4									
15	6			Geoprobe refusal at 14 feet below ground surface.								
16	5											
17	4											
18	3											
19	2											
20	1											
21	0											
22	-1											
	-2											

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 14 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Overcast



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 55 Cate Street	<b>Date Started:</b> 1-19-18	<b>GP-3 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-19-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Darwin	<b>Casing Hammer (lbs)/Drop (in):</b> NA	Date	Depth
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	Elev.	Notes
<b>Surface Elevation (ft):</b> 19.5	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	1-19-18	4 15.5
		1-22-18	6.24 13.3

Depth (ft)	Elev. (ft)	Symbol	Depth/EL to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes	
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"		
1	19		5.0 / 14.5	FILL	n/a	S1	30/27	0.0-2.5		Brown/gray, SILY SAND, trace gravel. (Fill)	
2	18				n/a	S2	30/27	2.5-5.0		Brown/gray, SILT, some clay, with wood and organic fibers. (Fill)	
3	17				n/a	S3	30/30	5.0-7.5		Brown/gray, mottled, SILTY CLAY. (Marine Clay)	
4	16				n/a	S4	30/30	7.5-10.0		Brown/gray, mottled, SILTY CLAY. (Marine Clay)	
5	15				n/a	S5	30/20	10.0-12.5		Brown/gray, mottled, SILTY CLAY with fine sand partings. (Marine Clay)	
6	14		16.5 / 3.0	MARINE CLAY	n/a	S6	30/20	12.5-15.0		Brown/gray, mottled, SILTY CLAY with fine sand partings. (Marine Clay)	
7	13				n/a	S7	18/23	15.0-16.5		Brown/gray, mottled, SILTY CLAY with fine sand partings. (Marine Clay)	
8	12				Geoprobe refusal at 16.5 feet below ground surface.						
9	11										
10	10										
11	9										
12	8										
13	7										
14	6										
15	5										
16	4										
17	3										
18	2										
19	1										
20	0										
21	-1										
22	-2										
	-3										

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 16.5 feet below ground surface with 13.5 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Overcast



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 55 Cate Street	<b>Date Started:</b> 1-19-18	<b>GP-4 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-19-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Darwin	<b>Casing Hammer (lbs)/Drop (in):</b> NA	Date	Depth
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-19-18	5.5
<b>Surface Elevation (ft):</b> 19.7	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	1-22-18	5.13
			Elev.
			Notes

Depth (ft)	Elev. (ft)	Symbol	Depth/EL to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes		
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"			
1	19	[Cross-hatch symbol]	7.5 / 12.2	FILL	n/a	S1	30/19	0.0-2.5		Brown/gray, SILTY SAND, some gravel, with trace bricks. (Fill)		
2	18				n/a	S2	30/19	2.5-5.0		Brown/gray, SAND, some silt, some gravel. (Fill)		
3	17				n/a	S3	30/22	5.0-7.5		Brown/gray, SILT, SAND, some gravel, with trace asphalt. (Fill)		
4	16											
5	15											
6	14											
7	13											
8	12	[Dotted symbol]	14.0 / 5.7	OUTWASH	n/a	S4	30/22	7.5-10.0		Brown/yellow, SILTY SAND, some gravel. (Outwash) Petroleum odor and staining observed approximately 9 feet bgs.		
9	11				n/a	S5	24/18	10.0-12.0		Brown/gray, GRAVEL, some sand, some silt. (Outwash)		
10	10				n/a	S6	24/18	12.0-14.0		Brown/gray, SILTY SAND. (Outwash)		
11	9											
12	8											
13	7											
14	6											
15	5			Geoprobe refusal at 14 feet below ground surface.								
16	4											
17	3											
18	2											
19	1											
20	0											
21	-1											
22	-2											
	-3											

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 14 feet below ground surface with 11 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Overcast



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-19-18	<b>GP-5 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-19-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Darwin	<b>Casing Hammer (lbs)/Drop (in):</b> NA	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-19-18	6
<b>Surface Elevation (ft):</b> 23.3	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	1-22-18	7.95
			15.4

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes		
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"			
1	23	[Cross-hatch symbol]	0.3 / 23.0	ASPHALT						Brown/black, SILTY SAND, some gravel, with brick and asphalt. (Fill)		
2	22				n/a	S1	30/16	0.0-2.5				
3	21				FILL						Brown/black, SILTY SAND, some gravel, with brick. (Fill)	
4	20					n/a	S2	30/16	2.5-5.0			
5	19											Brown, SILTY SAND and GRAVEL, trace cobbles, with wood. (Fill)
6	18					n/a	S3	30/8	5.0-7.5			
7	17											
8	16		7.5 / 15.8	OUTWASH						Brown, SILTY SAND, some gravel. (Outwash)		
9	15	[Dotted symbol]			n/a	S4	30/8	7.5-10.0				
10	14											Gray, SAND and GRAVEL, some silt. (Outwash)
11	13					n/a	S5	27/16	10.0-12.3			
12	12											
13	11					n/a	S6	27/16	12.3-14.5			Brown, SILTY SAND and GRAVEL. (Outwash)
14	10			14.5 / 8.8								
15	9			Geoprobe refusal at 14.5 feet below ground surface.								
16	8											
17	7											
18	6											
19	5											
20	4											
21	3											
22	2											
	1											

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 14.5 feet below ground surface with 11.5 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Overcast



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-19-18	<b>GP-6 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-19-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Darwin	<b>Casing Hammer (lbs)/Drop (in):</b> NA	Date	Depth
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-19-18	10
<b>Surface Elevation (ft):</b> 24.6	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	1-22-18	8.65
			Elev.
			Notes

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"	
1	24		0.3 / 24.3	ASPHALT						Brown/gray, SILTY SAND, some gravel, with ash & cinders. (Fill)
2	23			FILL	n/a	S1	30/18	0.0-2.5		
3	22		2.5 / 22.1	OUTWASH						Brown, SAND, some silt, some gravel. (Outwash)
4	21				n/a	S2	30/18	2.5-5.0		
5	20				n/a	S3	30/2	5.0-7.5		
6	19				n/a	S4	30/2	7.5-10.0		
7	18				n/a	S5	24/7	10.0-12.0		
8	17									Brown, SILTY SAND and cobble blocking the geoprobe. (Outwash)
9	16									
10	15									Brown/gray, SILTY SAND, some clay. (Outwash)
11	14									
12	13		12.0 / 12.6							
13	12			Geoprobe refusal at 12 feet below ground surface.						
14	11									
15	10									
16	9									
17	8									
18	7									
19	6									
20	5									
21	4									
22	3									
	2									

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 12 feet below ground surface with 9 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Overcast



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**



<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-22-18	<b>GP-7 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-22-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	Groundwater Observations	
<b>Driller/Helper:</b> Matt	<b>Casing Hammer (lbs)/Drop (in):</b> NA	Date	Depth
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-22-18	5
<b>Surface Elevation (ft):</b> 22.3	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	Elev.	Notes
		17.3	

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes	
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"		
1	22		0.3 / 22.0	ASPHALT						Brown/black, SILT, SAND, some gravel, with ash & cinders. (Fill)	
2	21			FILL	n/a	S1	30/20	0.0-2.5			
3	20		2.5 / 19.8							Brown/gray, mottled, SILTY CLAY. (Marine Clay)	
4	19			MARINE CLAY	n/a	S2	30/20	2.5-5.0			
5	18										
6	17					n/a	S3	30/30	5.0-7.5		Brown/gray, mottled, SILT, SAND, some clay. (Marine Clay)
7	16										
8	15				n/a	S4	30/30	7.5-10.0		Brown/gray, mottled, SILTY SAND and CLAY, some gravel. (Marine Clay)	
9	14										
10	13		10.0 / 12.3								
11	12			Geoprobe refusal at 10 feet below ground surface.							
12	11										
13	10										
14	9										
15	8										
16	7										
17	6										
18	5										
19	4										
20	3										
21	2										
22	1										
	0										

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 10 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Snow/Rain



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-22-18	<b>GP-8 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-22-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Matt	<b>Casing Hammer (lbs)/Drop (in):</b> NA	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-22-18	DRY
<b>Surface Elevation (ft):</b> 25.3	<b>Sampler Hammer (lbs)/Drop (in):</b> NA		

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes		
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"			
1	25	[Cross-hatch symbol]	0.3 / 25.0	ASPHALT						Brown/black, SILT and SAND, some gravel, with ash & cinders and bricks. (Fill)		
2	24		FILL		n/a	S1	30/20	0.0-2.5				
3	23	[Dotted symbol]	2.5 / 22.8	OUTWASH						Brown/gray, SILTY SAND, some gravel. (Outwash)		
4	22				n/a	S2	30/20	2.5-5.0				
5	21											Brown/gray, SILTY SAND, some gravel. (Outwash)
6	20				n/a	S3	30/10	5.0-7.5				
7	19											Brown/gray, SAND, some gravel, some silt. (Outwash)
8	18											
9	17											
10	16		10.0 / 15.3									
11	15			Geoprobe refusal at 10 feet below ground surface.								
12	14											
13	13											
14	12											
15	11											
16	10											
17	9											
18	8											
19	7											
20	6											
21	5											
22	4											
23	3											

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 10 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Snow/Rain



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-22-18	<b>GP-9 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-22-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Matt	<b>Casing Hammer (lbs)/Drop (in):</b> NA	Date	Depth
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-22-18	5
<b>Surface Elevation (ft):</b> 25.7	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	Elev.	Notes
		20.7	

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"	
1	25		0.3 / 25.4	ASPHALT						Brown/gray/black, SILT and SAND, trace gravel. (Fill)
2	24			FILL	n/a	S1	30/14	0.0-2.5		
3	23		2.5 / 23.2	OUTWASH						Brown/gray, mottled, SILTY SAND, some clay, trace gravel. (Outwash)
4	22				n/a	S2	30/14	2.5-5.0		
5	21				n/a	S3	30/12	5.0-7.5		Brown/gray, SILTY SAND. (Outwash)
6	20				n/a	S4	30/12	7.5-10.0		Brown/gray, SILTY SAND, some gravel. (Outwash)
7	19									
8	18									
9	17									
10	16		10.0 / 15.7	Geoprobe refusal at 10 feet below ground surface.						
11	15									
12	14									
13	13									
14	12									
15	11									
16	10									
17	9									
18	8									
19	7									
20	6									
21	5									
22	4									
	3									

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 10 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Snow/Rain



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.:</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-22-18	<b>GP-10 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-22-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Matt	<b>Casing Hammer (lbs)/Drop (in):</b> NA	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-22-18	DRY
<b>Surface Elevation (ft):</b> 21.6	<b>Sampler Hammer (lbs)/Drop (in):</b> NA		

Depth (ft)	Elev. (ft)	Symbol	Depth/EL to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"	
1	21	[Cross-hatched symbol]	0.3 / 21.3	ASPHALT	n/a	S1	30/20	0.0-2.5		Brown/gray, SAND, some silt, some gravel, with ash & cinders and crushed stone. (Fill)
2	20		FILL		n/a	S2	30/20	2.5-5.0		Brown, SAND, some gravel, trace silt. (Fill)
3	19				n/a	S3	36/30	5.0-8.0		Brown/gray, SAND and GRAVEL, with crushed stone and ash & cinders. (Fill) Petroleum odor and staining observed.
4	18									
5	17									
6	16									
7	15									
8	14			8.0 / 13.6						
9	13			Geoprobe refusal at 8 feet below ground surface.						
10	12									
11	11									
12	10									
13	9									
14	8									
15	7									
16	6									
17	5									
18	4									
19	3									
20	2									
21	1									
22	0									
	-1									

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		
COHESIVE SOILS		Notes:	
BLOWS/FT.	CONSISTENCY	Geoprobe installed observation well at 8 feet below ground surface with 5 feet of PVC screen and 3 feet of PVC riser.	
<2	V.SOFT		
2-4	SOFT		
4-8	FIRM		
8-15	STIFF		
15-30	V.STIFF		
>30	HARD	Weather: Snow/Rain	



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-22-18	<b>GP-11 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-22-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Matt	<b>Casing Hammer (lbs)/Drop (in):</b> NA	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-22-18	3.5
<b>Surface Elevation (ft):</b> 26.2	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	<b>Elev.</b>	<b>Notes</b>

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes
					N-Value	No.	Pen. /Rec. (in)	Depth (ft)	Blows Per 6"	
1	26		0.3 / 25.9	ASPHALT						Brown/gray, SILTY SAND, some gravel, with ash & cinders. (Fill)
2	25			FILL	n/a	S1	30/15	0.0-2.5		
3	24		2.5 / 23.7							
4	23				n/a	S2	30/15	2.5-5.0		Brown/gray, SAND, some silt, some gravel, some clay with fine sand partings. (Outwash)
5	22									
6	21									Brown/gray, SILTY SAND, trace gravel. (Outwash)
7	20			OUTWASH	n/a	S3	30/14	5.0-7.5		
8	19									
9	18				n/a	S4	30/14	7.5-10.0		Brown/gray, SILTY SAND and GRAVEL. (Outwash)
10	17		10.0 / 16.2							
11	16			Geoprobe refusal at 10 feet below ground surface.						
12	15									
13	14									
14	13									
15	12									
16	11									
17	10									
18	9									
19	8									
20	7									
21	6									
22	5									
	4									

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 10 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Snow/Rain



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.:</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-22-18	<b>GP-12 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-22-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Matt	<b>Casing Hammer (lbs)/Drop (in):</b> NA	Date	Depth
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-22-18	DRY
<b>Surface Elevation (ft):</b> 26.6	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	Elev.	Notes

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes	
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"		
1	26	[Cross-hatched symbol]	0.3 / 26.3	ASPHALT	n/a	S1	30/20	0.0-2.5		Brown/gray, SILTY SAND, trace gravel, with trace pulverized gravel. (Fill)	
2	25		FILL			n/a	S2	30/20	2.5-5.0		Brown/gray, SILTY SAND. (Fill)
3	24					n/a	S3	30/30	5.0-7.5		Brown/gray/black, SILTY SAND, with some crushed stone. (Fill)
4	23					n/a	S4	30/30	7.5-10.0		Brown, SILTY SAND, some gravel, trace clay. (Fill)
5	22										
6	21										
7	20										
8	19										
9	18										
10	17				10.0 / 16.6						
11	16			Geoprobe refusal at 10 feet below ground surface.							
12	15										
13	14										
14	13										
15	12										
16	11										
17	10										
18	9										
19	8										
20	7										
21	6										
22	5										
	4										

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 10 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Snow/Rain



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-22-18	<b>GP-13 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-22-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Matt	<b>Casing Hammer (lbs)/Drop (in):</b> NA	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-22-18	5
<b>Surface Elevation (ft):</b> 24.7	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	<b>Elev.</b>	<b>Notes</b>
		19.7	

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes				
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"					
1	24		0.3 / 24.4	ASPHALT	n/a	S1	30/15	0.0-2.5		Brown/gray/black, SILTY SAND, trace clay. (Fill)				
2	23				FILL	n/a	S2	30/15	2.5-5.0		Brown/gray, SILTY SAND, trace clay, with bricks. (Fill)			
3	22							FILL	n/a	S3	30/15	5.0-7.5		Brown/gray/blue, SILTY SAND, some clay, with ash & cinders. (Fill)
4	21										FILL	n/a	S4	30/15
5	20				FILL	n/a	S3	30/15				5.0-7.5		Brown/gray/blue, SILTY SAND, some clay, with ash & cinders. (Fill)
6	19							FILL	n/a	S3	30/15	5.0-7.5		Brown/gray/blue, SILTY SAND, some clay, with ash & cinders. (Fill)
7	18				FILL				n/a	S3	30/15	5.0-7.5		Brown/gray/blue, SILTY SAND, some clay, with ash & cinders. (Fill)
8	17					7.5 / 17.2	MARINE CLAY	n/a	S4	30/15	7.5-10.0		Gray/blue, SILTY CLAY, some gravel. (Marine Clay)	
9	16				MARINE CLAY			n/a	S4	30/15	7.5-10.0		Gray/blue, SILTY CLAY, some gravel. (Marine Clay)	
10	15					10.0 / 14.7	MARINE CLAY	n/a	S4	30/15	7.5-10.0		Gray/blue, SILTY CLAY, some gravel. (Marine Clay)	
11	14				Geoprobe refusal at 10 feet below ground surface.			n/a						
12	13													
13	12													
14	11													
15	10													
16	9													
17	8													
18	7													
19	6													
20	5													
21	4													
22	3													

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 10 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Snow/Rain



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**

<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.:</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-22-18	<b>GP-14 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-22-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Matt	<b>Casing Hammer (lbs)/Drop (in):</b> NA	<b>Date</b>	<b>Depth</b>
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	<b>Elev.</b>	<b>Notes</b>
<b>Surface Elevation (ft):</b> 25.4	<b>Sampler Hammer (lbs)/Drop (in):</b> NA		

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes		
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"			
1	25		0.3 / 25.1	ASPHALT	n/a	S1	30/18	0.0-2.5		Brown/gray, SILT, some sand, trace gravel. (Fill)		
2	24			FILL	n/a	S2	30/18	2.5-5.0		Brown/gray/black, SILTY SAND, trace clay. (Fill)		
3	23					FILL	n/a	S3	30/15	5.0-7.5		Blue/gray, mottled, SILT, some clay, trace sand, with some organic fibers. (Fill)
4	22							FILL	n/a	S4	30/15	7.5-10.0
5	21			FILL	n/a	S4			30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)
6	20					FILL	n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)
7	19			FILL			n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)
8	18				FILL	n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
9	17			FILL		n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
10	16				FILL	n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
11	15			FILL		n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
12	14				FILL	n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
13	13			FILL		n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
14	12				FILL	n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
15	11			FILL		n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
16	10				FILL	n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
17	9			FILL		n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
18	8				FILL	n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
19	7			FILL		n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
20	6				FILL	n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
21	5			FILL		n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
22	4				FILL	n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	
	3			FILL		n/a	S4	30/15	7.5-10.0		Brown/gray/blue, mottled, SILTY SAND, some gravel, trace clay. (Outwash)	

<b>GRANULAR SOILS</b>		<b>SOIL COMPONENT</b>	
<b>BLOWS/FT.</b>	<b>DENSITY</b>	<b>DESCRIPTIVE TERM</b>	<b>PROPORTION OF TOTAL</b>
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		
<b>COHESIVE SOILS</b>		SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"	
<b>BLOWS/FT.</b>	<b>CONSISTENCY</b>	<b>Notes:</b>	
<2	V.SOFT	Geoprobe installed observation well at 10 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.	
2-4	SOFT		
4-8	FIRM		
8-15	STIFF		
15-30	V.STIFF		
>30	HARD	Weather: Snow/Rain	



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423



<b>Project:</b> Portsmouth Parcels	<b>Job #:</b> 6524.9.00	<b>Boring No.</b>
<b>Location:</b> 428 Bypass Road	<b>Date Started:</b> 1-22-18	<b>GP-15 (OW)</b>
<b>City/State:</b> Portsmouth, NH	<b>Date Finished:</b> 1-22-18	

<b>Contractor:</b> TDS	<b>Casing Type/Depth (ft):</b> NA	<b>Groundwater Observations</b>	
<b>Driller/Helper:</b> Matt	<b>Casing Hammer (lbs)/Drop (in):</b> NA	Date	Depth
<b>Logged By/Reviewed By:</b> K. Hanrahan	<b>Sampler Size/Type:</b> 5' Sleeve	1-22-18	5
<b>Surface Elevation (ft):</b> 25.1	<b>Sampler Hammer (lbs)/Drop (in):</b> NA	Elev.	Notes
		20.1	

Depth (ft)	Elev. (ft)	Symbol	Depth/Elev. to Strata Change (ft)	Stratum	Sample					Sample Description and Boring Notes
					N-Value	No.	Pen./Rec. (in)	Depth (ft)	Blows Per 6"	
1	24		0.3 / 24.8	ASPHALT						Brown/gray/black, SILTY SAND, trace gravel, with ash & cinders. (Fill)
2	23		2.5 / 22.6	FILL	n/a	S1	30/24	0.0-2.5		
3	22			MARINE CLAY	n/a	S2	30/24	2.5-5.0		Brown/gray, SILT and SAND, some clay. (Marine Clay)
4	21				n/a	S3	30/30	5.0-7.5		Brown/gray, mottled, SILTY SAND and CLAY. (Marine Clay)
5	20				n/a	S4	30/30	7.5-10.0		Brown/gray, SILTY SAND and CLAY, some gravel. (Marine Clay)
6	19									
7	18									
8	17									
9	16									
10	15		10.0 / 15.1	Geoprobe refusal at 10 feet below ground surface.						
11	14									
12	13									
13	12									
14	11									
15	10									
16	9									
17	8									
18	7									
19	6									
20	5									
21	4									
22	3									

GRANULAR SOILS		SOIL COMPONENT	
BLOWS/FT.	DENSITY	DESCRIPTIVE TERM	PROPORTION OF TOTAL
0-4	V.LOOSE	"TRACE"	0-10%
4-10	LOOSE	"SOME"	10-20%
10-30	COMPACT	"ADJECTIVE" (eg SANDY, SILTY)	20-35%
30-50	DENSE	"AND"	35-50%
>50	V.DENSE		

SOIL CONTAINING THREE COMPONENTS EACH OF WHICH COMPRISE AT LEAST 25% OF THE TOTAL ARE CLASSIFIED AS "A WELL-GRADED MIXTURE OF"

COHESIVE SOILS		Notes:
BLOWS/FT.	CONSISTENCY	
<2	V.SOFT	Geoprobe installed observation well at 10 feet below ground surface with 7 feet of PVC screen and 3 feet of PVC riser.
2-4	SOFT	
4-8	FIRM	
8-15	STIFF	
15-30	V.STIFF	
>30	HARD	

Weather: Snow/Rain



**McPHAIL ASSOCIATES, LLC**  
 2269 MASSACHUSETTS AVENUE  
 CAMBRIDGE, MA 02140  
 TEL: 617-868-1420  
 FAX: 617-868-1423

**Page 1 of 1**



**APPENDIX G:**

**GROUNDWATER MONITORING REPORTS  
GP-1 THROUGH GP-15 AND B-1(OW) THROUGH B-3(OW)**









































## Appendix J

---

UIC Registration for infiltration to Groundwater (underground systems)





REGISTRATION AND NOTIFICATION FORM FOR STORM WATER INFILTRATION TO GROUNDWATER (5H1) Groundwater Discharge Program



RSA/Rule: RSA 485-A:6, VII; 485:3, X; Env-Wq 402

Applicant Information

Name: Cate Street Development, LLC Daytime Phone: (978)490-5278
Mailing Address: 11 Elkins Street, Suite 420
City: Boston State: MA Zip: 02127
Contact Person Name: Jay Bisognano Email: jb@torprops.com
Contact Person: Phone Number 978-490-5278 Fax Number:

Facility Information

Facility Name: West End Yards | Cate Street Redevelopment
Address: 428 US Route 1 Bypass | Cate Street
City: Portsmouth State: NH Zip: 03801
Property Tax Map: Lot #163-33&34, 163-37, 165-2, 172-1&173-2
Latitude & Longitude of discharge location(s): SSIB1: LAT 43.0692, LONG -70.7756
SSIB2: LAT 43.0694, LONG -70.7751 SSIB3: LAT 43.0696 LONG -70.7747

Facility Owner Information (complete only if different than applicant)

Owner Name: Daytime Phone: ( ) -
Mailing Address:
City: State: Zip:
Contact Person Name: Email:
Contact Person: Phone Number Fax Number:

Property Owner Information (complete only if different than applicant)

Owner Name: Daytime Phone: ( ) -
Mailing Address:
City: State: Zip:
Contact Person Name: Email:
Contact Person: Phone Number Fax Number:

Facility Operator's Information (complete only if different than applicant)

Owner Name: Daytime Phone: ( ) -
Mailing Address:
City: State: Zip:

Complete this form if you are using a drywell or other subsurface infiltration structures to recharge storm water to the ground or groundwater. If a completed UIC registration form was submitted to the Alteration of Terrain Program for this project, then one is not required to be sent directly to the GWB.

**REGISTRATION AND NOTIFICATION FORM FOR STORM WATER INFILTRATION TO GROUNDWATER (attach additional sheets, as necessary, for responses to questions below)**

Please provide a complete description of the facility including historic uses, any former contamination and/or on-going remedial action at the site:

The site has been occupied by the Frank Jones Center, PK Brown Construction, a house, a number of Light industrial / warehousing buildings and a large expanse of pavement. there has been a fuel tank associated with a diesel garage operating out of the industrial buildings. This tank is being removed. The infiltration Systems are not located in the area of the tank. there are no ongoing remedial actions on the site.

Please provide information concerning the location of the infiltration activity, include Locus map (i.e. USGS map):

Please refer to Figure 1 Site Location Map (USGS) and design plans CG-100 thru CG-104 Roadway Plans and CG-200 thru CG-203 of the Site Plans.

Please describe the pretreatment system, if any, and capacity of the system:

Deep sum hooded catch basins in offline configuration and isolation rows on each SSIB.

Please describe the materials and products used for the subsurface infiltration structure (i.e., pipe and stone leachfield, plastic chamber units, concrete drywell, etc.):

Stormtech SC-740 chamber systems with isolator rows

Please describe the disposal method and location. Include a site plan showing: the infiltration structure, any other on-site infiltration structures, dimensions, depth to groundwater (if known), adjacent septic system(s), and Drinking water source(s):

Subsurface chamber systems see sheet CG-202 for SSIB1 thru 3 as well as detail sheet CD-512 for typical detail

Please provide information concerning methods and schedule for periodic inspection and/or maintenance:

I & M plan for project is attached.



---

**Applicant/Owner Certification Statement and Signature**

**By signing this application the signer certifies that the information contained in or otherwise submitted with this application is true, complete and not misleading to the best of the signer's knowledge and belief.**

**By signing this application the signer understands that submission of false, incomplete or misleading information is grounds for:**

- Denying the application;**
- Revoking any application that is granted based on the information; and**
- If the signer is acting as or on behalf of a listed engineer as defined in Env-C 502.10, debarring the listed engineer from the roster.**

**By signing the application the signer and applicant agree to comply with all applicable rules and conditions of this permit and to not discharge to the holding tank(s) until written permission from the department has been received.**

---

**Signature of Facility Owner or Contact**

---

**Date**



## Appendix K

---

### Inspection and Maintenance Manual



# Inspection & Maintenance Plan

## West End Yards

Cate Street/Route 1  
Portsmouth, NH 03801

APPLICANT & OWNER

## Cate Street Development, LLC

11 Elkins Street  
Suite 420  
Boston, MA 02127

July 24, 2019



**FUSS & O'NEILL**

5 Fletcher Street, Suite 1  
Kennebunk, ME 04043

Project No. 20180317.A10

# Table of Contents

Long-Term Inspection & Maintenance Plan  
 Cate Street Development, LLC  
 Belmont, NH 03220

---

1	Introduction.....	1
2	Inspection and Maintenance Requirements.....	2
2.1	Bioretention Basins.....	2
2.2	Drainage Channel.....	2
2.3	Drainage Structures.....	2
2.4	Energy Dissipator and Level Spreader.....	3
3	Pollution Prevention .....	4
3.1	Spill Procedures.....	4
3.2	Sanitary Facilities .....	4
3.3	Material Storage .....	4
3.4	Material Disposal .....	4
4	Contacts.....	5

## Appendices

End of Report

- A Operation, Maintenance, and Management Inspection Checklists
- B BMP Location Map



# 1 Introduction

This report outlines the long-term inspection and maintenance for West End Yards, owned by Cate Street Development, LLC, located at 428 US Route 1 Bypass & Cate Street in Portsmouth, New Hampshire. Site development includes two residential buildings, one commercial building, 23 townhomes, and new section of roadway. The stormwater management system consists of 2 bioretention basins, 3 subsurface infiltration basins, 2 subsurface detention basins, 2 water quality units, deep sump hooded catch basins in an off line configuration, and rip rap energy dissipaters, together with conveyance systems that open grass channels. These best management practices (BMPs) will provide groundwater recharge and peak flow mitigation of stormwater runoff.

The purpose of this this Long-Term Inspection and Maintenance Plan is to identify specific inspection and maintenance activities that are necessary to ensure the success and minimize the deterioration of the stormwater system over time. The Contractor is responsible for implementing Inspection and Maintenance through the completion of construction and during the warranty period. The Inspection shall be responsible implementing this Long-Term Inspection and Maintenance Plan thereafter.

Maintenance operations shall be funded by the Operator. In the event the facility becomes owned by different entities, this Long-Term Inspection and Maintenance Plan shall be transferred to the future owners/operators.

## 2 Inspection and Maintenance Requirements

The following inspection and maintenance activities shall be conducted to ensure the success and minimize the deterioration of the stormwater system over time. All BMPs shall be inspected after every storm event larger than one-inch (over a 24-hour period) in the first six-months following construction. Afterwards, BMPs shall be inspected after major storm events greater than 2.8 inches (over a 48-hour period), and at a minimum twice per year in late spring (May/June) and early fall (September/October). Checklists to assist with the inspection and maintenance activities are provided in Appendix A. A map depicting the location of the components of the stormwater management system is provided in Appendix B.

---

### 2.1 Bioretention Basins

Bioretention basin inspections shall include inspecting the isolator rows for accumulated sediment. Inlets and outlets should be inspected for erosion and damage. If inspection of the isolator row indicates the need for maintenance, the sediment shall be removed using the JetVac process. Once sediment is removed from the isolator row, catch basins and manholes upstream of the basin shall be inspected and cleaned.

---

### 2.2 Drainage Channel

Channels shall be inspected for sediment accumulation, erosion, and condition of the surface lining material. Vegetative channels shall be inspected to determine if high flows have caused erosion of the vegetative surface lining. Any areas subject to erosion shall be replenished with the original design material and re-vegetated according to design drawings. Materials deposited on the surface of the channels (e.g., trash, litter, sediment, debris) must be removed manually. Vegetation within the channel shall be mowed a minimum of once per year to eliminate woody vegetation. It is recommended to cut grass no shorter than four inches to maintain establishment of hearty stand of grass.

---

### 2.3 Drainage Structures

Immediately prior to the end of construction or acceptance by the Owner/Operator, the Contractor shall clean all drainage structures. Once construction is complete and has been accepted by the Owner/Operator, all drainage structures shall be inspected annually. Inspections shall include checking for debris, sediment, and hydrocarbons, and structural integrity or damage. Deficiencies must be corrected immediately. Grates shall not be welded to the frame so the structures can be easily inspected and maintained.



---

## 2.4 Energy Dissipator and Level Spreader

Energy dissipator shall be inspected to determine if high flows have caused scour or dislodged any of the stone. If repairs are needed, they should be accomplished immediately. Materials deposited on the surface of the dissipator/spreader (e.g., trash, litter, sediment, debris) must be removed.

## 3 Pollution Prevention

The following pollution prevention activities shall be conducted to minimize potential impacts on stormwater runoff quality. The Contractor is responsible for all activities during construction. The Owner/Operator is responsible thereafter.

---

### 3.1 Spill Procedures

Any discharge of waste oil or other pollutant shall be reported immediately to the New Hampshire Department of Environmental Services (NHDES). The operator will be responsible for any incident of groundwater contamination resulting from the improper discharge of pollutants to the stormwater system, and may be required by NHDES to remediate incidents that may impact groundwater quality. Should property ownership be transferred, the subsequent owner/operator will be informed of the legal responsibilities associated with operation of the stormwater system, as indicated above.

---

### 3.2 Sanitary Facilities

Sanitary facilities shall be provided during all phases of construction. There are no bathroom facilities on site long term.

---

### 3.3 Material Storage

No on site trash facility is provided. The customers are required to remove trash from the site. Hazardous material storage is prohibited.

---

### 3.4 Material Disposal

All waste material, trash, sediment, and debris shall be removed from the site and disposed of in accordance with applicable local, state, and federal guidelines and regulations. Removed sediments shall be dewatered (if necessary) prior to disposal.

## 4 Contacts

### Owner

Cate Street Development, LLC  
11 Elkins Street  
Suite 420  
Boston, MA 02127

### Operator

TBD

### Maintenance Contact

TBD

### I&M Plan Contact

Fuss & O'Neill, Inc.  
Richard Lundborn, PE  
5 Fletcher Street, Suite 1  
Kenebunk, ME 04043  
207.363.0669  
RLundborn@fando.com

## Appendix A

---

### Operation, Maintenance, and Management Inspection Checklist

Inspection & Maintenance  
Manual Checklist

BMP/System	Minimum Inspection Frequency	Minimum Inspection requirements	Maintenance / Cleanout Threshold
Closed Drainage (Structures & Pipes)	Twice Annually	Check for sediment accumulation, clogging, and debris.	Clean catch basin sump when half full. Remove all floating debris. Clean pipe runs with 2" or more of sediment.
Catch Basin Hood Inserts	Twice Annually	Check for blocked hoods and floating debris in associated catch basins	Unclog any debris from hoods, remove floatables and hydrocarbons. Check insertion to outlet pipe. Replace if damaged.
Infiltration Basin	Routinely during 1st year, twice annually after	Check for sediment accumulation, clogging, and debris. Monitor growth of vegetation	Inspect vegetation as necessary, remove debris from structures, and remove sediment accumulation from forebay and basin bottom. Mow, cut back, and control woody growth on the side slopes and inside the infiltration basin. Check slopes and spillways for structural integrity.
Bioretention Basin	Twice Annually	System should be inspected for drawdown time, sediment removed, and vegetation	Remove any trash or debris from structures or drains, vegetation maintained in healthy condition and bioretention basin drain time inspected for filtration function.
Invasive Plant Control	Routinely	Inspect for any invasive plants that destroy the natural communities or obstruct drainage structures	Pull deadhead, mow, cut, use controlled burning use a herbicide, girdle, frill or use a foliar spray with glyphosate to control or remove invasive plants.
Litter / Trash Removal	Routinely	Inspect parking areas, driveways, storm water systems, and around buildings.	Site will be free of trash / litter



## Appendix B

---

### BMP Location Map



800.286.2469  
[www.fando.com](http://www.fando.com)

ENGINEERS • SCIENTISTS • PLANNERS






## Figure 1

---

Site Location Map




File Path: F:\P2018\0317\A10\Civil\3\DWG\20180317A10\_COV01.dwg Layout: FIGURE 1 Plotted: Tue, May 08, 2018 - 10:43 AM User: jandretta  
 MS VIEW: PLOTTER: DWG TO PDF-PC3 CTB File: FO.STB

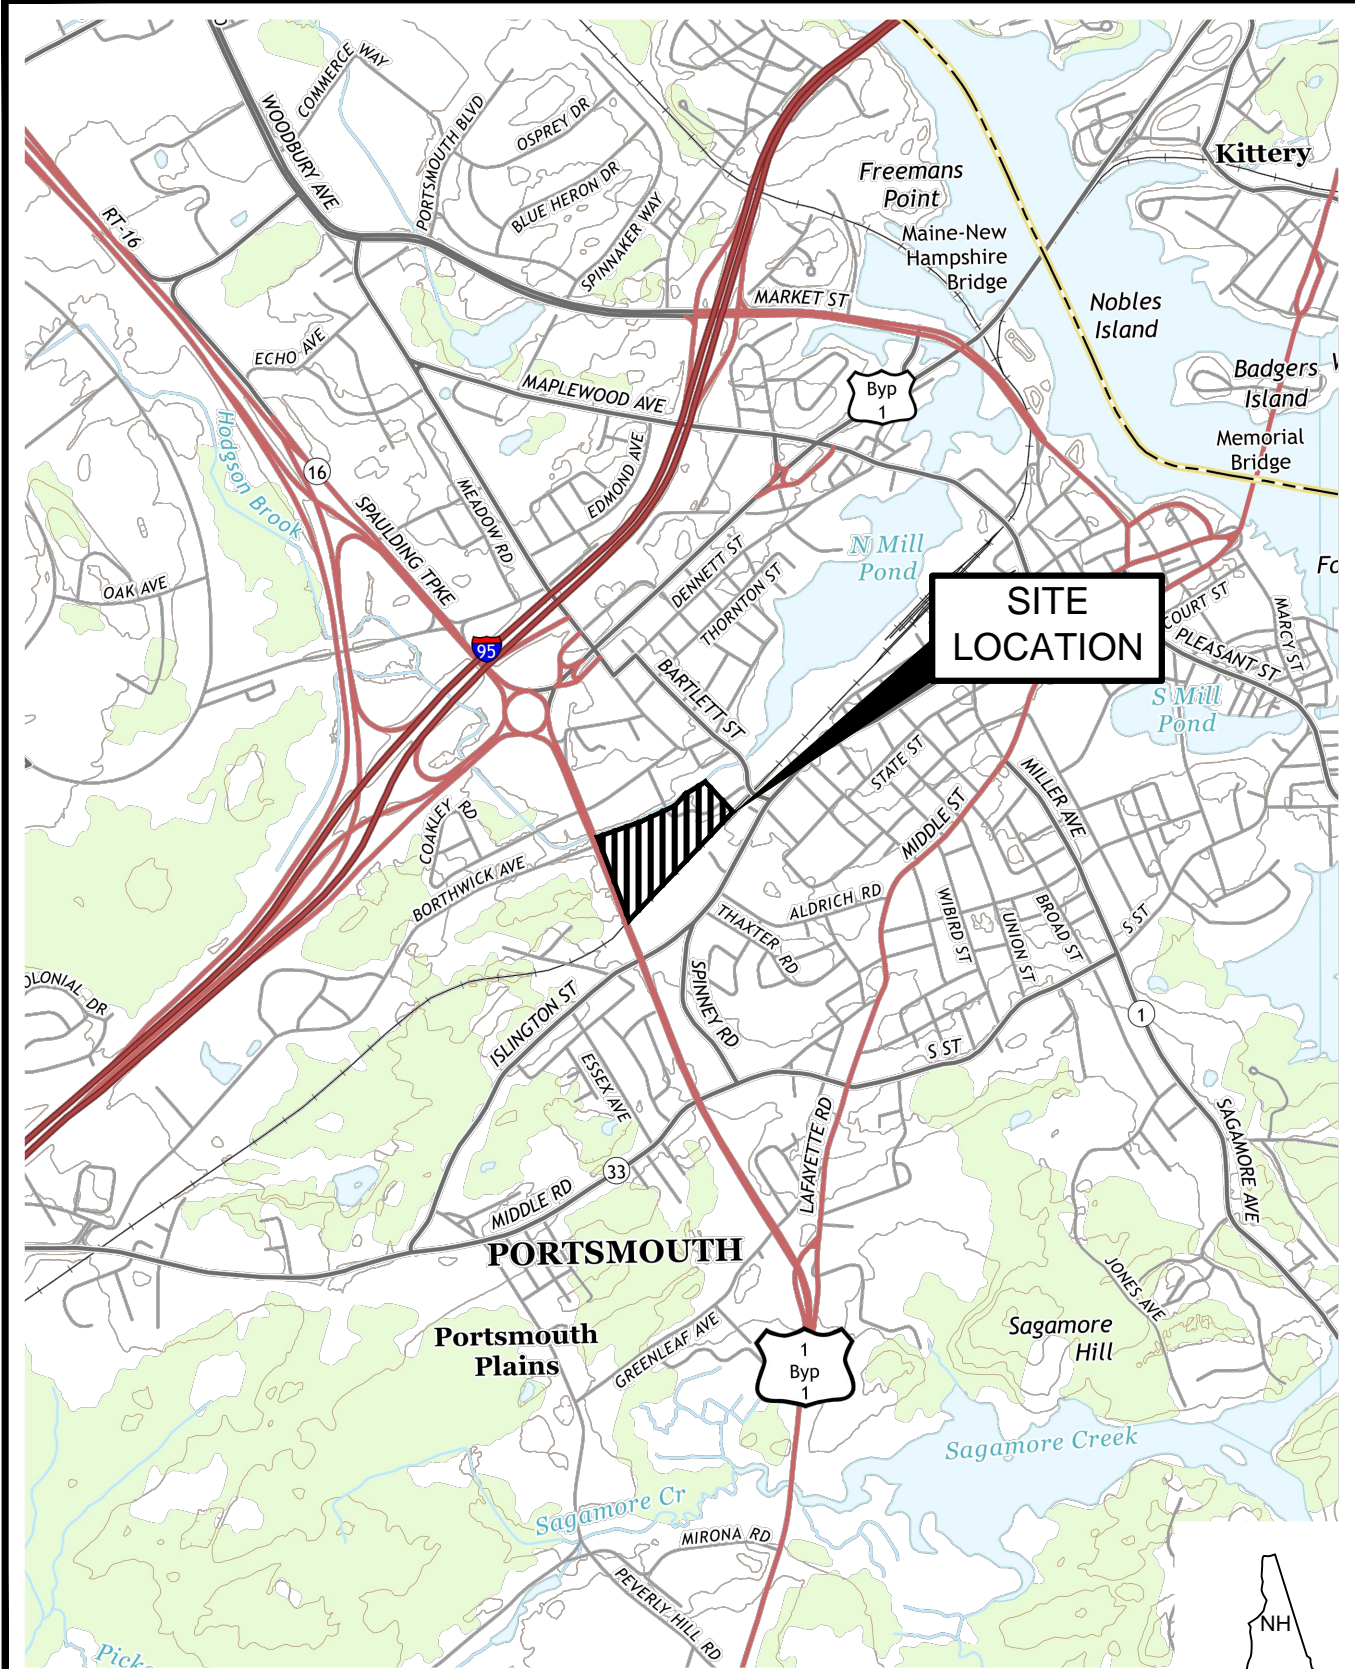

**MAP REFERENCE:**

2015 USGS US TOPO 7.5-MINUTE MAP FOR PORTSMOUTH, NH QUADRANGLE



<b>SCALE:</b>	
HORZ.:	1" = 2000'
VERT.:	
<b>DATUM:</b>	
HORZ.:	NAD83
VERT.:	NAVD88
<b>GRAPHIC SCALE</b>	

**FUSS & O'NEILL**  
 LIBBY HOUSE  
 5 FLETCHER STREET, SUITE 1  
 KENNEBUNK, MAINE 04043  
 207.363.0669  
 www.fando.com

AAM 15 MANAGEMENT, LLC  
 SITE LOCATION MAP  
 FRANK JONES CENTER  
 PORTSMOUTH NEW HAMPSHIRE

PROJ. No.: 20180317.A10
DATE: 05/08/2018
<b>FIGURE 1</b>



## Figure 2

---

### FEMA Flood Insurance Rate Map






# National Flood Hazard Layer FIRMette



43°4'22.13"N

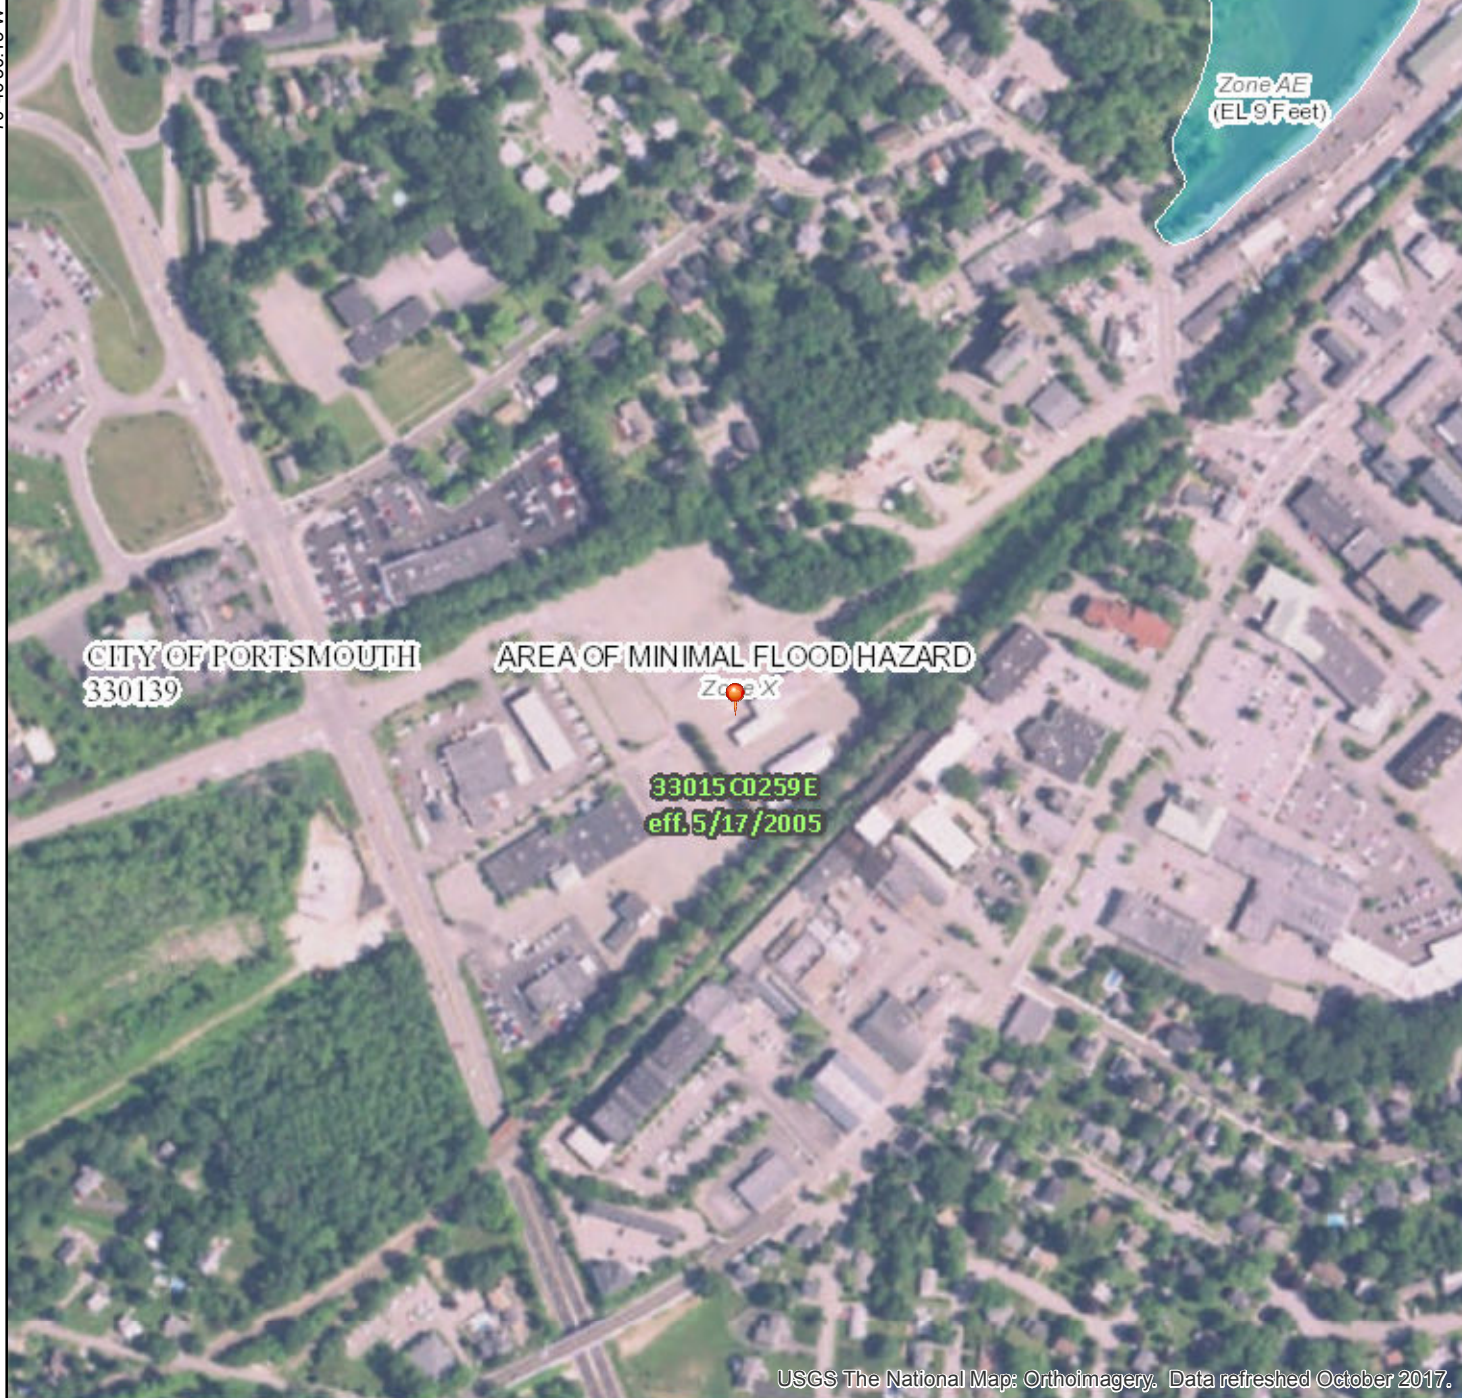

## Legend


SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

- |                                    |  |   |
|------------------------------------|--|---|
| <b>SPECIAL FLOOD HAZARD AREAS</b>  |  | Without Base Flood Elevation (BFE)<br>Zone A, V, A99  |
|                                    |  | With BFE or Depth Zone AE, AO, AH, VE, AR   |
|                                    |  | Regulatory Floodway   |
| <b>OTHER AREAS OF FLOOD HAZARD</b> |  | 0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X |
|                                    |  | Future Conditions 1% Annual Chance Flood Hazard Zone X  |
|                                    |  | Area with Reduced Flood Risk due to Levee. See Notes. Zone X  |
|                                    |  | Area with Flood Risk due to Levee Zone D  |
| <b>OTHER AREAS</b>                 |  | NO SCREEN Area of Minimal Flood Hazard Zone X   |
|                                    |  | Effective LOMRs   |
| <b>GENERAL STRUCTURES</b>          |  | Area of Undetermined Flood Hazard Zone D  |
|                                    |  | Channel, Culvert, or Storm Sewer  |
| <b>OTHER FEATURES</b>              |  | Levee, Dike, or Floodwall   |
|                                    |  | 20.2 Cross Sections with 1% Annual Chance Water Surface Elevation   |
| <b>MAP PANELS</b>                  |  | 17.5 Coastal Transect   |
|                                    |  | Base Flood Elevation Line (BFE)   |
|                                    |  | Limit of Study  |
|                                    |  | Jurisdiction Boundary   |
|                                    |  | Coastal Transect Baseline   |
|                                    |  | Profile Baseline  |
|                                    |  | Hydrographic Feature  |
|                                    |  | Digital Data Available  |
|                                    |  | No Digital Data Available   |
|                                    |  | Unmapped  |
- The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on **11/18/2018 at 8:15:07 PM** and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.



43°3'55.84"N

70°46'12.67"W







## Figure 3

---

### Pre-Development Subwatershed Plan







**LEGEND**

- WATERSHED BOUNDARY
- TIME OF CONCENTRATION PATH
- WETLAND LINE
- HSG C SOIL
- IMPERVIOUS AREA
- SUBCATCHMENT
- POINT OF ANALYSIS

CATE STREET DEVELOPMENT, LLC  
 EXISTING COLOR CODED SOIL PLAN  
 CATE STREET/ WEST END YARDS  
 PORTSMOUTH NEW HAMPSHIRE

**FUSS & O'NEILL**  
 UPPER SQUARE BUSINESS CENTER  
 5 FLETCHER STREET, SUITE 1  
 KENNEBUNK, MAINE 04043  
 207.563.0669  
 www.fandoc.com

No.	DATE	DESCRIPTION	DESIGNER/REVIEWER
4.	7/24/2019	TAC SUBMITTAL	JVA/DAD RRL
3.	6/20/2019	TAC SUBMITTAL	JVA/DAD RRL
2.	5/20/2019	TAC SUBMITTAL	JVA/DAD RRL
1.	3/18/2019	TAC SUBMITTAL	JVA/DAD RRL

SCALE: HORIZ.: 1"=50'  
 VERT.: 1"=10'  
 DATUM: NAD 83  
 HORIZ.: 1"=50'  
 VERT.: 1"=10'  
 GRAPHIC SCALE








PROJ. No.: 20180317.A10  
 DATE: 07/24/2019

**DA-101**





**LEGEND**

-  WATERSHED BOUNDARY
-  TIME OF CONCENTRATION PATH
-  WETLAND LINE
-  HSG C SOIL
-  IMPERVIOUS AREA
-  SUBCATCHMENT
-  POINT OF ANALYSIS

No.	DATE	DESCRIPTION	DESIGNER/REVIEWER
4.	7/24/2019	TAC SUBMITTAL	JVA/DAD
3.	6/20/2019	TAC SUBMITTAL	JVA/DAD
2.	5/20/2019	TAC SUBMITTAL	JVA/DAD
1.	3/18/2019	TAC SUBMITTAL	JVA/DAD

SCALE:	HORIZ.: 1"=50'
	VERT.: 1"=10'
DATUM:	HORIZ.: TAC SUBMITTAL
	VERT.: TAC SUBMITTAL
	GRAPHIC SCALE


**FUSS & O'NEILL**  
 UPPER SQUARE BUSINESS CENTER  
 5 FLETCHER STREET, SUITE 1  
 KENNEBUNK, MAINE 04043  
 207.563.0609  
 www.fussdo.com

CATE STREET DEVELOPMENT, LLC  
 EXISTING COLOR CODED  
 SOIL PLAN  
 CATE STREET/WEST END YARDS  
 PORTSMOUTH NEW HAMPSHIRE






PROJ. No.: 20180317.A10  
 DATE: 07/24/2019  
**DA-102**

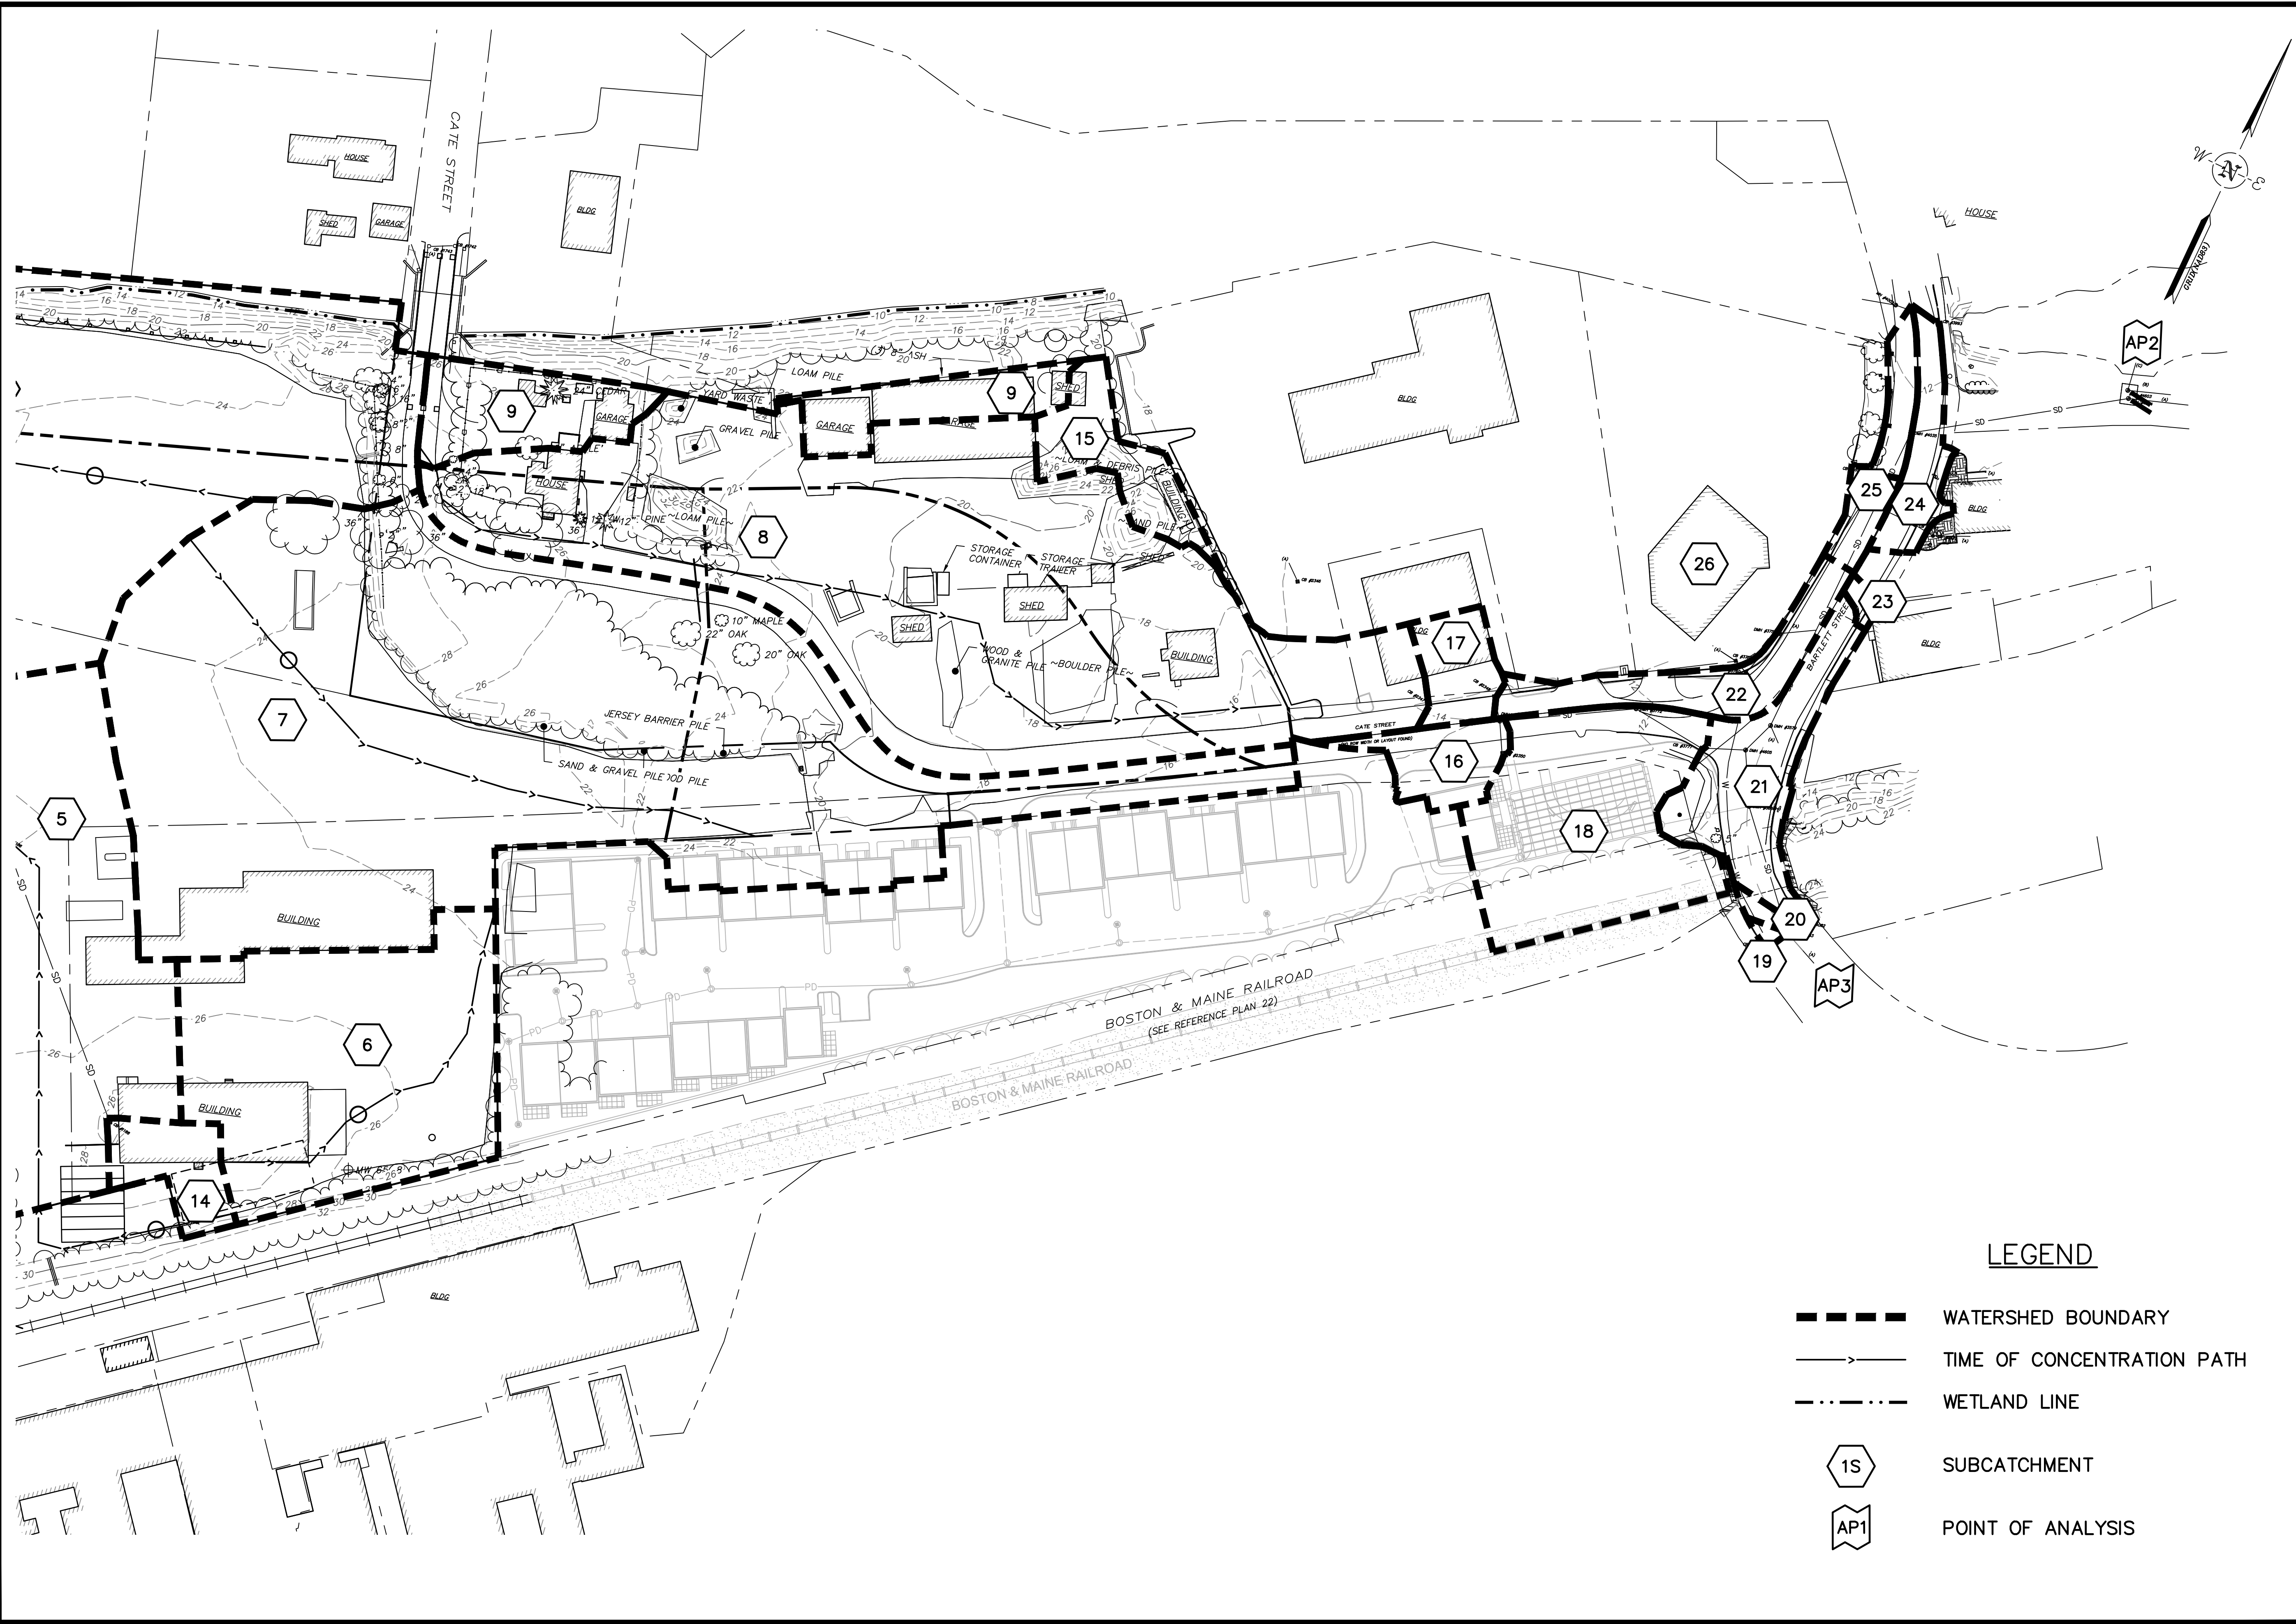






**LEGEND**

-  WATERSHED BOUNDARY
-  TIME OF CONCENTRATION PATH
-  WETLAND LINE
-  SUBCATCHMENT
-  POINT OF ANALYSIS

No.	DATE	DESCRIPTION	DESIGNER/REVIEWER
4.	7/24/2019	TAC SUBMITTAL	JVA/DAD
3.	6/20/2019	TAC SUBMITTAL	JVA/DAD
2.	5/20/2019	TAC SUBMITTAL	JVA/DAD
1.	3/18/2019	TAC SUBMITTAL	JVA/DAD

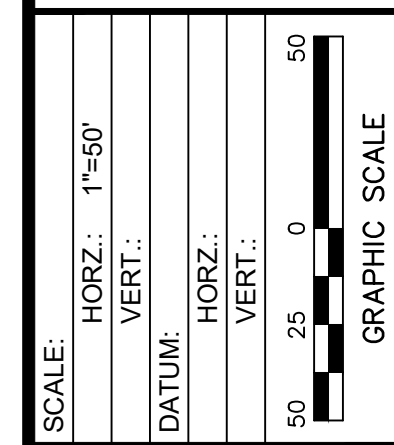

**FUSS & O'NEILL**  
 UPPER SQUARE BUSINESS CENTER  
 5 FLETCHER STREET, SUITE 1  
 KENNEBUNK, MAINE 04043  
 207.563.0609  
 www.fandoo.com

CATE STREET DEVELOPMENT, LLC  
 EXISTING DRAINAGE  
 AREA PLAN  
 CATE STREET/WEST END YARDS  
 PORTSMOUTH NEW HAMPSHIRE

PROJ. No.: 20180317.A10  
 DATE: 07/24/2019

**DR-102**

## Figure 4

---

### Post-Development Subwatershed Plan







**LEGEND**

- WATERSHED BOUNDARY
- TIME OF CONCENTRATION PATH
- WETLAND LINE
- HSG C SOIL
- IMPERVIOUS AREA
- SUBCATCHMENT
- POINT OF ANALYSIS

CATE STREET DEVELOPMENT, LLC  
 PROPOSED COLOR CODED SOIL PLAN  
 CATE STREET/ WEST END YARDS  
 PORTSMOUTH NEW HAMPSHIRE

**FUSS & O'NEILL**  
 UPPER SQUARE BUSINESS CENTER  
 5 FLETCHER STREET, SUITE 1  
 KENNEBUNK, MAINE 04043  
 www.fandoo.com

No.	DATE	DESCRIPTION	DESIGNER/REVIEWER
4.	7/24/2019	TAC SUBMITTAL	JVA/DAD RRL
3.	6/20/2019	TAC SUBMITTAL	JVA/DAD RRL
2.	5/20/2019	TAC SUBMITTAL	JVA/DAD RRL
1.	3/18/2019	TAC SUBMITTAL	JVA/DAD RRL

SCALE: HORIZ.: 1"=50'  
 VERT.: 1"=10'  
 DATUM: NAD 83  
 HORIZ.: 1"=50'  
 VERT.: 1"=10'  
 GRAPHIC SCALE








PROJ. No.: 20180317.A10  
 DATE: 07/24/2019


**DA-201**






**LEGEND**

-  WATERSHED BOUNDARY
-  TIME OF CONCENTRATION PATH
-  WETLAND LINE
-  HSG C SOIL
-  IMPERVIOUS AREA
-  SUBCATCHMENT
-  POINT OF ANALYSIS






 <p><b>FUSS &amp; O'NEILL</b>          UPPER SQUARE BUSINESS CENTER          5 FLETCHER STREET, SUITE 1          KENNEBUNK, MAINE 04043          207.563.0609          www.fandoo.com</p>																																			
CATE STREET DEVELOPMENT, LLC PROPOSED COLOR CODED SOIL PLAN CATE STREET/ WEST END YARDS PORTSMOUTH NEW HAMPSHIRE	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td>SCALE:</td> <td>HORIZ.: 1"=50'</td> </tr> <tr> <td></td> <td>VERT.: 1"=50'</td> </tr> <tr> <td>DATUM:</td> <td></td> </tr> <tr> <td></td> <td>HORIZ.: 1"=50'</td> </tr> <tr> <td></td> <td>VERT.: 1"=50'</td> </tr> <tr> <td></td> <td>50 25 0 50</td> </tr> <tr> <td></td> <td>GRAPHIC SCALE</td> </tr> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>No.</th> <th>DATE</th> <th>DESCRIPTION</th> <th>DESIGNER/REVIEWER</th> </tr> <tr> <td>4.</td> <td>7/24/2019</td> <td>TAC SUBMITTAL</td> <td>JVA/DAD RRL</td> </tr> <tr> <td>3.</td> <td>6/20/2019</td> <td>TAC SUBMITTAL</td> <td>JVA/DAD RRL</td> </tr> <tr> <td>2.</td> <td>5/20/2019</td> <td>TAC SUBMITTAL</td> <td>JVA/DAD RRL</td> </tr> <tr> <td>1.</td> <td>3/18/2019</td> <td>TAC SUBMITTAL</td> <td>JVA/DAD RRL</td> </tr> </table>	SCALE:	HORIZ.: 1"=50'		VERT.: 1"=50'	DATUM:			HORIZ.: 1"=50'		VERT.: 1"=50'		50 25 0 50		GRAPHIC SCALE	No.	DATE	DESCRIPTION	DESIGNER/REVIEWER	4.	7/24/2019	TAC SUBMITTAL	JVA/DAD RRL	3.	6/20/2019	TAC SUBMITTAL	JVA/DAD RRL	2.	5/20/2019	TAC SUBMITTAL	JVA/DAD RRL	1.	3/18/2019	TAC SUBMITTAL	JVA/DAD RRL
SCALE:	HORIZ.: 1"=50'																																		
	VERT.: 1"=50'																																		
DATUM:																																			
	HORIZ.: 1"=50'																																		
	VERT.: 1"=50'																																		
	50 25 0 50																																		
	GRAPHIC SCALE																																		
No.	DATE	DESCRIPTION	DESIGNER/REVIEWER																																
4.	7/24/2019	TAC SUBMITTAL	JVA/DAD RRL																																
3.	6/20/2019	TAC SUBMITTAL	JVA/DAD RRL																																
2.	5/20/2019	TAC SUBMITTAL	JVA/DAD RRL																																
1.	3/18/2019	TAC SUBMITTAL	JVA/DAD RRL																																
PROJ. No.: 20180317.A10 DATE: 07/24/2019																																			
DA-202																																			

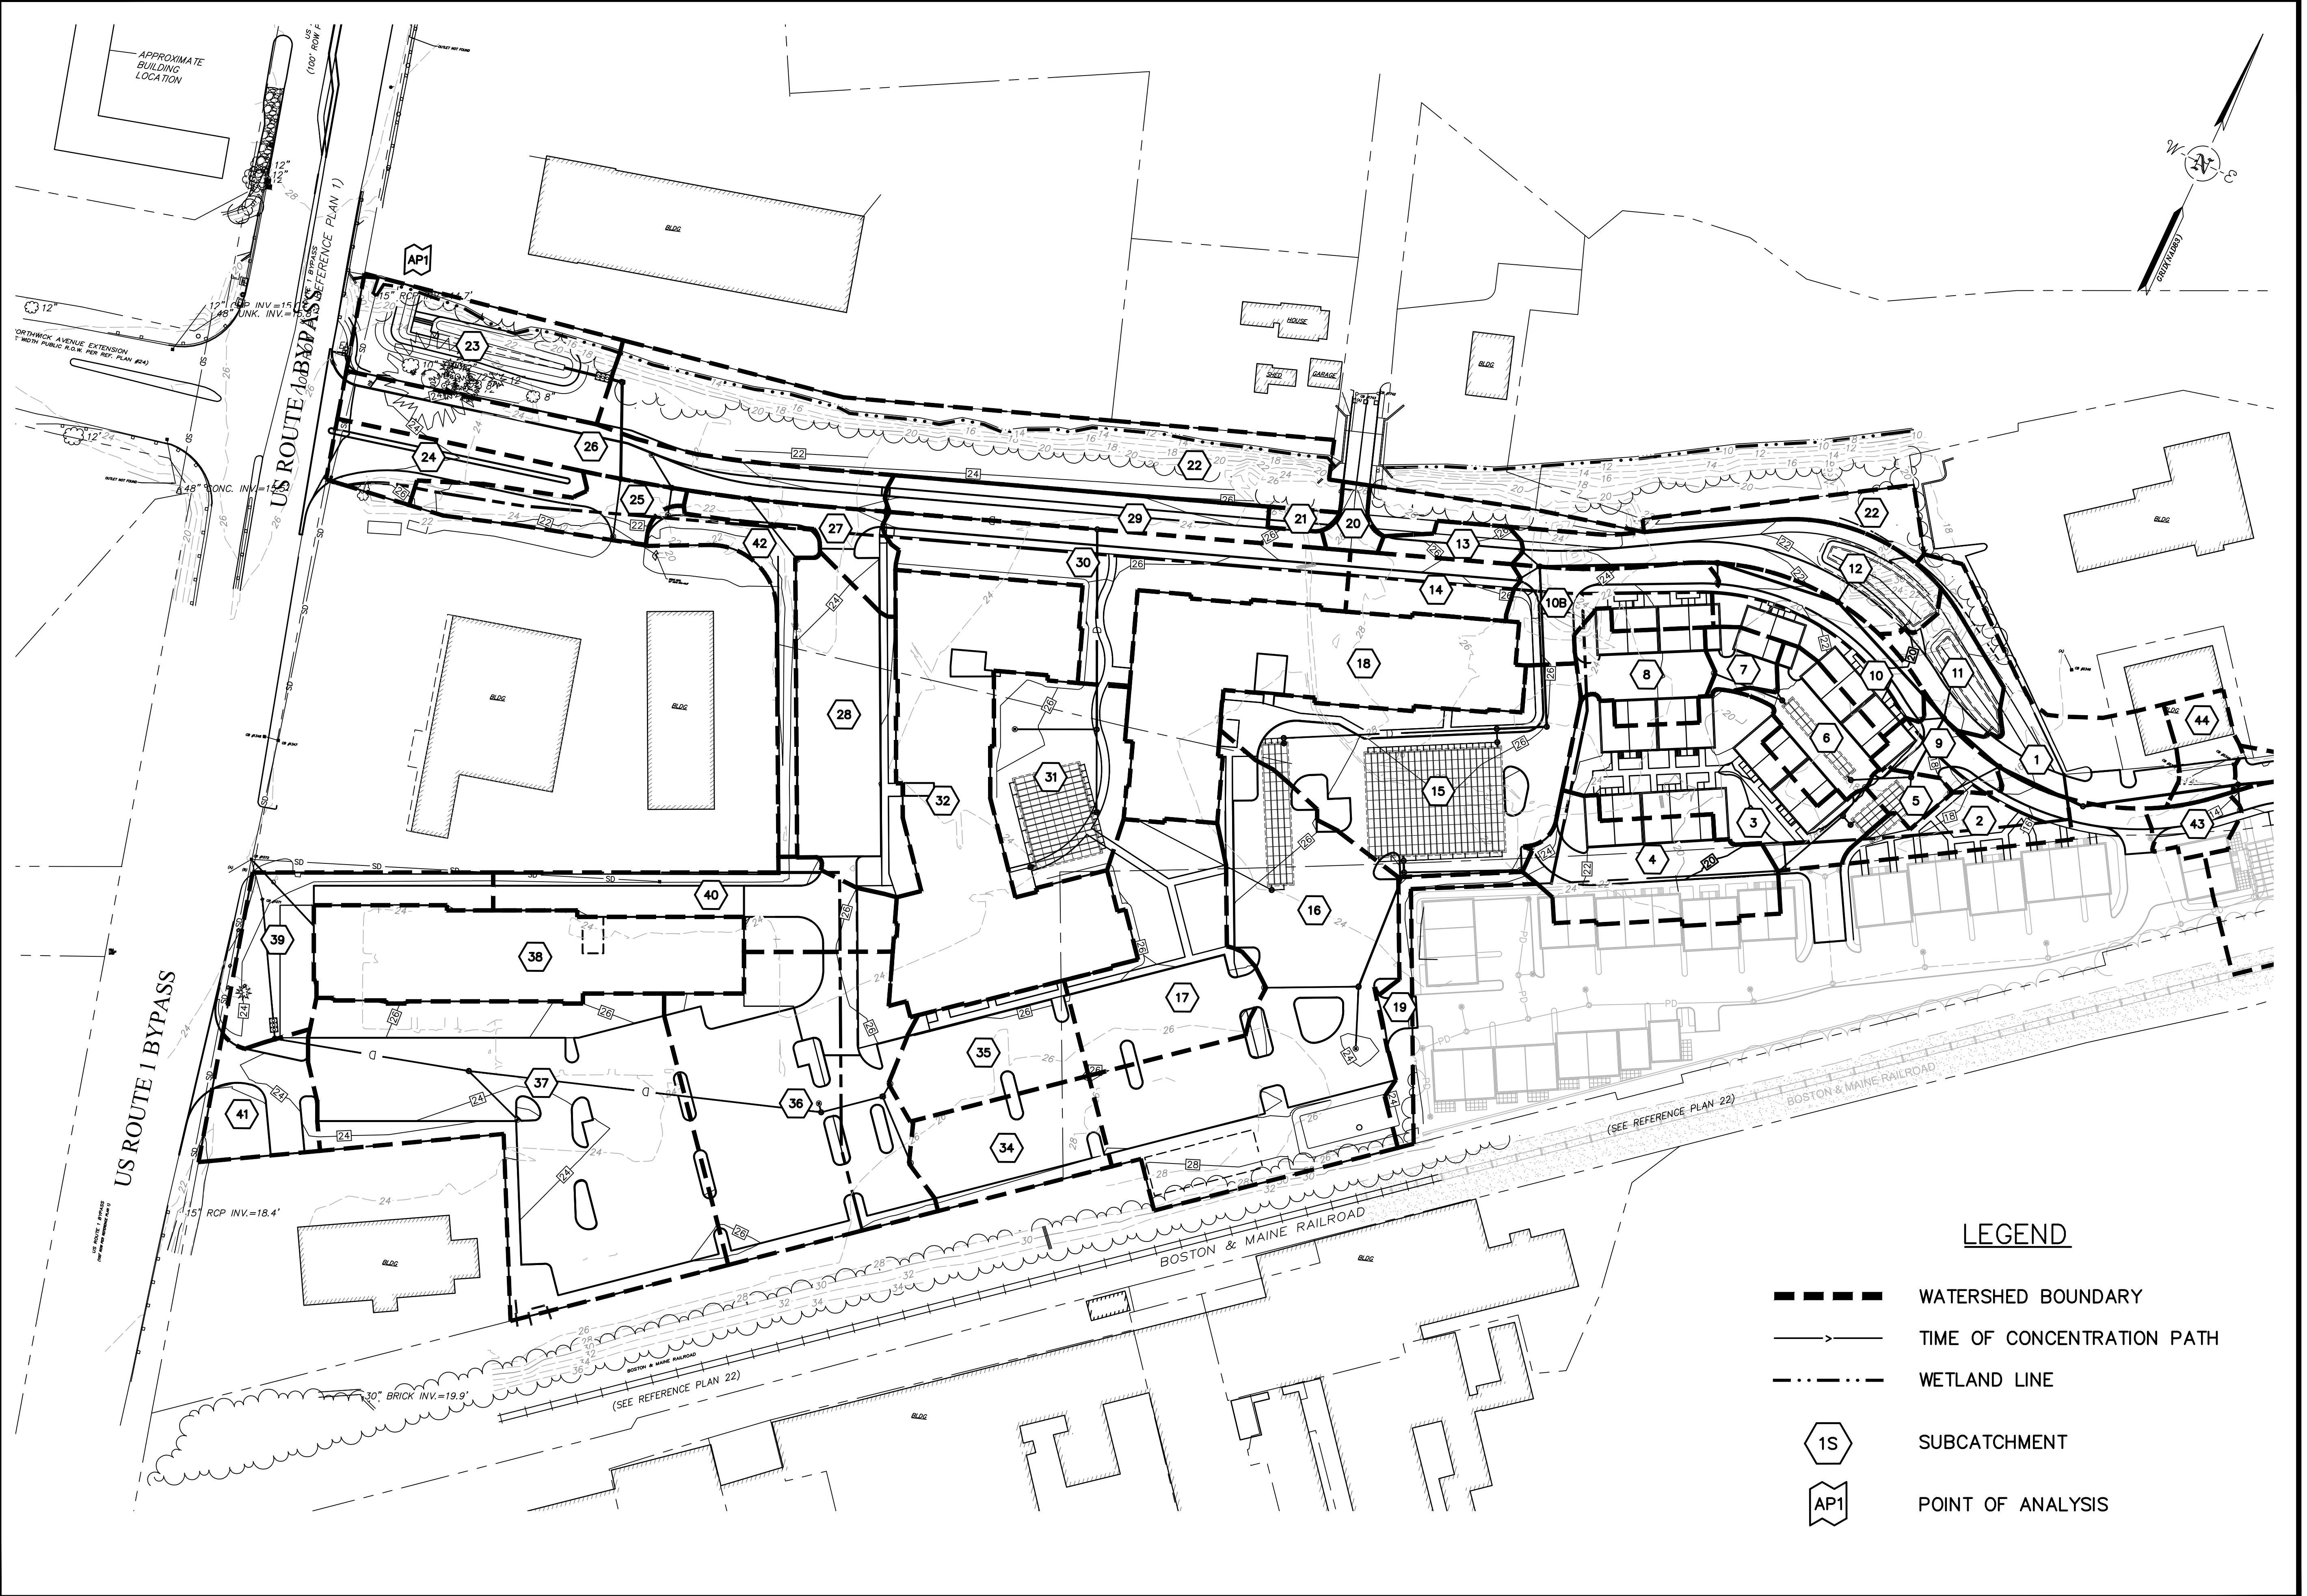


File Path: F:\P20180317A\10\CH\3\DWG\20180317A10\_DRA01.dwg Layout: DR-201 Plotted: Thu, July 25, 2019 - 2:32 PM User: jandretta  
 MS VIEW: LAYER STATE: Plotter: DWG TO PDF-PC3 CTB File: FO-STB




**LEGEND**






-  WATERSHED BOUNDARY
-  TIME OF CONCENTRATION PATH
-  WETLAND LINE
-  SUBCATCHMENT
-  POINT OF ANALYSIS

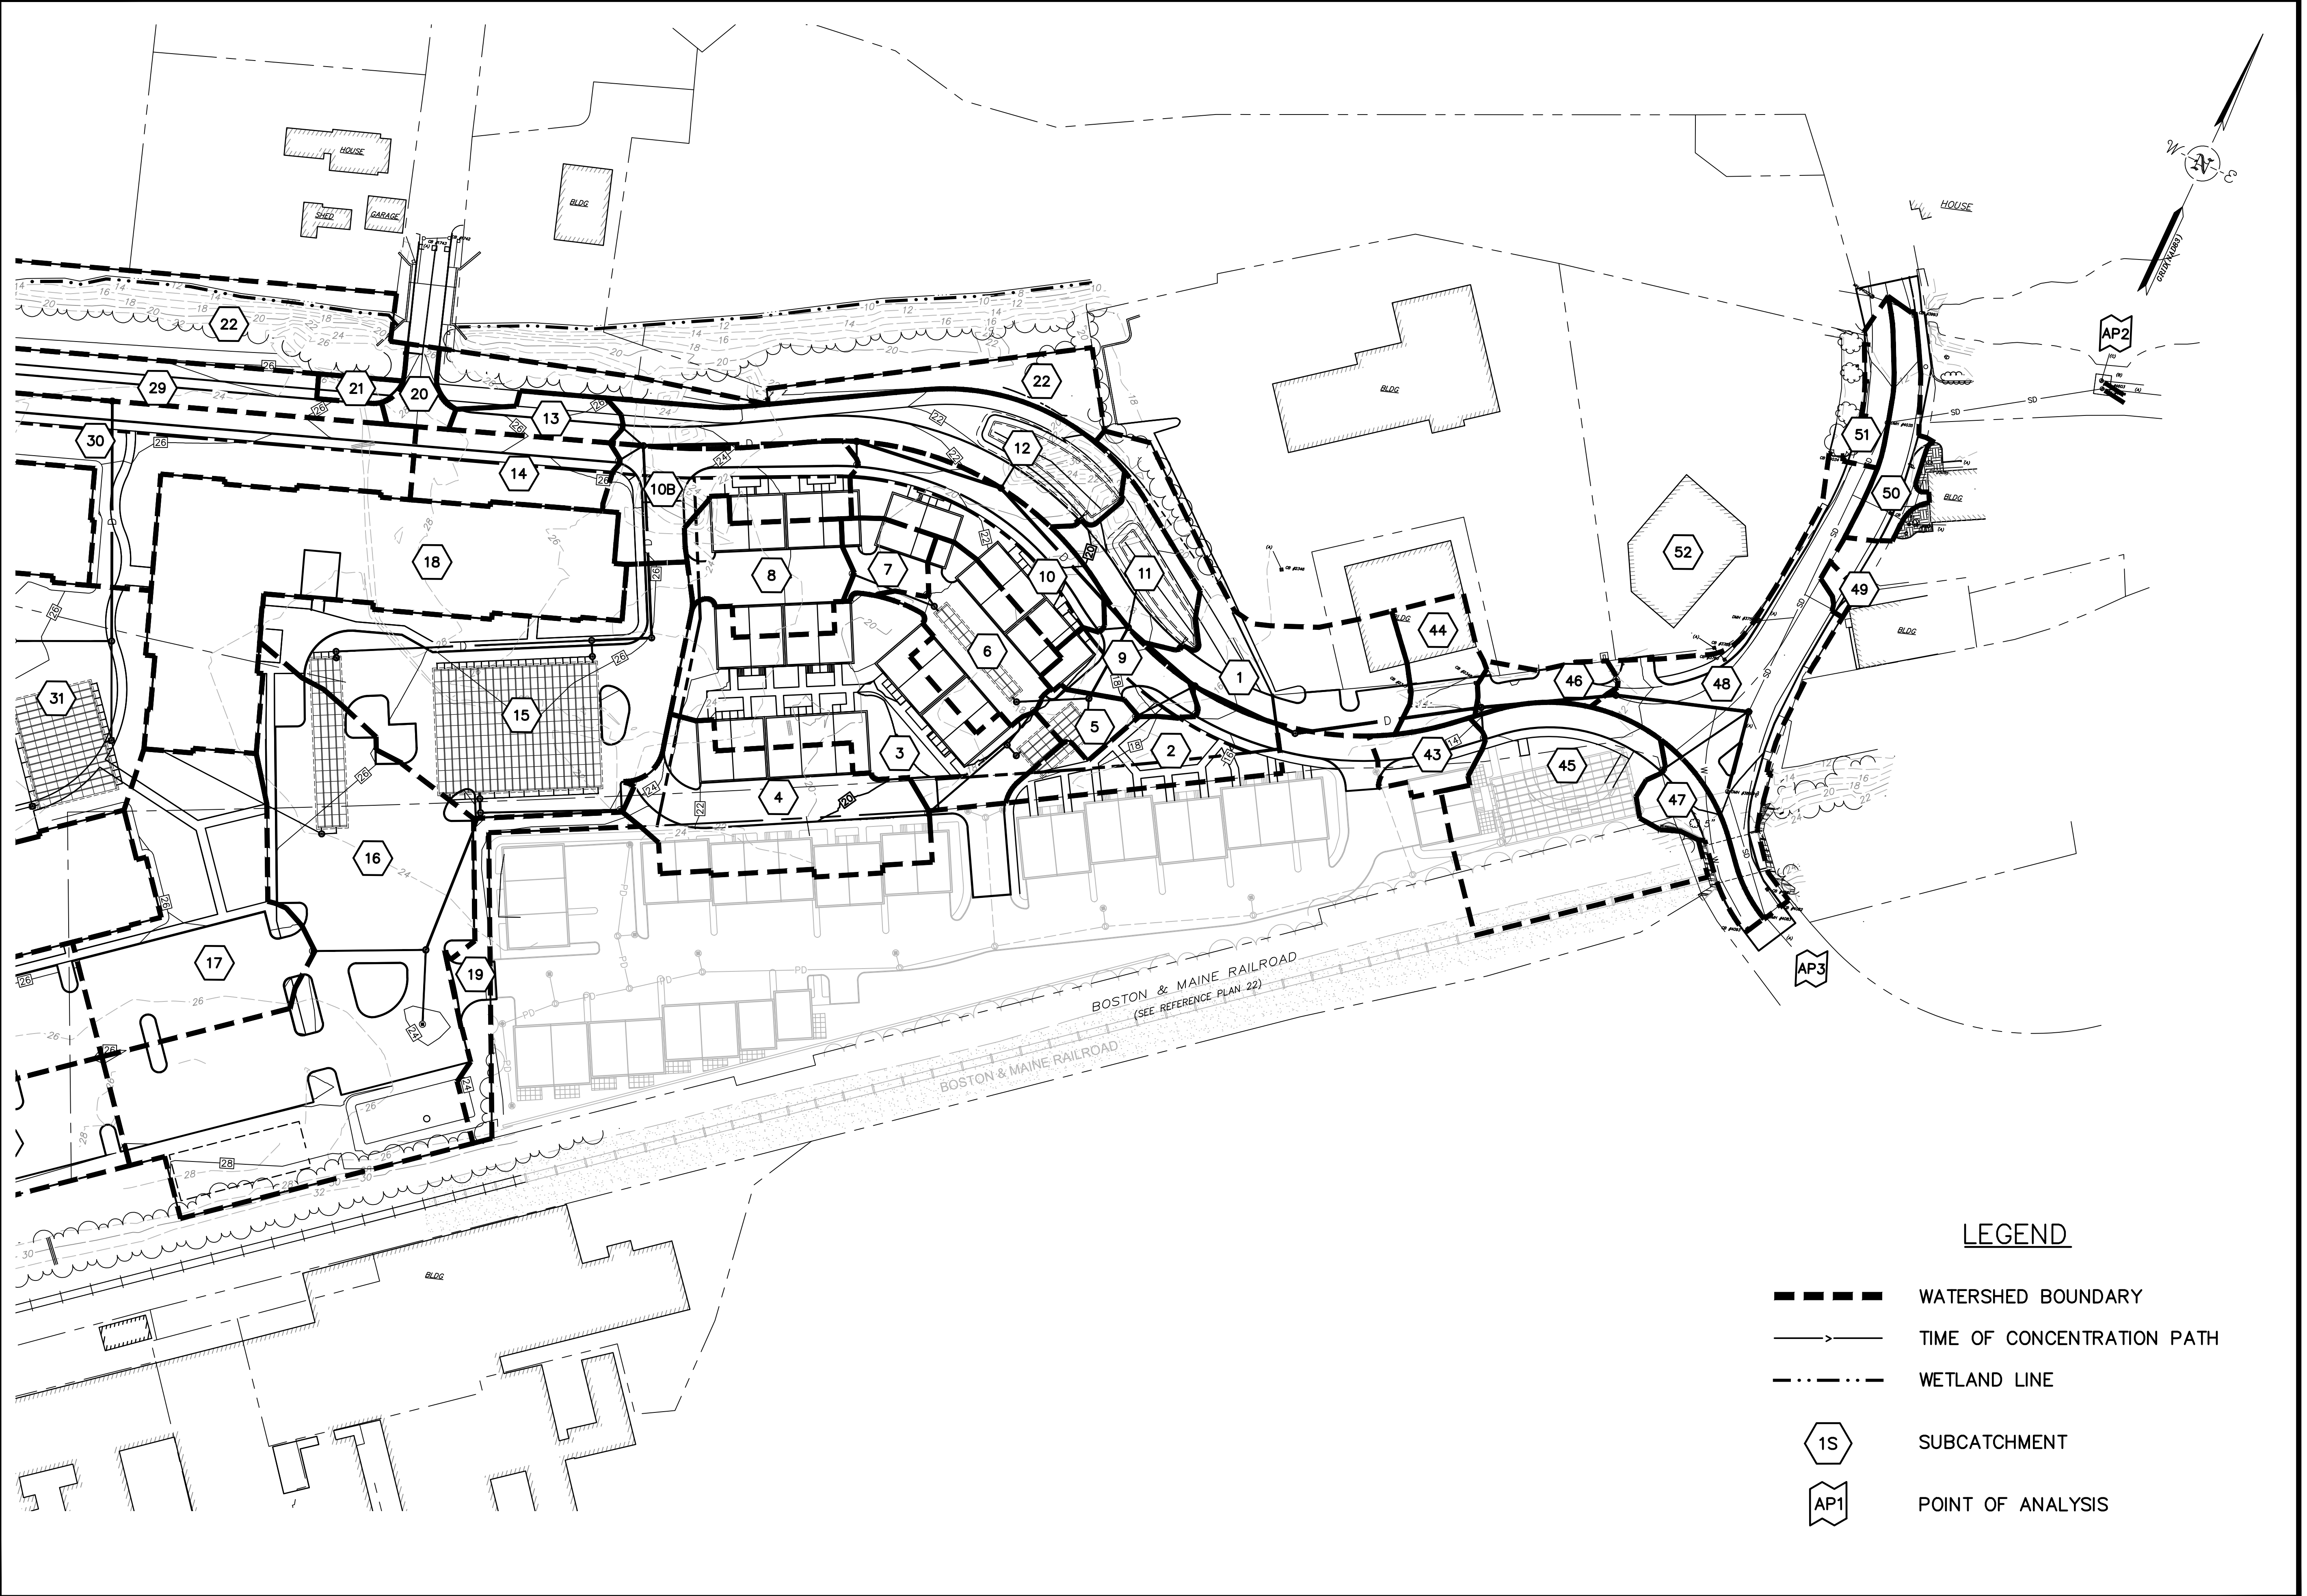
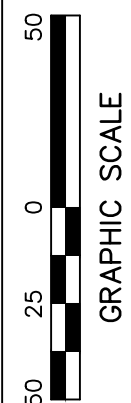
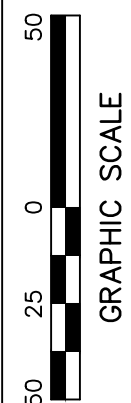
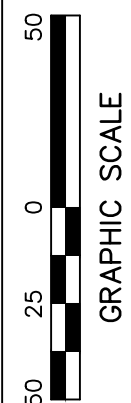
 <b>FUSS &amp; O'NEILL</b> UPPER SQUARE BUSINESS CENTER 5 FLETCHER STREET, SUITE 1 KENNEBUNK, MAINE 04043 www.fandoo.com													
CATE STREET DEVELOPMENT, LLC PROPOSED DRAINAGE AREA PLAN CATE STREET/ WEST END YARDS PORTSMOUTH NEW HAMPSHIRE	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 20%;">SCALE:</td> <td style="width: 20%;">HORZ.: 1"=50'</td> <td style="width: 20%;">VERT.: 1"=50'</td> <td style="width: 20%;">DRAINAGE</td> <td style="width: 20%;">DATE</td> <td style="width: 20%;">DESIGNER REVIEWER</td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </table>	SCALE:	HORZ.: 1"=50'	VERT.: 1"=50'	DRAINAGE	DATE	DESIGNER REVIEWER						
SCALE:	HORZ.: 1"=50'	VERT.: 1"=50'	DRAINAGE	DATE	DESIGNER REVIEWER								
PROJ. No.: 20180317.A10 DATE: 07/24/2019													
DR-201													

File Path: F:\P20180317A10\CH3\3DWg\20180317A10\_DRA01.dwg Layout: DR-202 Plotted: Thu, July 25, 2019 - 2:32 PM User: jandretta  
 MS VIEW: LAYER STATE: Plotter: DWG TO PDF.PC3 CTB File: FO.STB



**LEGEND**

-  WATERSHED BOUNDARY
-  TIME OF CONCENTRATION PATH
-  WETLAND LINE
-  SUBCATCHMENT
-  POINT OF ANALYSIS

 <p><b>FUSS &amp; O'NEILL</b>          UPPER SQUARE BUSINESS CENTER          5 FLETCHER STREET, SUITE 1          KENNEBUNK, MAINE 04043          207.563.0609          www.fandco.com</p>																					
CATE STREET DEVELOPMENT, LLC PROPOSED DRAINAGE AREA PLAN CATE STREET/WEST END YARDS PORTSMOUTH NEW HAMPSHIRE	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">SCALE: HORZ.: 1"=50'</td> <td style="width: 50%;">VERT.: 1"=50'</td> </tr> <tr> <td colspan="2" style="text-align: center;">  <p>GRAPHIC SCALE</p> </td> </tr> </table>	SCALE: HORZ.: 1"=50'	VERT.: 1"=50'	 <p>GRAPHIC SCALE</p>																	
SCALE: HORZ.: 1"=50'	VERT.: 1"=50'																				
 <p>GRAPHIC SCALE</p>																					
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>No.</th> <th>DATE</th> <th>DESCRIPTION</th> <th>DESIGNER/REVIEWER</th> </tr> </thead> <tbody> <tr> <td>4.</td> <td>7/24/2019</td> <td>TAC SUBMITTAL</td> <td>RRL</td> </tr> <tr> <td>3.</td> <td>6/20/2019</td> <td>TAC SUBMITTAL</td> <td>RRL</td> </tr> <tr> <td>2.</td> <td>5/20/2019</td> <td>TAC SUBMITTAL</td> <td>RRL</td> </tr> <tr> <td>1.</td> <td>3/18/2019</td> <td>TAC SUBMITTAL</td> <td>RRL</td> </tr> </tbody> </table>		No.	DATE	DESCRIPTION	DESIGNER/REVIEWER	4.	7/24/2019	TAC SUBMITTAL	RRL	3.	6/20/2019	TAC SUBMITTAL	RRL	2.	5/20/2019	TAC SUBMITTAL	RRL	1.	3/18/2019	TAC SUBMITTAL	RRL
No.	DATE	DESCRIPTION	DESIGNER/REVIEWER																		
4.	7/24/2019	TAC SUBMITTAL	RRL																		
3.	6/20/2019	TAC SUBMITTAL	RRL																		
2.	5/20/2019	TAC SUBMITTAL	RRL																		
1.	3/18/2019	TAC SUBMITTAL	RRL																		
PROJ. No.: 20180317.A10 DATE: 07/24/2019																					
DR-202																					