




December 6, 2016

## PEASE TRADEPORT WATER SUPPLY UPDATE

### **ACTIVATED CARBON FILTERS – WATER QUALITY MONITORING**

The activated carbon demonstration filters for the Harrison and Smith wells have been on line since mid-September 2016. Two carbon filters were installed in series and seven rounds of samples have been taken since that time. Results for six of those sample rounds have been received and all samples have come back “non detect” (ND) for PFOS and PFOA. The results are attached and will be updated monthly as the demonstration project continues. The sample points established by the consultant are at 25% of the first filter, the effluent of the first filter and the effluent of the second filter. The intent of this sampling is to determine when PFOS and PFOA compounds start to pass through filter #1, and at what level so that a proper filter change-out frequency can be determined. The graphic below shows a schematic of the current Pease water sources, treatment and sampling points:

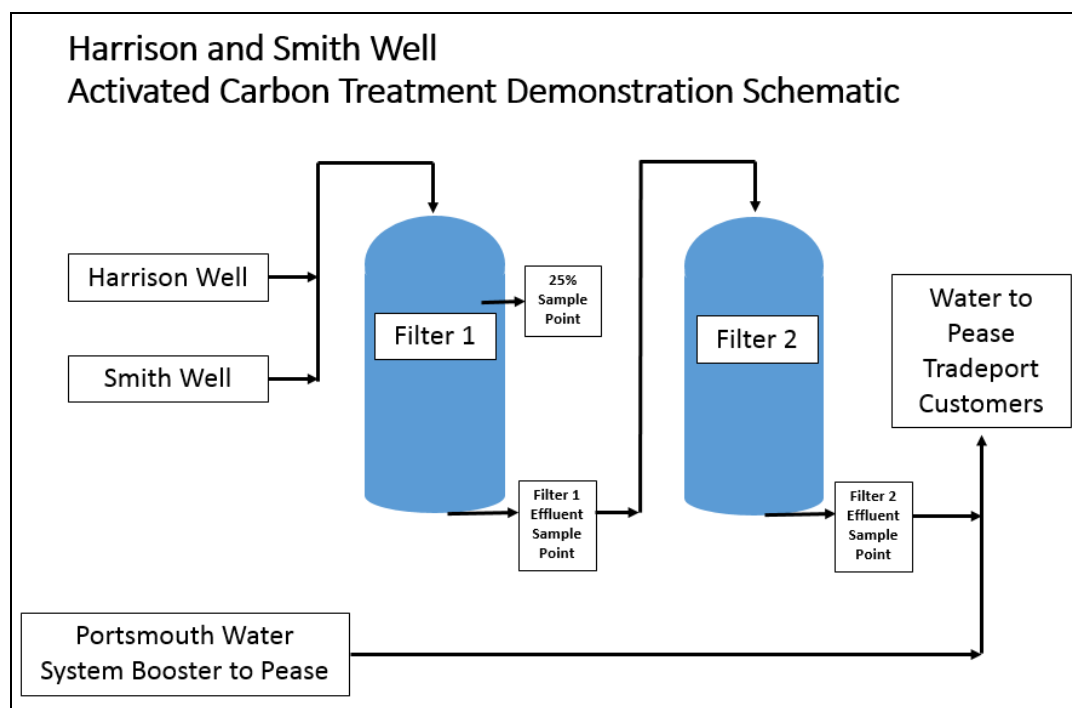

***PEASE TRADEPORT WATER SYSTEM UPDATE TO CITY COUNCIL***

Brian Goetz, Deputy Director of Public Works, and Al Pratt, Water Resources Manager, provided the City Council with an update on the Pease PFC Monitoring, Treatment Demonstration Project and Haven Well Project at their December 6, 2016 meeting. A copy of that update is also attached.

***ONGOING WATER QUALITY MONITORING***

The Air Force's consultant has been performing frequent routine sampling of the water supply wells in the Pease water system since May 2014. The Smith Well has been sampled weekly for PFCs and the Harrison Well sampled every two weeks. In addition to these water supply wells, the Air Force's consultant samples other monitoring wells in the surrounding area to track the aquifer and monitor for any PFCs moving toward the supply wells.

The EPA recently issued new health advisories of 0.070 µg/L (micrograms per liter) for Perfluorooctanoic Acid (PFOA) and Perfluorooctane Sulfonate (PFOS). The Smith and Harrison wells that supply the Pease Tradeport Water System have combined levels PFOA and PFOS that have consistently been below this limit since sampling began in 2014.

**Additional information can be accessed at:**

<http://www.cityofportsmouth.com/publicworks/phwn.html>

Or by calling Al Pratt, Water Resources Manager, at 520-0622

**Table 1**  
**Summary of PFC Analytical Results**  
**Demonstration Project**  
**Former Pease Air Force Base, New Hampshire**

Sample Location	Sample ID	Collection Date	6:2 Fluorotelomer sulfonate (6:2 FTS)	8:2 Fluorotelomer sulfonate (8:2 FTS)	N-Ethyl perfluorooctane sulfonamide (EtFOSA)	N-Ethyl perfluorooctane sulfonamidoethanol (EtFOSE)	N-Methyl Perfluorooctane Sulfonamide (MEFOSA)	N-Methyl Perfluorooctane Sulfonamidoethanol (MEFOSE)	Perfluorobutanesulfonic acid (PFBS)	Perfluorobutanoic acid (PFBA)	Perfluorodecane sulfonate (PFDS)	Perfluorodecanoic acid (PFDA)	Perfluorododecanoic acid (PFDoA)	Perfluoroheptane sulfonate (PFHpS)	Perfluoroheptanoic acid (PFHpA)	Perfluorohexanesulfonic acid (PFHxS)	Perfluorohexanoic acid (PFHxA)	Perfluorooctanoic acid (PFOA)	Perfluorononanoic acid (PFNA)	Perfluorooctane sulfonamide (PFOSA)	Perfluorooctanesulfonic acid (PFOS)	Perfluoropentanoic acid (PFPeA)	Perfluorotetradecanoic acid (PFTeDA)	Perfluorotridecanoic acid (PFTrDA)	Perfluoroundecanoic acid (PFUnA)	PFOS+PFOA	
USEPA Health Advisory (HA):			-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	0.07	-	-	0.07	-	-	-	-	0.07	
Method Detection Limit (MDL)			0.0065	0.0055	0.0053	0.0049	0.0040	0.0061	0.0019	0.0066	0.0043	0.0066	0.0057	0.0036	0.0047	0.0040	0.0046	0.0053	0.0046	0.0058	0.0033	0.0036	0.0052	0.0032	0.0037		
Reported Detection Limit (RDL)			0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	
Filter 2 Effluent	S1	22-Sep-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 1 - 25%	PV1-25	06-Oct-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 2 Effluent	PV2-100	06-Oct-16	ND	ND	ND	ND	0.0065 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 1 - 25%	PV1-25	14-Oct-16	ND	ND	ND	ND	ND	ND	0.0022 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 1 Effluent	PV1-100	14-Oct-16	ND	ND	ND	ND	ND	ND	0.0021 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 2 Effluent	PV2-100	14-Oct-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.0053 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 1 - 25%	PV1-25	20-Oct-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 1 Effluent	PV1-100	20-Oct-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 2 Effluent	PV2-100	20-Oct-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 1 - 25%	PV1-25	28-Oct-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.0082 J	ND	ND	ND	0.0062 J	ND	0.0052 J	ND	ND	ND	ND	ND	0.0082 J	0.0084 J	ND
Filter 1 Effluent	PV1-100	28-Oct-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.0049 J	ND	ND	ND	ND	ND	0.0078 J	0.0081 J	ND
Filter 2 Effluent	PV2-100	28-Oct-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.0040 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 1 - 25%	PV1-25	10-Nov-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 1 Effluent	PV2-100	10-Nov-16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Filter 1 - 25%	PV1-25	28-Nov-16	Collected, awaiting results																								
Filter 1 Effluent	PV2-100	28-Nov-16	Collected, awaiting results																								

Notes:  
 Grey text indicates the parameter was not analyzed or not detected.  
 All concentrations in µg/L - micrograms per liter  
 All values in micrograms per liter  
 D - duplicate sample  
 J - The result is an estimated value.  
 B - Detected in Blank.  
 Q - The analyte is both B qualified because of blank detection and J qualified because of an additional QC issue.

USEPA - Environmental Protection Agency  
 NA - Not Analysed or Not Applicable  
 µg/L - micrograms per liter  
 ND - Not detected  
 HA - Health Advisory screening value (EPA 2016)  
 — - No HA available



# Pease Tradeport Water System: PFC Monitoring, Treatment Demonstration Project and Haven Well Update

Portsmouth City Council


December 5, 2016

Brian Goetz – Deputy Director of Public Works

Al Pratt – Water Resources Manager

# Pease Tradeport Water System


- 3 Wells
- 2 Storage Tanks
- Booster from Portsmouth to Pease
- 30 Miles of water main
- 0.4 to 1.0 Million Gallons per Day Usage

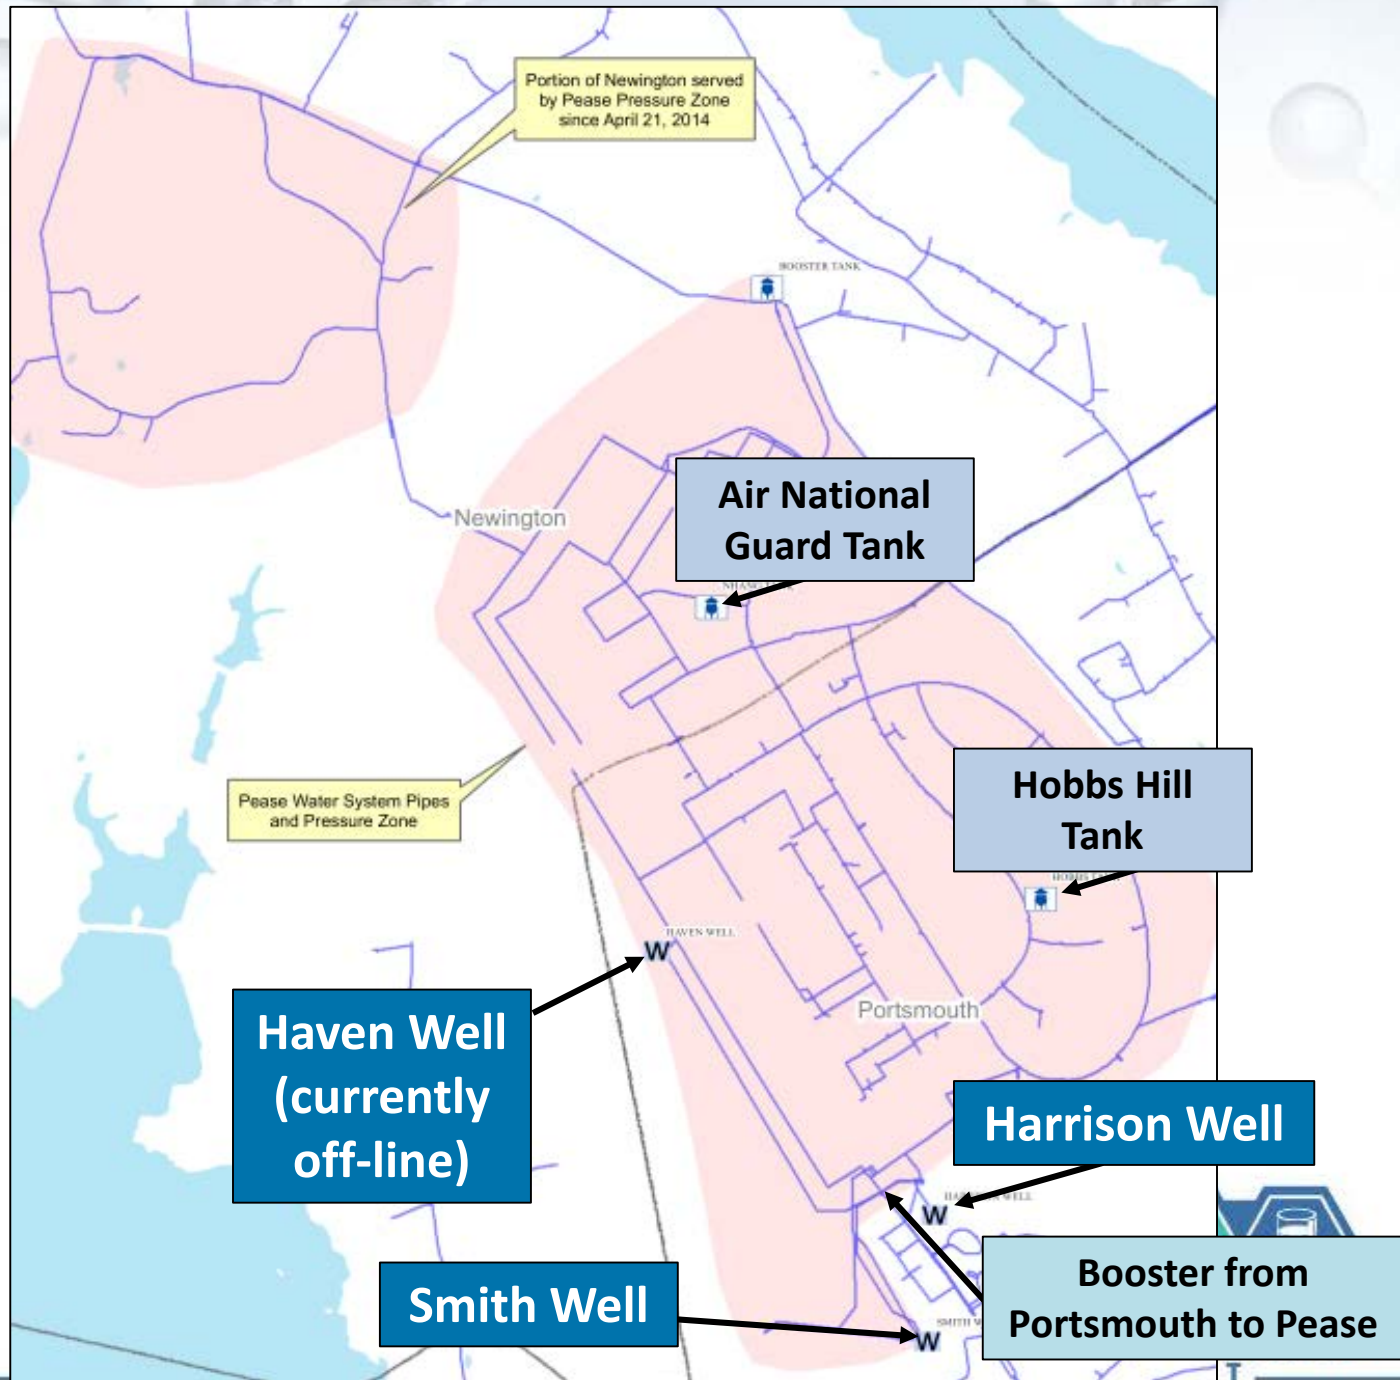

# Haven Well Shutdown: Chronology of Events

- April 2014 – City Contacted by EPA regarding their request that Air Force sample the Pease Wells for PFCs
- Air Force Consultant sampled all three Pease wells in mid-April 2014 for PFCs
- May 12, 2014 – City staff are notified that PFC levels in Haven Well exceeded the EPA's Health Advisory Standard for PFOS
  - 2.5 ug/L (Preliminary Health Advisory = 0.2 ug/L)
- May 12, 2014 - Haven Well is shut down
- Since May 12, 2014 - Pease water system is supplemented with water from Portsmouth's water system (50% of demand supplied by Portsmouth)
- Ongoing Monitoring of PFCs by the Air Force's consultant
- Ongoing technical work both by Air Force and City staff/consultants
- September 2016 – Activated Carbon Filters Installed to Treat Harrison and Smith Wells

# Regulatory Advisory Update – May 2016

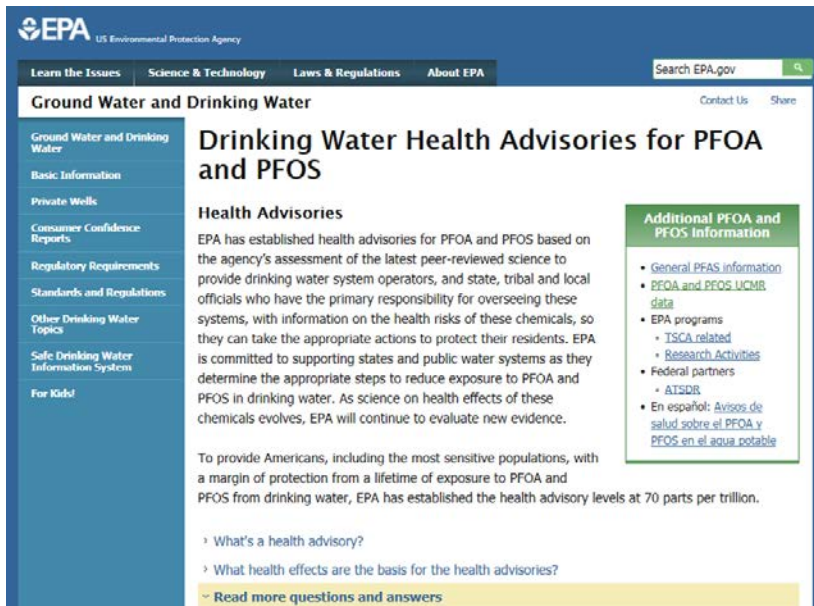

The screenshot shows the EPA website page for 'Drinking Water Health Advisories for PFOA and PFOS'. The page is titled 'Ground Water and Drinking Water' and includes a search bar for 'EPA.gov'. The main content area is titled 'Drinking Water Health Advisories for PFOA and PFOS' and contains the following text:

**Health Advisories**

EPA has established health advisories for PFOA and PFOS based on the agency's assessment of the latest peer-reviewed science to provide drinking water system operators, and state, tribal and local officials who have the primary responsibility for overseeing these systems, with information on the health risks of these chemicals, so they can take the appropriate actions to protect their residents. EPA is committed to supporting states and public water systems as they determine the appropriate steps to reduce exposure to PFOA and PFOS in drinking water. As science on health effects of these chemicals evolves, EPA will continue to evaluate new evidence.

To provide Americans, including the most sensitive populations, with a margin of protection from a lifetime of exposure to PFOA and PFOS from drinking water, EPA has established the health advisory levels at 70 parts per trillion.

› What's a health advisory?  
› What health effects are the basis for the health advisories?  
~ Read more questions and answers


Additional PFOA and PFOS Information

- [General PFAS information](#)
- [PFOA and PFOS LCMR data](#)
- EPA programs
  - [TSCA related](#)
  - [Research Activities](#)
- Federal partners
  - [ATSDR](#)
- En español: [Avisos de salud sobre el PFOA y PFOS en el agua potable](#)

- “To provide Americans, including the most sensitive populations, with a margin of protection from a lifetime of exposure to PFOA and PFOS from drinking water, EPA has established the health advisory levels at 70 parts per trillion.”
- “EPA’s health advisory level for PFOA and PFOS offers a margin of protection for all Americans throughout their life from adverse health effects resulting from exposure to PFOA and PFOS in drinking water.”
- “These health advisories are specifically for PFOA and PFOS and do not apply to other perfluoroalkyl substances (PFASs). The Agency is continuing to gather information about other PFAS.”



# PFC Monitoring Locations

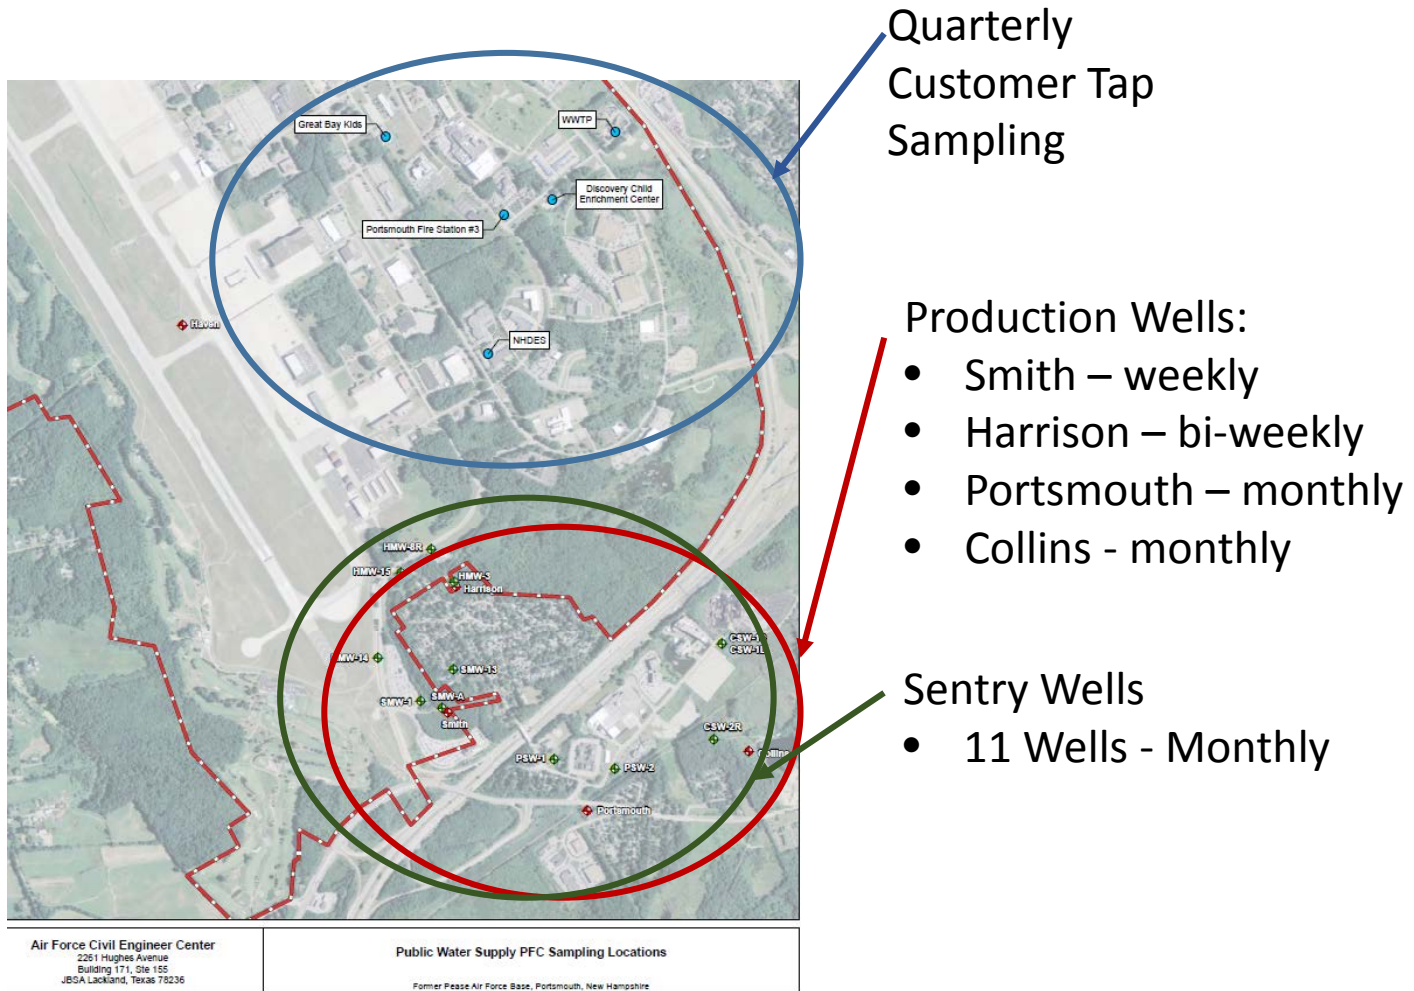

“No increasing trends identified”

– AMEC (Air Force) November 16, 2016 Update



# Well Treatment – Carbon Filters

- Preliminary Design – Complete
- Piloting – performed in summer 2016
- Demonstration filters for Harrison and Smith Wells – on line September 2016
- Design of treatment system upgrades for all three wells (8 to 12 months) – pending next agreement with Air Force
- Construction start - anticipated in late 2017

# Harrison/Smith Well Filters



# Mailer to all Pease Customers:

City of  
Portsmouth  
*Department of Public Works*



September 8, 2016

## TREATMENT PLAN FOR PEASE TRADEPORT WATER SUPPLY

Following the detection of levels above the preliminary health advisory for perfluorinated hydrocarbons (PFCs) in the Haven Well and its subsequent shut down in May 2014, the City of Portsmouth and the United States Air Force established a water treatment plan for the operating Harrison and Smith Wells that will also guide the treatment of the Haven Well, the three wells that supply water to the Pease Tradeport water supply system. Through an agreement with the United States Air Force, the City is has been moving forward with the installation of two 20,000 lb. granular activated carbon vessels (GACs) to filter and remove PFCs from the Harrison and Smith Wells at the existing Grafton Road water facility. This installation will ensure effective technology is in place to properly treat the PFCs and enhance the overall performance of our water system.



This work follows an initial pilot study that was completed in June 2016. Pilot testing results indicated that the GAC filter media will remove PFCs without significant pressure, build up or fouling in the media. General chemistry results also indicated acceptable levels for pH and alkalinity with no anticipated disruption to the existing water distribution system. Frequent sampling, filter monitoring and operational requirements from the Harrison and Smith Wells' demonstration project will be evaluated for the first six months of operation. Information from both the pilot and the demonstration study will then be used by the City's consultant to revise the final design parameters for treatment of the Haven Well.

Startup of the carbon filter system for the Harrison and Smith Wells is anticipated in late September or early October 2016. Final data and design plans for the Haven treatment system

1

are planned for Spring 2017 with construction of this system anticipated to commence in the Fall of 2017. The Haven Well design will also include contingency planning and treatment system retrofits to treat other contaminants if necessary.

### TREATMENT SYSTEM COMPONENTS AND OPERATION

The filtration system for the demonstration will consist of GAC as a filter media. Calgon pressure vessels will be filled with Filtrasorb 400™, which has been used effectively to treat PFCs in drinking water systems in Minnesota, Maryland and other states. Similar to the pilot study, filter vessels for the demonstration project will be placed in series. Groundwater will be pumped through a primary filter (lead), while a second filter (lag) will provide additional filtration capacity to ensure effective removal of PFCs if any pass through the lead filter. Water quality will be monitored before, between and after the filters to evaluate media life. The use of a lead/lag arrangement allows the GAC to be replaced in the lead filter when adsorptive capacities are fully utilized and PFC removal effectiveness has diminished. This dual filtration design provides redundancy and safety for finished water from the plant.



### ONGOING WATER QUALITY MONITORING

The Air Force's consultant has been performing frequent routine sampling of the water supply wells in the Pease water system since May 2014. The Smith Well has been sampled weekly for PFCs and the Harrison Well sampled every two weeks. In addition to these water supply wells, the Air Force's consultant samples other monitoring wells in the surrounding area to track the aquifer and monitor for any PFCs moving toward the supply wells.

The EPA recently issued new health advisories of 0.070 µg/L (micrograms per liter) for Perfluorooctanoic Acid (PFOA) and Perfluorooctane Sulfonate (PFOS). The Smith and Harrison wells that supply the Pease Tradeport Water System have combined levels PFOA and PFOS that have consistently been below this limit since sampling began in 2014. The most recent samples of tap water in the Pease water system in two locations both had combined levels of PFCs of 0.018 ug/L. Once the City receives the validated results for these wells, plus quarterly sampling in the distribution system, the data is updated and posted on the City's website.

Additional information can be accessed at:

<http://www.cityofportsmouth.com/publicworks/phwn.html>

Or by calling Al Pratt, Water Resources Manager, at 520-0622

2

# Filter performance

- Sampling for PFCs utilizing the same method and laboratory as the Air Force's sampling (Maxxam lab)
- Six rounds of sampling since September 22, 2016
  - PFOS – ND “Non Detect”
  - PFOA – ND
  - A few intermittent “J” estimated compounds detected in some samples but they come and go
- Other water quality parameters are being sampled for consideration in final design of new treatment system

- Well sample results and information posted on City website
- Treatment Demonstration sample results will be posted after this presentation



Department of Public Works, 680 Peverly Hill Rd, Portsmouth, NH 03801 Phone: (603) 427-1530, Fax: (603) 427-1539 | Contact

### Pease Tradeport Water Information

#### Pease International Tradeport Water System Update

The City of Portsmouth's Water Division has been actively working with the United States Air Force (Air Force), the United States Environmental Protection Agency (EPA), and the New Hampshire Department of Environmental Services (DES) in response to the detection of elevated levels of the unregulated contaminant perfluorooctane sulfonic acid (PFOS) from the Haven Well, one of three wells that serves the Pease International Tradeport and the New Hampshire Air National Guard base at Pease. PFOS is one of a class of chemicals known as PFCs or perfluorochemicals. Because the level of PFOS exceeded the "provisional health advisory" set by the EPA, the well was shut down by the City of Portsmouth on May 12, 2014 and since that time it has been physically disconnected from the system. A number of actions have been taken by the project team. The following documents provide additional information:

- [Drinking Water Health Advisories](#)
- [Portsmouth announces upgraded water filtration at Pease Tradeport](#)
- [Pease Water Supply Update 09 08 16](#)
- [Pease Water Treatment System and Piloting Overview RAB Tour 07.14.16](#)
- [Pease Water Supply Update 06 30 16](#)
- [Portsmouth Signs Agreement with Air Force to Proceed with Pease Tradeport Well Treatment System Project](#)
- [Haven Well Update to City Council March 12 2016](#)
- [Pease Trade Port Water System Overview and History](#)
- [Pease Water System Operations Update 03.31.15](#)
- [Pease Water Supply Update 08/13/14](#)

#### Pease well monitoring and sampling results: :

The Air Force's consultants under the direction of the EPA and DES and in cooperation with the City of Portsmouth have been sampling PFCs in and around the affected Portsmouth drinking water wells. Once validated, this data is posted below:

- [Pease Well PFC Results Most Recent 11 21 2016](#)
- [Pease Well PFC Results Most Recent 10 19 2016](#)
- [Pease Well PFC Results thru 10 19 2016](#)



# Looking Ahead:

- Continued sampling and assessment of Harrison/Smith filter performance
- Design and construction of final treatment system for all three wells - Harrison, Smith and Haven
- Determine operating parameters for treatment system filter media changeouts
- Continued monitoring of PFCs
- Aquifer mitigation work (Air Force project)
- Public Outreach

# Questions?

